



NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION
State Pollutant Discharge Elimination System (SPDES)
DISCHARGE PERMIT

Industrial Code: 4941
 Discharge Class (CL): 01
 Toxic Class (TX): T
 Major Drainage Basin: 13
 Sub Drainage Basin: 01
 Water Index Number: H
 Compact Area: IEC

SPDES Number: **NY 0280364**
 DEC Number: **3-1326 00275/00004**
 Effective Date (EDP): **EDP**
 Expiration Date (ExDP): **ExDP**
 Modification Dates:(EDPM)

This SPDES permit is issued in compliance with Title 8 of Article 17 of the Environmental Conservation Law of New York State and in compliance with the Clean Water Act, as amended, (33 U.S.C. §1251 et.seq.)(hereinafter referred to as "the Act").

PERMITTEE NAME AND ADDRESS

Name: United Water New York Inc. Attention: Sameet Master, P.E.
 Street: 360 West Nyack Road
 City: West Nyack State: NY Zip Code: 10994

is authorized to discharge from the facility described below:

FACILITY NAME AND ADDRESS

Name: UWNH Haverstraw Water Supply Project
 Location (C,T,V): Haverstraw (T) County: Rockland
 Facility Address: 555-571 Beach Road
 City: Haverstraw State: NY Zip Code: 10927
 NYTM -E: NYTM - N:
 From Outfall No.: 01A at Latitude: ° ' " & Longitude: ° ' " Class: SB
 into receiving waters known as: Hudson River

and; (list other Outfalls, Receiving Waters & Water Classifications)

in accordance with: effluent limitations; monitoring and reporting requirements; other provisions and conditions set forth in this permit; and 6 NYCRR Part 750-1.2(a) and 750-2.

DISCHARGE MONITORING REPORT (DMR) MAILING ADDRESS

Mailing Name: United Water New York Inc.
 Street: 360 West Nyack Road
 City: West Nyack State: NY Zip Code: 10994
 Responsible Official or Agent: Michael Pointing, V.P. & General Manager Phone: (845) 620-3312

This permit and the authorization to discharge shall expire on midnight of the expiration date shown above and the permittee shall not discharge after the expiration date unless this permit has been renewed, or extended pursuant to law. To be authorized to discharge beyond the expiration date, the permittee shall apply for permit renewal not less than 180 days prior to the expiration date shown above.

DISTRIBUTION:

C.O. BWP – Permit Coordinator
 RWE/RPA
 EPA Region II - Michelle Josilo
 IEC

Permit Administrator:	
Address: 625 Broadway Albany, NY 12233-1750	
Signature:	Date: / /

PERMIT LIMITS, LEVELS AND MONITORING DEFINITIONS

OUTFALL	WASTEWATER TYPE	RECEIVING WATER	EFFECTIVE	EXPIRING		
	This cell describes the type of wastewater authorized for discharge. Examples include process or sanitary wastewater, storm water, non-contact cooling water.	This cell lists classified waters of the state to which the listed outfall discharges.	The date this page starts in effect. (e.g. EDP or EDPM)	The date this page is no longer in effect. (e.g. ExDP)		
PARAMETER	MINIMUM	MAXIMUM	UNITS	SAMPLE FREQ.	SAMPLE TYPE	
e.g. pH, TRC, Temperature, D.O.	The minimum level that must be maintained at all instants in time.	The maximum level that may not be exceeded at any instant in time.	SU, °F, mg/l, etc.			
PARA-METER	EFFLUENT LIMIT	MINIMUM LEVEL (ML)	ACTION LEVEL	UNITS	SAMPLE FREQUENCY	SAMPLE TYPE
	Limit types are defined below in Note 1. The effluent limit is developed based on the more stringent of technology-based limits, required under the Clean Water Act, or New York State water quality standards. The limit has been derived based on existing assumptions and rules. These assumptions include receiving water hardness, pH and temperature; and rates of this and other discharges to the receiving stream; etc. If assumptions or rules change the limit may, after due process and modification of this permit, change.	For the purposes of compliance assessment, the analytical method specified in the permit shall be used to monitor the amount of the pollutant in the outfall to this level, provided that the laboratory analyst has complied with the specified quality assurance/quality control procedures in the relevant method. Monitoring results that are lower than this level must be reported, but shall not be used to determine compliance with the calculated limit. This ML can be neither lowered nor raised without a modification of this permit.	Action Levels are monitoring requirements, as defined below in Note 2, that trigger additional monitoring and permit review when exceeded.	This can include units of flow, pH, mass, Temperature, concentration. Examples include µg/l, lbs/d, etc.	Examples include Daily, 3/week, weekly, 2/month, monthly, quarterly, 2/yr and yearly.	Examples include grab, 24 hour composite and 3 grab samples collected over a 6 hour period.

Note 1: DAILY DISCHARGE.: The discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for the purposes of sampling. For pollutants expressed in units of mass, the ‘daily discharge’ is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the ‘daily discharge’ is calculated as the average measurement of the pollutant over the day.

DAILY MAX.: The highest allowable daily discharge. **DAILY MIN.:** The lowest allowable daily discharge.

MONTHLY AVG: The highest allowable average of daily discharges over a calendar month, calculated as the sum of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

7 DAY ARITHMETIC MEAN (7 day average): The highest allowable average of daily discharges over a calendar week.

30 DAY GEOMETRIC MEAN: The highest allowable geometric mean of daily discharges over a calendar month, calculated as the antilog of : the sum of the log of each of the daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

7 DAY GEOMETRIC MEAN: The highest allowable geometric mean of daily discharges over a calendar week.

RANGE: The minimum and maximum instantaneous measurements for the reporting period must remain between the two values shown.

Note 2: ACTION LEVELS: Routine Action Level monitoring results, if not provided for on the Discharge Monitoring Report (DMR) form, shall be appended to the DMR for the period during which the sampling was conducted. If the additional monitoring requirement is triggered as noted below, the permittee shall undertake a short-term, high-intensity monitoring program for the parameter(s). Samples identical to those required for routine monitoring purposes shall be taken on each of at least three consecutive operating and discharging days and analyzed. Results shall be expressed in terms of both concentration and mass, and shall be submitted no later than the end of the third month following the month when the additional monitoring requirement was triggered. Results may be appended to the DMR or transmitted under separate cover to the same address. If levels higher than the Action Levels are confirmed, the permit may be reopened by the Department for consideration of revised Action Levels or effluent limits. The permittee is not authorized to discharge any of the listed parameters at levels which may cause or contribute to a violation of water quality standards.

SPECIAL CONDITIONS

1. **Water Intakes** - The permittee shall install, maintain and operate an intake structure equipped with a ½ mm slot width cylindrical-shaped wedge-wire screens to minimize potential adverse effects to aquatic resources related to potential impingement (in which aquatic resources are pulled against the screen) or entrainment (in which they are drawn into the intake) with a maximum through slot velocity of 0.5 feet per second..
2. **Shared Outfall and Diffuser** – The calculated dilution/mixing zone for the diffuser system associated with this discharge is based upon the design flow from the Haverstraw Joint Regional Sewage Treatment Plant. If at some future time, the flow from the Haverstraw Joint Regional Sewage Treatment Plant was discontinued, the Permittee shall reevaluate the dilution/mixing calculations through the diffuser system without the Haverstraw Joint Regional Sewage Treatment Plant discharge and submit a permit modification request to address any changes in applicable limits or action levels. This evaluation and request must be received at least 6 months prior to the actual discontinuation of that discharge.

SPECIAL CONDITIONS - INDUSTRY BEST MANAGEMENT PRACTICES

1. **General** - The permittee shall develop, maintain, and implement a Best Management Practices (BMP) plan to prevent releases of significant amounts of pollutants to the waters of the State through plant site runoff; spillage and leaks; sludge or waste disposal; and stormwater discharges including, but not limited to, drainage from raw material storage.

The BMP plan shall be documented in narrative form and shall include the 13 minimum BMPs and any necessary plot plans, drawings, or maps. Other documents already prepared for the facility such as a Safety Manual or a Spill Prevention, Control and Countermeasure (SPCC) plan may be used as part of the plan and may be incorporated by reference. A copy of the current BMP plan shall be submitted to the Department as required in item (2.) below and a copy must be maintained at the facility and shall be available to authorized Department representatives upon request.

2. **Compliance Deadlines** - The initial completed BMP plan shall be submitted **WITHIN 6 MONTHS OF EDP** to the Regional Water Engineer. The BMP plan shall be implemented within 6 months of submission. The BMP plan shall be reviewed annually and shall be modified whenever (a) changes at the facility materially increase the potential for releases of pollutants; (b) actual releases indicate the plan is inadequate, or (c) a letter from the Department identifies inadequacies in the plan. The permittee shall certify in writing, as an attachment to the December Discharge Monitoring Report (DMR), that the annual review has been completed. All BMP plan revisions (with the exception of SWPPPs - see item (4.B.) below) must be submitted to the Regional Water Engineer within 30 days. Note that the permittee is not required to obtain Department approval of the BMP plan (or of any SWPPPs) unless notified otherwise. Subsequent modifications to or renewal of this permit does not reset or revise these deadlines unless a new deadline is set explicitly by such permit modification or renewal.
3. **Facility Review** - The permittee shall review all facility components or systems (including but not limited to material storage areas; in-plant transfer, process, and material handling areas; loading and unloading operations; storm water, erosion, and sediment control measures; process emergency control systems; and sludge and waste disposal areas) where materials or pollutants are used, manufactured, stored or handled to evaluate the potential for the release of pollutants to the waters of the State. In performing such an evaluation, the permittee shall consider such factors as the probability of equipment failure or improper operation, cross-contamination of storm water by process materials, settlement of facility air emissions, the effects of natural phenomena such as freezing temperatures and precipitation, fires, and the facility's history of spills and leaks. The relative toxicity of the pollutant shall be considered in determining the significance of potential releases.

4. **13 BMPs** - Whenever the potential for a release of pollutants to State waters is determined to be present, the permittee shall identify BMPs that have been established to prevent or minimize such potential releases. Where BMPs are inadequate or absent, appropriate BMPs shall be established. In selecting appropriate BMPs, the permittee shall consider good industry practices and, where appropriate, structural measures such as secondary containment and erosion/sediment control devices and practices. USEPA guidance for development of stormwater elements of the BMP is available in the September 1992 manual *Storm Water Management for Industrial Activities*, EPA 832-R-92-006 (available from NTIS, (703) 487-4650, order # PB 92235969). The BMPs are listed below:

- | | | |
|-------------------------------------|---|---------------------------------|
| 1. BMP Pollution Prevention Team | 6. Security | 10. Spill Prevention & Response |
| 2. Reporting of BMP Incidents | 7. Preventive Maintenance | 11. Erosion & Sediment Control |
| 3. Risk Identification & Assessment | 8. Good Housekeeping | 12. Management of Runoff |
| 4. Employee Training | 9. Materials/Waste Handling, Storage, & Compatibility | 13. Street Sweeping |
| 5. Inspections and Records | | |

Note that for some facilities, especially those with few employees, some of the above BMPs may not be applicable. It is acceptable in these cases to indicate "Not Applicable" for the portion(s) of the BMP Plan that do not apply to your facility, along with an explanation.

B. Stormwater Pollution Prevention Plans (SWPPPs) Required for Discharges of Stormwater From Construction

Activity to Surface Waters - As part of BMP #11, a SWPPP shall be developed prior to the initiation of any site disturbance of one acre or more of uncontaminated area. Uncontaminated area means soils or groundwater which are free of contamination by any toxic or non-conventional pollutants identified in Tables 6-10 of SPDES application Form NY-2C. Disturbance of any size contaminated area(s) and the resulting discharge of contaminated stormwater is not authorized by this permit unless the discharge is under State or Federal oversight as part of a remedial program or after review by the Regional Water Engineer; nor is such discharge authorized by any SPDES general permit for stormwater discharges. SWPPPs are not required for discharges of stormwater from construction activity to groundwaters.

The SWPPP shall conform to the *New York Standards and Specifications for Erosion and Sediment Control* and *New York State Stormwater Management Design Manual*, unless a variance has been obtained from the Regional Water Engineer, and to any local requirements. The permittee shall submit a copy of the SWPPP and any amendments thereto to the local governing body and any other authorized agency having jurisdiction or regulatory control over the construction activity **at least 30 days prior to soil disturbance**. The SWPPP shall also be submitted to the Regional Water Engineer if contamination, as defined above, is involved and the permittee must obtain a determination of any SPDES permit modifications and/or additional treatment which may be required prior to soil disturbance. Otherwise, the SWPPP shall be submitted to the Department only upon request. When a SWPPP is required, a properly completed *Notice of Intent* (NOI) form shall be submitted (available at www.dec.ny.gov/chemical/43133.html) prior to soil disturbance. Note that submission of a NOI is required for informational purposes; the permittee is not eligible for and will not obtain coverage under any SPDES general permit for stormwater discharges, nor are any additional permit fees incurred. SWPPPs must be developed and submitted for subsequent site disturbances in accordance with the above requirements. The permittee is responsible for ensuring that the provisions of each SWPPP are properly implemented.

SCHEDULE OF COMPLIANCE

a) The permittee shall comply with the following schedule:

Outfall Number(s)	Compliance Action	Due Date
01A	The permittee shall conduct quarterly sampling of the RO concentrate discharge during the 1 st year of operation. Samples must be analyzed for conventional parameters that are not already required by the SPDES permit (i.e., Oil & Grease, Total Organic Nitrogen, Ammonia (N), Nitrate, Nitrite, Total Phosphorus, Flow Rate, Temperature, Hardness (as CaCO ₃), Fecal Coliform and Total Coliform), 126 priority pollutants and PCBs. Mercury analysis must be performed using EPA Method 1631. Other metals shall be analyzed using EPA Method 200.7. Analysis shall be for the "Total" form of metals. PCB analysis shall report individual species plus the sum total concentration. Sampling results shall be submitted to the Regional Water Engineer and the NYSDEC, Bureau of Water Permits in Albany at the addresses provided on page 9 of this permit. The permittee shall submit the results of the analyses along with the daily flow. Following evaluation of the results, the Department may reopen the permit to add additional limits or action levels for these parameters.	Upon Completion of Construction and Start-up + 15 months

The above compliance actions are one time requirements. The permittee shall comply with the above compliance actions to the Department's satisfaction once. When this permit is administratively renewed by NYSDEC letter entitled "SPDES NOTICE/RENEWAL APPLICATION/PERMIT," the permittee is not required to repeat the submission(s) noted above. The above due dates are independent from the effective date of the permit stated in the letter of "SPDES NOTICE/RENEWAL APPLICATION/PERMIT."

- b) The permittee shall submit a written notice of compliance or non-compliance with each of the above schedule dates no later than 14 days following each elapsed date, unless conditions require more immediate notice as prescribed in 6 NYCRR Part 750-1.2(a) and 750-2. All such compliance or non-compliance notification shall be sent to the locations listed under the section of this permit entitled RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS. Each notice of non-compliance shall include the following information:
1. A short description of the non-compliance;
 2. A description of any actions taken or proposed by the permittee to comply with the elapsed schedule requirements without further delay and to limit environmental impact associated with the non-compliance;
 3. A description or any factors which tend to explain or mitigate the non-compliance; and
 4. An estimate of the date the permittee will comply with the elapsed schedule requirement and an assessment of the probability that the permittee will meet the next scheduled requirement on time.
- c) The permittee shall submit copies of any document required by the above schedule of compliance to NYSDEC Regional Water Engineer at the location listed under the section of this permit entitled RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS and to the Bureau of Water Permits, 625 Broadway, Albany, N.Y. 12233-3505, unless otherwise specified in this permit or in writing by the Department.

WATER TREATMENT CHEMICAL (WTC) REQUIREMENTS

New or increased use of a WTC requires prior DEC review and authorization. At a minimum, the permittee must notify the DEC in writing of its intent to change WTC use by submitting a completed WTCFX Form for each WTC. The DEC will review that submittal and determine if a SPDES permit modification is necessary or whether WTC review and authorization may proceed outside of the formal permit administrative process. **The majority of WTC authorizations do not require formal SPDES permit modification.** WTCs which are used in closed systems and cannot be discharged or those which are discharged to municipal STP do not require DEC review. **WTC use and discharge questions or requests for forms** should be directed to the DEC staff person who developed your SPDES permit. If you are not sure who that is, contact the DEC staff person who last inspected your facility.

Examples of WTCs include biocides, coagulants, conditioners, corrosion inhibitors, defoamers, flocculants, scale inhibitors, sequestrants, and settling aids. DEC staff may also direct you to use a WTCFX Form for review and authorization of substances other than WTCs, e.g. process chemicals.


The permittee must demonstrate that the use and discharge of any WTCs containing **phosphorus**, tributary to the Great Lakes Basin or other ponded waters, is necessary and that no acceptable alternatives exist. Please note that in some cases your permit may require modification to regulate phosphorus.

Generic WTC Usage Requirements

- (b) WTC use shall not exceed the rate reported by the permittee or authorized below, whichever is less.
- (c) The discharge shall not cause or contribute to a violation of water quality or an exceedance of ambient water quality criteria.
- (d) **The permittee must maintain a logbook** of all WTC use, noting for each WTC the date, time, exact location, and amount of each dosage, and, the name of the individual applying or measuring the chemical. The logbook must also document that adequate process controls are in place to ensure that excessive levels of WTCs are not used and subsequently discharged through outfalls. The permittee shall retain the logbook data for a period of at least 5 years. This period may be extended by request of the DEC.
- (e) **The permittee shall provide an annual report**, attached to the December DMR, containing the following information for each outfall: the current list of WTCs authorized for use and discharge by the DEC, for each WTC the amount in pounds used during the year, identification of authorized WTCs the permittee no longer uses, and any other pertinent information.

MONITORING LOCATIONS

The permittee shall take samples and measurements, to comply with the monitoring requirements specified in this permit, at the location(s) specified below:

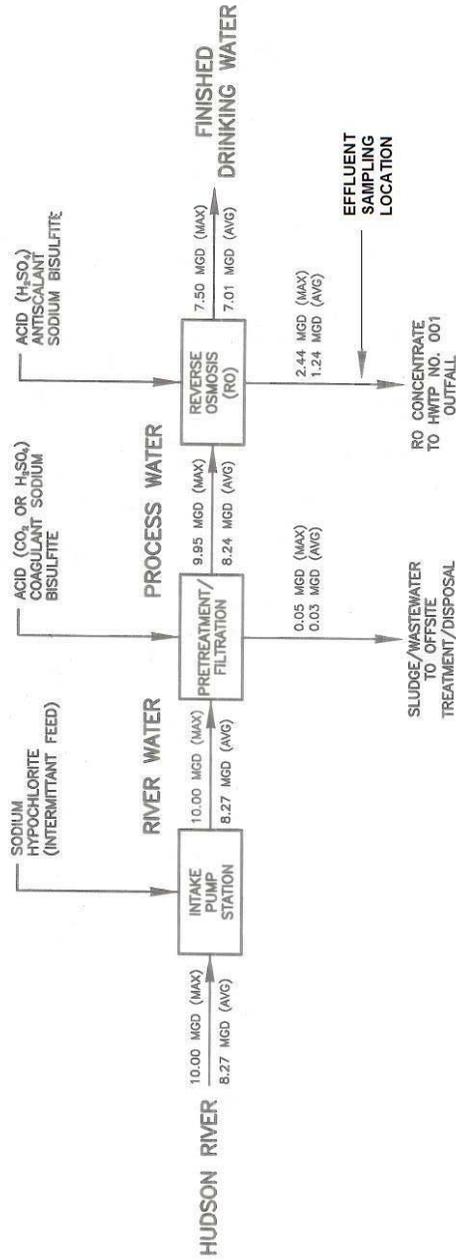

NOTES:

1. FLOW RATES ARE DAILY VALUES.
2. FLOW RATES ARE BASED UPON PHASE 3 FULL BUILDOUT CAPACITY.

RECORDING, REPORTING AND ADDITIONAL MONITORING REQUIREMENTS

- a) The permittee shall also comply with 6 NYCRR Part 750 concerning additional monitoring and reporting requirements and conditions, including noncompliance reporting.
- b) In addition to a) above, all **POTWs** shall provide adequate notice to the Department and USEPA of the following: (1) Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA if it were directly discharging those pollutants; and (2) Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit. (3) For purposes of this paragraph, adequate notice shall include information on (i) the quality and quantity of effluent introduced into the POTW, and (ii) any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.
- c) The monitoring information required by this permit shall be summarized, signed and retained for a period of at least five years from the date of the sampling for subsequent inspection by the Department or its designated agent. **Also, monitoring information required by this permit shall be summarized and reported by submitting;**

(if box is checked) completed and signed Discharge Monitoring Report (DMR) forms for each ____ month reporting period to the locations specified below. Blank forms are available at the Department's Albany office listed below. The first reporting period begins on the effective date of this permit and the reports will be due no later than the 28th day of the month following the end of each reporting period.

(if box is checked) an annual report to the Regional Water Engineer at the address specified below. The annual report is due by February 1 each year and must summarize information for January to December of the previous year in a format acceptable to the Department.

(if box is checked) a monthly "Wastewater Facility Operation Report..." (form 92-15-7) to the:

Regional Water Engineer and/or County Health Department or Environmental Control Agency specified below

Send the **original** (top sheet) of each DMR page to:
 Department of Environmental Conservation
 Division of Water, Bureau of Water Compliance
 625 Broadway, Albany, New York 12233-3506
 Phone: (518) 402-8177

Send the **first copy** (second sheet) of each DMR page to:
 Department of Environmental Conservation
 Regional Water Engineer, Region 3
 100 Hillside Avenue, Suite 1W
 White Plains, NY 10603-2860
 Phone: (914) 428-2505 ext. 350

Send an **additional copy** of each DMR page to:

- d) Monitoring and analysis shall be conducted according to test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in this permit.
- e) More frequent monitoring of the discharge(s), monitoring point(s), or waters of the State than required by the permit, where analysis is performed by a certified laboratory or where such analysis is not required to be performed by a certified laboratory, shall be included in the calculations and recording of the data on the corresponding DMRs.
- f) Calculations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- g) Unless otherwise specified, all information recorded on the DMRs shall be based upon measurements and sampling carried out during the most recently completed reporting period.
- h) Any laboratory test or sample analysis required by this permit for which the State Commissioner of Health issues certificates of approval pursuant to section 502 of the Public Health Law shall be conducted by a laboratory which has been issued a certificate of approval. Inquiries regarding laboratory certification should be directed to the New York State Department of Health, Environmental Laboratory Accreditation Program.