


FIGURE 6

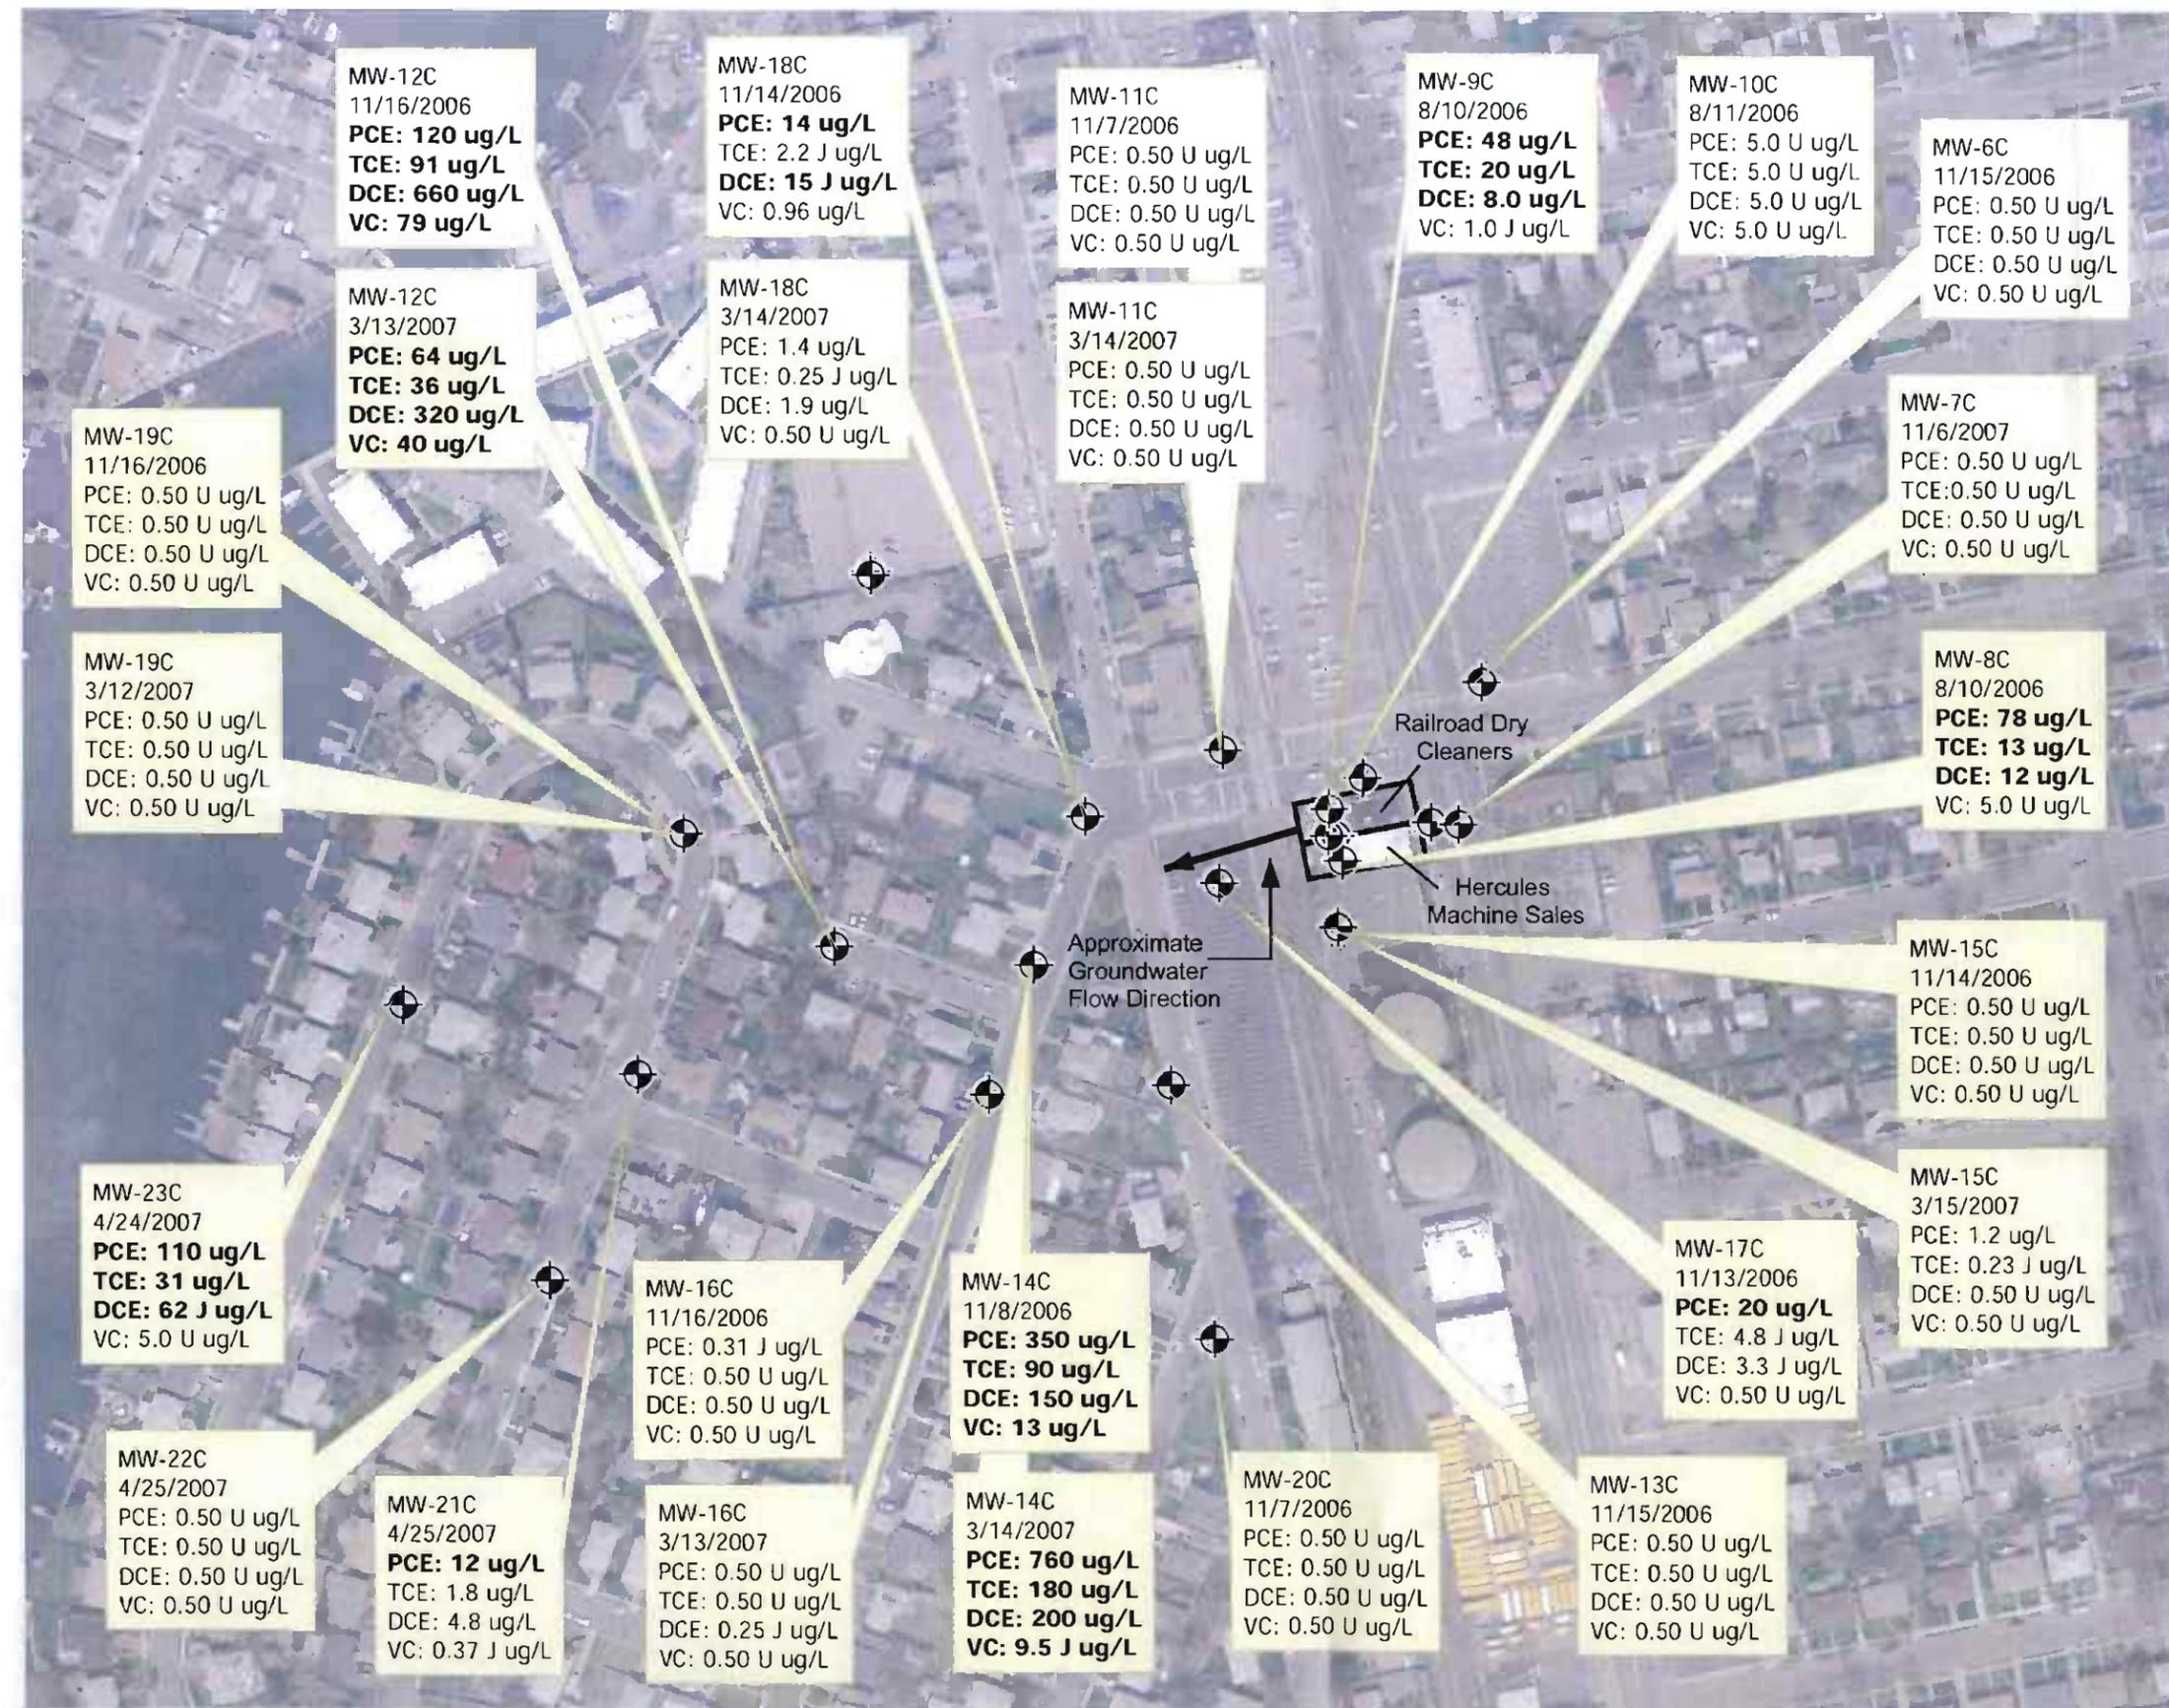


Legend

Monitoring Well Locations

Notes: PCE: Tetrachloroethene TCE: Trichloroethene DCE: cis-1,2-Dichloroethene VC: Vinyl chloride Concentrations that exceed NYS Class GA ground water standards are bolded. Micrograms per liter (ug/L) is equivalent to parts-per-billion (ppb).


HERCULES MACHINE SALES OCEANSIDE, NEW YORK

GROUND WATER COC RESULTS "C" INTERVAL SCREENED 43.4-58.6 ft bgs



September 2007 Figure 6-3\_C.mxd

FIGURE 7

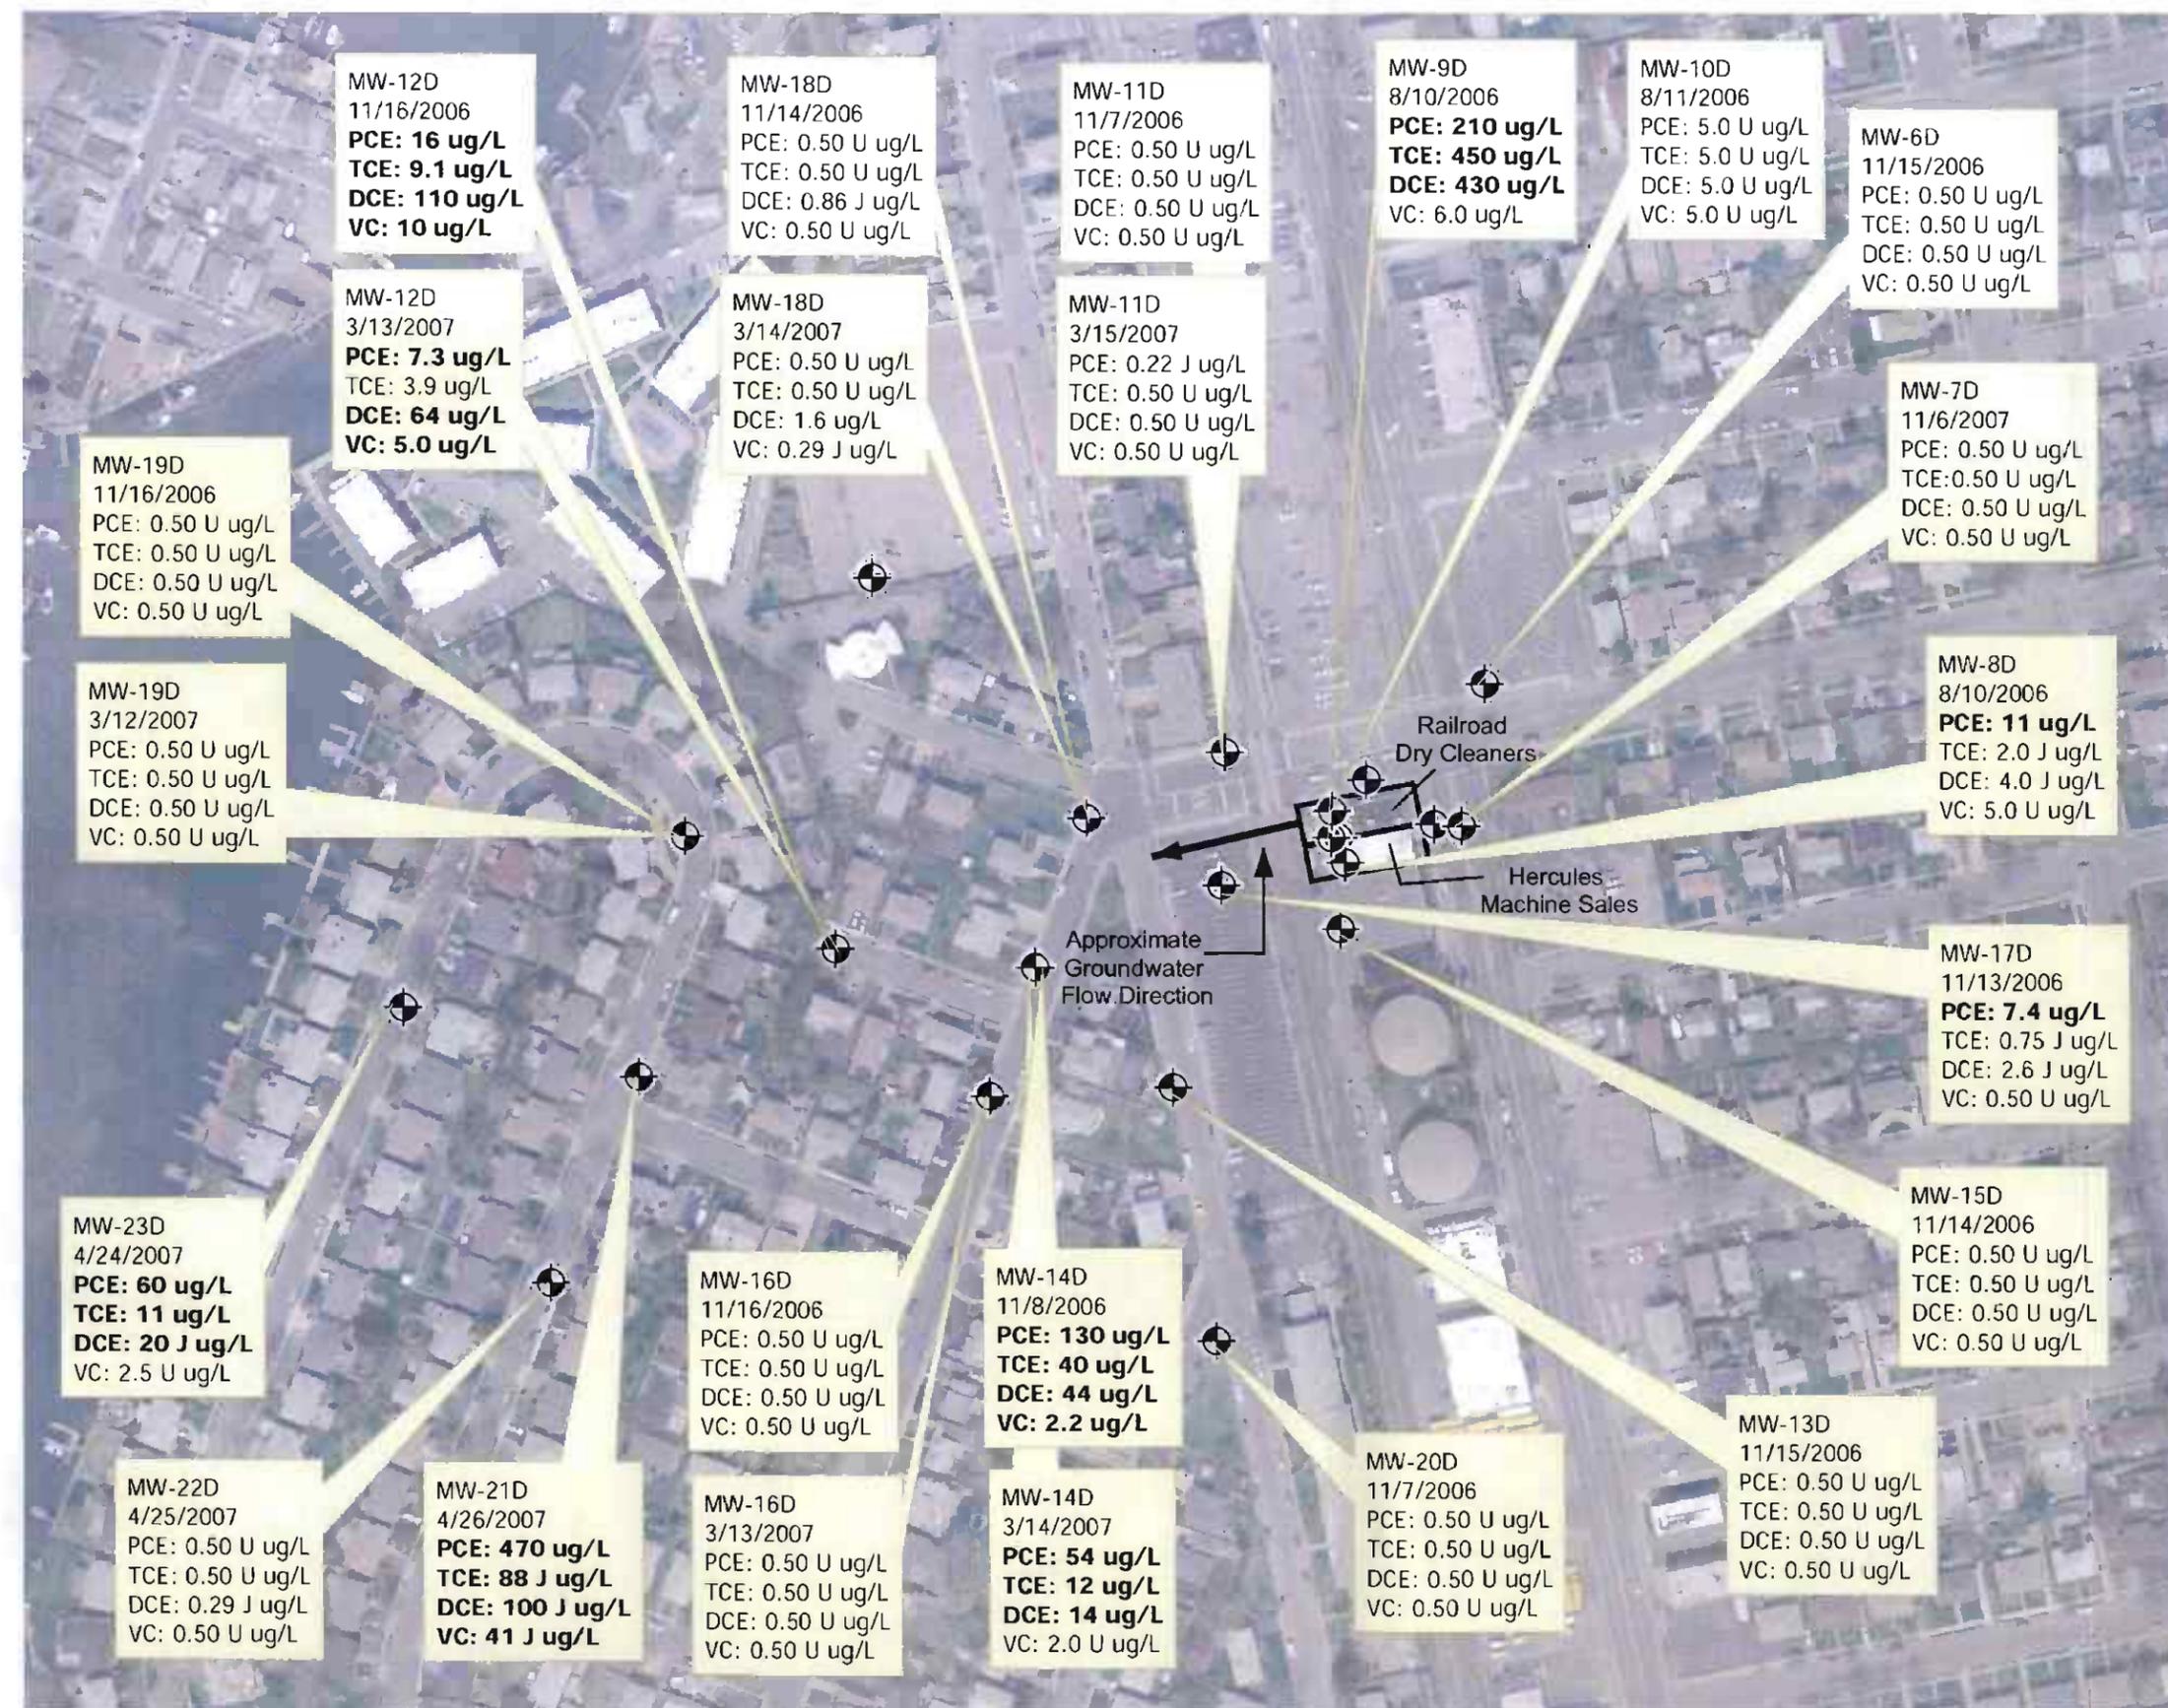

Legend

Monitoring Well Locations

Notes:

PCE: Tetrachloroethene  
 TCE: Trichloroethene  
 DCE: cis-1,2-Dichloroethene  
 VC: Vinyl chloride


Concentrations that exceed NYS  
 Class GA ground water standards  
 are bolded.

Micrograms per liter (ug/L) is  
 equivalent to parts-per-billion (ppb).

**HERCULES  
 MACHINE SALES  
 OCEANSIDE, NEW YORK**

**GROUND WATER  
 COC RESULTS  
 "D" INTERVAL  
 SCREENED 64.3-78.8  
 ft bgs**

FIGURE 8

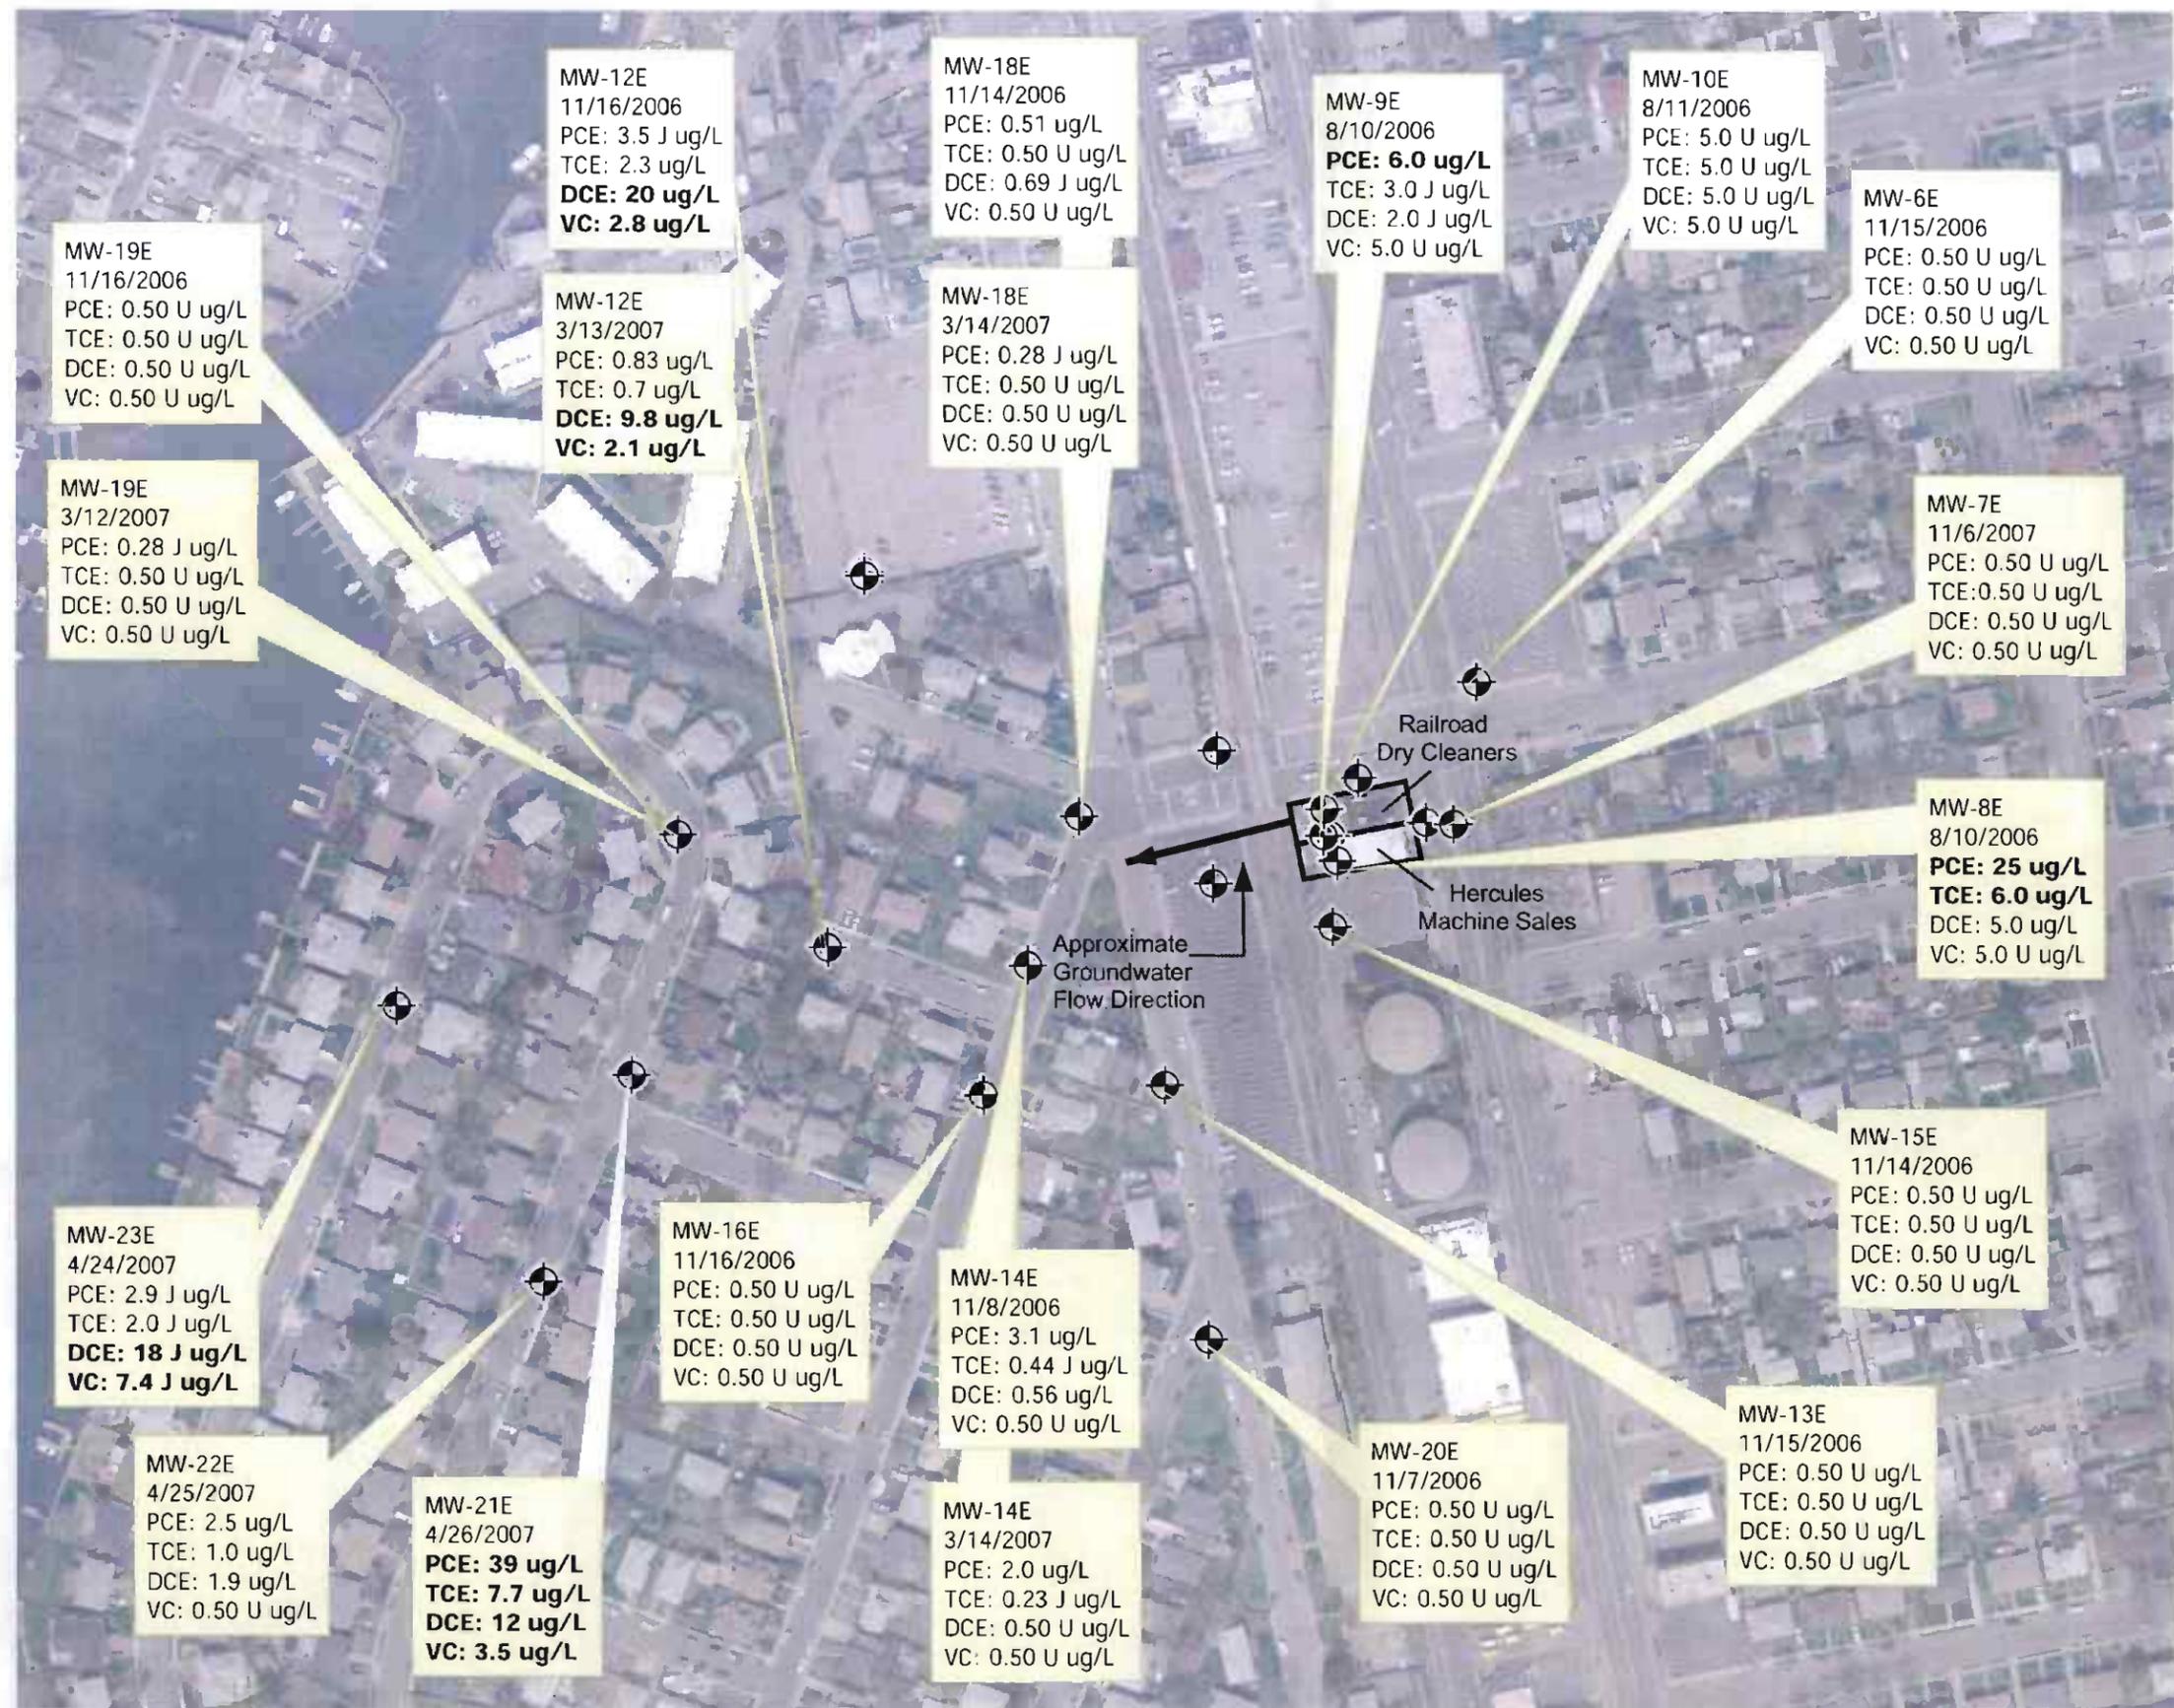

Legend

Monitoring Well Locations


Notes:  
 PCE: Tetrachloroethene  
 TCE: Trichloroethene  
 DCE: cis-1,2-Dichloroethene  
 VC: Vinyl chloride

Concentrations that exceed NYS Class GA ground water standards are bolded.

Micrograms per liter (ug/L) is equivalent to parts-per-billion (ppb).

HERCULES MACHINE SALES OCEANSIDE, NEW YORK

GROUND WATER COC RESULTS "E" INTERVAL SCREENED 83.1-99.8 ft bgs



September 2007 Figure 6-5\_E.mxd

FIGURE 9



Legend

Monitoring Well Locations


Notes:  
PCE: Tetrachloroethene  
TCE: Trichloroethene  
DCE: cis-1,2-Dichloroethene  
VC: Vinyl chloride

Concentrations that exceed NYS Class GA ground water standards are bolded.


Micrograms per liter (ug/L) is equivalent to parts-per-billion (ppb).

HERCULES  
MACHINE SALES  
OCEANSIDE, NEW YORK

GROUND WATER  
COC RESULTS  
"F" INTERVAL  
SCREENED 101.4-116.9  
ft bgs



September 2007  
Figure 6-6\_F.mxd

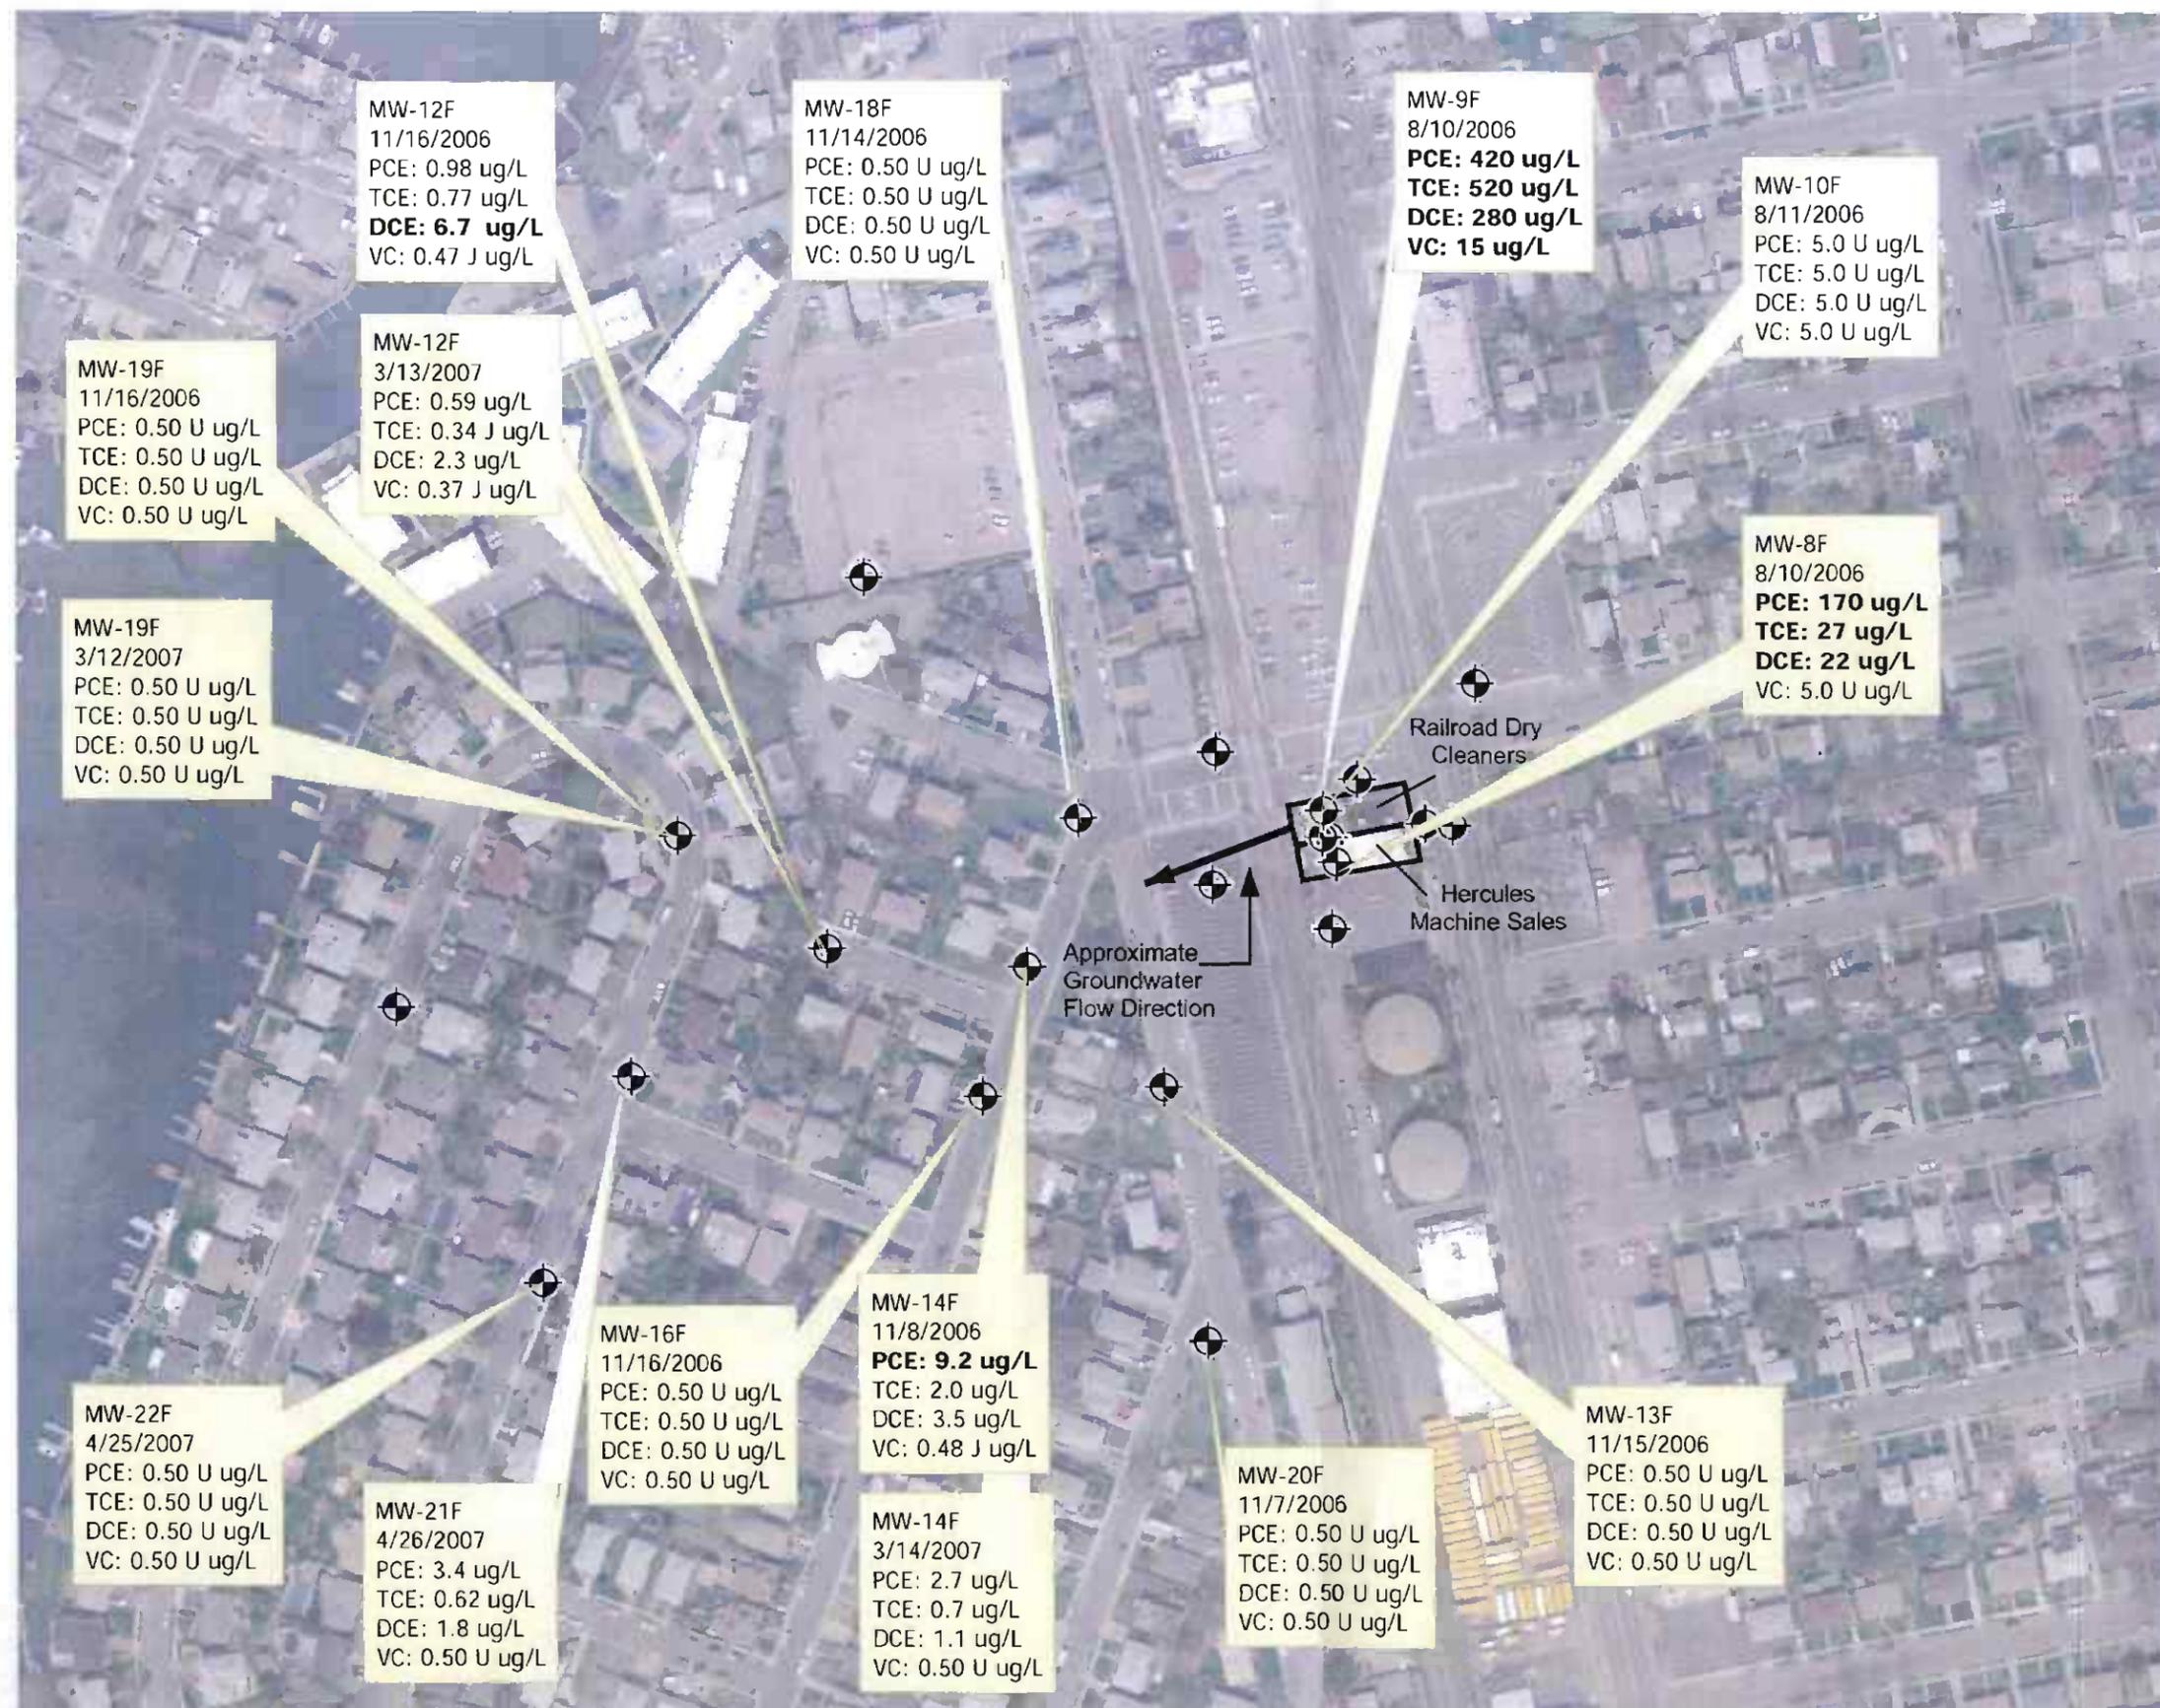

MW-12F  
11/16/2006  
PCE: 0.98 ug/L  
TCE: 0.77 ug/L  
**DCE: 6.7 ug/L**  
VC: 0.47 J ug/L

MW-18F  
11/14/2006  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L

MW-9F  
8/10/2006  
**PCE: 420 ug/L**  
**TCE: 520 ug/L**  
**DCE: 280 ug/L**  
**VC: 15 ug/L**

MW-10F  
8/11/2006  
PCE: 5.0 U ug/L  
TCE: 5.0 U ug/L  
DCE: 5.0 U ug/L  
VC: 5.0 U ug/L

MW-19F  
11/16/2006  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L

MW-12F  
3/13/2007  
PCE: 0.59 ug/L  
TCE: 0.34 J ug/L  
DCE: 2.3 ug/L  
VC: 0.37 J ug/L

MW-8F  
8/10/2006  
**PCE: 170 ug/L**  
**TCE: 27 ug/L**  
**DCE: 22 ug/L**  
VC: 5.0 U ug/L

MW-19F  
3/12/2007  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L

Approximate  
Groundwater  
Flow Direction

Railroad Dry  
Cleaners

Hercules  
Machine Sales

MW-16F  
11/16/2006  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L

MW-14F  
11/8/2006  
**PCE: 9.2 ug/L**  
TCE: 2.0 ug/L  
DCE: 3.5 ug/L  
VC: 0.48 J ug/L

MW-13F  
11/15/2006  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L


MW-22F  
4/25/2007  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L

MW-21F  
4/26/2007  
PCE: 3.4 ug/L  
TCE: 0.62 ug/L  
DCE: 1.8 ug/L  
VC: 0.50 U ug/L

MW-14F  
3/14/2007  
PCE: 2.7 ug/L  
TCE: 0.7 ug/L  
DCE: 1.1 ug/L  
VC: 0.50 U ug/L

MW-20F  
11/7/2006  
PCE: 0.50 U ug/L  
TCE: 0.50 U ug/L  
DCE: 0.50 U ug/L  
VC: 0.50 U ug/L

FIGURE 10

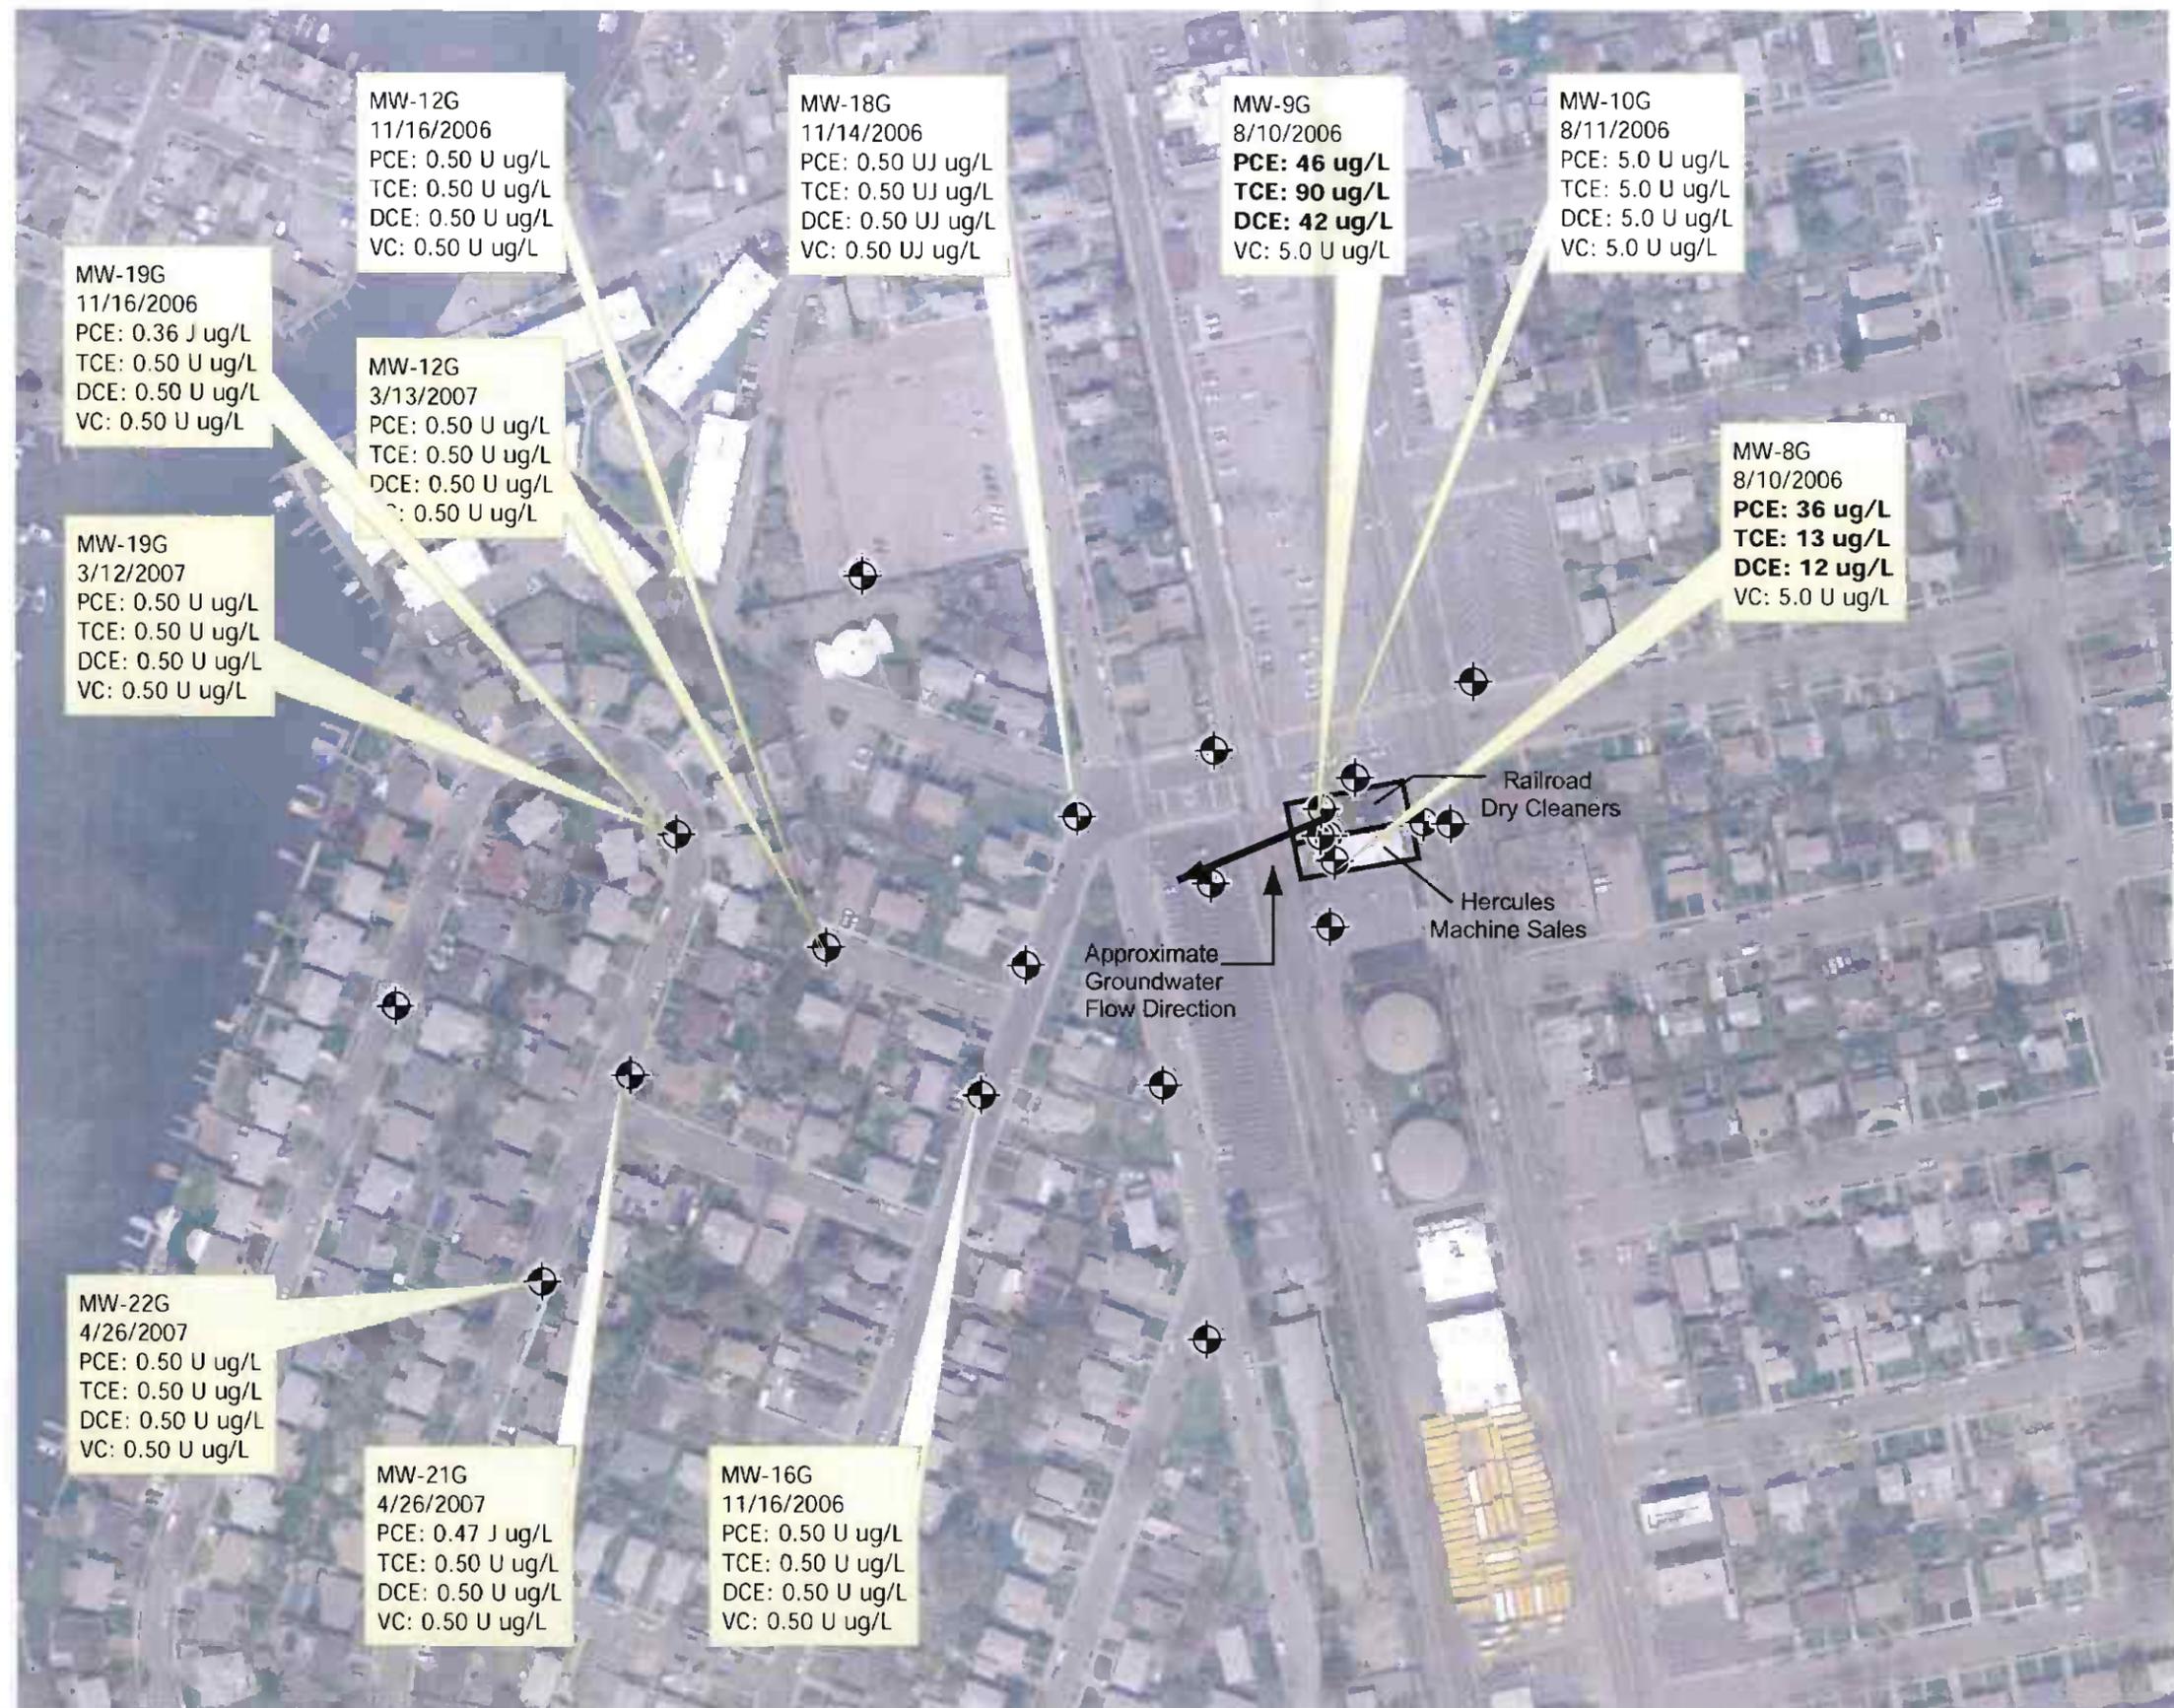

**Legend**

Monitoring Well Locations


Notes:  
 PCE: Tetrachloroethene  
 TCE: Trichloroethene  
 DCE: cis-1,2-Dichloroethene  
 VC: Vinyl chloride

Concentrations that exceed NYS Class GA ground water standards are bolded.

Micrograms per liter (ug/L) is equivalent to parts-per-billion (ppb).


**HERCULES  
 MACHINE SALES  
 OCEANSIDE, NEW YORK**

**GROUND WATER  
 COC RESULTS  
 "G" INTERVAL  
 SCREENED 129.1-130.7  
 ft bgs**



September 2007  
 Figure 6-7\_G.mxd

FIGURE 11

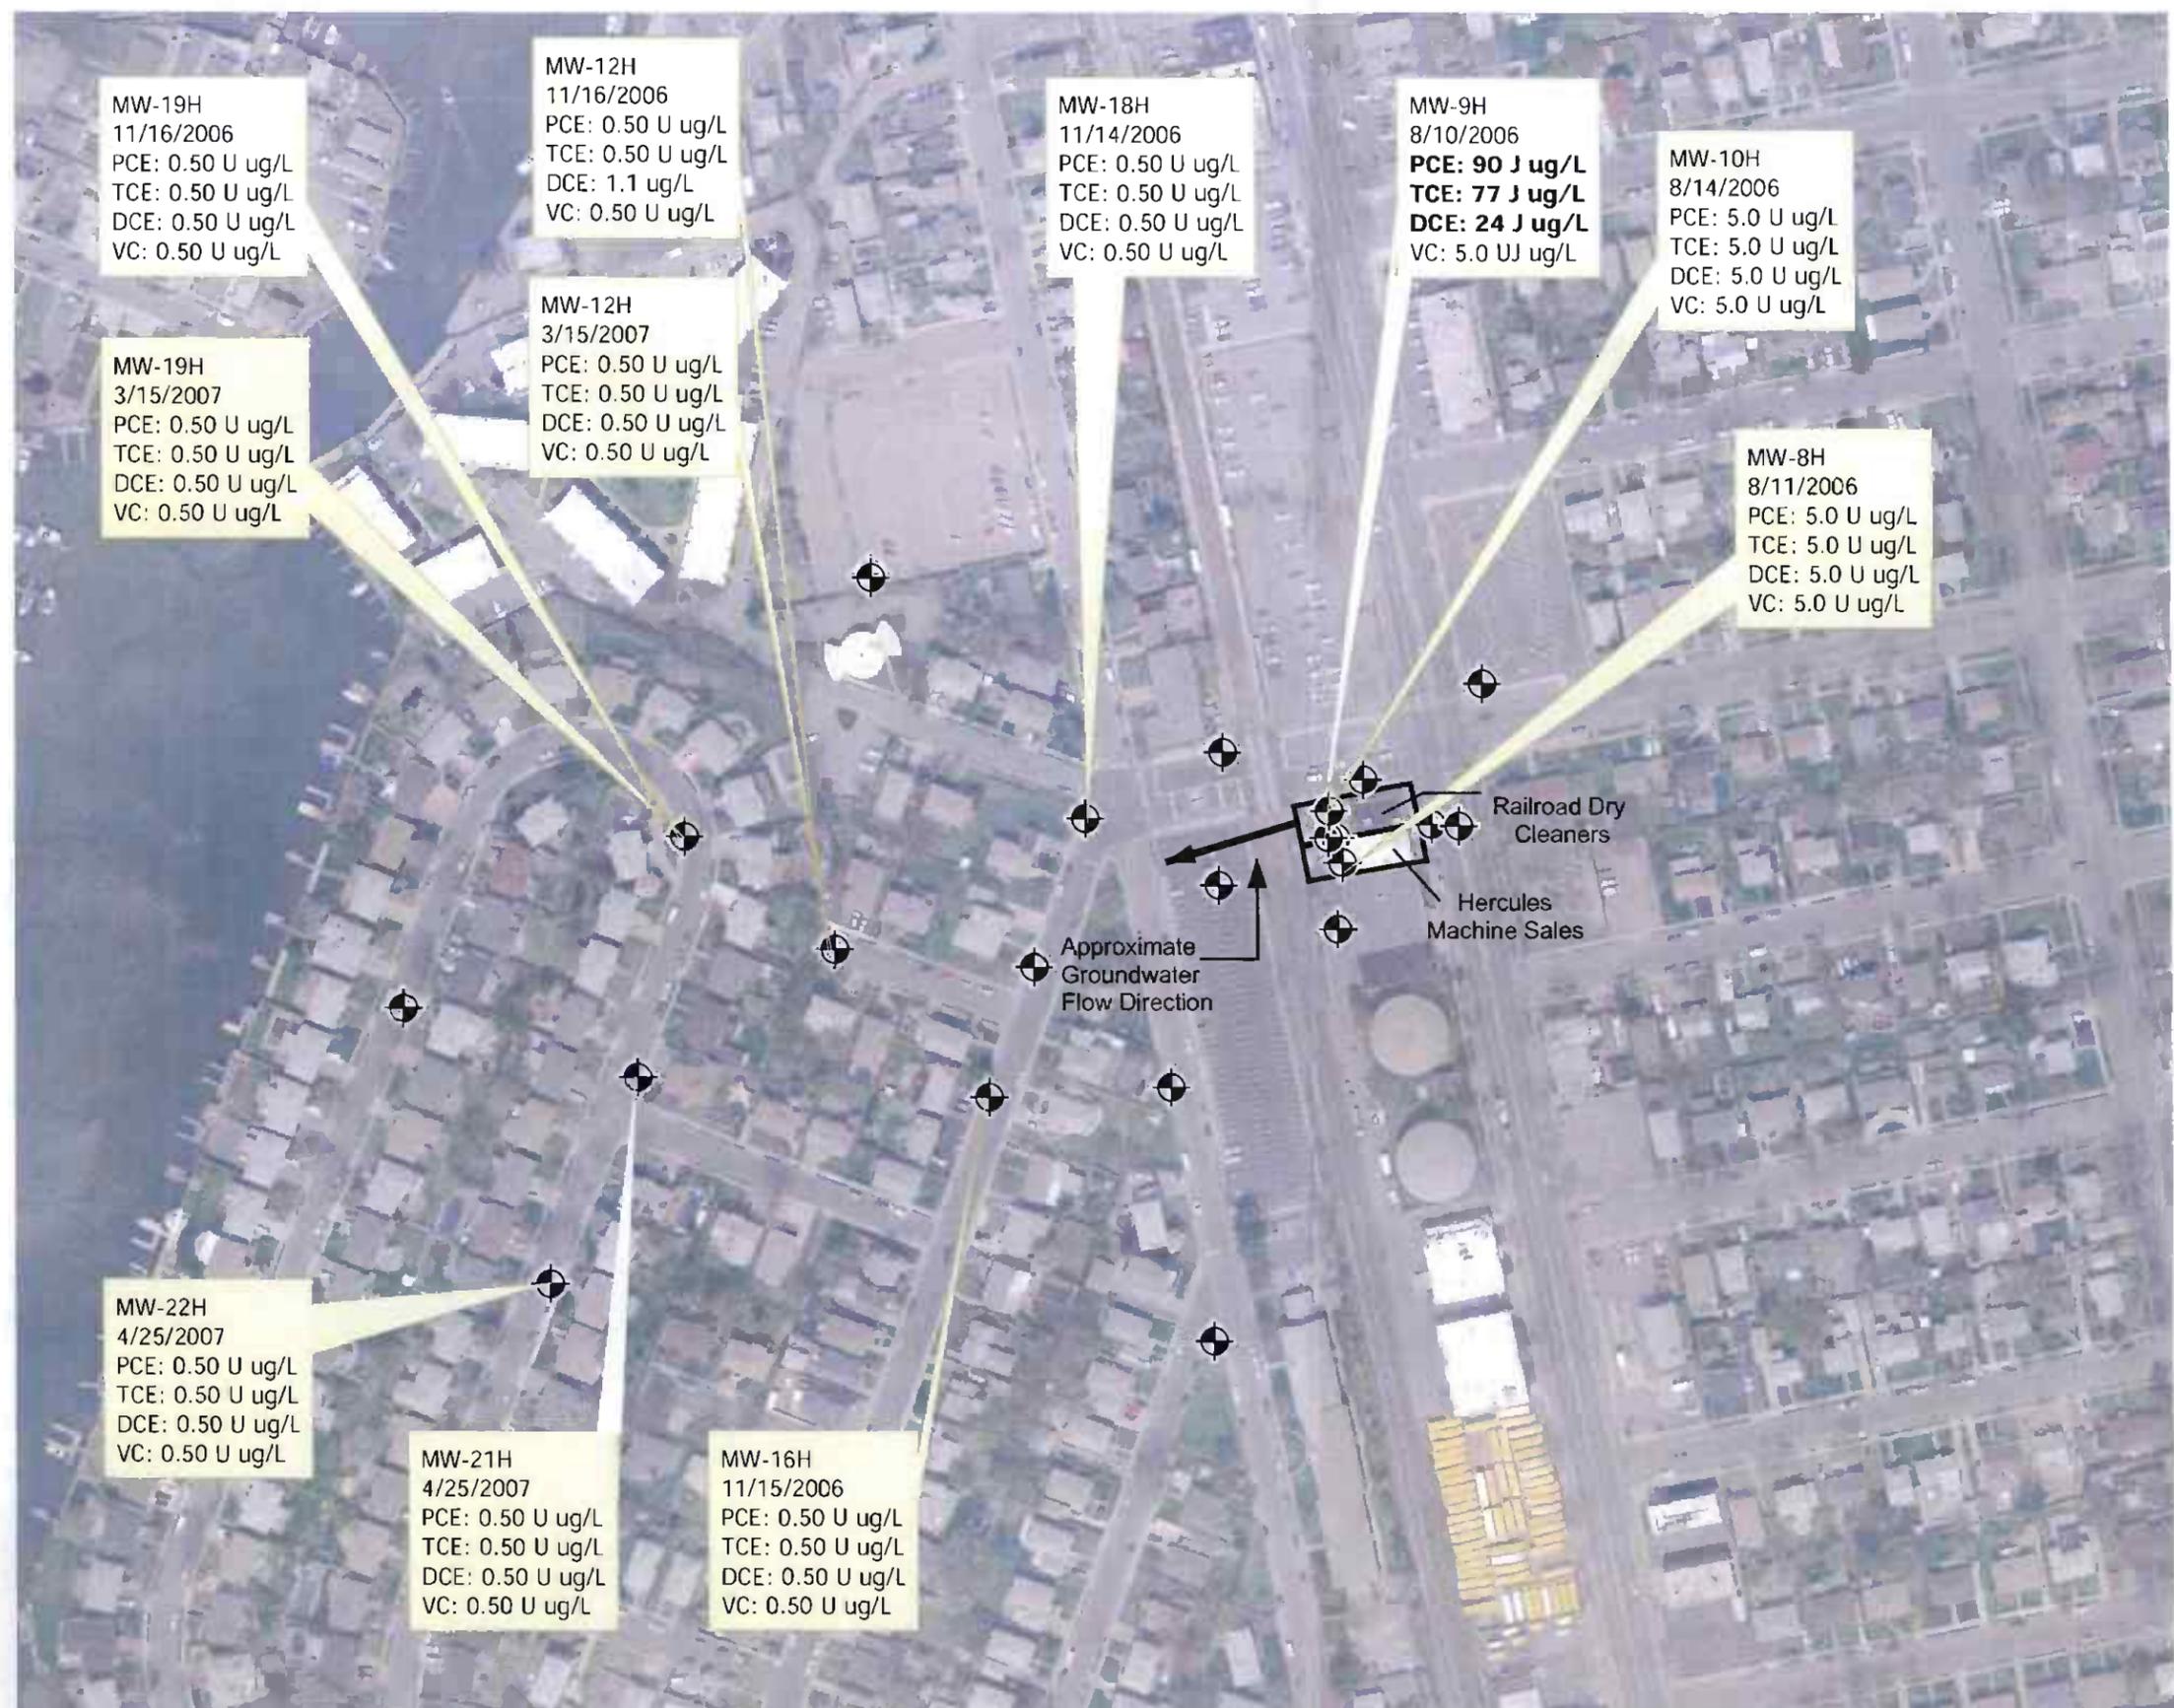

**Legend**

Monitoring Well Locations


Notes:  
 PCE: Tetrachloroethene  
 TCE: Trichloroethene  
 DCE: cis-1,2-Dichloroethene  
 VC: Vinyl chloride

Concentrations that exceed NYS Class GA ground water standards are bolded.

Micrograms per liter (ug/L) is equivalent to parts-per-billion (ppb).

**HERCULES  
 MACHINE SALES  
 OCEANSIDE, NEW YORK**

**GROUND WATER  
 COC RESULTS  
 "H" INTERVAL  
 SCREENED 149.0-152.1  
 ft bgs**



September 2007  
 Figure 6-8\_H.mxd

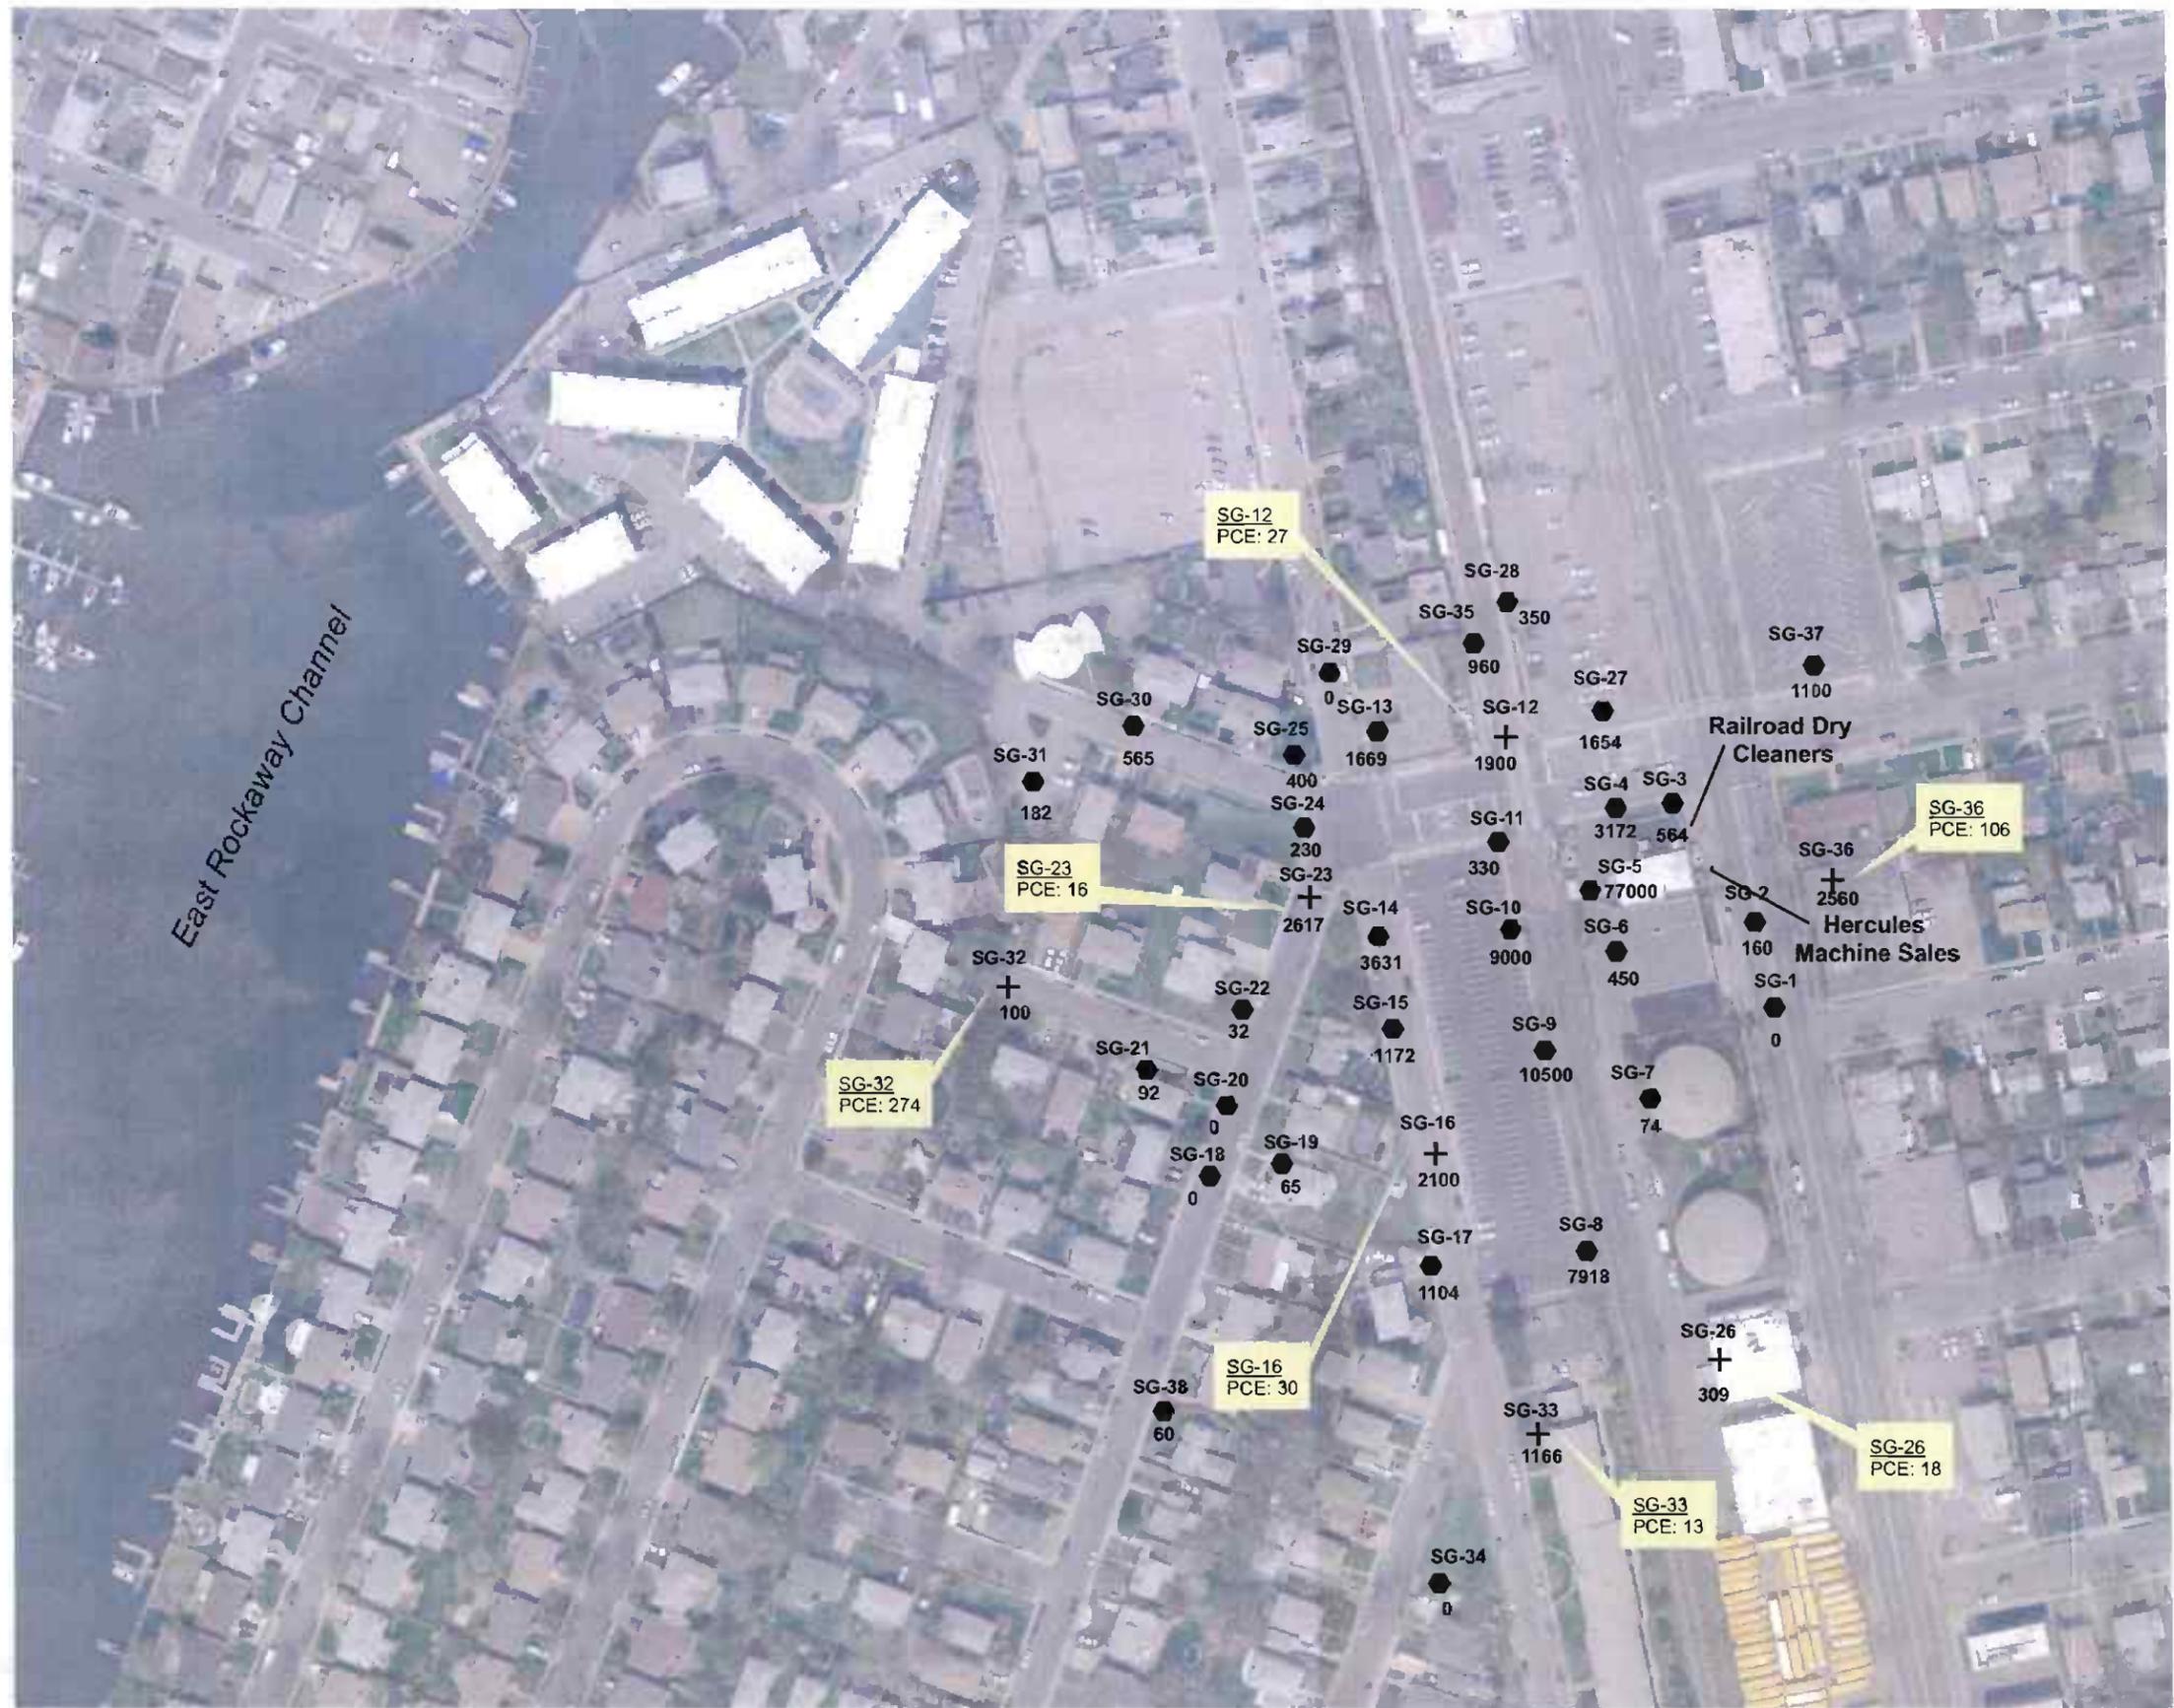


FIGURE 12




**Legend**

- Soil Vapor Screening Locations with PID Reading
- ⊕ Soil Vapor and Summa Screening Location

Note:  
 1. PID measurement of total VOCs in ppb  
 2. PCE = Tetrachloroethylene  
 3. Summa PCE result in ug/m<sup>3</sup>

HERCULES MACHINE SALES  
OCEANSIDE, NEW YORK

**SOIL VAPOR  
SCREENING AND  
SAMPLING RESULTS**



September 2007  
Figure 7-1\_SG Screening and VOC Conc.mxd

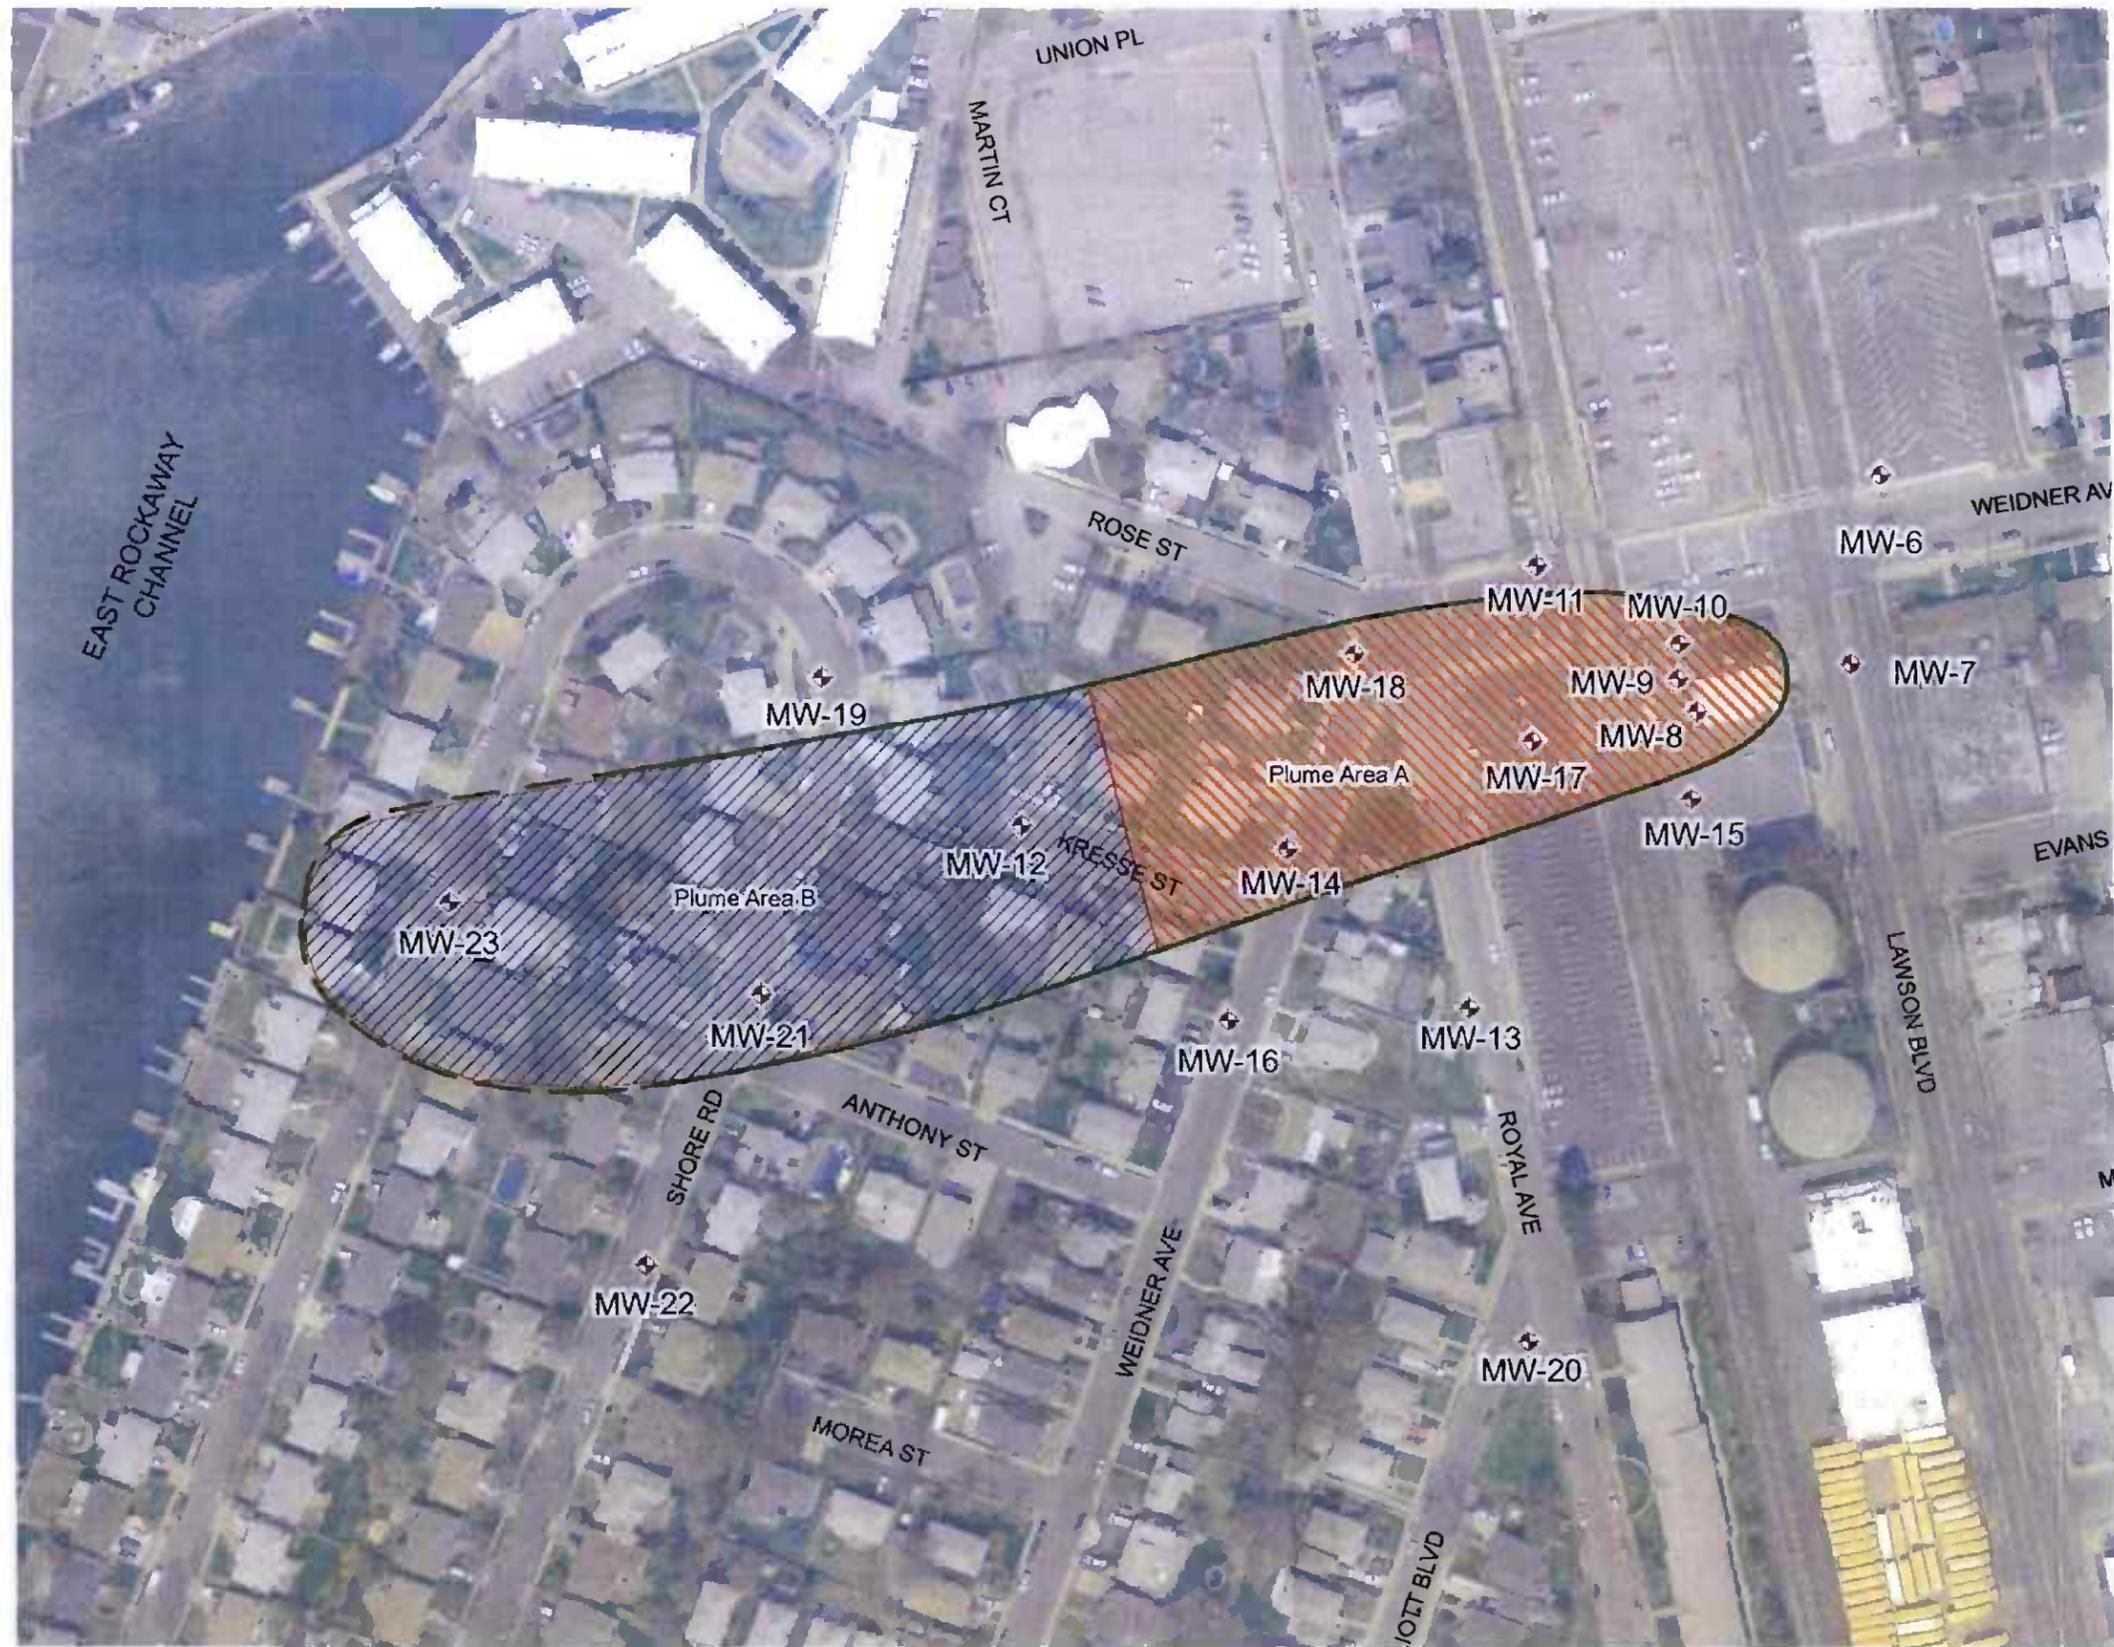


FIGURE 13




Legend

- Monitoring Well Locations
- Extent of COCs Above GW Standards
- Plume Area A
- Plume Area B

HERCULES MACHINE SALES  
OCEANSIDE, NEW YORK

**HORIZONTAL EXTENT  
OF COCS ABOVE  
GROUND WATER  
STANDARDS**



November 2007