

Figure 5A.28
Optional Sediment Basin Dewatering Methods


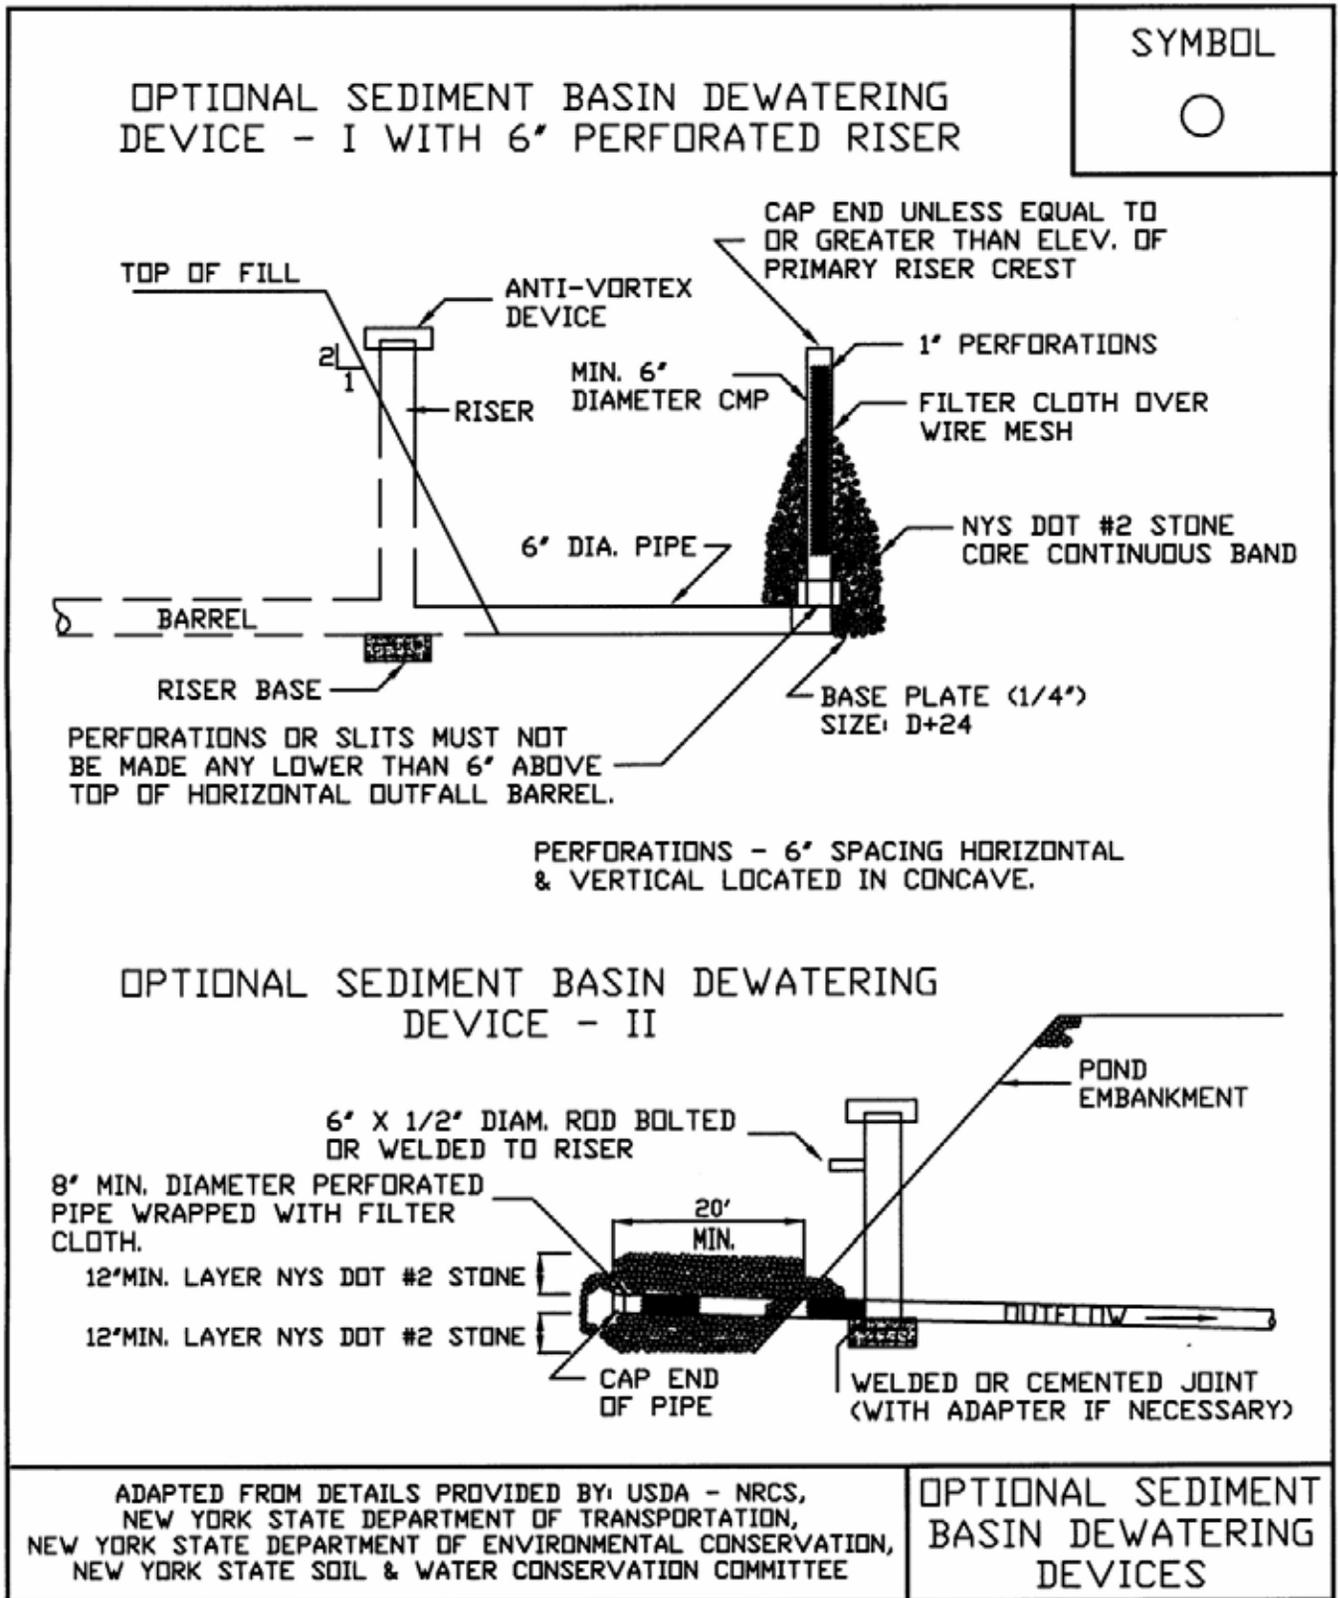


Figure 5A.29(1)
Concentric Trash Rack and Anti-Vortex Device
 (USDA - NRCS)

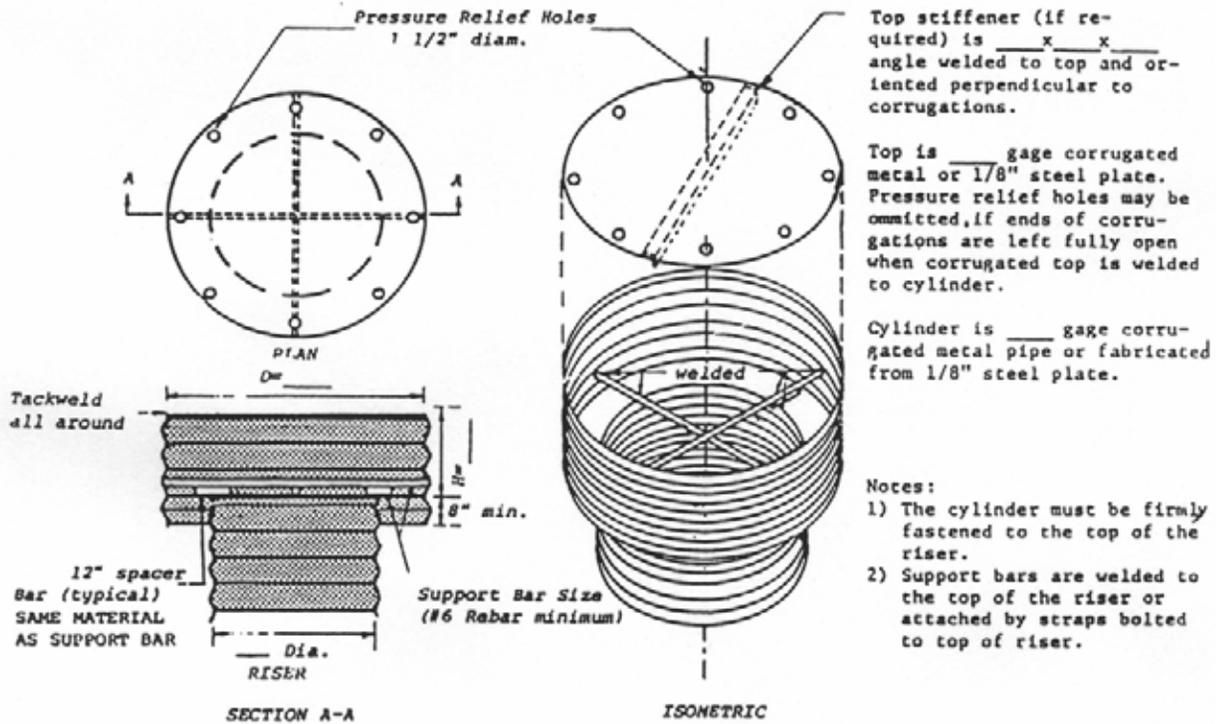

CONCENTRIC TRASH RACK AND ANTI-VORTEX DEVICE
 (not to scale)

Figure 5A.29(2)
Concentric Trash Rack and Anti-Vortex Device Design Table
 (USDA - NRCS)

Riser Diam.(in)	Cylinder Diam.(in.)	Thick. Gage	H.(in.)	Minimum Size Support Bar	Minimum Top	
					Thickness	Stiffener
12	18	16	6	#6 Rebar	16 ga.	—
15	21	16	7	#6 Rebar	16 ga.	—
18	27	16	8	#6 Rebar	16 ga.	—
21	30	16	11	#6 Rebar	16 ga.	—
24	36	16	13	#6 Rebar	14 ga.	—
27	42	16	15	#6 Rebar	14 ga.	—
36	54	14	17	#8 Rebar	12 ga.	—
42	60	14	19	#8 Rebar	12 ga.	—
48	72	12	21	1 1/4" pipe or 1 1/4x1 1/4x1/4 angle	10 ga.	—
54	78	12	25	See 48" Riser	10 ga.	—
60	90	12	29	1 1/2" pipe or 1 1/2x1 1/2x1/2 angle	8 ga.	—
66	96	10	33	2" pipe or 2x2x3/16 angle	8 ga. w/stiffener	2x2x1/4 angle
72	102	10	36	— See 66" Riser —		2 1/2x2 1/2x1/4 angle
78	114	10	39	2 1/2" pipe or 2x2x1/4 angle	See 72" Riser	See 72" Riser
84	120	10	42	2 1/2" pipe or 2 1/2x2 1/2x1/4 angle	See 72" Riser	2 1/2x 5/16 angle

Note: The criteria for sizing the cylinder is that the area between the inside of the cylinder and the outside of the riser is equal to or greater than the area inside the riser. Therefore, the above table is invalid for use with concrete pipe risers.

Figure 5A.30
Riser Base Details

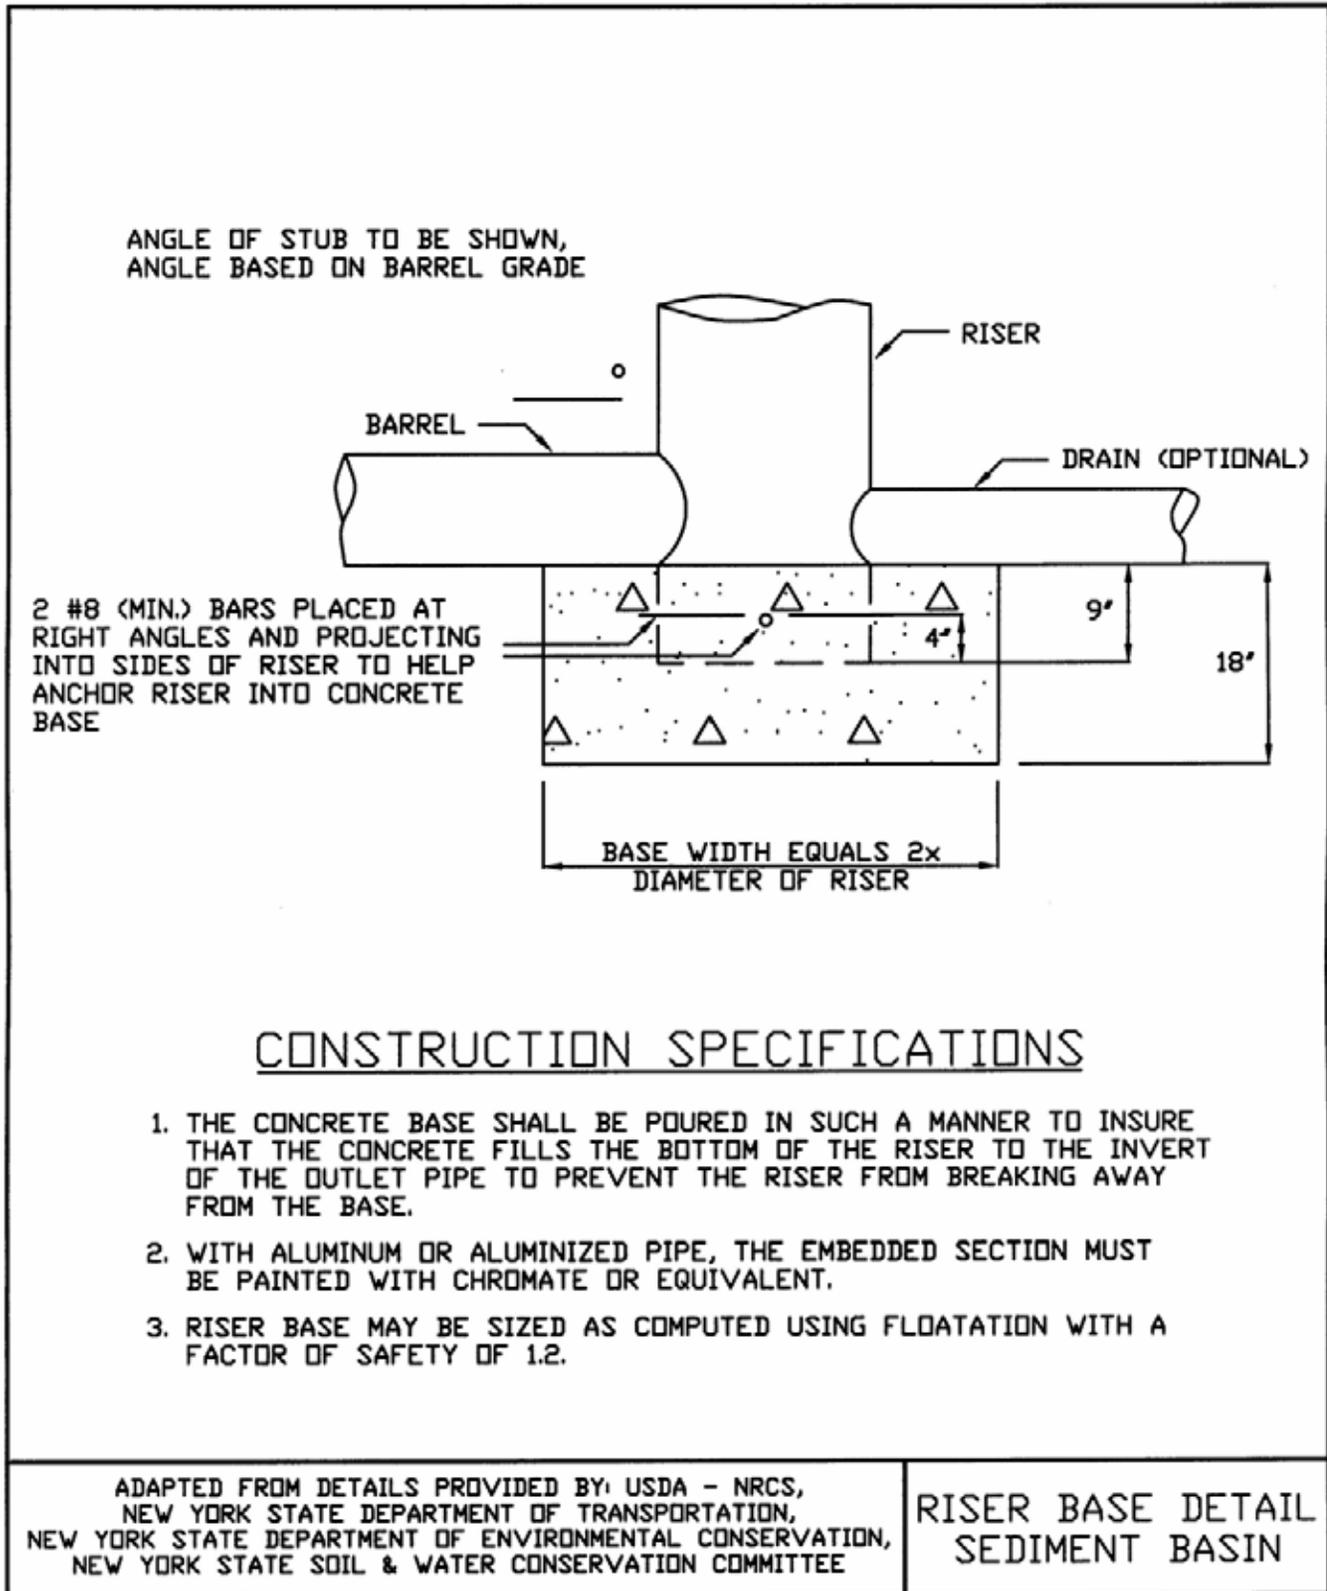


Figure 5A.31(1) Anti-Seep Collar Design

This procedure provides the anti-seep collar dimensions for only temporary sediment basins to increase the seepage length by 15% for various pipe slopes, embankment slopes and riser heights.

The first step in designing anti-seep collars is to determine the length of pipe within the saturated zone of the embankment. This can be done graphically or by the following equation, assuming that the upstream slope of the embankment intersects the invert of the pipe at its upstream end. (See embankment-invert intersection on the drawing below:

$$L_s = y (z + 4) \left[1 + \frac{\text{pipe slope}}{0.25 - \text{pipe slope}} \right]$$

Where: L_s = length of pipe in the saturated zone (ft.)

y = distance in feet from upstream invert of pipe to highest normal water level expected to occur during the life of the structure, usually the top of the riser.

z = slope of upstream embankment as a ratio of z ft. horizontal to one ft. vertical.

pipe slope = slope of pipe in feet per foot.

This procedure is based on the approximation of the phreatic line as shown in the drawing below:


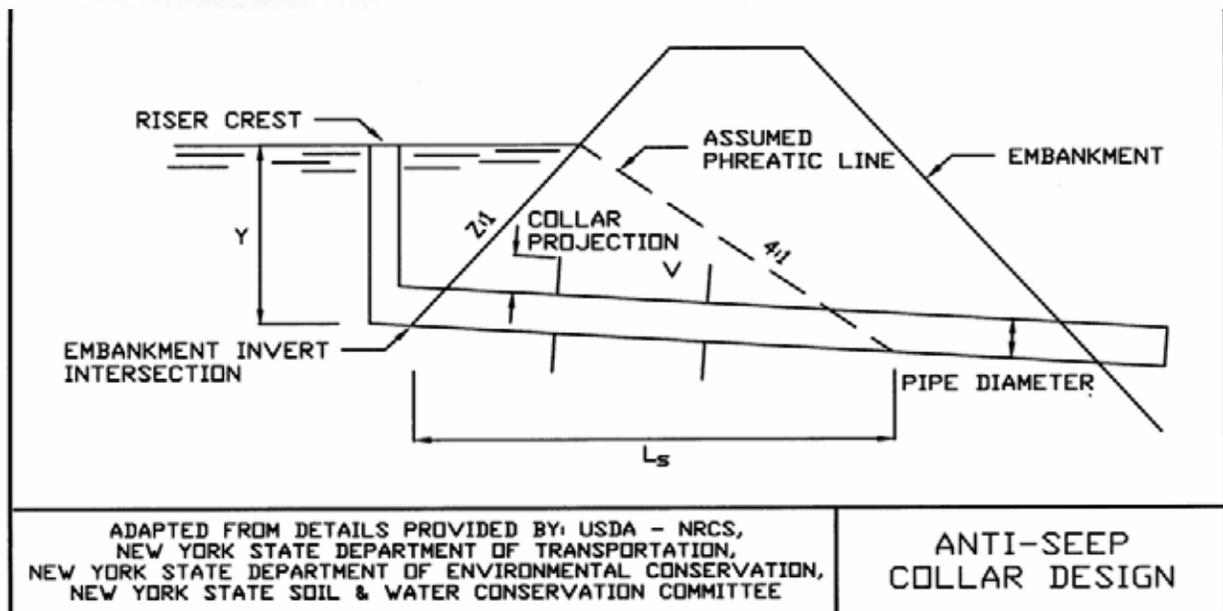


Figure 5A.31(2)
Anti-Seep Collar Design Charts (USDA - NRCS)



**Figure 5A.32
Anti-Seep Collar Design**

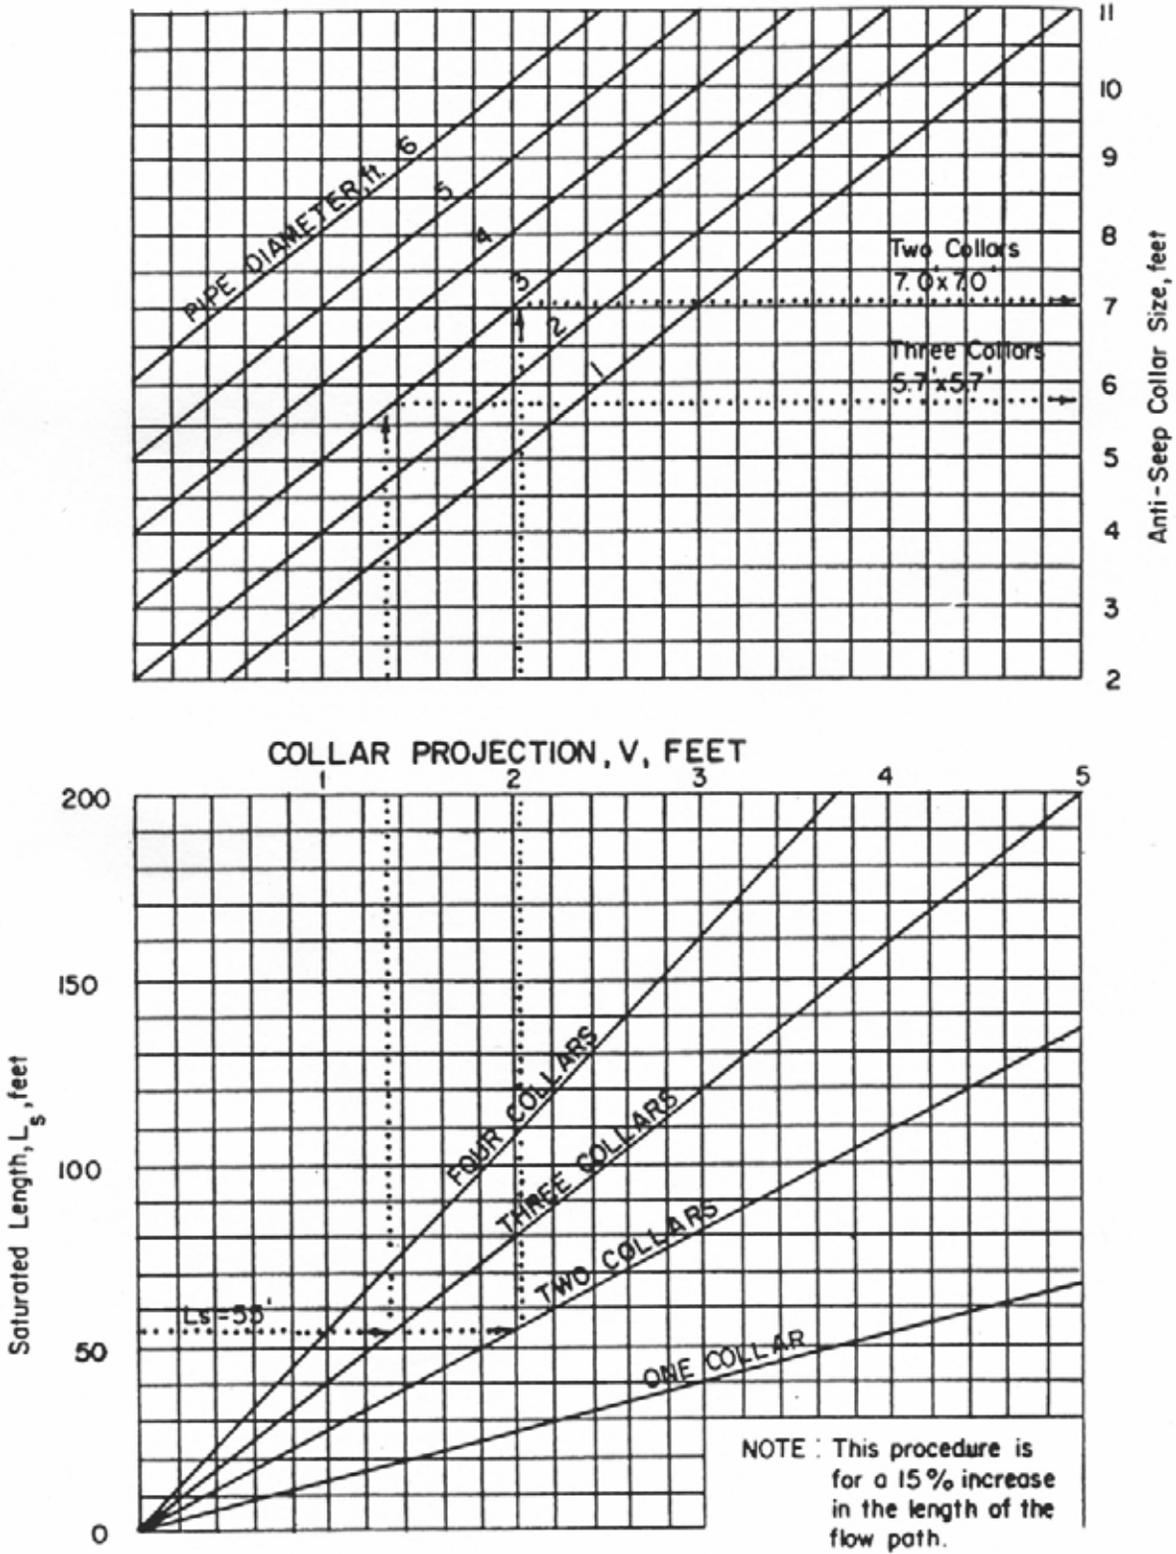