

Mr. Jason Pelton  
Section Chief  
New York State Department of Environmental Conservation  
Remedial Bureau D  
625 Broadway  
Albany, NY 12233-7015

Arcadis of New York, Inc.  
Two Huntington  
Quadrangle  
Suite 1S10  
Melville  
New York 11747  
Phone: 631 249 7600  
Fax: 631 249 7610

[www.arcadis.com](http://www.arcadis.com)

Date: May 31, 2023

Our Ref: 30123958

Subject: Results of First Quarter 2023 System Operation and Monitoring,  
Bethpage Park Groundwater Containment System (BPGWCS),  
Operable Unit 3 (Former Grumman Settling Ponds),  
Bethpage, New York, NYSDEC Site #1-30-003A.

Dear Jason,

Enclosed is one electronic PDF copy of the First Quarter 2023 Report for the BPGWCS Operation and Monitoring Program, prepared in accordance with the 2013 NYSDEC ROD, 2014 NYSDEC Order on Consent, OM&M Manual (Arcadis 2009) and the NYSDEC-approved Sampling and Analysis Plan (SAP; Arcadis 2009). As we have transitioned to electronic submittals (via PDF) in line with NYSDEC's paper reduction program, hard copies of the report can be provided on request.

The notable increase in total and project VOC concentrations detected in the Q3 2022 RW-1 influent water samples (due to the addition of remedial wells BCPMW-4-1 and BCPMW-4-2 that were tied-in to the RW-1 influent pipe) has continued to decrease significantly in Q1 2023 (Table 10). The notable increase in concentrations of cis-1,2-Dichloroethene and Trichloroethylene detected in Q1 2022 RW-3 influent water samples has continued to decrease significantly in Q1 2023 (Table 10). The total and project VOC concentrations remain below historical maximum concentrations (Figures 6A and 6B). The notable increases in concentrations of cis-1,2-Dichloroethene, Trichloroethylene, Vinyl Chloride, Benzene, Toluene, m,p-Xylenes, and o-Xylene detected in the August 2021 RW-2 influent water sample continue to decrease (Table 10). The total and project VOC concentrations remain below historical maximum concentrations (Figures 6A and 6B). These constituents have not been detected in the BPGWCS Q1 2023 effluent water samples (Table 3). In addition, the air quality impact analysis (Table 9) shows that none of the detected compounds exceed the 6 NYCRR Part 212-2.2 Table 2 High Toxicity Air Contaminant List annual mass emission limits. We will continue monitoring this situation during subsequent quarterly monitoring rounds.

Mr. Jason Pelton  
NYSDEC RB

May 31, 2023

If you have any questions, please do not hesitate to contact me.

Sincerely,  
Arcadis of New York, Inc.



Christopher Engler, PE New York PE-069748  
Vice President

Email: Christopher.Engler@arcadis.com  
Direct Line: 315.409.6579

CC. Edward Hannon, Northrop Grumman  
Matthew Travis, NYSDEC  
Jim Sullivan, NYS Dept. of Health  
Angela Pettinelli, Nassau County Dept. of Health  
Robin Putnam, Nassau County Dept. of Health  
Richard Castle, Nassau County Dept. of Health  
Carlo San Giovanni, Arcadis  
Mike Wolfert, Arcadis  
Nidal Azzam, USEPA  
Alexis Stabulas, USEPA  
Public Repository  
File




# Tables

**Table 1**  
**Operational Summary**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



MONTH	DAY																															Days Operational <sup>1</sup>			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31				
2009 Total																																		160	
2010 Total																																			352
2011 Total																																			351
2012 Total																																			353
2013 Total																																			354
2014 Total																																			349
2015 Total																																			348
2016 Total																																			351
2017 Total																																			354
2018 Total																																			348
2019 Total																																			355
2020 Total																																			345
2021 Total																																			346
2022 Total																																			344
Jan 2023																																			27
Feb 2023																																			28
Mar 2023																																			29
1Q 2023																																			84
2023 Total																																			84
<b>TOTAL</b>																																			<b>4794</b>

**Legend:**

-  Indicates system online for greater than 18 hours.
-  Indicates system operated with reduced flows for 6 hours or greater.
-  Indicates system off-line for 6 hours or greater.

Notes, Abbreviations, and Units on last page.

**Table 1**  
**Operational Summary**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



**Notes:**

1. Days the system was operational for greater than 18 hours are counted as one day.

**First Quarter 2023**

**Abbreviations/Units:**

1Q      First Quarter

**Table 2**  
**Summary of Influent Water Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Compound <sup>3</sup> (All Constituent Concentrations in µg/L)	05/16/22	08/17/22	11/16/22	02/08/23
<b><u>Project VOCs</u></b>				
1,1,1 - Trichloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,1 - Dichloroethane	< 1.0	<b>0.64 J</b>	< 1.0	< 1.0
1,2 - Dichloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,1 - Dichloroethene	< 1.0	<b>0.96 J</b>	< 1.0	< 1.0
Tetrachloroethene	< 1.0	< 1.0	< 1.0	< 1.0
Trichloroethene	<b>11.6</b>	<b>56.8</b>	<b>49.1</b>	<b>24.9</b>
Vinyl Chloride	<b>3.3</b>	<b>11.8</b>	<b>4.5</b>	<b>1.4</b>
cis 1,2-Dichloroethene	<b>44.0</b>	<b>125</b>	<b>49.1</b>	<b>22.3</b>
trans 1,2-Dichloroethene	< 1.0	<b>1.2</b>	<b>0.78 J</b>	< 1.0
Benzene	< 0.50	<b>0.97</b>	< 0.50	< 0.50
Toluene	<b>7.9</b>	<b>140</b>	<b>3.3</b>	< 1.0
o-Xylene	<b>1.7</b>	<b>21.4</b>	<b>1.5</b>	< 1.0
m,p-Xylene	<b>2.0</b>	<b>28.3</b>	<b>1.6</b>	< 1.0
<b>Subtotal Project VOCs</b>	<b>70.5</b>	<b>387.7</b>	<b>109.9</b>	<b>48.6</b>
<b><u>Non-Project VOCs</u></b>				
1,1,2,2-Tetrachloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,1,2-Trichloroethane	< 1.0	< 1.0	< 1.0	< 1.0
1,2-Dichloropropane	< 1.0	< 1.0	< 1.0	< 1.0
1,3-Butanone		< 1.0		
1,3-Butadiene	< 5.0	< 5.0	< 5.0	< 5.0
2-Butanone	< 10	< 10	< 10	< 10
4-Methyl-2-Pentanone	< 5.0	< 5.0	< 5.0	< 5.0
Acetone	< 10	< 10	< 10	< 10
Bromodichloromethane	< 1.0	< 1.0	< 1.0	< 1.0
Bromoform	< 1.0	< 1.0	< 1.0	< 1.0
Bromomethane	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Disulfide	< 2.0	< 2.0	< 2.0	< 2.0
Carbon Tetrachloride	< 1.0	< 1.0	< 1.0	< 1.0
Chlorobenzene	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodibromomethane	< 1.0	< 1.0	< 1.0	< 1.0
Chlorodifluoromethane (Freon 22)	< 5.0	< 5.0	< 5.0	< 5.0
Chloroethane	< 1.0	< 1.0	< 1.0	< 1.0
Chloroform	<b>1.7</b>	<b>1.4</b>	<b>1.2</b>	<b>0.72 J</b>
Chloromethane	< 1.0	< 1.0	< 1.0	< 1.0
cis-1,3-Dichloropropene	< 1.0	< 1.0	< 1.0	< 1.0

Notes, Abbreviations, Qualifiers, and Units on last page.

**Table 2**  
**Summary of Influent Water Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Compound <sup>3</sup> (All Constituent Concentrations in µg/L)	05/16/22	08/17/22	11/16/22	02/08/23
<b>Non-Project VOCs</b>				
Dichlorodifluoromethane (Freon 12)	< 2.0	< 2.0	< 2.0	< 2.0
Dichloromethane	< 2.0	< 2.0	< 2.0	< 2.0
Ethylbenzene	<b>0.66 J</b>	<b>17.4</b>	<b>1.7</b>	<b>0.76 J</b>
Methyl N-Butyl Ketone	< 5.0	< 5.0	< 5.0	< 5.0
Methyl Tert-Butyl Ether	< 1.0	< 1.0	< 1.0	< 1.0
Styrene (Monomer)	< 1.0	< 1.0	< 1.0	< 1.0
trans-1,3-Dichloropropene	< 1.0	< 1.0	< 1.0	< 1.0
Trichlorofluoromethane (Freon 11)	< 2.0	< 2.0	< 2.0	< 2.0
Trichlorotrifluoroethane (Freon 113)	< 5.0	< 5.0	< 5.0	< 5.0
1-Chloro-1,1-difluoroethane (Freon 142b)	< 5.0	< 5.0	< 5.0	< 5.0
<b>Subtotal Non-Project VOCs</b>	<b>2.4</b>	<b>18.8</b>	<b>2.9</b>	<b>1.5</b>
<b>Total VOCs<sup>1,4</sup></b>	<b>73</b>	<b>407</b>	<b>113</b>	<b>50</b>
1,4-Dioxane	<b>0.70</b>	<b>2.8</b>	<b>2.0</b>	<b>1.6</b>
pH <sup>2</sup>	5.4	--	5.1	6.2

**Notes, Abbreviations, Qualifiers, and Units:**

1. "Total VOCs" represents the sum of individual concentrations of the compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.
2. Influent pH samples collected and measured in the field by Arcadis personnel on the dates listed using a field calibrated pH/conductivity meter. pH units are standard units.
3. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.
4. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

-- pH not recorded due to a field recording error.

VOC Volatile Organic Compound

**2.4** Bold value indicates a detection.

< 1.0 Compound not detected at or above the laboratory quantification limit.

µg/L micrograms per liter

J Result is estimated.

**Table 3**  
**Summary of Effluent Water Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Compound <sup>6</sup> (All Constituent Concentrations in µg/L)	Discharge Limit <sup>1</sup>	04/14/22	05/16/22	06/13/22	07/25/22	08/17/22	09/15/22	10/13/22	11/16/22	12/12/22	01/10/23	02/08/23	03/07/23
<b>Project VOCs</b>													
1,1,1-Trichloroethane	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
1,1-Dichloroethene	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
Tetrachloroethene	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
Trichloroethene	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
Vinyl Chloride	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
cis 1,2-Dichloroethene	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
trans 1,2-Dichloroethene	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.0	<1.0	<1.0	< 1.0	<1.0	<1.0
<b>Subtotal Project VOCs</b>		<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>
Compound <sup>6</sup> (All Constituent Concentrations in µg/L)	Discharge Limit <sup>1</sup>	04/14/22	05/16/22	06/13/22	07/25/22	08/17/22	09/15/22	10/13/22	11/16/22	12/12/22	01/10/23	02/08/23	03/07/23
<b>Non-Project VOCs</b>													
Acetone	50	< 10	< 10	< 10	< 10	< 10	<10	< 10	<10	<10	< 10	<10	<10
Chloroform	5 <sup>2</sup>	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	<1.0	< 1.1	<1.1	<1.0	< 1.1	<1.1	<1.0
Dichloromethane	5 <sup>2</sup>	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	<2.0	< 2.1	<2.1	<2.0	< 2.1	<2.1	<2.0
Trichlorotrifluoroethane (Freon 113)	5 <sup>2</sup>	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	<5.0	< 5.1	<5.1	<5.0	< 5.1	<5.1	<5.0
<b>Subtotal Non-Project VOCs</b>		<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>
<b>Total VOCs<sup>3,7</sup></b>		<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>	<b>ND</b>
Treatment Efficiency <sup>4</sup>		> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%	> 99.9%
Compound <sup>6</sup> (All Constituent Concentrations in µg/L)	Discharge Limit <sup>1</sup>	04/14/22	05/16/22	06/13/22	07/25/22	08/17/22	09/15/22	10/13/22	11/16/22	12/12/22	01/10/23	02/08/23	03/07/23
<b>Inorganics</b>													
Total Iron	600	<b>195</b>	<b>323</b>	<b>474</b>	<b>208</b>	<b>767</b>	<b>286</b>	<b>281</b>	<b>214</b>	<b>186</b>	<b>178</b>	<b>142</b>	<b>519</b>
Total Manganese	600	<b>46.4</b>	<b>69.8</b>	<b>56.0</b>	<b>42.6</b>	<b>127.0</b>	<b>82.9</b>	<b>82.0</b>	<b>67.3</b>	<b>70.6</b>	<b>63.0</b>	<b>54.0</b>	<b>49.5</b>
Nitrate and Nitrite	10,000	<b>2,800</b>	<b>2,800</b>	<b>2,600</b>	<b>2,700</b>	<b>2,500</b>	<b>3,100</b>	<b>2,700</b>	<b>3,200</b>	<b>2,800</b>	<100	<b>2,600</b>	<b>2,300</b>
Total Kjeldahl Nitrogen	10,000	< 200	380.0	< 200	< 200	<200	<200	<200	<200	<200	<200	<b>430</b>	<200
Total Nitrogen	10,000	<b>3,000</b>	<b>3,200</b>	<b>2,600</b>	<b>2,700</b>	<b>2,500</b>	<b>3,100</b>	<b>2,700</b>	<b>3,500</b>	<b>3,000</b>	<300	<b>3,000</b>	<b>2,300</b>
1,4-Dioxane	NE	<b>0.91</b>	<b>0.82</b>	<b>1.1</b>	<b>0.84</b>	<b>1.8</b>	<b>1.4</b>	<b>1.4</b>	<b>1.2</b>	<b>0.90</b>	<b>0.92</b>	<b>1.0</b>	<b>0.61</b>
pH <sup>5</sup>	5.5-8.5	6.9	6.9	7.1	7.6	--	7.2	5.9	6.2	7.0	6.0	6.2	6.6

Notes, Abbreviations, Qualifiers, and Units on last page.



**Table 3**  
**Summary of Effluent Water Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



**Notes, Abbreviations, Qualifiers, and Units:**

1. Discharge limits per the interim SPDES equivalency program or Division of Water Technical and Operational Guidance Series (TOGS 1.1.1) Quality Standards and Guidance Values and Groundwater Effluent Limitations, if the compound is not part of the SPDES Permit Equivalency.
2. As of September 2017, the 10 SPDES VOCs discharge limits are per Site Number 1-30-003A Operable Unit 3 SPDES Permit Equivalency.
3. "Total VOCs" represents the sum of individual concentrations of compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.
4. Treatment efficiency was calculated by dividing the difference between the influent and effluent total VOC concentrations by the influent total VOC concentration.
5. Effluent pH measured on site using a handheld pH meter. pH units are standard units.
6. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.
7. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

SPDES	State Pollutant Discharge Elimination System
VOC	Volatile Organic Compound
NE	Not Established
--	pH not recorded due to a field recording error.
<b>1.0</b>	Bold value indicates a detection.
< 1.0	Compound not detected above the laboratory quantification limit.
µg/L	micrograms per liter
<b>ND</b>	Analyte not detected at, or above its laboratory quantification limit.

**Table 4**  
**Influent Vapor Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Compound <sup>1,3</sup> (All Constituent Concentrations in µg/m <sup>3</sup> )	05/16/22	08/17/22	02/08/23
<b><u>Project VOCs</u></b>			
1,1,1 - Trichloroethane	< 4.4	< 2.2	< 2.2
1,1 - Dichloroethane	<b>5.7 J</b>	<b>6.5</b>	<b>3.0 J</b>
1,2 - Dichloroethane	< 6.5	< 3.2	< 3.2
1,1 - Dichloroethene	<b>5.6</b>	<b>8.7</b>	<b>1.8</b>
Tetrachloroethene	<b>2.3</b>	<b>3.2</b>	<b>2.5</b>
Trichloroethene	<b>261</b>	<b>602</b>	<b>276</b>
Vinyl Chloride	<b>54.4</b>	<b>109</b>	<b>19</b>
cis 1,2-Dichloroethene	<b>1160</b>	<b>1410</b>	<b>288</b>
trans 1,2-Dichloroethene	<b>8.7</b>	<b>13</b>	<b>2.9 J</b>
Benzene	<b>4.5 J</b>	<b>8.3</b>	<b>3.5</b>
Toluene	<b>227</b>	<b>1,050</b>	<b>1.6 J</b>
o-Xylene	<b>50.0</b>	<b>140</b>	<b>2.1 J</b>
m,p-Xylene	<b>67.8</b>	<b>180</b>	<b>2.5 J</b>
<b>Subtotal Project VOCs</b>	<b>1847</b>	<b>3531</b>	<b>603</b>
<b><u>Non-Project VOCs</u></b>			
1,1,1,2-Tetrachloroethane	< 5.5	< 2.7	< 2.7
1,1,2-Trichloroethane	< 4.4	< 2.2	< 2.2
1,2-Dichloropropane	< 7.4	< 3.7	< 3.7
1,3-Butadiene	< 3.5	< 1.8	< 1.8
2-Butanone	< 4.7	<b>1.9 J</b>	<b>2.7</b>
4-Methyl-2-Pentanone	< 6.6	< 3.3	< 3.3
Acetone	<b>4.0</b>	<b>10</b>	<b>21</b>
Bromodichloromethane	< 5.4	< 2.7	< 2.7
Bromoform	< 3.3	< 1.7	< 1.7
Bromomethane	< 6.2	< 3.1	< 3.1
Carbon Disulfide	< 5.0	< 2.5	< 2.5
Carbon Tetrachloride	< 2.0	< 1.0	< 1.0
Chlorobenzene	< 7.4	< 3.7	< 3.7
Chlorodibromomethane	< 6.8	< 3.4	< 3.4
Chlorodifluoromethane (Freon 22)	< 5.6	<b>2.8 J</b>	<b>2.9</b>
Chloroethane	< 4.2	< 2.1	< 2.1
Chloroform	<b>38</b>	<b>23</b>	<b>12</b>
Chloromethane	<b>1.9 J</b>	<b>1.4 J</b>	<b>2.5</b>
cis-1,3-Dichloropropene	< 7.3	< 3.6	< 3.6
Dichlorodifluoromethane (Freon 12)	< 5.6	<b>2.1 J</b>	<b>2.1 J</b>
Dichloromethane	< 5.6	<b>19</b>	<b>3.5</b>
Ethylbenzene	<b>28</b>	<b>108</b>	<b>7.4</b>
Methyl N-Butyl Ketone	< 6.5	< 3.3	< 3.3
Methyl Tert-Butyl Ether	< 5.8	< 2.9	< 2.9
Styrene (Monomer)	< 6.8	< 3.4	< 3.4
trans-1,3-Dichloropropene	< 7.3	< 3.6	< 3.6
Trichlorofluoromethane (Freon 11)	< 4.5	<b>2.6</b>	< 2.2
Trichlorotrifluoroethane (Freon 113)	< 6.1	< 3.1	< 3.1
1-Chloro-1,1-difluoroethane (Freon 142b)	< 6.6	< 3.3	< 3.3
<b>Subtotal Non-Project VOCs</b>	<b>72</b>	<b>171</b>	<b>54</b>
<b>Total VOCs<sup>2,4,5</sup></b>	<b>1920</b>	<b>3702</b>	<b>657</b>

Notes, Abbreviations, Qualifiers, and Units on last page.

**Table 4**  
**Influent Vapor Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



**Notes, Abbreviations, Qualifiers, and Units:**

1. Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Influent samples were collected at Vapor Sampling Port-1 (VSP-1); refer to Figure 3 of this OM&M Report for the location of VSP-1.

2. "Total VOCs" represents the sum of individual concentrations of compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.

3. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

4. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

5. Influent vapor samples were not analyzed for the Q4 2022 reporting period due to a laboratory error. Influent vapor sample results from the Q1 2023 event were in line with historic concentrations.

ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
OM&M	Operation, Maintenance, and Monitoring
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

<b>6.5</b>	Bold value indicates a detection.
< 3.4	Compound not detected above the laboratory quantification limit.
J	Result is estimated.

$\mu\text{g}/\text{m}^3$       micrograms per cubic meter

**Table 5**  
**Summary of Effluent Vapor Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Compound <sup>1,3</sup> (All Constituent Concentrations in µg/m <sup>3</sup> )	05/16/22	08/17/22	02/08/23
<b>Project VOCs</b>			
1,1,1 - Trichloroethane	< 0.44	< 0.44	< 0.44
1,1 - Dichloroethane	<b>0.81</b>	<b>1.3</b>	<b>1.9</b>
1,2 - Dichloroethane	< 0.65	< 0.65	< 0.65
1,1 - Dichloroethene	<b>0.39</b>	<b>0.83</b>	<b>1.2</b>
Tetrachloroethene	<b>0.28</b>	<b>0.54</b>	<b>0.68</b>
Trichloroethene	<b>13</b>	<b>33</b>	<b>26</b>
Vinyl Chloride	<b>12</b>	<b>25</b>	<b>10</b>
cis 1,2-Dichloroethene	<b>42.4</b>	<b>71.8</b>	<b>99.5</b>
trans 1,2-Dichloroethene	< 0.63	<b>0.48 J</b>	<b>0.63</b>
Benzene	<b>0.80</b>	<b>1.5</b>	<b>0.38 J</b>
Toluene	<b>31</b>	<b>166</b>	<b>0.79</b>
o-Xylene	<b>5.6</b>	<b>14</b>	<b>0.61 J</b>
m,p-Xylene	<b>7.4</b>	<b>17</b>	<b>0.78</b>
<b>Subtotal Project VOCs</b>	<b>114</b>	<b>331</b>	<b>142</b>
<b>Non-Project VOCs</b>			
1,1,2,2-Tetrachloroethane	< 0.55	< 0.55	< 0.55
1,1,2-Trichloroethane	< 0.44	< 0.44	< 0.44
1,2-Dichloropropane	< 0.74	< 0.74	< 0.74
1,3-Butadiene	< 0.35	< 0.35	< 0.35
2-Butanone	<b>3.8</b>	<b>3.8</b>	<b>2.3</b>
4-Methyl-2-Pentanone	< 0.66	< 0.66	< 0.66
Acetone	<b>25.7</b>	<b>28.0</b>	<b>14</b>
Bromodichloromethane	< 0.54	< 0.54	< 0.54
Bromoform	< 0.33	< 0.33	< 0.33
Bromomethane	< 0.62	< 0.62	< 0.62
Carbon Disulfide	< 0.50	< 0.50	< 0.50
Carbon Tetrachloride	< 0.20	< 0.20	< 0.20
Chlorobenzene	< 0.74	< 0.74	< 0.74
Chlorodibromomethane	< 0.68	< 0.68	< 0.68
Chlorodifluoromethane (Freon 22)	<b>2.9</b>	<b>3.3</b>	<b>3.9</b>
Chloroethane	< 0.42	< 0.42	< 0.42
Chloroform	<b>5.4</b>	<b>4.1</b>	<b>6.8</b>
Chloromethane	<b>1.6</b>	<b>1.4</b>	<b>1.7</b>
cis-1,3-Dichloropropene	< 0.73	< 0.73	< 0.73
Dichlorodifluoromethane (Freon 12)	<b>2.9</b>	<b>1.9</b>	<b>2.2</b>
Dichloromethane	<b>8</b>	<b>21</b>	<b>0.97</b>
Ethylbenzene	<b>2.2</b>	<b>7.8</b>	<b>1.1</b>
Methyl N-Butyl Ketone	< 0.65	1.4	< 0.65
Methyl Tert-Butyl Ether	< 0.58	< 0.58	< 0.58
Styrene (Monomer)	< 0.68	< 0.68	< 0.68
trans-1,3-Dichloropropene	< 0.73	< 0.73	< 0.73
Trichlorofluoromethane (Freon 11)	<b>1.0</b>	<b>1.9</b>	<b>1.1</b>
Trichlorotrifluoroethane (Freon 113)	< 0.61	< 0.61	< 0.61
1-Chloro-1,1-difluoroethane (Freon 142b)	< 0.66	< 0.66	<b>0.45 J</b>
<b>Subtotal Non-Project VOCs</b>	<b>53</b>	<b>75</b>	<b>35</b>
<b>Total VOCs<sup>2,4,5</sup></b>	<b>166</b>	<b>406</b>	<b>177</b>

Notes, Abbreviations, Qualifiers, and Units on last page.

**Table 5**  
**Summary of Effluent Vapor Sample Analytical Results**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



**Notes, Abbreviations, Qualifiers, and Units:**

1. Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Effluent samples were collected at Vapor Sampling Port-5 (VSP-5); refer to Figure 3 of this OM&M Report for the location of VSP-5.

2. "Total VOCs" represents the sum of individual concentrations of all compounds detected. The values used in calculations referenced in this report have been rounded to the nearest whole number.

3. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

4. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

5. Effluent vapor samples were not analyzed for the Q4 2022 reporting period due to a laboratory recording error.

ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
OM&M	Operation, Maintenance, and Monitoring
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

**1.9** Bold value indicates a detection.

< 0.66 Compound not detected above the laboratory quantification limit.

J Result is estimated.

µg/m<sup>3</sup> micrograms per cubic meter

**Table 6**  
**Summary of Effluent Vapor Tentatively Identified Compounds**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Compound <sup>1,4</sup> (All Constituent Concentrations in ppbv)	05/16/22	08/17/22	02/08/23
<b><u>Tentatively Identified Compounds</u></b>			
Carbon Dioxide	<b>440 JNB</b>	<b>530 JNB</b>	<b>150 JNB</b>
1-Hexanol, 2-ethyl	ND	ND	<b>5.2 JN</b>
Acetic acid, 2-ethylhexyl ester	ND	ND	<b>1.4 JN</b>
Ethyl Acetate	ND	ND	ND
Cyclohexane, methyl-	ND	<b>1.9 JN</b>	<b>1.6 JN</b>
<b>Total VOC TICs<sup>2,3,5,6</sup></b>	ND	<b>1.9 J</b>	<b>24.53 J</b>

**Notes, Abbreviations, Qualifiers, and Units:**

1. Vapor samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per Modified USEPA Method TO-15. A VOC analyte list is provided in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). Effluent samples were collected at Vapor Sampling Port-5 (VSP-5); refer to Figure 3 of this OM&M Report for the location of VSP-5.

2. VSP-5 sample location moved to new sample port at ECU effluent stack.

3. Compounds found in associated method blank are not included in Total VOC TICs.

4. Results validated following protocols specified in Sampling and Analysis Plan in the Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous annual reports for historical analytical results.

5. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

6. Effluent vapor samples were not analyzed for the Q4 2022 reporting period due to a laboratory recording error.

ECU	Emission Control Unit
ELAP	Environmental Laboratory Approval Program
NYSDOH	New York State Department of Health
OM&M	Operation, Maintenance, and Monitoring
TIC	Tentatively Identified Compound
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound

<b>530</b>	Bold value indicates a detection.
ND	TIC were not detected.
<b>B</b>	TIC was detected in the associated method blank.
<b>J</b>	Result is estimated.
<b>N</b>	Indicates presumptive evidence of a compound.
ppbv	parts per billion by volume

**Table 7**  
**Summary of System Parameters**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



Date <sup>1</sup>	Water Flow Rates (All Flows in gpm)						Water Pressures (All Pressures in psi)					Air Flow Rate (scfm) <sup>2</sup>	Air Pressures (All Pressures in iwc) <sup>5,6</sup>					Air Temp. (°R) <sup>5</sup>
	Remedial Well <sup>2</sup>				Combined Influent <sup>3</sup>	Effluent <sup>2</sup>	Remedial Well Effluent <sup>2,4</sup>				Effluent <sup>5</sup>	Effluent	ECU Influent				Effluent	Effluent
	RW-1 <sup>7</sup>	RW-2	RW-3	RW-4			RW-1	RW-2	RW-3	RW-4			GAC-501	GAC-502	PPZ-601	PPZ-602		
	(gpm)	(gpm)	(gpm)	(gpm)	(gpm)	(gpm)	(psi)	(psi)	(psi)	(psi)	(psi)	(scfm)	(iwc)	(iwc)	(iwc)	(iwc)	(iwc)	(iwc)
04/14/22	30.2	74.5	74.7	30.3	210	200	57	32	48	57	12	1,309	5.0	< 1.0	1.0	< 1.0	1.0	540
05/16/22	30.6	75.5	75.4	30.4	212	198	57	26	46	57	16	1,425	5.0	< 1.0	1.0	< 1.0	1.0	542
06/13/22	30.8	74.9	76.3	30.3	212	190	57	18	47	56	15	1,419	5.0	< 1.0	1.0	< 1.0	1.0	546
07/25/22	28.8	75.1	74.9	30.3	209	203	57	17	48	56	27	1,314	4.0	< 1.0	< 1.0	< 1.0	< 1.0	550
08/17/22	17.5	75.7	74.8	30.4	198	182	92	13	43	55	11	1,308	4.0	< 1.0	< 1.0	< 1.0	0.5	548
09/15/22	18.3	66.2	74.7	30.5	190	184	90	8	43	55	10	1,282	4.0	< 1.0	< 1.0	< 1.0	0.5	549
10/13/22	15.9	65.6	74.8	29.9	186	178	22	8	43	55	10	1,125	3.5	< 1.0	< 1.0	< 1.0	0.5	538
11/16/22	14.5	66.2	73.1	29.9	184	175	23	8	47	56	11	1,109	3.5	< 1.0	< 1.0	< 1.0	6.5	528
12/12/22	14.1	66.1	75.0	30.0	185	189	22	8	41	56	20	1,173	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	536
01/10/23	30.6	65.4	75.1	30.4	201	216	71	9	41	55	9	1,202	3.0	< 1.0	< 1.0	< 1.0	4.5	523
02/08/23	28.5	65.9	74.4	30.6	199	212	71	9	44	55	24	1,220	3.0	< 1.0	< 1.0	< 1.0	0.5	528
03/07/23	30.9	65.4	75.8	30.8	203	216	59	9	39	55	13	1,157	3.0	< 1.0	< 1.0	< 1.0	0.5	522

Notes, Abbreviations, and Units on last page.

**Table 7**  
**Summary of System Parameters**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



**Notes, Abbreviations, and Units:**

1. Operational data collected by Arcadis on days noted. Parameters listed were typically recorded during compliance monitoring events. Data in this table correspond to approximately the past year of system operation.
2. Instantaneous parameters obtained from the SCADA HMI: Water Flow Rate, Water Pressure, Air Flow Rate.
3. Combined influent water-flow rate is the sum of individual well flow rates via the SCADA System.
4. Remedial Well effluent pressure readings measured at the influent manifold within the treatment system building.
5. Instantaneous values recorded from field-mounted instruments during weekly site visits.
6. Pressure readings recorded as < 1.0 iwc due to pressure being too low for gauge sensitivity.
7. As of August 4, 2022 the RW-1 flow rate presented includes the combined flow rates from wells BCPMW-4-1 and BCPMW-4-2 as additional recovery wells.

ECU	Emission Control Unit
GAC	Granular Activated Carbon
HMI	Human-Machine Interface
RW	Remedial Well
SCADA	Supervisory Control and Data Acquisition
Temp	Temperature
gpm	gallons per minute
iwc	inches of water column
psi	pounds per square inch
°R	degrees Rankine
scfm	standard cubic feet per minute



Table 8  
 Summary of Groundwater Recovered, VOC Mass Recovered, and VOC Mass Recovery Rates  
 Bethpage Park Groundwater Containment System  
 Operable Unit 3 (Former Grumman Settling Ponds)  
 Northrop Grumman,  
 Bethpage, New York



Operating Period <sup>1</sup>	Volume of Groundwater Recovered (x1,000 gal) <sup>2</sup>					VOC Mass Recovered (lbs) <sup>3</sup>															VOC Mass Recovery Rate (lbs/day) <sup>4</sup>																			
						Total VOCs <sup>5</sup>					Project VOCs <sup>6</sup>					Non-Project VOCs <sup>7</sup>					Total VOCs <sup>5</sup>					Project VOCs <sup>6</sup>					Non-Project VOCs <sup>7</sup>									
	RW-1 <sup>9</sup>	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total	RW-1	RW-2	RW-3	RW-4	Total					
<b>System Pilot Test, Shakedown and Startup Totals<sup>8</sup></b>	137	270	251	150	808	NA	NA	NA	NA	1.1	NA	NA	NA	NA	1.0	NA	NA	NA	NA	0.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
<b>2010 Totals</b>	15,726	35,127	38,160	15,689	104,702	0.56	172	412	89	672	0.56	171	28	0.10	200	< 0.01	0.17	383	89	469	< 0.01	0.46	1.1	0.24	1.8	< 0.01	0.46	0.075	< 0.01	0.54	< 0.01	< 0.01	1.0	0.24	1.3					
<b>2011 Totals</b>	15,218	36,570	37,682	15,196	104,666	0.36	167	271	78	516	0.36	167	35	0.090	203	< 0.01	1.1	236	78	314	< 0.01	0.45	0.73	0.21	1.4	< 0.01	0.45	0.095	< 0.01	0.55	< 0.01	< 0.01	0.64	0.21	0.85					
<b>2012 Totals</b>	15,260	35,178	36,111	15,336	101,885	0.28	114	113	40	267	0.25	113	12	0.39	126	< 0.01	1.5	101	40	141	< 0.01	0.31	0.31	0.11	0.73	< 0.01	0.31	0.032	< 0.01	0.35	< 0.01	< 0.01	0.28	0.11	0.39					
<b>2013 Totals</b>	15,968	37,514	36,622	16,036	106,140	0.14	111	41	18	171	0.14	110	4.3	0.36	113	< 0.01	1.6	37	18	57	< 0.01	0.30	0.11	0.050	0.47	< 0.01	0.30	0.012	< 0.01	0.31	< 0.01	< 0.01	0.10	0.049	0.16					
<b>2014 Totals</b>	15,690	33,222	31,199	15,691	95,802	0.063	67	9.9	8.1	85	0.063	65	2.0	0.20	67	< 0.01	1.5	8.1	7.9	17	< 0.01	0.19	0.028	0.023	0.24	< 0.01	0.18	< 0.01	< 0.01	0.19	< 0.01	< 0.01	0.023	0.022	0.047					
<b>2015 Totals</b>	15,859	38,082	34,961	14,755	103,657	0.028	47	7.1	4.5	57	0.021	45	1.5	0.20	45	< 0.01	1.7	5.6	4.2	12	< 0.01	0.13	0.019	0.012	0.16	< 0.01	0.12	< 0.01	< 0.01	0.12	< 0.01	< 0.01	0.015	0.012	0.032					
<b>2016 Totals</b>	15,826	34,539	39,349	15,826	105,540	< 0.01	38	3.2	2.2	44	< 0.01	37	1.4	0.20	39	< 0.01	1.5	1.7	2.0	5.2	< 0.01	0.10	< 0.01	< 0.01	0.12	< 0.01	0.10	< 0.01	< 0.01	0.11	< 0.01	< 0.01	< 0.01	< 0.01	0.014					
<b>2017 Totals</b>	16,005	31,600	37,614	15,965	101,184	< 0.01	13	2.2	1.2	17	< 0.01	13	1.1	0.16	14	< 0.01	0.56	1.1	1.1	2.7	< 0.01	0.037	< 0.01	< 0.01	0.046	< 0.01	0.035	< 0.01	< 0.01	0.038	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
<b>2018 Totals</b>	15,145	37,712	32,473	14,917	100,247	< 0.01	13.71	0.90	0.56	15.2	< 0.01	13.5	0.70	< 0.01	14.2	< 0.01	0.27	0.19	0.52	0.97	< 0.01	0.038	< 0.01	< 0.01	0.042	< 0.01	0.037	< 0.01	< 0.01	0.039	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
<b>2019 Totals</b>	15,456	32,470	38,416	15,343	101,685	< 0.01	11.51	1.36	0.22	13.10	< 0.01	11.51	1.07	< 0.01	12.59	< 0.01	< 0.01	0.29	0.18	0.63	< 0.01	0.032	< 0.01	< 0.01	0.036	< 0.01	0.032	< 0.01	< 0.01	0.034	< 0.01	< 0.01	< 0.01	0.001	< 0.01					
<b>2020 Totals</b>	14,475	35,814	37,537	15,113	102,939	< 0.01	19.3	1.3	< 0.01	20.6	< 0.01	19.3	0.91	< 0.01	20.2	< 0.01	< 0.01	0.36	< 0.01	0.36	< 0.01	0.053	< 0.01	< 0.01	0.056	< 0.01	0.053	< 0.01	< 0.01	0.055	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
<b>2021 Totals</b>	14,490	36,403	38,153	15,324	104,370	< 0.01	171.4	1.9	0.05	173.3	< 0.01	167.7	1.14	< 0.01	168.9	< 0.01	3.6	0.75	0.11	4.49	< 0.01	1.865	< 0.01	< 0.01	1.886	< 0.01	1.825	< 0.01	< 0.01	1.839	< 0.01	0.04	< 0.01	< 0.01	0.0470					
<b>2022 Totals</b>	12,224	36,802	38,231	15,238	102,495	45	53	15	< 0.01	112.3	43.3	51.2	13.1	< 0.01	107.6	1.7	1.3	1.6	0.1	4.8	0.5	0.6	0.2	< 0.01	1.2	0.5	0.6	0.1	< 0.01	1.2	0.02	0.01	< 0.01	< 0.01	0.04					
<b>January through March 2023</b>																																								
01/01/23 - 02/01/23	1,205	2,665	3,053	1,235	8,158	1.6	0.56	0.45	< 0.01	2.56	1.5	0.6	0.41	< 0.01	2.5	0.04	< 0.01	0.04	< 0.01	0.071	0.050	0.018	0.014	< 0.01	0.083	0.049	0.018	0.013	< 0.01	0.080	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
02/01/23 - 03/01/23	1,151	2,654	3,026	1,228	8,058	1.5	0.56	0.44	< 0.01	2.48	1.4	0.6	0.41	< 0.01	2.4	0.03	< 0.01	0.04	< 0.01	0.069	0.053	0.020	0.016	< 0.01	0.089	0.052	0.020	0.015	< 0.01	0.086	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
03/01/23 - 04/01/23	1,335	2,911	3,376	1,366	8,988	1.7	0.61	0.50	< 0.01	2.82	1.7	0.6	0.46	< 0.01	2.7	0.04	< 0.01	0.04	< 0.01	0.078	0.055	0.020	0.016	< 0.01	0.091	0.054	0.020	0.015	< 0.01	0.089	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
<b>Subtotal Jan - Mar 2023</b>	3,691	8,229	9,455	3,829	25,204	4.8	1.73	1.39	< 0.01	7.87	4.7	1.7	1.28	< 0.01	7.6	0.11	< 0.01	0.11	< 0.01	0.22	0.053	0.019	0.015	< 0.01	0.087	0.052	0.019	0.014	< 0.01	0.085	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
<b>2023 Totals</b>	3,691	8,229	9,455	3,829	25,204	4.8	1.73	1.39	< 0.01	7.87	4.7	1.7	1.28	< 0.01	7.6	0.1	< 0.01	0.11	< 0.01	0.22	0.05	0.02	0.02	< 0.01	0.09	0.05	0.02	0.01	< 0.01	0.09	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01					
<b>Total Since System Start Up</b>	207,762	483,369	502,660	210,982	1,404,773	51	1,275	934	256	2,514	50	1,258	122	2	1,432	2	15	812	254	1,076	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--					

Notes, Abbreviations, and Units on last page.

**Notes, Abbreviations, Qualifiers, and Units:**

1. Represents operating period between consecutive monitoring events.
2. Volume of groundwater recovered is based on individual local well totalized flow readings. Listed value is the difference between totalized flow values recorded between consecutive monitoring events. The total groundwater recovered during a given operating period is the sum of the individual well flow totals. Values shown are rounded to the nearest gallon, but should only be considered accurate to two significant figures to account for error associated with field measurements.
3. Mass recovered per well was calculated by multiplying the Total VOC concentration from the most recent sampling event by the number of gallons extracted during the reporting period. The total amount recovered during a given operating period is the sum of masses recovered from each of the individual wells. Values less than ten pounds are presented using two significant figures and values greater than ten pounds have been rounded to the nearest whole number; however, these values should only be considered accurate to two significant figures to account for error associated with field measurements and analytical data.
4. Mass recovery rates were calculated by dividing the total mass recovered for each well and for the system by the number of days in the respective operating period. Values are presented using two significant figures.
5. "Total VOCs" represents the sum of individual concentrations of the VOCs detected.
6. "Project VOCs" represents the sum of individual compound concentrations of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethylene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and xylenes-o,m, p.
7. "Non-Project VOCs" represents the difference between Total VOCs and Project VOCs.
8. Values based on operational data recorded prior to system startup on July 21, 2009.
9. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

NA	Not Applicable
VOC	Volatile Organic Compound.
<	Less than
gal	Gallons
lbs	Pounds
lbs/day	Pounds per day

**Table 9**  
**2023 Rule 212 Evaluation**  
**Bethpage Park Soil Gas Containment System and Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**

Project VOCs	CAS#	HTAC? <sup>1</sup>	2023 BPGWCS Maximum Effluent Conc. (ug/m3) <sup>2,8</sup>	2023 BPSGCS Maximum Effluent Conc. (ug/m3) <sup>2,8</sup>	2023 BPGWCS Emissions (lb/yr) <sup>4</sup>	2023 BPSGCS Emissions - combined with ISTR (lb/yr) <sup>4</sup>	Facility Wide Emissions (lb/yr) <sup>5</sup>	Rule 212 Emission Limit (lb/yr) <sup>6</sup>	Further evaluation Required? <sup>7</sup>
1,1,1-Trichloroethane	71-55-6	No		1.9	0.000	0.017	0.106	100	N
1,1 - Dichloroethane	75-34-3	No	1.9	4.9	0.076	0.090	0.397	100	N
1,1 - Dichloroethene	75-35-4	No	1.2	0.75	0.048	0.027	0.110	100	N
Benzene	71-43-2	Yes	0.38	0.54	0.015	0.010	0.050	100	N
cis- 1,2-Dichloroethene	156-59-2	No	99.5	117	3.975	4.155	13.640	100	N
Tetrachloroethene	127-18-4	Yes	0.68	3.9	0.027	0.011	0.222	1000	N
Toluene	108-88-3	No	0.79	1.0	0.032	0.016	0.094	100	N
trans- 1,2-Dichloroethene	156-60-5	No	0.63	2.1	0.025	0.141	0.265	100	N
Trichloroethene	79-01-6	Yes	26	260	1.039	0.009	13.293	500	N
Vinyl Chloride	75-01-4	Yes	10	1.1	0.399	0.186	0.637	100	N
Xylenes <sup>3</sup>	1330-20-7	No	1.39	0.6	0.056	0.043	0.127	100	N
<b>Non-Project VOCs</b>									
1-Chloro-1,1-difluoroethane (Freon 142B)	75-68-3	No	0.45	47.7	0.018	0.000	2.265	100	N
2-Butanone	78-93-3	No	2.3	3.2	0.092	0.051	0.294	100	N
2-Hexanone	591-78-6	No		0.78	0.000	0.000	0.037	100	N
Acetone	67-64-1	No	14	0.5	0.559	0.323	0.906	100	N
Chlorodifluoromethane (Freon 22)	75-45-6	No	3.9	0.88	0.156	0.000	0.197	100	N
Chloromethane	74-87-3	No	1.7	0.56	0.068	0.013	0.108	100	N
Chloroform	67-66-3	Yes	6.8	21	0.272	0.307	1.568	100	N
Dichlorodifluoromethane (Freon 12)	75-71-8	No	2.2	2.2	0.088	0.019	0.211	100	N
Ethylbenzene	100-41-4	No	1.1		0.044	0.012	0.056	100	N
Methylene Chloride	75-09-2	No	0.97	5.6	0.039	0.024	0.326	100	N

Footnotes on last page

**Table 9**  
**2023 Rule 212 Evaluation**  
**Bethpage Park Soil Gas Containment System and Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**

Project VOCs	CAS#	HTAC? <sup>1</sup>	2023 BPGWCS Maximum Effluent Conc. (ug/m3) <sup>2,8</sup>	2023 BPSGCS Maximum Effluent Conc. (ug/m3) <sup>2,8</sup>	2023 BPGWCS Emissions (lb/yr) <sup>4</sup>	2023 BPSGCS Emissions - combined with ISTR (lb/yr) <sup>4</sup>	Facility Wide Emissions (lb/yr) <sup>5</sup>	Rule 212 Emission Limit (lb/yr) <sup>6</sup>	Further evaluation Required? <sup>7</sup>
<b>Non-Project VOCs (cont'd)</b>									
Trichlorofluoromethane (Freon 11)	75-69-4	No	1.1	1.5	0.044	0.016	0.130	100	N

**Flowrates**

Description	Flow (cfm)
BPGWCS	1220
BPSGCS - combined with ISTR	782

**Notes:**

- High toxicity air contaminant (HTAC) based on 6 CRR-NY Rule 212-2.2, Table 2 – high toxicity air contaminant list.
- Maximum effluent concentrations for soil gas effluent from VSP-601 and GW vapor from VSP-05 based on sampling performed in 2023. Compounds not detected above the laboratory reporting limit are excluded from the air quality impact analysis summary.
- Total for xylenes m, o, and P.
- Emission rate calculated based on maximum effluent concentration and maximum air flow rates measured during the sampling events. Emission rate standardized at 70 °F and 1 atm.  
 e.g., TCE (lb/yr) = TCE [µg/m<sup>3</sup>] x Air Flow Rate [ft<sup>3</sup>/min] x (1 m<sup>3</sup>/35.3147 ft<sup>3</sup>) x (60 min/hr) x (0.000001 g/1 µg) x (0.0022 lb/g) x 8,760 hrs/yr
- Combined 2022 emissions from groundwater, ISTR, and soil gas containment systems.
- 100 lb/yr for non-HTACs, and mass emission limits based on Rule 212-2.2, Table 2 for HTACs.
- For HTACs, no further demonstration (i.e., comparison to SGCs, AGCs, or air modeling) is required if the actual facility-wide emissions are less than mass emission limit. For non-HTACs, no further demonstration is required if the actual facility-wide emissions are less than 100 lbs/yr.
- Blank cell indicates that the compound was not detected above its laboratory quantification limit.



**Table 10**  
**Summary of Remedial Well Groundwater Sample Analytical Results - VOCs**  
**Bethpage Park Groundwater Containment System**  
**Operable Unit 3 (Former Grumman Settling Ponds)**  
**Northrop Grumman,**  
**Bethpage, New York**



**Notes, Abbreviations, Qualifiers, and Units:**


1. Water samples collected by Arcadis on the dates shown and submitted to a NYSDOH ELAP certified laboratory for VOC analyses per NYSDEC ASP 2005, Method OLM 4.3 (prior to September 1, 2014) and per USEPA Method 8260C (after September 1, 2014). Results validated following protocols specified in Sampling and Analysis Plan in the DRAFT Bethpage Park Groundwater Containment System OM&M Manual (Arcadis 2016). See previous quarterly reports for historical analytical results.
2. "Total VOCs" represents the sum of individual concentrations of the VOCs detected.
3. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

ASP	Analytical Services Protocol
ELAP	Environmental Laboratory Approval Program
NE	Not Established
NYSDEC	New York State Department of Environmental Conservation
NYSDOH	New York State Department of Health
OLM	Ozone Limited Method
OM&M	Operation, Maintenance, and Monitoring
SCGs	Standards, Criteria, and Guidance values
USEPA	United States Environmental Protection Agency
VOC	Volatile Organic Compound


<b>1.2</b>	Bold cell outline indicates an exceedance of an SCG
<b>1.2</b>	Bold data indicates a detection
< 1.0	Compound not detected above its laboratory quantification limit
J	Compound detected below its reporting limit; value is estimated
U	Indicates the compound was analyzed for but not detected above the specified level
<b>ND</b>	Analyte not detected at, or above its laboratory quantification limit.
µg/L	micrograms per liter

# Figures

CITY:SYRACUSE,NY DIV:GROUP:ENV DB:A.SANCHEZ TM:(Op) LVR:(Op)ION:"OFF-REF" PLOT: 11/11/2015 4:54 PM BY: STOWELL, GARY  
 G:\ENV\CAD\STRACUSE\ACT\1001496114\DOMINANT\1496\_801.dwg LAYOUT: BETHPAGE PARK SAVED: 11/11/2015 4:51 PM ACADVER: 19.1.S (LMS TECH) PAGES: 19.1.S (LMS TECH) PAGES: 19.1.S (LMS TECH) PAGES: 19.1.S (LMS TECH) PAGES: 19.1.S (LMS TECH) PAGES: 19.1.S (LMS TECH)

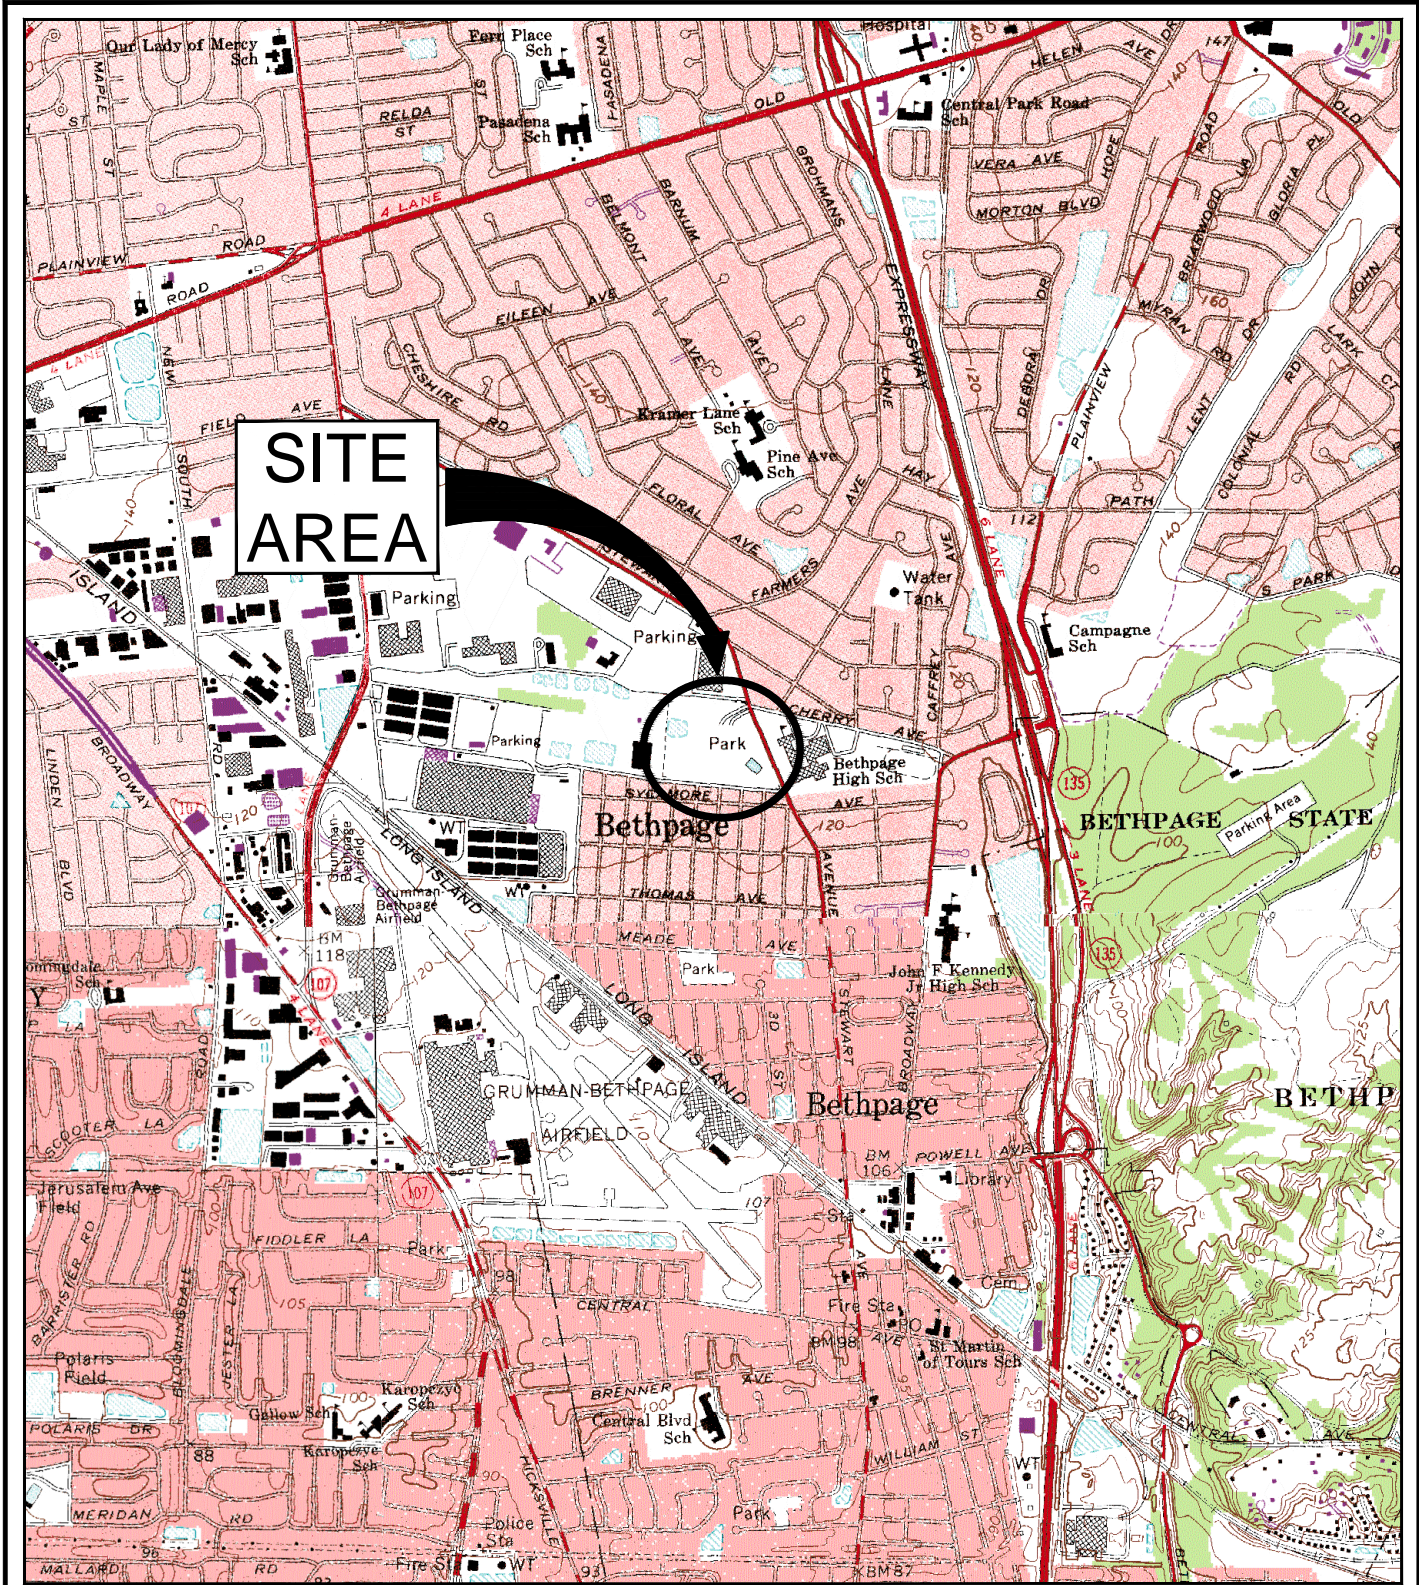


SOURCE:  
 USGS 7.5 MIN. AMITYVILLE QUADRANGLE, AMITYVILLE, N.Y., 1994, FREEPORT QUADRANGLE, FREEPORT, N.Y., 1994,  
 HICKSVILLE QUADRANGLE, HICKSVILLE, N.Y., 1967, PHOTOREVISED 1979, HUNTINGTON, N.Y., 1967, PHOTOREVISED 1979

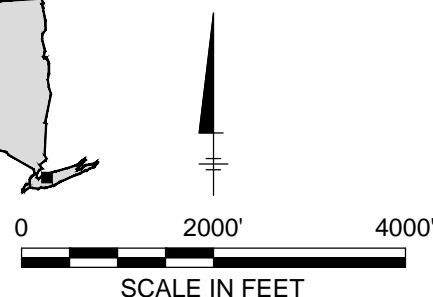

<p>BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM          OPERABLE UNIT 3          (FORMER GRUMMAN SETTLING PONDS)          BETHPAGE, NEW YORK</p>	
<p><b>SITE LOCATION</b></p>	
	<p>FIGURE  <b>1</b></p>



CITY:SYRACUSE-NY DIV:GROUP:ENV DBA:SANCHEZ LD:AS PIC:(Opt) PM:(Read) TM:(Opt) Lyr:(ON)OFF=REF  
 C:\Users\lsanchez\OneDrive - ARCADIS\BIM 360 Docs\NORTHROP GRUMMAN\0MM4\IN\1498801.DWG LAYOUT: 2 SAVED: 8/16/2018 1:24 PM ACADVER: 21.05 (LMS TECH) PAGESETUP: --- PLOTSTYLETABLE: --- PLOTTED: 8/16/2018 1:24 PM BY: SANCHEZ, ADRIAN  
 XREFS: X1:498800 X-ON:SITE-BASE SITE  
 PROJECT NAME: ---

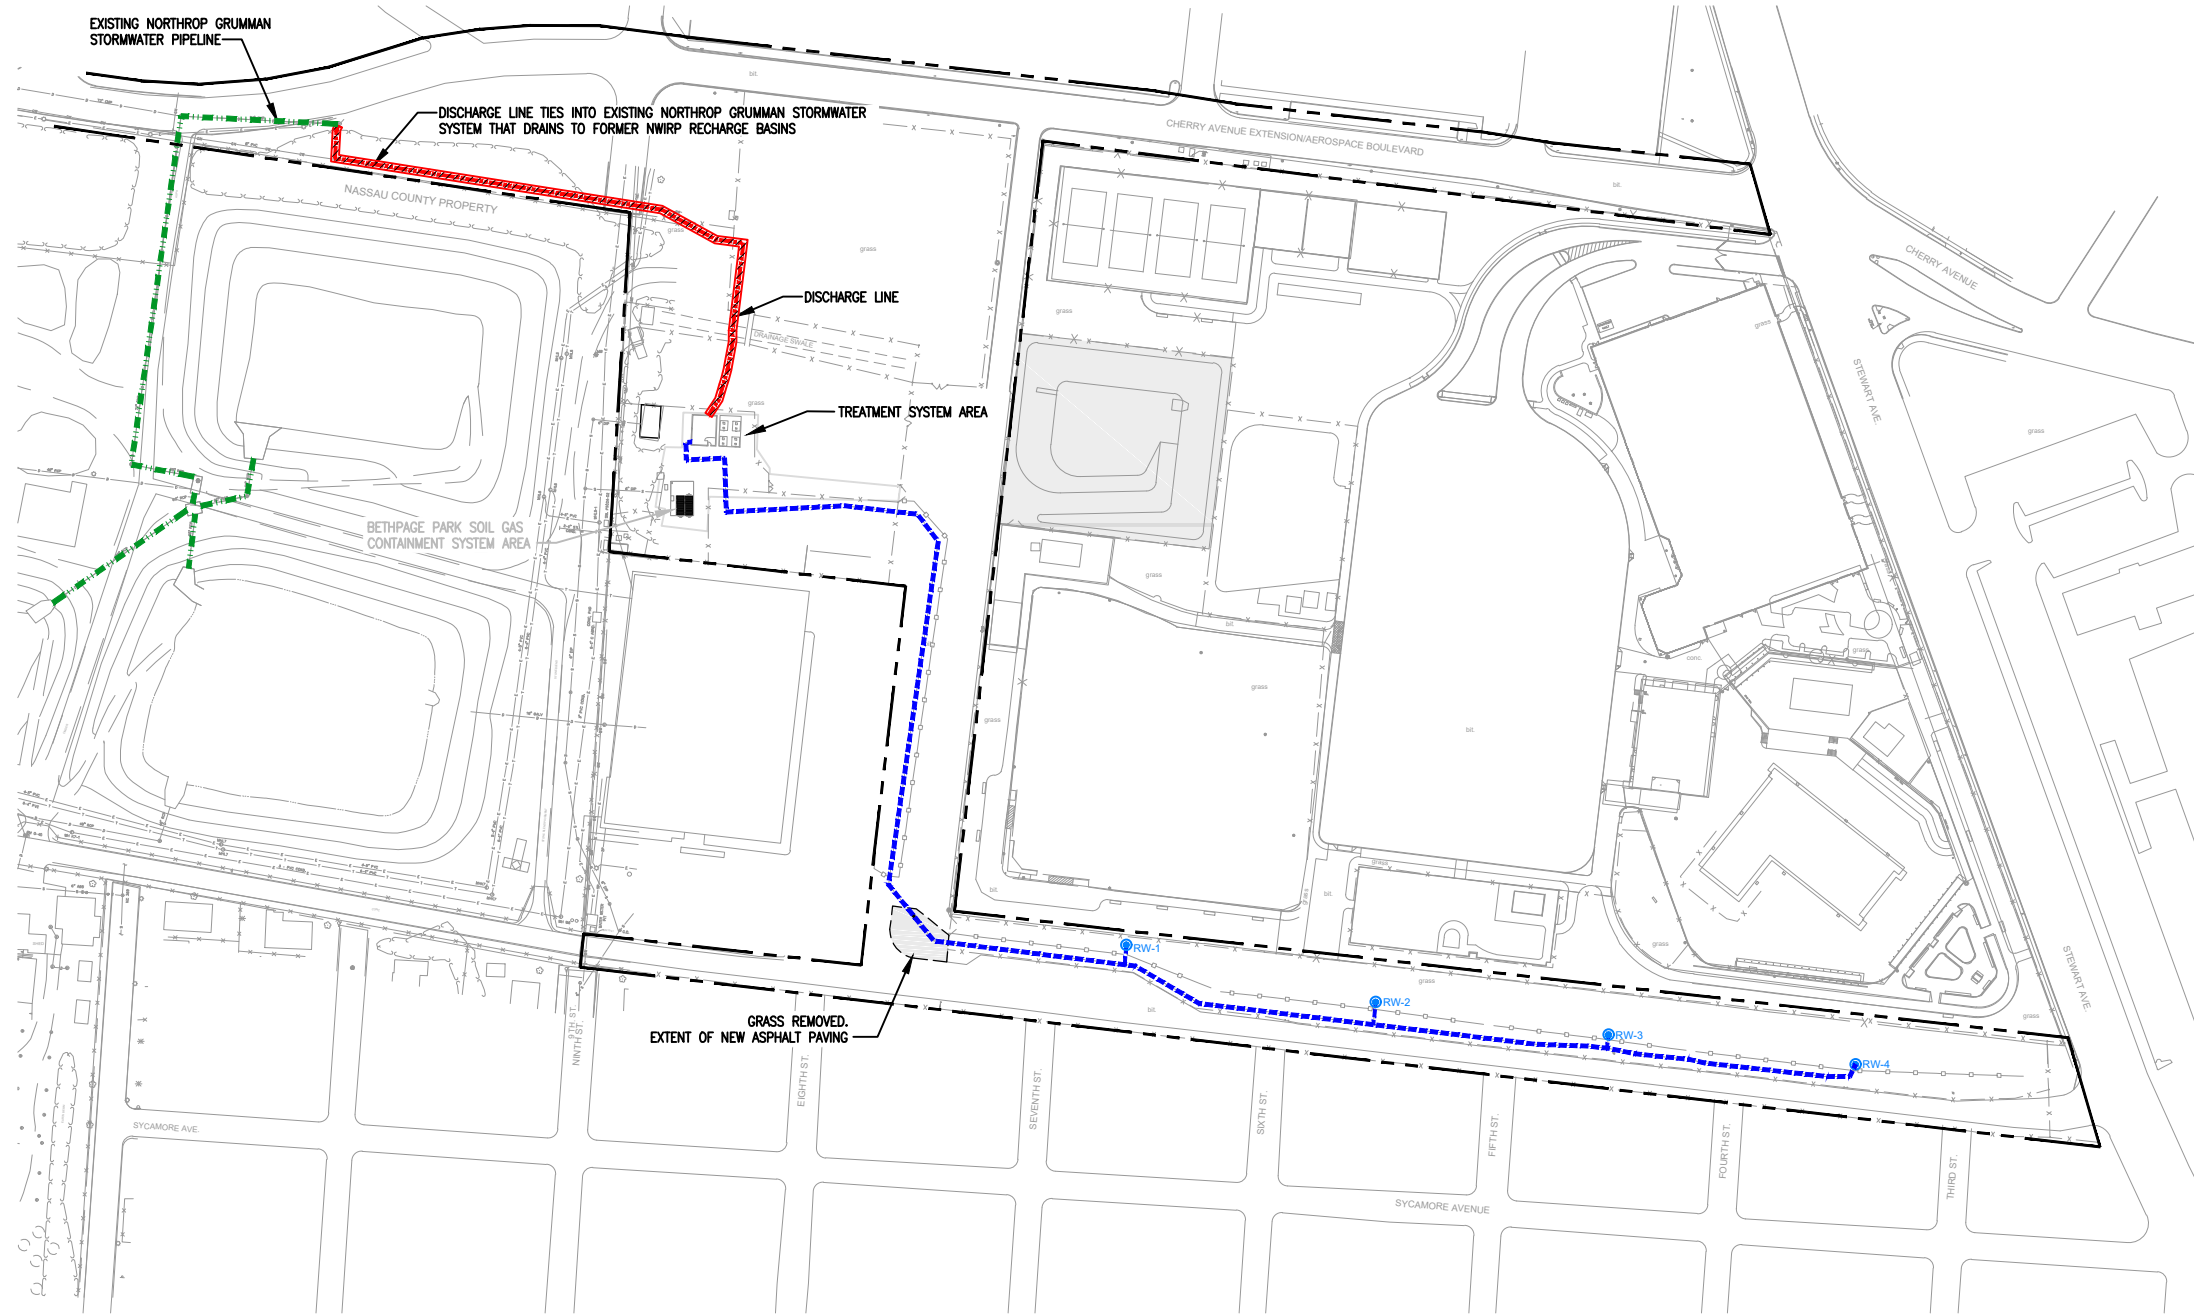


- LEGEND:**
- NORTHROP GRUMMAN PROPERTY LINE
  - FENCE
  - BITUMINOUS PAVEMENT
  - INFLUENT PIPELINE AND ELECTRICAL CONDUITS
  - EFFLUENT PIPELINE
  - EXISTING NORTHROP GRUMMAN STORMWATER PIPELINE
  - REMEDIAL WELL
  - NWIRP



BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
 OPERABLE UNIT 3  
 (FORMER GRUMMAN SETTLING PONDS)  
 BETHPAGE, NEW YORK

**SITE AND  
 GROUNDWATER CONTAINMENT SYSTEM**

FIGURE  
**2**

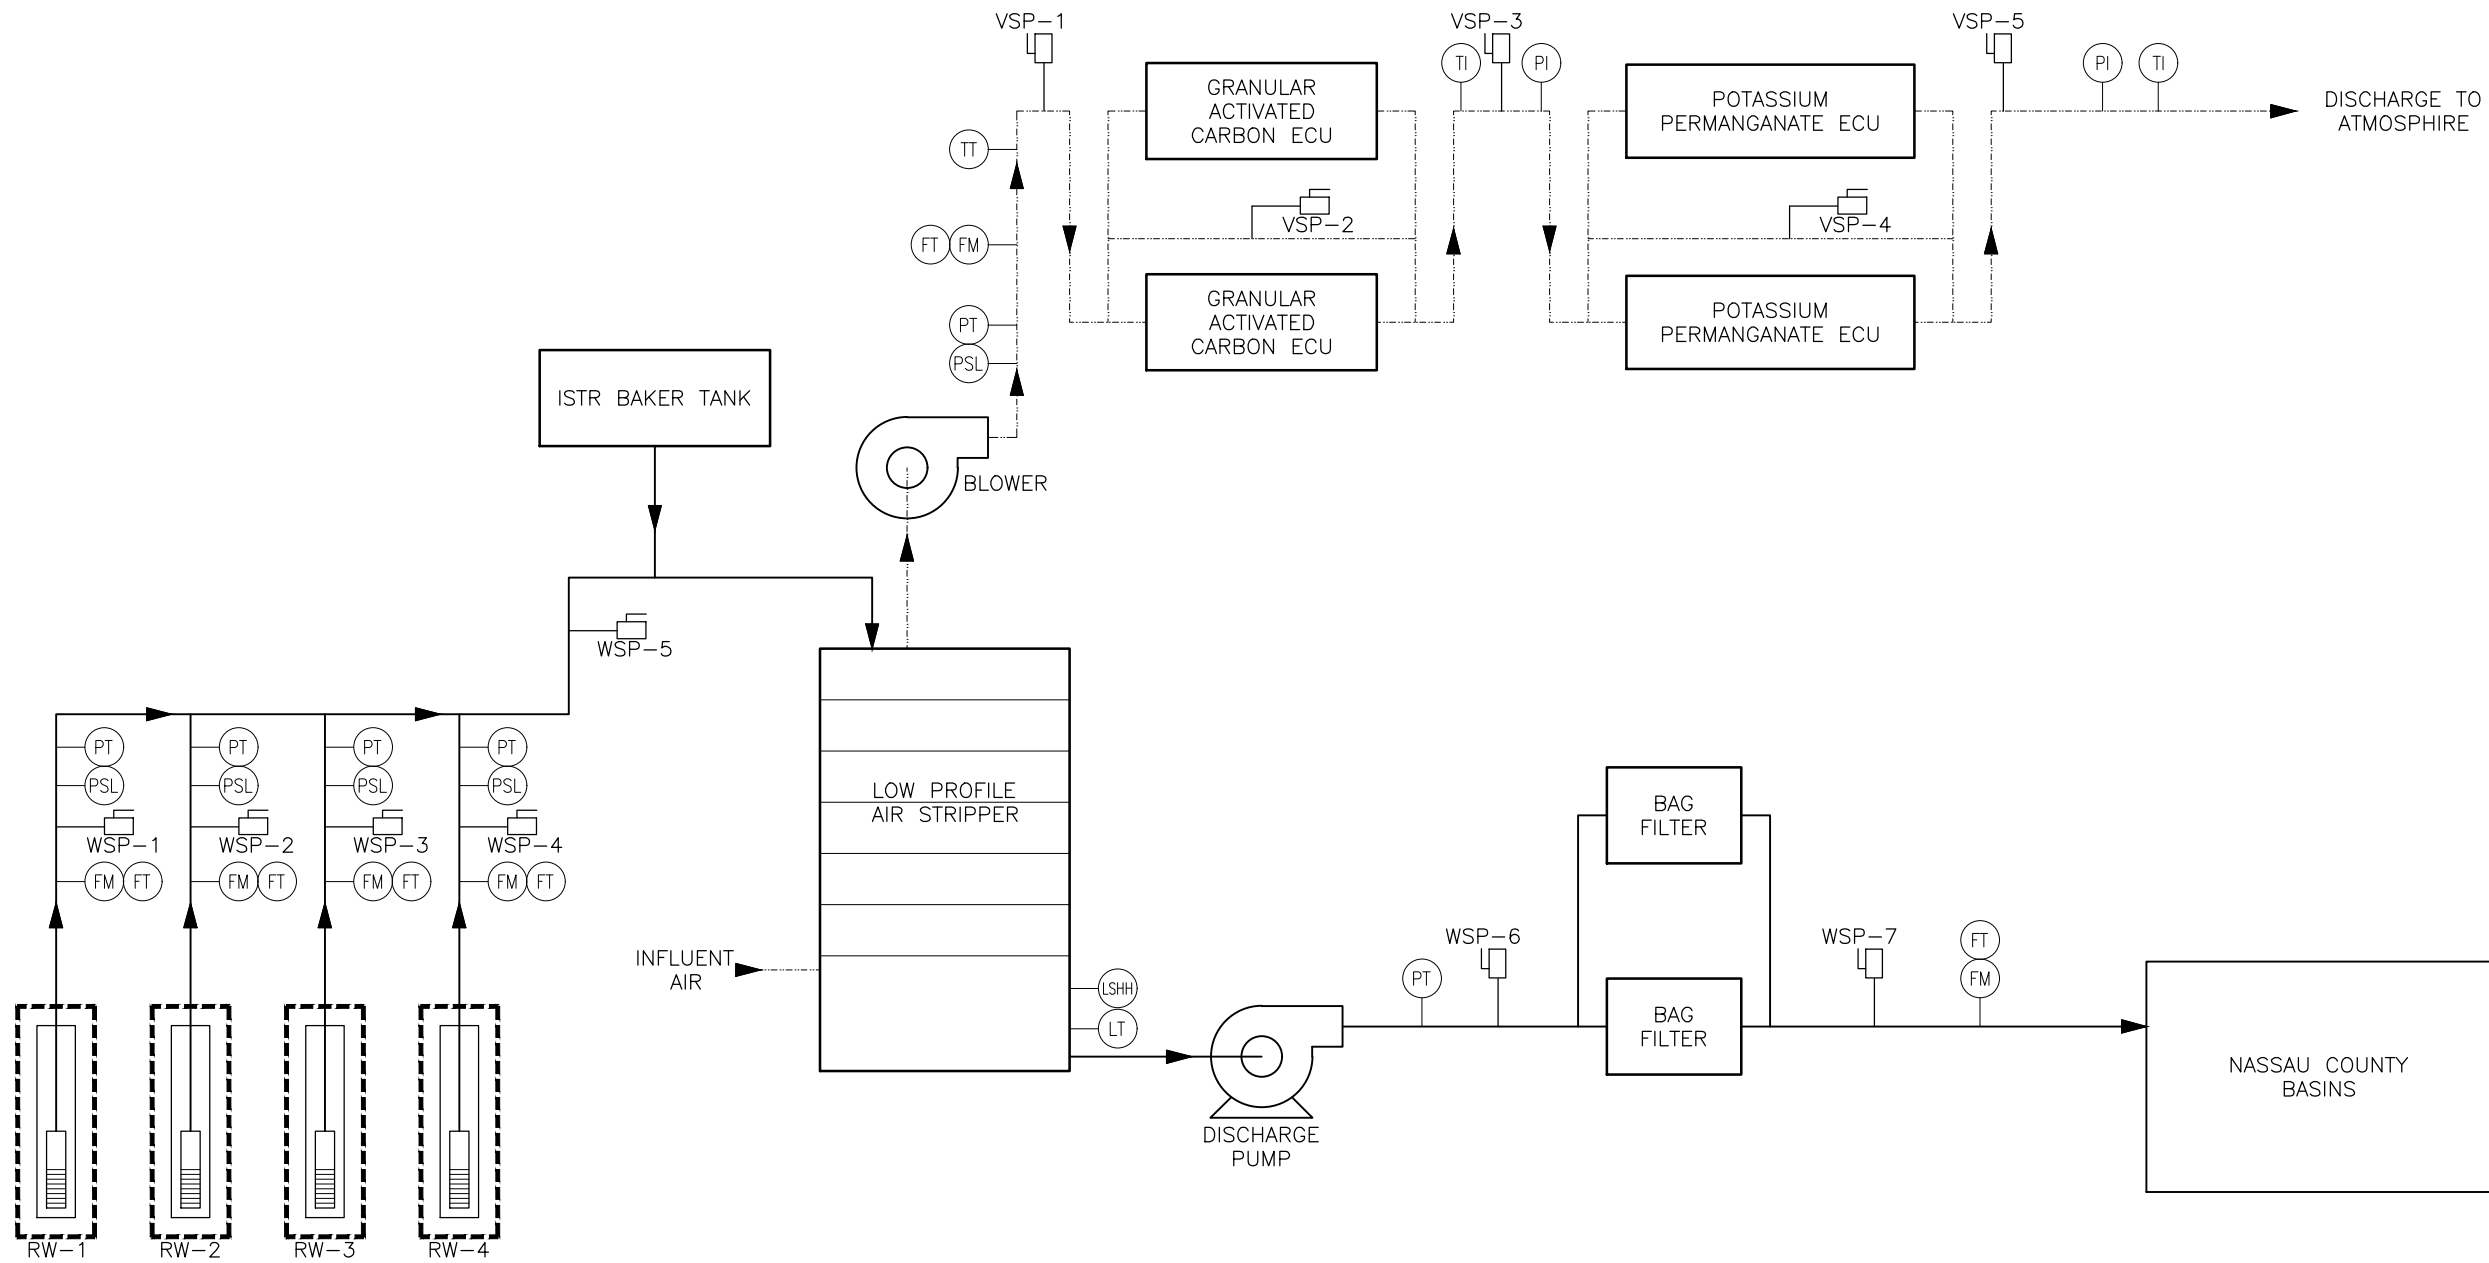


- LEGEND:**
- PROCESS WATER
  - - - PROCESS AIR
  - ⊖ INSTRUMENT
  - SAMPLE PORT
  - ▶ FLOW DIRECTION
  - FM FLOW METER
  - FT FLOW RATE TRANSMITTER
  - PSL PRESSURE VACUUM LOW
  - PT PRESSURE TRANSMITTER
  - PI PRESSURE INDICATOR
  - LSHH LEVEL SWITCH HIGH HIGH
  - LT LEVEL TRANSMITTER
  - TT TEMPERATURE TRANSMITTER
  - TI TEMPERATURE INDICATOR
  - WSP WATER SAMPLE PORT
  - VSP VAPOR SAMPLE PORT
  - ECU EMISSION CONTROL UNIT

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
 OPERABLE UNIT 3  
 (FORMER GRUMMAN SETTLING PONDS)  
 BETHPAGE, NEW YORK

**GROUNDWATER TREATMENT SYSTEM  
 PROCESS SCHEMATIC,  
 PROCESS FLOW DIAGRAM,  
 AND MONITORING LOCATIONS**

**ARCADIS** | FIGURE  
**3**

CITY: SYRACUSE, NY DIV: GROUP: ENV DB: A: SANCHEZ, LDALS, PIC: (04) PM: (Read) TM: (04) LVR: (OPTION) OFF: REF  
 C:\Users\lsanchez\OneDrive - ARCADIS\BIM360 Docs\NORTHROP GRUMMAN\COMM\141466RPH4801.dwg LAYOUT: 4. SAVED: 01/19/2018 7:41 PM ACADVER: 21.08 (LMS TECH) PAGESETUP: PLOTSTYLETABLE: PLOTSTYLETABLE: PLOTTED: 8/10/2018 1:18 PM BY: SANCHEZ, ADRIAN  
 AREAS: IMAGES: PROJECTNAME: XREFS: XREF: SITE-BASE SITE XT146654

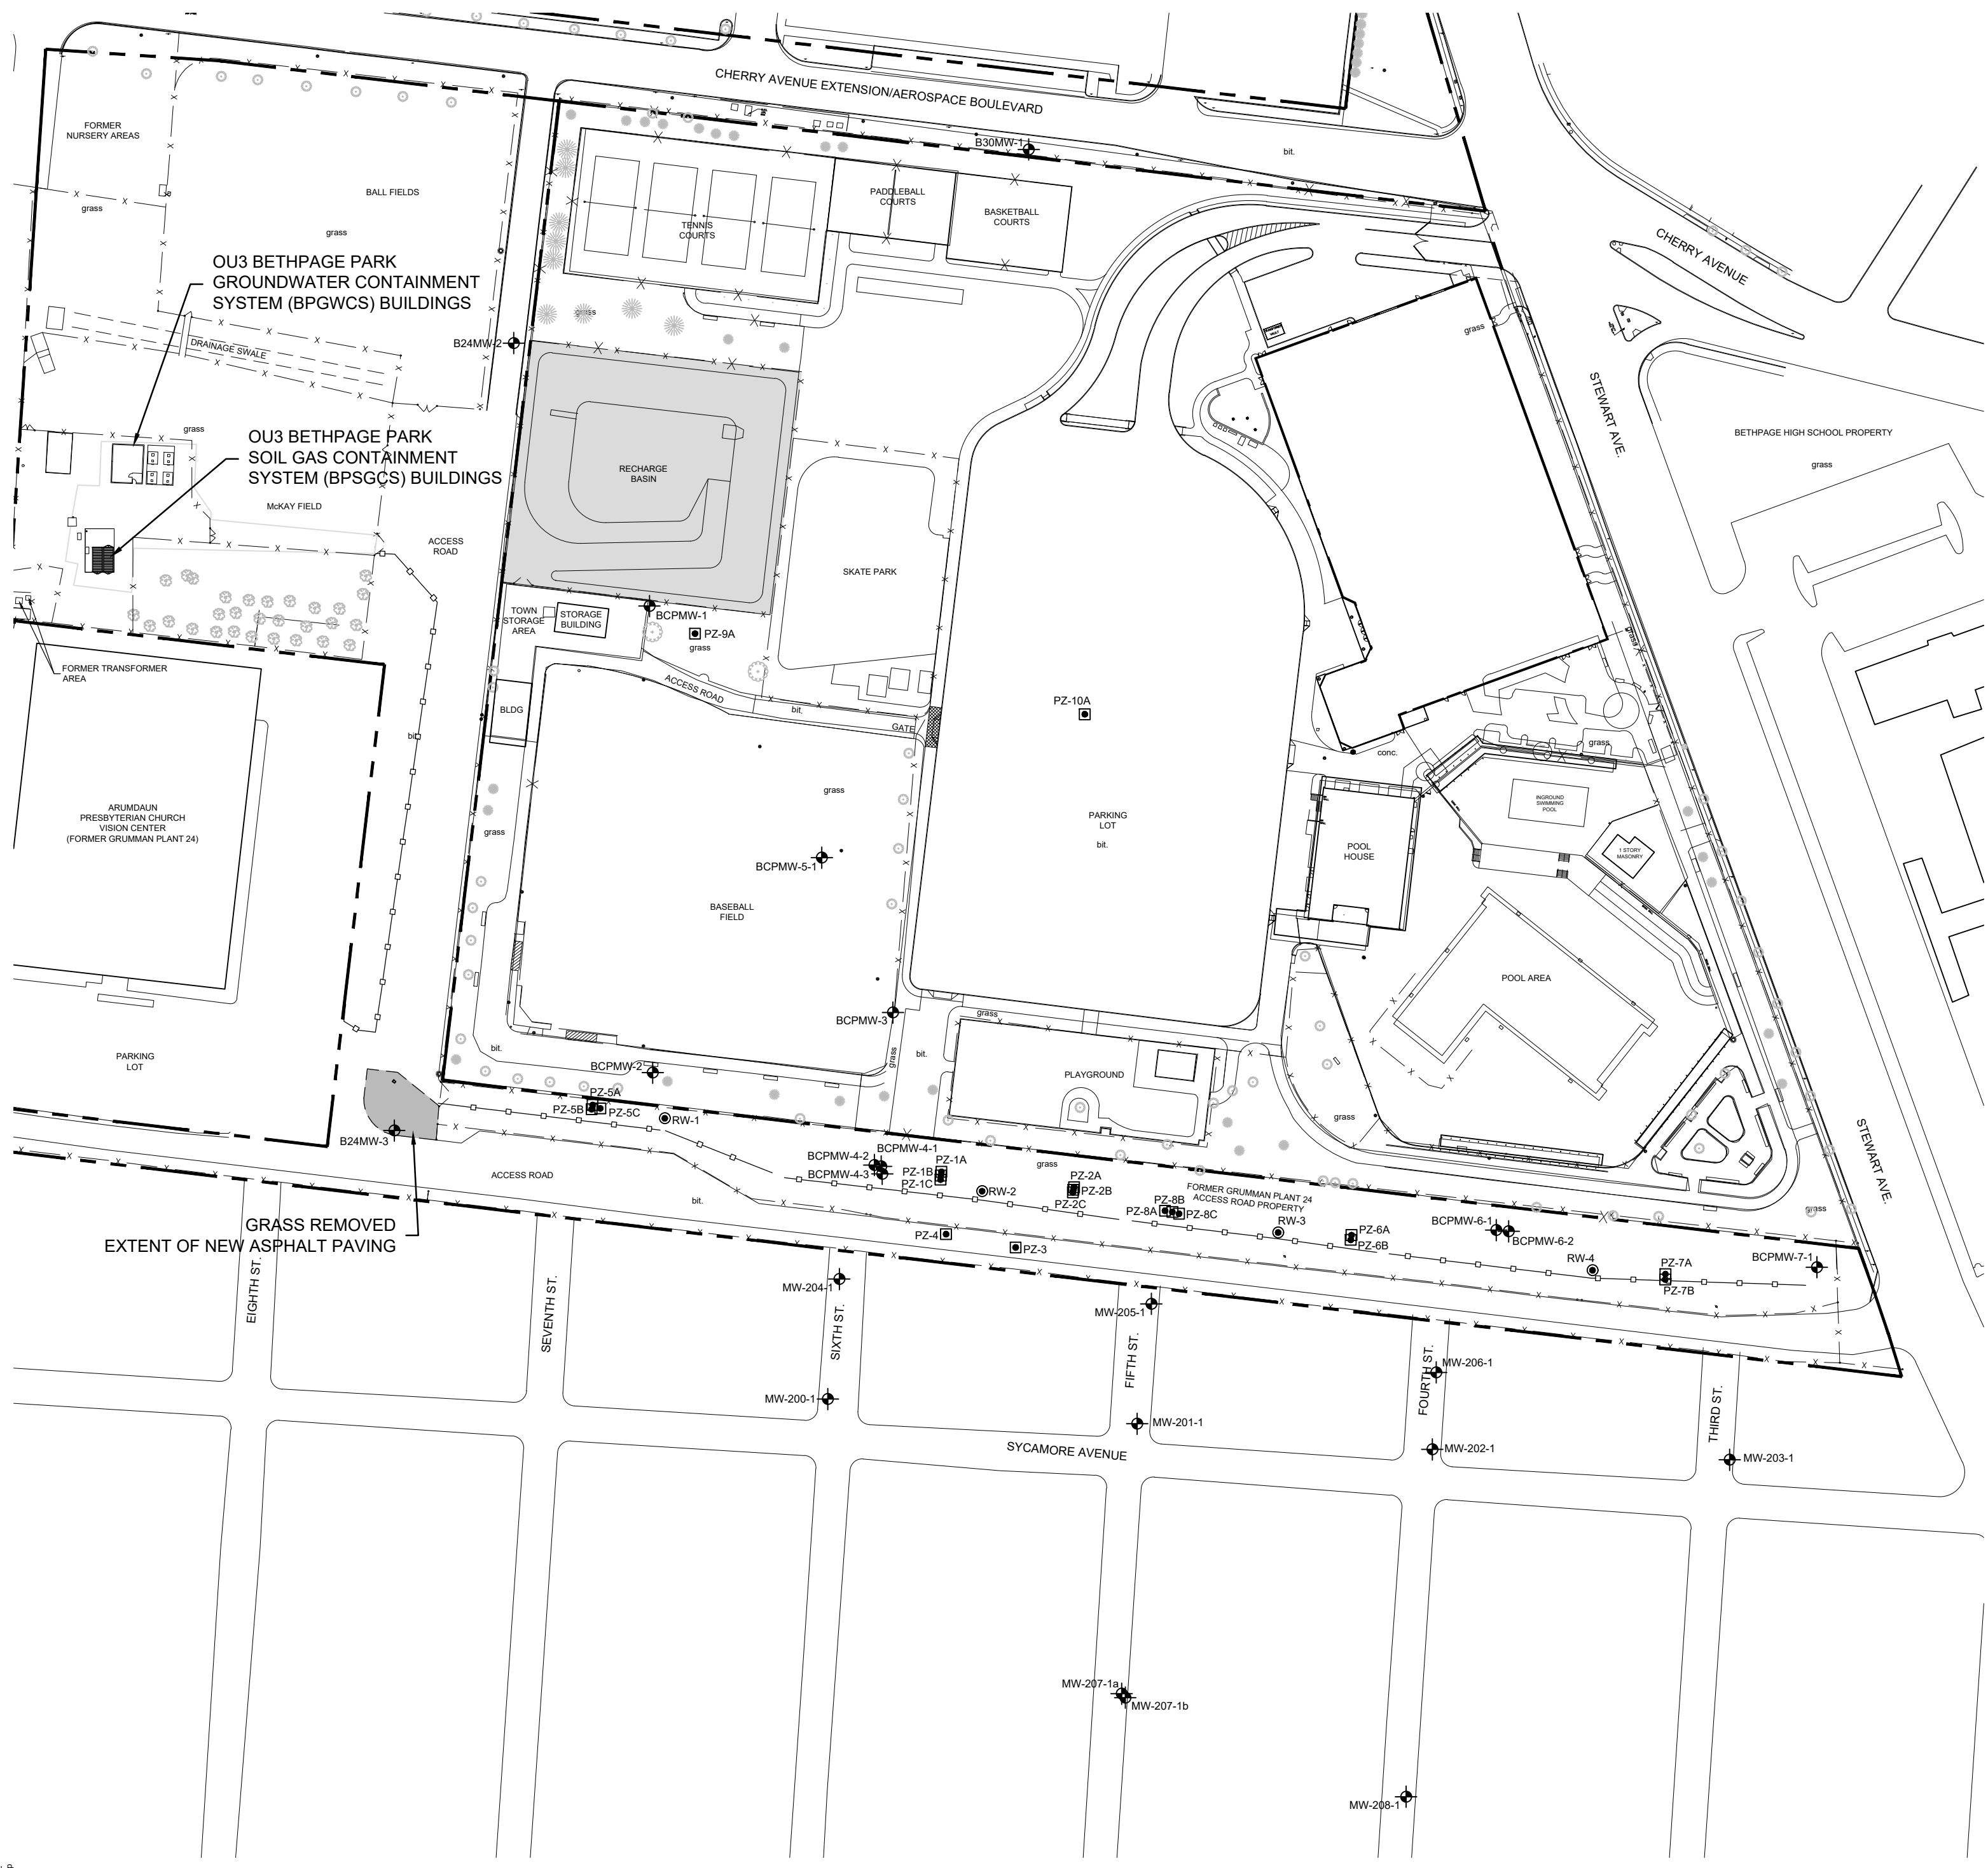


- EXPLANATION:**
- NORTHROP GRUMMAN PROPERTY LINE
  - x - x - FENCE
  - [Hatched Box] BASIN
  - bit. BITUMINOUS PAVEMENT
  - MW-200-1 [Well Symbol] MONITORING WELL
  - RW-2 [Well Symbol] REMEDIAL WELL
  - PZ-2C [Well Symbol] PIEZOMETER

- NOTES:**
1. MONITORING WELLS, REMEDIAL WELLS, AND PIEZOMETERS SURVEYED TO NORTH AMERICAN DATUM (NAD) 83.



BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
OPERABLE UNIT 3  
(FORMER GRUMMAN SETTLING PONDS)  
BETHPAGE, NEW YORK

**GROUNDWATER MONITORING NETWORK  
SITE PLAN**

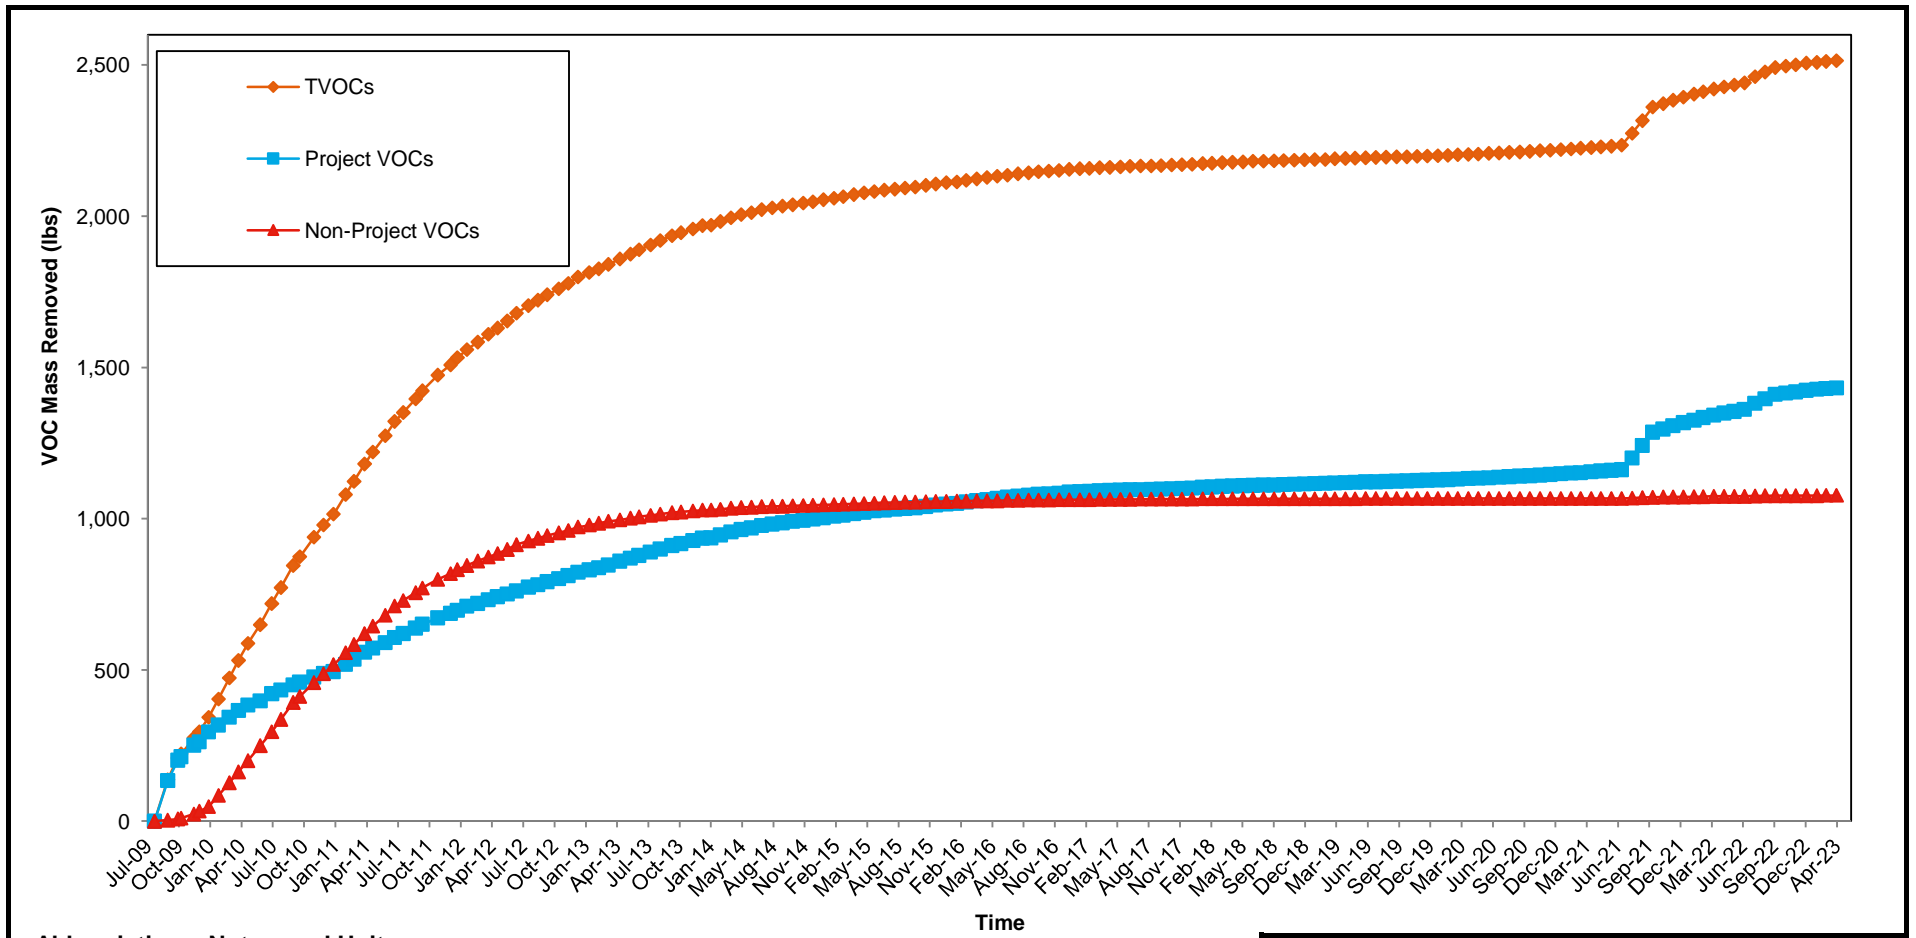

**Abbreviations, Notes, and Units:**

VOC = Volatile Organic Compound  
 TVOCs = Total VOCs removed


Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.

Non-Project VOCs = sum of VOCs that are not Project VOCs.

1. A notable increase in VOC mass removal was observed between Q3 2021 and Q1 2022 due to the increase in TVOCs detected (Figures 6A)
2. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

lbs = pounds

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK	
<b>CUMULATIVE TOTAL, PROJECT, AND          NON-PROJECT VOC MASS REMOVED</b>	
	<b>FIGURE          5</b>

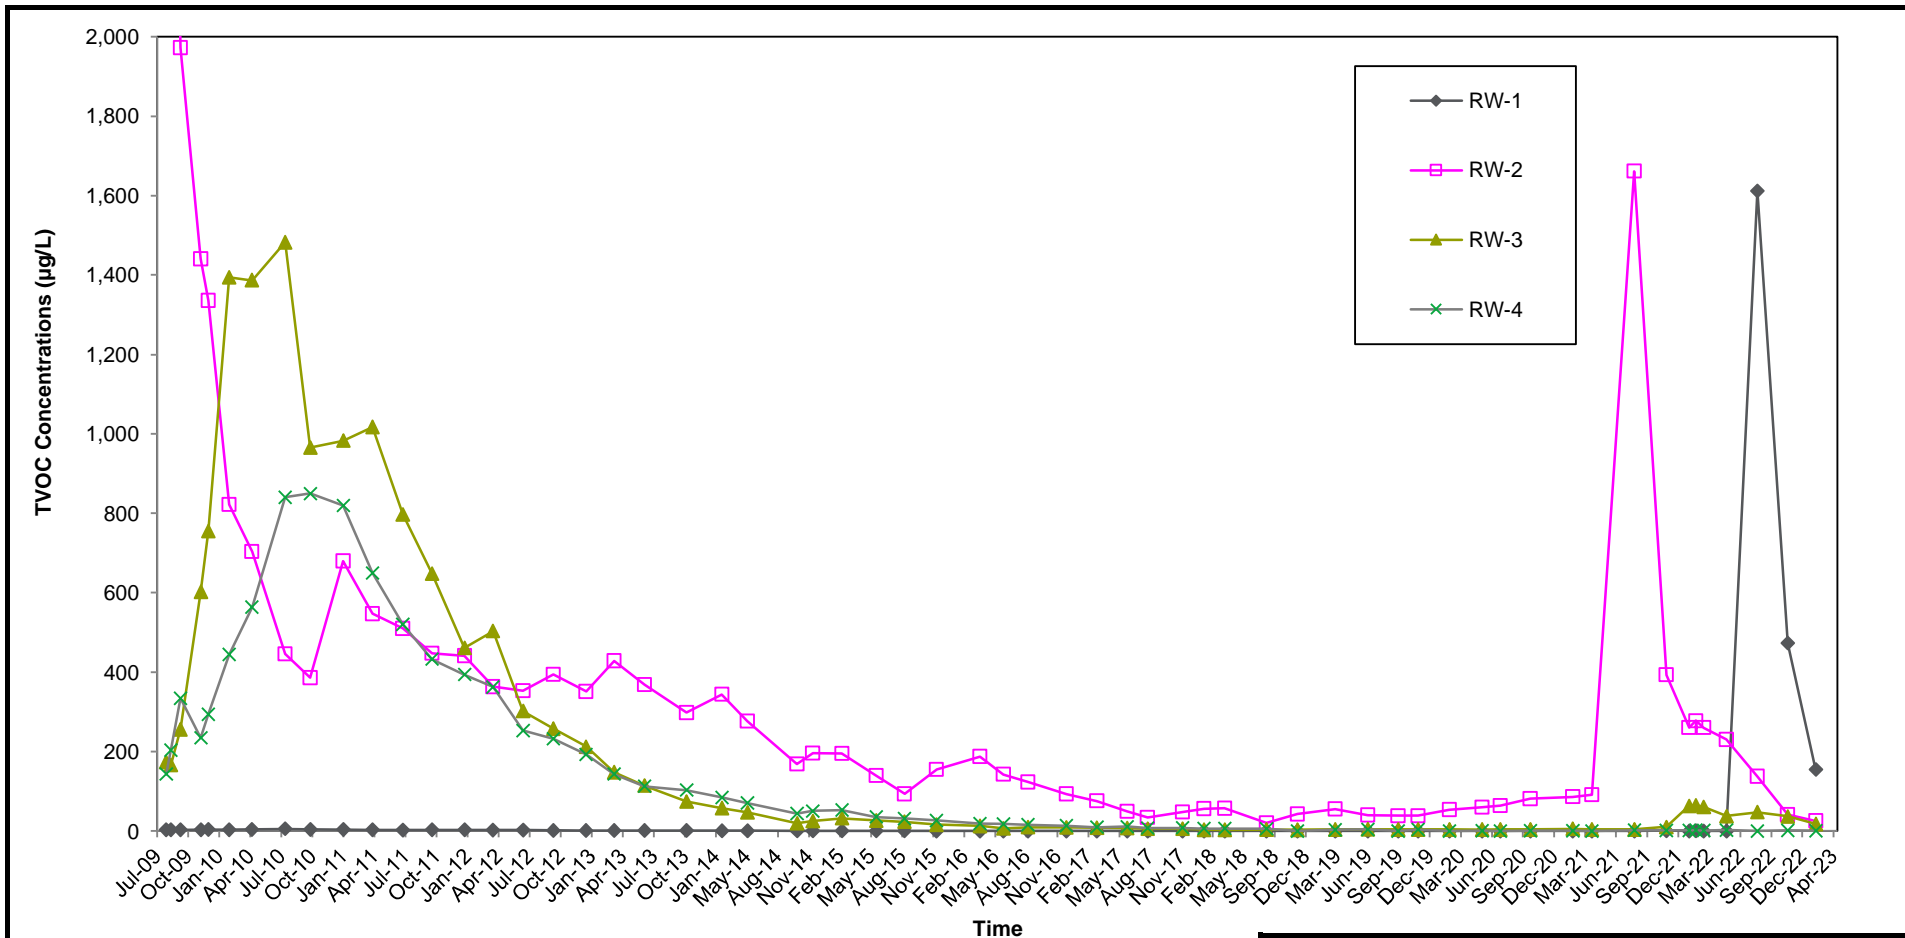

**Abbreviations, Notes, and Units:**

VOC = Volatile Organic Compound  
 TVOCs = Total VOCs detected

1. Results prior to September 10, 2009 are not shown to improve figure clarity. The TVOC concentrations were greater than 2,000 µg/L. See previous reports for full data set.
2. A notable increase in TVOCs was detected in the August 13, 2021, sample from RW-2. This increase is likely due to the ISTR system activities on the Bethpage Community Park property
3. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells. A notable increase in TVOCs was detected in the August 22, 2022 sample from RW-1, which is likely due to the addition of BCPMW-4-1 and BCPMW-4-2.


µg/L = micrograms per liter

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
 OPERABLE UNIT 3  
 (FORMER GRUMMAN SETTLING PONDS)  
 BETHPAGE, NEW YORK

**REMEDIAL WELL TOTAL VOC CONCENTRATIONS**



**FIGURE 6A**

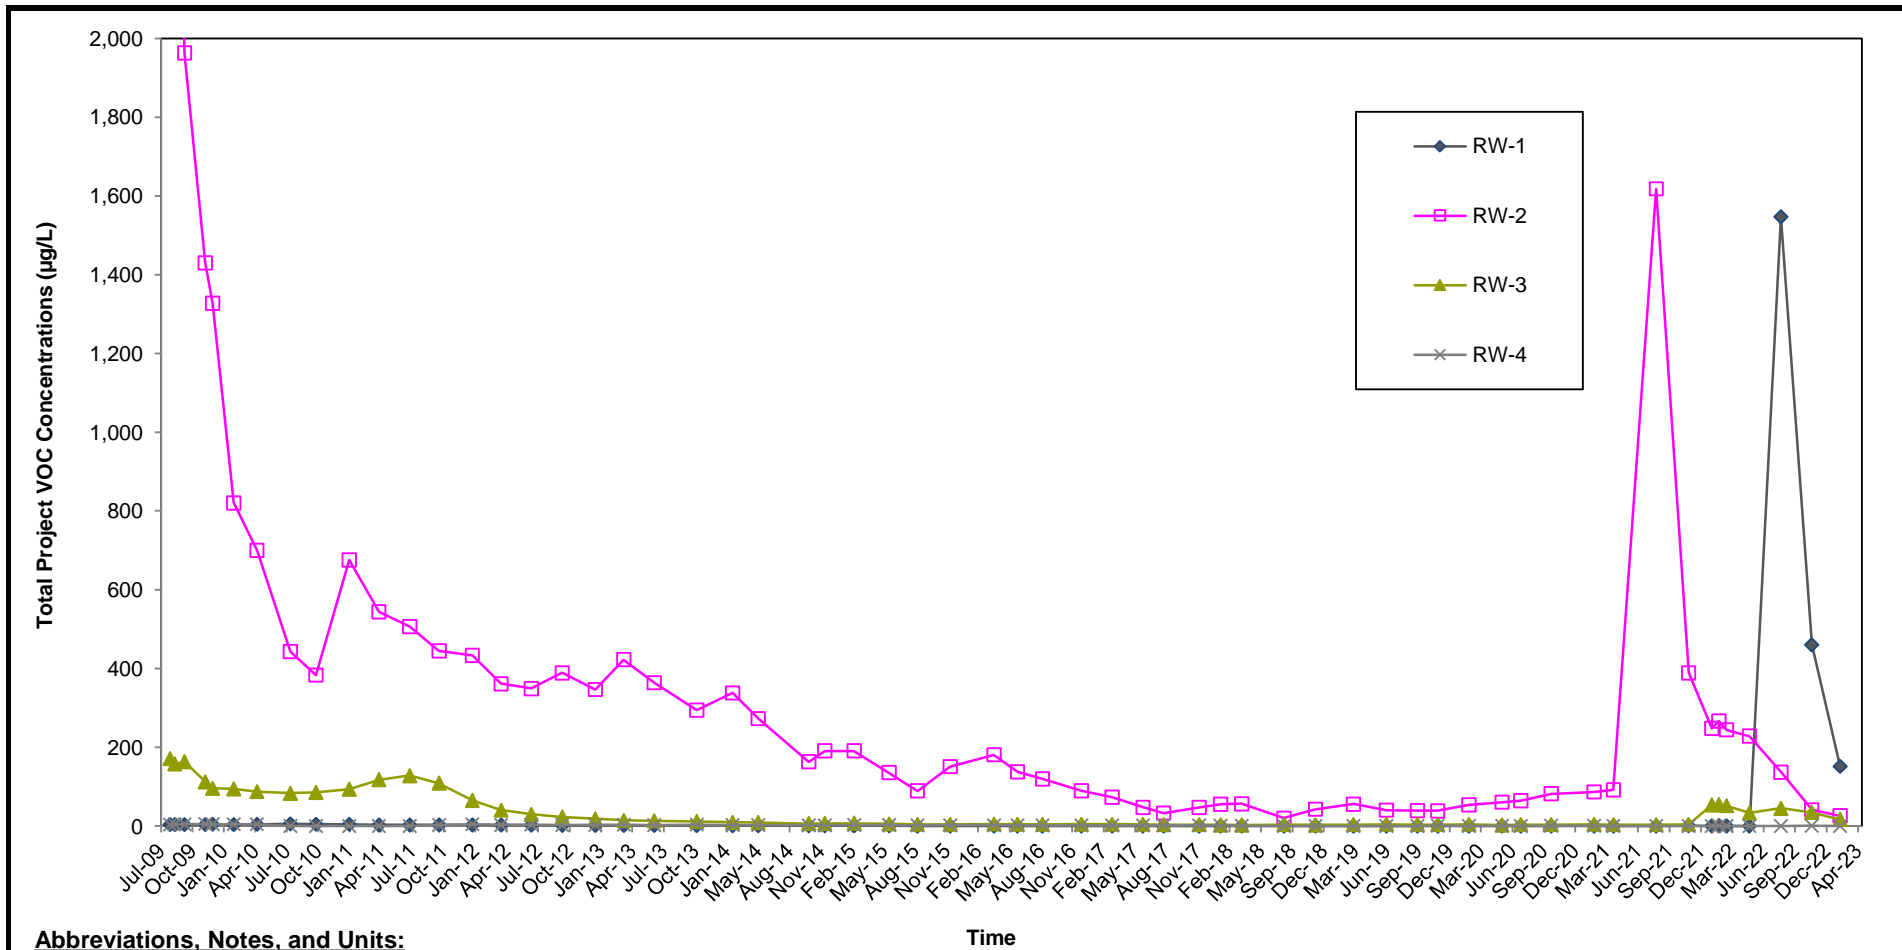

**Abbreviations, Notes, and Units:**


VOC = Volatile Organic Compound  
 TVOCs = Total VOCs detected

Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.

1. Results prior to September 10, 2009 are not shown to improve figure clarity. Total Project VOC concentrations are greater than 2,000 µg/L. See previous reports for full data set.
2. A notable increase in Project VOCs was detected in the August 13, 2021, sample from RW-2. This increase is likely due to the ISTR system activities on the Bethpage Community Park property
3. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells. A notable increase in TVOCs was detected in the August 22, 2022 sample from RW-1, which is likely due to the addition of BCPMW-4-1 and BCPMW-4-2.

µg/L = micrograms per liter

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK	
<b>REMEDIAL WELL PROJECT VOC          CONCENTRATIONS</b>	
	<b>FIGURE          6B</b>

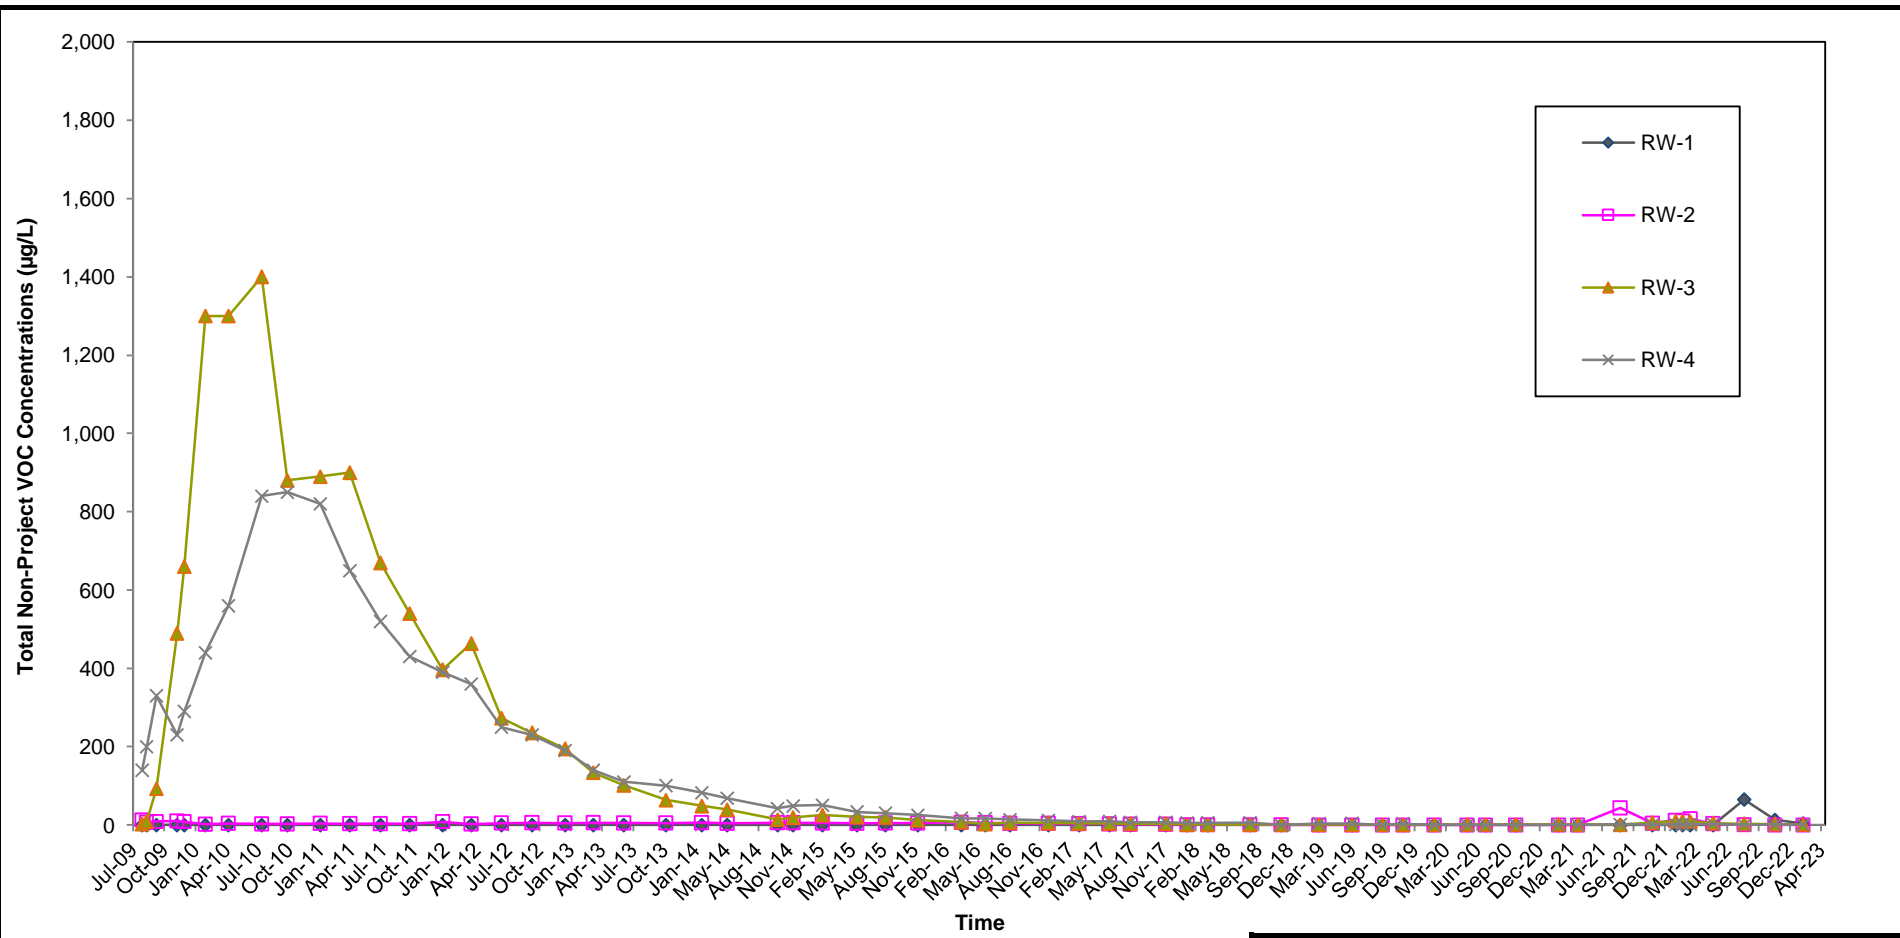

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
 OPERABLE UNIT 3  
 (FORMER GRUMMAN SETTLING PONDS)  
 BETHPAGE, NEW YORK

**REMEDIAL WELL NON-PROJECT VOC CONCENTRATIONS**


**ARCADIS** **FIGURE 6C**

**Abbreviations, Notes, and Units:**

VOC = Volatile Organic Compound  
 TVOCs = Total VOCs detected.

Non-Project VOCs = sum of TVOCs that are not Project VOCs.

1. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells. A notable increase in TVOCs was detected in the August 22, 2022 sample from RW-1, which is likely due to the addition of BCPMW-4-1 and BCPMW-4-2.

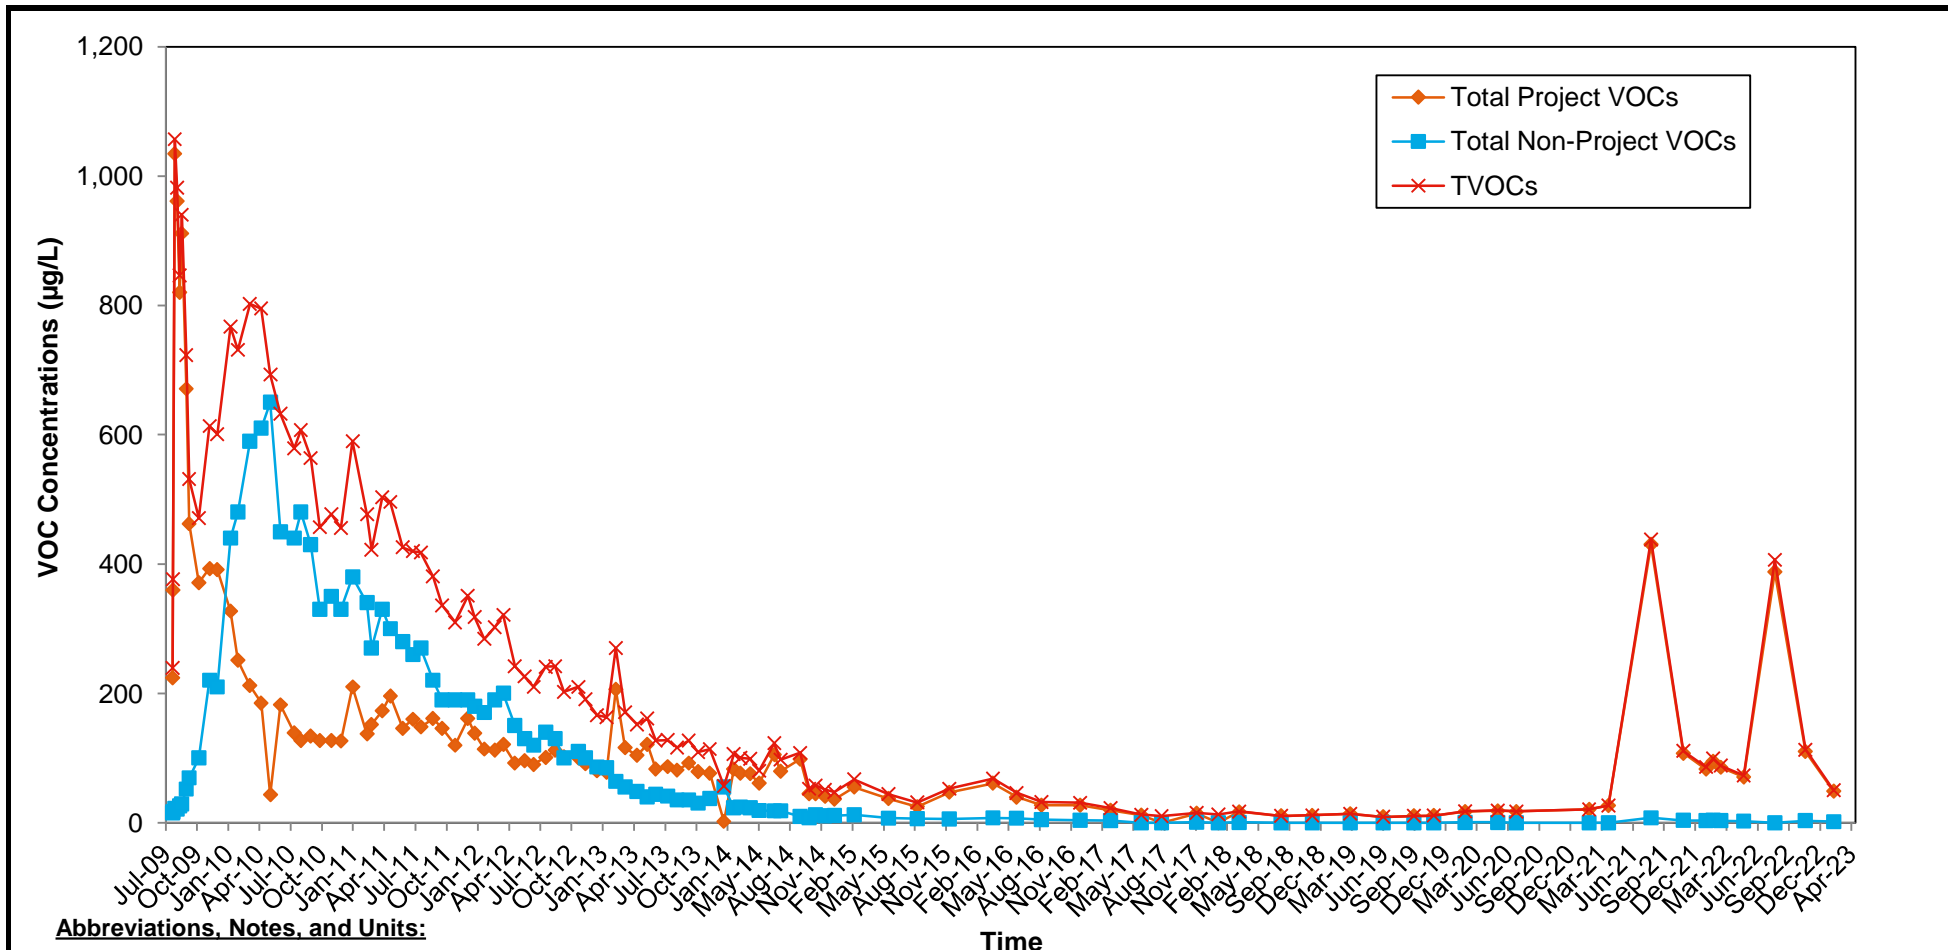

**Abbreviations, Notes, and Units:**

VOC = Volatile Organic Compound  
 TVOCs = Total VOCs detected.

Project VOCs = sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes.


Non-Project VOCs = sum of VOCs that are not Project VOCs.

1. Quarter 4 2020 sampling was conducted during ISTR Baker Tank discharge. The combined Influent sample port (WSP-5) is located upstream of the ISTR connection into the influent line. Due to this setup, the combined influent port (WSP-5) was not sampled as it would not be representative of the true combined influent.
2. A notable increase in VOCs was detected in the August 13, 2021, system influent sample. This increase is likely due to the ISTR system activities on the Bethpage Community Park property
3. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells. A notable increase in TVOCs was detected in the August 22, 2022 sample from RW-1, which is likely due to the addition of BCPMW-4-1 and BCPMW-4-2.

µg/L = micrograms per liter

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK	
<b>INFLUENT TOTAL, PROJECT          AND NON-PROJECT          VOC CONCENTRATIONS</b>	
	<b>FIGURE          7</b>



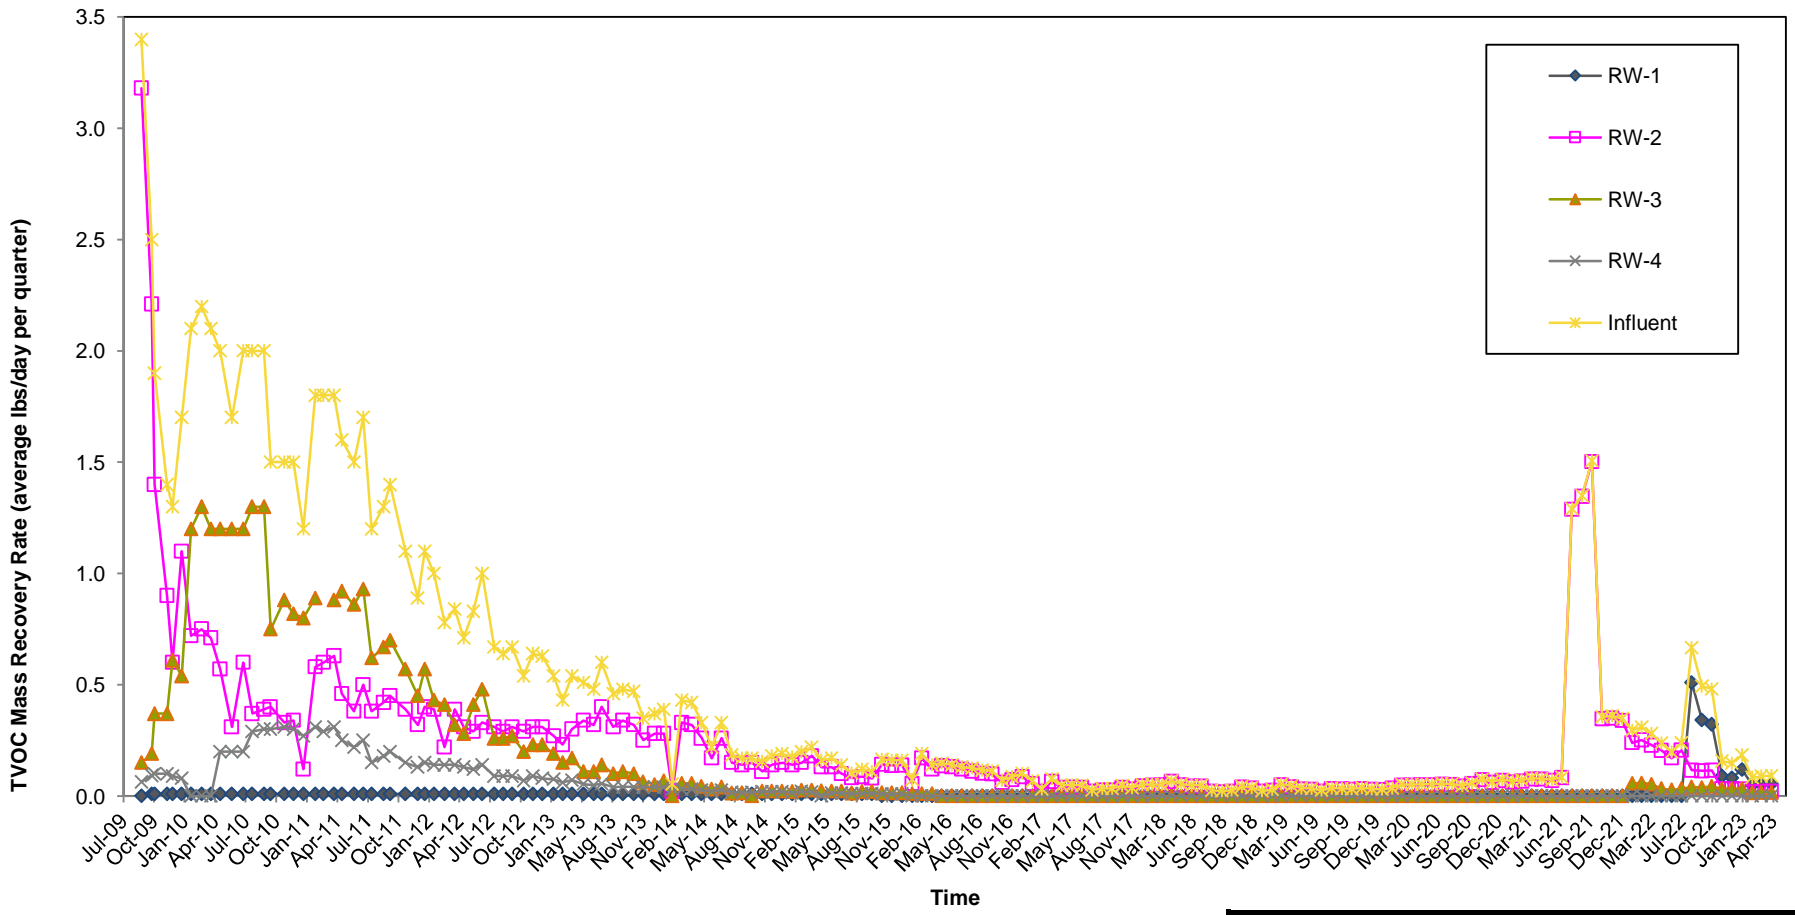


**Abbreviation, Notes, and Units:**

VOC = Volatile Organic Compound  
 TVOCs = Total VOCs

1. A notable increase in TVOC mass recovery rates was observed between Q3 2021 and Q1 2022 due to the increase in TVOCs detected (Figure 6A)
2. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells. A notable increase in TVOCs was detected in the August 22, 2022 sample from RW-1, which is likely due to the addition of BCPMW-4-1 and BCPMW-4-2.

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM OPERABLE UNIT 3 (FORMER GRUMMAN SETTLING PONDS) BETHPAGE, NEW YORK	
<b>TOTAL VOC MASS RECOVERY RATES</b>	
	<b>FIGURE 8A</b>

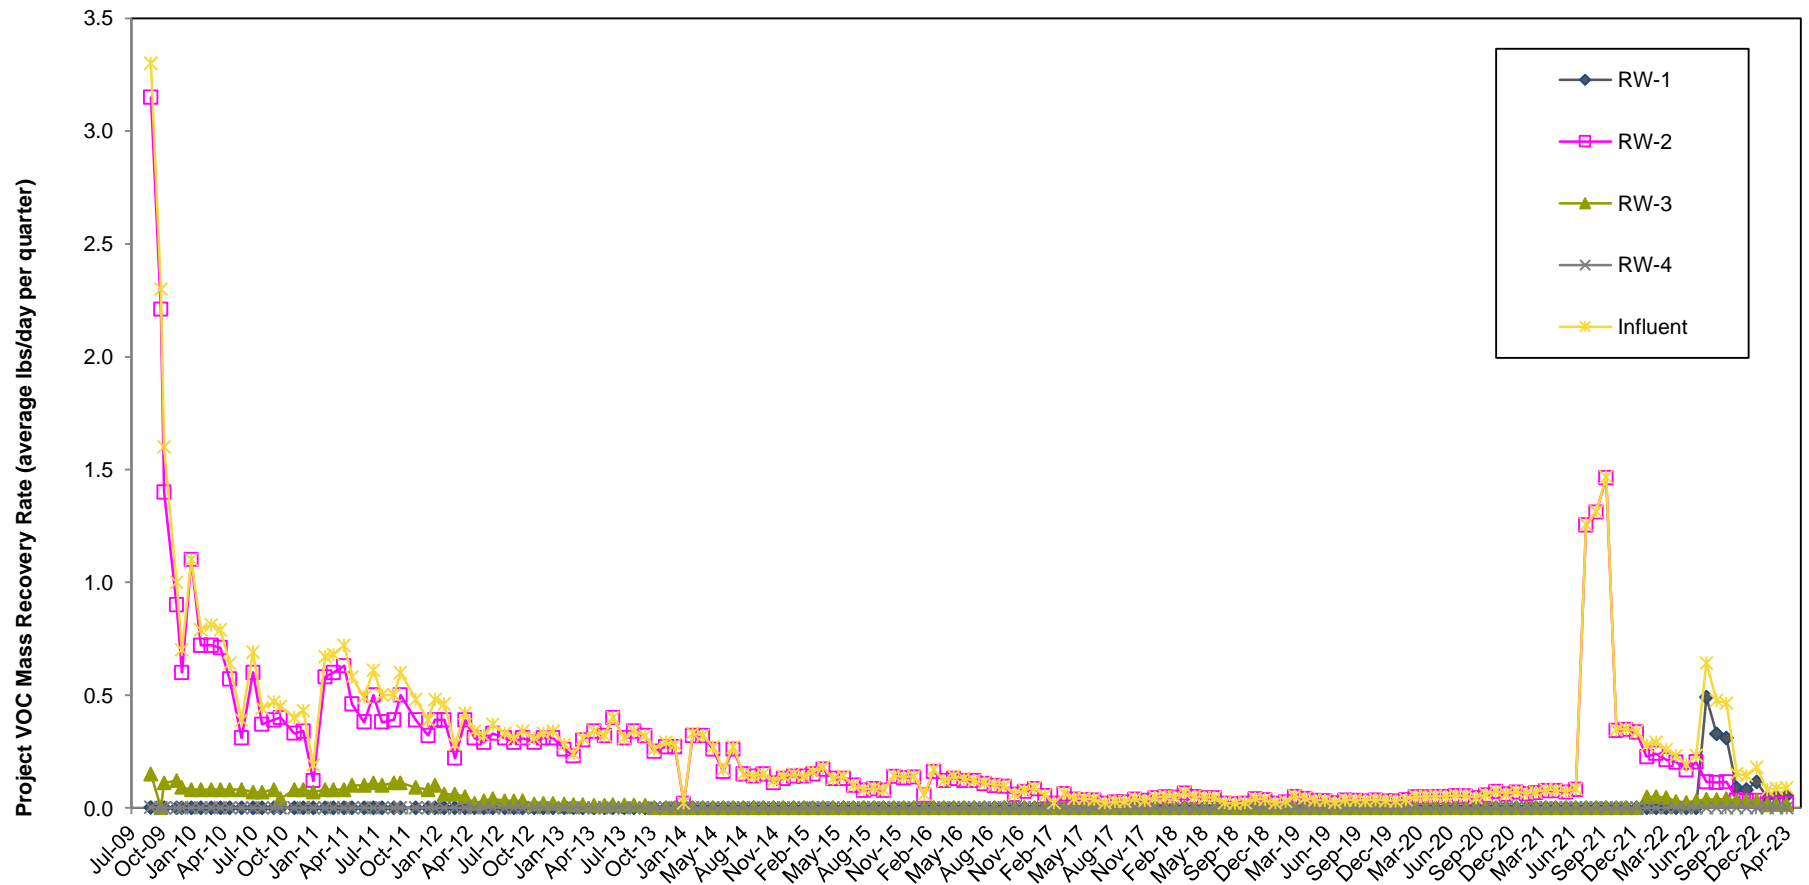

**Abbreviations, Notes, and Units:**

Time

VOC = Volatile Organic Compound

Project VOCs = Sum of 1,1,1-trichloroethane; 1,1-dichloroethane; 1,2-dichloroethane; 1,1-dichloroethene; tetrachloroethene; trichloroethene; vinyl chloride; cis-1,2-dichloroethene; trans-1,2-dichloroethene; benzene; toluene; and total xylenes

1. A notable increase in TVOC mass recovery rates was observed between Q3 2021 and Q1 2022 due to the increase in TVOCs detected (Figure 6B)
2. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells. A notable increase in TVOCs was detected in the August 22, 2022 sample from RW-1, which is likely due to the addition of BCPMW-4-1 and BCPMW-4-2.


lbs/day = pounds per day

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
 OPERABLE UNIT 3  
 (FORMER GRUMMAN SETTLING PONDS)  
 BETHPAGE, NEW YORK

**PROJECT VOC MASS RECOVERY RATES**



FIGURE  
**8B**

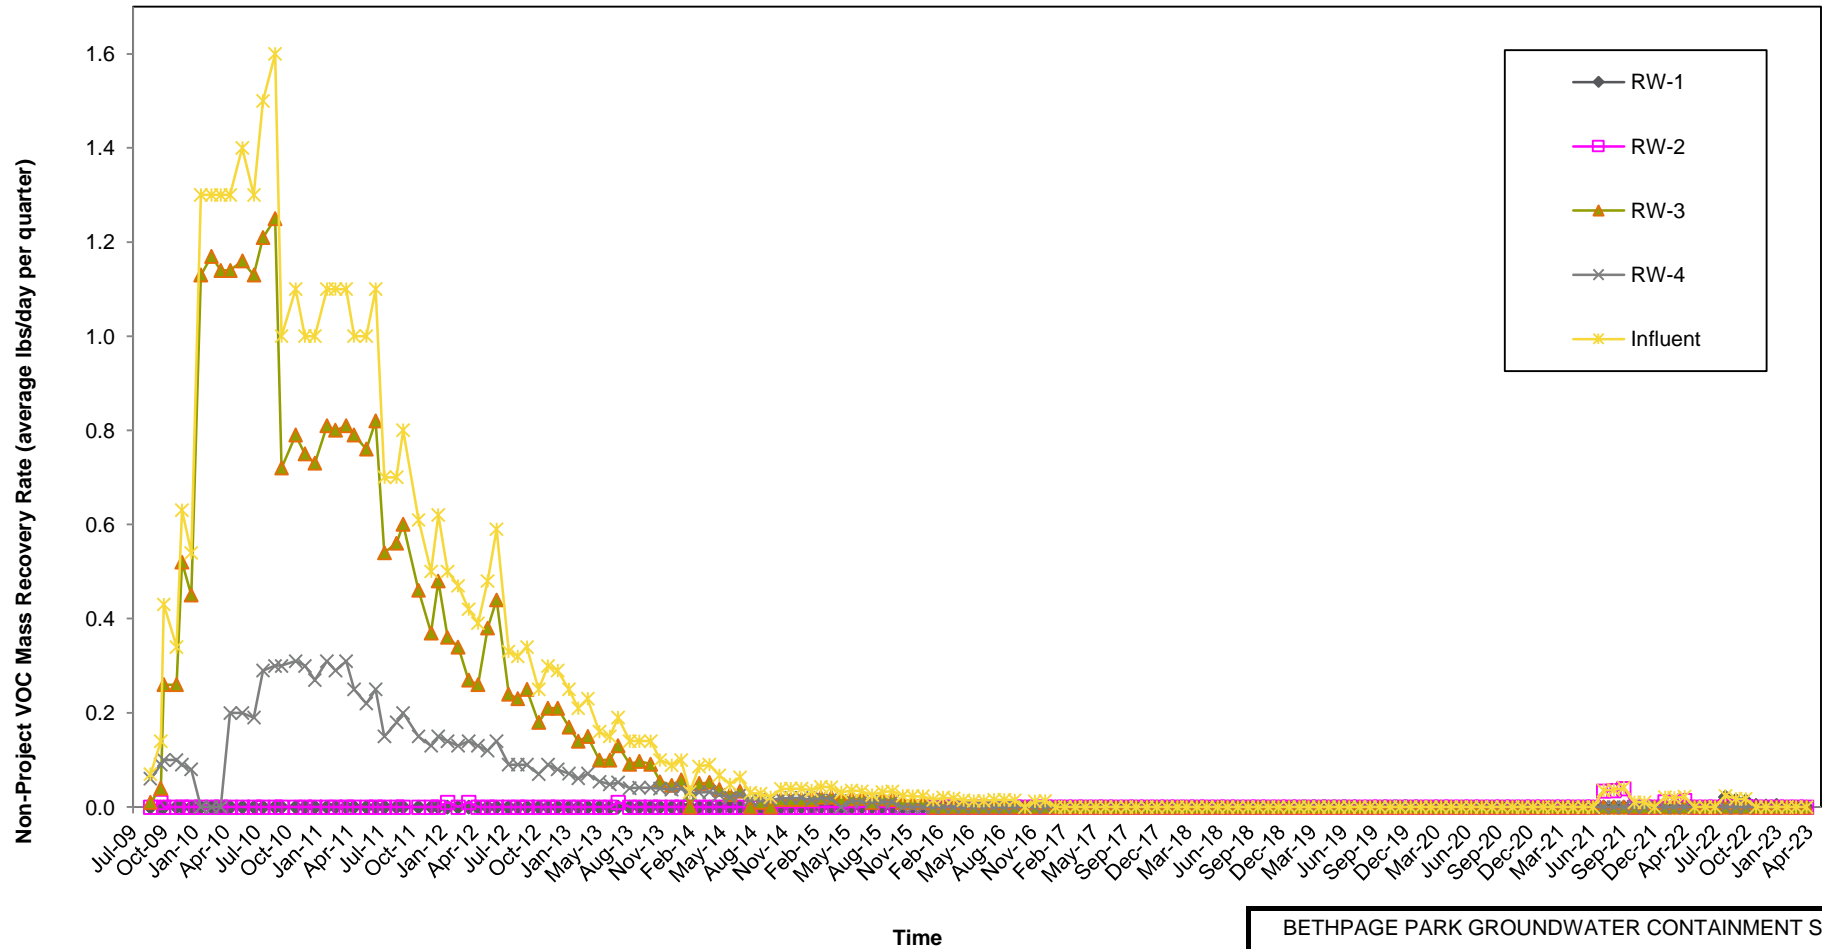

**Abbreviations, Notes, and Units:**

VOC = Volatile Organic Compound

Non-Project VOCs = sum of VOCs that are not Project VOCs.

1. As of August 4, 2022 the RW-1 concentration is representative of the addition of BCPMW-4-1 and BCPMW-4-2 that were added as additional recovery wells.

lbs/day = pounds per day

BETHPAGE PARK GROUNDWATER CONTAINMENT SYSTEM  
 OPERABLE UNIT 3  
 (FORMER GRUMMAN SETTLING PONDS)  
 BETHPAGE, NEW YORK

**NON-PROJECT VOC MASS RECOVERY RATES**



FIGURE  
**8C**