



27 December 2022

Mr. Scott Sokolowski
Remedial Project Manager
Naval Facilities Engineering Systems Command, Mid Atlantic
9324 Virginia Avenue, Building Z-144
Norfolk, VA 23511-3095

**Subject: US NAVY CONTRACT NO. N40085-16-D-2288
CONTRACT TASK ORDER NO. 0005
2022 THIRD QUARTER OPERATIONS REPORT
GWTP GM-38 AREA REMEDIATION
NAVAL WEAPONS INDUSTRIAL RESERVE PLANT, BETHPAGE, NY**

Dear Mr. Sokolowski:

An electronic copy of the *2022 Third Quarter Operations Report, Groundwater Treatment Plant, GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York*, has been submitted to your attention via email.

Please contact me at rgregory@komangs.com or 610.400.0636 if you have any questions or comments regarding this submittal.

Sincerely,
KOMAN Government Solutions, LLC (KGS)

A handwritten signature in black ink, appearing to read "Robert G. Gregory".
Robert G. Gregory
Project Manager

Cc: Mr. Jason Pelton (NYSDEC) – electronic only
Ms. Kristin Granzen (NYSDEC) – electronic only
Mr. Matthew Travis (NYSDEC) – electronic only
Mr. Steven Scharf (NYSDEC) – electronic only
Mr. William Cords (NAVAIR) – electronic only
Mr. James Sullivan (NYSDOH) – electronic only
Ms. Monica Marrow (Jacobs - NIRIS) – 1 hard copy, 1 CD
Mr. Vin Varricchio (NWIRP Bethpage) – 2 hard copies, 2 CDs
Mr. Ed Hannon (Northrop Grumman) – electronic only
Mr. David Stern (ARCADIS) – electronic only
Mr. David Brayack (Tetra Tech) – electronic only
Mr. Patrick Schauble (KGS) – electronic only

**Quarterly Operations Report
Third Quarter 2022**

**Groundwater Treatment Plant
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant
Bethpage, New York**

**Contract No. N40085-16-D-2288
Contract Task Order No. 0005**

December 2022

Prepared for:



Naval Facilities Engineering Systems Command Mid-Atlantic
9324 Virginia Avenue
Norfolk, VA 23511

Prepared by:



**KOMAN Government Solutions, LLC
180 Gordon Drive, Suite 110
Exton, Pennsylvania 19341
(610) 363-3000**

**Quarterly Operations Report
Third Quarter 2022**

**Groundwater Treatment Plant
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant
Bethpage, New York**

**Contract No. N40085-16-D-2288
Contract Task Order No. 0005**

December 2022

Prepared for:

Naval Facilities Engineering Systems Command Mid-Atlantic
9324 Virginia Avenue
Norfolk, VA 23511



Patrick Schable
Program Manager

12/15/2022

Date



Robert Gregory
Project Manager

12/15/2022

Date

TABLE OF CONTENTS

1.0	INTRODUCTION.....	1-1
1.1	Background.....	1-1
1.2	GWTP Overview	1-1
2.0	GWTP OPERATIONS AND MAINTENANCE	2-1
2.1	Routine Maintenance Activities.....	2-1
2.2	Non-routine Maintenance / Site Activities	2-1
3.0	GWTP MONITORING	3-1
3.1	Process Water Quality Monitoring	3-1
3.2	Air Quality Monitoring.....	3-1
3.3	Groundwater Quality Monitoring.....	3-1
3.3.1	Groundwater Quality Results.....	3-2
3.3.2	Quality Assurance/Quality Control Sampling.....	3-3
3.3.3	Groundwater Concentration Trends	3-3
4.0	CONCLUSIONS AND RECOMMENDATIONS	4-1
5.0	REFERENCES.....	5-1

FIGURES

FIGURE 1	Site Location Map
FIGURE 2	Process Flow Diagram
FIGURE 3	Site Map
FIGURE 4	Recovery Well Locations
FIGURE 5	3 rd Quarter 2022 Groundwater Analytical Map – Select VOC Concentrations - Recovery Wells
FIGURE 6	3 rd Quarter 2022 Groundwater Analytical Map – Select VOC Concentrations - Monitoring Wells
FIGURE 7	Groundwater Concentrations Trends of Select VOCs – RW-1
FIGURE 8	Groundwater Concentrations Trends of Select VOCs – RW-4 (PCE, TCE, cis-1,2-DCE)
FIGURE 9	Groundwater Concentrations Trends of Select VOCs – RW-4 (PCE, cis-1,2-DCE)
FIGURE 10	Groundwater Concentrations Trends of Select VOCs – RW1-MW1
FIGURE 11	Groundwater Concentrations Trends of Select VOCs – RW1-MW3
FIGURE 12	Groundwater Concentrations Trends of Select VOCs – RW2-MW1
FIGURE 13	Groundwater Concentrations Trends of Select VOCs – RW3-MW1
FIGURE 14	Groundwater Concentrations Trends of Select VOCs – RW3-MW2
FIGURE 15	Groundwater Concentrations Trends of Select VOCs – RW3-MW3
FIGURE 16	Groundwater Concentrations Trends of Select VOCs – RW3-MW4

FIGURE 17 Groundwater Concentrations Trends of Select VOCs – TP-01

TABLES

- TABLE 1 Discharge Monitoring Results – Third Quarter 2022
- TABLE 2 Air Sampling Results – Third Quarter 2022
- TABLE 3 Stack Emissions – Third Quarter 2022
- TABLE 4 Groundwater Level Measurements – Third Quarter 2022
- TABLE 5 Summary of Groundwater Chemistry Results – Third Quarter 2022
- TABLE 6 Summary of Detected Groundwater Analytical Results – Third Quarter 2022
- TABLE 7 Summary of Historical Groundwater Analytical Results through Third Quarter 2022

APPENDICES

APPENDIX A NYSDEC Effluent Limitations and Monitoring Requirements and July 2022 –
September 2022 DMRs

APPENDIX B NYSDEC Air Discharge Limit Documentation

APPENDIX C Field Logs and Chain of Custody Documentation – Third Quarter 2022

APPENDIX D Data Validation Report

Acronyms and Abbreviations

%	percent
AOP	Advanced Oxidation Process
ARAR	Applicable or Relevant and Appropriate Requirement
AS	air stripper
ASE	air stripper effluent
BFE	bag filter effluent
bgs	below ground surface
CERCLA	Comprehensive Environmental Response Compensation and Liability Act
DAR	Division of Air Resources
DCA	dichloroethane
DCE	dichloroethene
DMR	Discharge Monitoring Report
DO	dissolved oxygen
DoD	Department of Defense
DTW	depth to water
EB	equipment blank
ECL	Environmental Conservation Law
ELAP	Environmental Laboratory Accreditation Program
GOCO	Government Owned Contractor Operated
gpm	gallon per minute
GWTP	groundwater treatment plant
KGS	KOMAN Government Solutions, LLC
HMI	human-machine interface
ID	isotope dilution
IRP	Installation Restoration Program
L	liter
lb	pound
LGAC	liquid phase granular activated carbon
MS/MSD	matrix spike/matrix spike duplicate
NAVFAC	Naval Facilities Engineering Systems Command
Navy	United States Department of the Navy
NELAC	National Environmental Laboratory Accreditation Conference
NG	Northrop Grumman

NWIRP	Naval Weapons Industrial Reserve Plant
NYSDEC	New York State Department of Environmental Conservation
O&M	Operation and Maintenance
ORP	oxidation-reduction potential
OU	operable unit
PCE	tetrachloroethene
PLC	programmable logic controller
QA/QC	quality assurance/quality control
ROD	Record of Decision
RPD	relative percent difference
SC	specific conductance
scfm	standard cubic feet per minute
SIM	selection ion monitoring
SPDES	State Pollution Discharge Elimination System
TB	trip blank
TCE	trichloroethene
TE	treated effluent
Tetra Tech	Tetra Tech, Inc.
TICs	tentatively identified compounds
TtEC	Tetra Tech EC, Inc.
TSS	total suspended solids
µg/L	micrograms per liter
USEPA	United States Environmental Protection Agency
VC	vinyl chloride
VGAC	vapor phase granular activated carbon
VOC	volatile organic compound

1.0 INTRODUCTION

KOMAN Government Solutions, LLC (KGS) has prepared this Quarterly Operations Report for the GM-38 Area Groundwater Treatment Plant (GWTP) at the Naval Weapons Industrial Reserve Plant (NWIRP) in Bethpage, New York. This report has been prepared for the United States Department of the Navy (Navy), Naval Facilities Engineering Systems Command (NAVFAC), Mid-Atlantic, under Contract No. N40085-16-D-2288, Contract Task Order No. 0005. This Third Quarter 2022 Operations Report details activities that occurred from July to September 2022. Data were collected and operational activities were performed by KGS in accordance with the following documents:

- *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by Tetra Tech EC, Inc. (TtEC) in 2010, hereafter referred to as the “O&M Manual.”
- *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York* prepared by TtEC in 2010.

1.1 Background

NWIRP Bethpage is located in east central Nassau County, Long Island, New York, approximately 30 miles east of New York City (**Figure 1**) and is currently listed by New York State Department of Environmental Conservation (NYSDEC) as an “inactive hazardous waste site” (#1-30-003B). In the late 1990s, the Navy’s property totaled approximately 109.5 acres and was a Government Owned Contractor Operated (GOCO) facility that was operated by Northrop Grumman (NG) until September 1998. NWIRP Bethpage was bordered on the north, west, and south by property owned, or formerly owned, by NG that covered approximately 550 acres, and on the east by a residential neighborhood.

The GM-38 Area refers to a cluster of monitoring wells installed in the 1990s by NG. The GM-38 Area is approximately 8,500 feet south, southeast, and hydraulically downgradient of NWIRP Bethpage. The GWTP is located within a utility easement with a street address of 100 Broadway, Bethpage, New York.

The “hot spot” cleanup remedy for the GM-38 Area groundwater was originally set forth in Record of Decision (ROD) documents for Operable Unit (OU) 2 Groundwater for the NG and NWIRP Sites (New York State Registry Site Numbers 1-30-003A & 1-30-003B, respectively) issued by NYSDEC Division of Environmental Remediation in March 2001 and for the NWIRP Bethpage Site by NAVFAC in April 2003 (Revision 1). The selected remedy was chosen in accordance with the New York State Environmental Conservation Law (ECL) and the Navy’s Installation Restoration Program (IRP). It is also consistent with the Comprehensive Environmental Response Compensation and Liability Act (CERCLA), as amended, 42 U.S.C. §§ 9601-9675.

1.2 GWTP Overview

Currently, groundwater is extracted from recovery wells RW-1 and RW-4. Pumping at RW-3 was suspended from July 2015 to June 2018, and then again in April 2021 when the new recovery well RW-4 was brought online. All extracted groundwater is treated in the GWTP. The treatment process consists of flow equalization, air stripping and vapor-phase carbon treatment, bag filtration, and liquid-phase carbon treatment. In addition, an Advanced Oxidation Process (AOP) system has been installed at the GWTP and is intended to remove residual concentrations of 1,4-dioxane from the GWTP effluent prior to discharge. The AOP commissioning process began in April 2021.

The GWTP was originally equipped with a pH adjustment system utilizing sodium hydroxide; however, it was subsequently determined that pH adjustment was not necessary. The equipment has been taken off-line and sodium hydroxide sent off site for beneficial reuse. A process flow diagram is presented as

Figure 2. The treated water is either re-injected into injection well IW-1 or discharged into the Nassau County Recharge Basin #495. Under CERCLA, the Navy is required to meet the effluent requirements in the NYSDEC State Pollution Discharge Elimination System (SPDES) Permit Equivalent Application as an Applicable or Relevant and Appropriate Requirement (ARAR).

The GWTP was designed to operate at an average flow rate of 1,100 gallons per minute (gpm), as measured by the average discharge flow rate. It was determined that this flow rate would be optimal with respect to effective containment of the higher concentration of contamination in the GM-38 Area groundwater. During the current reporting period, both the AOP system and recovery well RW-4 have been online full time but at a reduced capacity while operations continue to be evaluated by the Navy team. RW-1 was operating at an average flow rate of approximately 447 gpm, 514 gpm, and 470 gpm during July, August, and September 2022, respectively. RW-4 was operating at an average flow rate of approximately 409 gpm, 504 gpm, and 459 gpm during July, August, and September, respectively.

Volatile Organic Compounds (VOCs) in the influent groundwater consist of trichloroethene (TCE), tetrachloroethene (PCE), vinyl chloride (VC), cis-1,2-dichloroethene (DCE), 1,2-dichloroethane (DCA), benzene, toluene, total xylenes, and 1,4-dioxane.

The air stripper (AS) is a structural aluminum tower that is packed with 3.5-inch diameter polypropylene Jaeger Tripack. Groundwater is pumped to the AS distribution port and sprayed over the column of Jaeger Tripack at a design flow rate of approximately 1,100 gpm. Previously, 100 gpm of recirculated water was also rerouted through the AS, but as of October 2010, recirculation was no longer deemed necessary to the operation of the system. An induced draft countercurrent flow of air enters the AS below the base of the packing material at a rate of 8,000 standard cubic feet per minute (scfm). The large surface area of the packing material allows for a mass transfer of the VOCs from the groundwater into the air stream. The VOCs in the off-gas, except for VC, are removed via two 20,000-pound (lb) vapor phase granular activated carbon (VGAC) units (VGAC-1 and VGAC-2). VC is oxidized into potassium chloride and carbon dioxide via treatment in a 20,000-lb vessel (VGAC-3) containing zeolite impregnated with potassium permanganate. The potassium chloride remains in the pore structure of the zeolite substrate. The treated off-gas is discharged from the stack.

Water treated by the AS is subsequently processed through the AOP unit, followed by processing through three 8,000-lb liquid phase granular activated carbon (LGAC) units in parallel prior to discharge in the recovery basin (or injection well, if necessary).

The GWTP is controlled by a programmable logic controller (PLC)-based digital and analog control system, with instrumentation that monitors pH, pressure, tank level, flow and differential pressure transmitters, water level in recovery wells, and motor operational status. The information in the PLC is made available to an operator via a human-machine interface (HMI) program. By using this program, the status of the GWTP can be displayed in real time and adjusted, if necessary, by the operator. The AOP unit has a standalone PLC to control its internal functions. The GWTP and AOP control systems are interlocked such that shut down of the AOP unit will result in shut down of the GWTP, and vice versa, to ensure that effluent is fully treated prior to discharge.

A 2014 evaluation of the GM-38 Area, conducted in order to better determine the capture zone of the recovery wells, recommended that use of recovery well RW-3 be discontinued (“*Capture Zone Evaluation and Path Forward, GM-38 Area Groundwater Treatment Plant*” [Tetra Tech, Inc. [Tetra Tech], 2014]). The report was sent to NYSDEC in March 2014 and recommended ceasing operation of recovery well RW-3 and increasing the pumping rate of recovery well RW-1. These system modifications would maintain the existing GWTP pumping rate of 1,000 to 1,100 gpm while maintaining the desired capture zone of the GWTP (Tetra Tech, 2014). NYSDEC concurred with the implementation of this path forward and associated system modifications on 20 April 2015. On 1 July 2015, in accordance with the approved path forward, recovery well RW-3 was taken off-line. The flowrate of recovery well RW-1 was increased from approximately 800 gpm to approximately 1,000 gpm. Pumping

at RW-3 was once again resumed in June 2018 to address persistent VOC concentrations at this well. Pumping at RW-3 was suspended in April 2021 to facilitate startup and integration of RW-4 into the system.

2.0 GWTP OPERATIONS AND MAINTENANCE

While designed to run autonomously, the GWTP requires regular visits by an operator to record and adjust operational parameters and to perform scheduled maintenance. The GWTP is equipped with telemetry that will alert an on-call operator in the event of a plant shutdown.

2.1 Routine Maintenance Activities

Routine maintenance activities at the GWTP were performed during the operator's visits. These activities include general site inspections, collection of operational data (water and vapor flowrates, differential pressures across the AS, carbon units, bag filter units and blower discharge pressures, tank levels, and totalizer readings), measurement of water levels in the recovery wells, adjustment of pump set points, collection of vapor and process water samples, changing bag filters, switching lead/lag pump assignments, and preventive maintenance of system equipment.

2.2 Non-routine Maintenance / Site Activities

Various non-routine maintenance tasks associated with adjustments to the AOP unit and startup of RW-4 in the current reporting period were performed. Recording and reporting of these tasks specific to the AOP unit itself were conducted by others under a separate contract and are not itemized in this report.

The increased sediment load that had been transported to the GWTP following incorporation of RW-4 was addressed during the previous (Second Quarter 2022) and current reporting periods. RW-4 was redeveloped in the previous reporting period by others under separate contract; all redevelopment water was collected in the GWTP and later removed and transported offsite for disposal by others under separate contract. Groundwater from RW-4 was used to flush the pipeline connecting RW-4 to the GWTP; flush water was collected in the GWTP and later removed and transported offsite for disposal by others under separate contract. Sediment from flushing was accumulated at the GWTP, containerized, and disposed of by others under separate contract during the current reporting period.

The chronology of non-routine activities at the GWTP during the current reporting period is presented below:

- 22 July – Annual fire alarm inspection conducted.
- 27 July – Sediment derived from the redevelopment of RW-4 and clean-out of the RW-4 pipeline removed from the GWTP.
- 1 September – Backwashing of GAC #100.
- 12 September – Backwashing of GAC #200.

3.0 GWTP MONITORING

The objective of the GWTP is to remove contaminant mass and reduce elevated VOC levels to levels similar to those in the surrounding aquifer. It is anticipated that GWTP operation will minimize contaminant impacts on water supply wells and currently unaffected portions of the groundwater aquifer. The GWTP is not intended to remediate groundwater contamination in the local aquifer to non-detectable levels (TtEC, 2010). Various process samples (water and vapor) are collected on a monthly basis to monitor GWTP efficiency and to ensure compliance with Federal and State effluent discharge and air emission requirements. In addition, groundwater samples are collected semi-annually to monitor water quality and determine the effectiveness of the remediation activities and monitor the hydraulic containment and capture of impacted groundwater by the recovery wells.

3.1 Process Water Quality Monitoring

Processed groundwater is analyzed to comply with calculations submitted by the Navy and documented in the NYSDEC SPDES Permit Equivalent Application for applicable effluent limitations and monitoring requirements. These results are also submitted to NYSDEC on a monthly basis in the form of a Discharge Monitoring Report (DMR). A copy of the current NYSDEC effluent limitations, monitoring constituents, and the completed reporting forms for the Third Quarter are included in **Appendix A**.

Monthly aqueous samples are collected from the active recovery wells (RW-1 and RW-4), and the treated effluent (TE) discharge line. In addition, various intermediary process system samples are collected monthly, consisting of air stripper effluent (ASE), bag filter effluent (BFE), and effluent samples (LC1, LC2, and LC3) of each of the three LGAC units. The analytical results of monthly aqueous samples collected during the Third Quarter are presented in **Table 1**.

3.2 Air Quality Monitoring

Treated off-gas discharged at the stack of the GWTP is subject to emissions limitations. Original discharge goals were derived from calculations submitted by the Navy and approved by the NYSDEC Division of Air Resources (DAR) in July 2009. In November 2011, the Navy submitted an evaluation proposing revised discharge goals, which NYSDEC approved in October 2013. A copy of this documentation is included as **Appendix B**.

Sampling of the stack emissions is required for NYSDEC compliance; however, process vapor samples are also collected using 6-liter (L) summa canisters at various locations to monitor for breakthrough of the VGAC units. The analytical results of monthly influent and effluent vapor samples as well as midfluent samples (VC12 and VC23) collected during the Third Quarter are presented in **Table 2**. Air emissions calculations using the stack vapor concentrations along with discharge flowrates are presented in **Table 3**. All constituents were within the regulatory requirements during the Third Quarter, as demonstrated by the calculated emission rates.

3.3 Groundwater Quality Monitoring

The groundwater monitoring well system at the GM-38 Groundwater Remediation Area consists of 14 monitoring wells, four recovery wells (RW-1, RW-2, RW-3, and RW-4), and one injection well (IW-1). Well locations are depicted on **Figure 3**. Recovery well RW-4, brought on-line in April 2021, is located approximately one mile to the west of the GWTP (**Figure 4**). Although RW-2 was installed in 2005, a pump was never installed in this well and the well is not operated as a recovery well in response to concerns expressed by the Bethpage Water District. As mentioned in Section 1.2, pumping at RW-3 was suspended between July 2015 and June 2018. RW-3 was reactivated on 1 June 2018 to address persistent VOC concentrations at this location and was subsequently replaced with Well RW-4 in April 2021. Well RW-1 was offline during the months of October and November 2020 as a result of a rehabilitation and redevelopment effort conducted at that time. In addition, RW-4 underwent redevelopment during April and May 2022; the well was offline during this timeframe.

Depth to water (DTW) measurements are collected from 12 of the monitoring wells on a quarterly basis. Prior to 2014, water quality samples were collected from eight of the monitoring wells on a quarterly basis; beginning in 2014, the sample collection frequency was reduced to semi-annually, with sample collection generally in the March (First Quarter) and September (Third Quarter) timeframes. The monitoring network includes well clusters located near the recovery wells RW-1 and RW-3 and injection well IW-1 as described below and as shown on **Figure 3**. Two additional wells, GM-38D and GM-38D2, located at the corner of Arthur Avenue and Broadway, are monitored by others.

Third Quarter groundwater samples for 2022 were collected from eight monitoring wells (RW1-MW1, RW1-MW3, RW2-MW1, RW3-MW1, RW3-MW2, RW3-MW3, RW3-MW4, and TP-01) and from two recovery wells (RW-1 and RW-4). Samples are collected from monitoring wells using bladder pumps in accordance with United States Environmental Protection Agency (USEPA) low-flow sampling methodologies. Samples were collected from recovery wells RW-1 and RW-4 using the dedicated extraction pumps as it is normally done during routine O&M sampling. Results of the groundwater sampling for the Third Quarter sampling event are presented in Section 3.3.1 below. Descriptions of monitoring well locations are as follows:

Recovery Well 1 (RW-1) Monitoring Wells

The RW-1 cluster consists of three monitoring wells screened between 395 and 435 feet below ground surface (bgs). RW1-MW1 is located approximately 140 feet northwest of RW-1 and RW1-MW2 is located approximately 50 feet north of RW-1. RW1-MW3 is located approximately 400 feet northeast of RW-1, on the eastern side of Seaford Oyster Bay Expressway. All three wells are hydraulically monitored while only RW1-MW1 and RW1-MW3 are also monitored for water quality.

Recovery Well 2 (RW-2) Monitoring Wells

The RW-2 cluster consists of three monitoring wells screened between 470 and 510 feet bgs. RW2-MW1 is located approximately 60 feet northwest of RW-2, RW2-MW2 is located approximately 100 feet west of RW-2, and RW2-MW3 is located approximately 20 feet west of RW-2. All three wells are hydraulically monitored while only RW2-MW1 is monitored for water quality.

Recovery Well 3 (RW-3) Monitoring Wells

The RW-3 cluster consists of four monitoring wells. RW3-MW2 and RW3-MW4 are screened between 475 and 495 feet bgs. RW3-MW1 and RW3-MW3 are screened between 330 and 350 feet bgs and 320 and 340 feet bgs, respectively. RW3-MW1 and RW3-MW2 are located approximately 280 feet west of RW-3, at the intersection of Arthur Avenue and Leroy Avenue. RW3-MW3 and RW3-MW4 are located approximately 400 feet north of the intersection of Sophia Street and Broadway. All four wells are both hydraulically monitored and monitored for water quality.

TP-01

TP-01 is screened between 450 and 470 feet bgs and is located approximately 25 feet north of the GWTP building, inside the fenced area. It is hydraulically monitored to observe the change in water levels associated with the influence from the pumping rates at the neighboring public water supply well field adjacent to the hot spot area and is also monitored for water quality.

Injection Well 1 (IW-1) Monitoring Well

There is one monitoring well associated with injection well IW-1. IW1-MW1 is screened between 20 and 150 feet bgs, is located approximately 20 feet south of IW-1, and is only hydraulically monitored on a quarterly basis.

3.3.1 Groundwater Quality Results

Groundwater samples for the October 2022 semi-annual event were collected on 4 and 5 October 2022. DTW measurements were used to calculate the groundwater elevations shown in **Table 4**. Field parameters measured during the well purging, which consisted of pH, specific conductivity (SC), temperature, oxidation-reduction potential (ORP), dissolved oxygen (DO), and turbidity, are summarized in **Table 5**. Following stabilization of field parameters, groundwater samples were collected. Copies of the field logs and chain of custody documentation are presented in **Appendix C**.

Groundwater samples were submitted to a laboratory accredited in accordance with the National Environmental Laboratory Accreditation Conference (NELAC) requirements and the Department of Defense (DoD) Environmental Laboratory Accreditation Program (ELAP). The samples were sent to ALS Environmental, located in Rochester, NY. The samples were analyzed for VOCs (including tentatively identified compounds [TICs] via USEPA Method 624.1, mercury via USEPA Method 245.1, and total suspended solids (TSS) via USEPA Method SM 2540D-2015. For the recovery wells, 1,4-dioxane was analyzed via USEPA Method 8270D Selective Ion Monitoring (SIM) and Method 8270D SIM Isotope Dilution (ID). Validated analytical sampling results for the October 2022 semi-annual groundwater monitoring event and the October 2022 recovery well sampling data are summarized in **Table 6**. Historical analytical results for the groundwater monitoring wells up to and including the Third Quarter 2022 results are presented in **Table 7**. Data validation reports are presented in **Appendix D**. Raw analytical data are provided under separate cover.

3.3.2 Quality Assurance/Quality Control Sampling

Quality assurance/quality control (QA/QC) samples were collected during the semi-annual groundwater monitoring event in accordance with the Final Sampling and Analysis Plan (TtEC, 2010a). These samples consisted of field duplicates (collected from RW3-MW3), matrix spike/matrix spike duplicate (MS/MSD) samples, equipment rinsate blank (EB) collected at a rate one per sampling event, and trip blanks (TB) submitted at a rate of one per cooler.

The EB contained trace amounts of TCE, however, the sample results for TCE were greater than two times the EB contamination and no qualification was required. Neither mercury or TSS were detected in either the EB or in the method blank; no qualifications were required.

The TB sample was listed on the chain but was not analyzed as all the bottles for this sample were broken upon arrival to the laboratory.

The MS/MSD recoveries for all analyses were within the laboratory QC limits; no qualifications were required.

For field duplicates, the precision between the parent sample and its duplicate is evaluated by calculating the relative percent difference (RPD). RPDs for the Third Quarter sampling event are presented in the data validation report in **Appendix D**. RPDs for VOC compounds were all less than 50 percent (%) with one exception: chloroform was detected in the duplicate sample but not detected in the parent sample. Results for chloroform in the parent/duplicate pair (GM-38-GW-RW3-MW3-1022/GM-38-GW-RW3-MW3-DUP-1022) were qualified as estimated UJ/J, respectively. Mercury and TSS were not detected in the parent/duplicate pairs no qualification was required. This overall consistency between the parent sample and its duplicate verifies that proper sample collection methods were followed.

3.3.3 Groundwater Concentration Trends

Groundwater analytical results of select VOCs (cis-1,2-DCE, PCE, TCE, and VC) for recovery wells RW-1 and RW-4 for the Third Quarter 2022 are presented on **Figures 7 through 9**.

Figure 7 presents concentrations measured at recovery well RW-1. TCE concentrations have decreased from initial concentrations in early 2010 (747 micrograms per liter [$\mu\text{g}/\text{L}$] measured in April 2010), remaining below 300 $\mu\text{g}/\text{L}$ since the latter half of 2012, decreasing in the current reporting period to a minimum concentration of 45.6 $\mu\text{g}/\text{L}$ in July. TCE concentrations remained stable in the Third Quarter

2022 ranging between concentrations of 45.6 µg/L in July to 51.2 µg/L in August and September. PCE concentrations have decreased from an initial concentration in February 2010 (180 µg/L) to a range of 13.5 µg/L (July) to 14.2 µg/L (August and September) in the current reporting period and have remained below 20 µg/L since April 2020. Concentrations of cis-1,2-DCE have followed a similar trend, decreasing from a maximum of 160 µg/L in February 2010 to a minimum concentration of 2.99 J µg/L in July. Cis-1,2-DCE has ranged from 2.99 J µg (July) to 3.35 J µg/L (September) in the current reporting period. Measured concentrations of cis-1,2-DCE have remained below 5.0 µg/L since February 2019. VC concentrations have remained below 5.0 µg/L since the final quarter of 2011 and below 1.0 µg/L since June 2013. VC was not detected during the current reporting period.

Figure 8 and **Figure 9** present concentrations measured at recovery well RW-4. Well RW-4 was brought online in place of well RW-3 in April 2021. Sampling of the well was initiated in May 2021 following stabilization of the pumping rate via the wireless communication with the GWTP. No samples were collected from RW-4 in May 2022; the well was offline because of redevelopment of the well. Measured TCE concentrations in the Third Quarter 2022 ranged from 677 µg/L in September to 690 µg/L in August. Measured PCE concentrations in the Third Quarter 2022 ranged from 4.29 J µg/L in July to 6.06 µg/L in September. Measured cis-1,2-DCE concentrations ranged from non-detect in September to 2.26 J µg/L in July 2022. VC has not been detected during any sampling event.

The concentration trend of select VOCs (cis-1,2-DCE, PCE, TCE, and VC) for the eight monitoring wells sampled during the October 2022 semi-annual monitoring event are presented on **Figures 10 through 17** and are discussed below.

Figure 10 presents concentrations measured at RW1-MW1. TCE concentrations have varied widely since the initial sampling in May 2005 (53.6 µg/L). The concentration of TCE in October 2022 (56.7 µg/L) was slightly higher than the concentration reported in May 2005, but less than the maximum concentration observed in September 2013 (175 µg/L). Concentrations of cis-1,2-DCE have remained consistently below 5.0 µg/L since September 2018 except for one instance in September 2021, when a slightly increased concentration of 7.06 J µg/L was measured. This concentration is well below the initial concentration observed in May 2005 (78.6 µg/L) and has since decreased for the October 2022 sampling event (3.54 J µg/L). PCE concentrations have remained consistently below 1.0 µg/L; PCE was detected at an estimated concentration of 0.306 J in October 2022. VC has not been detected since the September 2011 sampling event.

Figure 11 presents concentrations measured at RW1-MW3. TCE concentrations have consistently remained below 5.0 µg/L since monitoring was initiated in January 2010; TCE was detected in September 2022 at 2.91 J µg/L. Concentrations of cis-1,2-DCE and PCE have consistently remained below 1.0 µg/L since January 2010. VC has not been detected during any sampling event.

Figure 12 presents concentrations measured at RW2-MW1. TCE concentrations have varied since the initial sampling in May 2005 (37.6 µg/L). TCE was detected at a concentration of 3.22 J µg/L in October 2022. The concentration of cis-1,2-DCE measured in October 2022 (4.36 J µg/L) was above the initial concentration observed in May 2005 (non-detect) but below the maximum concentration observed in March 2016 (15.3 µg/L). PCE and VC have not been detected during any sampling event.

Figure 13 presents concentrations measured at RW3-MW1. TCE concentrations have decreased since reaching a maximum in November 2010 (77.6 µg/L). The TCE concentration in October 2022 (19.4 µg/L) was also below the initial concentration observed in January 2010 (35.0 µg/L). Cis-1,2-DCE has not been detected since September 2014. PCE concentrations have remained consistently near or below 2.0 µg/L since May 2005, with a concentration of 2.50 J µg/L measured in October 2020, equal to the previous maximum in March 2016. The measured concentration of PCE in October 2022 was 1.41 J µg/L. VC has not been detected during any sampling event.

Figure 14 presents concentrations measured at RW3-MW2. The TCE concentration observed in October 2022 (48.2 µg/L) was below the initial concentration observed in January 2010 (160 µg/L), below the

maximum concentration observed in April 2010 (211 µg/L), and represents the lowest concentration measured to date. A steadily decreasing trend in the measured concentration of TCE from 131 µg/L (September 2019) to 48.2 µg/L in October 2022 is noted. Concentrations of cis-1,2-DCE at this location have consistently remained below 2.0 µg/L with a non-detect in October 2022. PCE has been detected at this location at trace levels throughout most of the period of record, with concentrations ranging from non-detect in October 2022 to 0.66 J µg/L in March 2016. VC has not been detected during any sampling event.

Figure 15 presents concentrations measured at RW3-MW3. TCE concentrations have decreased since the maximum concentration was observed in June 2013 (410 µg/L). The TCE concentration measured in October 2022 (139 µg/L) was well below both the initial concentration observed in January 2010 (350 µg/L) and the maximum concentration measured in June 2013 (410 µg/L). Concentrations of cis-1,2-DCE have remained near or below 2.0 µg/L since March 2012. PCE concentrations have remained below 1.0 µg/L for all events. VC has not been detected during any sampling event.

Figure 16 presents concentrations measured at RW3-MW4. TCE concentrations have decreased since the initial sampling event in January 2010 (21 µg/L), with a concentration of 4.80 J µg/L in October 2022. PCE was detected for the first time in September 2015 at a concentration of 0.31 J µg/L but has not been detected since the March 2016 sampling event. Cis-1,2-DCE has been detected infrequently since the initial sampling event in January 2010 (0.46 µg/L) and was not detected in October 2022. VC has not been detected during any sampling event.

Figure 17 presents concentrations measured at TP-01. TCE concentrations have steadily decreased since the sampling event in March 2018. The TCE concentration observed in October 2022 (10.3 µg/L) is well below the initial and maximum concentration observed in January 2010 (65 µg/L) and is the lowest concentration measured to date. Concentrations of cis1,2-DCE have generally decreased from an initial value of 190 µg/L in January 2010 to the current concentration measured in October 2022 (0.991 J µg/L). PCE has remained below 1.0 µg/L since September 2013 and had not been detected since March 2017 until a detection of 0.680 J µg/L in March 2021; concentrations have increased to the most current measurement of 2.53 J µg/L in October 2022. VC has not been detected during any sampling event.


4.0 CONCLUSIONS AND RECOMMENDATIONS

The objective of the groundwater treatment system at GM-38 is to remove contaminant mass and reduce elevated VOC concentrations to levels similar to those in the surrounding aquifer, and in doing so minimize the impacts on downgradient water supply wells and currently unaffected portions of the aquifer. Based on the removal of VOCs by the GWTP and decreasing contaminant concentration trends observed in the recovery wells and several of the monitoring wells, progress toward these goals is indicated. Based on the concentrations in the groundwater wells, the GWTP should continue to be operated. Groundwater sampling frequency for the eight monitoring wells is currently performed on a semi-annual basis in accordance with the O&M Manual. Water levels for the 14 monitoring wells continue to be measured on a quarterly basis.

5.0 REFERENCES

- Tetra Tech, Inc. (Tetra Tech), 2014. *Capture Zone Evaluation and Path Forward, GM-38 Area Groundwater Treatment Plant, Naval Weapons Industrial Reserve Plant, Bethpage, New York.* March.
- Tetra Tech EC, Inc. (TtEC), 2010. *Final Operation, Maintenance & Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation, Naval Weapons Industrial Reserve Plant, Bethpage, New York.* April.
- Tetra Tech EC, Inc. (TtEC), 2010a. *Final Sampling and Analysis Plan (Field Sampling Plan and Quality Assurance Project Plan), UFP-SAP for Operations, Maintenance, and Monitoring of the Groundwater Treatment Plant, GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, New York.* September.

FIGURES

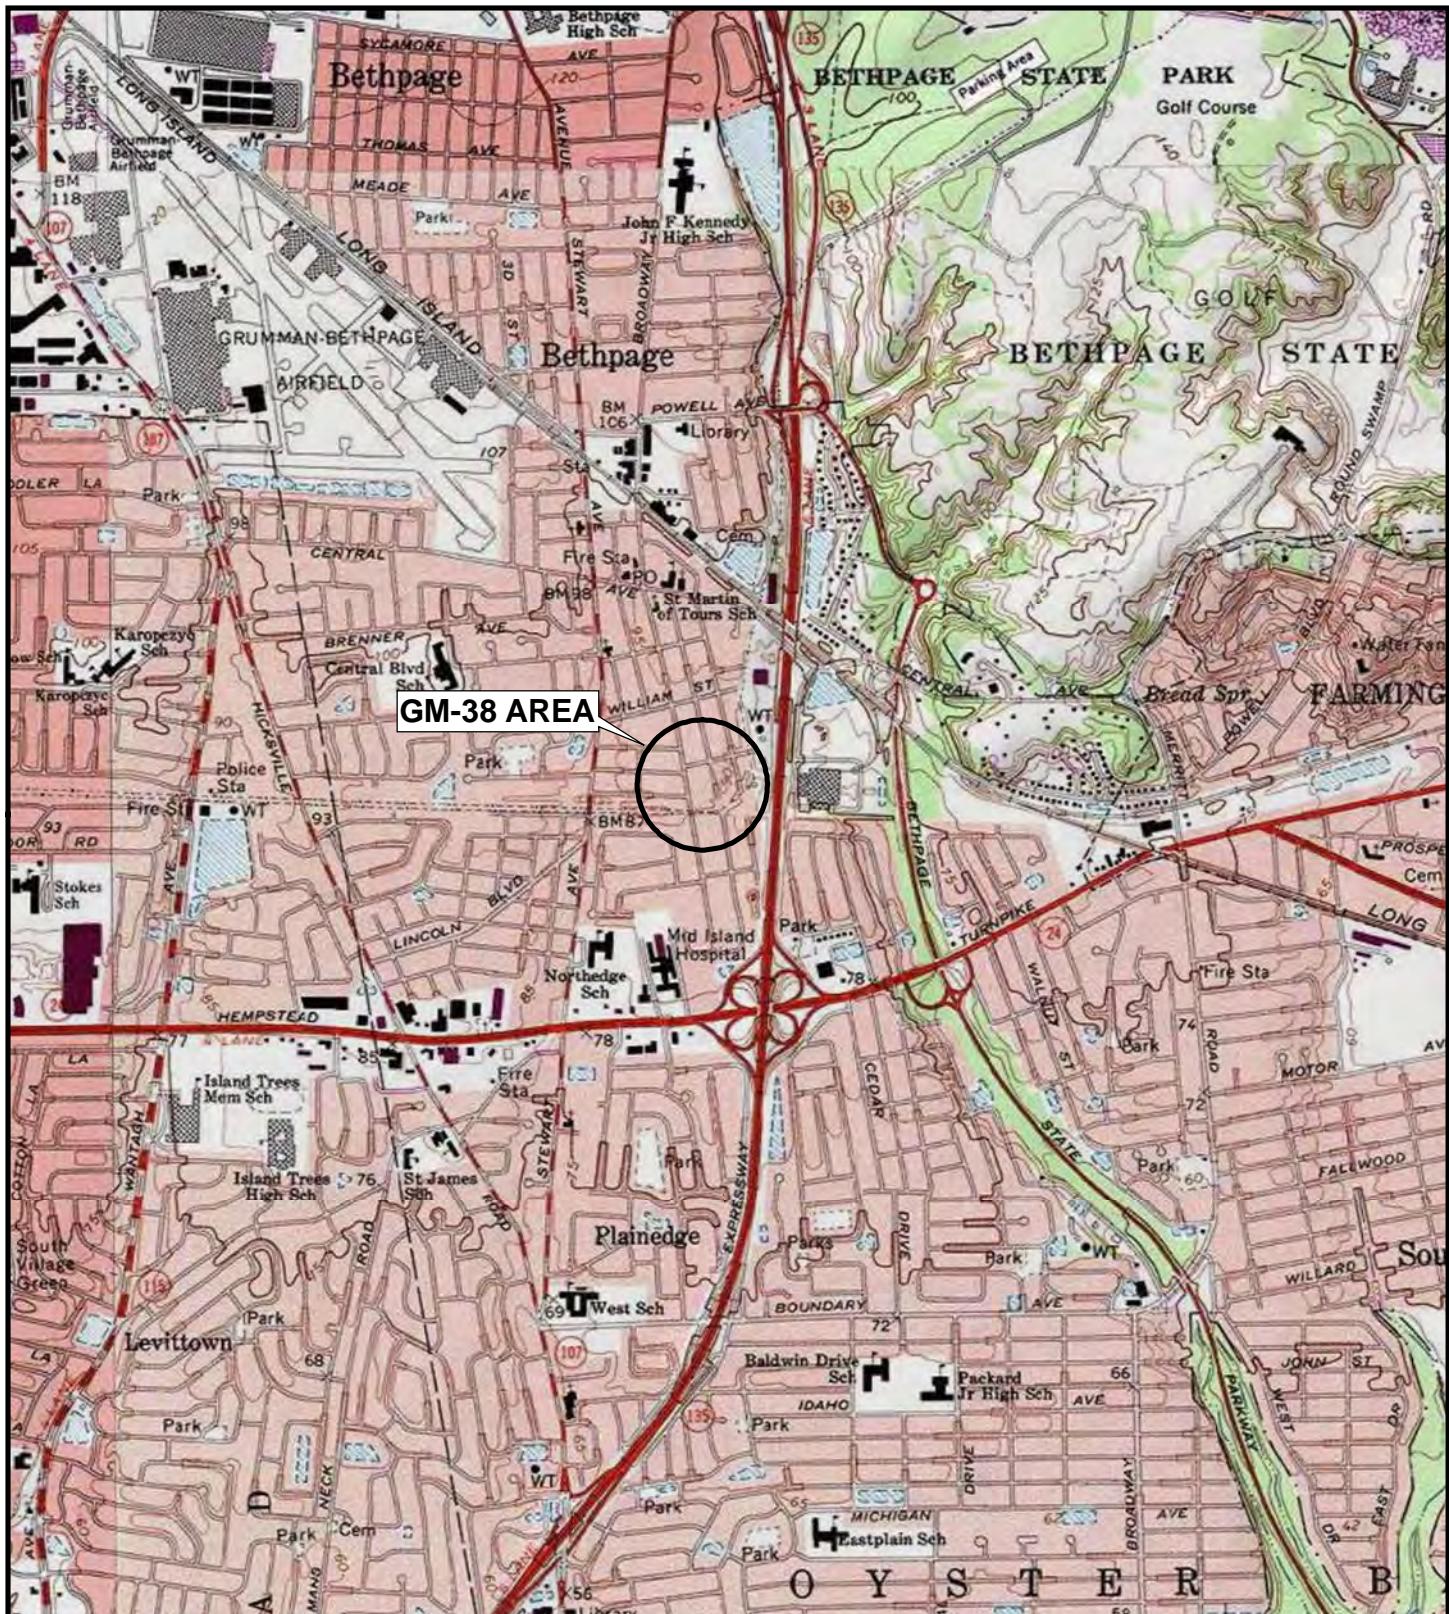

File: 1022_Bethpage_GM38_F1_SLM.mxd



Quadrangle Location Map

Map Reference: Copyright © 2013 National Geographic Society, i-cubed
USGS 7.5 Minutes Quadrangles: Amityville, Freeport, Hicksville, Huntington, New York

Site Location Map

Department of the Navy
Naval Facilities Engineering Systems Command, Mid-Atlantic

GM-38 Area
Naval Weapons Industrial Reserve Plant
Bethpage, New York


KOMAN Government Solutions, LLC
180 Gordon Drive, Suite 110, Exton, PA 19341


0 1,000 2,000
Feet


Date:
10/21/2022


Figure
1



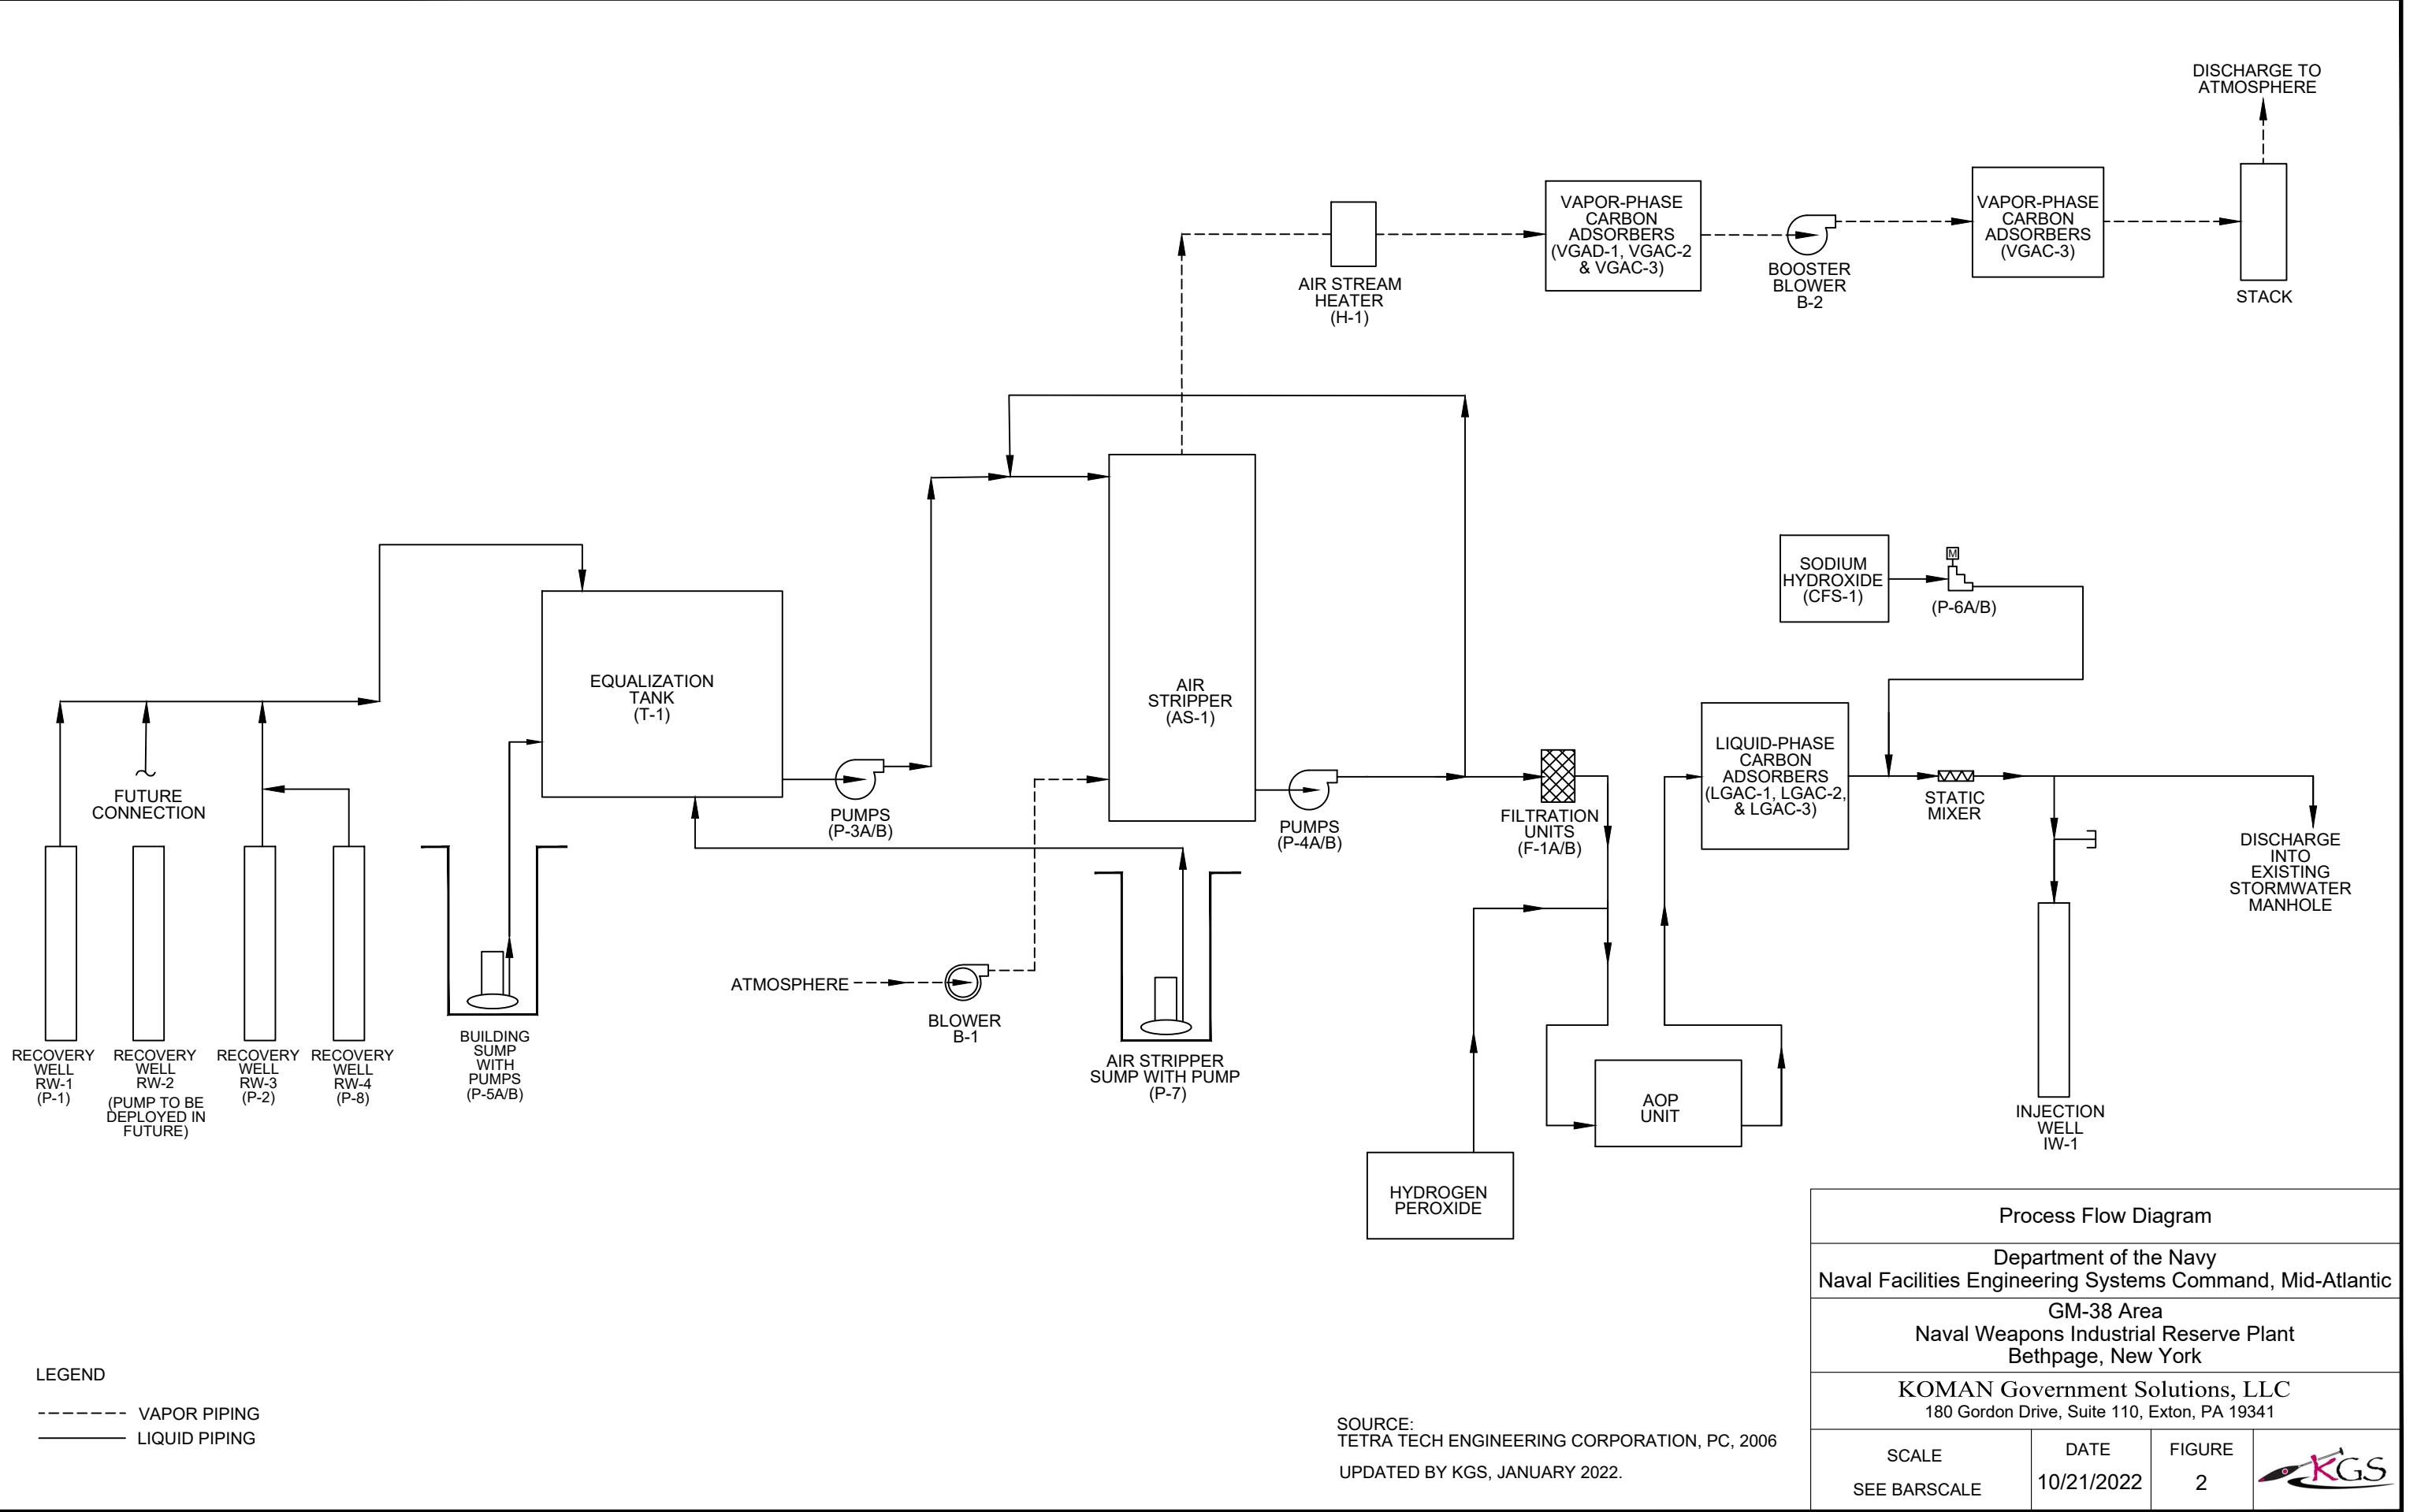

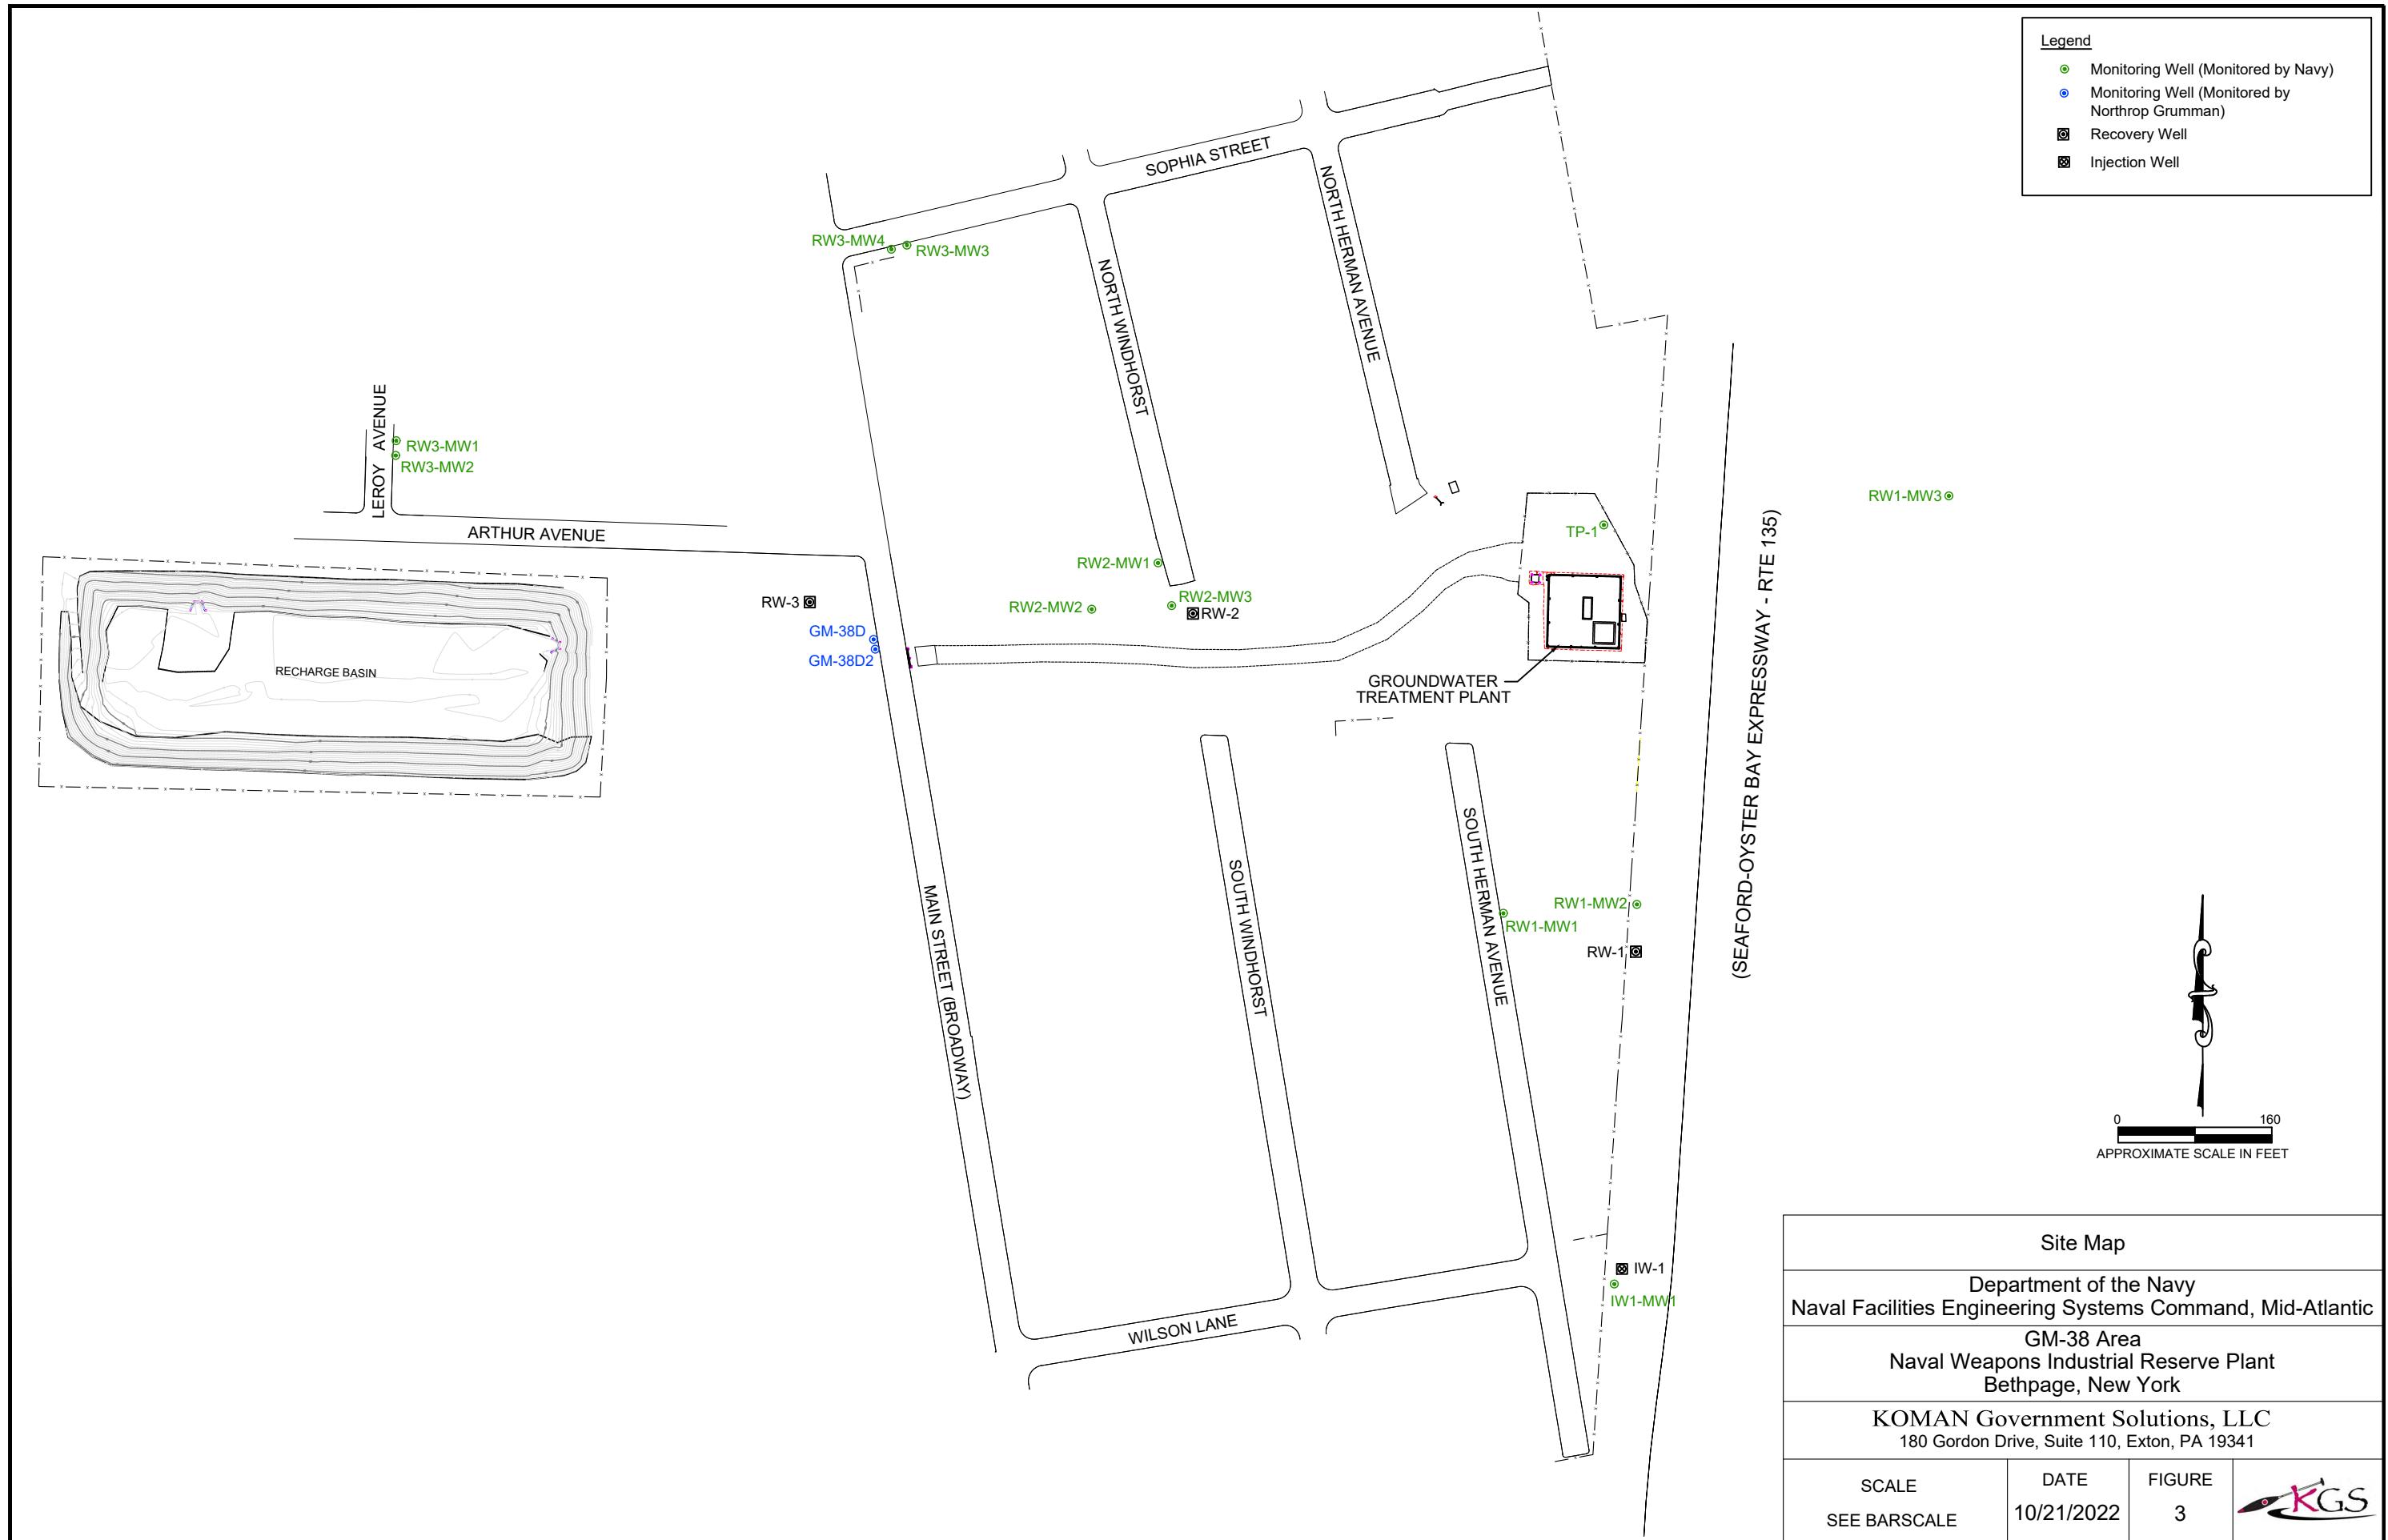

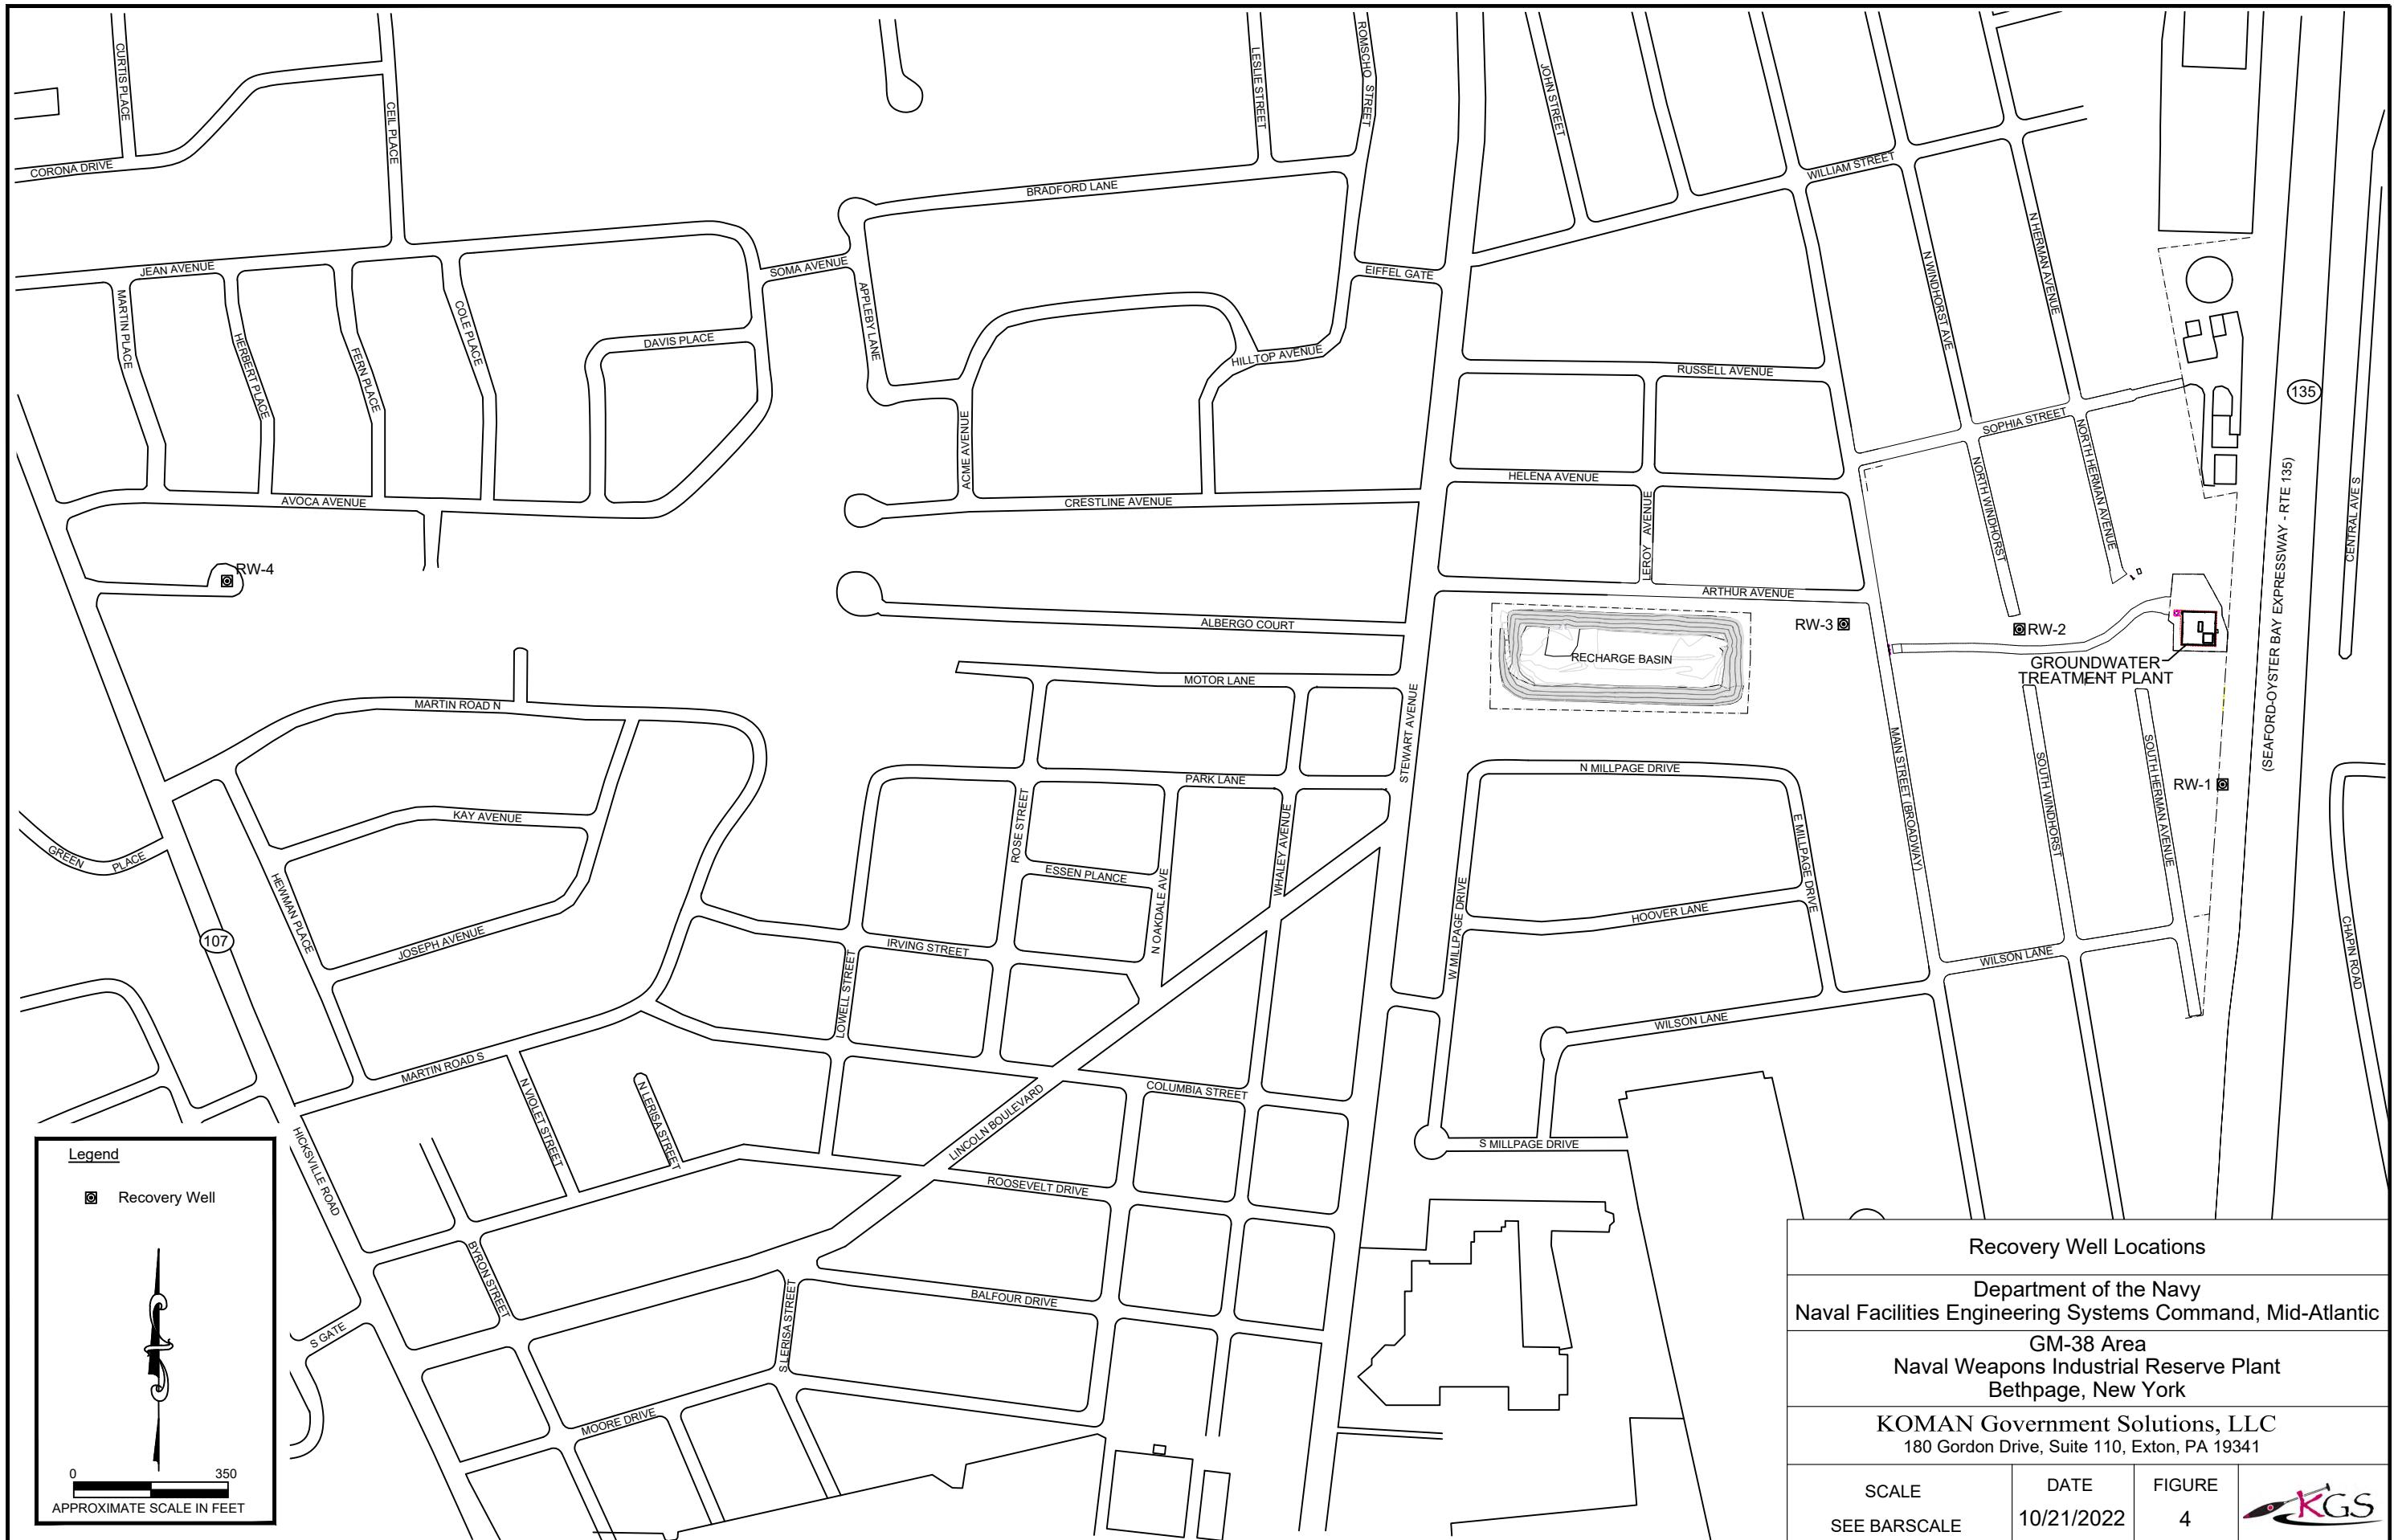

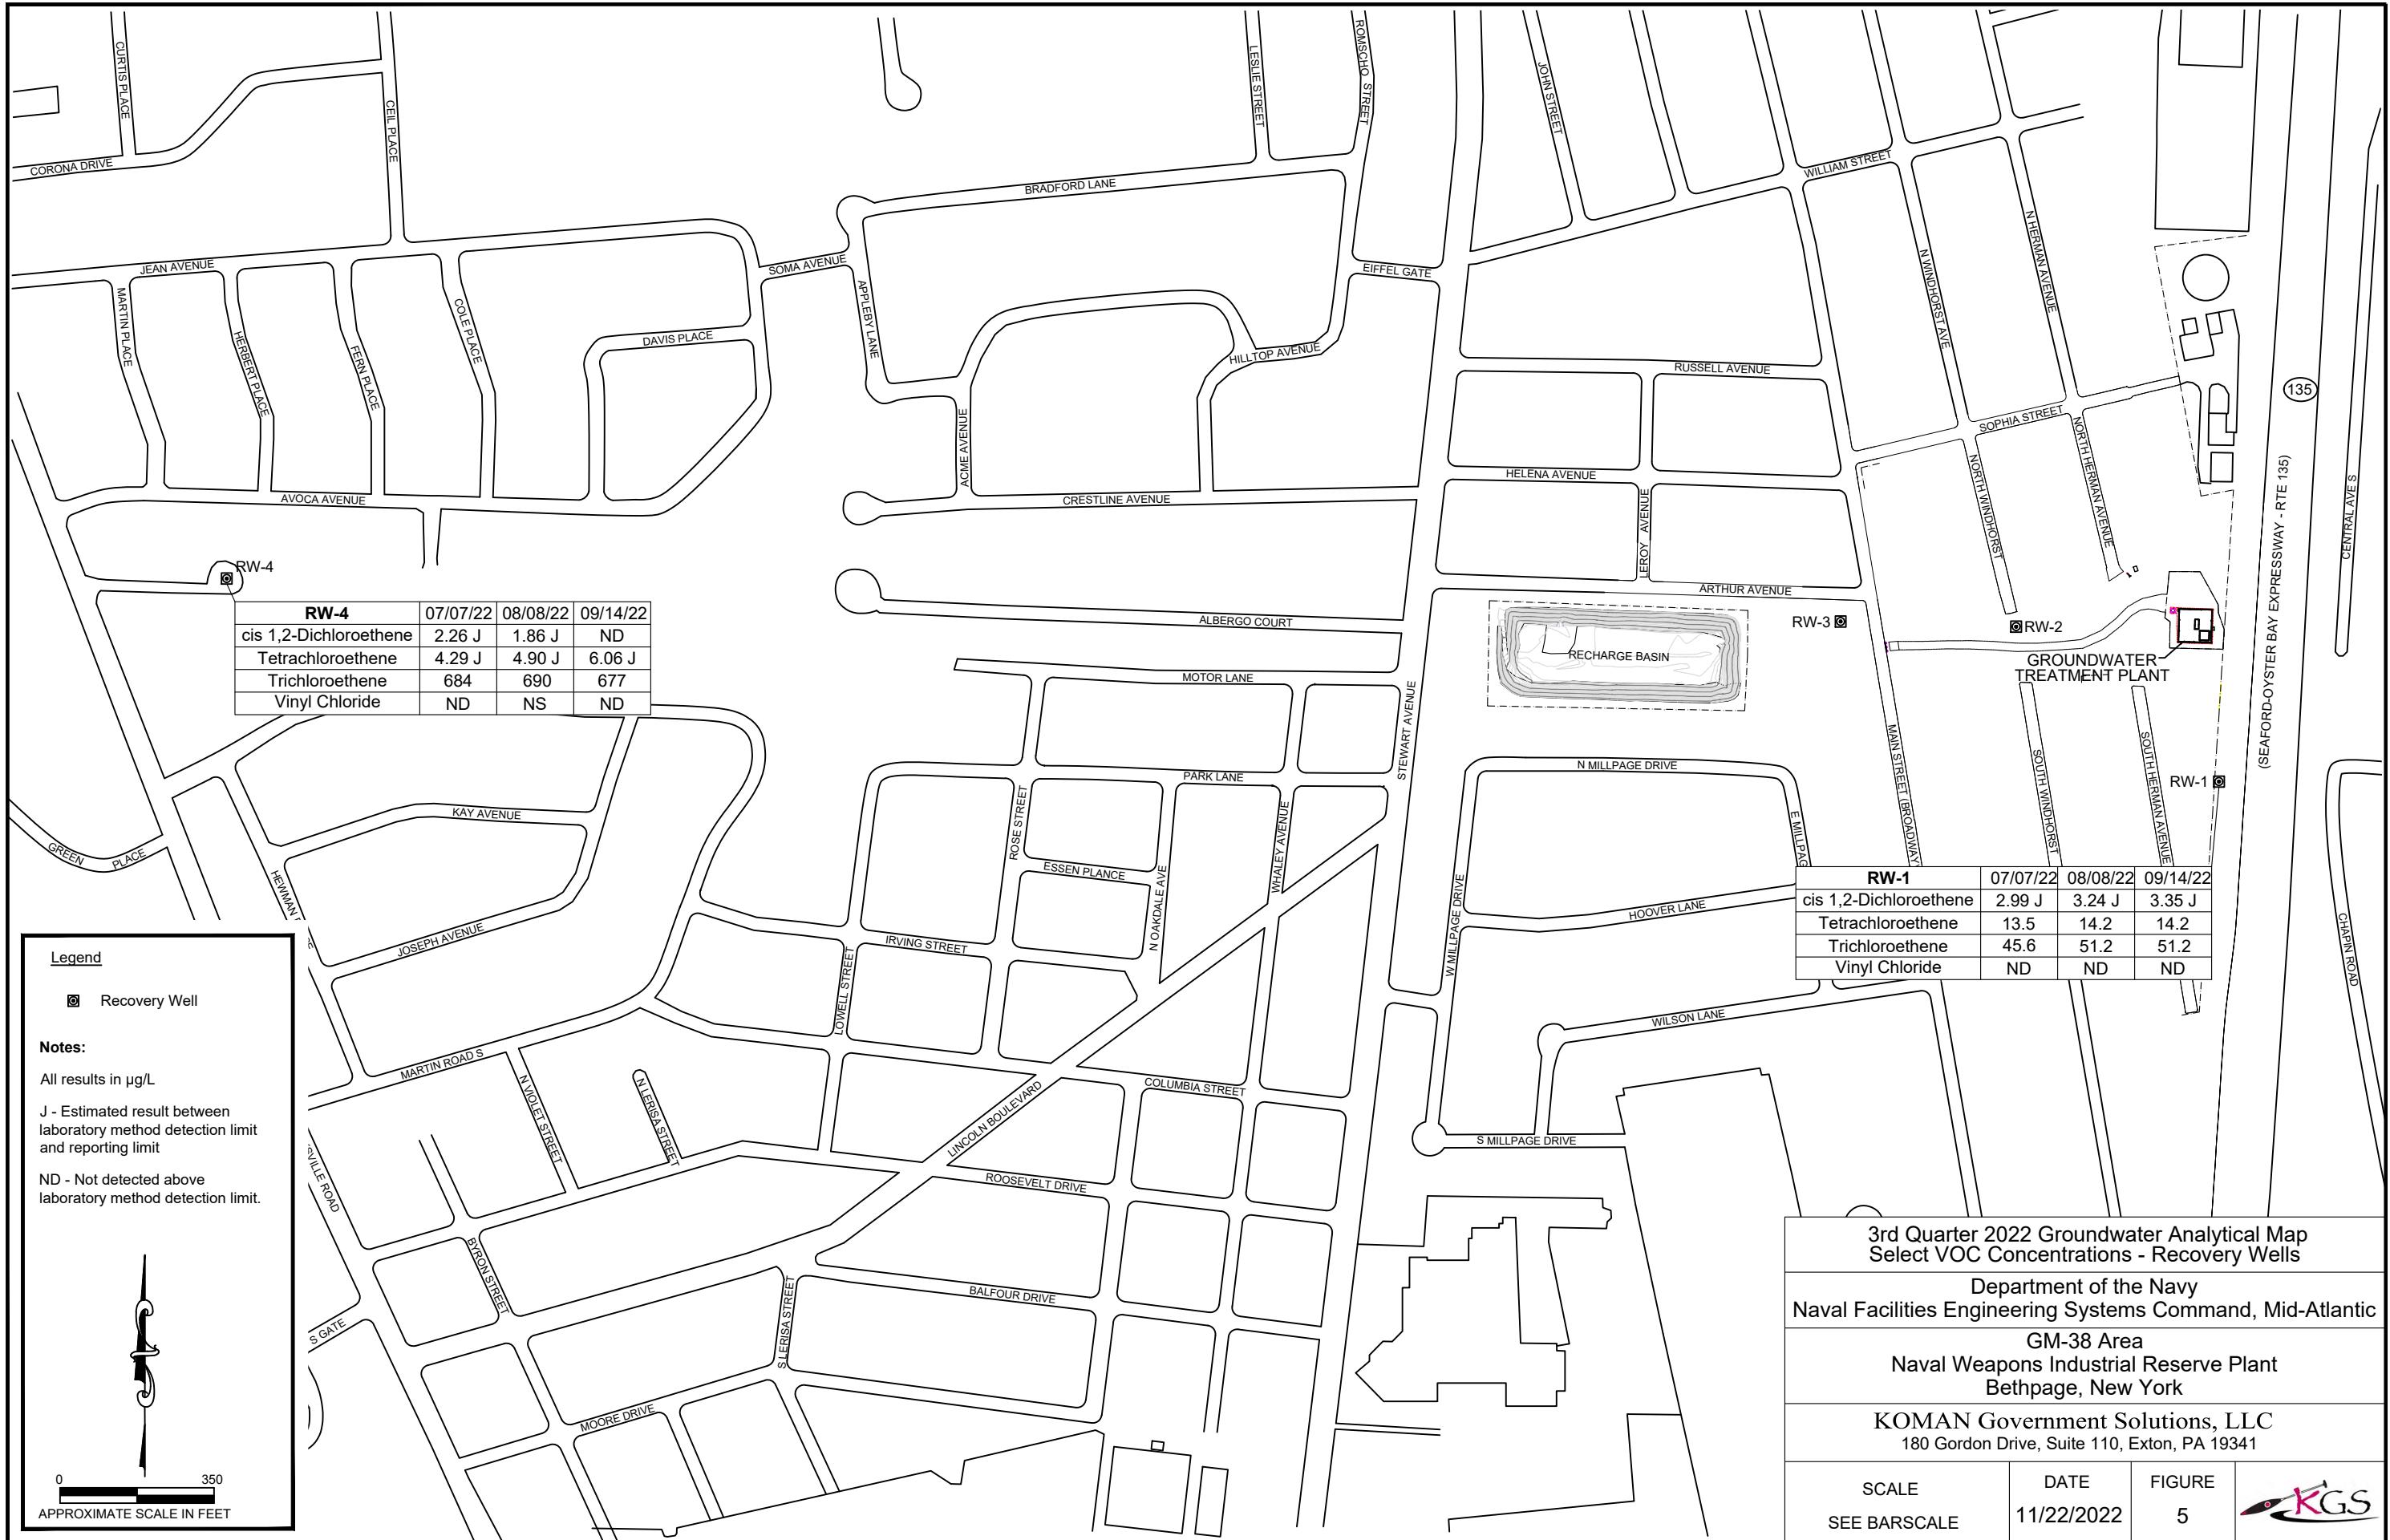

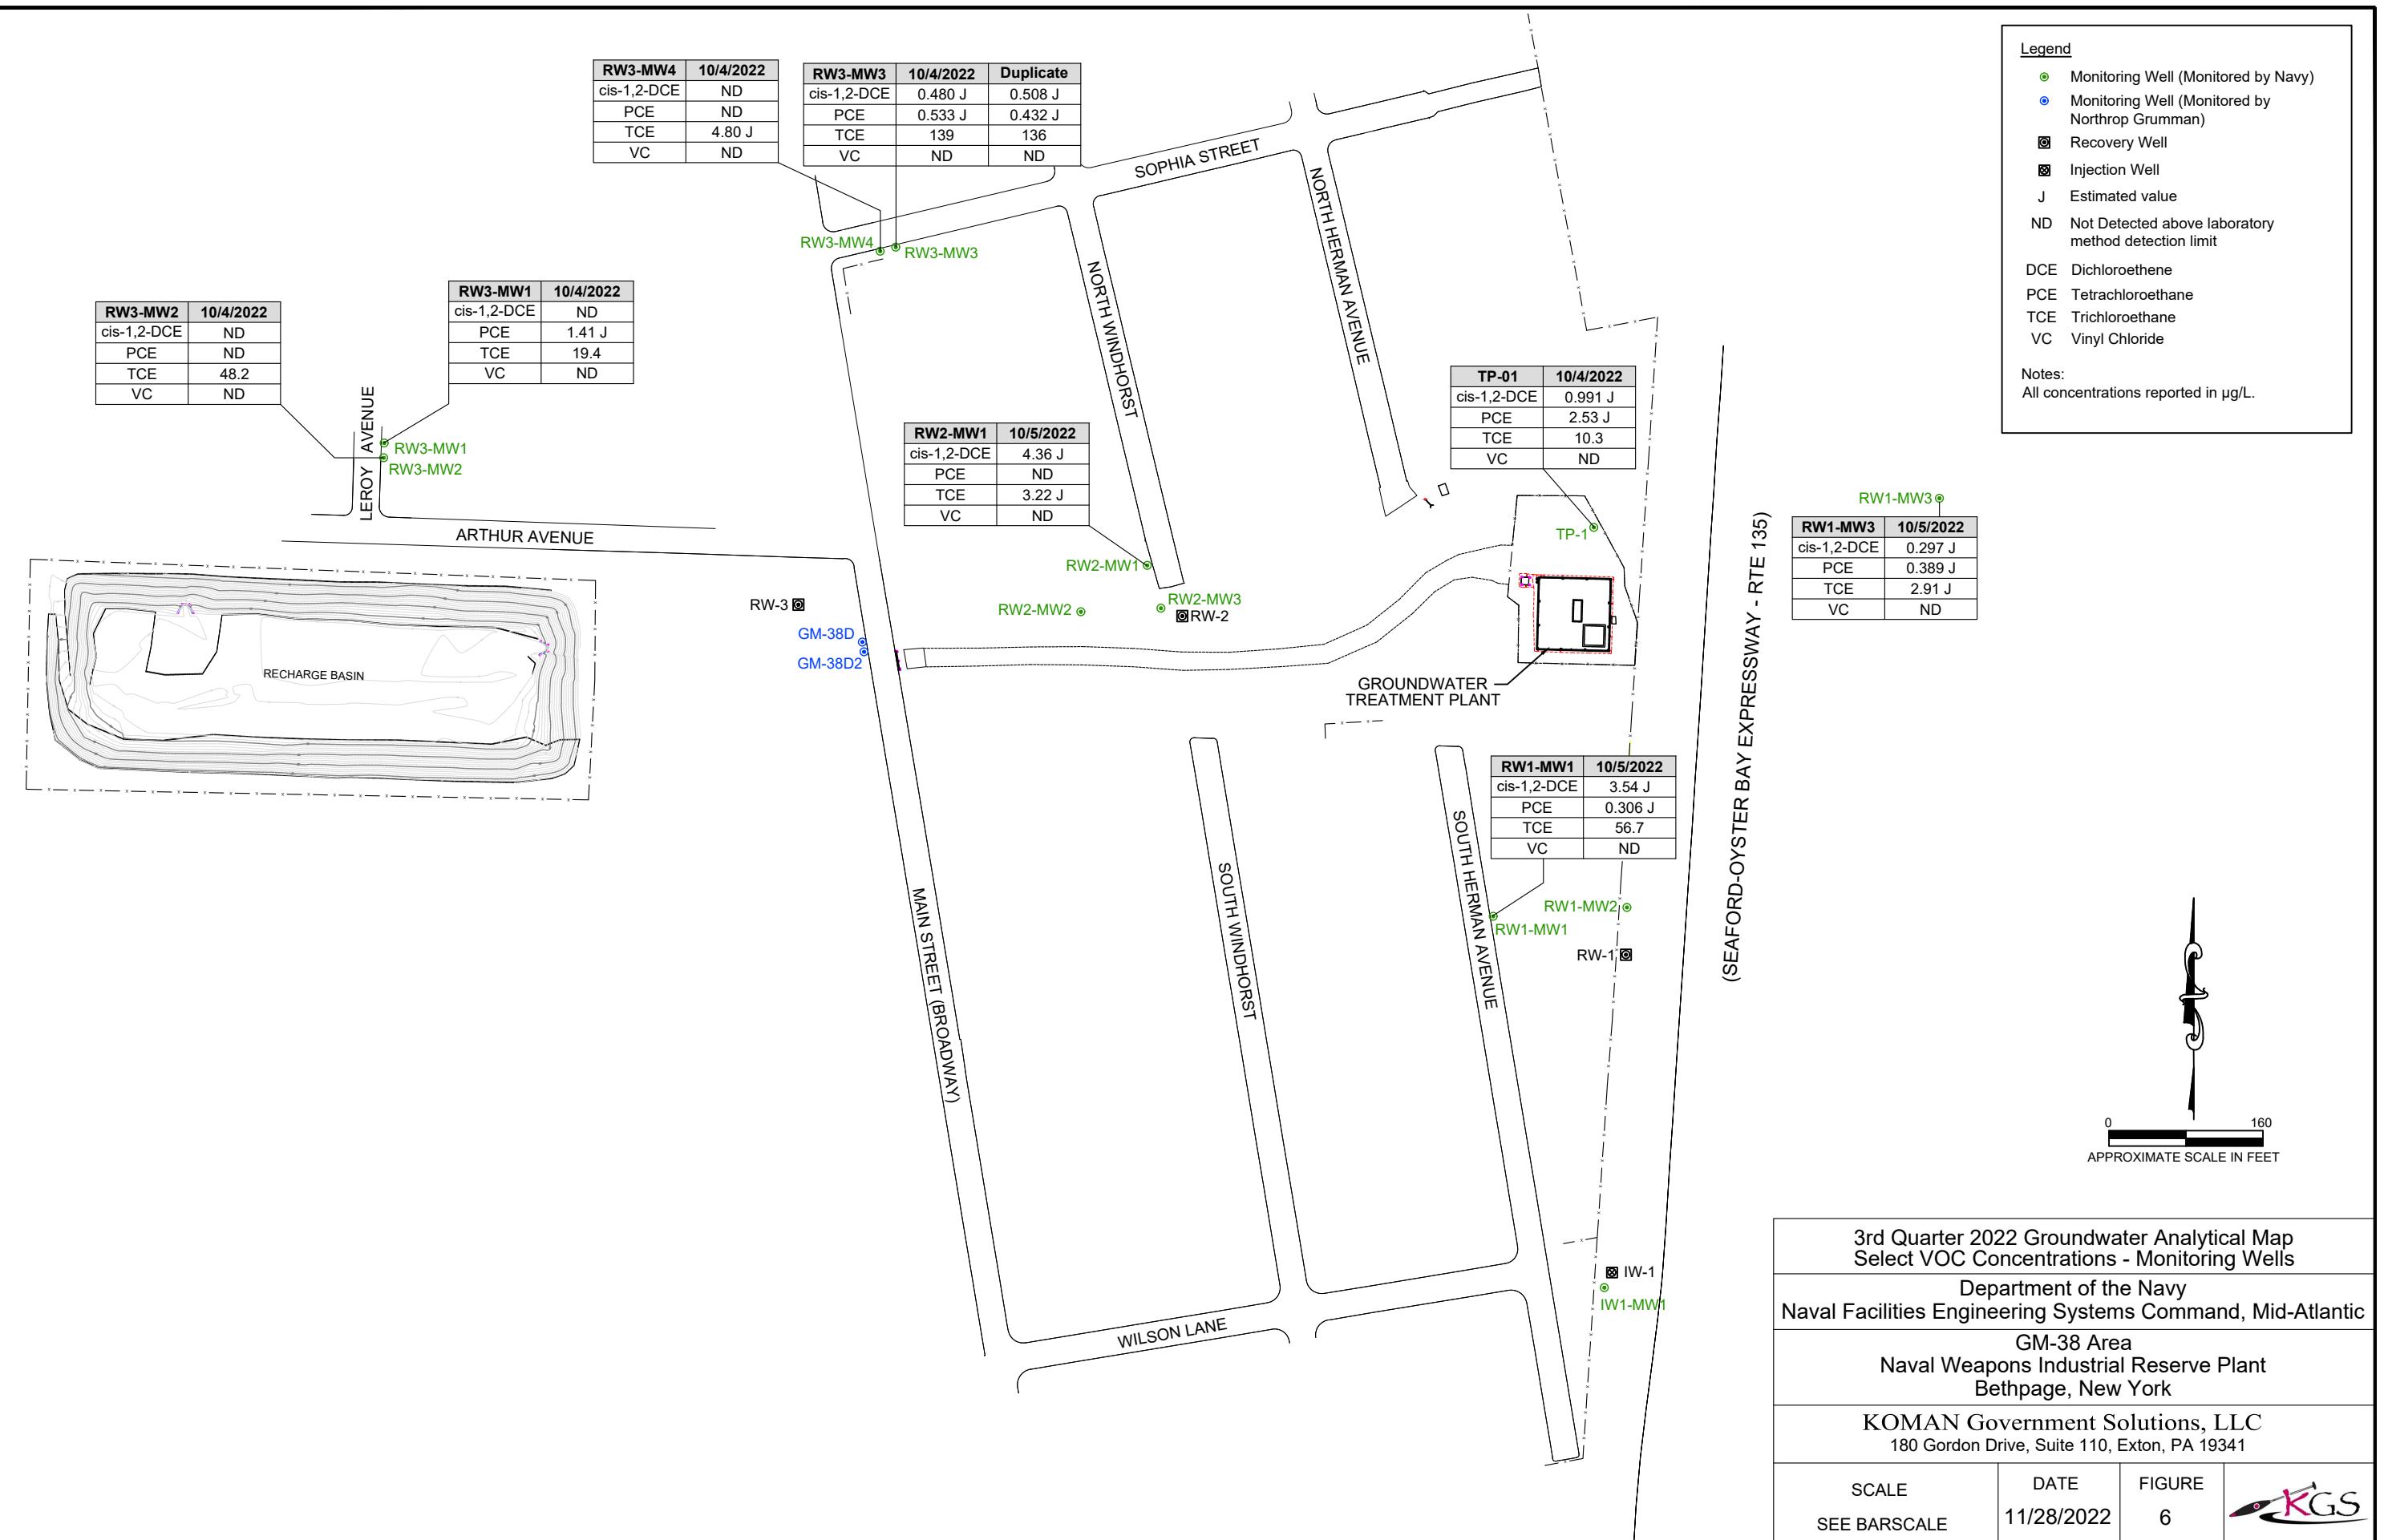


Figure 7
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW-1

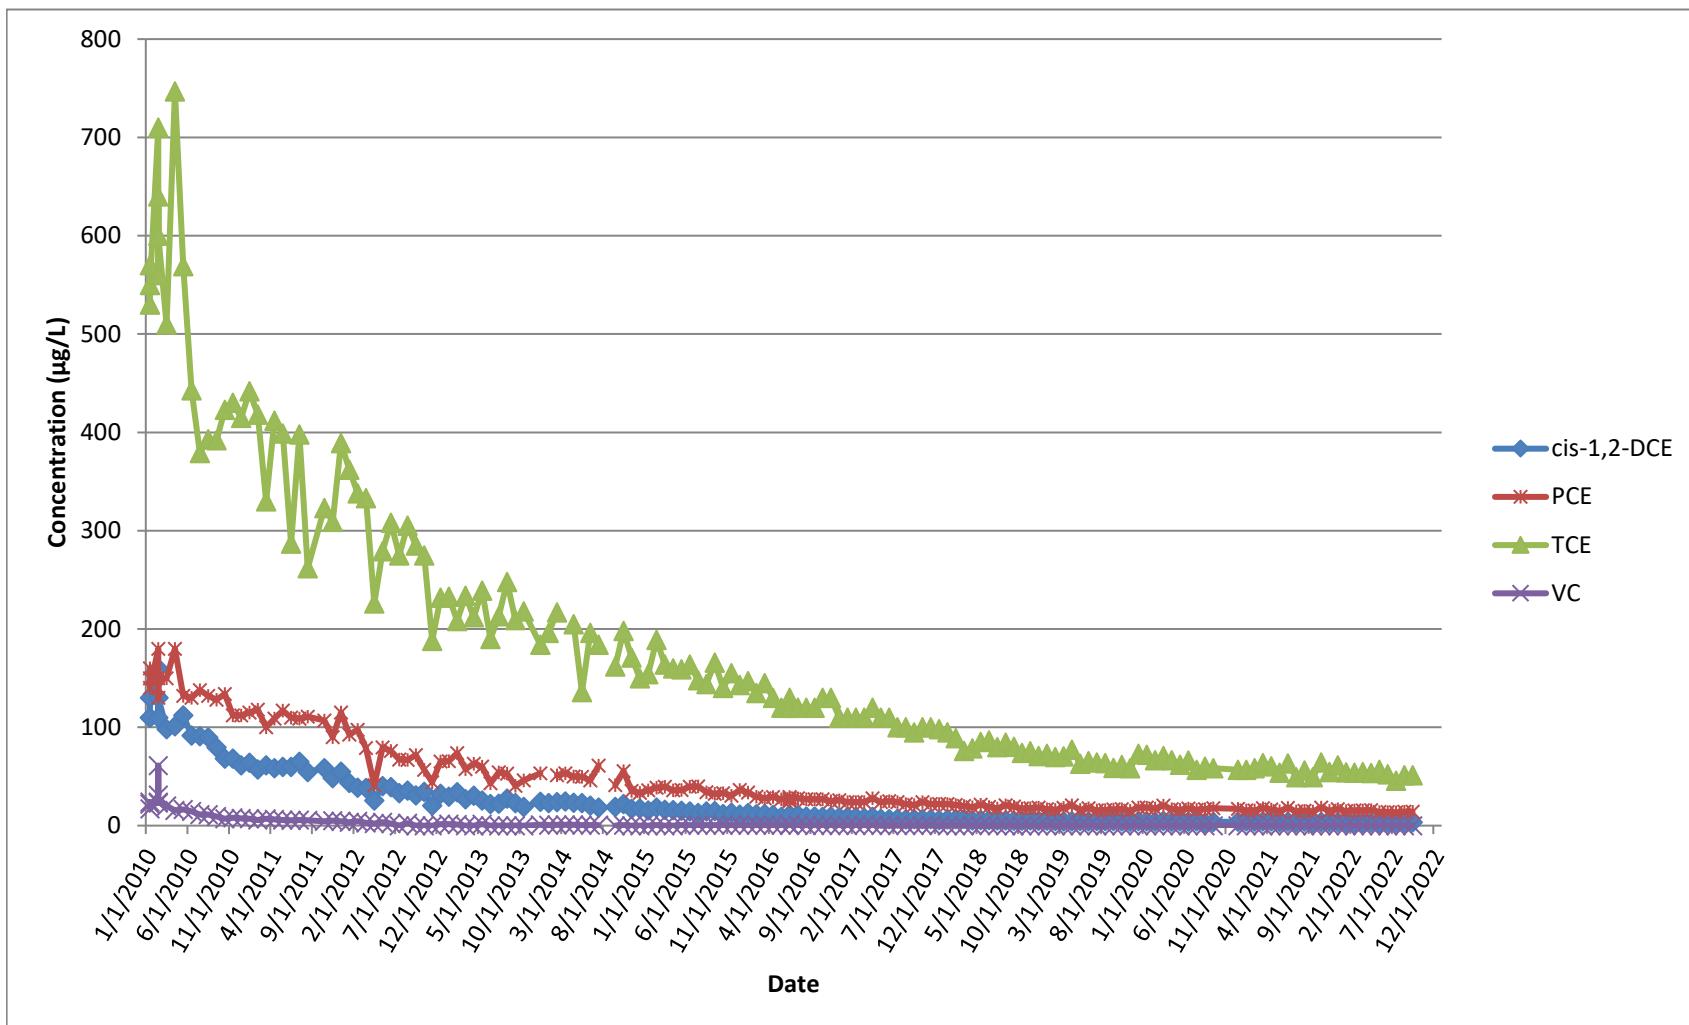


Figure 8
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW-4

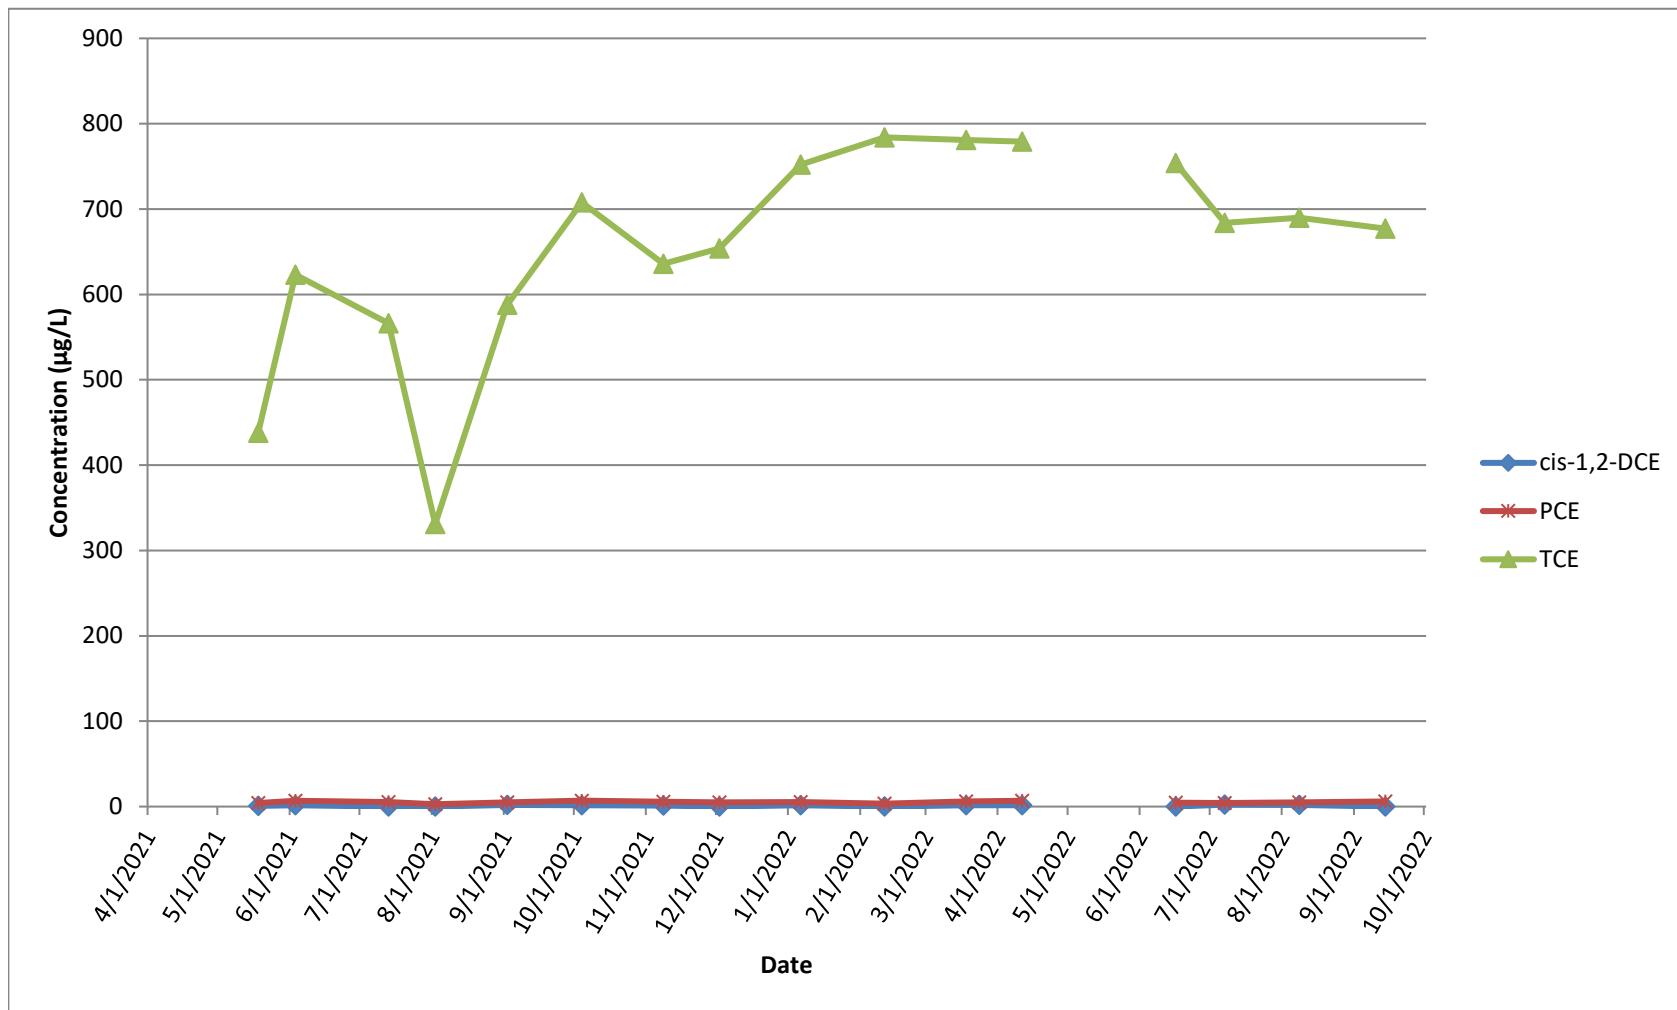


Figure 9
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW-4

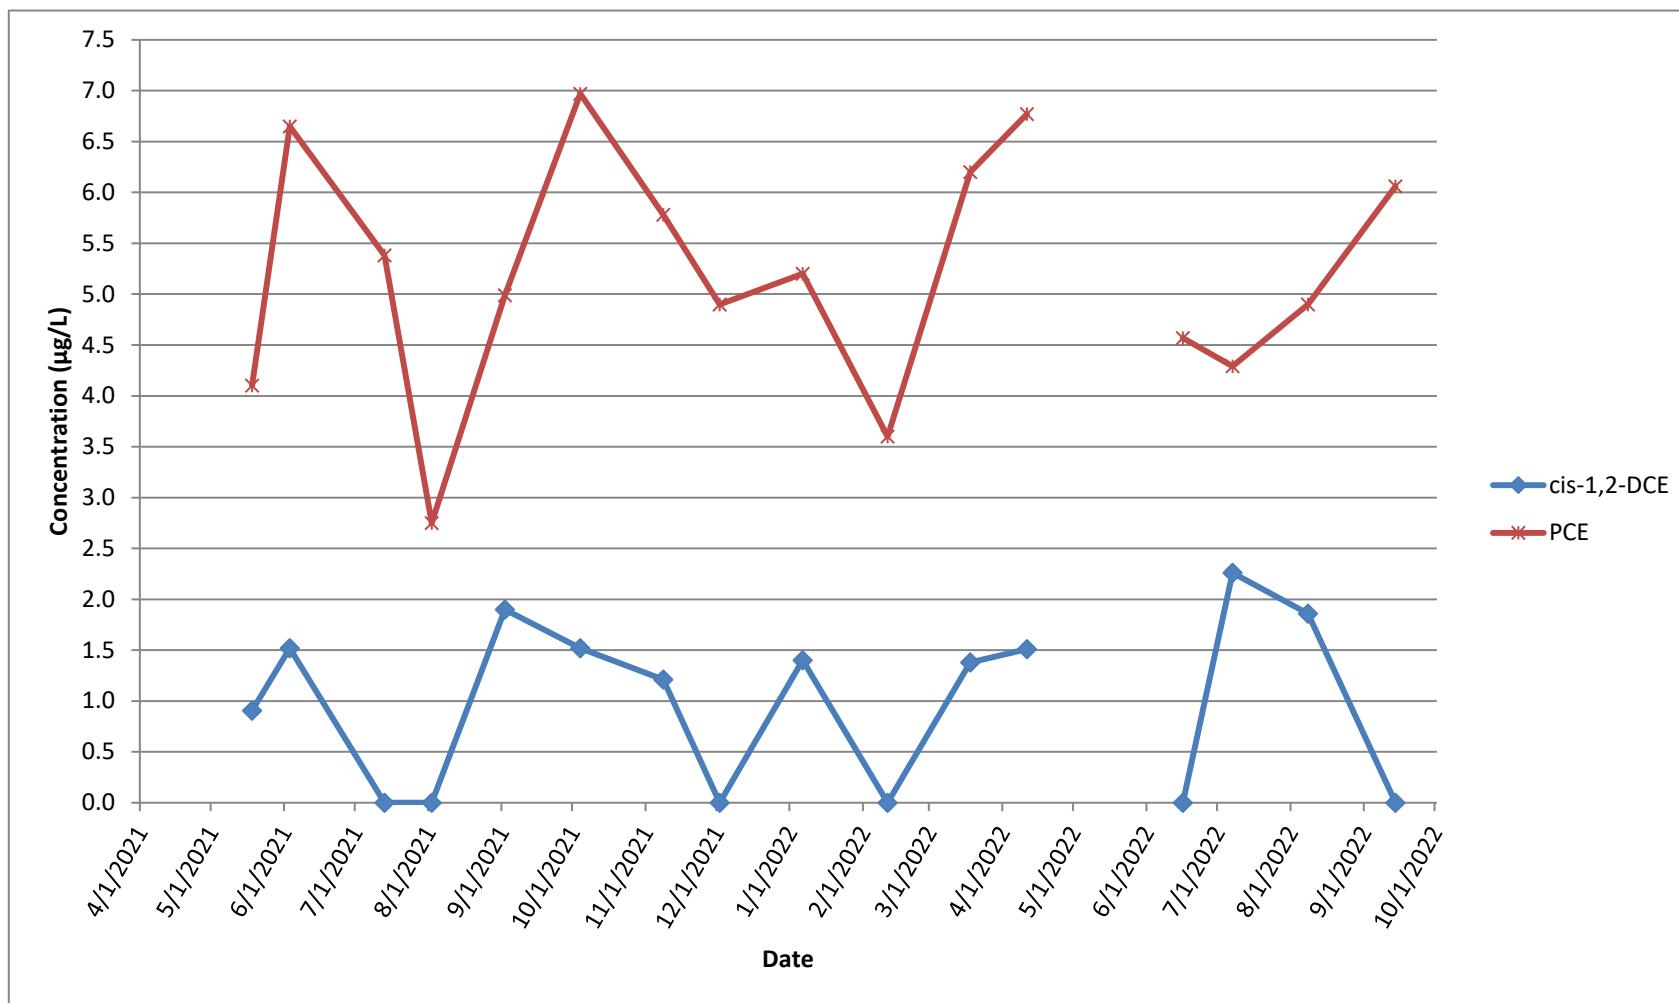


Figure 10
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW1-MW1

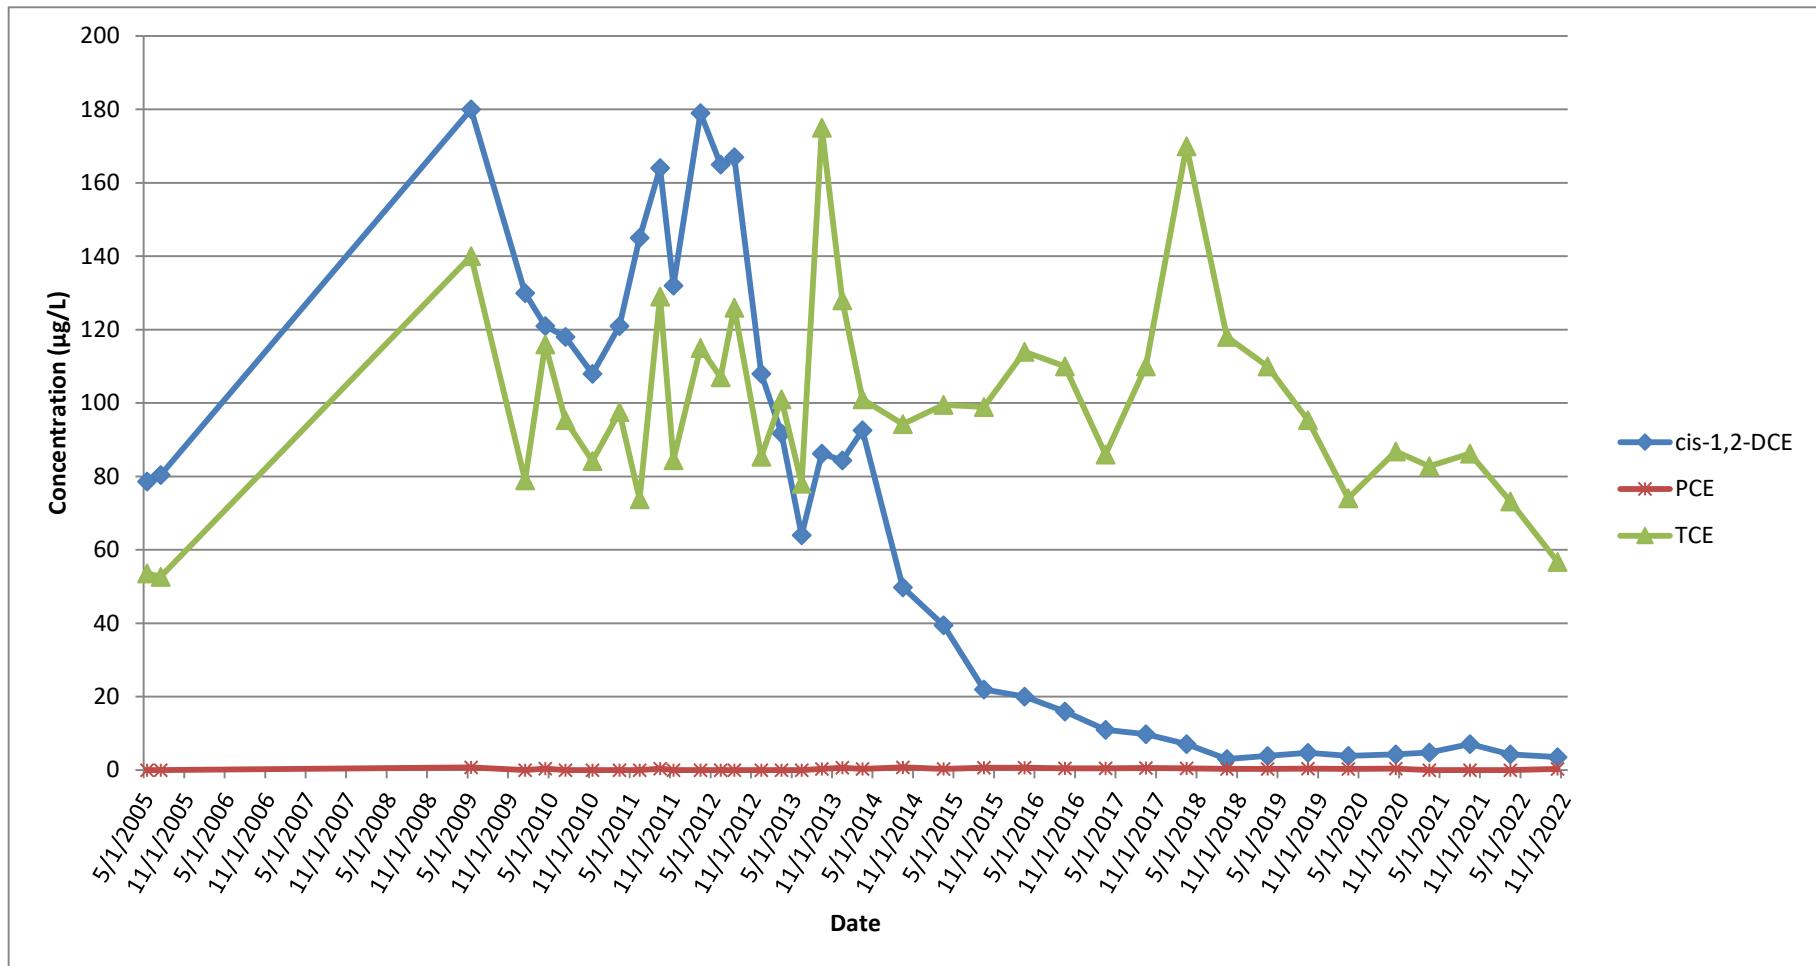


Figure 11
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW1-MW3

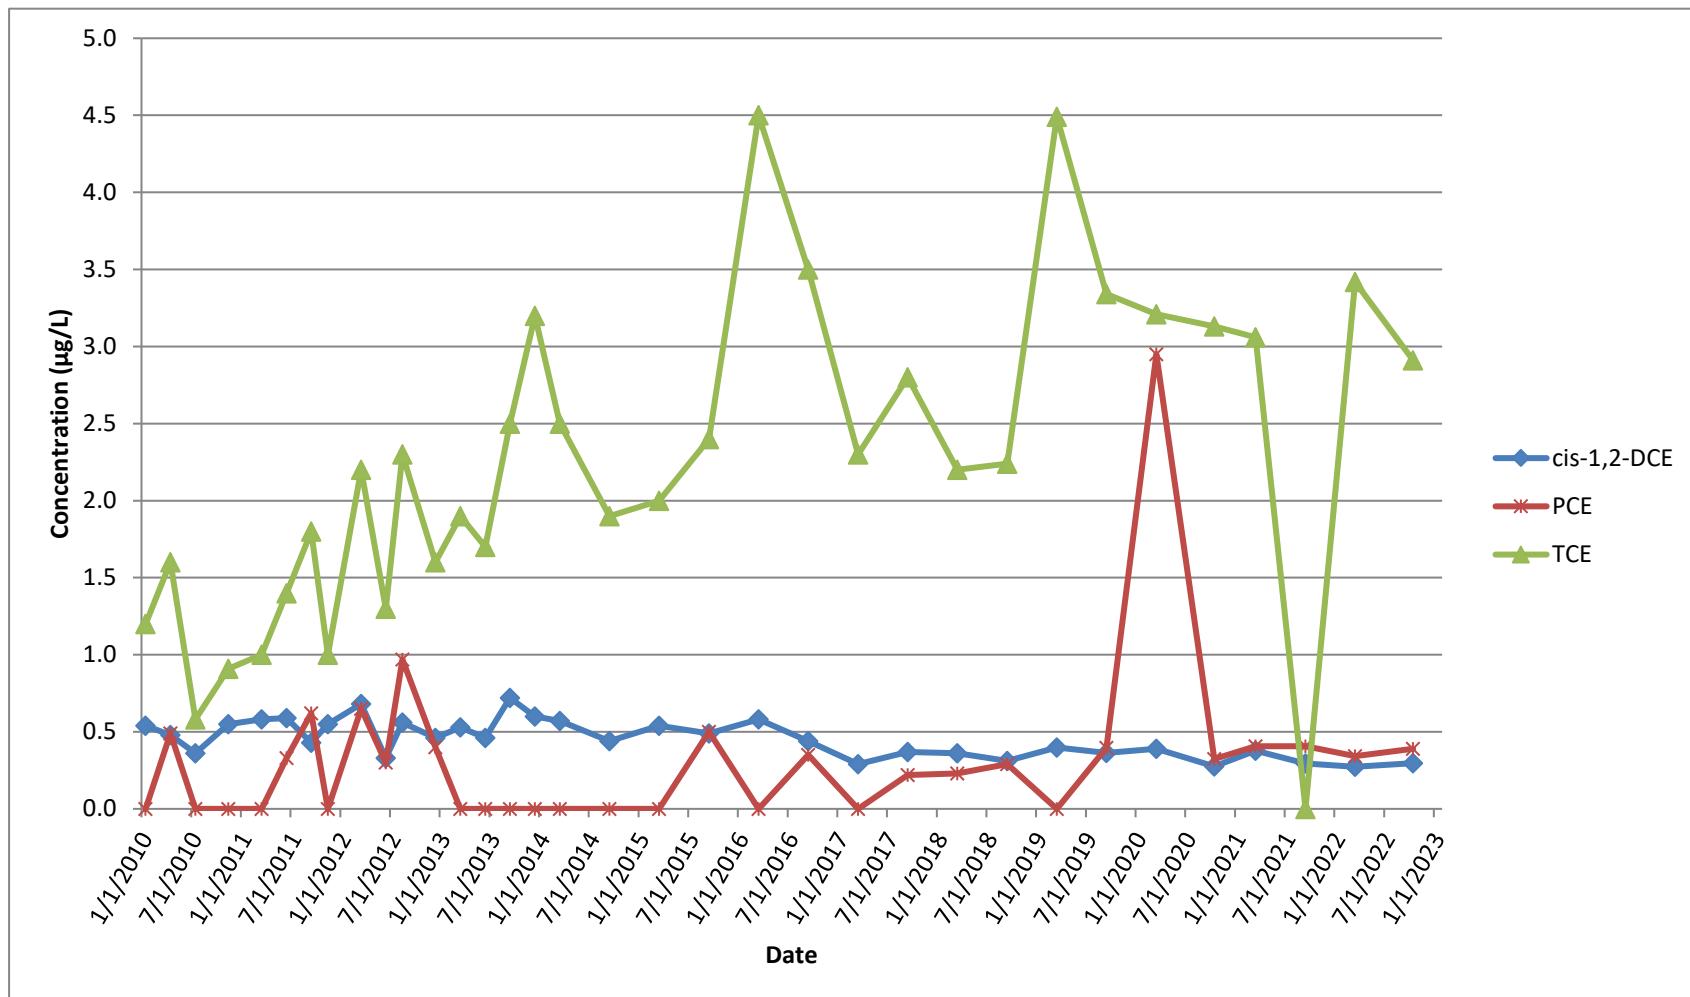


Figure 12
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW2-MW1

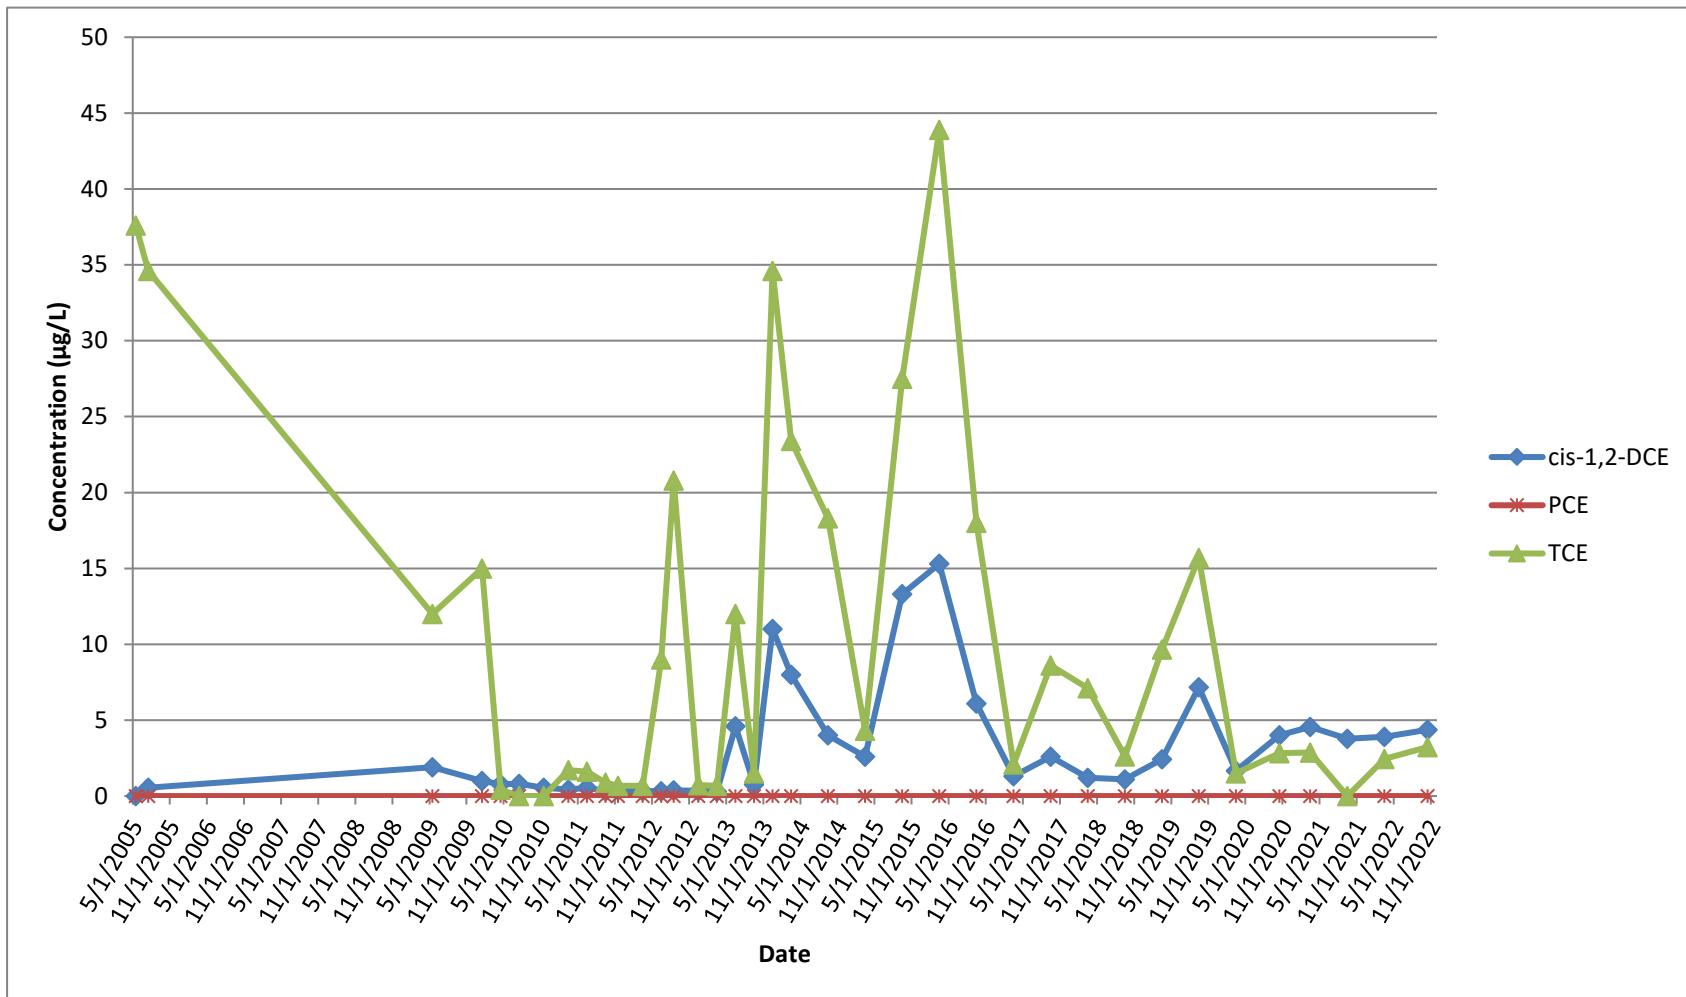


Figure 13
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW3-MW1

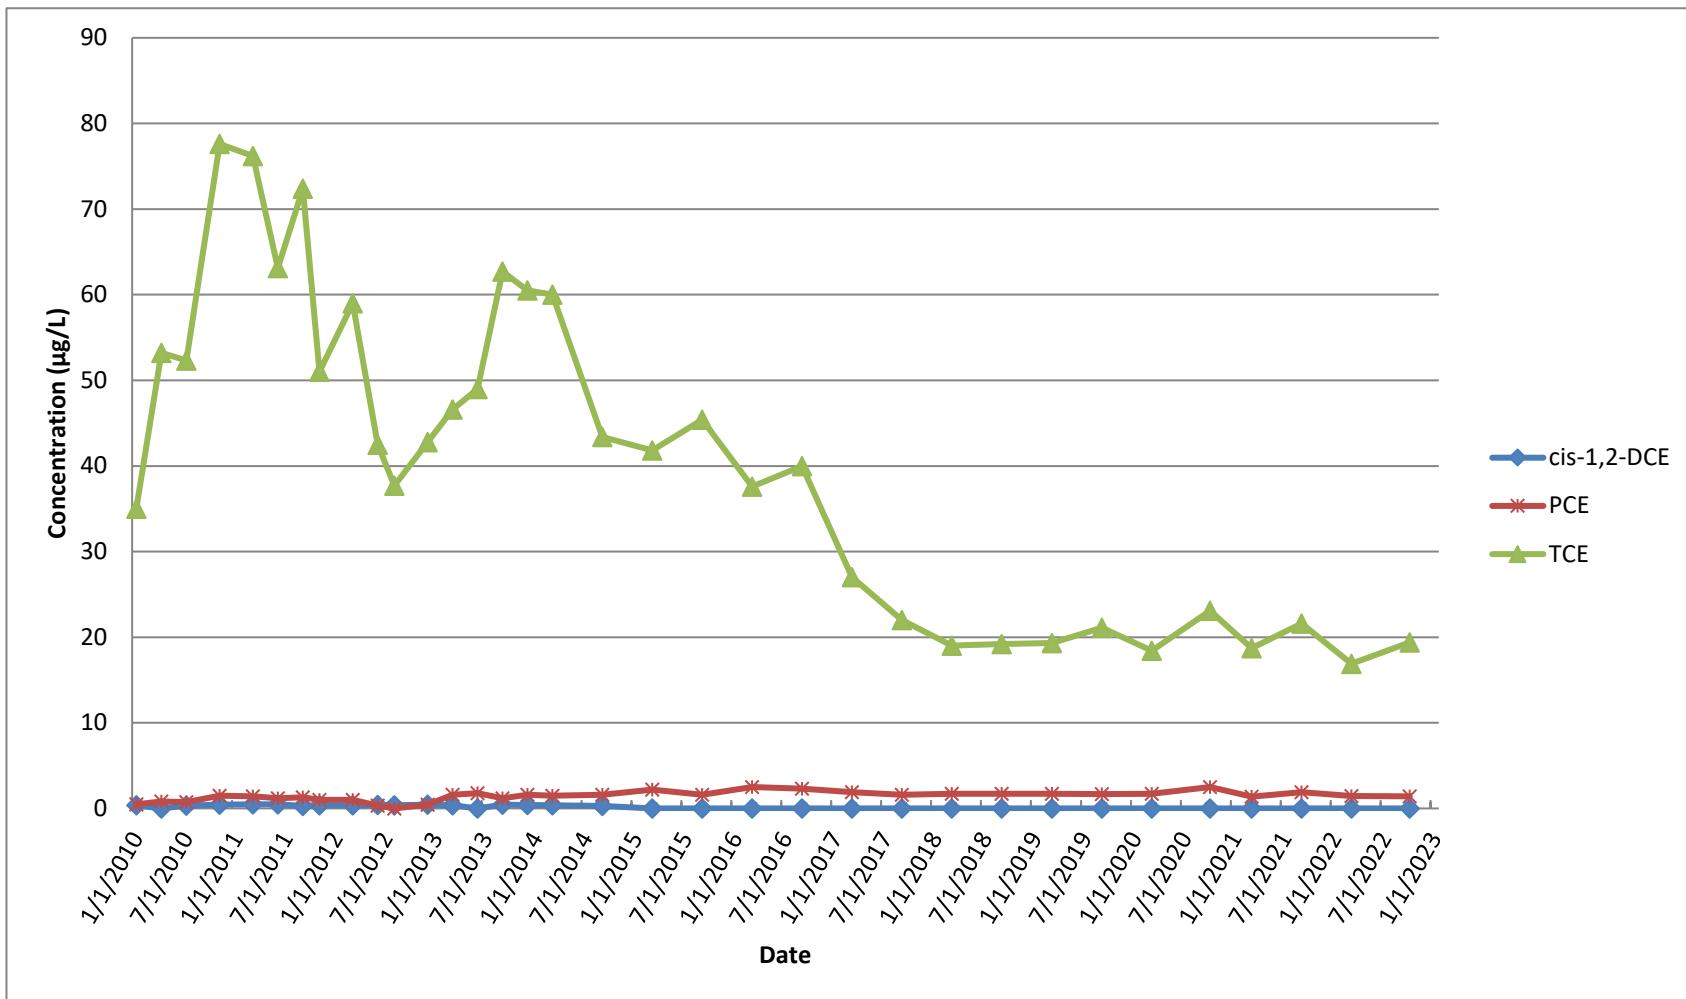


Figure 14
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW3-MW2

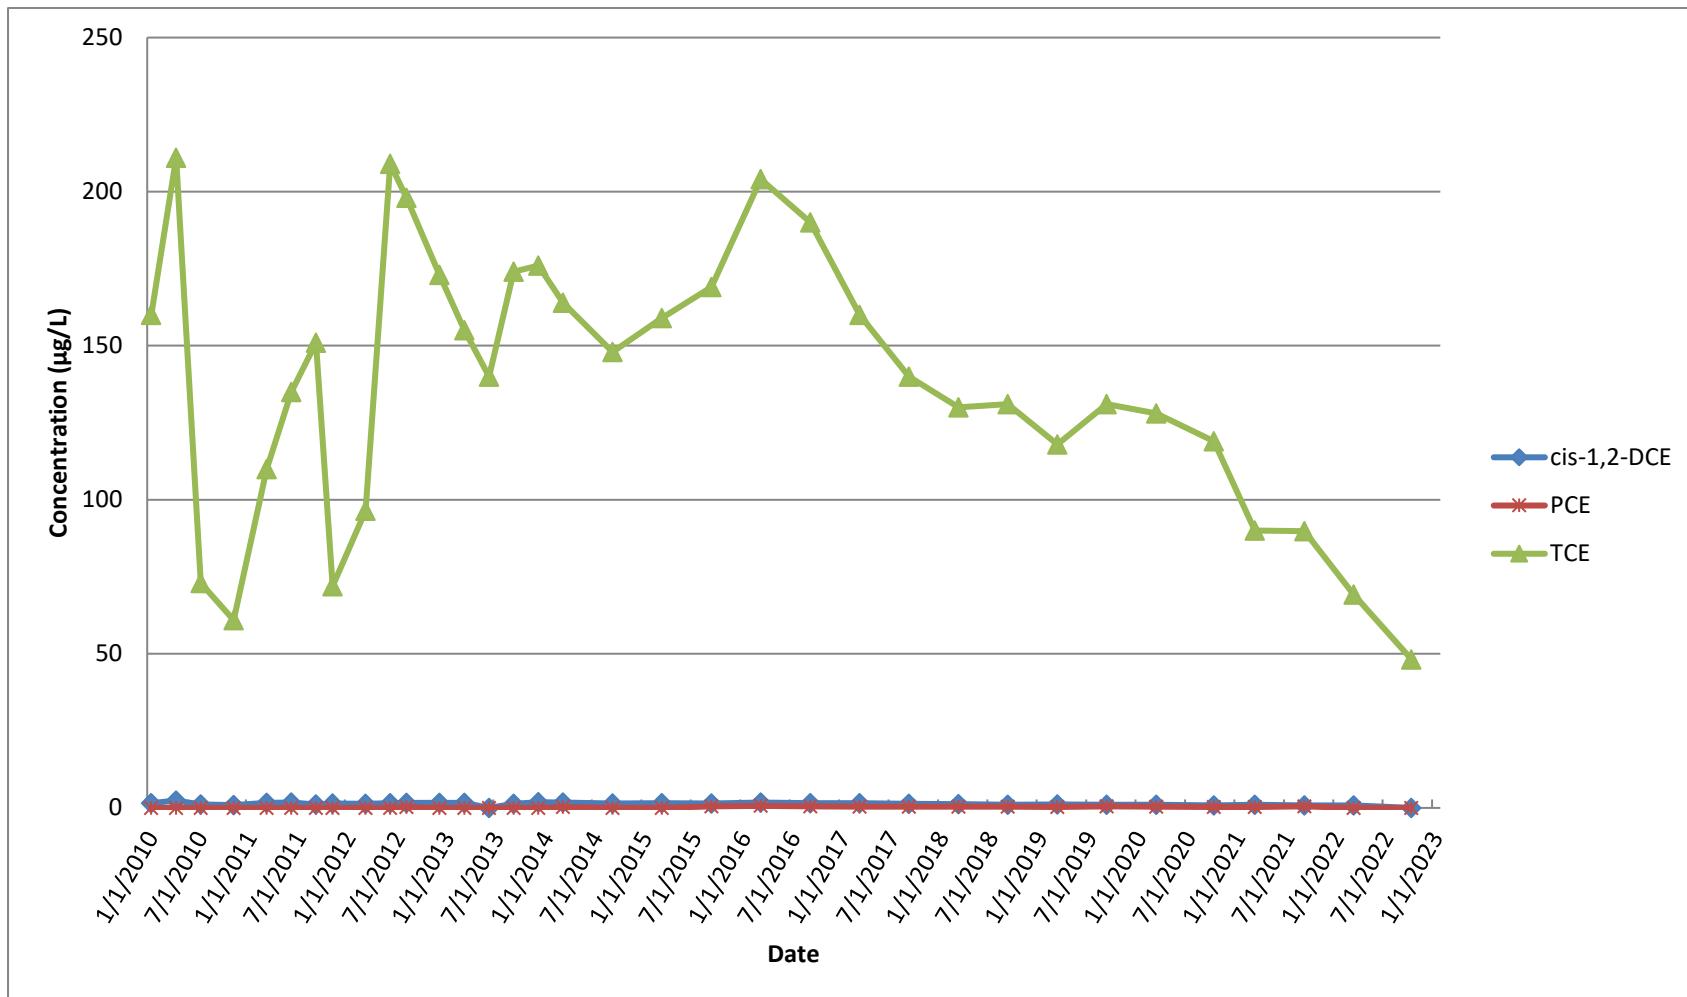


Figure 15
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW3-MW3

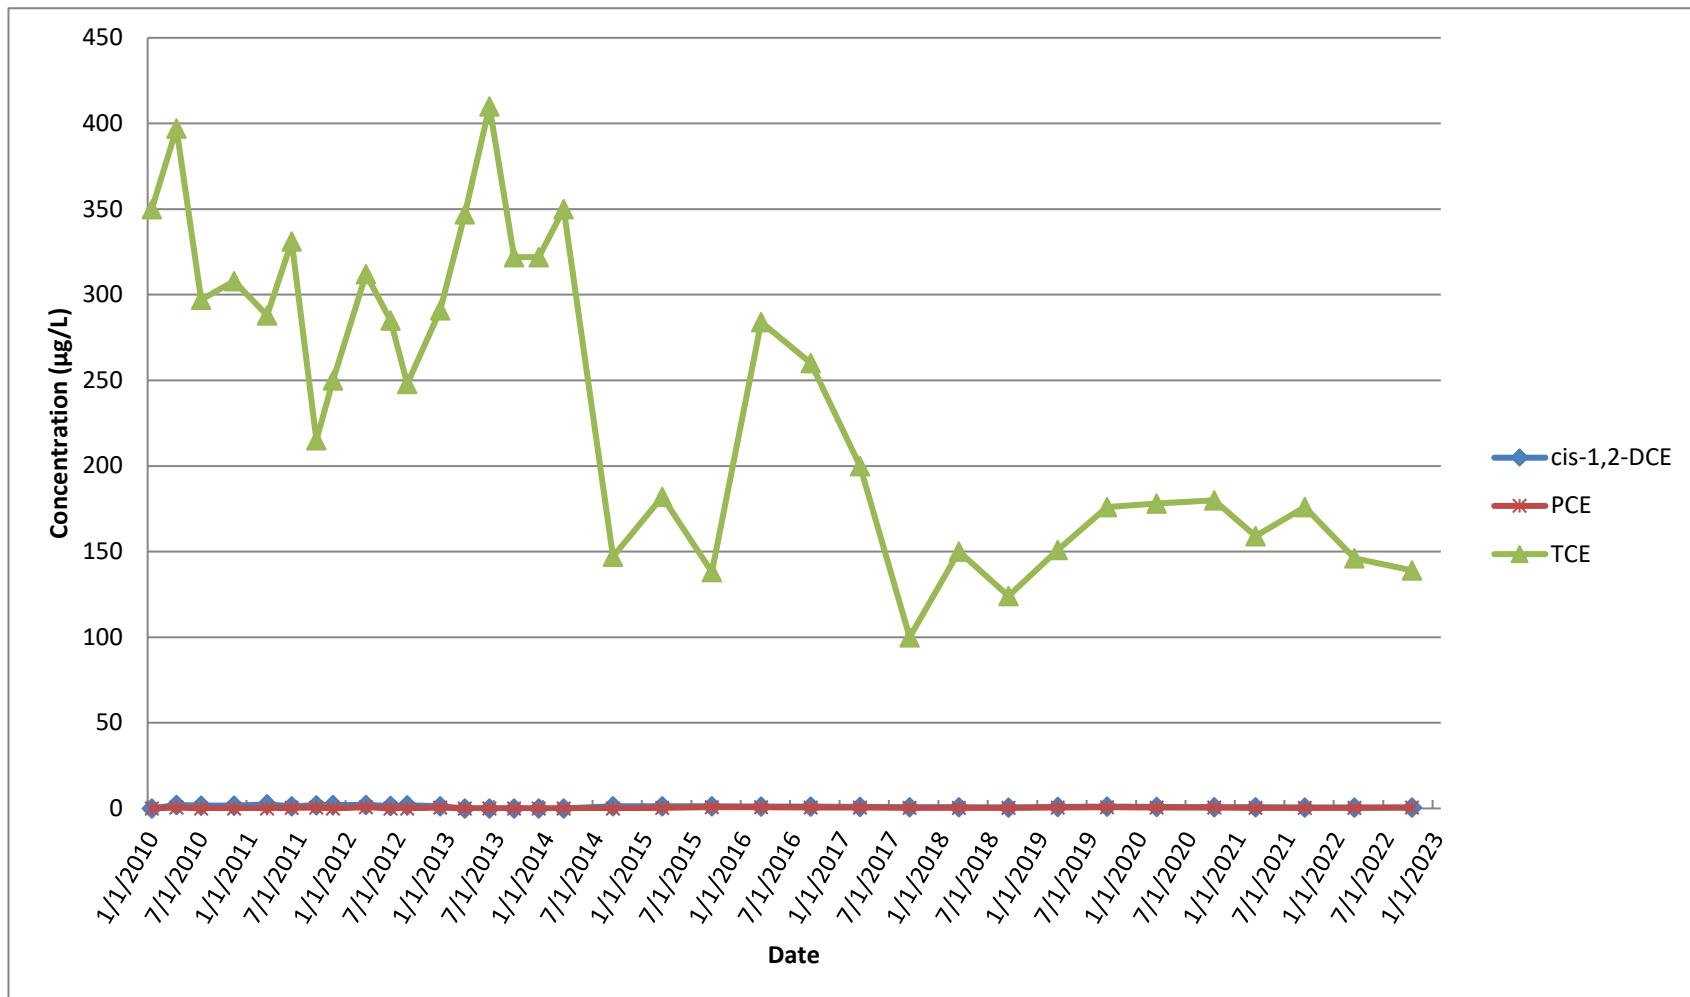


Figure 16
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
RW3-MW4


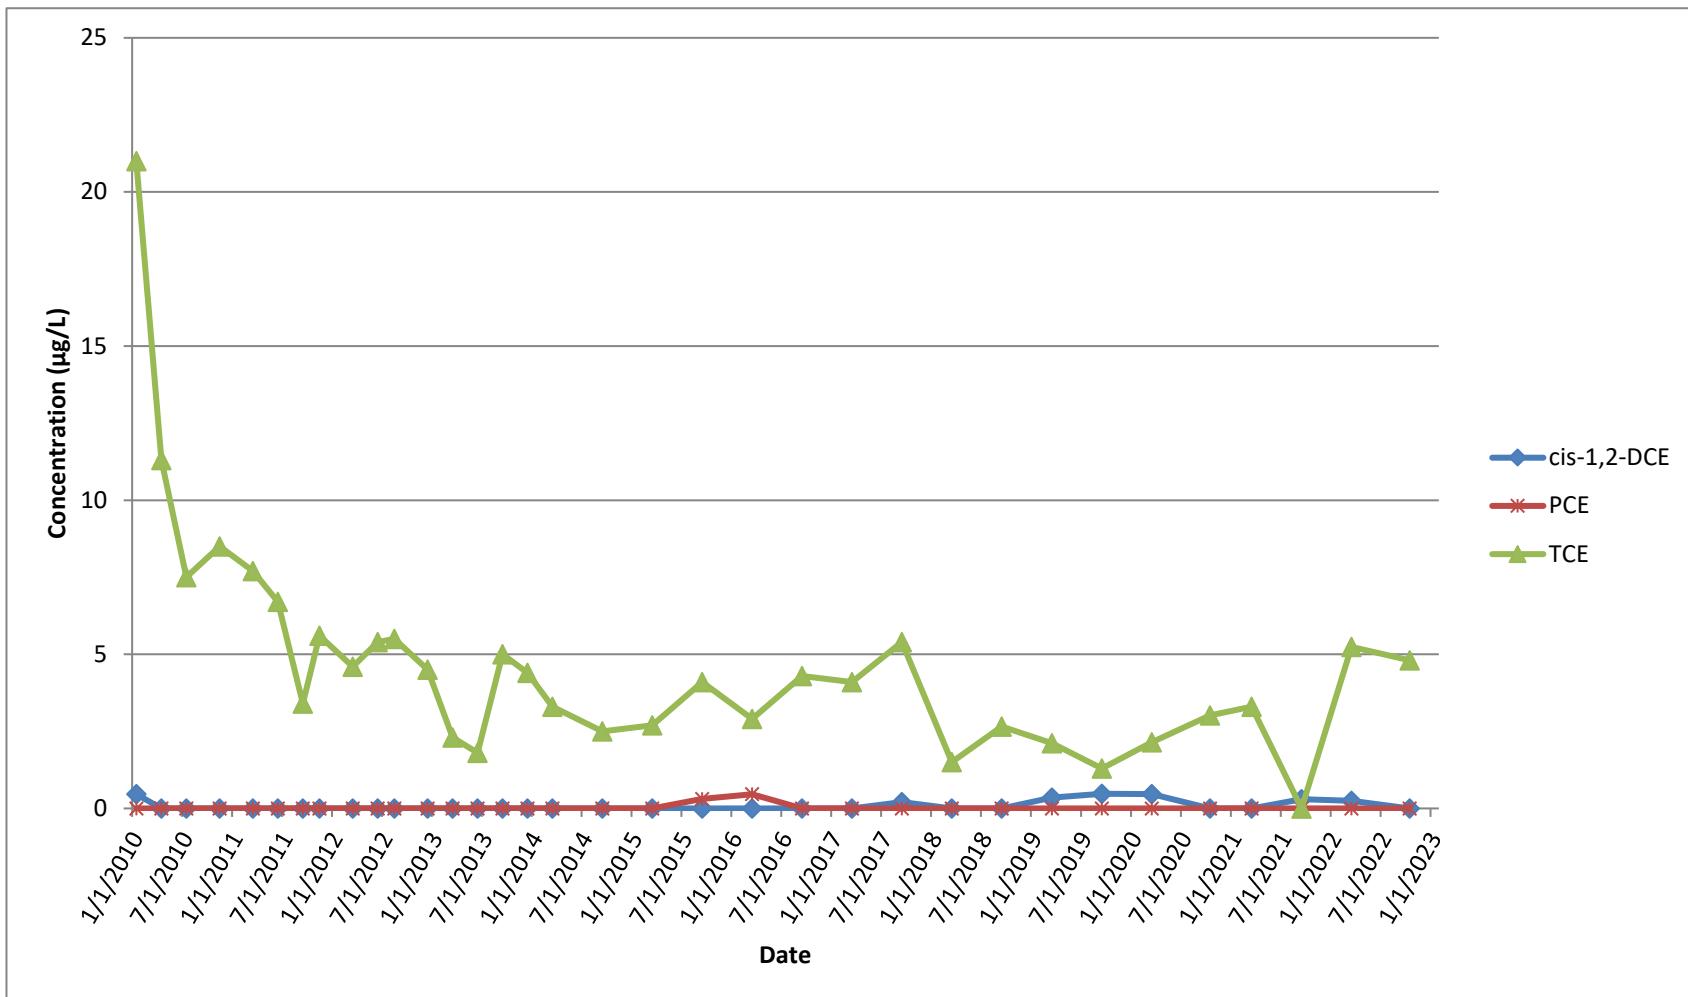


Figure 17
GM-38 Area Groundwater Remediation
Naval Weapons Industrial Reserve Plant - Bethpage, N
Groundwater Concentration Trends of Select VOCs
TP-01

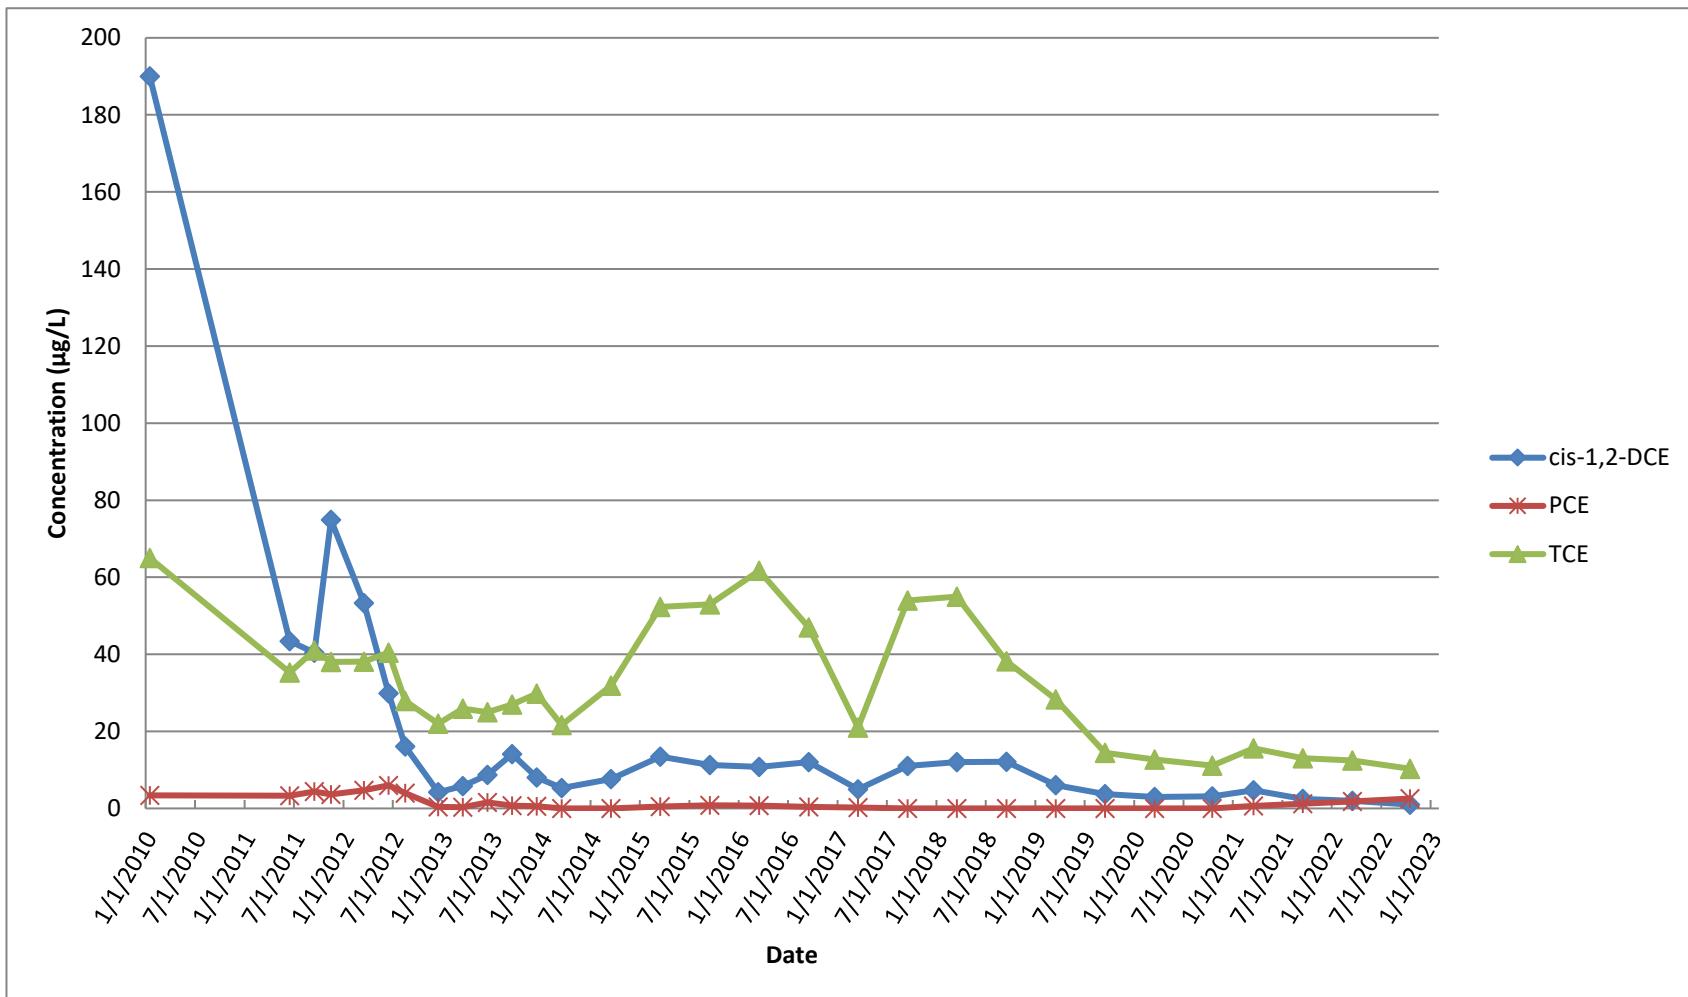

TABLES

Table 1
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Results
Third Quarter 2022

SPDES Parameters ¹	Daily Maximum Goal	Units	July 2022											
			RW-1	RW-3	RW-4	Combined Influent	Treated Effluent	Treated Effluent DUPLICATE	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	AOP Influent
Process Stream														
Well Depth		ft	445	530	675	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Screened Interval		ft	335-395 410-430	392-412 442-504	570-670	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Sampling Date	N/A										7/7/22			
Average Flowrate	1100	GPM	447	0	409	856	891	NR	NR	843	NR	NR	NR	NR
Total Flow	N/A	gallons	19,701,770	0	18,024,201	37,725,971	39,261,251	NR	NR	37,136,613	NR	NR	NR	NR
pH	5.5 - 8.5	SU	5.54	NS	6.20	5.86	6.77	6.76	6.92	6.93	6.75	6.77	6.77	6.75
Chloroform	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	1.03 J	NS	ND (1.0)	0.54 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	0.430 J	NS	2.13 J	1.24 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	2.99 J	NS	2.26 J	2.64 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	13.5	NS	4.29 J	9.1	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,1,1-Trichloroethane	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	45.6	NS	684	350.6	0.342 J	ND (1.0)	2.97 J	3.01 J	ND (1.0)	ND (1.0)	ND (1.0)	3.01 J
1,1,2-Trichlorotrifluoroethane	5	µg/L	ND (1.0)	NS	5.27 J	2.52 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
Vinyl Chloride	2	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)
1,4-Dioxane - 8270D	1	µg/L	1.8	NS	12	6.7	0.20	0.23	NS	NS	NS	NS	NS	6.2
1,4-Dioxane - 8270D SIM IDMS	1	µg/L	2.0	NS	14	7.7	0.23	0.27	NS	NS	NS	NS	NS	7.5
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	24.7	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)

Table 1
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Results
Third Quarter 2022

SPDES Parameters ¹	Daily Maximum Goal	Units	August 2022														
			RW-1	RW-3	RW-4	Combined Influent	Treated Effluent	Treated Effluent DUPLICATE	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	AOP Influent			
Process Stream																	
Well Depth		ft	445	530	675	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A			
Screened Interval		ft	335-395 410-430	392-412 442-504	570-670	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A			
Sampling Date	N/A						8/8/22										
Average Flowrate	1100	GPM	514	0	504	1,018	1,043	NR	NR	1,015	NR	NR	NR	NR			
Total Flow	N/A	gallons	22,650,430	0	22,245,899	44,896,329	45,982,249	NR	NR	44,763,387	NR	NR	NR	NR			
pH	5.5 - 8.5	SU	5.51	NS	6.07	5.79	6.59	6.58	6.86	6.89	6.57	6.59	6.59	6.56			
Chloroform	5	µg/L	0.308 J	NS	ND (1.0)	0.16 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
1,1-Dichloroethane	5	µg/L	1.13 J	NS	ND (1.0)	0.57 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
1,1-Dichloroethene	5	µg/L	0.629 J	NS	2.36 J	1.49 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
cis 1,2-Dichloroethene	5	µg/L	3.24 J	NS	1.86 J	2.56 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
Tetrachloroethene	5	µg/L	14.2	NS	4.90 J	9.59	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
1,1,1-Trichloroethane	5	µg/L	0.420 J	NS	ND (1.0)	0.21 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
Trichloroethene	5	µg/L	51.2	NS	690	367.7	0.538 J	0.359 J	4.24 J	4.27 J	0.262 J	0.251 J	0.327 J	3.6 J			
1,1,2-Trichlorotrifluoroethane	5	µg/L	ND (1.0)	NS	4.84 J	2.4 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
Vinyl Chloride	2	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			
1,4-Dioxane - 8270D	1	µg/L	1.6	NS	12	6.8	0.39	0.30	NS	NS	NS	NS	NS	6.6			
1,4-Dioxane - 8270D SIM IDMS	1	µg/L	2.0	NS	14	7.9	0.47	0.34	NS	NS	NS	NS	NS	8.0			
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)			
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	12.7	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)			

Table 1
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Results
Third Quarter 2022

SPDES Parameters ¹	Daily Maximum Goal	Units	September 2022												
			RW-1	RW-3	RW-4	Combined Influent	Treated Effluent	Treated Effluent DUPLICATE	Air Stripper Effluent (ASE)	Bag Filter Effluent (BFE)	Liquid Carbon 1 Effluent (LC1)	Liquid Carbon 2 Effluent (LC2)	Liquid Carbon 3 Effluent (LC3)	AOP Influent	
Process Stream															
Well Depth		ft	445	530	675	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Screened Interval		ft	335-395 410-430	392-412 442-504	570-670	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Sampling Date	N/A						9/14/22								
Average Flowrate	1100	GPM	470	0	459	929	985	NR	NR	1,178	NR	NR	NR	NR	
Total Flow	N/A	gallons	19,770,300	0	19,293,000	39,063,300	41,404,800	NR	NR	49,538,100	NR	NR	NR	NR	
pH	5.5 - 8.5	SU	5.59	NS	6.28	5.93	6.67	6.69	6.89	6.91	6.68	6.68	6.67	6.62	
Chloroform	5	µg/L	0.276 J	NS	ND (1.0)	0.14 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
1,1-Dichloroethane	5	µg/L	1.07 J	NS	ND (1.0)	0.54 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
1,1-Dichloroethene	5	µg/L	0.647 J	NS	1.60 J	1.12 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
cis 1,2-Dichloroethene	5	µg/L	3.35 J	NS	ND (1.0)	1.70 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
Tetrachloroethene	5	µg/L	14.2	NS	6.06 J	10.2	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
1,1,1-Trichloroethane	5	µg/L	0.315 J	NS	ND (1.0)	0.16 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
Trichloroethene	5	µg/L	51.2	NS	677	360	ND (1.0)	0.282 J	4.36 J	4.08 J	ND (1.0)	ND (1.0)	ND (1.0)	4.20 J	
1,1,2-Trichlorotrifluoroethane	5	µg/L	ND (1.0)	NS	4.69 J	2.3 J	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
Vinyl Chloride	2	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	
1,4-Dioxane - 8270D	1	µg/L	1.9	NS	13	7.4	0.11 *	0.12 *	NS	NS	NS	NS	NS	7.5	
1,4-Dioxane - 8270D SIM IDMS	1	µg/L	2.1	NS	14	8.0	0.11 *	0.13 *	NS	NS	NS	NS	NS	7.9	
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	ND (0.00010)	
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	ND (1.0)	NS	

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

NA - Not Applicable

ND - Not detected above laboratory method detection limit. Limit of detection (LOD) given in parentheses.

NR - Not Recorded

NS - Not Sampled

gpm - gallons per minute

* - Indicates the samples were reanalyzed outside of the holdtime.

-- LOD for non-detect combined well influent not applicable; RW-4 sample required dilution.

(1) Wastewater discharge equivalence permit renewed on 18 August 2017. Discharge limits established for 10 years. Chloroform, 1,4-dioxane and 1,1,2-trichlorotrifluoroethane are now monitored under the new permit.

Table 2
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
Third Quarter 2022

DAR Parameters	Discharge Goal ⁽³⁾	Units	July 2022					
			Influent (VCI1)	Effluent	Effluent Duplicate	VC12	VC23	
Process Stream								
Sampling Date				7/7/22				
Average Flowrate	N/A	CFM	NR	8,670				
Total Flow ⁽¹⁾	N/A	ft ³	NR	382,092,396	NR	NR	NR	
Total Flow ⁽²⁾	N/A	m ³	NR	10,819,652	NR	NR	NR	
1,2-Dichloroethane	N/A	µg/m ³	ND	0.98 J	1.1 J	ND	1.1 J	
cis 1,2-Dichloroethene	≤ 100,000 ⁽⁴⁾	µg/m ³	28	35	36	25	37	
trans 1,2-Dichloroethene		µg/m ³	ND	ND	ND	ND	ND	
1,2-Dichloroethene (total)	≤ 100,000	µg/m ³	ND	35	36	25	37	
Toluene	N/A	µg/m ³	ND	ND	ND	ND	ND	
Total Xylene	N/A	µg/m ³	ND	ND	ND	ND	ND	
1,1,2-Trichloroethane	N/A	µg/m ³	ND	ND	ND	ND	ND	
Trichloroethene	≤ 2600	µg/m ³	5400	5.1	ND	6.8	3.6 J	
Vinyl Chloride	≤ 560	µg/m ³	ND	ND	ND	ND	ND	
Tetrachloroethylene	≤ 5100	µg/m ³	140	ND	3.3 J	1.7 J	ND	

Notes:

NA - Not applicable

ND - Not detected

NR - Not recorded

SGC - Short-term Guideline Concentration

µg/m³ - micrograms per cubic meter

CFM - cubic feet per minute

DAR - Division of Air Resources

(1) Total Flow (ft³) = avg flowrate (cfm) * operational time (min)

(2) Total Flow (m³) = total flow (ft³) * (0.3048³)m³/ft³

(3) Discharge goal approved by NYSDEC's letter dated 10/31/2013.

(4) Discharge goal is for total 1,2-Dichloroethene.

Table 2
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
Third Quarter 2022

DAR Parameters	Discharge Goal ⁽³⁾	Units	Augst 2022					
			Influent (VC11)	Effluent	Effluent Duplicate	VC12	VC23	
Process Stream								
Sampling Date				8/8/22				
Average Flowrate	N/A	CFM	NR	8,132				
Total Flow ⁽¹⁾	N/A	ft ³	NR	358,626,713	NR	NR	NR	
Total Flow ⁽²⁾	N/A	m ³	NR	10,155,178	NR	NR	NR	
1,2-Dichloroethane	N/A	µg/m ³	ND	1.8 J	1.8 J	ND	1.6 J	
cis 1,2-Dichloroethene	≤ 100,000 ⁽⁴⁾	µg/m ³	24	26	27	48	28	
trans 1,2-Dichloroethene		µg/m ³	ND	ND	ND	ND	ND	
1,2-Dichloroethene (total)	≤ 100,000	µg/m ³	ND	26	27	48	28	
Toluene	N/A	µg/m ³	ND	ND	ND	ND	ND	
Total Xylene	N/A	µg/m ³	ND	ND	ND	ND	ND	
1,1,2-Trichloroethane	N/A	µg/m ³	ND	ND	ND	ND	ND	
Trichloroethene	≤ 2600	µg/m ³	6800	8.3	ND	16	5.8	
Vinyl Chloride	≤ 560	µg/m ³	ND	ND	ND	ND	ND	
Tetrachloroethene	≤ 5100	µg/m ³	150	7.4	ND	5.4	ND	

Notes:

NA - Not applicable

ND - Not detected

NR - Not recorded

SGC - Short-term Guideline Concentration

µg/m³ - micrograms per cubic meter

CFM - cubic feet per minute

DAR - Division of Air Resources

(1) Total Flow (ft³) = avg flowrate (cfm) * operational time (min)

(2) Total Flow (m³) = total flow (ft³) * (0.3048³)m³/ft³

(3) Discharge goal approved by NYSDEC's letter dated 10/31/2013.

(4) Discharge goal is for total 1,2-Dichloroethene.

Table 2
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
Third Quarter 2022

DAR Parameters	Discharge Goal ⁽³⁾	Units	September 2022				
			Influent (VC11)	Effluent	Effluent Duplicate	VC12	VC23
Process Stream							
Sampling Date				9/14/22			
Average Flowrate	N/A	CFM	NR	7,999			
Total Flow ⁽¹⁾	N/A	ft ³	NR	336,356,807	NR	NR	NR
Total Flow ⁽²⁾	N/A	m ³	NR	9,524,564	NR	NR	NR
1,2-Dichloroethane	N/A	µg/m ³	ND	1.6 J	1.4 J	1.9 J	1.5 J
cis 1,2-Dichloroethene	≤ 100,000 ⁽⁴⁾	µg/m ³	28	13	13	52	14
trans 1,2-Dichloroethene		µg/m ³	ND	ND	ND	1.1 J	ND
1,2-Dichloroethene (total)	≤ 100,000	µg/m ³	28	13	13	52	14
Toluene	N/A	µg/m ³	ND	ND	1.6 J	ND	ND
Total Xylene	N/A	µg/m ³	ND	ND	ND	ND	ND
1,1,2-Trichloroethane	N/A	µg/m ³	ND	ND	ND	ND	ND
Trichloroethene	≤ 2600	µg/m ³	7000	6.2	ND	92	8.3
Vinyl Chloride	≤ 560	µg/m ³	ND	ND	ND	ND	ND
Tetrachloroethene	≤ 5100	µg/m ³	180	ND	ND	7.9	ND

Notes:

NA - Not applicable

ND - Not detected

NR - Not recorded

SGC - Short-term Guideline Concentration

µg/m³ - micrograms per cubic meter

CFM - cubic feet per minute

DAR - Division of Air Resources

(1) Total Flow (ft³) = avg flowrate (cfm) * operational time (min)

(2) Total Flow (m³) = total flow (ft³) * (0.3048³)m³/ft³

(3) Discharge goal approved by NYSDEC's letter dated 10/31/2013.

(4) Discharge goal is for total 1,2-Dichloroethene.

Table 3
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Stack Emissions
Third Quarter 2022

DAR Parameters	Discharge Goal ⁽¹⁾	Units	July 2022	August 2022	September 2022
Sampling Date			7/7/22	8/8/22	9/14/22
Average Flowrate	N/A	CFM	8,670	8,132	7,999
Total Flow	N/A	ft ³	382,092,396	358,626,713	336,356,807
Total Flow	N/A	m ³	10,819,652	10,155,178	9,524,564
Trichloroethene	≤ 0.09	lb/hr	0.00016	0.00000	0.00018
Vinyl Chloride	≤ 0.02	lb/hr	0.00000	0.00000	0.00000
1,2 Dichloroethene	≤ 11	lb/hr	0.00112	0.00081	0.00038
1,2-Dichloroethane	N/A	lb/hr	0.00003	0.00005	0.00005
Toluene	N/A	lb/hr	0.00000	0.00000	0.00000
Total Xylene	N/A	lb/hr	0.00000	0.00000	0.00000
1,1,2-Trichloroethane	N/A	lb/hr	0.00000	0.00000	0.00000
Tetrachloroethene	≤ 0.18	lb/hr	0.00000	0.00000	0.00000

Notes:

NA - Not applicable

lb/hr - pounds per hour

DAR - Division of Air Resources

CFM - Cubic feet per minute

Stack Emissions (lb/hr) = average flowrate (cfm) * (0.3048^{^3})m³/ft³ * conc.(ug/m³) * 1 lb/453592370 ug *
60 min/hr

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

Table 4
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Groundwater Level Measurements
Third Quarter 2022

Monitoring Well ID	Date	Well Elevation (ft amsl)	Total Depth (ft)	Screen Interval (ft)	Depth to Water (ft)	Groundwater Elevation (ft amsl)
RW1-MW1	10/5/2022	85.86	435	395-435	36.65	49.21
RW1-MW2	10/5/2022	87.35	435	395-435	38.17	49.18
RW1-MW3	10/5/2022	80.34	435	395-435	29.66	50.68
RW2-MW1	10/5/2022	90.75	510	470-510	40.21	50.54
RW2-MW2	10/5/2022	90.15	510	470-510	39.67	50.48
RW2-MW3	10/5/2022	89.75	510	470-510	39.35	50.40
RW3-MW1	10/4/2022	92.22	350	330-350	38.56	53.66
RW3-MW2	10/4/2022	91.98	495	475-495	40.12	51.86
RW3-MW3	10/4/2022	92.98	340	320-340	39.92	53.06
RW3-MW4	10/4/2022	92.92	495	475-495	37.15	55.77
TP-01	10/4/2022	85.91	470	450-470	34.76	51.15
IW1-MW1	10/5/2022	89.41	150	20-150	41.77	47.64
RW-1	NA	91.37	340	320-340	NA	NA
RW-3	NA	91.57	495	475-495	NA	NA
RW-4	NA	NA	675	570-670	NA	NA

Notes:

amsl - above mean sea level

ft - feet

NA - Not Applicable

NM - Not Measured

Table 5
Summary of Final Groundwater Chemistry Data
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Groundwater Chemistry Results
Third Quarter 2022

Location	Temp (°C)	pH (SU)	S.C. (µS/cm³)	DO (mg/L)	ORP (mV)	Turbidity (NTU)	Color (Visual)
RW1-MW1	15.8	4.24	152	1.18	197.0	0.69	Clear
RW1-MW3	14.5	4.53	183	0.58	195.2	7.05	Clear
RW2-MW1	15.1	6.00	163	0.39	156.7	4.49	Clear
RW3-MW1	16.6	4.24	181	5.21	221.4	0.20	Clear
RW3-MW2	15.6	4.52	86	0.42	219.8	4.78	Clear
RW3-MW3	14.2	4.59	132	2.79	228.0	3.44	Clear
RW3-MW4	14.8	4.34	137	0.98	249.4	1.84	Clear
TP-01	14.1	5.01	262	3.54	203.6	0.50	Clear

Notes:

S.C. = Specific Conductance
 mS/cm = millisiemens per centimeter
 NTU = nephelometric turbidity units
 mg/L = milligrams per liter
 °C = degrees celsius
 mV = millivolts
 SU = standard units
 ORP = oxidation/reduction potential

Table 6
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Detected Groundwater Analytical Results
Third Quarter 2022

Sample ID	RW1-MW1	RW1-MW3	RW2-MW1	RW3-MW1	RW3-MW2	RW3-MW3	RW3-MW3	RW3-MW4	TP-01	RW-1	RW-4
Sample Date	10/5/2022	10/5/2022	10/5/2022	10/4/2022	10/4/2022	10/4/2022	10/4/2022	10/4/2022	10/4/2022	10/13/2022	10/13/2022
Comments							Duplicate				
VOCS (EPA 624.1) ug/L ⁽¹⁾											
Chloroform	0.454 J	0.583 J	ND	ND	ND	ND	0.291 J	0.475 J	0.645 J	0.259 J	ND
1,1-dichloroethane	3.39 J	3.13 J	2.01 J	ND	0.299 J	1.09 J	1.09 J	3.41 J	0.853 J	0.981 J	ND
1,2-dichloroethane	ND	ND	0.366 J	ND	ND						
1,1-dichloroethene	1.03 J	0.774 J	0.366 J	ND	ND	0.741 J	0.706 J	0.765 J	0.347 J	0.504 J	1.62 J
cis-1,2-dichloroethene	3.54 J	0.297 J	4.36 J	ND	ND	0.480 J	0.508 J	ND	0.991 J	3.03 J	1.25 J
trans-1,2-dichloroethene	ND	ND									
Tetrachloroethene	0.306 J	0.389 J	ND	1.41 J	ND	0.533 J	0.432 J	ND	2.53 J	14.4	5.62 J
1,1,1-trichloroethane	0.645 J	0.606 J	ND	ND	ND	0.235 J	0.268 J	0.591 J	0.333 J	0.423 J	ND
1,1,2-trichloroethane	ND	0.323 J	ND	NS	NS						
Trichloroethene	56.7	2.91 J	3.22 J	19.4	48.2	139	136	4.80 J	10.3	51.1	653
Vinyl Chloride	ND	ND									
1,4-Dioxane (EPA 8270D) ug/L	NS	1.8	12								
1,4-Dioxane (EPA 8270D SIM IDMS) ug/L	NS	2.0	13								
Mercury (EPA 245.1) ug/L	ND	ND									
TSS (SM20 2540D) mg/L	1.7	ND	3.3	ND	1.5	ND	ND	ND	ND	ND	ND

Notes:

J = estimated value

ND = Not detected above laboratory method detection limit

mg/L = milligrams per liter

µg/L = micrograms per liter

NS = Not Sampled

(1) Samples were analyzed for TCL VOCs (including tentatively identified compounds [TICs]). Only those VOCs detected are presented above.

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results
Through Third Quarter 2022

Sample ID	RW1-MW1							
	3/7/2019	9/26/2019	3/11/2020	10/6/2020	3/11/2021	9/29/2021	3/10/2022	10/5/2022
Comments								
Well Depth (Ft)	435							
Screened Interval (Ft)	395-435							
VOCS (EPA 624) ug/L ⁽⁴⁾								
Acrolein	NR	NR	NR	NR	NR	NR	NR	NR
Acrylonitrile	ND	ND	ND	ND	ND	ND	NR	ND
Acetone	NR	NR	NR	NR	NR	NR	ND	NR
Benzene	ND	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	ND	ND	ND	ND	ND	ND	ND	ND
2-butanol	NR	NR	NR	NR	NR	NR	NR	NR
carbon disulfide	NR	NR	NR	NR	NR	NR	ND	NR
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND
Dibromochloromethane	ND	ND	ND	ND	ND	ND	NR	ND
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	NR	NR	NR	NR	NR	NR
Chloroform	0.573 J	ND	0.476 J	0.454 J	0.480 J	ND	ND	0.454 J
Chloromethane	ND	ND	ND	ND	ND	ND	ND	ND
cyclohexane	NR	NR	NR	NR	NR	NR	ND	NR
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND
1,3-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	ND	NR
1,1-dichloroethane	7.89	6.30	6.26	5.54	4.23 J	4.90 J	4.18	3.39 J
1,2-dichloroethane	ND	0.227 J	ND	ND	ND	ND	0.119 J	ND
1,1-dichloroethene	2.19 J	1.79 J	1.76 J	1.81 J	1.44 J	1.25 J	1.39	1.03 J
cis-1,2-dichloroethene	3.86 J	4.70 J	3.86 J	4.33 J	4.77 J	7.06 J	4.33	3.54 J
trans-1,2-dichloroethene	ND	ND	ND	ND	0.228 J	ND	ND	ND
1,2-dichloropropane	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	NR
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND
2-hexanone	NR	NR	NR	NR	NR	NR	NR	NR
isopropylbenzene	NR	NR	NR	NR	NR	NR	ND	NR
methyl acetate	NR	NR	NR	NR	NR	NR	ND	NR
Methylene chloride	ND	ND	ND	ND	ND	ND	ND	ND
4-methyl-2-pentanone	NR	NR	NR	NR	NR	NR	ND	NR
styrene	NR	NR	NR	NR	NR	NR	ND	NR
1,1,2,2-tetrachloroethane	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-trichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR
Tetrachloroethene	0.323 BJ	0.401 J	0.308 J	0.395 J	ND	ND	ND	0.306 J
Toluene	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1-trichloroethane	1.16 J	0.988 J	0.841 J	0.819 J	0.674 J	0.649 J	0.673 J	0.645 J
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	ND	ND
Trichloroethene	110	95.4	74.1	86.8	82.8	86.2	73.2	56.7
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND
xlenes (total)	NR	NR	NR	NR	NR	NR	ND	NR
Mercury (EPA 245.1) ug/L	ND	ND	ND	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	ND	ND	ND	3.7	ND	1.5	1.4	1.7

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results
Through Third Quarter 2022

Sample ID	RW2-MW1															
	8/21/2012	12/7/2012	3/13/2013	6/17/2013 ⁽²⁾	9/17/2013	12/17/2013	12/17/2013	3/25/2014	9/23/2014	3/26/2015	9/14/2015	3/21/2016	3/21/2016	9/15/2016	3/1/2017	9/13/2017
	Comments				Duplicate								Duplicate			
Well Depth (ft)	510															
Screened Interval (ft)	470-510															
VOCS (EPA 624) ug/L ⁽⁴⁾																
Acrolein	30 R	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Acrylonitrile	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Acetone	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Benzene	ND	0.68 J	0.54 J	ND	0.59 J	ND	ND	0.21 J	0.21 J	0.56 J	ND	ND	0.18 J	ND	0.51 J	
Bromodichloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromoform	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromomethane	ND	ND	ND	ND	ND	ND	ND	1.8 J	ND	ND	ND	ND	ND	ND	ND	
2-butanone	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
carbon disulfide	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	7.0 J	1.6 J	ND	
Dibromochloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-chloroethylvinyl ether	ND	ND	ND	NR	ND	2.0 R	2.0 R	ND	ND							
Chloroform	ND	ND	ND	2.9	ND	ND	ND	2.8 J	1.5	0.46 J	2.2	3.4	3.5	2.4	0.25 J	
Chloromethane	ND	ND	ND	ND	ND	ND	ND	0.68 J	ND	ND	ND	ND	ND	ND	ND	
cyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dichlorobenzene	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,3-dichlorobenzene	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,4-dichlorobenzene	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1-dichloroethane	4.8	0.58 J	0.52 J	7.0	ND	5.8	6.4	5.1	ND	2.1	6.3	8.7	8.5	6.4	1.7	
1,2-dichloroethane	ND	ND	ND	1.3	ND	1.9 J	1.7 J	1.3	0.69 J	0.41 J	1.4	1.4	1.3	0.93 J	ND	
1,1-dichloroethene	0.95 J	0.19 J	ND	1.9	ND	2.6	2.6	1.8	1.3 J	0.61 J	2.6	3.7	3.4	1.6	0.27 J	
cis-1,2-dichloroethene	0.39 J	0.33 J	0.29 J	7.7	0.77 J	11.0 J	11.1 J	8.0	4.0	2.6	13.3	15.3	15.0	6.1	1.3	
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2-dichloropropane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
cis-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
trans-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-hexanone	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
isopropylbenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
methyl acetate	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Methylene chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
4-methyl-2-pentanone	NR	NR	NR	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
styrene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1,2,2-tetrachloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2,4-trichlorobenzene	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Tetrachloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Toluene	ND	0.27 J	ND	ND	0.31 J	ND	ND	ND	ND	0.26 J	ND	0.20 J	ND	ND	ND	
1,1,1-trichloroethane	0.33 J	ND	ND	0.84	ND	0.94 J	0.94 J	ND	0.39 J	ND	ND	ND	ND	0.56 J	ND	
1,1,2-trichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Trichloroethene	20.8	0.73 J	0.67 J	14	1.5	34.6	33.5	23.4	18.3	4.3	27.5	43.9	44.2	18	2.1	
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
xlenes (total)	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Mercury (EPA 245.1) ug/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
TSS (SM20 2540D) mg/L	12	10	ND	13	12	30	24	12	6	17	11	24	26	3.8	13.8	
															8.7	

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results
Through Third Quarter 2022

Sample ID	RW3-MW2										
Sample Date	9/12/2017	3/6/2018	9/11/2018	3/5/2019	9/25/2019	3/11/2020	10/6/2020	3/11/2021	9/29/2021	3/10/2022	10/4/2022
Comments											
Well Depth (Ft)	495										
Screened Interval (Ft)	475-495										
VOCS (EPA 624) ug/L ⁽⁴⁾											
Acrolein	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	
Acrylonitrile	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	
Acetone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromodichloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromoform	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Bromomethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-butanone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
carbon disulfide	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
Dibromochloromethane	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND	
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-chloroethylvinyl ether	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	
Chloroform	0.24 J	0.23 J	ND	ND	ND	ND	ND	ND	ND	ND	
Chloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
cyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,2-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,3-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,4-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1-dichloroethane	0.36 J	0.29 J	0.290 J	0.364 J	ND	0.203 J	0.287 J	0.279 J	0.350 J	0.371 J	
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1-dichloroethene	0.26 J	ND	ND	0.256 J	ND	ND	ND	ND	ND	ND	
cis-1,2-dichloroethene	1.3	1.2	0.990 J	1.10 J	0.994 J	1.00 J	0.809 J	1.05 J	0.828 J	0.774 J	
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2-dichloropropane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
cis-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
trans-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,4-dioxane	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Ethylbenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
2-hexanone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
isopropylbenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
methyl acetate	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Methylene chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
4-methyl-2-pentanone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
styrene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
1,1,2,2-tetrachloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,2,4-trichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Tetrachloroethene	0.43 J	0.38 J	0.430 J	0.328 J	0.477 J	0.367 J	0.317 J	0.274 J	0.485 J	ND	
Toluene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
1,1,1-trichloroethane	0.26 J	0.33 J	ND	ND	ND	ND	ND	ND	ND	ND	
1,1,2-trichloroethane	0.26 J	ND	ND	0.240 J	0.204 J	ND	ND	ND	ND	ND	
Trichloroethene	140	130	131	118	131	128	119	90.0	89.8	69.2	
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
xylenes (total)	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	
Mercury (EPA 245.1) ug/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	
TSS (SM20 2540D) mg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	1.5	

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results
Through Third Quarter 2022

Sample ID	TP-01																		
Sample Date	9/22/2014	3/25/2015	9/14/2015	9/14/2015	3/21/2016	9/14/2016	3/1/2017	9/13/2017	3/5/2018	9/11/2018	3/6/2019	9/25/2019	3/12/2020	10/6/2020	3/11/2021	9/29/2021	3/10/2022	10/4/2022	
Comments	Duplicate																		
Well Depth (Ft)	470																		
Screened Interval (Ft)	450-470																		
VOCS (EPA 624) ug/L ⁽⁴⁾	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR						
Acrolein	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR
Acrylonitrile	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Acetone	ND	ND	ND	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Benzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	ND	ND	ND	ND	ND	ND	ND	0.53 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-butanone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
carbon disulfide	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Dibromochloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	NR	ND
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-chloroethylvinyl ether	ND	ND	2.0 R	ND	ND	NR	ND	ND	ND	NR	NR	NR	NR	NR	NR	NR	NR	NR	ND
Chloroform	1.9	2.6	1.3	1.3	1.7	1.6	1.2	6.3	2.0	1.08	0.684 J	ND	ND	0.292 J	1.17 J	0.478 J	ND	0.645 J	
Chloromethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cyclohexane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromo-3-chloro-propane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dibromomethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,2-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,3-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dichlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
dichlorodifluoromethane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1-dichloroethane	1.3 J	2.5	2.1	2.0	1.8	2.1	0.78 J	1.3	1.2	1.24	0.717 J	0.381 J	0.335 J	0.363 J	0.629 J	0.533 J	0.895 J	0.853 J	
1,2-dichloroethane	0.67 J	0.88 J	0.82 J	0.82 J	0.86 J	0.70 J	0.45 J	0.79	0.79 J	0.650 J	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	0.47 J	1.2 J	0.77 J	0.83 J	0.75 J	0.68 J	0.23 J	0.36 J	0.46 J	0.420 J	ND	ND	ND	0.301 J	0.221 J	0.339 J	0.347 J		
cis-1,2-dichloroethene	7.6	13.4	11.3	11.6	10.8	12	5	11	12	12.1	6.01	3.75 J	3.01 J	3.14 J	4.73 J	2.51 J	1.99	0.991 J	
trans-1,2-dichloroethene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2-dichloropropane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Ethylbenzene	ND	ND	ND	ND	ND	ND	NR	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
2-hexanone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
isopropylbenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
methyl acetate	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Methylene chloride	ND	ND	ND	ND	0.37 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
4-methyl-2-pentanone	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
styrene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
1,1,2,2-tetrachloroethane	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-trichlorobenzene	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR
Tetrachloroethylene	ND	0.48 J	0.82 J	0.88 J	0.72 J	0.37 J	0.22 J	ND	ND	ND	ND	ND	ND	ND	ND	0.680 J	1.21 J	1.84 J	2.53 J
Toluene	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
1,1,1-trichloroethane	ND	ND	ND	ND	ND	0.49 J	0.25 J	0.29 J	0.27 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.3

Table 7
GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Summary of Historical Groundwater Analytical Results
Through Third Quarter 2022

Sample ID	IW-1 MW-1		IW-1	RW-3 ⁽³⁾				
Sample Date	5/3/2005	6/18/2013 ⁽²⁾	5/27/2009	9/15/2015	3/22/2016	9/15/2016	3/2/2017	9/13/2017
Comments								
Well Depth (Ft)	150		230	530				
Screened Interval (Ft)	20-150		200-230	392-412				
VOCS (EPA 624) ug/L ⁽⁴⁾								
Acrolein	NR	NR	NR	ND	ND	ND	ND	ND
Acrylonitrile	NR	NR	NR	ND	ND	ND	ND	ND
Acetone	ND	ND	ND	ND	ND	ND	NR	NR
Benzene	ND	ND	ND	ND	ND	ND	ND	ND
Bromodichloromethane	ND	ND	ND	ND	ND	ND	ND	ND
Bromoform	ND	ND	ND	ND	ND	ND	ND	ND
Bromomethane	ND	ND	ND	ND	ND	ND	ND	ND
2-butanone	R	ND	ND	NR	NR	NR	NR	NR
carbon disulfide	ND	NR	ND	NR	NR	NR	NR	NR
Carbon tetrachloride	ND	ND	ND	ND	ND	ND	ND	ND
Chlorobenzene	ND	ND	ND	ND	ND	ND	ND	ND
Dibromochloromethane	NR	ND	ND	ND	ND	ND	ND	ND
Chloroethane	ND	ND	ND	ND	ND	ND	ND	ND
2-chloroethylvinyl ether	NR	NR	ND	ND	ND	NR	ND	ND
Chloroform	0.94J	ND	0.98J	ND	0.46 J	0.26 J	ND	0.28 J
Chloromethane	ND	ND	ND	ND	ND	NR	ND	ND
cyclohexane	NR	NR	ND	NR	NR	NR	NR	NR
1,2-dibromo-3-chloro-propane	ND	NR	ND	NR	NR	NR	NR	NR
1,2-dibromomethane	ND	NR	ND	NR	NR	NR	NR	NR
1,2-dichlorobenzene	NR	NR	ND	ND	ND	ND	ND	ND
1,3-dichlorobenzene	NR	NR	ND	ND	ND	ND	ND	ND
1,4-dichlorobenzene	NR	NR	ND	ND	ND	ND	ND	ND
dichlorodifluoromethane	NR	NR	ND	NR	NR	NR	NR	NR
1,1-dichloroethane	0.39J	0.51	0.22J	1.9	2.1	1.8	1.4 J	1.5
1,2-dichloroethane	ND	ND	ND	ND	ND	ND	ND	ND
1,1-dichloroethene	ND	ND	ND	1.9	2.5	1.5	1.3 J	1.4
cis-1,2-dichloroethene	ND	ND	ND	1.6	2.4	1.4	1.6 J	1.9
trans-1,2-dichloroethene	ND	ND	ND	0.23 J	ND	ND	ND	ND
1,2-dichloropropane	ND	ND	ND	ND	ND	ND	ND	ND
cis-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND
trans-1,3-dichloropropene	ND	ND	ND	ND	ND	ND	ND	ND
1,4-dioxane	NR	NR	NR	NR	NR	NR	NR	ND
Ethylbenzene	ND	ND	ND	ND	ND	NR	NR	ND
2-hexanone	ND	ND	ND	NR	NR	NR	NR	NR
isopropylbenzene	NR	NR	ND	NR	NR	NR	NR	NR
methyl acetate	NR	NR	ND	NR	NR	NR	NR	NR
Methylene chloride	ND	ND	ND	0.64 J	ND	ND	ND	ND
4-methyl-2-pentanone	ND	ND	ND	NR	NR	NR	NR	NR
styrene	ND	NR	ND	NR	NR	NR	NR	NR
1,1,2,2-tetrachloroethane	ND	ND	ND	ND	ND	ND	ND	ND
1,2,4-trichlorobenzene	NR	NR	ND	NR	NR	NR	NR	NR
Tetrachloroethene	ND	0.55	ND	0.68 J	0.79 J	0.64 J	0.60 J	0.65 J
Toluene	ND	ND	0.19J	ND	ND	ND	ND	ND
1,1,1-trichloroethane	0.47	0.92	0.49J	0.96 J	1.3	0.95 J	ND	0.83 J
1,1,2-trichloroethane	ND	ND	0.30 J	0.49 J	0.29 J	ND	0.45 J	
Trichloroethene	ND	ND	0.17J	237	371	230	230	220
Vinyl chloride	ND	ND	ND	ND	ND	ND	ND	ND
xylenes (total)	ND	NR	ND	NR	NR	NR	NR	NR
Mercury (EPA 245.1) ug/L	NR	NR	0.20	ND	ND	ND	ND	ND
TSS (SM20 2540D) mg/L	NR	NR	2.4	ND	ND	ND	2.4	8.1

Note:

VOC analysis changed from SW846 8260B to EPA Method 624 in January 2010.

D = Dilution

J = estimated value

J- =biased low estimated value

ND = not detected

NR = not reported / required

R = rejected

mg/L - milligrams per liter

µg/L - micrograms per liter

(1) Analytical results presented above for samples collected from RW3-MW3 and RW3-MW4 in November 2010 are not consistent with historical trends, indicating samples may have been switched. For trend analysis, concentrations for RW3-MW3 were used for RW3-MW4 for November 2010 and vice versa.

(2) VOCs were analyzed by USEPA Method 524.2 (as opposed to Method 624) in June 2013 to correlate with samples collected under the Bethpage Regional Plume Comprehensive Groundwater Sampling Plan conducted in June 2013.

(3) RW-3, previously an active extraction well sampled on a monthly basis, was taken off-line on 7/1/15. While off-line, RW-3 was sampled semi-annually in conjunction with the semi-annual LTM events.

(4) Samples were analyzed for TCL VOCs, including tentatively identified compounds (TICs), beginning in March 2016. No TICs were detected, unless otherwise indicated.

Data prior to June 2011 were collected by others.


APPENDIX A

NYSDEC EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS AND JULY - SEPTEMBER 2022 DMRS

New York State Department of Environmental Conservation

Division of Water

Bureau of Water Permits, 4th Floor
 625 Broadway, Albany, New York 12233-3505
 Phone: (518) 402-8111 • FAX: (518) 402-9029
 Website: www.dec.state.ny.us



Alexander B. Grannis
 Commissioner

RECEIVED

JUN - 9 2008

BUREAU OF EASTERN
 REGIONAL WATER ENGINEERING

MEMORANDUM

TO: Steven Scharf, DER

FROM: Jean Occidental, DOW, Bureau of Water Permits JO

SUBJECT: Naval Weapons Industrial Reserve Plant (NWIRP); DER Site # 1-01-001

DRAINAGE BASIN: na

DATE: June 6, 2008

In response to your request and the permittee's SPDES Permit Equivalent Application dated April 27, 2008, attached is the effluent criteria for the above noted groundwater remediation discharge.

The Division of Water does not have any regulatory authority over a discharge from a State, PRP, or Federal Superfund Site. The Division of Environmental Remediation will be responsible for ensuring compliance with the attached effluent criteria and approval of all engineering submissions. Additional Condition (1) identifies the contact to send all effluent results, engineering submissions, and modification requests. The Regional Water Engineer should be kept apprised of the status of these discharges and, in accordance with the attached criteria, receive a copy of the effluent results for informational purposes.

If you have any questions, please call me at (518) 402-8116.

Attachment

cc: (w/att) RWE, Region 1
 C. Webber
 BWP Permit Coordinator

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

During the period beginning: April 1, 2009and lasting until: April 1, 2014

the discharges from the treatment facility to Groundwater shall be limited and monitored by the operator as specified below:

Outfall and Parameters	Limitations		Units	Minimum Monitoring Requirements	
	Daily Avg.	Daily Max.		Measurement Frequency	Sample Type
Treated Groundwater Remediation Discharge from: Recovery Wells 1, 2, and 3					
Flow	Monitor	1100	GPM	Continuous	Recorder
pH (range)	5.5 - 8.5		SU	Weekly	Grab
1,1-Dichloroethane	NA	5	µg/l	Monthly ¹	Grab
1,2-Dichloroethane	NA	0.6	µg/l	Monthly ¹	Grab
1,1-Dichloroethene	NA	5	µg/l	Monthly ¹	Grab
cis-1,2-Dichloroethene	NA	5	µg/l	Monthly ¹	Grab
trans-1,2-Dichloroethene	NA	5	µg/l	Monthly ¹	Grab
Tetrachloroethene	NA	5	µg/l	Monthly ¹	Grab
1,1,1-Trichloroethane	NA	5	µg/l	Monthly ¹	Grab
Trichloroethene	NA	5	µg/l	Monthly ¹	Grab
Vinyl chloride	NA	2	µg/l	Monthly ¹	Grab
Mercury	NA	0.25	µg/l	Monthly ¹	Grab

Footnotes:

- (1) The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations.

Naval Weapons Industrial Reserve Plant

DER site # 1-01-001

Page 1 of 2

Additional Conditions:

- (1) Discharge is not authorized until such time as an engineering submission showing the method of treatment is approved by the Department. The discharge rate may not exceed the effective or design treatment system capacity. All monitoring data, engineering submissions and modification requests must be submitted to:

Steven Scharf
Division of Environmental Remediation
NYSDEC, 625 Broadway
Albany, NY 12233-7015
Phone: (518) 402-9620

With a copy sent to:

Regional Water Engineer
NYSDEC - Region 1
Building 40, SUNY Campus
Stony Brook, New York 11790-2356
Phone: (631) 444-0354

- (2) Only site generated wastewater is authorized for treatment and discharge.
- (3) Authorization to discharge is valid only for the period noted above but may be renewed if appropriate. A request for renewal must be received 6 months prior to the expiration date to allow for a review of monitoring data and reassessment of monitoring requirements.
- (4) Any use of corrosion/scale inhibitors, biocidal-type compounds, or other water treatment chemicals used in the treatment process must be approved by the department prior to use.
- (5) This discharge and administration of this discharge must comply with the substantive requirements of 6NYCRR Part 750.

NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION

Division of Environmental Remediation, Remedial Bureau D
625 Broadway, 12th Floor, Albany, NY 12233-7013
P: (518) 402-9676 | F: (518) 402-9773
www.dec.ny.gov

August 31, 2017

Ms. Lora Fly
Remedial Project Manager
Naval Facilities Engineering Command
9324 Virginia Ave.
Bldg. Z-144, Code OPTE3-6
Norfolk, VA 23511

Re: SPDES Permit Equivalent Application,
Naval Weapons Industrial Reserve
Plant Site (NWIRP), Bethpage.
NYSDEC Site No 130003B

Lora:

The Department of the Navy (Navy) has requested to renew the State Pollutant Discharge Elimination System (SPDES) effluent for the GM-38 groundwater extraction and treatment system. The New York State Department Environmental Conservation (NYSDEC) has reviewed this request and has established discharge limits for the GM-38 system. These discharge limits, and associated reporting requirements, are detailed in the attached memorandum from the NYSDEC Division of Water.

Thanks and please do not hesitate to contact me at (518) 402-9478 or jason.pelton@dec.ny.gov with any questions.

Sincerely,

Jason M. Pelton
Project Manager
Remedial Section B, Remedial Bureau D
Division of Environmental Remediation

cc:
B. Caldwell, EnSafe/Resolution Consultants
S. Edwards, NYSDEC
D. Hesler, NYSDEC
C. Haas, NYSDEC Region 1
W. Parish, NYSDEC Region 1
S. Karpinski, NYSDOH
J. DeFranco/J. Lovejoy, NCDOH
L. Thantu, USEPA Region 2

NEW YORK STATE DEPARTMENT OF ENVIRONMENTAL CONSERVATION

Division of Water, Bureau of Permits
625 Broadway, Albany, New York 12233-3505
P: (518) 402-8111 | F: (518) 402-9029
www.dec.ny.gov

M E M O R A N D U M

TO: Jason Pelton, DER
FROM: Robert Wither, Chief, South Permits Section, DOW
SUBJECT: Naval Weapons Industrial Reserve Plant, DER Site #1-30-003B
DATE: August 18, 2017

In response to your request received July 13, 2017, attached please find effluent limitations and monitoring requirements for the above noted remediation discharge.

The DOW does not have any regulatory authority over a discharge from a State, PRP, or Federal Superfund Site. DER will be responsible for ensuring compliance with the attached effluent limitations and monitoring requirements, and approval of all engineering submissions. Footnote 1 identifies the appropriate DER contact as the place to send all effluent results, engineering submissions, and modification requests. The Regional Water Engineer should be kept apprised of the status of this discharge and, in accordance with the attached criteria, receive a copy of the effluent results for informational purposes.

If you have any questions, please call me at 518-402-8123.

Attachment (Effluent Limitations and Monitoring Requirements)

cc: Cathy Haas, RWE, Region 1

EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

During the period beginning **September 1, 2017** and lasting until **August 31, 2027** the discharges from the wastewater treatment facility to groundwater, Class GA shall be limited and monitored by the operator as specified below:

Outfall Number and Parameter	Discharge Limitations		Units	Minimum Monitoring Requirements	
	Monthly Avg.	Daily Max		Measurement Frequency	Sample Type
Outfall 001 - Treated Remediation Discharge:					
Flow	Monitor	1100	GPM	Continuous	Recorder
pH (range)	5.5 - 8.5		SU	Monthly	Grab
1,1-Dichloroethane	NA	5	µg/l	Monthly	Grab
1,2-Dichloroethane	NA	0.6	µg/l	Monthly	Grab
1,1-Dichloroethene	NA	5	µg/l	Monthly	Grab
cis-1,2-Dichloroethene	NA	5	µg/l	Monthly	Grab
trans-1,2-Dichloroethene	NA	5	µg/l	Monthly	Grab
Tetrachloroethene	NA	5	µg/l	Monthly	Grab
1,1,1-Trichloroethane	NA	5	µg/l	Monthly	Grab
Trichloroethene	NA	5	µg/l	Monthly	Grab
Vinyl Chloride	NA	2	µg/l	Monthly	Grab
Mercury	NA	0.25	µg/l	Monthly	Grab
Chloroform	NA	5	µg/l	Monthly	Grab
Trichlorotrifluoroethane (Freon 113)	NA	5	µg/l	Monthly	Grab
1,4 Dioxane	NA	Monitor	µg/l	Monthly	Grab

Additional Conditions:

1. The discharge rate may not exceed the effective or design treatment system capacity. All monitoring data, engineering submissions and modification requests must be submitted to:

Jason Pelton
Division of Environmental Remediation
NYSDEC
625 Broadway
Albany, New York 12233- 7015
518-402-9870

With a copy sent to:

Regional Water Engineer, Region 1
NYSDEC
SUNY @ Stony Brook
50 Circle Road
Stony Brook, NY 11790-3409

2. Only site generated wastewater is authorized for treatment and discharge.
3. Authorization to discharge is valid only for the period noted above but may be renewed if appropriate. A request for renewal must be received 6 months prior to the expiration date to allow for a review of monitoring data and reassessment of monitoring requirements.
4. Both concentration (mg/l or µg/l) and mass loadings (lbs/day) must be reported to the Department for all parameters except flow and pH.
5. Any use of corrosion/scale inhibitors, biocidal-type compounds, or other water treatment chemicals used in the treatment process must be approved by the department prior to use.
6. This discharge and administration of this discharge must comply with the substantive requirements of 6NYCRR Part 750.

JULY 2022



8 August 2022

Mr. Jason Pelton
New York State Department of Environmental Conservation
Division of Solid & Hazardous Materials
625 Broadway
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2
JULY 2022 REPORTING PERIOD**

Dear Mr. Pelton:

KOMAN Government Solutions, LLC (KGS) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2, and the SPDES Permit Equivalent # 13003B.

GWTP operational data from 1 July to 31 July 2022 are presented in Attachment A. The plant was down for approximately 9.5 hours during the reporting period as the result of high air stripper alarms attributable to loss of efficiency in the filter bag system resulting from suspended solids in the plant influent, a local power outage, and low flow alarms from the hydrogen peroxide pump.

As indicated in Attachment A, all SPDES permitted constituents are in compliance with regulatory guidelines during this reporting period.

Please contact me at 610-400-0636 with any questions or concerns you may have regarding this report.

Sincerely,

KOMAN Government Solutions, LLC

A handwritten signature in black ink that reads "Robert G. Gregory".

Robert G. Gregory
Project Manager

Attachment A: Groundwater and Air Sampling Results for July 2022

cc: C. Haas, NYSDEC Region 1
C. Engelhardt, NYSDEC Region 1
J. Pilewski, NYSDEC – Region 1 Water Engineer
K. Granzen, NYSDEC
M. Travis, NYSDEC
J. Sullivan, NYSDOH
G. Ennis, Nassau County Department of Public Works
T. Licata, Town of Oyster Bay
M. Russo, Town of Oyster Bay
S. Sokolowski, NAVFAC Mid-Atlantic
V. Varricchio, NWIRP Bethpage Facilities Management
P. Schauble, KGS
GM-38 Copy

ATTACHMENT A

GROUNDWATER AND AIR SAMPLING RESULTS

JULY 2022

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Report
July 2022

SPDES Parameters			July 2022				
Process Stream	Daily Treated Effluent Maximum ⁽¹⁾	Units	RW-1	RW-3	RW-4	Combined Influent (RW-1 + RW-3 + RW-4)	Treated Effluent
Well Depth	N/A	ft	445	530	675	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	570-670	N/A	N/A
Sampling Date	N/A				7/7/22		
Effective Flowrate	1100	GPM	447	0	409	856	891
Total Flow	N/A	gallons	19,701,770	0	18,024,201	37,725,971	39,261,251
pH	5.5 - 8.5	SU	5.54	NS	6.20	5.86	6.77
Chloroform	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethane	5	µg/L	1.03 J	NS	ND (1.0)	0.54 J	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	0.430 J	NS	2.13 J	1.24 J	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	2.99 J	NS	2.26 J	2.64 J	ND (1.0)
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	13.5	NS	4.29 J	9.1	ND (1.0)
1,1,1-Trichloroethane	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
Trichloroethene	5	µg/L	45.6	NS	684	350.6	0.342 J
1,1,2-Trichlorotrifluoroethane	5	µg/L	ND (1.0)	NS	5.27 J	2.5 J	ND (1.0)
Vinyl Chloride	2	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,4-Dioxane - 8270D	1	µg/L	1.8	NS	12	6.7	0.20
1,4-Dioxane - 8270D SIM IDMS	1	µg/L	2.0	NS	14	7.7	0.23
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Limit of Detection (LOD) given in parentheses.

N/A - Not Applicable

NS - Not Sampled

(1) Wastewater discharge equivalence permit renewed on 18 August 2017. Discharge limits established for 10 years. Chloroform, 1,4-dioxane and 1,1,2-trichlorotrifluoroethane are now monitored under the new permit.

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
July 2022

DAR Parameters			July 2022	
Process Stream	Units	Discharge Goal ⁽¹⁾	Influent	Effluent
Sampling Date			7/7/22	
Average Flowrate	CFM	N/A	NR	8,670
Total Flow	ft ³	N/A	NR	382,092,396
Total Flow	m ³	N/A	NR	10,819,652
1,2-Dichloroethane	µg/m ³	N/A	ND	0.98 J
cis 1,2-Dichloroethene	µg/m ³	≤ 100,000 ⁽²⁾	28	35
trans 1,2-Dichloroethene	µg/m ³		ND	ND
1,2-Dichloroethene (total)	µg/m ³	≤ 100,000	ND	35
Toluene	µg/m ³	N/A	ND	ND
Total Xylene	µg/m ³	N/A	ND	ND
1,1,2-Trichloroethane	µg/m ³	N/A	ND	ND
Trichloroethene	µg/m ³	≤ 2600	5400	5.1
Vinyl Chloride	µg/m ³	≤ 560	ND	ND
Tetrachloroethene	µg/m ³	≤ 5100	140	ND

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Controlled Stack Emissions
July 2022

DAR Parameters	Units	Discharge Goal ⁽¹⁾	July 2022
Sampling Date			7/7/22
Average Flowrate	CFM	N/A	8,670
Total Flow	ft ³	N/A	382,092,396
Total Flow	m ³	N/A	10,819,652
Trichloroethene	lb/hr	≤ 0.09	0.00016
Vinyl Chloride	lb/hr	≤ 0.02	0.00000
1,2 Dichloroethene	lb/hr	≤ 11	0.00112
1,2-Dichloroethane	lb/hr	N/A	0.00003
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	≤ 0.18	0.00000

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

AUGUST 2022



6 September 2022

Mr. Jason Pelton
New York State Department of Environmental Conservation
Division of Solid & Hazardous Materials
625 Broadway
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2
AUGUST 2022 REPORTING PERIOD**

Dear Mr. Pelton:

KOMAN Government Solutions, LLC (KGS) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2, and the SPDES Permit Equivalent # 13003B.

GWTP operational data from 1 August to 31 August 2022 are presented in Attachment A. The plant was down for approximately 9.0 hours during the reporting period as the result of high air stripper alarms attributable to loss of efficiency in the filter bag system resulting from suspended solids in the plant influent and low flow alarms from the advanced oxidation process (AOP) hydrogen peroxide delivery system.

As indicated in Attachment A, all SPDES permitted constituents are in compliance with regulatory guidelines during this reporting period.

Please contact me at 610-400-0636 with any questions or concerns you may have regarding this report.

Sincerely,

KOMAN Government Solutions, LLC

A handwritten signature in black ink that reads "Robert G. Gregory".

Robert G. Gregory
Project Manager

Attachment A: Groundwater and Air Sampling Results for August 2022

cc: C. Haas, NYSDEC Region 1
C. Engelhardt, NYSDEC Region 1
J. Pilewski, NYSDEC – Region 1 Water Engineer
K. Granzen, NYSDEC
M. Travis, NYSDEC
J. Sullivan, NYSDOH
G. Ennis, Nassau County Department of Public Works
T. Licata, Town of Oyster Bay
M. Russo, Town of Oyster Bay
S. Sokolowski, NAVFAC Mid-Atlantic
V. Varricchio, NWIRP Bethpage Facilities Management
P. Schauble, KGS
GM-38 Copy

ATTACHMENT A

GROUNDWATER AND AIR SAMPLING RESULTS

AUGUST 2022

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Report
August 2022

SPDES Parameters			August 2022				
Process Stream	Daily Treated Effluent Maximum ⁽¹⁾	Units	RW-1	RW-3	RW-4	Combined Influent (RW-1 + RW-3 + RW-4)	Treated Effluent
Well Depth	N/A	ft	445	530	675	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	570-670	N/A	N/A
Sampling Date	N/A				8/8/22		
Effective Flowrate	1100	GPM	514	0	504	1,018	1,043
Total Flow	N/A	gallons	22,650,430	0	22,245,899	44,896,329	45,982,249
pH	5.5 - 8.5	SU	5.51	NS	6.07	5.79	6.59
Chloroform	5	µg/L	0.308 J	NS	ND (1.0)	0.16 J	ND (1.0)
1,1-Dichloroethane	5	µg/L	1.13 J	NS	ND (1.0)	0.57 J	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	0.629 J	NS	2.36 J	1.49 J	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	3.24 J	NS	1.86 J	2.56 J	ND (1.0)
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	14.2	NS	4.90 J	9.6	ND (1.0)
1,1,1-Trichloroethane	5	µg/L	0.420 J	NS	ND (1.0)	0.21 J	ND (1.0)
Trichloroethene	5	µg/L	51.2	NS	690	367.7	0.538 J
1,1,2-Trichlorotrifluoroethane	5	µg/L	ND (1.0)	NS	4.84 J	2.4 J	ND (1.0)
Vinyl Chloride	2	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,4-Dioxane - 8270D	1	µg/L	1.6	NS	12	6.8	0.39
1,4-Dioxane - 8270D SIM IDMS	1	µg/L	2.0	NS	14	7.9	0.47
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Limit of Detection (LOD) given in parentheses.

N/A - Not Applicable

NS - Not Sampled

(1) Wastewater discharge equivalence permit renewed on 18 August 2017. Discharge limits established for 10 years. Chloroform, 1,4-dioxane and 1,1,2-trichlorotrifluoroethane are now monitored under the new permit.

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
August 2022

DAR Parameters			August 2022	
Process Stream	Units	Discharge Goal ⁽¹⁾	Influent	Effluent
Sampling Date			8/8/22	
Average Flowrate	CFM	N/A	NR	8,132
Total Flow	ft ³	N/A	NR	358,626,713
Total Flow	m ³	N/A	NR	10,155,178
1,2-Dichloroethane	µg/m ³	N/A	ND	1.8 J
cis 1,2-Dichloroethene	µg/m ³	≤ 100,000 ⁽²⁾	24	26
trans 1,2-Dichloroethene	µg/m ³		ND	ND
1,2-Dichloroethene (total)	µg/m ³	≤ 100,000	ND	26
Toluene	µg/m ³	N/A	ND	ND
Total Xylene	µg/m ³	N/A	ND	ND
1,1,2-Trichloroethane	µg/m ³	N/A	ND	ND
Trichloroethene	µg/m ³	≤ 2600	6800	8.3
Vinyl Chloride	µg/m ³	≤ 560	ND	ND
Tetrachloroethene	µg/m ³	≤ 5100	150	7.4

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Controlled Stack Emissions
August 2022

DAR Parameters	Units	Discharge Goal ⁽¹⁾	August 2022
Sampling Date			8/8/22
Average Flowrate	CFM	N/A	8,132
Total Flow	ft ³	N/A	358,626,713
Total Flow	m ³	N/A	10,155,178
Trichloroethene	lb/hr	≤ 0.09	0.00000
Vinyl Chloride	lb/hr	≤ 0.02	0.00000
1,2 Dichloroethene	lb/hr	≤ 11	0.00081
1,2-Dichloroethane	lb/hr	N/A	0.00005
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	≤ 0.18	0.00000

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

SEPTEMBER 2022



10 October 2022

Mr. Jason Pelton
New York State Department of Environmental Conservation
Division of Solid & Hazardous Materials
625 Broadway
Albany, NY 12233-7252

**Subject: GROUNDWATER DISCHARGE MONITORING/AIR EMISSION REPORT
GM-38 AREA, NWIRP BETHPAGE, NY; DER SITE # 1-30-003B-OU 2
SEPTEMBER 2022 REPORTING PERIOD**

Dear Mr. Pelton:

KOMAN Government Solutions, LLC (KGS) is submitting this monthly monitoring report of the groundwater discharge and air emission results for the Groundwater Treatment Plant (GWTP) located at the Former Naval Weapons Industrial Reserve Plant (NWIRP), Bethpage, NY, GM-38 Area. This report was prepared in accordance with GWTP operational requirements for DER Site # 1-30-003B-OU 2, and the SPDES Permit Equivalent # 13003B.

GWTP operational data from 1 September to 30 September 2022 are presented in Attachment A. The plant was down for approximately 19.2 hours during the reporting period as the result of the backwashing of the GAC units and low flow alarms from the advanced oxidation process (AOP) hydrogen peroxide delivery system.

As indicated in Attachment A, all SPDES permitted constituents are in compliance with regulatory guidelines during this reporting period.

Please contact me at 610-400-0636 with any questions or concerns you may have regarding this report.

Sincerely,

KOMAN Government Solutions, LLC

A handwritten signature in black ink that reads "Robert G. Gregory".

Robert G. Gregory
Project Manager

Attachment A: Groundwater and Air Sampling Results for September 2022

cc: C. Haas, NYSDEC Region 1
C. Engelhardt, NYSDEC Region 1
J. Pilewski, NYSDEC – Region 1 Water Engineer
K. Granzen, NYSDEC
M. Travis, NYSDEC
J. Sullivan, NYSDOH
G. Ennis, Nassau County Department of Public Works
T. Licata, Town of Oyster Bay
M. Russo, Town of Oyster Bay
S. Sokolowski, NAVFAC Mid-Atlantic
V. Varricchio, NWIRP Bethpage Facilities Management
P. Schauble, KGS
GM-38 Copy

ATTACHMENT A

GROUNDWATER AND AIR SAMPLING RESULTS

SEPTEMBER 2022

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Discharge Monitoring Report
September 2022

SPDES Parameters			September 2022				
Process Stream	Daily Treated Effluent Maximum ⁽¹⁾	Units	RW-1	RW-3	RW-4	Combined Influent (RW-1 + RW-3 + RW-4)	Treated Effluent
Well Depth	N/A	ft	445	530	675	N/A	N/A
Screened Interval	N/A	ft bgs	335-395 410-430	392-412 442-504	570-670	N/A	N/A
Sampling Date	N/A				9/14/22		
Effective Flowrate	1100	GPM	470	0	459	929	985
Total Flow	N/A	gallons	19,770,300	0	19,293,000	39,063,300	41,404,800
pH	5.5 - 8.5	SU	5.59	NS	6.28	5.93	6.67
Chloroform	5	µg/L	0.276 J	NS	ND (1.0)	0.14 J	ND (1.0)
1,1-Dichloroethane	5	µg/L	1.07 J	NS	ND (1.0)	0.54 J	ND (1.0)
1,2-Dichloroethane	0.6	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,1-Dichloroethene	5	µg/L	0.647 J	NS	1.60 J	1.12 J	ND (1.0)
cis 1,2-Dichloroethene	5	µg/L	3.35 J	NS	ND (1.0)	1.70 J	ND (1.0)
trans 1,2-Dichloroethene	5	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
Tetrachloroethene	5	µg/L	14.2	NS	6.06 J	10.2	ND (1.0)
1,1,1-Trichloroethane	5	µg/L	0.315 J	NS	ND (1.0)	0.16 J	ND (1.0)
Trichloroethene	5	µg/L	51.2	NS	677	360.3	ND (1.0)
1,1,2-Trichlorotrifluoroethane	5	µg/L	ND (1.0)	NS	4.69 J	2.3 J	ND (1.0)
Vinyl Chloride	2	µg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)
1,4-Dioxane - 8270D	1	µg/L	1.9	NS	13	7.4	0.11 *
1,4-Dioxane - 8270D SIM IDMS	1	µg/L	2.1	NS	14	8.0	0.11 *
Mercury	0.00025	mg/L	ND (0.00010)	NS	ND (0.00010)	ND (0.00010)	ND (0.00010)
Total Suspended Solids (TSS)	N/A	mg/L	ND (1.0)	NS	ND (1.0)	ND (1.0)	ND (1.0)

Notes:

J - Estimated result between laboratory method detection limit and reporting limit

ND - Not detected above laboratory method detection limit. Limit of Detection (LOD) given in parentheses.

N/A - Not Applicable

NS - Not Sampled

* - Indicates the samples were reanalyzed outside of the holdtime.

(1) Wastewater discharge equivalence permit renewed on 18 August 2017. Discharge limits established for 10 years. Chloroform, 1,4-dioxane and 1,1,2-trichlorotrifluoroethane are now monitored under the new permit.

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Air Sampling Results
September 2022

DAR Parameters			September 2022	
Process Stream	Units	Discharge Goal ⁽¹⁾	Influent	Effluent
Sampling Date			9/14/22	
Average Flowrate	CFM	N/A	NR	7,999
Total Flow	ft ³	N/A	NR	336,356,807
Total Flow	m ³	N/A	NR	9,524,564
1,2-Dichloroethane	µg/m ³	N/A	ND	1.6 J
cis 1,2-Dichloroethene	µg/m ³	$\leq 100,000$ ⁽²⁾	28	13
trans 1,2-Dichloroethene	µg/m ³		ND	ND
1,2-Dichloroethene (total)	µg/m ³	$\leq 100,000$	28	13
Toluene	µg/m ³	N/A	ND	ND
Total Xylene	µg/m ³	N/A	ND	ND
1,1,2-Trichloroethane	µg/m ³	N/A	ND	ND
Trichloroethene	µg/m ³	≤ 2600	7000	6.2
Vinyl Chloride	µg/m ³	≤ 560	ND	ND
Tetrachloroethene	µg/m ³	≤ 5100	180	ND

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

J - Estimated result between laboratory method detection limit and reporting limit

N/A - Not Applicable

NR - Not recorded

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

(2) Discharge goal is for total 1,2-Dichloroethene.

GM-38 Area Groundwater Remediation
Groundwater Treatment Plant
Naval Weapons Industrial Reserve Plant - Bethpage, NY
Controlled Stack Emissions
September 2022

DAR Parameters	Units	Discharge Goal ⁽¹⁾	September 2022
Sampling Date			9/14/22
Average Flowrate	CFM	N/A	7,999
Total Flow	ft ³	N/A	336,356,807
Total Flow	m ³	N/A	9,524,564
Trichloroethene	lb/hr	≤ 0.09	0.00018
Vinyl Chloride	lb/hr	≤ 0.02	0.00000
1,2 Dichloroethene	lb/hr	≤ 11	0.00038
1,2-Dichloroethane	lb/hr	N/A	0.00005
Toluene	lb/hr	N/A	0.00000
Total Xylene	lb/hr	N/A	0.00000
1,1,2-Trichloroethane	lb/hr	N/A	0.00000
Tetrachloroethene	lb/hr	≤ 0.18	0.00000

Notes:

CFM - cubic feet per minute

DAR - Division of Air Resources

N/A - Not Applicable

(1) Discharge goal as approved by NYSDEC's letter dated 31 October 2013.

APPENDIX B

**NYSDEC AIR DISCHARGE LIMIT
DOCUMENTATION**

New York State Department of Environmental Conservation

Division of Environmental Remediation
Remedial Action Bureau A, 12th Floor
625 Broadway, Albany, New York 12233-7015
Phone: (518) 402-9620 FAX: (518) 402-9022



Joseph Martens
Commissioner

October 31, 2013

Lora Fly
Remedial Program Manager
NAVFAC Mid-Atlantic
Northeast IPT
9742 Maryland Avenue
Norfolk, VA, 23511-3095

RE: Northrop Grumman, Naval Weapons Industrial Reserve Plant (NWIRP) and Grumman Steel Los Sites, NYSDEC Site No.'s I-30-003 A & B.

Dear Ms. Fly:

Tetra Tech NUS Inc., on behalf of the Department of the Navy NAVFAC Midlantic, has submitted an application to remove the GM 38 Area Groundwater Extraction and Treatment system impregnated Xeolite™ resin from the air discharge treatment system. Currently, the air treatment system uses a combined activated carbon with permanganate impregnated resin treatment train. The New York State Department of Environmental Conservation (NYSDEC) has reviewed the Department of the Navy application and concurs with the findings presented.

The routine monitoring, as detailed in Table 1, clearly indicates that vinyl chloride, one of the main contaminants of concern, has diminished to almost non-detect, and discharge concentrations have dropped to below the limit to require air treatment for the other contaminants as well. However, NAVFAC Midlantic is still proposing activated carbon to reduce the other discharge contaminant levels. Therefore, the NYSDEC hereby approves the proposed changes to the GM 38 Area air treatment. The Xeolite™ resin beds will remain in place should reactivation, based on routine monitoring, be required.

If you have any questions in the interim, please contact me at (518)402-9620.

Sincerely,

Steven M. Scharf, P.E.
Project Engineer
Remedial Action Bureau A
Division of Environmental Remediation

EC: J. Swartwout
S. Scharf
W. Parish, Region 1
S. Karpinski, NYSDOH
E. Hannon, NGC
D. Stern, Arcadis
D. Brayack, TTNUS



TETRA TECH

NOR-01264

November 21, 2011

Mr. Stephen Scharf
New York Department of Environmental Conservation
Division of Environmental Remediation
Bureau of Remedial Action A
625 Broadway, 11th Floor
Albany, New York 12233-7015

Reference: CLEAN Contract No. N62470-08-D-1001
 Contract Task Order WE06

Subject: Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds (VOCs)
 for Air Stripping Tower
 GM-38 Offsite Groundwater Treatment Plant,
 NWIRP Bethpage, New York

Dear Mr. Scharf:

On behalf of the Navy, please find enclosed a copy of the subject document. This document presents an evaluation of current concentrations of off gas VOCs from the GM-38 groundwater treatment plant air-stripping tower (prior to treatment with granular activated carbon). Maximum emission rates were re-evaluated due to decreasing maximum concentrations of target VOCs in un-treated air stripper AS-1 off gas. In addition, breakthrough of target contaminants (e.g., cis-1,2-dichloroethene) is beginning to occur in the granular activated carbon bed. Maximum emission rates were re-evaluated to provide a determination if breakthrough of contaminants would trigger the need for a replacement of the granular activated carbon bed.

Existing Discharge Goals were established in the "Final Operation, Maintenance and Monitoring Plan for Groundwater Treatment Plant GM-38 Area Groundwater Remediation" prepared by Tetra Tech EC (April 2010). Existing goals were based on emission estimates for a 95% reduction (see Attachment A), instead of being based on the original DAR-1 analysis of air stripper off gas. Emission estimates were calculated using the air stripper design flow rate of 8,000 cubic feet per minute (cfm), and previous contaminant discharge rates in pounds per hour (lb/hr). Original emission estimates are provided in Attachment B.

Proposed Revised Discharge Goals were calculated using an average flow rate of 9,200 cfm, January to March 2011 VOC loading rates (taken from the Quarterly Operations Report First Quarter 2011 from ECOR Federal Services), and the Actual Annual % of Annual Guideline Concentrations (AGCs), taken from the revised DAR-1 Model Output. The revised DAR-1 Model Output is provided in Attachment C. Existing Discharge Goals and Proposed Revised Discharge Goals are compared in tabular format in the first page of the attachment. Proposed Revised Discharge Goals for trichloroethene (TCE) are the same as previous. The proposed limit for tetrachloroethene (PCE) is approximately 10 times the previous limit, and vinyl chloride is approximately 2 times the previous limit. Revised Discharge Goals for 1,2-dichloroethene (goals are the same for cis-1,2-dichloroethene) are 100 times greater than previously established limits. It is recommended that these revised limits replace previous discharge goals, and treatment of air stripper off gas by granular activated carbon is recommended to continue for TCE and PCE, with no treatment required for vinyl chloride and 1,2-dichloroethene.

Tetra Tech NUS, Inc.


5700 Lake Wright Drive, Suite 309, Norfolk, VA 23502
Tel 757.461.3768 Fax 757.461.4148 www.ttnus.com

NOR-01264

Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds (VOCs) NWIRP Bethpage
11-21-11 - Page 2

If you have any questions please contact Ms. Lora Fly, NAVFAC Mid-LANT, at (757) 341-2012.

Sincerely,



David D. Brayack, P.E.
Project Manager

Enclosure: (1) Proposed Modification to Discharge Limits for Off Gas Volatile Organic Compounds (VOCs) for Air Stripping Tower
GM-38 Offsite Groundwater Treatment Plant

Distribution:

Mid-Lant, Lora Fly
NYSDEC (Albany), Henry Wilkie
NYSDOH (Troy), Steve Karpinski
NAVAIR, Richard Smith
USEPA, Carol Stein
NGC, Kent Smith
Tetra Tech NUS, Dave Brayack
ECOR Solutions, Al Taormina
Administrative Record
Public Repository
Project File

TABLE 1
COMPARISON OF EXISTING DISCHARGE GOALS WITH ACTUAL EMISSIONS AND PROPOSED DISCHARGE GOALS
AIR STRIPPING TOWER GM-38 OFFSITE GROUNDWATER TREATMENT PLANT
NWIRP BETHPAGE, NEW YORK

Chemical	Existing Discharge Goal		Actual January to March 2011 Values (Pre-Off Gas Treatment)		Proposed Revised Discharge Goals based on DAR-1 Analysis	
	Existing Discharge Loading Rate (pounds (lbs)/hour) ⁽¹⁾	Equivalent Existing Discharge Goals ($\mu\text{g}/\text{m}^3$) ⁽²⁾	Actual Jan-Mar 2011 Concentration ($\mu\text{g}/\text{m}^3$) ⁽³⁾	Actual VOC Loading Pre-Off Gas Treatment (lbs/hour) ⁽⁴⁾	Proposed Discharge Loading Rate (lbs/hour) ⁽⁵⁾	Equivalent Proposed Discharge Goal ($\mu\text{g}/\text{m}^3$) ⁽⁵⁾
TCE	0.09	2,600	10,000	0.345	0.09	2,600
PCE	0.02	580	6,800	0.234	0.18	5,100
Vinyl Chloride	0.01	290	76	0.003	0.02	560
1,2-Dichloroethene (total)	0.03	870	750	0.026	11	greater than 100,000

Notes:

⁽¹⁾Existing Discharge Goals are based on the design flow rate of 8,000 cfm. Existing Discharge Goals were taken from the Final Operations and Maintenance Plan for GM-38 Area Groundwater Remediation from Tetra Tech EC. Existing goals were based on emission estimates for a 95% reduction, and not the previous DAR-1 Analysis. Attachment B (provided at the end of this package) provides the original emission estimates.

⁽²⁾Existing Discharge Goals were calculated using the actual flow rate of 9,200 cfm and the existing discharge loading rate in pounds per hour (lb/hr).

⁽³⁾Values were taken from the Quarterly Operations Report First Quarter 2011 from ECOR Federal Services. Values were the maximum effluent concentration in off gas from air stripper stack AS-1 prior to treatment with vapor phase granular activated carbon (GAC), for the months of January, February and March 2011.

⁽⁴⁾Actual VOC Loading was calculated using an average flow rate of 9,200 cfm and the January-March 2011 concentrations. Existing off gas treatment consists of two stage vapor phase GAC followed by potassium permanganate zeolite media to provide additional treatment for vinyl chloride.

⁽⁵⁾Values were calculated using an average flow rate of 9,200 cfm, and the Actual Annual % of the AGCs from the 2011 DAR-1 Model Output to achieve air quality requirements.

ATTACHMENT A
2008 AIR PERMIT SUBMITTAL

**New York State Department of Environmental Conservation
Air Permit Application**



DEC ID	APPLICATION ID	OFFICE USE ONLY
[REDACTED]	[REDACTED]	[REDACTED]

Section I - Certification

Title V Certification	
I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons directly responsible for gathering the information [required pursuant to 6 NYCRR 201-6.3(d)] I believe the information is, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations.	
Responsible Official	Title
Signature	Date ____ / ____ / ____

State Facility Certification	
I certify that this facility will be operated in conformance with all provisions of existing regulations.	
Responsible Official	Title
Signature	Date ____ / ____ / ____

Section II - Identification Information

Title V Facility Permit N/A	State Facility Permit N/A
<input type="checkbox"/> New <input type="checkbox"/> Significant Modification	<input type="checkbox"/> Administrative Amendment
<input type="checkbox"/> Renewal <input type="checkbox"/> Minor Modification	General Permit Title: _____
<input checked="" type="checkbox"/> Application involves construction of new facility <input type="checkbox"/> Application involves construction of new emission unit(s)	

Owner/Firm				
Name US Navy/NAVFAC Midlant				
Street Address 9742 Maryland Ave, Bldg Z-144				
City Norfolk	State VA	Country US	Zip 23511-3095	
Owner Classification <input checked="" type="checkbox"/> Federal <input type="checkbox"/> Corporation/Partnership	<input type="checkbox"/> State <input type="checkbox"/> Individual	<input type="checkbox"/> Municipal	Taxpayer ID [REDACTED]	
Facility				
<input type="checkbox"/> Confidential				
Name Naval Weapons Industrial Reserve Plant (NWIRP) GM-38 Area				
Location Address Bethpage				
<input type="checkbox"/> City / <input checked="" type="checkbox"/> Town / <input type="checkbox"/> Village Oyster Bay, New York			Zip 11714	
Project Description				
<input type="checkbox"/> Continuation Sheet(s)				
Air stripping of groundwater to remove VOCs				

Owner/Firm Contact Mailing Address				
Name (Last, First, Middle Initial) Fly, Lora			Phone No. (757) 444-0781	
Affiliation Department of the Navy		Title Remedial PM		Fax No. ()
Street Address 9742 Maryland Ave. Bldg Z-144				
City Norfolk	State VA	Country US	Zip 23511-3095	
Facility Contact Mailing Address				
Name (Last, First, Middle Initial) Same			Phone No. ()	
Affiliation		Title		Fax No. ()
Street Address				
City	State	Country	Zip	

**New York State Department of Environmental Conservation
Air Permit Application**



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section III - Facility Information

Classification					
<input type="checkbox"/> Hospital	<input type="checkbox"/> Residential	<input type="checkbox"/> Educational/Institutional	<input type="checkbox"/> Commercial	<input checked="" type="checkbox"/> Industrial	<input type="checkbox"/> Utility

Affected States (Title V Only) N/A				
<input type="checkbox"/> Vermont	<input type="checkbox"/> Massachusetts	<input type="checkbox"/> Rhode Island	<input type="checkbox"/> Pennsylvania	Tribal Land: _____
<input type="checkbox"/> New Hampshire	<input type="checkbox"/> Connecticut	<input type="checkbox"/> New Jersey	<input type="checkbox"/> Ohio	Tribal Land: _____

SIC Codes											
9999											

Facility Description		<input type="checkbox"/> Continuation Sheet(s)
Groundwater Remediation by Air Stripping followed by Vapor-Phase GAC for emission control		

Compliance Statements (Title V Only) N/A	
I certify that as of the date of this application the facility is in compliance with all applicable requirements: <input type="checkbox"/> YES <input type="checkbox"/> NO	
If one or more emission units at the facility are not in compliance with all applicable requirements at the time of signing this application (the 'NO' box must be checked), the noncomplying units must be identified in the "Compliance Plan" block on page 8 of this form along with the compliance plan information required. For all emission units at this facility that are operating <u>in compliance</u> with all applicable requirements complete the following:	
<ul style="list-style-type: none"> <input type="checkbox"/> This facility will continue to be operated and maintained in such a manner as to assure compliance for the duration of the permit, except those units referenced in the compliance plan portion of Section IV of this application. <input type="checkbox"/> For all emission units, subject to any applicable requirements that will become effective during the term of the permit, this facility will meet all such requirements on a timely basis. <input type="checkbox"/> Compliance certification reports will be submitted at least once a year. Each report will certify compliance status with respect to each requirement, and the method used to determine the status. 	

Facility Applicable Federal Requirements N/A										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	
	CERCLA	all substantive	requirements							

Facility State Only Requirements										<input type="checkbox"/> Continuation Sheet(s)
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause	

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section III - Facility Information (continued)

Facility Compliance Certification N/A										<input type="checkbox"/> Continuation Sheet(s)			
Rule Citation													
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause				
<input type="checkbox"/> Applicable Federal Requirement	<input type="checkbox"/> Capping	CAS No.		Contaminant Name									
<input type="checkbox"/> State Only Requirement													
Monitoring Information													
<input type="checkbox"/> Ambient Air Monitoring			<input type="checkbox"/> Work Practice Involving Specific Operations			<input type="checkbox"/> Record Keeping/Maintenance Procedures							
Description													
<hr/> <hr/> <hr/> <hr/> <hr/>													
Work Practice	Process Material								Reference Test Method				
Type	Code	Description											
Parameter													
Code	Description											Manufacturer Name/Model No.	
Limit				Limit Units									
Upper	Lower	Code	Description										
Averaging Method			Monitoring Frequency				Reporting Requirements						
Code	Description		Code	Description		Code	Description						

Facility Emissions Summary				<input type="checkbox"/> Continuation Sheet(s)	
CAS No.	Contaminant Name	PTE		Actual (lbs/yr)	
		(lbs/yr)	Range Code		
NY075 - 00 - 5	PM-10				
NY075 - 00 - 0	PARTICULATES				
7446 - 09 - 5	SULFUR DIOXIDE				
NY210 - 00 - 0	OXIDES OF NITROGEN				
630 - 08 - 0	CARBON MONOXIDE				
7439 - 92 - 1	LEAD				
NY998 - 00 - 0	VOC	117			
NY100 - 00 - 0	HAP	110			
0079 - 01 - 6	Trichloroethylene	99			
00075 - 01 - 4	Vinyl Chloride	3.7			
00540 - 59 - 0	1,2-Dichloroethylene	7.3			
- -					
- -					

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section IV - Emission Unit Information

Emission Unit Description										<input type="checkbox"/> Continuation Sheet(s)		
EMISSION UNIT	0	-	0	0	E	U	1					
Air Stripper AS-1 for groundwater remediation, provided with activated carbon for emission control.												
The emission point is stack 00ST-1. The 2-stage VGAC is followed by a 3rd vessel containing potassium permanganate zeolite media for increased VC capacity.												

Building										<input type="checkbox"/> Continuation Sheet(s)
Building	Building Name					Length (ft)	Width (ft)	Orientation		
BLDG-1	Treatment Plant					75	75	0		

Emission Point										<input type="checkbox"/> Continuation Sheet(s)
EMISSION PT.	00ST1									
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section					
					Length (in)	Width (in)				
90	40	15	36	80						
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal				
19	8020			BLDG-1	50					
EMISSION PT.										
Ground Elev. (ft)	Height (ft)	Height Above Structure (ft)	Inside Diameter (in)	Exit Temp. (°F)	Cross Section					
					Length (in)	Width (in)				
Exit Velocity (FPS)	Exit Flow (ACFM)	NYTM (E) (KM)	NYTM (N) (KM)	Building	Distance to Property Line (ft)	Date of Removal				

Emission Source/Control										<input type="checkbox"/> Continuation Sheet(s)
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.			
ID	Type				Code	Description				
AS-1	I				048	Granular Act. Carbon	Air Stripping Column			
Design Capacity	Design Capacity Units				Waste Feed		Waste Type			
	Code	Description			Code	Description	Code	Description		
Emission Source		Date of Construction	Date of Operation	Date of Removal	Control Type		Manufacturer's Name/Model No.			
ID	Type				Code	Description				
Design Capacity	Design Capacity Units				Waste Feed		Waste Type			
	Code	Description			Code	Description	Code	Description		

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section IV - Emission Unit Information (continued)

Process Information										<input type="checkbox"/> Continuation Sheet(s)			
EMISSION UNIT	0	-	0	0	E	U	1			PROCESS	P	R	1
Description													
<p>The remedial system is air stripping, using a packed column at a groundwater flow rate of 1,100 gpm (plus 100 gpm recycle, for a total of 1,200 gpm). Vapor phase treatment includes the use of 3 vessels, a 2-stage GAC unit, followed by a 3rd vessel containing a potassium permanganate impregnated zeolite for increased VC capacity. Prior to entering the vapor-phase GAC adsorption system, the humidity of the air stripper exhaust is reduced to approximately 50 percent or less to optimize the efficiency of the vapor-phase GAC.</p> <p>Air Stripper AS-1: Existing. Type: Vertical, Cylindrical Construction: Aluminum</p> <p>Packing: 25-foot Jaeger Tripack. Dimensions: 10.0 ft. Dia x 47 ft. H</p>													
Source Classification Code (SCC)	Total Thruput			Thruput Quantity Units									
	Quantity/Hr	Quantity/Yr	Code	Description									
<input type="checkbox"/> Confidential <input checked="" type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions	Operating Schedule			Building	Floor/Location								
	Hrs/Day	Days/Yr											
	24	365	BLDG-1										
Emission Source/Control Identifier(s)													
AS-1													
EMISSION UNIT		-								PROCESS			
Description													
Source Classification Code (SCC)	Total Thruput			Thruput Quantity Units									
	Quantity/Hr	Quantity/Yr	Code	Description									
<input type="checkbox"/> Confidential <input type="checkbox"/> Operating at Maximum Capacity <input type="checkbox"/> Activity with Insignificant Emissions	Operating Schedule			Building	Floor/Location								
	Hrs/Day	Days/Yr											
Emission Source/Control Identifier(s)													

**New York State Department of Environmental Conservation
Air Permit Application**



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section IV - Emission Unit Information (continued)

Emission Unit	Emission Point	Process	Emission Source	Emission Unit Applicable Federal Requirements								<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause
-	-	-	-										
-	-	-	-										
-	-	-	-										
-	-	-	-										

Emission Unit	Emission Point	Process	Emission Source	Emission Unit State Only Requirements								<input type="checkbox"/> Continuation Sheet(s)	
				Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause	Sub Clause
-	-	-	-										
-	-	-	-										
-	-	-	-										
-	-	-	-										

Emission Unit Compliance Certification										<input type="checkbox"/> Continuation Sheet(s)																																																																																																																																															
Rule Citation																																																																																																																																																									
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause																																																																																																																																																
6	NYCRR	212																																																																																																																																																							
<input checked="" type="checkbox"/> Applicable Federal Requirement					<input type="checkbox"/> State Only Requirement			<input type="checkbox"/> Capping																																																																																																																																																	
Emission Unit	Emission Point	Process	Emission Source	CAS No.				Contaminant Name																																																																																																																																																	
0-00EU1	00ST1	PR1	AS-1	00079 - 01 - 6				Trichloroethylene																																																																																																																																																	
Monitoring Information																																																																																																																																																									
<input type="checkbox"/> Continuous Emission Monitoring <input checked="" type="checkbox"/> Intermittent Emission Testing <input type="checkbox"/> Ambient Air Monitoring				<input type="checkbox"/> Monitoring of Process or Control Device Parameters as Surrogate <input type="checkbox"/> Work Practice Involving Specific Operations <input type="checkbox"/> Record Keeping/Maintenance Procedures																																																																																																																																																					
Description																																																																																																																																																									
Monthly grab samples analyzed for VOCs from the vapor phase treatment system influent, effluent and two intermediate locations.																																																																																																																																																									
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td colspan="2">Work Practice</td> <td colspan="4">Process Material</td> <td colspan="6">Reference Test Method</td> </tr> <tr> <td>Type</td> <td>Code</td> <td colspan="4">Description</td> <td colspan="6"></td> </tr> <tr> <td></td> <td></td> <td colspan="4"></td> <td colspan="6"></td> </tr> <tr> <td colspan="2">Parameter</td> <td colspan="4"></td> <td colspan="6"></td> </tr> <tr> <td>Code</td> <td colspan="4">Description</td> <td colspan="6">Manufacturer Name/Model No.</td> </tr> <tr> <td>23</td> <td colspan="4">Concentration</td> <td colspan="6"></td> </tr> <tr> <td colspan="2">Limit</td> <td colspan="4"></td> <td colspan="6">Limit Units</td> </tr> <tr> <td colspan="2">Upper</td> <td colspan="2">Lower</td> <td>Code</td> <td colspan="4"></td> <td colspan="4">Description</td> </tr> <tr> <td colspan="2">3,125</td> <td colspan="2"></td> <td>255</td> <td colspan="4"></td> <td colspan="4">micrograms per cubic meter</td> </tr> <tr> <td colspan="2">Averaging Method</td> <td colspan="4">Monitoring Frequency</td> <td colspan="6">Reporting Requirements</td> </tr> <tr> <td>Code</td> <td colspan="2">Description</td> <td>Code</td> <td colspan="2">Description</td> <td>Code</td> <td colspan="4">Description</td> </tr> <tr> <td>01</td> <td colspan="2">Instantaneous</td> <td>05</td> <td colspan="2">Monthly</td> <td>10</td> <td colspan="4">Upon Request</td> </tr> </table>												Work Practice		Process Material				Reference Test Method						Type	Code	Description																						Parameter												Code	Description				Manufacturer Name/Model No.						23	Concentration										Limit						Limit Units						Upper		Lower		Code					Description				3,125				255					micrograms per cubic meter				Averaging Method		Monitoring Frequency				Reporting Requirements						Code	Description		Code	Description		Code	Description				01	Instantaneous		05	Monthly		10	Upon Request			
Work Practice		Process Material				Reference Test Method																																																																																																																																																			
Type	Code	Description																																																																																																																																																							
Parameter																																																																																																																																																									
Code	Description				Manufacturer Name/Model No.																																																																																																																																																				
23	Concentration																																																																																																																																																								
Limit						Limit Units																																																																																																																																																			
Upper		Lower		Code					Description																																																																																																																																																
3,125				255					micrograms per cubic meter																																																																																																																																																
Averaging Method		Monitoring Frequency				Reporting Requirements																																																																																																																																																			
Code	Description		Code	Description		Code	Description																																																																																																																																																		
01	Instantaneous		05	Monthly		10	Upon Request																																																																																																																																																		

New York State Department of Environmental Conservation
Air Permit Application



DEC ID					
-	-	-	-	-	-

Section IV - Emission Unit Information (continued)

Determination of Non-Applicability (Title V Only)						N/A	<input type="checkbox"/> Continuation Sheet(s)				
Rule Citation											
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause		
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement					
Description											
Rule Citation											
Title	Type	Part	Sub Part	Section	Sub Division	Paragraph	Sub Paragraph	Clause	Sub Clause		
Emission Unit	Emission Point	Process	Emission Source			<input type="checkbox"/> Applicable Federal Requirement <input type="checkbox"/> State Only Requirement					
Description											
Process Emissions Summary											
								<input type="checkbox"/> Continuation Sheet(s)			
EMISSION UNIT	0 - 0 0 E U 1							PROCESS	P	R	1
CAS No.	Contaminant Name				% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
0079 - 01 - 6	Trichloroethylene						95	1.87	02		
(lbs/hr)	(lbs/yr)	(standard units)		Standard Units	PTE How Determined	Actual					
0.09	99						02				
EMISSION UNIT	0 - 0 0 E U 1							PROCESS	P	R	1
CAS No.	Contaminant Name				% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
00075 - 01 - 4	Vinyl Chloride						95	0.17	03		
(lbs/hr)	(lbs/yr)	(standard units)		Standard Units	PTE How Determined	Actual					
0.01	3.7						02				
EMISSION UNIT	0 - 0 0 E U 1							PROCESS	P	R	1
CAS No.	Contaminant Name				% Thruput	% Capture	% Control	ERP (lbs/hr)	ERP How Determined		
000540 - 59 - 0	1,2-Dichloroethylene						95	0.6	02		
(lbs/hr)	(lbs/yr)	(standard units)		Standard Units	PTE How Determined	Actual					
0.03	7.3						02				

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section IV - Emission Unit Information (continued)

EMISSION UNIT		Emission Unit Emissions Summary				<input type="checkbox"/> Continuation Sheet(s)			
0	-00EU1								
CAS No.		Contaminant Name							
00107- 06 - 2	1,2-Dichloroethane								
ERP (lbs/yr)	PTE Emissions	Actual							
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)					
13.4	Below Reporting Threshold BRT								
CAS No.		Contaminant Name							
00108 - 88 - 3	Toluene								
ERP (lbs/yr)	PTE Emissions	Actual							
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)					
72.7	BRT	BRT							
CAS No.		Contaminant Name							
01330- 20 - 7	Xylene								
ERP (lbs/yr)	PTE Emissions	Actual							
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)					
77.1	BRT	BRT							
CAS No.		Contaminant Name							
- -	1,1,2-Trichloroethane								
ERP (lbs/yr)	PTE Emissions	Actual							
	(lbs/hr)	(lbs/yr)	(lbs/hr)	(lbs/yr)					
	BRT	BRT							

Compliance Plan										<input type="checkbox"/> Continuation Sheet(s)			
For any emission units which are not in compliance at the time of permit application, the applicant shall complete the following													
Consent Order			Certified progress reports are to be submitted every 6 months beginning / /										
Emission Unit	Process	Emission Source	Applicable Federal Requirement										
			Title	Type	Part	Sub Part	Section	Sub Division	Parag.	Sub Parag.	Clause		
											Sub Clause		
Remedial Measure / Intermediate Milestones										R/I	Date Scheduled		

New York State Department of Environmental Conservation
Air Permit Application



DEC ID									
-	-	-	-	-	-	-	-	-	-

Section IV - Emission Unit Information (continued)

Request for Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT											
Emission Reduction Description											
Contaminant Emission Reduction Data											
Baseline Period / / to / /										Reduction	
										Date	Method
										/	/
CAS No.		Contaminant Name								ERC (lbs/yr)	
										Netting	Offset
Facility to Use Future Reduction											
Name										APPLICATION ID	
										/	/
Location Address											
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village					State		Zip				

Use of Emission Reduction Credits										<input type="checkbox"/> Continuation Sheet(s)	
EMISSION UNIT											
Proposed Project Description											
Contaminant Emissions Increase Data											
CAS No.		Contaminant Name								PEP (lbs/yr)	
Statement of Compliance											
<input type="checkbox"/> All facilities under the ownership of this "ownership/firm" are operating in compliance with all applicable requirements and state regulations including any compliance certification requirements under Section 114(a)(3) of the Clean Air Act Amendments of 1990, or are meeting the schedule of a consent order.											
Source of Emission Reduction Credit - Facility											
Name										PERMIT ID	
										/	/
Location Address											
<input type="checkbox"/> City / <input type="checkbox"/> Town / <input type="checkbox"/> Village					State		Zip				
Emission Unit		CAS No.		Contaminant Name				ERC (lbs/yr)			
								Netting	Offset		

**New York State Department of Environmental Conservation
Air Permit Application**



DEC ID									
-	-	-	-	-	-	-	-	-	-

Supporting Documentation

- P.E. Certification (form attached)
- List of Exempt Activities (form attached)
- Plot Plan
- Methods Used to Determine Compliance (form attached)
- Calculations
- Air Quality Model (____ / ____ / ____)
- Confidentiality Justification
- Ambient Air Monitoring Plan (____ / ____ / ____)
- Stack Test Protocols/Reports (____ / ____ / ____)
- Continuous Emissions Monitoring Plans/QA/QC (____ / ____ / ____)
- MACT Demonstration (____ / ____ / ____)
- Operational Flexibility: Description of Alternative Operating Scenarios and Protocols
- Title IV: Application/Registration
- ERC Quantification (form attached)
- Use of ERC(s) (form attached)
- Baseline Period Demonstration
- Analysis of Contemporaneous Emission Increase/Decrease
- LAER Demonstration (____ / ____ / ____)
- BACT Demonstration (____ / ____ / ____)
- Other Document(s): _____ (____ / ____ / ____)

_____ (____ / ____ / ____)

ATTACHMENT B
2008 EMISSION ESTIMATES BASED ON 95% REMOVAL

ATTACHMENT 1
Emission Estimate

Feed Water Flow 1,100 gpm: max or normal
250 m³/hr

Water Flow Including Recycle 1,200 gpm: max or normal
273 m³/hr

Air Flow 8,000 cfm
13,592 m³/hr

A/W vol ratio 50

EXAMPLE EMISSION CALC: Vinyl Chloride

4.8 ug/L x 1000 L/m³ x 250 m³ water/13,623 m³ air = 88 ug/m³

**POTENTIAL EMISSION ESTIMATES,
USED TO DEVELOP 95% REDUCTION
OF EMISSION VALUES AS BASED ON
INFLUENT GROUNDWATER CONCENTRATIONS
(95% REDUCTION OF EMISSION
VALUES ARE PROVIDED
ON PAGE 7 OF THE 2008 AIR
PERMIT APPLICATION PROCESS
EMISSIONS SUMMARY)**

Name	CAS Number	Toxicity: H/M/L ²	VOC ³	HAP ⁴	GW Conc. ¹		Effluent Conc ¹		Uncontrolled Stripper Exhaust							
					Max ug/L	Avg ug/L	Max ug/L	Avg ug/L	Max lb/day	Avg lb/day	Max lb/hr	Avg lb/hr	Max gm/sec	Avg gm/sec	Max ug/m ³	Avg ug/m ³
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	3	3.0			0.04	0.04	0.00	0.00	2.08E-04	2.08E-04	55	55
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	3.5	0.3			0.05	0.00	0.00	0.00	2.43E-04	2.08E-05	64	6
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	4	0.7			0.05	0.01	0.00	0.00	2.77E-04	4.85E-05	74	13
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	3	1.0	0.3	0.1	0.04	0.01	0.00	0.00	1.87E-04	6.24E-05	55	18
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	9	1.6			0.12	0.02	0.00	0.00	6.24E-04	1.11E-04	165	29
1,2-Dichloroethylene	00540-59-0	M	Yes	No	1,100	31.5	1.3	0.0	14.51	0.42	0.60	0.02	7.62E-02	2.18E-03	20,219	579
Benzene	00071-43-2	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	4	0.1			0.05	0.00	0.00	0.00	2.77E-04	6.94E-06	74	2
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	1	0.1			0.01	0.00	0.00	0.00	6.94E-05	6.94E-06	18	2
Chloroform	00067-66-3	M	Yes	Yes	2	0.8			0.03	0.01	0.00	0.00	1.39E-04	5.55E-05	37	15
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	2	0.1			0.03	0.00	0.00	0.00	1.39E-04	6.94E-06	37	2
Tetrachloroethylene	00127-18-4	M	Yes	Yes	900	33.8	0.9	0.0	11.88	0.45	0.49	0.02	6.24E-02	2.34E-03	16,543	621
Toluene	00108-88-3	L	Yes	Yes	15	0.7			0.20	0.01	0.01	0.00	1.04E-03	4.85E-05	276	13
Trichloroethylene	00079-01-6	M	Yes	Yes	3,400	411.5	4.5	0.5	44.86	5.43	1.87	0.23	2.35E-01	2.85E-02	62,494	7,564
Vinyl chloride	00075-01-4	H	Yes	Yes	300	4.8	0.0	0.0	3.96	0.06	0.17	0.00	2.08E-02	3.33E-04	5,514	88
Xylenes	01330-20-7	M	Yes	Yes	16	0.2			0.21	0.00	0.01	0.00	1.11E-03	1.39E-05	294	4
Total VOCs					5,764	487.3	7.0	0.6	76.05	6.43	3.17	0.27				
Total HAPs					4,667	458.8	5.7	0.6	61.57	6.05	2.57	0.25				

Total Uncontrolled VOC 2,347 lb/yr

Total Uncontrolled HAP 2,209 lb/yr

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003

2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Toxics Section, September 10, 2007.

3. Source: 6 NYCRR Part 200 1(cg)

4. Source: 6 NYCRR Part 200.1(ag)

ATTACHMENT 1
Emission Estimate

Feed Water Flow 1,100 gpm: max or normal
250 m³/hr

Water Flow Including Recycle 1,200 gpm: max or normal
273 m³/hr

Air Flow 8,000 cfm
13,592 m³/hr

A/W vol ratio 50

Name	CAS Number	Toxicity: H/M/L ²	VOC ³	HAP ⁴	Controlled Stripper Exhaust				
					GAC	Max lb/day	Avg lb/day	Max gm/sec	Avg gm/sec
1,1,1-Trichloroethane (Methyl Chloroform)	00071-55-6	L	No	Yes	95%	0.00	0.00	1.04E-05	1.04E-05
1,1,2-Trichloroethane	00079-00-5	M	Yes	Yes	95%	0.00	0.00	1.21E-05	1.04E-06
1,1-Dichloroethane	00075-34-3	L	Yes	Yes	95%	0.00	0.00	1.39E-05	2.43E-06
1,2-Dichloroethane	00107-06-2	M	Yes	Yes	95%	0.00	0.00	9.36E-06	3.12E-06
1,1-Dichloroethylene (Vinylidene Chloride)	00075-35-4	M	Yes	Yes	95%	0.01	0.00	3.12E-05	5.55E-06
1,2-Dichloroethylene	00540-59-0	M	Yes	No	95%	0.73	0.02	3.81E-03	1.09E-04
Benzene	00071-43-2	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Carbon Tetrachloride	00056-23-5	H	Yes	Yes	95%	0.00	0.00	1.39E-05	3.47E-07
Chlorobenzene (Monochlorobenzene)	00108-90-7	M	Yes	Yes	95%	0.00	0.00	3.47E-06	3.47E-07
Chloroform	00067-66-3	M	Yes	Yes	95%	0.00	0.00	6.94E-06	2.77E-06
Methyl Tert Butyl Ether	01634-04-4	M	Yes	Yes	95%	0.00	0.00	6.94E-06	3.47E-07
Tetrachloroethylene	00127-18-4	M	Yes	Yes	95%	0.59	0.02	3.12E-03	1.17E-04
Toluene	00108-88-3	L	Yes	Yes	95%	0.01	0.00	5.20E-05	2.43E-06
Trichloroethylene	00079-01-6	M	Yes	Yes	95%	2.24	0.27	1.18E-02	1.43E-03
Vinyl chloride	00075-01-4	H	Yes	Yes	95%	0.20	0.00	1.04E-03	1.66E-05
Xylenes	01330-20-7	M	Yes	Yes	95%	0.01	0.00	5.55E-05	6.94E-07
Total VOCs					3.80	0.32			
Total HAPs					3.08	0.30			
					Total Controlled VOC	117 lb/yr			
					Total Controlled HAP	110 lb/yr			

1. Source: "GM-38 Groundwater Remedy Analysis Report", February 2003
2. Source: DAR-1 AGC/SGC Tables, NYSDEC Division of Air Resources, Air Tox
3. Source: 6 NYCRR Part 200.1(cg)
4. Source: 6 NYCRR Part 200.1(ag)

ATTACHMENT C
2011 DISCHARGE GOALS AND 2011 DAR-1 ANALYSIS

Tetra Tech NUS**STANDARD CALCULATION SHEET**

CLIENT: US CLEAN	FILE No:	BY: SK	PAGE: 1 of 1
SUBJECT: Calculation of Current Discharge Goals GM-38 Area NWIRP Bethpage, New York	CHECKED BY:		DATE: 9/7/2011

1. Purpose:

To calculate current discharge goals for Trichloroethene (TCE), Tetrachloroethene (PCE), Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total), for treatment of off-gas from the air stripper stack AS-1.

2. Approach:

From the Contaminant Assessment Summary of the DAR-1 Model output for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total) (see DAR-1 output for analysis inputs), use the Actual Annual % of the Annual Guideline Concentration (AGC), a current average flow rate of 9,200 cubic feet per minute (cfm), and influent chemical emission rates in pounds per hour (lb/hour) and pounds per year (lb/year) to back calculate current discharge goals.

3. Calculation of Current Discharge Goals:

Chemical	Current Actual Annual % of AGC ⁽¹⁾	Current Maximum Concentration ($\mu\text{g}/\text{m}^3$) ⁽²⁾	Current Chemical Emission Rate Prior to Treatment (lb/hour) ⁽³⁾	Current Chemical Emission Rate Prior to Treatment (lb/year) ⁽³⁾	Calculated Discharge Goal (lb/hr) ⁽⁴⁾	Calculated Discharge Goal (lb/year) ⁽⁴⁾	Maximum Allowable Concentration ($\mu\text{g}/\text{m}^3$) ⁽⁴⁾
TCE	390.6	10,000	0.3446	3,019	0.0882	770	2,600
PCE	132.8	6,800	0.2344	2,053	0.1764	1,500	5,100
Vinyl Chloride	13.49	76	0.0026	22.94	0.0194	170	560
cis 1,2-Dichloroethene	0.2322	750	0.0258	226.4	11.13	98,000	320,000
1,2-Dichloroethene (total)	0.2322	750	0.0258	226.4	11.13	98,000	320,000

Notes:

⁽¹⁾Actual Annual % of the AGCs is from the attached DAR-1 Model Output.

⁽²⁾Values were taken from the Quarterly Operations Report First Quarter 2011 (June 2011) from ECOR Federal Services. Values were the maximum effluent concentration in off gas from air stripper stack AS-1 for the months of January, February, and March 2011.

⁽³⁾Chemical Emission Rates were calculated from maximum concentrations and an average flow rate of 9,200 cfm.

⁽⁴⁾Discharge Goals are based on a flow of 9,200 cfm, and calculated from the Actual Annual % of the AGCs from the DAR-1 Model Output to achieve air quality requirements. The summary of additional inputs for this model run is provided in the DAR-1 Model Output. Stack height is 40 feet, and the property line was evaluated at a distance of 50 feet.

BETHPAGE SITE GM-38 OFF-SITE GROUNDWATER AIR STRIPPER STACK EMISSIONS
 DAR-1 MODEL OUTPUT, POINT SOURCE (STACK EMISSIONS) TYPE
 INCLUDES ISCLT MODELING SUMMARY

- I. Summary of Inputs for Model Run to Nearest Property Line (50 feet), worst case scenario (highest contaminant concentrations seen in first quarter 2011 in untreated effluent from Air Stripper AS-1 prior to treatment with granular activated carbon (GAC))

Chemical	CAS No. 00079-01-6 (TCE)	CAS No. 00127-18-4 (PCE)	CAS No. 00075-01-4 (Vinyl Chloride)	CAS No. 00156-59-2 (cis 1,2-Dichloroethene)	CAS No. 00540-59-0 (1,2-Dichloroethene, total)
Emission Rate Prior to Treatment ⁽¹⁾ (lb/hour)	0.3444	0.2342	0.0026	0.0258	0.0258
Emission Rate Prior to Treatment ⁽¹⁾ (lb/year)	3,017	2,052	22.93	226.0	226.0
Maximum Concentration of Untreated Off Gas ($\mu\text{g}/\text{m}^3$) ⁽¹⁾	10,000	6,800	76	750	750
Annual Guideline Concentration (AGC) ($\mu\text{g}/\text{m}^3$)	0.5	1.0	0.11	63	63
Short-term Guideline Concentration (SGC) ($\mu\text{g}/\text{m}^3$)	14,000	1,000	180,000	--	--

HA	Height Above stack/ maximum height of plume (HA, feet)	15
SH	Stack Height/Treatment Building Air Stack (SH, feet)	40
D	Stack Diameter (D, inches)	36
T	Stack Exit Temperature (T, degrees Fahrenheit)	80
V	Stack Exit Velocity (V, ft/sec)	21.69
Q ⁽²⁾	Stack Exit Flow Rate [Q, Actual Cubic Feet per Minute (ACFM)]	9,200
Dpl	Shortest Distance from Source Building (Treatment Building) to Property Line (Dpl, feet) for point sources	50
BW	Building Width (BW, feet) of Source Building (Treatment Building) for point sources	75
BL	Building Length (BL, feet) of Source Building (Treatment Building)	75
Q	Actual Hourly Emission Rate (lbs/hour) for source contaminant	Chemical specific, see above
Qa	Actual Annual Emission Rate (lbs/year) for source contaminant	Chemical specific, see above

⁽¹⁾ Emission rates and maximum concentration values were taken from the Quarterly Operations Report First Quarter (June 2011) as provided by ECOR Services, using January, February, and March 2011 maximum rates of untreated off gas from Air Stripper AS-1 in the

GM-38 Treatment Building. Emission rates are based on continuous operation 24 hours per day, 7 days a week, 52 weeks a year, or approximately 8,760 hours of operation.

⁽²⁾"Q" is an average value of January and February 2011 monthly flow rates. Effective water and vapor flow rates were reduced during the reporting period of March due to a shutdown of the Treatment Plant on March 23, 2011.

II. Contaminant Assessment Summary of TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CAS NUMBER	CONTAMINANT ASSESSMENT SUMMARY OF DOR-1 ANALYSIS					9/ 8/11
	SHORT-TERM		CAVITY		POINT or AREA SOURCE	Page 1
	AGC ug/m ³	MAXIMUM (Gav,Pt,Area) ug/m ³	ACTUAL ANNUAL ug/m ³	POTENTIAL ANNUAL ug/m ³	ACTUAL ANNUAL ug/m ³	
00075-01-4	0.11000000	0.0005	0.0000	13.3889	13.4948	
00079-01-6	0.50000000	0.7757	0.0000	390.1734	398.6266	
00127-18-4	1.00000000	7.3852	0.0000	132.6635	132.8415	
00156-59-2	63.00000000	0.0000	0.0000	0.2320	0.2322	
00540-59-0	63.00000000	0.0000	0.0000	0.2320	0.2322	
SUMMARY TOTALS		8.1614	0.0000	536.6897	537.4274	

III. Contaminant Impact Summary of TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CAS NUMBER	CONTAMINANT IMPACT SUMMARY OF DOR-1 ANALYSIS					9/ 8/11
	SHORT-TERM		CAVITY		POINT or AREA SOURCE	Page 1
	AGC ug/m ³	MAXIMUM (Gav,Pt,Area) ug/m ³	ACTUAL ANNUAL ug/m ³	POTENTIAL ANNUAL ug/m ³	ACTUAL ANNUAL ug/m ³	
00075-01-4	0.11000000	0.81988204	0.00000000	0.01472780	0.01484433	
00079-01-6	0.50000000	108.60282900	0.00000000	1.95086694	1.95313276	
00127-18-4	1.00000000	73.85244750	0.00000000	1.32663476	1.32841584	
00156-59-2	63.00000000	8.13575172	0.00000000	0.14614509	0.14630693	
00540-59-0	63.00000000	8.13575172	0.00000000	0.14614509	0.14630693	

IV. Contaminant Impact Summary Step by Step Menu for TCE:

```
*****  
NWIRP BETHPAGE GM-38 AREA          BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00079-01-6      SIC =    0  
AGC =           0.500000000 ug/m3      SGC =       14000.000000 ug/m3  
STACK: HA=     15., SH=   40., D=   36., T=   80., U=   21.69, Q=   9200.00  
BUILDING: Dpl=    50., BW=   75., BL=   75., %CONTROL=   0.0000  
** Reported Hourly Emission Rate (Q) is equal to      0.344400000 lbs/hour.  
** Reported Annual Emission Rate (Qa) is equal to      3017.000000 lbs/year.  
II.B. Refined CAVITY IMPACT METHOD (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line (< 50. feet >) is less than or equal to the cavity length, or 3 building heights (< 75. feet >). Therefore, this building will have cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension (< 75. feet >) is greater than or equal to the building height (< 25. feet >). Therefore, the computer will NOT redefine the cavity length.  
II.B.3. Stack height (< 40. feet >) is greater than cavity height (< 38. feet >). Therefore, this source does not contribute to the buildings cavity impact. The Computer will assume the CAVITY Annual Impact equals 0.00 ug/m3.  
II.C. CAVITY Annual Impact (< 0.000 ug/m3 >) is less than AGC (< 0.500 ug/m3 >).  
III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).  
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).  
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.  
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal to 2.604 ug/m3 for 8760. hours/year of operation.  
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal to 2.601 ug/m3 assuming 8,760 hours/year of operation.  
III.A.4.a. Stack height to building height ratio is greater than 1.5, but less than 2.5. Computer will multiply actual annual & potential annual impacts by 0.75 factor.
```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact (< 1.953 ug/m³ >) is greater than AGC (< 0.500 ug/m³ >).

**** Refer to DAR-1 Section III.D.1. A refined site specific modeling analysis may be required.

III.D. STANDARD POINT SOURCE Potential Annual Impact (< 1.951 ug/m³ >) is greater than AGC (< 0.500 ug/m³ >).

**** Potential Annual Impact is based upon 8760 hours/year **** operation instead of reported 8760. hours/year.

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.
See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m³ as the plume escaped the cavity region: hs(< 40. feet) > hc(< 26. feet).

III.C. CAVITY Short-Term Impact (< 0.000 ug/m³ >) is less than SGC (< 14000.000 ug/m³ >).

2.3 Momentum flux, F_m, is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height, h_e, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 38.826 ug/m³, for: hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 129.908 ug/m³, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 108.603 ug/m³, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST: 108.603 ug/m³) is less than the SGC (< 14000.000 ug/m³ >) for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, <Cav,Pt,Area>) equals 108.603 ug/m³ and is reported in the ANALYSIS MENU. This value is less than the SGC (< 14000.000 ug/m³ >).

V. Contaminant Impact Summary Step by Step Menu for PCE:

```
*****  
NWIRP BETHPAGE GM-38 AREA      BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00127-18-4      SIC =    0  
AGC =           1.000000000 ug/m3      SGC =       1000.000000 ug/m3  
STACK: HA=     15., SH=    40., D=    36., T=    80., U=   21.69, q=  9200.00  
BUILDING: Dpl=    50., BW=    75., BL=    75., zCONTROL=  0.0000  
** Reported Hourly Emission Rate (Q) is equal to      0.234200000 lbs/hour.  
** Reported Annual Emission Rate (Qa) is equal to      2052.000000 lbs/year.  
II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line (< 50. feet )  
is less than or equal to the cavity length, or 3 building  
heights (< 75. feet ). Therefore, this building will have  
cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension (< 75. feet ) is greater than or  
equal to the building height (< 25. feet ). Therefore, the  
computer will NOT redefine the cavity length.
```

```
II.B.3. Stack height (< 40. feet ) is greater than cavity height  
< 38. feet ). Therefore, this source does not contribute to  
the buildings cavity impact. The Computer will assume the  
CAVITY Annual Impact equals 0.00 ug/m3.
```

```
II.C. CAVITY Annual Impact (< 0.000 ug/m3 ) is less than AGC  
< 1.000 ug/m3 ).
```

III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).

```
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft<4>/sec<2>.
```

```
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.
```

```
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal  
to 1.771 ug/m3 for 8762. hours/year of operation.
```

```
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal  
to 1.769 ug/m3 assuming 8,760 hours/year of operation.
```

```
III.A.4.a. Stack height to building height ratio is greater than  
1.5, but less than 2.5. Computer will multiply actual  
annual & potential annual impacts by 0.75 factor.
```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.B. STANDARD POINT SOURCE Actual Annual Impact (< 1.328 ug/m³ > is greater than AGC (< 1.000 ug/m³ >).

**** Refer to DAR-1 Section III.B.1. A refined site specific modeling analysis may be required. ****

III.D. STANDARD POINT SOURCE Potential Annual Impact (< 1.327 ug/m³ > is greater than AGC (< 1.000 ug/m³ >).

**** Potential Annual Impact is based upon 8760 hours/year **** operation instead of reported 8762. hours/year. ****

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.
See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m³ as the plume escaped the cavity region: hs(< 40. feet) > hc(< 26. feet).

II.C. CAVITY Short-Term Impact (< 0.000 ug/m³ > is less than SGC (< 1000.000 ug/m³ >).

2.3 Momentum Flux, F_m, is equal to 1000.331 ft<4>/sec<2>.

2.3 Effective stack height, h_e, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 26.483 ug/m³. For hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 88.340 ug/m³. for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 73.852 ug/m³, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST: 73.852 ug/m³ > is less than the SGC (< 1000.000 ug/m³ > for the point source.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, (Cav,Pt,Area)) equals 73.852 ug/m³ and is reported in the ANALYSIS MENU. This value is less than the SGC (< 1000.000 ug/m³ >.

VI. Contaminant Impact Summary Step by Step Menu for Vinyl Chloride:

```
*****  
NWIRP BETHPAGE GM-38 AREA      BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00075-01-4      SIC =    0  
AGC =           0.110000000 ug/m3      SGC =       180000.000000 ug/m3  
STACK: HA=   15., SH=   40., D=   36., T=   80., U=   21.69, Q=   9200.00  
BUILDING: Dpl=   50., BW=   75., BL=   75., zCONTROL=   0.0000  
** Reported Hourly Emission Rate (Q) is equal to       0.002600000 lbs/hour.  
** Reported Annual Emission Rate (Qa) is equal to       22.9300000 lbs/year.
```

II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).

- II.B.1. Shortest Distance from building to Property Line < 50. feet > is less than or equal to the cavity length, or 3 building heights < 75. feet >. Therefore, this building will have cavity impacts (if they occur) at receptors off plant property.
- II.B.2. The largest building dimension < 75. feet > is greater than or equal to the building height < 25. feet >. Therefore, the computer will NOT redefine the cavity length.

II.B.3. Stack height < 40. feet > is greater than cavity height < 38. feet >. Therefore, this source does not contribute to the buildings cavity impact. The Computer will assume the CAVITY Annual Impact equals 0.00 ug/m3.

II.C. CAVITY Annual Impact < 0.000 ug/m3 > is less than AGC (< 0.110 ug/m3 >).

III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).

III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).

III.A.1.b. Effective stack height, he, is equal to 51.001 feet.

III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal to 0.020 ug/m3 for 8819. hours/year of operation.

III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal to 0.020 ug/m3 assuming 8,760 hours/year of operation.

III.A.4.a. Stack height to building height ratio is greater than 1.5, but less than 2.5. Computer will multiply actual annual & potential annual impacts by 0.75 factor.

III.A.5.	STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.
III.D.	STANDARD POINT SOURCE Actual Annual Impact < 0.015 ug/m ³ > is less than AGC < 0.110 ug/m ³ >.
III.D.	STANDARD POINT SOURCE Potential Annual Impact < 0.015 ug/m ³ > is less than AGC < 0.110 ug/m ³ >. ***** Potential Annual Impact is based upon 8760 hours/year ***** ***** operation instead of reported 8819. hours/year. *****
2.0	DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD. See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.
2.2	CAVITY Short-Term Impact is equal to 0.00 ug/m ³ as the plume escaped the cavity region: hs< 40. feet > hc< 26. feet>.
II.C.	CAVITY Short-Term Impact < 0.000 ug/m ³ > is less than SGC < 180000.000 ug/m ³ >.
2.3	Momentum flux, F _m , is equal to 1000.331 ft<4>/sec<2>.
2.3	Effective stack height, h _e , is equal to 51.001 feet.
2.4	Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 0.293 ug/m ³ , for hs/h _b = 1.60
2.5	Maximum downwash Short-Term Impact (CSTD) is equal to 0.981 ug/m ³ , for: hs/h _b = 1.60 and ESH = 51. feet.
2.6	Adjusted maximum downwash Short-Term (CSTD) is equal to 0.820 ug/m ³ , for: RF = 0.84
III.D.	Maximum non-cavity Short-Term Impact (CST: 0.820 ug/m ³ > is less than the SGC < 180000.000 ug/m ³ > for the point source.
2.7	Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, <Cav,Pt,Area>) equals 0.820 ug/m ³ and is reported in the ANALYSIS MENU. This value is less than the SGC < 180000.000 ug/m ³ >.

VII. Contaminant Impact Summary Step by Step Menu for cis 1,2-Dichloroethene:

```
*****  
NWIRP BETHPAGE GM-38 AREA      BETHPAGE          OYSTER BAY, NEW  
EMISSION POINT =           TOTAL      CAS NUMBER = 00156-59-2      SIC =    0  
AGC =           63.000000000 ug/m3      SGC =       0.000000 ug/m3  
STACK: HA=   15., SH=   40., D=   36., T=   80., U=   21.69, q=   9200.00  
BUILDING: Dpl=   50., BW=   75., BL=   75., zCONTROL=   0.0000  
** Reported Hourly Emission Rate <Q> is equal to      0.025800000 lbs/hour.  
** Reported Annual Emission Rate <Qa> is equal to      226.000000 lbs/year.  
II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line (< 50. feet >  
is less than or equal to the cavity length, or 3 building  
heights (< 75. feet >). Therefore, this building will have  
cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension (< 75. feet >) is greater than or  
equal to the building height (< 25. feet >). Therefore, the  
computer will NOT redefine the cavity length.
```

II.B.3. Stack height (< 40. feet >) is greater than cavity height
< 38. feet >. Therefore, this source does not contribute to
the buildings cavity impact. The Computer will assume the
CAVITY Annual Impact equals 0.00 ug/m3.

II.C. CAVITY Annual Impact (< 0.000 ug/m3 >) is less than AGC
(< 63.000 ug/m3 >).

III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).

III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).

III.A.1.b. Effective stack height, he, is equal to 51.001 feet.

III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal
to 0.195 ug/m3 for 8760. hours/year of operation.

III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal
to 0.195 ug/m3 assuming 8,760 hours/year of operation.

III.A.4.a. Stack height to building height ratio is greater than
1.5, but less than 2.5. Computer will multiply actual
annual & potential annual impacts by 0.75 factor.

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.146 ug/m³ > is less than AGC < 63.000 ug/m³ >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.146 ug/m³ > is less than AGC < 63.000 ug/m³ >.

***** Potential Annual Impact is based upon 8760 hours/year *****
***** operation instead of reported 8760. hours/year. *****

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.
See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Vade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m³ as the plume escaped the cavity region: hs(40. feet) > hc(26. feet).

II.C. CAVITY Short-Term Impact is equal to 0.000 ug/m³.
There is no SGC for this contaminant.

2.3 Momentum Flux, F_m, is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height, h_e, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 2.909 ug/m³, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 9.732 ug/m³. For: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 8.136 ug/m³. For: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST) equals 8.136 ug/m³ for the point source. There is no SGC for this contaminant.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, <Cav,Pt,Area>) equals 8.136 ug/m³ and is reported in the ANALYSIS MENU.

VIII. Contaminant Impact Summary Step by Step Menu for 1,2-Dichloroethene (total):

```
*****NWIRP BETHPAGE GM-38 AREA***** BETHPAGE***** OYSTER BAY, NEW YORK*****  
EMISSION POINT = TOTAL CAS NUMBER = 00540-59-0 SIC = 0  
AGC = 63.000000000 ug/m3 SGC = 0.000000 ug/m3  
STACK: HA= 15., SH= 40., D= 36., T= 80., U= 21.69, q= 9200.00  
BUILDING: Dpl= 50., BW= 75., BL= 75., %CONTROL= 0.0000  
** Reported Hourly Emission Rate (Q) is equal to 0.025800000 lbs/hour.  
** Reported Annual Emission Rate (Qa) is equal to 226.000000 lbs/year.  
II.B. Refined Cavity Impact Method (DAR-1, APPENDIX B).  
II.B.1. Shortest Distance from building to Property Line (< 50. feet >) is less than or equal to the cavity length, or 3 building heights (< 75. feet >). Therefore, this building will have cavity impacts (if they occur) at receptors off plant property.  
II.B.2. The largest building dimension (< 75. feet >) is greater than or equal to the building height (< 25. feet >). Therefore, the computer will NOT redefine the cavity length.  
II.B.3. Stack height (< 40. feet >) is greater than cavity height (< 38. feet >). Therefore, this source does not contribute to the buildings cavity impact. The Computer will assume the CAVITY Annual Impact equals 0.00 ug/m3.  
II.C. CAVITY Annual Impact (< 0.000 ug/m3 >) is less than AGC (< 63.000 ug/m3 >).  
III.A. STANDARD POINT SOURCE METHOD (DAR-1, APPENDIX B).  
III.A.1.b. Momentum flux, Fm, is equal to 1000.331 ft(4)/sec(2).  
III.A.1.b. Effective stack height, he, is equal to 51.001 feet.  
III.A.2. STANDARD POINT SOURCE Actual Annual Impact is equal to 0.195 ug/m3 for 8760. hours/year of operation.  
III.A.3. STANDARD POINT SOURCE Potential Annual Impact is equal to 0.195 ug/m3 assuming 8,760 hours/year of operation.  
III.A.4.a. Stack height to building height ratio is greater than 1.5, but less than 2.5. Computer will multiply actual annual & potential annual impacts by 0.75 factor.
```

III.A.5. STANDARD POINT SOURCE Short-Term Impact is calculated below using the DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

III.D. STANDARD POINT SOURCE Actual Annual Impact < 0.146 ug/m³ > is less than AGC < 63.000 ug/m³ >.

III.D. STANDARD POINT SOURCE Potential Annual Impact < 0.146 ug/m³ > is less than AGC < 63.000 ug/m³ >.

**** Potential Annual Impact is based upon 8760 hours/year
**** operation instead of reported 8760. hours/year. ****

2.0 DAR-1 SOFTWARE PROGRAM SHORT-TERM METHOD.

See "Technical Reference for the Screening Procedures of the DAR-1 Software Program, Wade/Sedefian," 1/11/94.

2.2 CAVITY Short-Term Impact is equal to 0.00 ug/m³ as the plume escaped the cavity region: hs(40. feet) > hc(26. feet).

II.C. CAVITY Short-Term Impact is equal to 0.000 ug/m³. There is no SGC for this contaminant.

2.3 Momentum Flux, F_M, is equal to 1000.331 ft(4)/sec(2).

2.3 Effective stack height, h_E, is equal to 51.001 feet.

2.4 Maximum non-downwash GEP stack Short-Term Impact (CSTP) is equal to 2.909 ug/m³, for hs/hb = 1.60

2.5 Maximum downwash Short-Term Impact (CSTD) is equal to 9.732 ug/m³, for: hs/hb = 1.60 and ESH = 51. feet.

2.6 Adjusted maximum downwash Short-Term (CSTD) is equal to 8.136 ug/m³, for: RF = 0.84

III.D. Maximum non-cavity Short-Term Impact (CST) equals 8.136 ug/m³ for the point source. There is no SGC for this contaminant.

2.7 Maximum Short-Term cavity, point, or area source impact (SHORT-TERM MAXIMUM, <Cav,Pt,Area>) equals 8.136 ug/m³ and is reported in the ANALYSIS MENU.

IX. AGCs and SGCS for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethylene, and 1,2-Dichloroethene (total):

CAS NUMBER	CONTAMINANT NAME	AGCs & SGCS				9/ 8/11 Page 1
		SGC ug/m ³	H O M	AGC ug/m ³	H I O D U X	
00075-01-4	VINYL CHLORIDE	180000.00000	D	0.110000000	E H U HA	
00079-11-6	TRICHLOROETHYLENE	14000.00000	Z	0.500000000	D H U HD	
00127-10-4	TETRACHLOROETHYLENE	1000.00000	H	1.000000000	H M U HI	
00156-59-2	DICHLOROETHYLENE, cis	0.00000		63.000000000	D M	
00540-59-0	DICHLOROETHYLENE, 1,2	0.00000		63.000000000	D M	

X. Contaminant Emissions Summary for TCE, PCE, Vinyl Chloride, cis 1,2-Dichloroethene, and 1,2-Dichloroethene (total):

CONTAMINANT EMISSIONS SUMMARY				9/ 8/11 Page 1
CAS NUMBER	CONTAMINANT NAME	NUM. OF EPs PER CONTAM.	EMISSIONS (<1bs/hour>)	EMISSIONS (<1bs/year>)
00075-01-4	VINYL CHLORIDE	1	0.0026000	22.93000
00079-01-6	TRICHLOROETHYLENE	1	0.3444000	3817.00000
00127-18-4	TETRACHLOROETHYLENE	1	0.2342000	2852.00000
00156-59-2	DICHLOROETHYLENE, cis	1	0.0258000	226.00000
00540-59-0	DICHLOROETHYLENE, 1,2	12	0.0258000	226.00000
SUMMARY TOTALS		5	0.6328000	5543.93000

XI. Meter Grid Modeling Results for Maximum Annual Concentrations of TCE, within 25 meters:

CONCENTRATIONS × 10 ⁻² (ug/m ³) for 00079-01-6												09/08/11 13:17:58
AGC = 0.500000000 ug/m ³												
UTMN ↑	367000.	369000.	371000.	373000.	375000.	377000.	379000.					
UTME ↓	366000.	368000.	370000.	372000.	374000.	376000.	378000.					
4511000.	0.04	0.06	0.08	0.14	0.23	0.32	0.41	0.30	0.14	0.10	0.08	0.06
4510000.	0.03	0.05	0.08	0.13	0.25	0.43	0.60	0.40	0.17	0.12	0.09	0.07
4509000.	0.02	0.03	0.06	0.11	0.24	0.58	1.01	0.52	0.22	0.14	0.11	0.08
4508000.	0.02	0.03	0.04	0.06	0.18	0.62	2.16	0.64	0.31	0.19	0.13	0.11
4507000.	0.02	0.03	0.04	0.06	0.11	0.26	7.27	1.43	0.60	0.34	0.22	0.15
4506000.	0.03	0.03	0.05	0.07	0.13	0.33	2.58	2.99	1.12	0.51	0.30	0.20
4505000.	0.03	0.04	0.05	0.08	0.20	0.45	0.94	0.81	0.60	0.45	0.33	0.23
4504000.	0.03	0.04	0.07	0.12	0.20	0.22	0.47	0.43	0.33	0.27	0.24	0.20

TOP 100 CONTRIBUTORS TO MAXIMUM CONCENTRATION FOR 00079-01-6						09/08/11 13:17:58
Emission Point	Facility Name (shortened)	EP	Distance to Max.(m)	CONC. ug/m ³	Percent of Max.	
TOTAL	NWIRP BETHPAGE GM-38 AREA	SSE	539.	0.727E-01	100.000	
TOTAL OF ALL	1 CONTRIBUTORS			0.727E-01	100.000	

XII. ISCLT Model Run Information, within 25 meters:

MODEL RUN INFORMATION		09/08/11 13:17:58
1.	Current GRID SPACING equals 1000. meters.	
2.	Maximum Concentration (flashing) equals 0.0727115273 ug/m3 @ UTME: 373800. UTMN: 4507800.	
3.	RUN FILE: TEMP7.RUN	
4.	METEOROLOGICAL FILE: ALB.MET	
5.	RUN MODE: URBAN	
6.	HALF-LIVES: not used to account for pollutant removal from air.	
7.	BLD. WAKE EFFECTS: AG-1 METHOD, ALL DATA KNOWN (hh,bw,bl,orientation)	
8.	EMISSIONS: ACTUAL ANNUAL EMISSIONS	
9.	SOURCES: All sources within 25. meters of UTME: 373275., UTMN: 4506537.	
10.	CONTAMINANT CAS NUMBER(s): 00079-01-6	
11.	EMISSION POINT - CONTAMINANT(s) found by computer: 1	
12.	No data is being copied to DUMP file.	

APPENDIX C

FIELD LOGS AND CHAIN OF CUSTODY DOCUMENTATION THIRD QUARTER 2022

Date: 10-4-2022
10/5/2022*



Groundwater Level Measurement Sheet

Project Site: NWIPR Bethpage – GM-38
Location: Bethpage, NY
Field Crew: E. Seiler + E. Goernemann

Water Level Meter: Solinst
Weather: 49 cloudy + rain
Time of Low Tide: N/A
Time of High Tide: N/A

Well ID	Time	Depth to Water (Ft.)	Total Depth of Well/ Screened Interval (Ft.)	Comments
RW1-MW1	* 0820	36.65	435 / 395 – 435	
RW1-MW2	* 1535	38.17	435 / 395 – 435	
RW1-MW3	* 1204	29.66	435 / 395 – 435	
RW2-MW1	* 1007	40.2	510 / 470 – 510	
RW2-MW2	* 0950	39.67	510 / 470 – 510	
RW2-MW3	* 0948	39.35	510 / 470 – 510	
RW3-MW1	1520	38.56	350 / 330 – 350	
RW3-MW2	12:35	46.12	495 / 475 – 495	
RW3-MW3	9:56	39.92	340 / 320 – 340	
RW3-MW4	9:20	367.15	495 / 475 – 495	
TP1	17:08	34.76	470 / 450 – 470	
IW1-MW1	* 1540	41.77	470 / 450 – 470	
RW-1			Open vault and check integrity of piping, etc.	
RW-3			Open vault and check integrity of piping, etc.	

Signature:

Date: 10/6/2022



Instrument Calibration Log

Project/Site Name: Bethpage	Date: 10-4-2022	Weather: high 40's cloudy & rainy
Calibrated By: Elizabeth Goermann	Instrument: YSI ProDSS Hach	Serial Number: 18E105404 20100D001015

Parameters	Morning Calibration Time: 0715	Calibration Temperature °C eg	Afternoon Calibration Check Time: _____	Comments
Conductivity (µS/cm ³)	10.01 1,413	14.0		
pH (7)	6.85	14.6		
pH (4)	4.01	14.5		
pH (10)	10.01	14.0		
ORP (mv)	240	14.8		
Dissolved Oxygen (%)	99.2 %	12.8		
Zero Dissolved Oxygen (mg/L)				
Barometric Pressure (mmHg)				
Turbidity (NTU)	19.3			
Turbidity (NTU)	98.7			
Turbidity (NTU)	780			
Turbidity (NTU)	10.1			

Signature: Elizabeth Goermann

Date: 10-4-22



Instrument Calibration Log

Project/Site Name: Bethpage	Date: 10-5-2022	Weather: mid 50's cloudy & rainy
Calibrated By: Elizabeth Goerneemann	Instrument: YSI pro DSS Hach	Serial Number: 18E105404 20100D001015

Parameters	Morning Calibration Time: <u>0715</u>	Calibration Temperature °C	Afternoon Calibration Check Time: _____	Comments
Conductivity (µS/cm ³)	1.401	18.7		
pH (7)	6.90	18.8		
pH (4)	4.01	19.0		
pH (10)	10.03	18.7		
ORP (mv)	243.1	18.4		
Dissolved Oxygen (%)	101.3	15.6		
Zero Dissolved Oxygen (mg/L)	eg	eg		
Barometric Pressure (mmHg)	701.3 eg	15 eg		
Turbidity (NTU)	20.3			
Turbidity (NTU)	98.7			
Turbidity (NTU)	809			
Turbidity (10 NTU)	9.70			

Signature: Elizabeth Goerneemann

Date: 10-5-2022

KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log



Well Identification: RWI-MW1

Project: NWIRP Bethpage - GM38	Date: 10/5/2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information						
Casing Secure	Yes	No	N/A	Diameter	4"				
Concrete Pad intact			X	Material	PVC				
PVC casing intact	X			Depth to water (ft BTOR)	36.65				
Well gripper present	X			Depth to bottom (ft BTOR)	435				
Bolts present	X			Pump Set Depth (ft BTOR)					
Locked (stickup wells)		X		Screen Interval (ft BTOR)					
				Total volume purged (gal)	1.8				
Sampling Type									
Purging Method	Bladder pump	Tubing type	LDPE	Dedicated pump (Y/N)	N				
Purge start/stop time	0823/0901	Tubing diameter	3/8"	Air source	CO2				
Field Instrument (Model/S/N)	YSI Pro DSS 18E10584 HACH 2100Q 20100D06105								
Stabilization Parameters									
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm³)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color/Clarity
0830	250	36.71	15.8	4.48	152	1.76	181.4	1.41	clear
0835	250	36.71	15.9	4.28	153	1.38	187.0	1.10	clear
0840	250	36.71	15.9	4.22	153	1.28	190.7	0.60	clear
0845	250	36.71	15.8	4.23	153	1.22	193.8	0.65	clear
0850	250	36.71	15.8	4.24	152	1.18	197.0	0.69	clear
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume = 0.163 gal/ft or 616 ml/ft	
Post Cal. Check Variance Observed (Y/N):									
Sampling Details									
Sampling ID:	GM-38-GW-RW1-MW1-1022								
Sample Time:	0855	Duplicate (Y/N):	NO			MS/MSD (Y/N):			NO
Field Filtered (Y/N):	NO	Dup ID:	—						
Filter Size:	—	Dup Time:	—						

Comments _____

Signature

10/6/2022

Date

KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log



Well Identification: RW1- MW3

Project: NWIRP Bethpage - GM38	Date: 10/5/2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information						
Casing Secure	Yes	No	N/A	Diameter	4"				
Concrete Pad intact	X			Material	PVC				
PVC casing intact	X			Depth to water (ft BTOR)	29.66				
Well gripper present	X			Depth to bottom (ft BTOR)	435				
Bolts present	X			Pump Set Depth (ft BTOR)					
Locked (stickup wells)			X	Screen Interval (ft BTOR)					
				Total volume purged (gal)	2.5				
Sampling Type									
Purge start/stop time	1205	Tubing type	LDPE	Dedicated pump (Y/N)	NO				
Purge start/stop time	1205	Tubing diameter	3/8	Air source	CO ₂				
Field Instrument (Model/S/N)	YSI Pro DSS 18E10584 HACH 2100Q 20100D00 1015								
Stabilization Parameters									
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^c)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color/Clarity
12:5	275	29.66	14.6	4.69	183	0.95	181.7	9.85	Clear
1220	275	29.64	14.5	4.60	183	0.78	186.7	9.21	Clear
1225	275	29.62	14.5	4.57	183	0.69	189.6	7.42	Clear
1230	275	29.60	14.5	4.55	183	0.63	185.2	7.38	Clear
1235	275	29.60	14.5	4.54	183	0.60	194.1	7.07	Clear
1240	275	29.60	14.5	4.53	183	0.58	195.2	7.05	Clear
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume =	
Post Cal. Check Variance Observed (Y/N):								0.163 gal/ft or 616 ml/ft	
Sampling Details									
Sampling ID:	GM-38-GW-RW 1-MW3-1022								
Sample Time:	1245	Duplicate (Y/N):	NO	MS/MSD (Y/N):	NO				
Field Filtered (Y/N):	no	Dup ID:	-						
Filter Size:	-	Dup Time:	-						

Comments

Signature

10/6/2022

Date



KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log

Well Identification: RW2 - MW1

Project: NWIRP Bethpage - GM38	Date: 10/ 5 /2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information					
Casing Secure	Yes	No	N/A	Diameter	4"			
Concrete Pad intact	X			Material	Steel			
PVC casing intact		X		Depth to water (ft BTOR)	40.21			
Well gripper present	X			Depth to bottom (ft BTOR)	510			
Bolts present		X		Pump Set Depth (ft BTOR)				
Locked (stickup wells)		X		Screen Interval (ft BTOR)				
				Total volume purged (gal)	2.9			
Sampling Type								
Purging Method	Bladder		Tubing type	HDPE		Dedicated pump (Y/N)	No	
Purge start/stop time	1010/1116		Tubing diameter	3/8		Air source	CO ₂	
Field Instrument (Model/S/N)	YSI Pro DSS 18E10584 HACH 2100Q 20106D0001015							
Stabilization Parameters								
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^c)	DO (mg/L)	ORP (mv)	Turbidity (NTU)
1015	200	40.24	14.7	6.25	162	1.10	185.9	18.6
1020	200	40.24	14.8	7.48	154	0.69	171.9	11.2
1025	200	40.24	14.9	8.24	161	0.62	173.4	6.66
1030	200	40.18	15.0	7.29	164	0.56	179.0	6.37
1035	200	40.15	14.9	6.80	163	0.51	180.1	6.14
1040	200	40.12	14.9	6.49	163	0.48	177.4	6.62
1045	200	40.10	15.1	6.27	163	0.45	171.2	5.36
1050	200	40.05	15.2	6.13	163	0.43	165.3	4.87
1055	200	40.03	15.1	6.05	163	0.41	160.1	4.58
1100	200	40.01	15.1	6.02	163	0.40	158.5	4.02
1105	200	39.99	15.1	6.00	163	0.39	156.7	4.49
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume = 0.163 gal/ft or 616 ml/ft
Post Cal. Check Variance Observed (Y/N):								
Sampling Details								
Sampling ID:	GM-38-GW-RW2 -MW1 -1022							
Sample Time:	1110	Duplicate (Y/N):	No		MS/MSD (Y/N): No			
Field Filtered (Y/N):	NO	Dup ID:	-					
Filter Size:	-	Dup Time:	-					

Comments _____

Signature

10/16/2022

Date

KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log



Well Identification: RW3-MW1

Project: NWIRP Bethpage - GM38	Date: 10/4/2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information						
Casing Secure	Yes	No	N/A	Diameter	4"				
Concrete Pad intact			X	Material	PVC				
PVC casing intact	X			Depth to water (ft BTOR)	38.56				
Well gripper present	X			Depth to bottom (ft BTOR)	350				
Bolts present	X			Pump Set Depth (ft BTOR)					
Locked (stickup wells)		X		Screen Interval (ft BTOR)					
				Total volume purged (gal)	3.6				
Sampling Type									
Purging Method	Bladder pump			Tubing type	LDPE-HDPE			Dedicated pump (Y/N)	NO
Purge start/stop time	1519-1613			Tubing diameter	3/8			Air source	CO ₂
Field Instrument (Model/S/N)	YSI Pro DSS 18E10584 HACH 2100Q 207007001015								
Stabilization Parameters									
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^c)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color/Clarity
1525	300	38.57	17.2	4.23	181	5.12	239.9	1.16	Clear
1530	300	38.57	17.2	4.27	181	5.15	204.8	0.91	Clear
1535	300	38.56	17.2	4.25	181	5.18	219.4	0.63	clear
1540	300	38.58	16.9	4.40	181	5.20	176.1	0.37	clear
1545	300	38.59	16.8	4.27	181	5.21	194.5	0.48	clear
1550	300	38.60	16.8	4.25	181	5.22	205.9	0.27	clear
1555	300	38.60	16.7	4.25	181	5.22	213.7	0.30	clear
1600	300	38.58	16.7	4.25	181	5.22	217.7	0.87	clear
1605	300	38.58	16.6	4.24	181	5.21	221.4	0.20	clear
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume =	
Post Cal. Check Variance Observed (Y/N):								0.163 gal/ft or 616 ml/ft	
Sampling Details									
Sampling ID:	GM-38-GW-RW 3 -MW 1 -1022								
Sample Time:	1610	Duplicate (Y/N):	NO			MS/MSD (Y/N):	NO		
Field Filtered (Y/N):	NO	Dup ID:	-						
Filter Size:	-	Dup Time:	-						

Comments _____

Signature

10/6/2022

Date



KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log

Well Identification: RW 3 - MW 2

Project: NWIRP Bethpage - GM38	Date: 10/4/2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information					
Casing Secure	Yes	No	N/A	Diameter	4"			
Concrete Pad intact	X			Material	PVC			
PVC casing intact			X	Depth to water (ft BTOR)	40.12			
Well gripper present	X			Depth to bottom (ft BTOR)	49.5			
Bolts present	X			Pump Set Depth (ft BTOR)				
Locked (stickup wells)	X		X	Screen Interval (ft BTOR)				
				Total volume purged (gal)	4.2			
Sampling Type								
Purging Method	Bladder pump	Tubing type	HDPE	Dedicated pump (Y/N)	N			
Purge start/stop time	1250/1434	Tubing diameter	3/8"	Air source	CO ₂			
Field Instrument (Model/S/N)	1332	USF Pro DSS HACIT 2100Q	18E10584 20100D0001015					
Stabilization Parameters								
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ³)	DO (mg/L)	ORP (mv)	Turbidity (NTU)
1350	300	40.19	16.3	4.54	860	0.62	218.4	8.49
1355	300	40.19	16.3	4.55	8586	0.55	217.7	6.47
1400	300	40.20	16.2	4.55	860	0.51	217.8	5.80
1405	300	40.20	15.9	4.54	860	0.48	218.2	6.41
1410	300	40.20	15.7	4.54	860	0.45	218.8	6.09
1415	300	40.20	15.7	4.53	860	0.44	214.1	4.28
1420	300	40.20	15.7	4.52	860	0.43	214.5	4.11
1425	300	40.20	15.6	4.52	860	0.42	214.8	4.78
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume =
Post Cal. Check Variance Observed (Y/N):								0.163 gal/ft or 616 ml/ft
Sampling Details								
Sampling ID:	GM-38-GW-RW 3 -MW 2-1022							
Sample Time:	1430	Duplicate (Y/N):	NO	MS/MSD (Y/N):	NO			
Field Filtered (Y/N):	NO	Dup ID:	-					
Filter Size:	-	Dup Time:	-					

Comments Issues with bladder pump, switch pumps prior to pumping

F Sub

Signature

10/6/2022

Date



KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log

Well Identification: RW3-MW3

Project: NWIRP Bethpage - GM38	Date: 10/4/2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information					
Casing Secure	Yes	No	N/A	Diameter	4"			
Concrete Pad intact			X	Material	PVC			
PVC casing intact	X			Depth to water (ft BTOR)	39.92			
Well gripper present	X			Depth to bottom (ft BTOR)	340			
Bolts present		X		Pump Set Depth (ft BTOR)				
Locked (stickup wells)			X	Screen Interval (ft BTOR)				
				Total volume purged (gal)	3.0			
Sampling Type								
Purging Method	Bladder pump	Tubing type	LDPE	Dedicated pump (Y/N)	N			
Purge start/stop time	10/31/2021	Tubing diameter	3/8	Air source	CO ₂			
Field Instrument (Model/S/N)	YSI Pro PSS 18E10544 HAC1T 2400G 20100D001015							
Stabilization Parameters								
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ³)	DO (mg/L)	ORP (mv)	Turbidity (NTU)
1035	300	40.00	14.1	4.81	128	3.12	227.1	3.50
1040	300	40.00	14.3	4.69	131	2.94	227.3	5.64
1045	300	40.00	14.4	4.65	131	2.88	227.1	5.85
1050	300	40.00	14.3	4.62	132	2.85	227.2	5.38
1055	300	40.00	14.2	4.61	132	2.84	227.4	5.10
1100	300	40.00	14.3	4.60	132	2.81	227.7	3.88
1105	300	40.00	14.2	4.59	132	2.79	227.8	3.40
1110	300	40.00	14.2	4.59	132	2.79	228.0	3.44
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume =
Post Cal. Check Variance Observed (Y/N):								0.163 gal/ft or 616 ml/ft
Sampling Details								
Sampling ID:	GM-38-GW-RW3 -MW3-1022							
Sample Time:	1115	Duplicate (Y/N):	Yes	MS/MSD (Y/N): No				
Field Filtered (Y/N):	no	Dup ID:	GM-38-GW-RW3-MW3-DUP-1022					
Filter Size:	-	Dup Time:	1120					

Comments _____

E. Seiler

Signature

10/6/2022

Date



KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log

Well Identification: RW3-MW4

Project: <u>NWIRP Bethpage - GM38</u>	Date: <u>10/4/2022</u>
Location: <u>Bethpage, NY</u>	Sampler: <u>Seiler & Goernemann</u>

Well Integrity			Well Information						
Casing Secure	Yes	No	N/A	Diameter	4"				
Concrete Pad intact	X			Material	PVC	RHS			
PVC casing intact	X		X	Depth to water (ft BTOR)	07.15	37.15			
Well gripper present	X			Depth to bottom (ft BTOR)	49.5				
Bolts present	X			Pump Set Depth (ft BTOR)					
Locked (stickup wells)		X		Screen Interval (ft BTOR)					
				Total volume purged (gal)	3.0				
Sampling Type									
Purging Method	<u>Bladder pump</u>		Tubing type	<u>LDPE</u>		Dedicated pump (Y/N)	<u>N</u>		
Purge start/stop time	<u>0837/0938</u>		Tubing diameter	<u>3/8</u>		Air source	<u>CO2</u>		
Field Instrument (Model/S/N)	<u>USI Pro DSS 18E105404 HACH 2100G 20106D001615</u>								
Stabilization Parameters									
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^c)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color/Clarity
0855	250	41.21	14.6	4.48	137	1.45	255.1	2.43	Clear
0900	250	41.21	14.7	4.41	137	0.96	253.8	1.03	Clear
0905	250	41.21	14.8	4.37	137	1.06	251.9	1.80	Clear
0910	250	41.21	14.8	4.36	137	1.01	250.0	2.12	Clear
0915	250	41.22	14.8	4.34	137	0.98	249.4	1.84	Clear
	300								
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume = 0.163 gal/ft or 616 ml/ft	
Post Cal. Check Variance Observed (Y/N):									
Sampling Details									
Sampling ID:	<u>GM-38-GW-RW 3 -MW 4-1022</u>								
Sample Time:	<u>0920</u>	Duplicate (Y/N):	<u>no</u>		MS/MSD (Y/N):				<u>Yes</u>
Field Filtered (Y/N):	<u>no</u>	Dup ID:	<u>—</u>						
Filter Size:	<u>—</u>	Dup Time:	<u>—</u>						

Comments _____

F. S. G.

Signature

10/6/2022

Date

KOMAN GOVERNMENT SOLUTIONS LLC/TRINITY
Low Flow/ Low Stress Groundwater Sampling Log



Well Identification: TP01

Project: NWIRP Bethpage - GM38	Date: 10/4/2022
Location: Bethpage, NY	Sampler: Seiler & Goernemann

Well Integrity			Well Information						
Casing Secure	Yes	No	N/A	Diameter	4"				
Concrete Pad intact	X			Material	PVC				
PVC casing intact	X			Depth to water (ft BTOR)	34.76				
Well gripper present	X			Depth to bottom (ft BTOR)	470				
Bolts present	X			Pump Set Depth (ft BTOR)					
Locked (stickup wells)		X		Screen Interval (ft BTOR)					
				Total volume purged (gal)	3.6				
Sampling Type									
Purging Method	Bladder Pump			Tubing type	LDPE	Dedicated pump (Y/N)			N
Purge start/stop time	1710/1803			Tubing diameter	3/8	Air source			CO ₂
Field Instrument (Model/S/N)	YSI Pro DSS 18210584 HACH 2100Q 20160 D00 1015								
Stabilization Parameters									
Time (hhmm)	Flow Rate (ml/min)	Depth to Water (ft)	Temp (°C)	pH (STD)	SPC (µS/cm ^c)	DO (mg/L)	ORP (mv)	Turbidity (NTU)	Color/Clarity
1735	300	34.76	14.1	4.91	264	3.68	231.5	0.51	Clear
1740	300	34.77	14.1	4.96	264	3.64	210.1	0.57	Clear
1745	300	34.78	14.1	4.98	263	3.59	198.4	0.68	Clear
1750	300	34.78	14.1	5.00	263	3.56	202.3	0.36	Clear
1755	300	34.78	14.1	5.01	262	3.54	203.6	0.50	Clear
Acceptance Criteria:	<0.3ft	±3%	±0.1	±3%	±10%	± 10mv	10%	2" Screen Volume = 0.163 gal/ft or 616 ml/ft	
Post Cal. Check Variance Observed (Y/N):									
Sampling Details									
Sampling ID:	GM-38-GW-RW-MW-1022			TP01-1022					
Sample Time:	1800			Duplicate (Y/N):	No			MS/MSD (Y/N):	No
Field Filtered (Y/N):	No			Dup ID:	-				
Filter Size:	-			Dup Time:	-				

Comments *Water took ~10 min to travel through tubing + flow through cell then ~5 min to obtain flowrate <500 ml/min

Signature

Date

10/6/2022



CHAIN OF CUSTODY/LABORATORY ANALYSIS REQUEST FORM

065103

1565 Jefferson Road, Building 300, Suite 360 • Rochester, NY 14623 | +1 585 288 5380 +1 585 288 8475 (fax) PAGE / OF /

Project Name Bethpage GM38 semi annual LTM		Project Number 260S-106		ANALYSIS REQUESTED (Include Method Number and Container Preservative)														
Project Manager Bob Gregory		Report CC		PRESERVATIVE		O				2		O						
Company/Address 180 Gordon Drive Suite 110 Exton PA 19341				NUMBER OF CONTAINERS													Preservative Key 0. NONE 1. HCL 2. HNO3 3. H2SO4 4. NaOH 5. Zn, Acetate 6. MeOH 7. NaHSO4 8. Other _____	
Phone # 610-324-8462		Email Rgregory@komangs.com															REMARKS/ ALTERNATE DESCRIPTION	
Sampler's Signature Elizabeth Goermann		Sampler's Printed Name Elizabeth Goermann		CLIENT SAMPLE ID	FOR OFFICE USE ONLY LAB ID	SAMPLING		MATRIX	15	9	3	3	MS/MSD					
DATE 10-4-22		TIME 0920																
GM-38-GW-RW3-MW1-1022		GM-38-GW-RW3-mw3-1022				GW												
GM-38-GW-RW3-MW3-1022		GM-38-GW-RW3-mw3-1022				GW		5	3	1	1							
GM-38-GW-RW3-MW5-DUP-1022		GM-38-GW-RW3-MW2-1022				GW		5	3	1	1							
GM-38-GW-RW3-MW2-1022		GM-38-GW-RW3-mw2-1022				GW		5	3	1	1							
GM-38-GW-RW3-MW7-1022		GM-38-GW-RW3-mw7-1022				GW		5	3	1								
GM-38-EB-1022		(0-4-22) 1645				Blank		5	3	1	1					Equipment blank		
GM-38-GW-TP01-1022		GM-38-GW-TP01-1022				GW		5	3	1	1							
GM-38-GW-RW1-mw1-1022		GM-38-GW-RW1-mw1-1022				GW		5	3	1	1							
GM-38-GW-RW2-mw1-1022		GM-38-GW-RW2-mw1-1022				GW		5	3	1	1							
GM-38-GW-RW1-MW3-1022		GM-38-GW-RW1-MW3-1022				GW		5	3	1	1							
Trip Blank		10-5-22 —				Blank		3	3							Trip blank		
SPECIAL INSTRUCTIONS/COMMENTS Metals Total Metals = Hg Only										TURNAROUND REQUIREMENTS				REPORT REQUIREMENTS		INVOICE INFORMATION		
										RUSH (SURCHARGES APPLY) 1 day 2 day 3 day 4 day 5 day <input checked="" type="checkbox"/> Standard (10 business days-No Surcharge)				I. Results Only		PO #		
										REQUESTED REPORT DATE				II. Results + QC Summaries (LCS, DUP, MS/MSD as required)		BILL TO:		
														III. Results + QC and Calibration Summaries				
														IV. Data Validation Report with Raw Data				
														Edata Yes No				
See QAPP <input type="checkbox"/>																		
STATE WHERE SAMPLES WERE COLLECTED New York																		
RELINQUISHED BY		RECEIVED BY		RELINQUISHED BY		RECEIVED BY		RELINQUISHED BY		RECEIVED BY								
		Signature		Signature		Signature		Signature		Signature								
Printed Name		Printed Name		Printed Name		Printed Name		Printed Name		Printed Name								
Firm KGS		Firm		Firm		Firm		Firm		Firm								
Date/Time 10-5-22 1345		Date/Time 10-6-22 1000		Date/Time		Date/Time		Date/Time		Date/Time								



APPENDIX D

DATA VALIDATION REPORTS

VOLATILE ORGANIC COMPOUNDS
USEPA Region II –Data Validation

Project Name: Naval Weapons Industrial Reserve Plant, GM-38 Area LTM

Location: 100 Broadway, Bethpage, NY

SDG #: R2209606

Client: KOMAN Government Solutions, LLC

Date: 11/16/2022

Laboratory: ALS Environmental, Rochester, NY

Reviewer: Sherri Pullar

Summary:

1. Data validation was performed on the data for nine (9) water samples and one (1) equipment blank analyzed for Volatiles by EPA Method 624.1.
2. The samples were collected on 10/4/2022. The samples were submitted to ALS Environmental, Rochester, NY on 10/7/2022 for analysis.
3. The USEPA Region II SOP HW-34, Revision No.: 3, Trace Volatile Data Validation; USEPA National Functional Guidelines for Organic Data Review, EPA 540/R-2017-002, January 2017; EPA Method 624 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Volatiles data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

Samples:

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
GM-38-GW-RW3-MW4-1022	R2209606-001	10/4/2022	Water	
GM-38-GW-RW3-MW3-1022	R2209606-002	10/4/2022	Water	
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	10/4/2022	Water	Field Duplicate of sample GM-38-GW-RW3-MW3-1022
GM-38-GW-RW3-MW2-1022	R2209606-004	10/4/2022	Water	
GM-38-GW-RW3-MW1-1022	R2209606-005	10/4/2022	Water	
GM-38-EB-1022	R2209606-006	10/4/2022	Water	Equipment Blank
GM-38-GW-TP01-1022	R2209606-007	10/4/2022	Water	
GM-38-GW-RW1-MW1-1022	R2209606-008	10/5/2022	Water	
GM-38-GW-RW2-MW1-1022	R2209606-009	10/5/2022	Water	
GM-38-GW-RW1-MW3-1022	R2209606-010	10/5/2022	Water	

Sample Conditions/Problems:

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data except for a trip blank sample. Sample vials for Trip blank (R2209606-011) were broken upon receipt at the laboratory. This sample is not noted in the samples collected above as it could not be analyzed. No qualifications were required.

Holding Times:

1. All water samples were analyzed within 14 days from sample collection. No qualifications were required.
2. All water samples were properly preserved (pH<2.0). No qualifications were required.

Surrogates:

1. All surrogates %REC values for all water samples and associated QC were within the laboratory control limits. No qualifications were required.

Method Blank (MB), Storage Blank (SB), Trip Blank (TB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):

1. Method Blank (RQ2212497-06) analyzed on 10/11/2022 was free of contamination. No qualifications were required.
2. Equipment Blank (GM-38-EB-1022) (R2209606-006) analyzed on 10/11/2022 contained trichloroethene (0.598 ug/L). Field sample results for trichloroethene were >2X the equipment blank contamination. No qualifications were required.
3. Note: Trip Blank (R2209606-011) listed on the chain-of-custody was not analyzed as all the bottles received for this sample were broken upon arrival. No qualifications were required.

Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):

1. Laboratory Control Sample (RQ2212497-03) was analyzed on 10/11/2022. All %RECs were within the laboratory control limits. No qualifications were required.

Field Duplicate:

1. Sample GM-38-GW-RW3-MW3-DUP-1022 (R2209606-003) was collected as field duplicate for sample GM-38-GW-RW3-MW3-1022 (R2209606-002). Result for chloroform was detected in the field duplicate sample and was non-detect in the field sample. All RPDs were ≤50.0%.

Field Sample	Compound	Analytical Method	Result	Units	Field Duplicate	Result	Units	RPD	Qualifier
GM-38-GW-RW3-MW3-1022	1,1,1-Trichloroethane	EPA 624	0.235 J	µg/l	GM-38-GW-RW3-MW3-DUP-1022	0.268 J	µg/l	13.1	NONE
GM-38-GW-RW3-MW3-1022	1,1-Dichloroethane	EPA 624	1.09 J	µg/l	GM-38-GW-RW3-MW3-DUP-1022	1.09 J	µg/l	0.0	NONE
GM-38-GW-RW3-MW3-1022	1,1-Dichloroethene	EPA 624	0.741 J	µg/l	GM-38-GW-RW3-MW3-DUP-1022	0.706 J	µg/l	4.8	NONE
GM-38-GW-RW3-MW3-1022	Chloroform	EPA 624	ND	µg/l	GM-38-GW-RW3-MW3-DUP-1022	0.291 J	µg/l	NC	UJ/J
GM-38-GW-RW3-MW3-1022	Tetrachloroethene	EPA 624	0.533 J	µg/l	GM-38-GW-RW3-MW3-DUP-1022	0.432 J	µg/l	20.9	NONE
GM-38-GW-RW3-MW3-1022	Trichloroethene	EPA 624	139	µg/l	GM-38-GW-RW3-MW3-DUP-1022	136	µg/l	2.2	NONE
GM-38-GW-RW3-MW3-1022	Cis-1,2-dichloroethene	EPA 624	0.480 J	µg/l	GM-38-GW-RW3-MW3-DUP-1022	0.508 J	µg/l	5.7	NONE

Results for chloroform in field duplicate pair (GM-38-GW-RW3-MW3-1022/ GM-38-GW-RW3-MW3-DUP-1022) were qualified as estimated (UJ/J, respectively).

Matrix Spike (MS)/ Matrix Spike Duplicate (MSD):

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample GM-38-GW-RW3-MW4-1022 (R2209606-001). All %RECs/RPDs were within the laboratory control limits. No qualifications were required.

Compound Quantitation and Reported Contract Required Quantitation Limits (CRQLs):

1. All results were within the linear calibration range. No qualifications were required.

Target Compound Identification:

1. All Relative Retention Times (RRTs) of the reported compounds were within ± 0.06 RRT units of the standard (opening CCV).
2. Sample compound spectra were compared against the laboratory standard spectra.
3. No QC deviations were observed.

Comments:

1. Validation qualifiers (if required) were entered into the EDD for SDG: R2209606.
2. Summary of the qualified data is listed in the Qualification Summary Table for SDG: R2209606 at the end of the data validation report.

MERCURY
USEPA Region II – Data Validation

Project Name: Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM
Location: 100 Broadway, Bethpage, NY
SDG #: R2209606
Client: KOMAN Government Solutions, LLC
Date: 11/16/2022
Laboratory: ALS Environmental, Rochester, NY
Reviewer: Sherri Pullar

Summary:

1. Data validation was performed on the data for nine (9) water samples and one (1) field blank analyzed for Mercury by EPA Method 245.1.
2. The samples were collected on 10/4/2022. The samples were submitted to ALS Environmental, Rochester, NY on 10/7/2022 for analysis.
3. The USEPA Region II SOP No. HW-2C, Revision 15, December 2012, Mercury and Cyanide Data Validation; USEPA National Functional Guidelines for Inorganic Data Review, EPA 540-R-2017-001, January 2017 and Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 were used in evaluating the Mercury data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. Selected data points were qualified due to nonconformance of certain Quality Control criteria (See discussion below).

Samples:

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
GM-38-GW-RW3-MW4-1022	R2209606-001	10/4/2022	Water	
GM-38-GW-RW3-MW3-1022	R2209606-002	10/4/2022	Water	
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	10/4/2022	Water	Field Duplicate of sample GM-38-GW-RW3-MW3-1022
GM-38-GW-RW3-MW2-1022	R2209606-004	10/4/2022	Water	
GM-38-GW-RW3-MW1-1022	R2209606-005	10/4/2022	Water	
GM-38-EB-1022	R2209606-006	10/4/2022	Water	Equipment Blank
GM-38-GW-TP01-1022	R2209606-007	10/4/2022	Water	
GM-38-GW-RW1-MW1-1022	R2209606-008	10/5/2022	Water	
GM-38-GW-RW2-MW1-1022	R2209606-009	10/5/2022	Water	
GM-38-GW-RW1-MW3-1022	R2209606-010	10/5/2022	Water	

Sample Conditions/Problems:

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

Holding Times:

1. All water samples were digested and analyzed within the 28 days holding times for Mercury. No qualifications were required.

Blanks (Method Blank, ICB and CCB):

1. All ICBs and CCBs were free of contamination. No qualifications were required.
2. Method Blank (MB408092) digested on 10/13/2022 and analyzed on 10/15/2022 was free of contamination. No qualifications were required.

Field Blank (FB) and Equipment Blank (EB):

1. Field Blank (GM-38-EB-1022) (R2209606-006) analyzed on 10/15/2022 was free of contamination. No qualifications were required.

Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):

1. Mercury %REC in Laboratory Control Sample analyzed on 10/15/2022 was within the laboratory control limits. No qualifications were required.

Field Duplicate:

1. Sample GM-38-GW-RW3-MW3-DUP-1022 (R2209606-003) was collected as field duplicate for sample GM-38-GW-RW3-MW3-1022 (R2209606-002). Results for mercury were non-detect in the field duplicate pair. No qualifications were required.

Matrix Spike (MS)/ Matrix Spike Duplicate (MSD) and Duplicate/Laboratory Duplicate:

1. Matrix Spike (MS) and Matrix Spike Duplicate (MSD) were performed on sample GM-38-GW-RW3-MW4-1022 (R2209606-001). All %RECs and RPD were within the laboratory control limits. No qualifications were required.

Compound Quantitation and Reported Detection Limits:

1. All sample results were reported within the linear calibration range.

Comments:

1. Validation qualifiers (if required) were entered into the EDD for SDG: R2209606.
2. Summary of the qualified data is listed in the Qualification Summary Table for SDG: R2209606 at the end of the data validation report.

GENERAL CHEMISTRY
USEPA Region II – Data Validation

Project Name: Naval Weapons Industrial Reserve Plant, GM-38 Area-LTM

Location: 100 Broadway, Bethpage, NY

SDG #: R2209606

Client: KOMAN Government Solutions, LLC

Date: 11/16/2022

Laboratory: ALS Environmental, Rochester, NY

Reviewer: Sherri Pullar

Summary:

1. Data validation was performed on the data for nine (9) water samples and one (1) equipment blank (EB) sample analyzed for Solids, Total Suspended (TSS) by SM2540D.
2. The samples were collected on 10/4/2022. The samples were submitted to ALS Environmental, Rochester, NY on 10/7/2022 for analysis.
3. Quality Assurance Project Plan for GM-38 Area, Naval Weapons Industrial Reserve Plant, Bethpage, NY; September 3, 2009 was used in evaluating the Solids, Total Suspended data in this summary report.
4. In general, the data are valid as reported and may be used for decision making purposes. No data points were qualified due to nonconformance of Quality Control criteria (See discussion below).

Samples:

The samples included in this review are listed below:

Client Sample ID	Laboratory Sample ID	Collection Date	Matrix	Sample Status
GM-38-GW-RW3-MW4-1022	R2209606-001	10/4/2022	Water	
GM-38-GW-RW3-MW3-1022	R2209606-002	10/4/2022	Water	
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	10/4/2022	Water	Field Duplicate of sample GM-38-GW-RW3-MW3-1022
GM-38-GW-RW3-MW2-1022	R2209606-004	10/4/2022	Water	
GM-38-GW-RW3-MW1-1022	R2209606-005	10/4/2022	Water	
GM-38-EB-1022	R2209606-006	10/4/2022	Water	Equipment Blank
GM-38-GW-TP01-1022	R2209606-007	10/4/2022	Water	
GM-38-GW-RW1-MW1-1022	R2209606-008	10/5/2022	Water	
GM-38-GW-RW2-MW1-1022	R2209606-009	10/5/2022	Water	
GM-38-GW-RW1-MW3-1022	R2209606-010	10/5/2022	Water	

Sample Conditions/Problems:

1. The Traffic Reports/Chain-of-Custody Records, Sampling Report and/or Laboratory Case Narrative did not indicate any problems with sample receipt, condition of samples, analytical problems or special circumstances affecting the quality of the data. No qualifications were required.

Holding Times:

1. All water samples were analyzed within the 7 days holding times for Solids, Total Suspended. No qualifications were required.

Method Blank (MB), Storage Blank (SB), Field Blank (FB), Rinsate Blank (RB) and Equipment Blank (EB):

1. Method Blank (R2209606-MB) analyzed on 10/11/2022 was free of contamination. No qualifications were required.

2. Equipment Blank (GM-38-EB-1022) (R2209606-006) analyzed on 10/4/2022 was free of contamination. No qualifications were required.

Field Duplicate:

1. Sample GM-38-GW-RW3-MW3-DUP-1022 (R2209606-003) was collected as field duplicate for sample GM-38-GW-RW3-MW3-1022 (R2209606-002). Results for TSS were non-detect in the field duplicate pair. No qualifications were required.

Laboratory Control Sample (LCS)/ Laboratory Control Sample Duplicate (LCSD):

1. Mercury %REC in Laboratory Control Sample analyzed on 10/11/2022 was within the laboratory control limits. No qualifications were required.

Laboratory Duplicate:

1. Sample Duplicate was performed on sample GM-38-GW-RW3-MW4-1022 (R2209606-001). TSS RPD was inside the laboratory control limits. No qualifications were required.

Compound Quantitation and Reported Detection Limits:

1. All sample results were reported within the linear calibration range.

Comments:

1. Validation qualifiers (if required) were entered into the EDD for SDG: R2209606.
2. Summary of the qualified data is listed in the Qualification Summary Table for SDG: R2209606 at the end of the data validation report.

NWIRP BETHPAGE, GM-38 AREA LTM
OCTOBER 2022
QUALIFICATION SUMMARY TABLE
GROUNDWATER
SDG: R2209606
VOCs, MERCURY, and TSS

Sample Name	Lab ID	Analytical Method	Analyte	Unit	Reported Result	Lab Qualifier	Validated Value	DV Qualifier	Reason Code
GM-38-GW-RW3-MW3-1022	R2209606-002	E624	Chloroform	ug/l	1	U	1	UJ	FD
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	E624	Chloroform	ug/l	0.291	J	0.291	J	FD

NOTE: Only results that had qualifications added after validation are listed in this table.

Reason Codes

FD = Qualification due to field duplicate criteria exceedance.



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW3-MW4-1022	R2209606-001	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-GW-RW3-MW4-1022	R2209606-001	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	0.591	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	3.41	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	0.765	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Chloroform	0.475	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Tetrachloroethene (PCE)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Trichloroethene (TCE)	4.80	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	cis-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW4-1022	R2209606-001	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW3-MW3-1022	R2209606-002	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-GW-RW3-MW3-1022	R2209606-002	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	0.235	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	1.09	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	0.741	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Chloroform	1.00	UG_L	UJ	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Tetrachloroethene (PCE)	0.533	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Trichloroethene (TCE)	139	UG_L		1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	cis-1,2-Dichloroethene	0.480	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-1022	R2209606-002	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	0.268	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	1.09	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	0.706	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Chloroform	0.291	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Tetrachloroethene (PCE)	0.432	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Trichloroethene (TCE)	136	UG_L		1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	cis-1,2-Dichloroethene	0.508	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW3-DUP-1022	R2209606-003	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW3-MW2-1022	R2209606-004	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.5	MG_L			1.0
GM-38-GW-RW3-MW2-1022	R2209606-004	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	0.299	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Chloroform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Tetrachloroethene (PCE)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Trichloroethene (TCE)	48.2	UG_L		1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	cis-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW2-1022	R2209606-004	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW3-MW1-1022	R2209606-005	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-GW-RW3-MW1-1022	R2209606-005	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Chloroform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Tetrachloroethene (PCE)	1.41	UG_L	J	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Trichloroethene (TCE)	19.4	UG_L		1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	cis-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW3-MW1-1022	R2209606-005	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-EB-1022	R2209606-006	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-EB-1022	R2209606-006	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Chloroform	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Tetrachloroethene (PCE)	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Trichloroethene (TCE)	0.598	UG_L	J	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	cis-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-EB-1022	R2209606-006	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-TP01-1022	R2209606-007	2540D	10/4/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-GW-TP01-1022	R2209606-007	245.1	10/4/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,1,1-Trichloroethane (TCA)	0.333	UG_L	J	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,1-Dichloroethane (1,1-DCA)	0.853	UG_L	J	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,1-Dichloroethene (1,1-DCE)	0.347	UG_L	J	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Chloroform	0.645	UG_L	J	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Tetrachloroethene (PCE)	2.53	UG_L	J	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Trichloroethene (TCE)	10.3	UG_L		1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	cis-1,2-Dichloroethene	0.991	UG_L	J	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-TP01-1022	R2209606-007	624.1	10/4/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW1-MW1-1022	R2209606-008	2540D	10/5/2022	1	Solids, Total Suspended (TSS)	1.7	MG_L			1.0
GM-38-GW-RW1-MW1-1022	R2209606-008	245.1	10/5/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,1,1-Trichloroethane (TCA)	0.645	UG_L	J	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,1-Dichloroethane (1,1-DCA)	3.39	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,1-Dichloroethene (1,1-DCE)	1.03	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Chloroform	0.454	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Tetrachloroethene (PCE)	0.306	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Trichloroethene (TCE)	56.7	UG_L		1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	cis-1,2-Dichloroethene	3.54	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW1-MW1-1022	R2209606-008	624.1	10/5/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW2-MW1-1022	R2209606-009	2540D	10/5/2022	1	Solids, Total Suspended (TSS)	3.3	MG_L			1.0
GM-38-GW-RW2-MW1-1022	R2209606-009	245.1	10/5/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,1,1-Trichloroethane (TCA)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,1,2-Trichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,1-Dichloroethane (1,1-DCA)	2.01	UG_L	J	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,1-Dichloroethene (1,1-DCE)	0.366	UG_L	J	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,2-Dichloroethane	0.366	UG_L	J	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Chloroform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Tetrachloroethene (PCE)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Trichloroethene (TCE)	3.22	UG_L	J	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	cis-1,2-Dichloroethene	4.36	UG_L	J	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW2-MW1-1022	R2209606-009	624.1	10/5/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0
GM-38-GW-RW1-MW3-1022	R2209606-010	2540D	10/5/2022	1	Solids, Total Suspended (TSS)	1.0	MG_L	U		1.0
GM-38-GW-RW1-MW3-1022	R2209606-010	245.1	10/5/2022	1	Mercury	0.10	UG_L	U	0.10	0.20
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,1,1-Trichloroethane (TCA)	0.606	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,1,2,2-Tetrachloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,1,2-Trichloroethane	0.323	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,1-Dichloroethane (1,1-DCA)	3.13	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,1-Dichloroethene (1,1-DCE)	0.774	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,2-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,2-Dichloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,2-Dichloropropane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,3-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,4-Dichlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Acrylonitrile	100	UG_L	U		100
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Benzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Bromodichloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Bromoform	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Bromomethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Carbon Tetrachloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Chlorobenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Chloroethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Chloroform	0.583	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Chloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Dibromochloromethane	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Methylene Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Ethylbenzene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Tetrachloroethene (PCE)	0.389	UG_L	J	1.00	5.00



**NWIRP BETHPAGE GM-38 AREA LT,
OCTOBER 2022 EVENT
DATA SUMMARY TABLE
AQUEOUS
SDG: R2209606**

Sample Name	Lab ID	Analytical Method	Collection Date	Dilution Factor	Analyte	Result	Unit	Qualifier	LOD	LOQ
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Toluene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Trichloroethene (TCE)	2.91	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Trichlorofluoromethane (CFC 11)	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	Vinyl Chloride	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	cis-1,2-Dichloroethene	0.297	UG_L	J	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	cis-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	trans-1,2-Dichloroethene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	trans-1,3-Dichloropropene	1.00	UG_L	U	1.00	5.00
GM-38-GW-RW1-MW3-1022	R2209606-010	624.1	10/5/2022	1	1,3-Dichloropropene, Total	10.0	UG_L	U		10.0