


SCALE VERIFICATION: THIS BAR MEASURES 1" ON ORIGINAL. ADJUST SCALE ACCORDINGLY.

No	Revision	Date	Initial

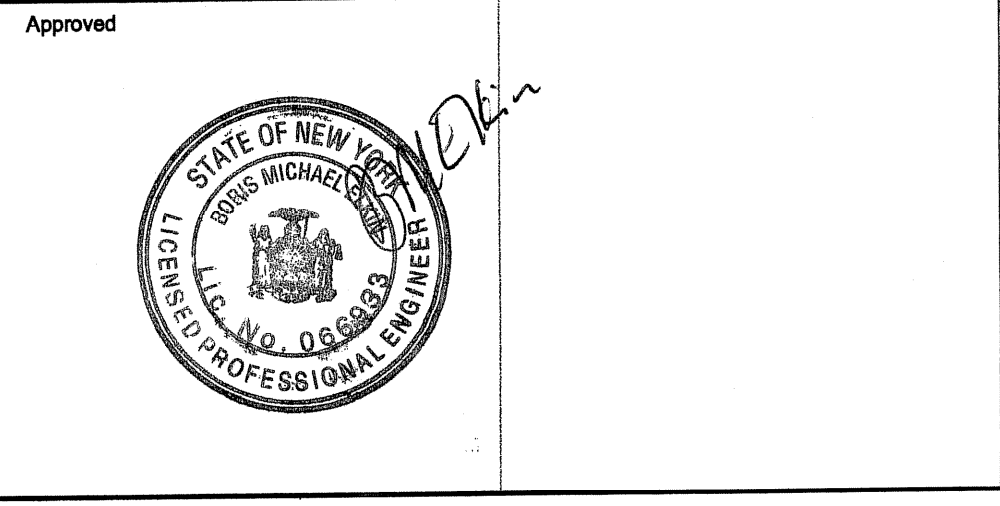

HOOKER/RUCO SITE  
HICKSVILLE, NEW YORK

BIOSPARGE TREATMENT SYSTEM

INJECTION WELL IW-5  
REMOTE I/O PANEL WIRING DIAGRAM

CRA Infrastructure & Engineering, Inc.

Source Reference:	Date:
Project Manager:	Reviewed By:
J.KAY	BME/TFP
Designed By:	Drawn By:
D. SZALACH	J.D.N.
Scale:	Project No:
NONE	06883-10
Report No:	Drawing No:
045	E-16 SHT.5

06883-10(045)EL-NF018 MAY 26/2005