

**ISLIP
RESOURCE
RECOVERY
AGENCY**


ISLIP, NEW YORK



**Sonia Road Landfill
Town of Islip, New York**

**Post Closure Groundwater
Monitoring Program
Quarterly Sampling Results
Second Quarter 2004
(Baseline Sampling Event)**

August 2004



DVIRKA AND BARTILUCCI
CONSULTING ENGINEERS
A DIVISION OF WILLIAM F. CONLICH ASSOCIATES, P.C.

**POST CLOSURE GROUNDWATER MONITORING PROGRAM
QUARTERLY SAMPLING RESULTS
SECOND QUARTER 2004**

(BASELINE SAMPLING EVENT)

**SONIA ROAD LANDFILL
WEST BRENTWOOD, NEW YORK**

PREPARED FOR

**ISLIP RESOURCE RECOVERY AGENCY
TOWN OF ISLIP, NEW YORK**

BY

**DVIRKA AND BARTILUCCI CONSULTING ENGINEERS
WOODBURY, NEW YORK**

AUGUST 2004

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
QUARTERLY SAMPLING RESULTS
SECOND QUARTER 2004
(BASELINE SAMPLING EVENT)**

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	INTRODUCTION	1-1
1.1	Purpose.....	1-1
1.2	Site Location and Description.....	1-1
2.0	MONITORING WELL NETWORK AND GROUNDWATER SAMPLE LOCATIONS	2-1
3.0	SAMPLING AND ANALYTICAL PROCEDURES	3-1
3.1	Groundwater Level Measurement.....	3-1
3.2	Groundwater Sampling.....	3-1
3.3	Organic Vapor and Combustible Gas Monitoring.....	3-2
3.4	Analytical Parameters.....	3-3
4.0	ANALYTICAL RESULTS	4-1
4.1	Field Parameters.....	4-1
4.2	Groundwater Samples.....	4-1
4.2.1	Leachate Indicators.....	4-1
4.2.2	Historic Leachate Indicators.....	4-3
4.2.3	Inorganic Parameters.....	4-7
4.2.4	Historic Inorganic Parameters.....	4-8
4.2.5	Volatile Organic Compounds.....	4-17
4.3	Organic Vapor and Combustible Gas Monitoring.....	4-18
5.0	DATA VALIDATION	5-1
6.0	GROUNDWATER LEVEL MEASUREMENTS AND FLOW DIRECTION	6-1

TABLE OF CONTENTS (continued)

<u>Section</u>	<u>Title</u>	<u>Page</u>
7.0	CONCLUSIONS AND RECOMMENDATIONS	7-1
7.1	Conclusions.....	7-1
7.2	Recommendations.....	7-2

List of Appendices

	Historic and Current Groundwater Sample Results - Leachate Indicators	A-1
	Historic and Current Groundwater Sample Results - Inorganic Parameters.....	A-2
	Historic and Current Groundwater Sample Results – Volatile Organic Compounds	A-3
	Historic Trend Graphs - Alkalinity, Iron Plus Manganese, Total Dissolved Solids and Specific Conductivity Results from Selected Monitoring Wells	A-4
	Field Forms - Field Observation Logs.....	B-1
	Field Forms - Daily Equipment Calibration Logs	B-2
	Chain-of-Custody Forms	C
	Data Validation Forms.....	D

List of Figures


1-1	Site Location Map.....	1-2
2-1	Groundwater Monitoring Well Locations.....	2-2
6-1	Water Table Elevation Contour Map – May 19, 2004.....	6-4
6-2	Intermediate Depth Potentiometric Surface Elevation Contour Map - May 19, 2004.....	6-5
6-3	Deep Potentiometric Surface Elevation Contour Map - May 19, 2004	6-6

TABLE OF CONTENTS (continued)

List of Tables

2-1	Summary of Monitoring Well Construction Details.....	2-3
2-2	Wells Sampled as Part of the Post Closure Groundwater Monitoring Program	2-6
4-1	Summary of Final Field Parameter Results and Field Data - Second Quarter 2004	4-2
4-2	Summary of Concentration Trends for Leachate Indicator Parameters - Second Quarter 2004.....	4-4
4-3	Summary of Concentration Trends for Inorganic Parameters - Second Quarter 2004	4-9
6-1	Monitoring Well Groundwater Elevation Measurements - Second Quarter 2004 – May 19, 2004	6-2

Section 1



1.0 INTRODUCTION

This report presents the results of the Post Closure Groundwater Monitoring Program conducted during the second quarter 2004 for the Sonia Road Landfill. The sampling program was conducted for the Town of Islip and administered by the Islip Resource Recovery Agency (IRRA) in conformance with the Sampling and Analysis Plan (SAP) prepared by Dvirka and Bartilucci Consulting Engineers (D&B), dated December 2001. The Sampling and Analysis Plan is part of the Sonia Road Post Closure Monitoring and Maintenance Plan (Volume 3 of 4).


1.1 Purpose

The purpose of the Post Closure Groundwater Monitoring Program is to monitor groundwater quality and flow direction following capping and closure of the Sonia Road Landfill.

This Post Closure Groundwater Monitoring Program Report includes discussions of the sample locations, sampling procedures, laboratory analyses, field and analytical results, data validation, groundwater level measurements and flow direction. In addition, this report includes a comparison of the analytical results of this sampling event (May 2004) to applicable New York State groundwater quality standards and guidance values, and groundwater sample results obtained during previous sampling events (first quarter 2004 routine sampling event and third quarter 2003 baseline sampling event).

1.2 Site Location and Description

The Sonia Road Landfill is a capped and closed inactive municipal solid waste landfill owned by the Town of Islip. The landfill is located at 1355 Howells Road in the hamlet of Brentwood in the western portion of the Town and is in close proximity to the western town boundary between the Towns of Islip and Babylon. The location of the Sonia Road Landfill is shown on Figure 1-1.

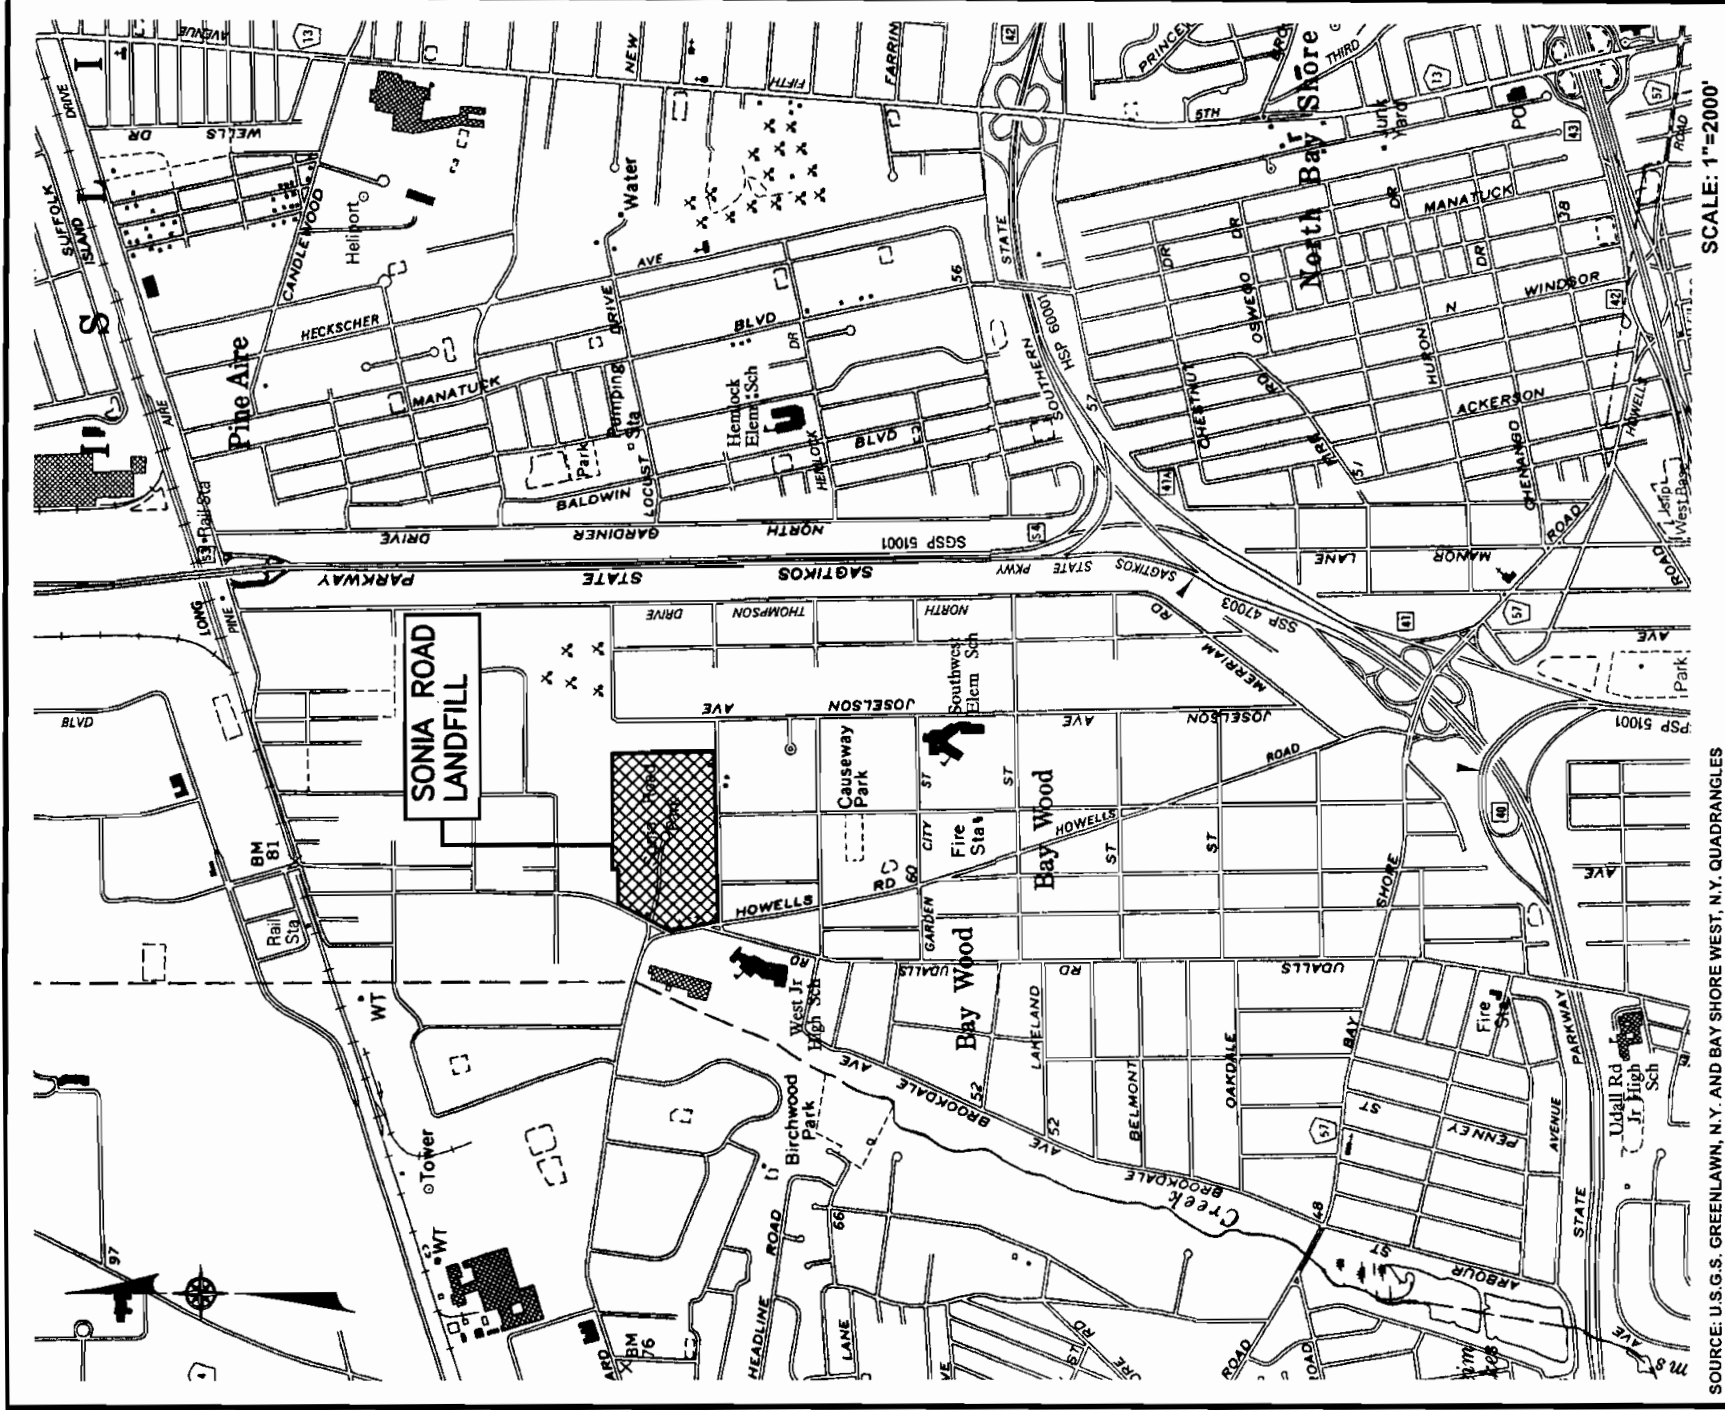

SOURCE: U.S.G.S. GREENLAWN, N.Y. AND BAY SHORE WEST, N.Y. QUADRANGLES

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 SITE LOCATION MAP



FIGURE No.1-1

The landfill property is 42.2 acres in area and is approximately rectangular in shape. The landfill is bounded to the north by industrial properties, to the east by residential properties, to the south by Deer Park Street with residential properties beyond, and to the west by Howell's Road, Secatogue Road and Corbin Avenue with industrial properties beyond. In the southwest corner of the site is one residential parcel (Tax Map No. 221-2-1), which is not part of landfill property described above. At the northwest corner of the property is a 0.5-acre parcel owned by the Town of Islip (Tax Map No. 198-5-7.3), which is identified as a paper street. Given that the waste mass extends onto this parcel, it is considered as part of the landfill property, and as a result, the overall landfill property is considered to be 42.7 acres. At and abutting the northeast corner of the landfill property is the western extension of Sonia Road for which the facility is named.

The landfill property itself is zoned Industrial I and Industrial II with a small portion along the southeastern boundary zoned as residential.

To the southwest of the landfill property is the West Brentwood Middle School, which is located on the west side of Howell's Road. Beyond the school property to the south and west is the headwaters of Sampawams Creek. Sampawams Creek is fed by groundwater discharge as well as storm water drainage systems for the surrounding areas. Sampawams Creek runs from north to south and discharges into the Guggenheim Lakes, which are located north of the Southern State Parkway. Sampawams Creek generally describes the western boundary of the Town of Islip and the eastern boundary of the Town of Babylon.

The Sonia Road Landfill has been owned by the Town of Islip since 1965. Prior to 1965, the site was privately owned and used as a source of mined sand and gravel. As a result of this mining operation, virtually all of the site was disturbed, including the removal of vegetation, topsoil and underlying minerals. The mining operation was extensive with the removal of minerals progressing to and below the water table. Removal of minerals below the water table was accomplished through the use of dredging equipment. This activity resulted in the formation of a groundwater lake over a significant portion (40% to 50%) of the site. It is reported that dredging may have removed materials to a depth of 50 feet below the water table. Soil borings

constructed as part of the remedial investigation confirmed that waste lies at least 36 feet below the water table.

In 1965, the Town of Islip took title to the Sonia Road property and began a landfilling operation for the disposal of municipal solid waste. Landfilling of the site occurred between 1965 and 1977. The most active period of landfilling occurred between 1965 and 1974. It has been estimated that between 1.5 and 2.0 million cubic yards of waste was disposed of at the site. There are no weigh records to substantiate this estimate.

The landfill reportedly accepted all municipal solid waste delivered to the site. This waste is reported to have included wood, concrete, metal, plastic, glass, household waste in the form of refuse, rubbish, demolition materials and yard wastes (particularly leaves). It is also reported that junk automobiles were routinely disposed at the facility and that underground fires were common.

The Sonia Road Landfill was capped in the Fall of 2000. The landfill capping system covers an area of approximately 40 acres. The capping system includes an active landfill gas management system, an on-site storm water management system and a perimeter road constructed around the entire site, surfaced with recycled concrete aggregate. The storm water management system consists of a series of drainage swales, catch basins, buried storm water piping, dry wells and two recharge basins. Storm water associated with the northeast corner of the property is discharged to a series of dry wells (leaching rings) in the area of Sonia Road. The remainder of the site storm water is directed to Recharge Basins 1 and 2 located on the west side of the property. Recharge Basin 1 is located adjacent to the main entrance gate located on Corbin Avenue and Recharge Basin 2 is located in the southwest corner of the property. For the majority of the site, drainage swales are located on the in-board side of the perimeter road.

Section 2


A thick black horizontal line spans the width of the page. It features a diagonal step that descends from the right side to the left side, positioned approximately one-fifth of the way across the page from the right edge.

2.0 MONITORING WELL NETWORK AND GROUNDWATER SAMPLE LOCATIONS

The monitoring well network for the Sonia Road Landfill consists of 36 wells. Well locations are shown on Figure 2-1. The monitoring wells were constructed in 12 well clusters, with each cluster comprising a shallow (S) well, intermediate (I) well and deep (D) well. All 36 wells are utilized for water level measurements. Well construction information for all wells is summarized in Table 2-1.

Twenty-three (23) wells are included as part of the Post Closure Monitoring Program. The sampled wells are listed in Table 2-2.

Twenty-two (22) of the 23 monitoring wells were sampled as part of the second quarter 2004 Post Closure Groundwater Sampling event. Monitoring well MW-02S could not be sampled due to a well casing obstruction at approximately 23 feet below ground surface.

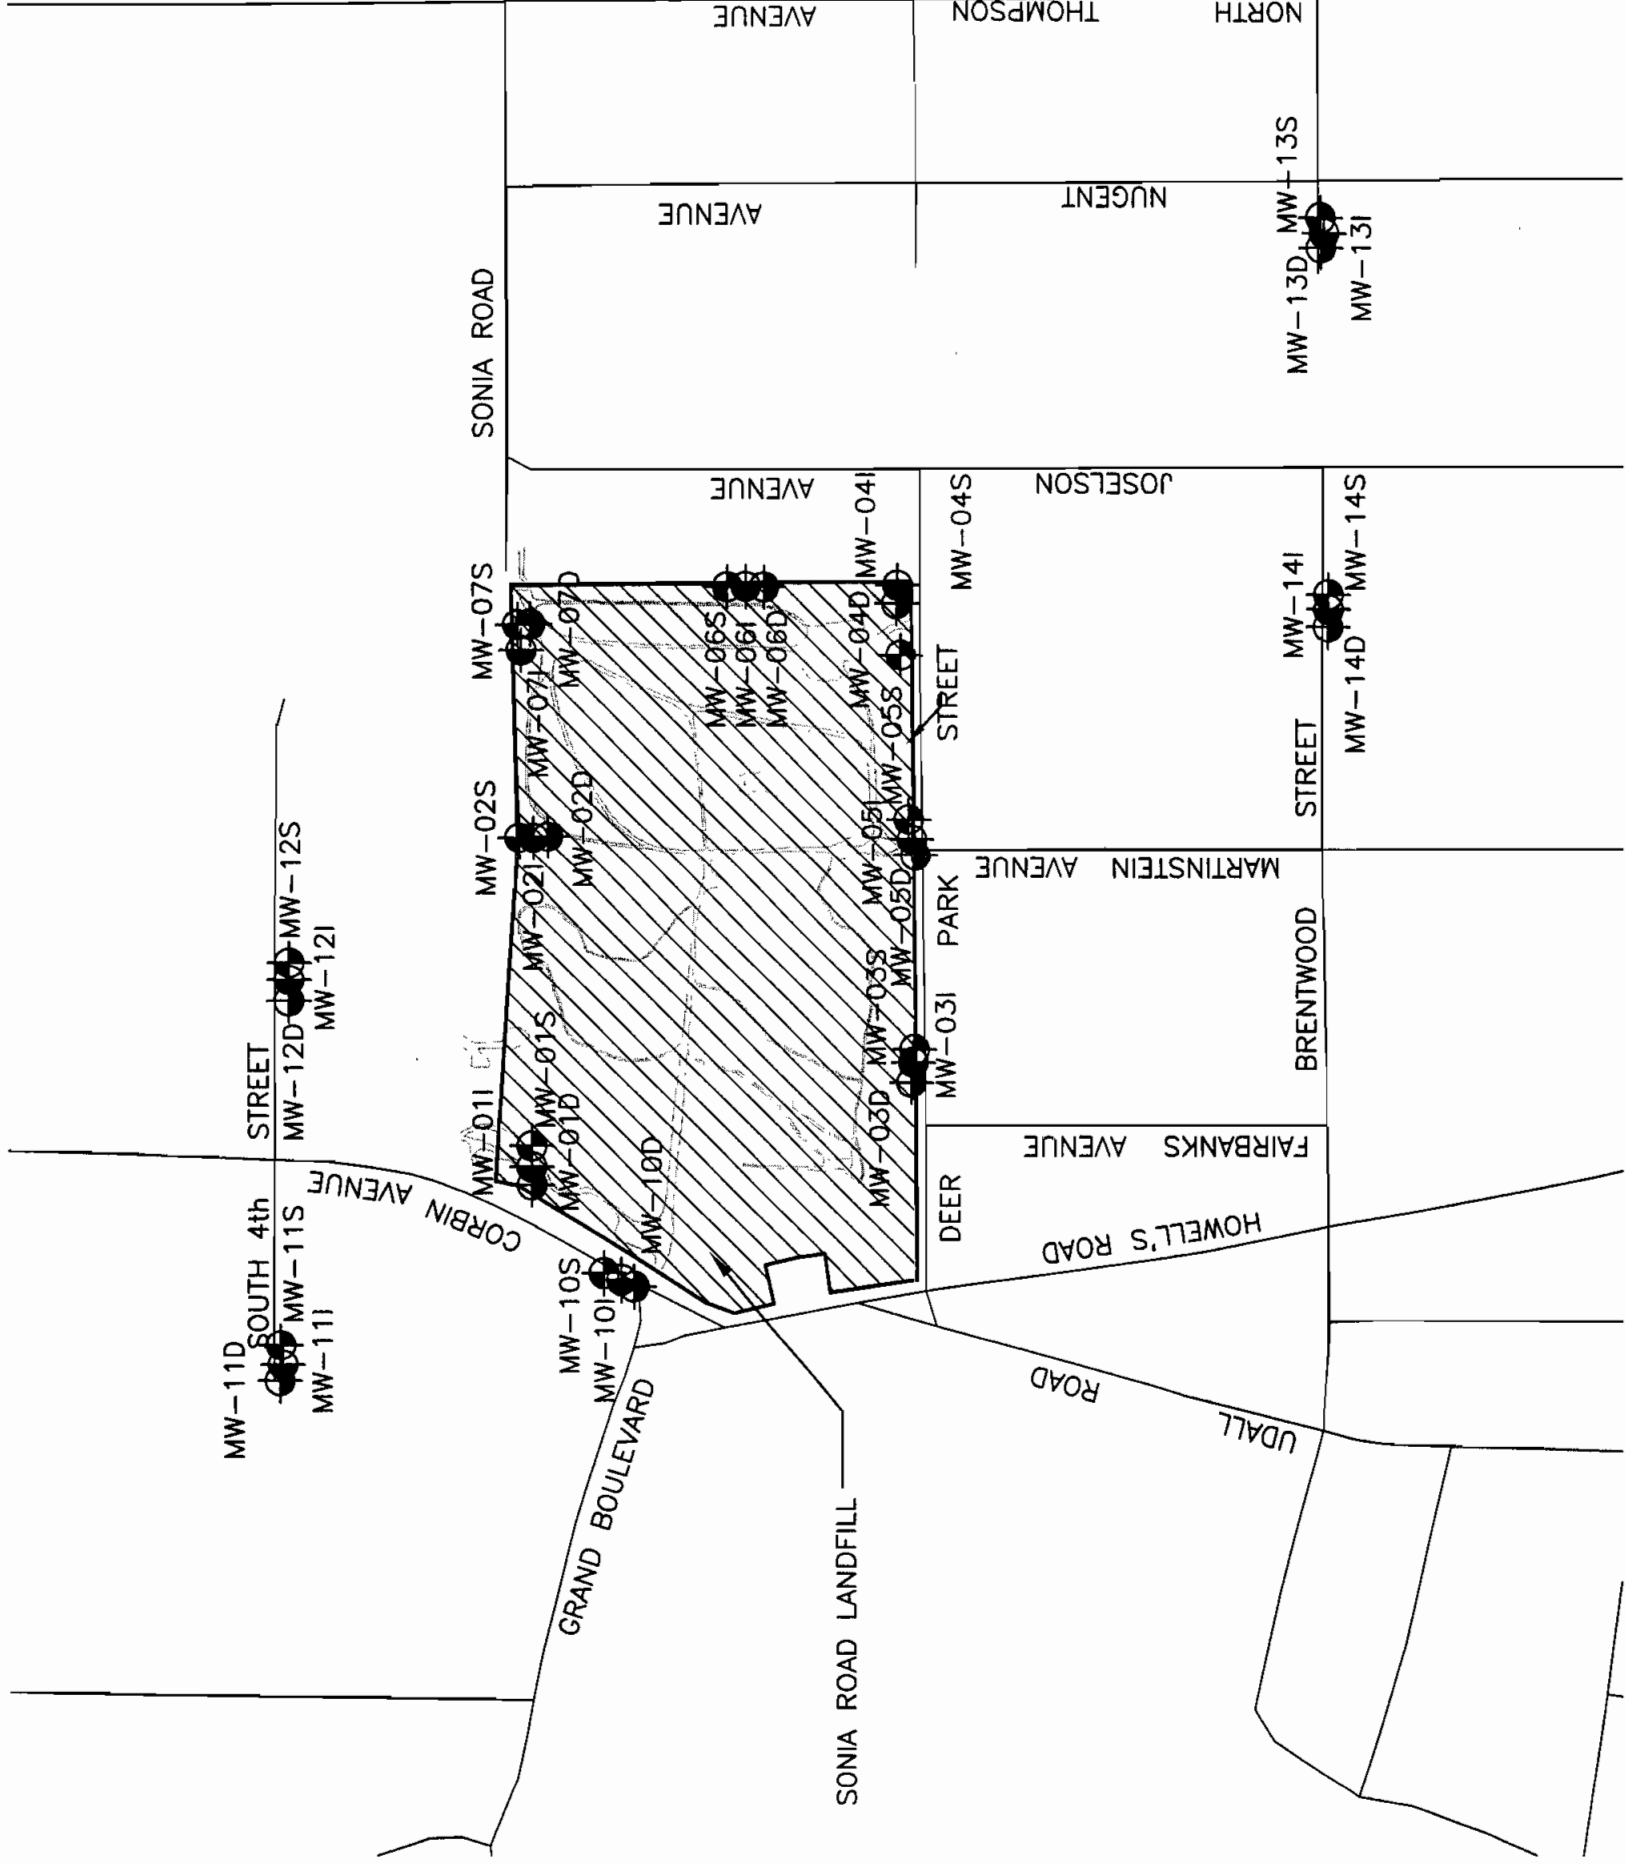

LEGEND:

- GROUNDWATER MONITORING WELL AND DESIGNATION
- MW-10S



Table 2-1

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
SUMMARY OF MONITORING WELL CONSTRUCTION DETAILS**

MONITORING WELLS

Well Designation	Date Completed	Well Diameter (inches)	Screen Type	Total Depth (feet below ground surface)	Elevation Below Measurement Point (feet)	Elevation Relative to Mean Sea Level (feet)	Measuring Point Elevation (feet above mean sea level)
----- Screen Setting -----							
MW-01D ⁽¹⁾	10/14/97	4	SS	106	96-106	(-32) - (-42)	64.53
MW-01I ⁽¹⁾	10/6/97	4	SS	78	68 - 78	(-2) - (-12)	65.36
MW-01S ⁽¹⁾	1/5/95	4	PVC	29	19-29	47 - 37	66.01
MW-02D ⁽¹⁾	10/13/97	4	SS	116	106 - 116	(-27) - (-37)	79.01
MW-02I ⁽¹⁾	10/1/97	4	SS	72	62 - 72	16 - 7	78.75
MW-02S ⁽¹⁾	1/4/95	4	PVC	43	33 - 43	45 - 35	77.98
MW-03D ⁽¹⁾	9/30/97	4	SS	107	97 - 107	(-26) - (-36)	70.50
MW-03I ⁽¹⁾	1/9/95	4	PVC	84	79 - 84	(-8) - (-13)	70.77
MW-03S ⁽¹⁾	1/6/95	4	PVC	32	22 - 32	49 - 39	70.76
MW-04D ⁽¹⁾	10/6/97	4	SS	114	104 - 114	(-35) - (-45)	69.03
MW-04I ⁽¹⁾	9/29/97	4	SS	71	61 - 71	8 - (-2)	69.31
MW-04S ⁽¹⁾	1/6/95	4	PVC	34	24 - 34	48 - 38	71.10
MW-05D ⁽¹⁾	10/10/97	4	SS	116	106 - 116	(-35) - (-45)	70.96
MW-05I ⁽¹⁾	10/2/97	4	SS	70	60 - 70	11 - 1	70.26
MW-05S ⁽¹⁾	10/4/97	4	SS	34	19 - 34	52 - 37	70.28

Table 2-1 (continued)

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 SUMMARY OF MONITORING WELL CONSTRUCTION DETAILS

MONITORING WELLS

Well Designation	Date Completed	Well Diameter (inches)	Screen Type	Total Depth (feet below ground surface)	Elevation Below Measurement Point (feet)	Elevation Relative to Mean Sea Level (feet)	Measuring Point Elevation (feet above mean sea level)
MW-06D ⁽¹⁾	10/1/97	4	SS	117	107 - 117	(-32) - (-42)	75.03
MW-06I ⁽¹⁾	9/25/97	4	SS	76	66 - 76	9 - (-1)	74.53
MW-06S ⁽¹⁾	9/24/97	4	SS	37	22 - 37	53 - 38	74.45
MW-07D ⁽¹⁾	10/8/97	4	SS	122	112 - 122	(-37) - (-47)	75.04
MW-07I ⁽¹⁾	9/26/97	4	SS	74	64 - 74	9 - (-1)	73.45
MW-07S ⁽¹⁾	9/28/97	4	SS	34	19 - 34	54 - 39	72.83
MW-10D ⁽²⁾	10/15/97	4	SS	96	86 - 96	(-29) - (-39)	56.34
MW-10I ⁽²⁾	10/7/97	4	SS	69	59 - 69	(-3) - (-13)	56.16
MW-10S ⁽²⁾	10/8/97	4	SS	19	4 - 19	53 - 38	56.65
MW-11D ⁽¹⁾	10/16/97	4	SS	94	84 - 94	(-24) - (-34)	60.19
MW-11I ⁽¹⁾	10/11/97	4	SS	71	61 - 71	(-1) - (-11)	60.38
MW-11S ⁽¹⁾	10/13/97	4	SS	19	4 - 19	56 - 41	59.87
MW-12D ⁽¹⁾	10/15/97	4	SS	98	88 - 98	(-29) - (-39)	58.61
MW-12I ⁽¹⁾	10/10/97	4	SS	70	60 - 70	(-1) - (-11)	58.92
MW-12S ⁽¹⁾	10/13/97	4	SS	19	4 - 19	55 - 40	58.79

Table 2-1 (continued)

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 SUMMARY OF MONITORING WELL CONSTRUCTION DETAILS

MONITORING WELLS

Well	Designation	Date Completed	Well Diameter (inches)	Screen Type	Total Depth (feet below ground surface)	Elevation Below Measurement Point (feet)	Elevation Relative to Mean Sea Level (feet)	Measuring Point Elevation (feet above mean sea level)
MW-13D ⁽³⁾	MW-13I ⁽³⁾	10/16/97	4	SS	119	109 - 119	(-38) - (-48)	70.37
MW-14D ⁽³⁾	MW-14I ⁽³⁾	10/17/97	4	SS	105	95 - 105	(-30) - (-40)	64.58
MW-13S ⁽³⁾	MW-13I ⁽³⁾	10/8/97	4	SS	37	22 - 37	49 - 34	70.51
MW-14S ⁽³⁾	MW-14I ⁽³⁾	10/14/97	4	SS	30	15 - 30	50 - 35	64.55

Notes:

PVC Polyvinyl chloride
 SS Stainless steel

⁽¹⁾Monitoring wells surveyed by Municipal Land Survey, P.C., August 2001.
⁽²⁾Monitoring wells surveyed by YEC, Inc., November 1997.
⁽³⁾Monitoring wells surveyed by YEC, Inc., September 2000.


Wells identified in **bold type** were modified during the construction of the landfill capping system to adjust the top of the well (reference point) to accommodate the thickness of the capping system. Wells MW-11S, MW-11I and MW-11D were modified to address grade changes at the well locations. SOURCE: Dvirka and Bartiucci Remedial Investigation/Feasibility Study (RI/FIS) dated April 1998 and surveys noted above.

Table 2-2

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
WELLS SAMPLED AS PART OF THE POST CLOSURE
GROUNDWATER MONITORING PROGRAM**

MW-01D	MW-03S	MW-05S	MW-11I
MW-01I	MW-04D	MW-06D	MW-11S
MW-01S	MW-04I	MW-06I	MW-12D
MW-02D	MW-04S	MW-06S	MW-12I
MW-02I	MW-05D	MW-07I	MW-12S
MW-02S	MW-05I	MW-11D	

Section 3



3.0 SAMPLING AND ANALYTICAL PROCEDURES

Sampling procedures for the Sonia Road Landfill site are described in the Sampling and Analysis Plan (SAP). Dedicated and disposable sampling equipment was used whenever possible in accordance with the SAP. All nondisposable equipment was decontaminated before first use on-site and between uses in accordance with the procedures described in the SAP. The following sections provide brief discussions of the procedures used during groundwater level measurements, organic vapor and combustible gas monitoring, groundwater sampling and sample analysis.

3.1 Groundwater Level Measurement

Prior to collecting the groundwater samples, synoptic water level measurements were obtained from all 36 monitoring wells for determination of groundwater elevations and groundwater flow direction. Groundwater level measurements were obtained from a survey measuring point on each well using an electronic water level indicator to an accuracy of 0.01 foot. A discussion of the groundwater level measurement results and groundwater flow direction is provided in Section 6.0.

3.2 Groundwater Sampling

Prior to collection of each groundwater sample, 3 to 5 well volumes were purged from the well. Well purging was accomplished by first measuring the static water level in the well and calculating the standing water volume. A decontaminated submersible pump was used to purge each well.

During the purging process, field parameters (pH, specific conductance, temperature, oxidation-reduction potential (Eh), dissolved oxygen and turbidity) were monitored and recorded. When the values of the field parameters, except turbidity, equilibrated within 10% based on the last two readings, the turbidity of the groundwater was less than 50 Nephelometric

Turbidity Units (NTUs) and at least three well volumes had been removed, well purging was considered complete.

Groundwater samples were collected using new, dedicated, disposable polyethylene bailers and polypropylene rope. Samples were collected immediately after purging. Filled sample bottles were stored in ice-filled coolers with the chain-of-custody forms and delivered on the day of collection to H2M Laboratories, Inc. for analysis. H2M Laboratories, Inc. is approved by the New York State Department of Health under the Environmental Laboratory Approval Program (ELAP) for the analyses performed.

Appropriate quality assurance/quality control (QA/QC) samples, which included field blanks, matrix spike and matrix spike duplicate (MS/MSD) sets and blind duplicates, were collected in accordance with the SAP. Trip blank samples accompanied all laboratory coolers.

Purge water from all on-site wells and all wells immediately adjacent to the landfill property was disposed directly into the nearest landfill capping system drainage swale. Purge water generated from off-site well clusters 11 and 12 was pumped into a tank truck, transported to the landfill and discharged into the landfill's on-site Recharge Basin 1 in accordance with the SAP.

Analytical results are summarized in Appendix A and are discussed in Section 4.2. Field forms for the second quarter 2004 sampling event, including field observation logs and daily equipment calibration logs, are contained in Appendices B-1 and B-2, respectively, and the chain-of-custody forms are provided in Appendix C.

3.3 Organic Vapor and Combustible Gas Monitoring

Total organic vapor and combustible gas measurements were collected in all 36 monitoring wells. Organic vapors were measured using a flame ionization detector (FID). Combustible gas was measured using a portable multi-gas meter. Gas monitoring results represent headspace measurements collected during the synoptic groundwater level

measurements. The results of the organic vapor and combustible gas monitoring are provided in Section 4.3.

3.4 Analytical Parameters

Groundwater samples collected during the second quarter 2004 sampling event were analyzed for 6 NYCRR Part 360 Baseline Parameters, including leachate indicators, inorganic parameters and volatile organic compounds (VOCs). The leachate indicators include alkalinity, ammonia, biochemical oxygen demand, bromide, chemical oxygen demand, chloride, total hardness (as CaCO₃), nitrate, total phenols, sulfate, total organic carbon, total dissolved solids and total kjeldahl nitrogen. Samples were analyzed in accordance with SW-846 methods as specified in the NYCRR Part 360 regulations. The analytical results for the groundwater samples are discussed in Section 4.2.

Section 4



4.0 ANALYTICAL RESULTS

4.1 Field Parameters

Table 4-1 provides a summary of the final field parameter values and field data measured for the second quarter 2004 sampling event.

4.2 Groundwater Samples

The second quarter 2004 analytical results for the groundwater samples, compared to NYSDEC Class GA groundwater standards and guidance values and to previous sample results, are provided in Appendices A-1 (leachate indicator parameters), A-2 (inorganic parameters) and A-3 (VOCs). Appendix A-4 contains historic trend graphs for alkalinity iron plus manganese, total dissolved solids and specific conductivity from selected upgradient and downgradient monitoring wells.

4.2.1 Leachate Indicators

The results of the leachate indicators for the groundwater samples are presented in Appendix A-1. As shown in the results table in Appendix A-1, two leachate indicator parameters, ammonia and chloride, were detected at concentrations exceeding Class GA standards in 6 of the 22 wells sampled during the second quarter 2004 sampling event. The remaining 16 wells did not contain any leachate indicator parameters at concentrations exceeding Class GA groundwater standards or guidance values. The leachate indicators that exceeded the Class GA standards are discussed below.

Ammonia

The groundwater standard for ammonia (2 milligrams per liter [mg/l]) was exceeded in five (5) wells (MW-04S, MW-04I, MW-04D, MW-05I and MW-06S). Ammonia concentrations in these wells ranged from 4.06 mg/l in well MW-04I to 6.45 mg/l well MW-04S.

Table 4-1

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
SUMMARY OF FINAL FIELD PARAMETER RESULTS AND FIELD DATA –
SECOND QUARTER 2004**

Monitoring Well	pH	Temperature (°C)	Specific Conductance (mS/cm)	Turbidity (NTU)	DO (mg/l)	Eh (mV)	Organic Vapor Screening and Combustible Gas Reading	
							FID (ppm)	% LEL
MW-01D	5.63	12.59	2.45	2.7	6.35	262	0	0
MW-01I	6.31	13.98	0.175	7.3	3.25	163	0	0
MW-01S	6.04	13.77	0.587	0.1	3.74	75	0	0
MW-02D	5.49	17.40	0.101	0.4	8.25	303	0	0
MW-02I	5.59	15.72	0.139	14.3	5.74	257	0	0
MW-02S	NS	NS	NS	NS	NS	NS	0	0
MW-03D	NS	NS	NS	NS	NS	NS	0	0
MW-03I	NS	NS	NS	NS	NS	NS	0	0
MW-03S	6.53	16.80	0.516	15.1	4.10	-51	0	0
MW-04D	6.65	13.95	0.470	10.3	2.50	-91	0	0
MW-04I	6.28	14.93	0.637	5.1	2.70	-41	0	0
MW-04S	6.32	14.37	0.813	20.1	4.15	-30	0	0
MW-05D	6.10	14.35	0.211	0.1	4.40	332	0	0
MW-05I	6.46	16.51	0.428	48.0	1.98	53	0	0
MW-05S	6.16	16.65	0.316	27.6	5.08	30	0	0
MW-06D	5.80	14.45	0.113	5.8	2.02	31	0	0
MW-06I	5.81	15.59	0.216	3.2	2.30	20	0	0
MW-06S	6.27	16.76	0.470	9.2	2.61	-46	0	0
MW-07D	NS	NS	NS	NS	NS	NS	0	0
MW-07I	5.50	15.01	0.186	0.1	5.91	231	0	0
MW-07S	NS	NS	NS	NS	NS	NS	0	0
MW-10D	NS	NS	NS	NS	NS	NS	0	0
MW-10I	NS	NS	NS	NS	NS	NS	0	0
MW-10S	NS	NS	NS	NS	NS	NS	0	0
MW-11D	5.50	14.21	0.150	30.1	7.16	333	0	0
MW-11I	6.00	15.65	0.131	3.7	4.85	307	0	0
MW-11S	6.58	12.00	0.462	0.1	3.75	279	0	0
MW-12D	5.47	14.00	0.056	0.1	9.37	321	0	0
MW-12I	5.16	15.43	0.053	0.1	8.45	338	0	0
MW-12S	6.58	14.00	0.338	16.2	7.21	341	0	0
MW-13D	NS	NS	NS	NS	NS	NS	0	0
MW-13I	NS	NS	NS	NS	NS	NS	0	0
MW-13S	NS	NS	NS	NS	NS	NS	0	0
MW-14D	NS	NS	NS	NS	NS	NS	0	0
MW-14I	NS	NS	NS	NS	NS	NS	0	0
MW-14S	NS	NS	NS	NS	NS	NS	0	0

Notes:

- ppm: parts per million
- °C: Degrees Celsius
- FID: Flame Ionization Detector
- mS/cm: Millisiemens per centimeter
- LEL: Lower Explosive Limit
- NTU: Nephelometric Turbidity Unit
- mV: Millivolt
- DO: Dissolved oxygen
- Eh: Oxidation-reduction potential
- mg/l: Milligrams per liter
- NS: Not sampled

Final field parameter readings were measured upon completion of sample collection.

Chloride

The groundwater standard for chloride (250 mg/l) was exceeded in MW-01D, which contained a chloride concentration of 656 mg/l.

4.2.2 Historic Leachate Indicators

A comparison of the leachate indicator results in the 22 wells sampled between the second quarter 2004 and the first quarter 2004 sampling events is provided below. Since well MW-02S was not sampled during the second quarter 2004 sampling event, it is not included in the comparison. Concentration trends and exceedances for each well are summarized in Table 4-2. Historic data for leachate indicator parameters are summarized in Appendix A-1.

Alkalinity

Four (4) of the 22 wells sampled showed an increase (defined as a change of at least 20% compared to the previous result) in alkalinity concentrations. The wells that showed an increase are MW-01I, MW-02I, MW-05I and MW-11D. Four (4) wells (MW-06D, MW-07I, MW-11S and MW-11I) showed a decrease (defined as a change of at least 20% compared to the previous result) in alkalinity concentrations. The remaining 14 wells were consistent (defined as within 20% of the previous result).

Ammonia

Eleven (11) wells (MW-01S, MW-01D, MW-02I, MW-03S, MW-04S, MW-04D, MW-05S, MW-05I, MW-06S, MW-11S and MW-12S) showed increasing concentrations of ammonia. Five (5) wells (MW-01I, MW-06I, MW-07I, MW-11D and MW-12I) showed decreasing concentrations. The remaining 6 wells were consistent.

Table 4-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 SUMMARY OF CONCENTRATION TRENDS FOR LEACHATE INDICATOR PARAMETERS - SECOND QUARTER 2004

Well	Location	Alkalinity	Ammonia	Biochemical Oxygen Demand	Bromide	Chemical Oxygen Demand	Chloride	Hardness	Nitrate	Total Phenols	Sulfate	Total Organic Carbon	Total Dissolved Solids	Total Kjeldahl Nitrogen
MW-01S	Upgradient	C	I	C	D	D	I	I	D	C	C	C	D	I
MW-01I	Upgradient	I	D	C	D	D	D	D	I	C	C	C	D	D
MW-01D	Upgradient	C	I	C	C	C	C	I	I	C	C	I	C	C
MW-02I	Upgradient	I	I	D	D	C	D	I	C	C	I	I	I	I
MW-02D	Upgradient	C	C	D	D	I	D	I	C	C	I	C	D	I
MW-03S	Downgradient	C	I	C	D	D	I	I	C	C	I	C	C	C
MW-04S	Downgradient	C	I	D	D	D	I	I	C	C	C	C	C	I
MW-04I	Downgradient	C	C	D	D	D	C	I	C	C	C	C	C	C
MW-04D	Downgradient	C	I	I	D	D	C	I	C	C	D	I	I	C
MW-05S	Downgradient	C	I	D	D	D	I	I	D	C	D	I	C	D
MW-05I	Downgradient	I	I	C	D	D	C	I	D	C	C	C	C	I
MW-05D	Downgradient	C	C	C	D	D	D	C	C	C	I	D	D	C
MW-06S	Sidegradient	C	I	D	D	D	C	I	I	C	I	C	C	I
MW-06I	Sidegradient	C	C	C	C	C	C	I	I	C	D	C	I	C
MW-06D	Sidegradient	D	D	C	D	C	C	I	I	C	I	C	D	C
MW-07I	Upgradient	D	D	D	I	I	C	I	I	C	I	C	I	C
MW-11S	Upgradient	D	I	I	I	I	C	I	I	D	I	C	D	I
MW-11I	Upgradient	D	C	I	I	D	D	I	I	D	D	C	D	C
MW-11D	Upgradient	I	I	C	C	I	D	C	C	C	I	C	D	I
MW-12S	Upgradient	C	C	C	C	D	D	I	C	C	I	C	D	I
MW-12I	Upgradient	C	D	C	C	D	D	C	C	C	I	C	I	D
MW-12D	Upgradient	C	C	C	C	C	D	I	D	C	I	C	I	C

Key: I = Increasing greater than 20%

D = Decreasing greater than 20%

C = Consistent within 20%

Parameter exceeds standard/guidance value during the current sampling event.

Biochemical Oxygen Demand

Four (4) wells (MW-04S, MW-04D, MW-05S and MW-11I) showed increasing concentrations of biochemical oxygen demand. Five (5) wells (MW-02I, MW-02D, MW-04I, MW-06S and MW-07I) showed decreasing concentrations. The remaining 13 wells were consistent.

Bromide

Three (3) wells (MW-07I, MW-11S and MW-11I) showed increasing bromide concentrations. Thirteen (13) wells (MW-01S, MW-01I, MW-02I, MW-02D, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S and MW-06D) showed decreasing concentrations. The remaining 6 wells were consistent.

Chemical Oxygen Demand

Five (5) wells (MW-01D, MW-02D, MW-07I, MW-11S and MW-11D) showed increasing concentrations of chemical oxygen demand. Thirteen (13) wells (MW-01S, MW-01I, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S, MW-11I, MW-12S and MW-12I) showed decreasing concentrations. The remaining 4 wells were consistent.

Chloride

Five (5) wells (MW-01S, MW-03S, MW-04S, MW-05S and MW-06I) showed increasing chloride concentrations. Nine (9) wells (MW-01I, MW-02I, MW-02D, MW-05D, MW-11I, MW-11D, MW-12S, MW-12I and MW-12D) showed decreasing concentrations. The remaining 8 wells were consistent.

Hardness

Nineteen (19) wells (MW-01S, MW-01D, MW-02I, MW-02D, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-06S, MW-06I, MW-06D, MW-07I, MW-11S, MW-11I, MW-11D, MW-12S and MW-12D) showed increasing hardness concentrations. Well MW-01I showed a decrease in hardness concentration. The remaining 2 wells were consistent.

Nitrate

Six (6) wells (MW-01I, MW-01D, MW-06S, MW-06I, MW-06D and MW-07I) showed increasing nitrate concentrations. Seven (7) wells (MW-01S, MW-05S, MW-05I, MW-11S, MW-11I, MW-12I and MW-12D) showed decreasing concentrations. The remaining 9 wells were consistent.

Total Phenols

All sampled wells were consistent.

Sulfate

Sixteen (16) wells (MW-01I, MW-01D, MW-02I, MW-02D, MW-03S, MW-04S, MW-04D, MW-05D, MW-06S, MW-06D, MW-07I, MW-11S, MW-11D, MW-12S, MW-12I and MW-12D) showed increasing sulfate concentrations. Three (3) wells (MW-05S, MW-06I and MW-11I) showed decreasing concentrations. The remaining 3 wells were consistent.

Total Organic Carbon

Four (4) wells (MW-01D, MW-02I, MW-04D and MW-05S) showed increasing concentrations of total organic carbon. Well MW-05D showed a decrease in total organic carbon concentration. The remaining 17 wells were consistent.

Total Dissolved Solids

Six (6) wells (MW-02I, MW-04D, MW-06I, MW-07I, MW-12I and MW-12D) showed increasing concentrations of total dissolved solids. Eight (8) wells (MW-01I, MW-02D, MW-05D, MW-06D, MW-11S, MW-11I, MW-11D and MW-12S) showed decreasing concentrations. The remaining 8 wells were consistent.

Total Kjeldahl Nitrogen

Nine (9) wells (MW-01S, MW-02I, MW-02D, MW-04S, MW-05I, MW-06S, MW-11S, MW-11D and MW-12S) showed increasing concentrations of total kjeldahl nitrogen. Three (3) wells (MW-01I, MW-05S and MW-12I) showed decreasing concentrations. The remaining 10 wells were consistent.

4.2.3 Inorganic Parameters

The results of the inorganic parameters for the groundwater samples are presented in Appendix A-2. As shown by the second quarter 2004 analytical results, total chromium, iron, manganese and sodium were detected at concentrations above the Class GA groundwater standards. The following provides a discussion of these exceedances.

Total Chromium

The groundwater standard for total chromium of 50 micrograms per liter (ug/l) was exceeded in well MW-11s, which contained total chromium concentration of 64.7 ug/l.

Iron

Thirteen (13) wells (MW-01S, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-06S, MW-06I, MW-06D, MW-11S, MW-11D and MW-12S) exceeded the

groundwater standard of 300 ug/l for iron. Iron concentrations for these wells with exceedances ranged from 330 ug/l in well MW-12S to 79,200 ug/l in well MW-04S.

Manganese

Fourteen (14) wells (MW-01S, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S, MW-06I, MW-06D, MW-07I, MW-11S and MW-11I) exceeded the groundwater standard of 300 ug/l for manganese. Manganese concentrations for these wells with exceedances ranged from 325 ug/l in well MW-06I to 5,700 ug/l in well MW-07I.

Sodium

Nine (9) wells (MW-01S, MW-01I, MW-01D, MW-03S, MW-04S, MW-04I, MW-05I, MW-11S and MW-12S) exceeded the groundwater standard of 20,000 ug/l for sodium. Sodium concentrations for these wells with exceedances ranged from 20,900 ug/l in well MW-03S to 448,000 ug/l in MW-01D.

4.2.4 Historic Inorganic Parameters

A comparison of the inorganic parameter results in the 22 wells sampled between the second quarter 2004 and the first quarter 2004 sampling events is provided below. For those parameters which were not included in the Part 360 Routine (first quarter 2004) sample event but included in the Baseline (second quarter 2004) sample event, the comparison is made to the previous Part 360 Baseline sampling event (third quarter 2003). Since well MW-02S was not sampled during the second quarter 2004 sampling event, it is not included in the comparison. Concentration trends and exceedances for each well are summarized in Table 4-3. Historic data for inorganic parameters are summarized in Appendix A-2.

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
SUMMARY OF CONCENTRATION TRENDS FOR INORGANIC PARAMETERS - SECOND QUARTER 2004**

Table 4-3

Well	Location	Aluminum	Antimony	Arsenic	Barium	Beryllium	Boron	Cadmium	Calcium	Hexavalent Chromium
MW-01S	Upgradient	C	D	C	D	C	C	I	C	C
MW-01I	Upgradient	I	D	C	D	C	I	I	D	C
MW-01D	Upgradient	I	D	C	I	C	I	I	I	C
MW-02I	Upgradient	I	D	C	C	C	D	D	I	C
MW-02D	Upgradient	C	D	C	C	C	D	I	C	C
MW-03S	Downgradient	I	D	I	C	D	D	I	C	C
MW-04S	Downgradient	I	D	I	C	D	C	I	C	C
MW-04I	Downgradient	I	D	C	C	D	C	I	D	C
MW-04D	Downgradient	C	D	I	I	D	C	I	C	C
MW-05S	Downgradient	I	D	C	D	C	D	I	D	C
MW-05I	Downgradient	D	D	I	I	D	I	I	C	C
MW-05D	Downgradient	I	D	D	C	D	D	I	D	C
MW-06S	Sidegradient	D	D	C	D	D	D	I	D	C
MW-06I	Sidegradient	I	D	C	D	D	C	C	C	C
MW-06D	Sidegradient	I	D	C	D	D	C	C	C	C
MW-07I	Upgradient	C	D	C	I	C	D	C	C	C
MW-11S	Upgradient	I	D	C	I	C	C	I	D	C
MW-11I	Upgradient	D	D	C	D	C	C	C	C	C
MW-11D	Upgradient	I	D	C	I	C	D	I	I	C
MW-12S	Upgradient	I	D	C	C	C	D	I	D	C
MW-12I	Upgradient	D	D	C	I	I	C	I	C	C
MW-12D	Upgradient	C	D	C	I	C	D	D	D	C

Key: I = Increase greater than 20%
D = Decrease greater than 20%
C = Consistent within 20%

Parameter exceeds standard/guidance value during the current sampling event.

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
SUMMARY OF CONCENTRATION TRENDS FOR INORGANIC PARAMETERS - SECOND QUARTER 2004**

Table 4-3 (continued)

Well	Location	Total Chromium	Cobalt	Copper	Iron	Lead	Magnesium	Manganese	Mercury
MW-01S	Upgradient	I	I	C	I	C	D	C	C
MW-01I	Upgradient	C	I	I	I	D	D	D	C
MW-01D	Upgradient	C	I	I	I	D	I	I	C
MW-02I	Upgradient	I	D	I	I	I	I	D	C
MW-02D	Upgradient	I	D	I	I	D	C	I	C
MW-03S	Downgradient	D	D	D	C	C	C	C	C
MW-04S	Downgradient	D	I	D	I	C	C	C	C
MW-04I	Downgradient	C	D	D	C	D	C	D	C
MW-04D	Downgradient	C	C	D	C	D	C	C	C
MW-05S	Downgradient	I	I	D	I	C	D	D	C
MW-05I	Downgradient	D	D	D	C	C	C	D	C
MW-05D	Downgradient	I	D	C	D	D	D	I	C
MW-06S	Sidegradient	D	D	D	D	D	C	D	C
MW-06I	Sidegradient	C	D	I	D	D	C	D	C
MW-06D	Sidegradient	I	D	I	D	C	C	D	C
MW-07I	Upgradient	I	D	I	C	D	C	C	C
MW-11S	Upgradient	I	D	I	D	D	D	I	C
MW-11I	Upgradient	I	I	D	C	D	C	C	C
MW-11D	Upgradient	I	D	I	I	I	C	C	C
MW-12S	Upgradient	I	D	I	C	D	D	D	C
MW-12I	Upgradient	C	D	I	C	D	C	D	C
MW-12D	Upgradient	I	D	I	D	D	D	C	C

Key: I = Increase greater than 20%
D = Decrease greater than 20%
C = Consistent within 20%

Parameter exceeds standard/guidance value during the current sampling event.

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 SUMMARY OF CONCENTRATION TRENDS FOR INORGANIC PARAMETERS - SECOND QUARTER 2004

Table 4-3 (continued)

Well	Location	Nickel	Potassium	Selenium	Silver	Sodium	Thallium	Vanadium	Zinc	Cyanide
MW-01S	Upgradient	D	C	D	D	D	C	C	D	C
MW-01I	Upgradient	I	D	D	D	D	C	C	I	C
MW-01D	Upgradient	C	I	I	I	C	C	C	C	D
MW-02I	Upgradient	I	I	D	D	D	C	C	I	C
MW-02D	Upgradient	C	I	D	D	C	C	C	I	C
MW-03S	Downgradient	D	C	D	D	D	D	D	D	C
MW-04S	Downgradient	C	C	D	D	C	C	D	C	C
MW-04I	Downgradient	D	C	D	D	D	D	D	I	C
MW-04D	Downgradient	D	C	D	D	C	D	D	D	C
MW-05S	Downgradient	I	D	D	D	D	D	D	D	C
MW-05I	Downgradient	D	C	D	D	C	D	D	D	C
MW-05D	Downgradient	I	D	D	D	D	D	D	I	C
MW-06S	Sidegradient	D	C	D	D	D	D	D	D	C
MW-06I	Sidegradient	I	C	D	D	C	D	D	I	C
MW-06D	Sidegradient	I	C	D	D	D	D	D	I	C
MW-07I	Upgradient	C	C	D	D	C	C	C	I	C
MW-11S	Upgradient	D	C	D	D	D	C	C	D	C
MW-11I	Upgradient	I	D	D	D	D	C	C	D	C
MW-11D	Upgradient	C	C	D	D	C	C	C	I	C
MW-12S	Upgradient	I	C	C	D	C	C	C	C	C
MW-12I	Upgradient	C	C	D	D	C	C	C	I	C
MW-12D	Upgradient	C	C	D	D	C	C	C	I	C

Key: I = Increase greater than 20%
 D = Decrease greater than 20%
 C = Consistent within 20%

Parameter exceeds standard/guidance value during the current sampling event.

Aluminum

Thirteen (13) wells (MW-01I, MW-01D, MW-02I, MW-03S, MW-04S, MW-04I, MW-05S, MW-05D, MW-06I, MW-06D, MW-11S, MW-11D and MW-12S) showed increasing aluminum concentrations. Four (4) wells (MW-05I, MW-06S, MW-11I and MW-12I) showed decreasing concentrations. The remaining 5 wells were consistent.

Antimony

All sampled wells showed decreasing antimony concentrations.

Arsenic

Four (4) wells (MW-03S, MW-04S, MW-04D and MW-05I) showed increasing arsenic concentrations. Well MW-05D showed a decreasing arsenic concentration. The remaining 17 wells were consistent.

Barium

Eight (8) wells (MW-01D, MW-04D, MW-05I, MW-07I, MW-11S, MW-11D, MW-12I and MW-12D) showed increasing barium concentrations. Seven (7) wells (MW-01S, MW-01I, MW-05S, MW-06S, MW-06I, MW-06D and MW-11I) showed decreasing concentrations. The remaining 7 wells were consistent.

Beryllium

Well MW-12I showed an increase in beryllium concentration. Nine (9) wells (MW-03S, MW-04S, MW-04I, MW-04D, MW-05I, MW-05D, MW-06S, MW-06I and MW-06D) showed decreasing concentrations. The remaining 12 wells were consistent.

Boron

Three (3) wells (MW-01I, MW-01D and MW-05I) showed increasing boron concentrations. Ten (10) wells (MW-02I, MW-02D, MW-03S, MW-05S, MW-05D, MW-06S, MW-07I, MW-11D, MW-12S and MW-12D) showed decreasing concentrations. The remaining 9 wells were consistent.

Cadmium

Sixteen (16) wells (MW-01S, MW-01I, MW-01D, MW-02D, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S, MW-11S, MW-11D, MW-12S and MW-12I) showed increasing cadmium concentrations. Wells MW-02I and MW-12D showed decreasing concentrations. The remaining 4 wells were consistent.

Calcium

Three (3) wells (MW-01D, MW-02I and MW-11D) showed increasing calcium concentrations. Eight (8) wells (MW-01I, MW-04I, MW-05S, MW-05D, MW-06S, MW-11S, MW-12S and MW-12D) showed decreasing concentrations. The remaining 11 wells were consistent.

Hexavalent Chromium

All sampled wells were consistent.

Total Chromium

Twelve (12) wells (MW-01S, MW-02I, MW-02D, MW-05S, MW-05D, MW-06D, MW-07I, MW-11S, MW-11I, MW-11D, MW-12S and MW-12D) showed increasing total chromium concentrations. Four (4) wells (MW-03S, MW-04S, MW-05I and MW-06S) showed decreasing concentrations. The remaining 6 wells were consistent.

Cobalt

Six (6) wells (MW-01S, MW-01I, MW-01D, MW-04S, MW-05S and MW-11I) showed increasing cobalt concentrations. Fifteen (15) wells (MW-02I, MW-02D, MW-03S, MW-04I, MW-05I, MW-05D, MW-06S, MW-06I, MW-06D, MW-07I, MW-11S, MW-11D, MW-12S, MW-12I and MW-12D) showed decreasing concentrations. The remaining well was consistent.

Copper

Twelve (12) wells (MW-01I, MW-01D, MW-02I, MW-02D, MW-06I, MW-06D, MW-07I, MW-11S, MW-11D, MW-12S, MW-12I and MW-12D) showed increasing copper concentrations. Eight (8) wells (MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-06S and MW-11I) showed decreasing concentrations. The remaining 2 wells were consistent.

Iron

Eight (8) wells (MW-01S, MW-01I, MW-01D, MW-02I, MW-02D, MW-04S, MW-05S and MW-11D) showed increasing iron concentrations. Six (6) wells (MW-05D, MW-06S, MW-06I, MW-06D, MW-11S and MW-12D) showed decreasing concentrations. The remaining 8 wells were consistent.

Lead

Two wells (MW-02I and MW-11D) showed increasing lead concentrations. Fourteen (14) wells (MW-01I, MW-01D, MW-02D, MW-04I, MW-04D, MW-05D, MW-06S, MW-06I, MW-07I, MW-11S, MW-11I, MW-12S, MW-12I and MW-12D) showed decreasing concentrations. The remaining 6 wells were consistent.

Magnesium

Two wells (MW-01D and MW-02I) showed increasing magnesium concentrations. Seven (7) wells (MW-01S, MW-01I, MW-05S, MW-05D, MW-11S, MW-12S and MW-12D) showed decreasing concentrations. The remaining 13 wells were consistent.

Manganese

Five (5) wells (MW-01D, MW-02D, MW-05I, MW-05D and MW-11S) showed increasing manganese concentrations. Nine (9) wells (MW-01I, MW-02I, MW-04I, MW-05S, MW-06S, MW-06I, MW-06D, MW-12S and MW-12I) showed decreasing concentrations. The remaining 8 wells were consistent.

Mercury

All sampled wells were consistent.

Nickel

Eight (8) wells (MW-01I, MW-02I, MW-05S, MW-05D, MW-06I, MW-06D, MW-11I and MW-12S) showed increasing nickel concentrations. Seven (7) wells (MW-01S, MW-03S, MW-04I, MW-04D, MW-05I, MW-06S and MW-11S) showed decreasing concentrations. The remaining 7 wells were consistent.

Potassium

Three (3) wells (MW-01D, MW-02I and MW-02D) showed increasing potassium concentrations. Four (4) wells (MW-01I, MW-05S, MW-05D and MW-11I) showed decreasing concentrations. The remaining 15 wells were consistent.

Selenium

Well MW-01D showed an increasing selenium concentration. Twenty (20) wells (MW-01S, MW-01I, MW-02I, MW-02S, MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S, MW-06I, MW-06D, MW-07I, MW-11S, MW-11I, MW-11D, MW-12I and MW-12D) showed decreasing concentrations. The remaining well was consistent.

Silver

Well MW-01D showed an increasing silver concentration. The remaining 21 wells showed decreasing concentrations.

Sodium

Eleven (11) wells (MW-01S, MW-01I, MW-02I, MW-03S, MW-04I, MW-05S, MW-05D, MW-06S, MW-06D, MW-11S and MW-11I) showed decreasing sodium concentrations. The remaining 11 wells were consistent.

Thallium

Nine (9) wells (MW-03S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S, MW-06I and MW-06D) showed decreasing thallium concentrations. The remaining 13 wells were consistent.

Vanadium

Ten (10) wells (MW-03S, MW-04S, MW-04I, MW-04D, MW-05S, MW-05I, MW-05D, MW-06S, MW-06I and MW-06D) showed decreasing vanadium concentrations. The remaining 12 wells were consistent.

Zinc

Eleven (11) wells (MW-01I, MW-02I, MW-02D, MW-04I, MW-05D, MW-06I, MW-06D, MW-07I, MW-11D, MW-12I and MW-12D) showed increasing zinc concentrations. Eight (8) wells (MW-01S, MW-03S, MW-04D, MW-05S, MW-05I, MW-06S, MW-11S and MW-11I) showed decreasing concentrations. The remaining 3 wells were consistent.

Cyanide

Well MW-01D showed a decreasing cyanide concentration. The remaining 21 wells were consistent.

In order to evaluate changes in groundwater, historic results for alkalinity, iron plus manganese, total dissolved solids and specific conductivity were graphed for the shallow, intermediate and deep zones for upgradient well clusters 1 and 11, and downgradient well clusters 4 and 5. These parameters were selected as possible indicators of landfill impacts to groundwater. These graphs are included in Appendix A-4.

4.2.5 Volatile Organic Compounds


The results of the volatile organic compounds (VOCs) are provided in Appendix A-3. The second quarter 2004 VOC results showed that 4 of the 22 wells sampled contained only one VOC at a concentration exceeding the Class GA groundwater standard. Wells MW-01D and MW-11I contained 1,1-dichloroethane (1,1-DCA) at concentrations of 16 ug/l and 11 ug/l, respectively, both of which exceeded the Class GA groundwater standard of 5 ug/l. Well MW-04I contained chloroethane at a concentration of 58 ug/l, which exceeded the groundwater standard of 5 ug/l. Well MW-11S contained cis-1,2-dichloroethene at a concentration of 10 ug/l, which exceeded the groundwater standard of 5 ug/l. The second quarter 2004 results showed an increase in the number of wells exceeding groundwater standards and guidance values for VOCs in comparison to the exceedances detected during the third quarter 2003 (Baseline) sampling

event. At that time, only monitoring well MW-01D showed an exceedance for VOCs, with 1,1-dichloroethane (1,1-DCA) detected at a concentration of 23 ug/l.

4.3 Organic Vapor and Combustible Gas Monitoring

The results of the organic vapor and combustible gas monitoring are presented in Table 4-1. The results measured by the flame ionization detector (FID) show nondetectable readings in all 36 wells. All 36 wells showed a combustible gas reading of 0% of the lower explosive limit (LEL). The LEL for methane is 5% by volume or 50,000 ppm.

Section 5



5.0 DATA VALIDATION

Twenty-two (22) groundwater samples, two blind duplicates, two matrix spike/matrix spike duplicate (MS/MSD) sets, two field blanks and five trip blanks were collected as part of the May 2004 Post Closure Groundwater Monitoring Program sampling event at the Sonia Road Landfill. The samples were analyzed for Baseline Parameters as listed in 6 NYCRR Part 360. Sample analysis was performed by H2M Laboratories, a contractor to the IRRRA, in accordance with SW-846 methods as specified in the Part 360 regulations. H2M Laboratories is approved under the New York State Department of Health Environmental Laboratory Approval Program (ELAP) for the analyses performed.

The data package submitted by H2M Laboratories was reviewed for completeness and compliance with the analytical methods. All of the quality assurance/quality control (QA/QC) samples (calibrations, spikes, duplicates and blanks), as well as 20% of the analytical results, were reviewed yielding a “20% validation” in conformance with the Sampling and Analysis Plan. The samples that were reviewed for calculation and transcription errors were MW-03S, MW-05S, MW-05I, MW-07I and MW-12I. The findings of the review process are summarized below.

All samples were analyzed within the method specified holding times. All QA/QC requirements (calibrations, MS/MSDs, duplicates and blanks) were met.

Blind duplicates were collected from MW-12I (Blind Duplicate 1) and MW-05I (Blind Duplicate 2), and the results were comparable between the samples with the exception of hardness and alkalinity in Blind Duplicate 2 and sample MW-05I. The raw data were reviewed and no problems were identified. Two MS/MSD sets were collected (from MW-05S and MW-07I). All spike recoveries were within QC limits.

The chlorobenzene results for samples MW-07I, MW-11D and MW-11I, as well as the 1,4-dichlorobenzene result for sample MW-07I, have been qualified as nondetect. That is, the

method blank associated with these samples contained the same compounds and the sample results were less than the concentrations found in the blank.

No problems were found with the data package. All results are deemed valid and usable for environmental assessment purposes.

Completed data validation forms for the second quarter 2004 sampling event are provided in Appendix D.

Section 6



6.0 GROUNDWATER LEVEL MEASUREMENTS AND FLOW DIRECTION

Groundwater level measurements were obtained on May 19, 2004, from each of the 23 monitoring wells included in the Post Closure Groundwater Monitoring Program and the 13 additional wells not sampled as part of this program. The depth to water measurements, measuring point elevations and calculated groundwater elevations for the 36 monitoring wells are presented in Table 6-1.

Water level data from May 19, 2004 were used to construct groundwater elevation contour maps for the shallow (water table), intermediate and deep upper glacial aquifer wells at and in the immediate vicinity of the Sonia Road Landfill. Water table and potentiometric surface (for the intermediate and deep wells) elevation contour maps are presented on Figures 6-1, 6-2 and 6-3, respectively. Groundwater flow within the zones screened by the shallow, intermediate and deep wells is predominantly toward the southeast in the vicinity of the landfill. These maps are consistent with the maps previously prepared for the site.

Table 6-1

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
MONITORING WELL GROUNDWATER ELEVATION
MEASUREMENTS - SECOND QUARTER 2004
MAY 19, 2004**

Monitoring Well No.	Measuring Point Elevation (feet amsl)	Depth to Water from Measuring Point (feet)	Groundwater Elevation (feet amsl)
MW-01D	64.53	13.20	51.33
MW-01I	65.36	14.00	51.36
MW-01S	66.01	14.68	51.33
MW-02D	79.01	28.33	50.68
MW-02I	78.75	28.21	50.54
MW-02S	77.98	27.21	50.77
MW-03D	70.50	20.96	49.54
MW-03I	70.77	20.98	49.79
MW-03S	70.76	20.97	49.79
MW-04D	69.03	20.31	48.72
MW-04I	69.31	20.68	48.63
MW-04S	71.10	22.40	48.70
MW-05D	70.96	21.69	49.27
MW-05I	70.26	21.23	49.03
MW-05S	70.28	21.23	49.05
MW-06D	75.03	25.79	49.24
MW-06I	74.53	25.36	49.17
MW-06S	74.45	25.79	48.66
MW-07D	75.04	25.06	49.98
MW-07I	73.45	23.48	49.97
MW-07S	72.83	22.81	50.02
MW-10D	56.34	5.03	51.31
MW-10I	56.16	4.83	51.33
MW-10S	56.65	5.00	51.65

Table 6-1 (continued)

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
MONITORING WELL GROUNDWATER ELEVATION
MEASUREMENTS - SECOND QUARTER 2004
MAY 19, 2002**

Monitoring Well No.	Measuring Point Elevation (feet amsl)	Depth to Water from Measuring Point (feet)	Groundwater Elevation (feet amsl)
MW-11D	60.19	7.18	53.01
MW-11I	60.38	7.42	52.96
MW-11S	59.87	6.92	52.95
MW-12D	58.61	6.91	51.70
MW-12I	58.92	7.12	51.80
MW-12S	58.79	7.07	51.72
MW-13D	70.37	24.36	46.01
MW-13I	70.30	24.32	45.98
MW-13S	70.51	24.52	45.99
MW-14D	64.58	17.75	46.83
MW-14I	64.57	17.77	46.80
MW-14S	64.55	17.68	46.87

amsl: above mean sea level

WATER TABLE ELEVATION CONTOUR MAP

MAY 19, 2004

FIGURE 6-1


SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM

SOURCE: BASE MAP PROVIDED BY ISLIP RESOURCE RECOVERY AGENCY

NOTE: CONTOUR INTERVAL EQUALS 0.50 FT.

APPROXIMATE GROUNDWATER FLOW DIRECTION

MONITORING WELL LOCATION, DESIGNATION AND GROUNDWATER ELEVATION (FEET ABOVE MEAN SEA LEVEL)




MAY 19, 2004

INTERMEDIATE DEPTH POTENTIOMETRIC SURFACE ELEVATION CONTOUR MAP

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM

FIGURE 6-2

SOURCE: BASE MAP PROVIDED BY ISLP RESOURCE RECOVERY AGENCY



NOTE: APPROXIMATE GROUNDWATER FLOW DIRECTION
 CONTOUR INTERVAL EQUALS 0.50 FT.

MONITORING WELL LOCATION, DESIGNATION AND GROUNDWATER ELEVATION (FEET ABOVE MEAN SEA LEVEL)

LEGEND

MW-011
51.36



FIGURE 6-3

DEEP POTENTIOMETRIC SURFACE ELEVATION CONTOUR MAP

POST CLOSURE GROUNDWATER MONITORING PROGRAM
SONIA ROAD LANDFILL

Dvirka and Bartilucci
A DIVISION OF WILLIAM F. COSULICH ASSOCIATES, P.C.
CONSULTING ENGINEERS

GIS_Arcview Projects\2023 Sonia Rd\Updated Sonia\Maps\2004\2ndQ\Decon5-19-04.mxd

SOURCE: BASE MAP PROVIDED BY ISLIP RESOURCE RECOVERY AGENCY


NOTE: CONTOUR INTERVAL EQUALS 0.50 FT.

APPROXIMATE GROUNDWATER FLOW DIRECTION

MONITORING WELL LOCATION, DESIGNATION AND GROUNDWATER ELEVATION (FEET ABOVE MEAN SEA LEVEL)

LEGEND

MW-01D
50.52



Section 7



7.0 CONCLUSIONS AND RECOMMENDATIONS

7.1 Conclusions

Groundwater Flow

Based on groundwater level measurements collected during the second quarter 2004 and the shallow (water table), intermediate and deep potentiometric surface elevation contour maps constructed for the site, groundwater flow at and in the vicinity of the Sonia Road Landfill is predominantly toward the southeast. This groundwater flow direction is consistent with previous maps prepared for the site.

Groundwater Quality

Based on a comparison of the second quarter 2004 results to the first quarter 2003 results (Routine sampling event) or to the third quarter 2003 results (previous Baseline sampling event), and review of the historical trend graphs in Appendix A-4, groundwater quality in the vicinity of the Sonia Road Landfill has not changed substantially.

Since the only chromium concentration that exceeded the groundwater standard was in upgradient well MW-11S, the source of the detected chromium is not the Sonia Road Landfill.

Similarly, the detected concentrations of iron, manganese and sodium are likely not indicative of landfill-influenced groundwater, since concentrations of these parameters above groundwater standards were detected in both upgradient and downgradient wells.

The second quarter 2004 sample results showed that 4 of the 22 wells sampled each contained only one VOC at a concentration exceeding the Class GA groundwater standard. The VOCs detected at concentrations above standards were chloroethane, 1,1-dichloroethane (1,1-DCA) and cis-1,2-dichloroethene (cis-1,2-DCE). Chloroethane has previously been detected in downgradient wells and the concentration detected in MW-04I during this sampling event is

within the range of previous detections. Concentrations of 1,1-DCA and cis-1,2-DCE were only detected in wells upgradient of the landfill during this sampling event. Historic sample results indicate that VOCs are migrating beneath the landfill from an upgradient source or sources. These results are consistent with that conclusion.

7.2 Recommendations

Based on the second quarter 2004 results and comparison of these results to historic data for the Sonia Road Landfill, it is recommended to continue to sample the groundwater monitoring wells in accordance with the SAP.

Due to the damaged well casing identified for well MW-02S, it is recommended that well MW-02S be abandoned and replaced with a new monitoring well. Since the landfill cap in this area extends to the northern property boundary, it is likely that the replacement well would need to be located on an adjacent property.

Appendix A



APPENDIX A-1

**HISTORIC AND CURRENT
GROUNDWATER SAMPLE RESULTS -
LEACHATE INDICATORS**

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class	CAS #	DATE	Standards/Guidance Values										
				UNITS:	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	
Color (APHA Units)	-	-	10/24/1997	80	50	50	NS	NS	50	NS	NS	NS	NS	20
Alkalinity (as CaCO ₃)	-	-	11/30/2000	264	183	180	126	211	177	151	161	0.1 U	161	161
Ammonia (as N)	2 ST	7727-37-9	11/30/2000	1	2.1	2.2	1.46	2.03	1.04	0.93	0.1 U	8	8	
Biochemical Oxygen Demand	-	-	01/29/2001	2 U	2 U	6	2 U	2 U	2 U	4	8	8	8	
Bromide	2 GV	24959-67-9	01/29/2001	0.7	0.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
Chemical Oxygen Demand	-	-	11/30/2000	46	29.6	10.7	22.5	29.8	83.2	10 U	21.6	21.6	21.6	
Chloride	250 ST	16887-00-6	11/30/2000	69.7	28.4	42	36.6	40.9	60.7	131	65.8	65.8	65.8	
Hardness (as CaCO ₃)	-	471-34-1	11/30/2000	310	140	200	240	520	200	270	320	320	320	
Nitrate (as N)	10 ST	14797-55-8	11/30/2000	0.1 U	0.1 U	0.080 U	0.1 U	0.1 U	0.1 U	0.12	0.55	0.55	0.55	
Phenols, total	0.001 ST	-	11/30/2000	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	
Sulfate	250 ST	14808-79-8	11/30/2000	36.3	50	42.5	78	89	117	108	188	188	188	
Total Organic Carbon	-	-	11/30/2000	11.7	6	9.1	4.8	5.1	6.9	4.3	5.6	5.6	5.6	
Total Dissolved Solids	-	-	11/30/2000	432	259	310	250	420	74	506	534	534	534	
Total Kjeldahl nitrogen (as N)	-	-	11/30/2000	2.3	1.9	3.3	1.26	2.11	1.21	0.84	0.85	0.85	0.85	

CONSTITUENT	NYSDEC Class	CAS #	DATE	Standards/Guidance Values									
				UNITS:	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	11/10/2003	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Alkalinity (as CaCO ₃)	-	-	02/26/2004	165	192	184	192	184	184	184	184	184	184
Ammonia (as N)	2 ST	7727-37-9	02/26/2004	1.57	0.44	1.15	1.15	1.15	1.15	1.15	1.15	1.15	1.15
Biochemical Oxygen Demand	-	-	05/20/2004	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Bromide	2 GV	24959-67-9	05/20/2004	5.1	1 U	0.5 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	05/20/2004	38.6	33	10 U	33	10 U	10 U	10 U	10 U	10 U	10 U
Chloride	250 ST	16887-00-6	05/20/2004	158	56.6	72.1	56.6	72.1	72.1	72.1	72.1	72.1	72.1
Hardness (as CaCO ₃)	-	471-34-1	05/20/2004	460	54	750	460	54	750	750	750	750	750
Nitrate (as N)	10 ST	14797-55-8	05/20/2004	0.1 U	0.26	0.1 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Phenols, total	0.001 ST	-	05/20/2004	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	05/20/2004	282	140	130	282	140	130	130	130	130	130
Total Organic Carbon	-	-	05/20/2004	8.3	7.4	6.6	8.3	7.4	6.6	6.6	6.6	6.6	6.6
Total Dissolved Solids	-	-	05/20/2004	690	498	477	690	498	477	477	477	477	477
Total Kjeldahl nitrogen (as N)	-	-	05/20/2004	1.72	0.77	1.07	1.72	0.77	1.07	1.07	1.07	1.07	1.07

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I
				10/24/1997	11/30/2000	01/30/2001	08/21/2002	11/20/2002	03/05/2003	06/03/2003	08/21/2003
Color (APHA Units)	-	-	(mg/l)	NS	5 U	5 U	NS	5	NS	NS	10
Alkalinity (as CaCO3)	-	-	(mg/l)	20.7	65.6	50	14.8	23.4	65.8	58.7	63.8
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.9	0.24	0.63	0.15	0.1 U	0.45	0.25	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2	2 U	2 U	2 U	2 U	8	7
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.1	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	3 U	10 U	10 U	12.7	10 U	30	10 U	16.8
Chloride	250 ST	16887-00-6	(mg/l)	195	34.6	72	16.4	68.7	59.5	13.1	122
Hardness (as CaCO3)	-	471-34-1	(mg/l)	42	5	30	40	32	80	14	48
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.72	0.53	1.3	2.74	0.6	0.1 U	0.1 U	0.91
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	35.2	10.2	5 U	5 U	12.1	23.4	9.2	5 U
Total Organic Carbon	-	-	(mg/l)	2.8	1.7	0.99 J	1.4	1 U	1.4	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	356	179	310	86	310	201	87	307
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.2 U	0.35	1.16	0.21	0.45	0.7	0.23	0.84

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I
				11/10/2003	02/26/2004	05/20/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	5 U					
Alkalinity (as CaCO3)	-	-	(mg/l)	50	34.8	42.6					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.93	1.53	0.55					
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2					
Bromide	2 GV	24959-67-9	(mg/l)	1.3	1 U	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	11.9	13.1	10 U					
Chloride	250 ST	16887-00-6	(mg/l)	96.7	98.8	21.9					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	106	140	22					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.79	0.26	1.55					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	9.6	7.7	9.8					
Total Organic Carbon	-	-	(mg/l)	1 U	1 U	1 U					
Total Dissolved Solids	-	-	(mg/l)	214	2910	157					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	1.41	1.12	0.84					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS**


CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE :	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S
			DATE :	10/27/1997	11/30/2000	01/31/2001	08/21/2002	11/20/2002	03/05/2003	06/03/2003	08/21/2003
			UNITS:	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	5 U	5 U	5 U	NS	NS	NS	NS	NS
Alkalinity (as CaCO3)	-	-	(mg/l)	86.6	86.2	85	NS	NS	NS	NS	NS
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.08	1.5	1.1	NS	NS	NS	NS	NS
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2	NS	NS	NS	NS	NS
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U	NS	NS	NS	NS	NS
Chemical Oxygen Demand	-	-	(mg/l)	15 U	10 U	10 U	NS	NS	NS	NS	NS
Chloride	250 ST	16887-00-6	(mg/l)	21.2	9.5	10	NS	NS	NS	NS	NS
Hardness (as CaCO3)	-	471-34-1	(mg/l)	92	88	120	NS	NS	NS	NS	NS
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.82	2.4	1.8	NS	NS	NS	NS	NS
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	NS	NS	NS	NS	NS
Sulfate	250 ST	14808-79-8	(mg/l)	20.9	26.6	19.2	NS	NS	NS	NS	NS
Total Organic Carbon	-	-	(mg/l)	2.2	1.6	2.7	NS	NS	NS	NS	NS
Total Dissolved Solids	-	-	(mg/l)	171	138	170	NS	NS	NS	NS	NS
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.2	1.4	1.1	NS	NS	NS	NS	NS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE :	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S
			DATE :	11/11/2003	02/26/2004	05/20/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
			UNITS:	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	NS					
Alkalinity (as CaCO3)	-	-	(mg/l)	NS	NS	NS					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	NS	NS	NS					
Biochemical Oxygen Demand	-	-	(mg/l)	NS	NS	NS					
Bromide	2 GV	24959-67-9	(mg/l)	NS	NS	NS					
Chemical Oxygen Demand	-	-	(mg/l)	NS	NS	NS					
Chloride	250 ST	16887-00-6	(mg/l)	NS	NS	NS					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	NS	NS	NS					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	NS	NS	NS					
Phenols, total	0.001 ST	-	(mg/l)	NS	NS	NS					
Sulfate	250 ST	14808-79-8	(mg/l)	NS	NS	NS					
Total Organic Carbon	-	-	(mg/l)	NS	NS	NS					
Total Dissolved Solids	-	-	(mg/l)	NS	NS	NS					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	NS	NS	NS					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

 : Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT		NYSDEC Class	GA Groundwater	CAS #	DATE :	SITE :	UNITS:	(mg/l)						
Standards/Guidance Values					10/27/1997	MW-021	(mg/l)	MW-021	MW-021	MW-021	MW-021	MW-021	MW-021	MW-021
Color (APHA Units)	-	-	-	-	12/01/2000	MW-021	5 U	5 U	5 U	NS	NS	10	NS	NS
Alkalinity (as CaCO ₃)	-	-	-	-	12/01/2000	MW-021	12.3	9	9.3	4.5	9.6	16.2	17.2	7.4
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.65	08/21/2002	MW-021	9.1	0.64	0.10 U	0.1 U	0.1 U	0.29	0.19	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	08/21/2002	MW-021	2 U	2 U	2 U	2 U	2 U	2 U	3	7
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	01/30/2001	MW-021	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	15 U	01/30/2001	MW-021	56.7	10 U	12.7	10 U	14	10 U	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	10	08/21/2002	MW-021	12.8	15	10.8	3.8	14	6.2	8.2	42
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	26	03/07/2003	MW-021	34	80	32	90	44	46	42	42
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.9	03/07/2003	MW-021	2.2	2.4	2.39	2.56	1.68	1.92	2.72	2.72
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	06/03/2003	MW-021	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	32.9	06/03/2003	MW-021	5.4	7.80	10.3	13.8	25.1	27.7	16.6	16.6
Total Organic Carbon	-	-	(mg/l)	1.5	03/07/2003	MW-021	1.5	1.1	1.3	1.3	3.2	2.3	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	103	08/21/2002	MW-021	88	99	58	97	83	82	112	112
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.8	08/21/2002	MW-021	0.8	9	1.20	0.1 U	0.28	1.45	0.66	0.26

CONSTITUENT		NYSDEC Class	GA Groundwater	CAS #	DATE :	SITE :	UNITS:	(mg/l)						
Standards/Guidance Values					11/11/2003 <th>MW-021</th> <th>(mg/l)</th> <th>MW-021</th> <th>MW-021</th> <th>MW-021</th> <th>MW-021</th> <th>MW-021</th> <th>MW-021</th> <th>MW-021</th>	MW-021	(mg/l)	MW-021	MW-021	MW-021	MW-021	MW-021	MW-021	MW-021
Color (APHA Units)	-	-	(mg/l)	NS	02/26/2004	MW-021	NS	NS	NS	NS	20	32.1	32.1	20
Alkalinity (as CaCO ₃)	-	-	(mg/l)	7.5	05/20/2004	MW-021	9.4	9.4	9.4	9.4	9.4	9.4	9.4	9.4
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	05/20/2004	MW-021	0.1 U	0.1 U	0.1 U	0.1 U	0.23	0.23	0.23	0.23
Biochemical Oxygen Demand	-	-	(mg/l)	3	05/20/2004	MW-021	3	3	3	3	2	2	2	2
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	05/20/2004	MW-021	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	10 U	05/20/2004	MW-021	10 U	10 U	10 U	10 U	28	23	23	23
Chloride	250 ST	16887-00-6	(mg/l)	11.1	05/20/2004	MW-021	14.7	14.7	14.7	8.3	8.3	8.3	8.3	8.3
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	40	05/20/2004	MW-021	44	44	44	44	110	110	110	110
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	2.82	05/20/2004	MW-021	2.82	2.82	2.82	2.82	2.19	2.19	2.19	2.19
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	05/20/2004	MW-021	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	13.9	05/20/2004	MW-021	13.9	13.9	13.9	15	27.2	27.2	27.2	27.2
Total Organic Carbon	-	-	(mg/l)	1 U	05/20/2004	MW-021	1 U	1 U	1 U	1 U	5.7	5.7	5.7	5.7
Total Dissolved Solids	-	-	(mg/l)	74	05/20/2004	MW-021	69	69	69	69	127	127	127	127
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.46	05/20/2004	MW-021	0.36	0.36	0.36	0.36	1.02	1.02	1.02	1.02

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-02D 12/01/1997 (mg/l)	MW-02D 12/01/2000 (mg/l)	MW-02D 01/30/2001 (mg/l)	MW-02D 08/21/2002 (mg/l)	MW-02D 11/20/2002 (mg/l)	MW-02D 03/05/2003 (mg/l)	MW-02D 06/03/2003 (mg/l)	MW-02D 08/22/2003 (mg/l)
Color (APHA Units)	-	-	(mg/l)	5 U	5 U	5 U	NS	5	NS	NS	5 U
Alkalinity (as CaCO3)	-	-	(mg/l)	10.2	13.8	14	10.5	11.9	13.6	13.5	13.6
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.24	0.2	0.22	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2 U	2 U	2 U	2 U	4	11
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.8
Chemical Oxygen Demand	-	-	(mg/l)	15 U	73	10 U	10 U	10 U	10 U	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	9.4	5.2	5.5	4.3	6.4	7.3	8.6	6.3
Hardness (as CaCO3)	-	471-34-1	(mg/l)	30	30	68	34	40	24	36	100
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.4	1.2	1	0.69	1.48	1.49	1.45	1.47
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	12.6	5 U	8.2	18.6	19.2	18.9	16.1	18.3
Total Organic Carbon	-	-	(mg/l)	0.7	1 U	0.88 J	1.2	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	76	96	80	60	110	80	73	91
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.23	0.19	0.340	0.1 U	0.1 U	0.18	0.1 U	0.1 U

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-02D 11/11/2003 (mg/l)	MW-02D 02/27/2004 (mg/l)	MW-02D 05/20/2004 (mg/l)	MW-02D (mg/l)	MW-02D (mg/l)	MW-02D (mg/l)	MW-02D (mg/l)	MW-02D (mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	5 U					
Alkalinity (as CaCO3)	-	-	(mg/l)	12.4	13	13.9					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	0.1 U	0.11					
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	8	2 U					
Bromide	2 GV	24959-67-9	(mg/l)	0.5	1 U	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	10 U	10 U	13.1					
Chloride	250 ST	16887-00-6	(mg/l)	5.4	8.5	6.4					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	42	48	110					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.62	1.51	1.69					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	19.8	17.9	25.6					
Total Organic Carbon	-	-	(mg/l)	1 U	1 U	1 U					
Total Dissolved Solids	-	-	(mg/l)	69	139	88					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.1 U	0.1 U	0.27					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT		CAS #	DATE : SITE : NYSDEC Class GA Groundwater	UNITS:	(mg/l)							
Standards/Guidance Values	MW-03S				MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S
Color (APHA Units)	-	-	70	(mg/l)	70	100	NS	50	NS	NS	NS	60
Alkalinity (as CaCO3)	-	-	187	(mg/l)	183	160	169	146	5 U	175	297	
Ammonia (as N)	2 ST	7727-37-9	2	(mg/l)	2.3	1.66	2.07	2.7	5.78	1.66	2.08	
Biochemical Oxygen Demand	-	-	11	(mg/l)	11	18	5	13	10	8	8	
Bromide	2 GV	24959-67-9	0.5 U	(mg/l)	0.5 U	0.5 U	1.5	0.5 U	0.5 U	0.5 U	0.6	
Chemical Oxygen Demand	-	-	37	(mg/l)	10 U	32.6	34.7	44.5	35.3	33.8	77.6	
Chloride	250 ST	16887-00-6	75.3	(mg/l)	28.8	26.8	37.6	40.2	30.5	21.2	42.9	
Hardness (as CaCO3)	-	-	190	(mg/l)	180	188	220	340	500	400	650	
Nitrate (as N)	10 ST	14797-55-8	0.1 U	(mg/l)	0.1 U	0.254	0.1 U	0.67	0.88	0.1 U	0.27	
Phenols, total	0.001 ST	-	0.0018	(mg/l)	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	
Sulfate	250 ST	14808-79-8	5 U	(mg/l)	5 U	19	96	54.5	860	96.5	30.4	
Total Organic Carbon	-	-	7.7	(mg/l)	4.3	4.67	4.9	3.9	5.8	5.7	8.1	
Total Dissolved Solids	-	-	246	(mg/l)	237	248	290	695	876	452	528	
Total Kjeldahl nitrogen (as N)	-	-	3.1	(mg/l)	2	1.7	3	2.48	8.69	1.46	2.92	

CONSTITUENT		CAS #	DATE : SITE : NYSDEC Class GA Groundwater	UNITS:	(mg/l)							
Standards/Guidance Values	MW-03S				MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S
Color (APHA Units)	-	-	NS	(mg/l)	NS	NS	NS	NS	NS	NS	NS	
Alkalinity (as CaCO3)	-	-	263	(mg/l)	213	209						
Ammonia (as N)	2 ST	7727-37-9	2.88	(mg/l)	0.5 U	1.57						
Biochemical Oxygen Demand	-	-	12	(mg/l)	9	10						
Bromide	2 GV	24959-67-9	2.1	(mg/l)	3.1	0.5 U						
Chemical Oxygen Demand	-	-	38.6	(mg/l)	50.4	25.5						
Chloride	250 ST	16887-00-6	52.3	(mg/l)	32.7	41.7						
Hardness (as CaCO3)	-	-	440	(mg/l)	300	700						
Nitrate (as N)	10 ST	14797-55-8	0.1 U	(mg/l)	0.5 U	0.56						
Phenols, total	0.001 ST	-	0.005 U	(mg/l)	0.005 U	0.005 U						
Sulfate	250 ST	14808-79-8	5.7	(mg/l)	11.2	24.3						
Total Organic Carbon	-	-	7	(mg/l)	6	6.8						
Total Dissolved Solids	-	-	345	(mg/l)	320	320						
Total Kjeldahl nitrogen (as N)	-	-	3.23	(mg/l)	2.03	2.27						

NOTES:
NS: Not sampled
U: Analyzed for but not detected, value shown is instrument detection limit
J: Reported value is estimated due to variance from quality control limits
: Concentration exceeds Standard/Guidance Value

Appendix A-1

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS**

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S
				10/29/1997	12/06/2000	02/01/2001	08/23/2002	11/22/2002	03/06/2003	06/03/2003	08/25/2003
Color (APHA Units)	-	-	(mg/l)	150	200	80	NS	70	NS	NS	60
Alkalinity (as CaCO ₃)	-	-	(mg/l)	618	364	400	405	543	489	452	374
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	9.3	7.8	7.2	7.63	7.18	9.21	9.6	8.64
Biochemical Oxygen Demand	-	-	(mg/l)	5	37	34	26	23	44	34	31
Bromide	2 GV	24959-67-9	(mg/l)	1	1.2	1	4	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	67	10 U	13.4	34.7	37.1	61.9	33.8	996
Chloride	250 ST	16887-00-6	(mg/l)	63.3	42.2	49	49.9	51.3	49.3	54.9	44.7
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	540	480	340	380	440	500	460	700
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	0.1 U	0.1 U	0.1 U	0.15	0.1 U	0.26	0.1 U
Phenols, total	0.001 ST	-	(mg/l)	0.0049	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.0052	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	5 U	8.9	5.30	5 U	14	6.4	11.2	15.9
Total Organic Carbon	-	-	(mg/l)	17.3	8.1	11	9	8.8	9.6	8.4	8.9
Total Dissolved Solids	-	-	(mg/l)	624	426	460	430	465	595	547	546
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	23.3	8.9	10.7	7.24	8.65	12.6	10.4	9.9

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S
				11/12/2003	03/02/2004	05/24/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	140					
Alkalinity (as CaCO ₃)	-	-	(mg/l)	402	343	379					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	8.03	1.16	6.45					
Biochemical Oxygen Demand	-	-	(mg/l)	41	31	67					
Bromide	2 GV	24959-67-9	(mg/l)	1.1	3.6	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	48.4	60.3	35.5					
Chloride	250 ST	16887-00-6	(mg/l)	37.9	40.3	49.3					
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	660	560	900					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.21	0.5	0.48					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	125	28.2	49.4					
Total Organic Carbon	-	-	(mg/l)	9.5	8.4	10.1					
Total Dissolved Solids	-	-	(mg/l)	610	471	440					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	7.64	5.24	6.73					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 LEACHATE INDICATORS

CONSTITUENT		NYSDEC Class	CAS #	DATE : UNITS:	Standards/Guidance Values							
GA Groundwater	GA Groundwater				GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	
Color (APHA Units)	-	-	-	30 (mg/l)	200 (mg/l)	60 (mg/l)	NS (mg/l)	80 (mg/l)	NS (mg/l)	NS (mg/l)	150 (mg/l)	
Alkalinity (as CaCO ₃)	-	-	-	309 (mg/l)	339 (mg/l)	240 (mg/l)	202 (mg/l)	385 (mg/l)	282 (mg/l)	354 (mg/l)	387 (mg/l)	
Ammonia (as N)	2 ST	7727-37-9	1.8 (mg/l)	9.2 (mg/l)	8.2 (mg/l)	5.48 (mg/l)	5.38 (mg/l)	6.01 (mg/l)	6.53 (mg/l)	5.49 (mg/l)		
Biochemical Oxygen Demand	-	-	6 (mg/l)	24 (mg/l)	20 (mg/l)	8 (mg/l)	18 (mg/l)	39 (mg/l)	50 (mg/l)	15 (mg/l)		
Bromide	2 GV	24959-67-9	0.8 (mg/l)	0.9 (mg/l)	0.70 (mg/l)	3.3 (mg/l)	0.5 U (mg/l)	0.5 U (mg/l)	0.5 U (mg/l)	0.5 U (mg/l)		
Chemical Oxygen Demand	-	-	37 (mg/l)	10 U (mg/l)	10 U (mg/l)	20 (mg/l)	46.9 (mg/l)	51.3 (mg/l)	31.4 (mg/l)	21.6 (mg/l)		
Chloride	250 ST	16887-00-6	28.7 (mg/l)	50.9 (mg/l)	48 (mg/l)	22.1 (mg/l)	49.5 (mg/l)	44.4 (mg/l)	49.8 (mg/l)	47 (mg/l)		
Hardness (as CaCO ₃)	-	-	210 (mg/l)	480 (mg/l)	200 (mg/l)	80 (mg/l)	460 (mg/l)	290 (mg/l)	440 (mg/l)	320 (mg/l)		
Nitrate (as N)	10 ST	14797-55-8	0.12 (mg/l)	0.1 U (mg/l)	0.1 U (mg/l)	0.59 (mg/l)	0.15 (mg/l)	0.1 U (mg/l)	0.1 U (mg/l)	0.1 U (mg/l)		
Phenols, total	0.001 ST	-	0.0039 (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)		
Sulfate	250 ST	14808-79-8	14.5 (mg/l)	5 U (mg/l)	5 U (mg/l)	5 U (mg/l)	10.7 (mg/l)	5.6 (mg/l)	6.3 (mg/l)	5 U (mg/l)		
Total Organic Carbon	-	-	5.2 (mg/l)	7.5 (mg/l)	7.5 (mg/l)	5.5 (mg/l)	6.4 (mg/l)	6.4 (mg/l)	7.2 (mg/l)	7.4 (mg/l)		
Total Dissolved Solids	-	-	424 (mg/l)	410 (mg/l)	310 (mg/l)	195 (mg/l)	402 (mg/l)	400 (mg/l)	422 (mg/l)	504 (mg/l)		
Total Kjeldahl nitrogen (as N)	-	-	7727-37-9 (mg/l)	4.3 (mg/l)	11.4 (mg/l)	10.1 (mg/l)	6.38 (mg/l)	7.29 (mg/l)	7.93 (mg/l)	6.21 (mg/l)	6.88 (mg/l)	

CONSTITUENT		NYSDEC Class	CAS #	DATE : UNITS:	Standards/Guidance Values							
GA Groundwater	GA Groundwater				GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater	GA Groundwater
Color (APHA Units)	-	-	-	NS (mg/l)	NS (mg/l)	NS (mg/l)	NS (mg/l)	NS (mg/l)	NS (mg/l)	NS (mg/l)	120 (mg/l)	
Alkalinity (as CaCO ₃)	-	-	-	326 (mg/l)	311 (mg/l)	278 (mg/l)						
Ammonia (as N)	2 ST	7727-37-9	5.74 (mg/l)	4.77 (mg/l)	4.06 (mg/l)							
Biochemical Oxygen Demand	-	-	62 (mg/l)	28 (mg/l)	10 (mg/l)							
Bromide	2 GV	24959-67-9	0.5 (mg/l)	3.4 (mg/l)	0.5 U (mg/l)							
Chemical Oxygen Demand	-	-	48.4 (mg/l)	30.5 (mg/l)	18.1 (mg/l)							
Chloride	250 ST	16887-00-6	46 (mg/l)	40.2 (mg/l)	40.8 (mg/l)							
Hardness (as CaCO ₃)	-	-	471-34-1 (mg/l)	390 (mg/l)	270 (mg/l)	850 (mg/l)						
Nitrate (as N)	10 ST	14797-55-8	0.1 U (mg/l)	0.1 U (mg/l)	0.1 U (mg/l)							
Phenols, total	0.001 ST	-	0.005 U (mg/l)	0.005 U (mg/l)	0.005 U (mg/l)							
Sulfate	250 ST	14808-79-8	5 U (mg/l)	5 U (mg/l)	5 U (mg/l)							
Total Organic Carbon	-	-	6.5 (mg/l)	6.6 (mg/l)	6.7 (mg/l)							
Total Dissolved Solids	-	-	368 (mg/l)	420 (mg/l)	370 (mg/l)							
Total Kjeldahl nitrogen (as N)	-	-	7727-37-9 (mg/l)	5.09 (mg/l)	4.45 (mg/l)	4.38 (mg/l)						

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

U: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D
				10/28/1997	12/06/2000	02/01/2001	08/23/2002	11/21/2002	03/07/2003	06/03/2003	08/25/2003
Color (APHA Units)	-	-	(mg/l)	150	150	50	NS	60	NS	NS	80
Alkalinity (as CaCO3)	-	-	(mg/l)	210	232	260	117	103	88.2	110	1430
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	2.8	5.3	5.4	3.91	2.65	3.68	4.33	4.31
Biochemical Oxygen Demand	-	-	(mg/l)	8	4	8	13	2 U	2	12	7
Bromide	2 GV	24959-67-9	(mg/l)	1.1	0.8	1.1	3	0.5 U	0.5 U	0.5 U	0.5
Chemical Oxygen Demand	-	-	(mg/l)	46	10 U	10.6	12.7	15.1	10 U	28.9	48.4
Chloride	250 ST	16887-00-6	(mg/l)	50.1	42.8	42	20	20.4	12.5	18.6	18.9
Hardness (as CaCO3)	-	471-34-1	(mg/l)	280	280	200	110	200	140	120	500
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	0.1 U	0.1 U	1.52	0.61	0.1 U	0.1 U	0.1 U
Phenols, total	0.001 ST	-	(mg/l)	0.0049	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	18.3	9.1	6.10	10	42.6	17.9	22.1	21.5
Total Organic Carbon	-	-	(mg/l)	4.7	6.5	6.2	3	1.7	2.9	2	1.8
Total Dissolved Solids	-	-	(mg/l)	318	304	310	170	241	40	162	214
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	5.6	6.6	7	4.47	3.06	4.85	4.14	4.69

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D
				11/11/2003	02/26/2004	05/24/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	200					
Alkalinity (as CaCO3)	-	-	(mg/l)	148	163	174					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	4.83	1.19	4.21					
Biochemical Oxygen Demand	-	-	(mg/l)	4	9	12					
Bromide	2 GV	24959-67-9	(mg/l)	2	2.3	0.5					
Chemical Oxygen Demand	-	-	(mg/l)	19.2	37.9	13.1					
Chloride	250 ST	16887-00-6	(mg/l)	17.8	25.1	27.6					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	320	132	800					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	0.1 U	0.1 U					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	14.8	8	13					
Total Organic Carbon	-	-	(mg/l)	1.7	2.3	3					
Total Dissolved Solids	-	-	(mg/l)	208	50	248					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	4.27	4.54	4.4					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I
				10/29/1997	12/08/2000	02/02/2001	08/23/2002	11/22/2002	03/07/2003	06/05/2003	08/25/2003
Color (APHA Units)	-	-	(mg/l)	40	300	100	NS	60	NS	NS	50
Alkalinity (as CaCO ₃)	-	-	(mg/l)	30.4	113	157	93	92.5	133	135	105
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.49	J	J	1.28	0.1	J	J	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	3	4 U	9	10	7	2 U	3	13
Bromide	2 GV	24959-67-9	(mg/l)	0.6	0.5 U	0.5 U	1.3	1	0.5 U	0.5 U	0.9
Chemical Oxygen Demand	-	-	(mg/l)	16	10 U	10 U	10 U	10 U	27.3	10 U	43.5
Chloride	250 ST	16887-00-6	(mg/l)	24.3	29.6	39.9	25.3	34.3	39.1	31.6	27.5
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	50	104	140	100	140	120	160	170
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	0.1 U	1.4	1.94	0.66	0.32	0.1 U	3.16
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	8.9	24.2	17	21.5	20.4	22.3	25.1	15.2
Total Organic Carbon	-	-	(mg/l)	1.8	4.7	5.12	3.4	2.5	3.2	2.5	3.7
Total Dissolved Solids	-	-	(mg/l)	100	216	250	432	207	280	218	257
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.7	4.4	5	2.44	1.43	4.77	3.46	0.7

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I
				11/12/2003	03/02/2004	05/25/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	40					
Alkalinity (as CaCO ₃)	-	-	(mg/l)	177	140	184					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	J	0.86	J					
Biochemical Oxygen Demand	-	-	(mg/l)	4	7	6					
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	J	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	21.6	25.5	10 U					
Chloride	250 ST	16887-00-6	(mg/l)	49.1	46.4	49.6					
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	240	400	850					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	4.52	0.1 U					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	27.9	17.1	14					
Total Organic Carbon	-	-	(mg/l)	4.5	4	4.8					
Total Dissolved Solids	-	-	(mg/l)	291	303	287					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	5.75	3.62	5.92					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

J: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS**

Appendix A-1

CONSTITUENT	GA Groundwater	Standards/Guidance Values	CAS #	UNITS:	DATE:							
					10/29/1997	12/08/2000	02/02/2001	08/23/2002	11/22/2002	03/07/2003	06/05/2003	08/25/2003
Color (APHA Units)	-	-	-	(mg/l)	50	50	10	NS	5	NS	NS	5 U
Alkalinity (as CaCO ₃)	-	-	-	(mg/l)	234	467	505	138	128	90	50.9	34.4
Ammonia (as N)	2 ST	7727-37-9	-	(mg/l)	4.3	14.9	16.1	4.41	0.1 U	2.96	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	-	(mg/l)	2	5	12	8	10	2 U	13	6
Bromide	2 GV	24959-67-9	-	(mg/l)	0.5 U	0.5 U	0.5 U	3.2	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	-	(mg/l)	43	40.5	32.6	17.6	22.5	10 U	10 U	36.2
Chloride	250 ST	16887-00-6	-	(mg/l)	51.5	65.4	51.6	27.9	32.8	34	38.5	27.1
Hardness (as CaCO ₃)	-	-	-	(mg/l)	260	410	360	148	130	136	160	110
Nitrate (as N)	10 ST	14797-55-8	-	(mg/l)	0.1 U	0.1 U	1.5	4.46	5.73	11.4	0.68	15.1
Phenols, total	0.001 ST	-	-	(mg/l)	0.0015	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	-	(mg/l)	27.5	25.5	17.8	33.5	32.7	15	9.8	7.6
Total Organic Carbon	-	-	-	(mg/l)	6	13.6	11.1	4.3	2.7	1.7	1 U	1 U
Total Dissolved Solids	-	-	-	(mg/l)	337	549	566	266	297	242	258	344
Total Kjeldahl nitrogen (as N)	-	-	-	(mg/l)	7727-37-9	6	15.3	18	4.57	2.54	3.46	1.4

CONSTITUENT	NYSDEC Class	GA Groundwater	Standards/Guidance Values	CAS #	UNITS:	DATE:							
						11/12/2003	03/02/2004	05/25/2004	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D
Color (APHA Units)	-	-	-	-	(mg/l)	NS	NS	5					
Alkalinity (as CaCO ₃)	-	-	-	-	(mg/l)	29.6	41.5	39.6					
Ammonia (as N)	2 ST	7727-37-9	-	-	(mg/l)	0.1	1.44	1.4					
Biochemical Oxygen Demand	-	-	-	-	(mg/l)	2 U	2	2 U					
Bromide	2 GV	24959-67-9	-	-	(mg/l)	1.1	6	1					
Chemical Oxygen Demand	-	-	-	-	(mg/l)	21.6	15.6	10 U					
Chloride	250 ST	16887-00-6	-	-	(mg/l)	23.3	32.7	23.9					
Hardness (as CaCO ₃)	-	-	-	-	(mg/l)	300	190	160					
Nitrate (as N)	10 ST	14797-55-8	-	-	(mg/l)	13.5	8.85	7.52					
Phenols, total	0.001 ST	-	-	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	-	-	(mg/l)	8.9	9	13.4					
Total Organic Carbon	-	-	-	-	(mg/l)	1.4	1.3	1 U					
Total Dissolved Solids	-	-	-	-	(mg/l)	190	284	189					
Total Kjeldahl nitrogen (as N)	-	-	-	-	(mg/l)	7727-37-9	1.14	1.39	1.52				

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

Concentration exceeds Standard/Guidance Value

: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S
				10/27/1997	12/05/2000	02/01/2001	08/21/2002	11/20/2002	03/05/2003	06/04/2003	08/22/2003
				(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	150	100	70	NS	60	NS	NS	150
Alkalinity (as CaCO3)	-	-	(mg/l)	453	245	200	161	183	156	202	279
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	7.2	3	1.7	2.9	2.76		2.67	5.45
Biochemical Oxygen Demand	-	-	(mg/l)	5	17	10	2 U	6	3	55	16
Bromide	2 GV	24959-67-9	(mg/l)	0.6	0.7	0.5 U	1.2	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	46	10.7	10 U	24.9	10 U	27.3	10 U	41.1
Chloride	250 ST	16887-00-6	(mg/l)	39.8	14.8	20	15.8	19.6	10.7	20	22.3
Hardness (as CaCO3)	-	471-34-1	(mg/l)	440	280	140	220	280	80	200	420
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	0.1 U	0.1 U	0.21	1.97	0.32	0.17	0.29
Phenols, total	0.001 ST	-	(mg/l)	0.005	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	5 U	5 U	8.40	33.8	38.2	18.3	20.6	133
Total Organic Carbon	-	-	(mg/l)	11.4	4.4	5.8	4.6	2.9	5.1	4.2	13.1
Total Dissolved Solids	-	-	(mg/l)	480	270	220	213	391	230	239	564
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	17.3	3.9	4.9	4.68	3.24	3.53	3.3	7.64

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S
				11/11/2003	02/27/2004	05/24/2004					
				(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	100					
Alkalinity (as CaCO3)	-	-	(mg/l)	239	258	206					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	4.79	3.28	4.39					
Biochemical Oxygen Demand	-	-	(mg/l)	25	9	4					
Bromide	2 GV	24959-67-9	(mg/l)	4	2	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	21.6	30.5	23					
Chloride	250 ST	16887-00-6	(mg/l)	17.4	19.9	16.4					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	280	36	950					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	1.15	3.76					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	39.8	12.2	80					
Total Organic Carbon	-	-	(mg/l)	5.7	9	7.8					
Total Dissolved Solids	-	-	(mg/l)	338	395	336					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	4.11	3.67	4.7					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT		Standards/Guidance Values	CAS #	UNITS:	SITE:	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061
CONSTITUENT		GA Groundwater	CAS #	UNITS:	DATE:	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061
Color (APHA Units)	-	-	-	(mg/l)	10	30	30	NS	NS	5	NS	NS	NS	5	NS	NS	5
Alkalinity (as CaCO ₃)	-	-	-	(mg/l)	115	97.1	77	43.7	50.7	55.7	48.9	58.7	0.1	U	0.1	U	0.1
Ammonia (as N)	2 ST	7727-37-9	-	(mg/l)	0.76	1.7	1.7	0.1	U	0.1	U	0.1	U	0.1	U	0.1	U
Biochemical Oxygen Demand	-	-	-	(mg/l)	2	14	2	2	2	2	11	8	0.8	U	10	U	10
Bromide	2 GV	24959-67-9	-	(mg/l)	0.5	U	0.5	U	0.5	U	0.5	U	0.5	U	0.5	U	0.5
Chemical Oxygen Demand	-	-	-	(mg/l)	15	U	10	U	10.2	10	U	10	U	10	U	10	U
Chloride	250 ST	16887-00-6	-	(mg/l)	25.4	20.1	18	12.3	16.2	8.8	8.4	10.1	10.1	U	10	U	10.1
Hardness (as CaCO ₃)	-	-	-	(mg/l)	180	108	120	80	170	40	108	85	85	U	10	U	108
Nitrate (as N)	10 ST	14797-55-8	-	(mg/l)	0.1	U	0.14	0.005	0.97	0.79	2.1	0.95	0.95	U	10	U	0.95
Phenols, total	0.001 ST	-	-	(mg/l)	0.002	0.005	0.005	0.005	0.005	0.005	0.005	0.005	0.005	U	10	U	0.005
Sulfate	250 ST	14808-79-8	-	(mg/l)	21.2	47.8	50.4	12.7	12.7	16	17.4	25.9	25.9	U	10	U	25.9
Total Organic Carbon	-	-	-	(mg/l)	2.4	1.8	2.4	1.7	1.4	1	1.2	1	1	U	10	U	1
Total Dissolved Solids	-	-	-	(mg/l)	190	211	120	99	151	94	123	153	153	U	10	U	153
Total Kjeldahl nitrogen (as N)	-	-	-	(mg/l)	1.4	2	2.30	0.1	U	0.23	0.13	0.14	0.14	U	10	U	0.14

CONSTITUENT		Standards/Guidance Values	CAS #	UNITS:	SITE:	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061
CONSTITUENT		GA Groundwater	CAS #	UNITS:	DATE:	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061	MW-061
Color (APHA Units)	-	-	-	(mg/l)	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Alkalinity (as CaCO ₃)	-	-	-	(mg/l)	45	37.2	33.2	37.2	33.2	33.2	33.2	33.2	33.2	U	10	U	33.2
Ammonia (as N)	2 ST	7727-37-9	-	(mg/l)	0.17	0.17	0.22	0.17	0.22	0.17	0.22	0.17	0.17	U	10	U	0.17
Biochemical Oxygen Demand	-	-	-	(mg/l)	2	U	2	U	2	U	2	U	2	U	10	U	2
Bromide	2 GV	24959-67-9	-	(mg/l)	2.5	0.5	U	0.5	U	0.5	U	0.5	U	U	10	U	0.5
Chemical Oxygen Demand	-	-	-	(mg/l)	10	U	10	U	10	U	10	U	10	U	10	U	10
Chloride	250 ST	16887-00-6	-	(mg/l)	13.1	12.7	18.7	12.7	18.7	18.7	18.7	18.7	18.7	U	10	U	18.7
Hardness (as CaCO ₃)	-	-	-	(mg/l)	88	110	180	119	180	180	180	180	180	U	10	U	180
Nitrate (as N)	10 ST	14797-55-8	-	(mg/l)	1.15	1.19	1.67	1.19	1.67	1.19	1.67	1.19	1.19	U	10	U	1.19
Phenols, total	0.001 ST	-	-	(mg/l)	0.005	U	0.005	U	0.005	U	0.005	U	0.005	U	10	U	0.005
Sulfate	250 ST	14808-79-8	-	(mg/l)	30.9	31	20.5	30.9	31	20.5	20.5	20.5	20.5	U	10	U	20.5
Total Organic Carbon	-	-	-	(mg/l)	1	U	1	U	1	U	1.2	1	1	U	10	U	1
Total Dissolved Solids	-	-	-	(mg/l)	119	60	119	60	119	60	119	60	60	U	10	U	119
Total Kjeldahl nitrogen (as N)	-	-	-	(mg/l)	0.19	0.18	0.2	0.19	0.18	0.18	0.18	0.18	0.18	U	10	U	0.18

NOTES:
 NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 -: Concentration exceeds Standard/Guidance Value
 f: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D
				10/28/1997	12/05/2000	01/31/2001	08/22/2002	11/20/2002	03/05/2003	06/05/2003	08/22/2003
Color (APHA Units)	-	-	(mg/l)	10	30	5 U	NS	20	NS	NS	5 U
Alkalinity (as CaCO3)	-	-	(mg/l)	31.3	40.6	38	40	31.2	35.5	27.3	34.3
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.32	0.1 U	0.24	0.1 U	0.1 U	0.14	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	3	37	2 U	2 U	2 U	2 U	2 U	8
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.60	0.5 U	0.5 U	0.5 U	0.5 U	0.7
Chemical Oxygen Demand	-	-	(mg/l)	15 U	10 U	10 U	22.5	22.5	19.3	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	7.3	12.6	9.3	14.7	16.2	10.5	5.6	5.1
Hardness (as CaCO3)	-	471-34-1	(mg/l)	120	44	68	72	62	80	80	80
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.1 U	0.2	0.14	0.67	0.4	0.36	1.47	0.2
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	20.3	23.3	17.2	14.5	23	26	25.5	24.4
Total Organic Carbon	-	-	(mg/l)	2	1.7	1.1	1.2	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	78	130	120	100	150	96	97	117
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.2 U	0.2	0.46	0.1 U	0.1 U	0.1	0.1 U	0.1 U

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D
				11/11/2003	02/27/2004	05/24/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	5					
Alkalinity (as CaCO3)	-	-	(mg/l)	36.8	24.7	11.6					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.24	0.2	0.21					
Biochemical Oxygen Demand	-	-	(mg/l)	16	2 U	2 U					
Bromide	2 GV	24959-67-9	(mg/l)	5.1	2.9	0.6					
Chemical Oxygen Demand	-	-	(mg/l)	55.7	10.6	10 U					
Chloride	250 ST	16887-00-6	(mg/l)	5	7	5.9					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	80	40	105					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.04	0.33	0.45					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	26.8	17.8	26.6					
Total Organic Carbon	-	-	(mg/l)	1.7	1 U	1.1					
Total Dissolved Solids	-	-	(mg/l)	105	155	93					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	3.07	0.24	0.23					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 LEACHATE INDICATORS

CONSTITUENT	Standards/Guidance Values	CAS #	DATE : UNITS:	MW-071							
				12/01/2000 (mg/l)	01/31/2001 (mg/l)	08/21/2002 (mg/l)	11/20/2002 (mg/l)	03/05/2003 (mg/l)	06/03/2003 (mg/l)	08/22/2003 (mg/l)	MW-071
Color (APHA Units)	-	-	(mg/l)	5 U	5 U	NS	5	NS	NS	NS	5 U
Alkalinity (as CaCO ₃)	-	-	(mg/l)	23.4	22.1	23	13.9	12.6	17.5	28.1	24.1
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	1.3	0.89	1.2	0.1 U	0.1 U	0.54	0.99	0.51
Biochemical Oxygen Demand	-	-	(mg/l)	6	2 U	8	2 U	3	3	7	4
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.6	0.9	0.5 U	0.5 U	0.5 U	0.5 U	0.6
Chemical Oxygen Demand	-	-	(mg/l)	15 U	10 U	10 U	12.7	10 U	27.3	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	9.2	37.6	31	7.8	5.8	6.4	19.8	10.1
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	180	72	88	40	160	80	34	58
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.88	3.4	3.1	3.63	2.47	2.03	1.6	1.7
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	19.9	6	18.9	13.8	17.9	16.6	15.9	22.3
Total Organic Carbon	-	-	(mg/l)	1.9	1 U	1.2	1.6	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	65	164	140	74	54	84	89	99
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	1.7	0.84	1.6	0.1 U	0.1 U	0.92	1.03	0.62

CONSTITUENT	GA Groundwater	CAS #	DATE : UNITS:	MW-071							
				11/11/2003 (mg/l)	02/27/2004 (mg/l)	05/20/2004 (mg/l)	MW-071 (mg/l)	MW-071 (mg/l)	MW-071 (mg/l)	MW-071 (mg/l)	MW-071 (mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	5 U	16.8	18.8	16.8	16.8	16.8
Alkalinity (as CaCO ₃)	-	-	(mg/l)	21.5	23.6	21.5	23.6	21.5	23.6	21.5	23.6
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.52	1.84	1.41	1.41	2 U	2 U	2 U	2 U
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	11	2 U	11	2 U	2 U	2 U	2 U
Bromide	2 GV	24959-67-9	(mg/l)	1.2	1.7	1.7	1.7	1.7	1.7	1.7	1.7
Chemical Oxygen Demand	-	-	(mg/l)	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	10.3	24	28.4	28.4	24	28.4	28.4	28.4
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	40	48	100	100	48	100	100	100
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	2.46	1.66	2.66	2.66	1.66	2.66	2.66	2.66
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	15.9	15.8	21.8	21.8	15.8	21.8	21.8	21.8
Total Organic Carbon	-	-	(mg/l)	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	74	90	114	114	74	90	114	114
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	1.02	1.5	1.53	1.53	1.5	1.53	1.53	1.53

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

f: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S
				10/31/1997	12/13/2000	02/07/2001	08/22/2002	11/21/2002	03/06/2003	06/04/2003	08/21/2003
Color (APHA Units)	-	-	(mg/l)	100	5 U	5 U	NS	5	NS	NS	10
Alkalinity (as CaCO ₃)	-	-	(mg/l)	127	134	135	91.2	133	106	125	174
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	1	1.3	1.51	1.16	0.1 U	0.58	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2 U	2 U	2 U	2 U	2 U	6
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U	0.5	0.8	0.5 U	0.5	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	22	10 U	11	12.7	10 U	19.3	19.2	10 U
Chloride	250 ST	16887-00-6	(mg/l)	65.1	50.7	36.1	35.1	21.3	23	97.7	139
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	120	210	156	120	230	156	250	270
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.28	0.21	0.25	2.6	2.25	1.6	1.65	1.31
Phenols, total	0.001 ST	-	(mg/l)	0.002	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	42.1	28.6	49.6	29.2	41	64.8	80.5	68
Total Organic Carbon	-	-	(mg/l)	3.7	4.6	3.53	2.8	2.8	4	3.8	7.2
Total Dissolved Solids	-	-	(mg/l)	261	253	254	179	326	250	423	560
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	1.2	1.5	7.76	4.53	0.18	0.77	0.26	0.34

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S
				11/13/2003	03/01/2004	05/21/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	5					
Alkalinity (as CaCO ₃)	-	-	(mg/l)	206	160	113					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	0.35	1.81					
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2 U					
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	1.2	1.8					
Chemical Oxygen Demand	-	-	(mg/l)	21.6	20.5	25.5					
Chloride	250 ST	16887-00-6	(mg/l)	96.6	86.4	79.6					
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	290	220	450					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.52	1.59	1.04					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	76.4	45.5	61					
Total Organic Carbon	-	-	(mg/l)	5	4	4.2					
Total Dissolved Solids	-	-	(mg/l)	465	392	300					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.31	0.32	1.65					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS**

Appendix A-1

CONSTITUENT	NYSDEC Class	CAS #	DATE : UNITS:	Standards/Guidance Values									
				MW-111	MW-111	MW-111	MW-111	MW-111	MW-111	MW-111	MW-111		
Color (APHA Units)	-	-	(mg/l) 5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Alkalinity (as CaCO3)	-	-	(mg/l) 27.6	34.2	27.4	14.4	28.2	58	57.6	32.9	0.1 U	4	40
Ammonia (as N)	2 ST	7727-37-9	(mg/l) 0.99	1.1	0.91	0.1 U	0.1 U	1.15	0.1 U	0.1 U	0.1 U	2 U	4
Biochemical Oxygen Demand	-	-	(mg/l) 2 U	2 U	2 U	2 U	2 U	2 U	3	4	0.5 U	4	40
Bromide	2 GV	24959-67-9	(mg/l) 0.5 U	0.5 U	0.5 U	0.5 U	0.6	0.8	0.8	0.5 U	10 U	19.7	40
Chemical Oxygen Demand	-	-	(mg/l) 15 U	10 U	10 U	12.7	10 U	16.7	10 U	10 U	10 U	19.7	40
Chloride	250 ST	16887-00-6	(mg/l) 40.4	17.3	17.5	7	24.3	7.7	14.3	19.7	10 U	19.7	40
Hardness (as CaCO3)	-	471-34-1	(mg/l) 54	34	40	40	180	56	62	40	10 U	19.7	40
Nitrate (as N)	10 ST	14797-55-8	(mg/l) 0.13	0.42	1.8	3.07	1.85	0.1 U	1.03	1.01	0.005 U	10.7	40
Phenols, total	0.001 ST	-	(mg/l) 0.001	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	10.7	40
Sulfate	250 ST	14808-79-8	(mg/l) 14.9	6.8	7	5	7.9	10	5.8	10.7	0.005 U	10.7	40
Total Organic Carbon	-	-	(mg/l) 1.6	1.3	1 U	1.1	1 U	1 U	1 U	1 U	1 U	10.7	40
Total Dissolved Solids	-	-	(mg/l) 96	42	63	58	152	109	84	103	1 U	10.7	40
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l) 1.5	1.2	0.79	0.1	0.19	0.99	1.18	0.8	1 U	10.7	40

CONSTITUENT	NYSDEC Class	CAS #	DATE : UNITS:	Standards/Guidance Values									
				MW-111	MW-111	MW-111	MW-111	MW-111	MW-111	MW-111	MW-111		
Color (APHA Units)	-	-	(mg/l) 5 U	NS	NS	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Alkalinity (as CaCO3)	-	-	(mg/l) 28.6	48	37.8	48	37.8	48	37.8	37.8	48	48	48
Ammonia (as N)	2 ST	7727-37-9	(mg/l) 0.1 U	1.15	1.19	4	1.19	1.7	4	4	0.005 U	48	48
Biochemical Oxygen Demand	-	-	(mg/l) 2 U	2 U	2 U	2 U	2 U	2 U	4	4	0.005 U	48	48
Bromide	2 GV	24959-67-9	(mg/l) 0.5 U	0.5 U	0.7	1.7	0.5 U	0.5 U	1.7	1.7	0.005 U	48	48
Chemical Oxygen Demand	-	-	(mg/l) 10 U	10 U	15.6	10 U	10 U	10 U	10 U	10 U	0.005 U	48	48
Chloride	250 ST	16887-00-6	(mg/l) 11.7	11.7	22.7	14.1	14.1	15.0	15.0	15.0	0.005 U	48	48
Hardness (as CaCO3)	-	471-34-1	(mg/l) 0.96	0.53	0.33	0.33	0.33	0.33	0.33	0.33	0.005 U	48	48
Nitrate (as N)	10 ST	14797-55-8	(mg/l) 0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Phenols, total	0.001 ST	-	(mg/l) 0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l) 12.9	5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.005 U	0.5 U	0.5 U
Total Organic Carbon	-	-	(mg/l) 1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l) 78	110	38	38	110	38	38	38	1 U	38	38
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l) 0.36	1.11	0.93	0.93	1.11	0.93	0.93	0.93	0.005 U	0.93	0.93

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D
				10/31/1997	12/13/2000	02/07/2001	08/22/2002	11/21/2002	03/06/2003	06/04/2003	08/21/2003
Color (APHA Units)	-	-	(mg/l)	80	5 U	5 U	NS	5	NS	NS	5
Alkalinity (as CaCO3)	-	-	(mg/l)	36.8	3.6	6.8	5.2	4.4	4	3.7	2.9
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.5	0.14	0.481	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	4	2	2 U	2 U	2 U	2 U	2 U	6
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U	0.5 U	0.9	0.8	0.6	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	40	10 U	10 U	12.7	10 U	22	11.9	10 U
Chloride	250 ST	16887-00-6	(mg/l)	13.3	7.9	10.3	5.4	17.3	13.9	16.6	19
Hardness (as CaCO3)	-	471-34-1	(mg/l)	26	17	28	24	110	22	24	28
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.5	1.9	1.79	0.74	1.91	1.96	2.59	3.67
Phenols, total	0.001 ST	-	(mg/l)	0.0068	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	31.3	11.3	10.9	17.2	12	13.5	10.1	9.3
Total Organic Carbon	-	-	(mg/l)	5.6	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	124	61	84	60	109	69	88	126
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.58	0.1 U	0.46	0.1 U	0.1 U	0.2 U	0.2 U	0.1 U

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D
				11/13/2003	03/01/2004	05/21/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	20					
Alkalinity (as CaCO3)	-	-	(mg/l)	3.8	3.3	26.4					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	0.23	0.12					
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2 U					
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	10 U	10 U	45.4					
Chloride	250 ST	16887-00-6	(mg/l)	18.2	23.8	18.3					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	43	30	120					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	4.92	4.17	4.32					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	12.1	8.6	13.7					
Total Organic Carbon	-	-	(mg/l)	1 U	1 U	1 U					
Total Dissolved Solids	-	-	(mg/l)	103	194	70					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.11	0.1 U	0.18					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT		NYSDEC Class	GA Groundwater	Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	(mg/l)																
Color (APHA Units)	-	-	-	-	-	MW-12S 10/31/1997	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	
Alkalinity (as CaCO3)	-	-	-	-	-	MW-12S 12/07/2000	102	104	98	113	111	77.8	74.3	141	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.11	0.02 U	MW-12S 02/05/2001	0.07 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	3	2	MW-12S 08/22/2002	2 U	2 U	2 U	2 U	2 U	2 U	4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	MW-12S 11/21/2002	1.4	1.4	1.4	1.4	1.4	0.8	0.8	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U
Chemical Oxygen Demand	-	-	(mg/l)	16	10 U	MW-12S 03/06/2003	16.7	16.7	16.7	16.7	16.7	21.6	21.6	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2
Chloride	250 ST	16887-00-6	(mg/l)	21	16	MW-12S 06/04/2003	24	15.7	17.7	113	113	25.6	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2	11.2
Hardness (as CaCO3)	-	471-34-1	(mg/l)	90	96	MW-12S 08/22/2002	100	140	108	108	108	82	110	110	110	110	110	110	110	110	110	110	110
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.75	0.67	MW-12S 03/06/2003	0.4	2.21	1.14	0.89	0.89	0.58	1.54	1.54	1.54	1.54	1.54	1.54	1.54	1.54	1.54	1.54	1.54
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	MW-12S 06/04/2003	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	32.8	36.4	MW-12S 08/21/2003	13.4	37.5	27.6	32.1	23.3	32	32	32	32	32	32	32	32	32	32	32	32
Total Organic Carbon	-	-	(mg/l)	2.3	1.7	MW-12S 03/06/2003	2.2	3.3	1.7	1.9	1.6	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
Total Dissolved Solids	-	-	(mg/l)	170	175	MW-12S 06/04/2003	250	185	290	352	151	241	241	241	241	241	241	241	241	241	241	241	241
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.21	0.2 U	MW-12S 03/06/2003	0.12	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U

CONSTITUENT		NYSDEC Class	GA Groundwater	Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	(mg/l)																
Color (APHA Units)	-	-	-	-	-	MW-12S 11/13/2003	NS	NS	NS	NS	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Alkalinity (as CaCO3)	-	-	(mg/l)	150	118	MW-12S 03/01/2004	118	119	119	119	119	119	119	119	119	119	119	119	119	119	119	119	119
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	0.1 U	MW-12S 05/21/2004	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	MW-12S 03/01/2004	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	MW-12S 05/21/2004	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	10 U	10 U	MW-12S 03/01/2004	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	25.8	52.2	MW-12S 03/01/2004	31.6	320	320	320	320	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6
Hardness (as CaCO3)	-	471-34-1	(mg/l)	220	120	MW-12S 03/01/2004	120	120	120	120	120	320	320	320	320	320	320	320	320	320	320	320	320
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.89	1.18	MW-12S 05/21/2004	1.18	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24	1.24
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	MW-12S 05/21/2004	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	38.4	24.4	MW-12S 05/21/2004	24.4	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5	29.5
Total Organic Carbon	-	-	(mg/l)	2	1.6	MW-12S 05/21/2004	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
Total Dissolved Solids	-	-	(mg/l)	265	296	MW-12S 05/21/2004	296	184	184	184	184	184	184	184	184	184	184	184	184	184	184	184	184
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.22	0.13	MW-12S 05/21/2004	0.13	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
LEACHATE INDICATORS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I
				10/31/1997	12/07/2000	02/08/2001	08/22/2002	11/21/2002	03/06/2003	06/04/2003	08/21/2003
Color (APHA Units)	-	-	(mg/l)	5 U	5 U	5 U	NS	10	NS	NS	5
Alkalinity (as CaCO3)	-	-	(mg/l)	10.5	31.8	17.2	2.8	6.8	4.4	7.1	3.1
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.51	0.61	0.703	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	6	2 U	2 U	2 U	2 U	2 U	6
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.700	0.5 U	1.1	1	0.5 U	0.5 U
Chemical Oxygen Demand	-	-	(mg/l)	16	10 U	10 U	10 U	39.6	14	10 U	10 U
Chloride	250 ST	16887-00-6	(mg/l)	17.5	14.9	13.1	4.5	8.4	4.6	13.1	7.9
Hardness (as CaCO3)	-	471-34-1	(mg/l)	54	52	36.0	16	1900	32	32	20
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	4.7	0.73	1.1	0.93	1.54	0.33	0.53	0.21
Phenols, total	0.001 ST	-	(mg/l)	0.0010 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Sulfate	250 ST	14808-79-8	(mg/l)	43.1	48.3	24.2	10	10.4	11.6	11.3	8.6
Total Organic Carbon	-	-	(mg/l)	3.6	1.2	0.0010 U	1 U	1 U	1 U	1 U	1 U
Total Dissolved Solids	-	-	(mg/l)	106	143	90	39	79	55	62	49
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.46	0.84	8.30	0.1 U	0.1 U	0.2 U	0.1 U	0.1 U

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE : DATE : UNITS:	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I
				11/13/2003	03/01/2004	05/21/2004	(mg/l)	(mg/l)	(mg/l)	(mg/l)	(mg/l)
Color (APHA Units)	-	-	(mg/l)	NS	NS	5 U					
Alkalinity (as CaCO3)	-	-	(mg/l)	4.4	4.2	3.5					
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	0.14	0.1 U					
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	2 U	2 U					
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	0.5 U	0.5 U					
Chemical Oxygen Demand	-	-	(mg/l)	10 U	15.6	10 U					
Chloride	250 ST	16887-00-6	(mg/l)	4.8	5.5	4.3					
Hardness (as CaCO3)	-	471-34-1	(mg/l)	26	24	22					
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	1.3	0.7	0.52					
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	0.005 U	0.005 U					
Sulfate	250 ST	14808-79-8	(mg/l)	9.8	6.9	8.8					
Total Organic Carbon	-	-	(mg/l)	1 U	1 U	1 U					
Total Dissolved Solids	-	-	(mg/l)	40	14	47					
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.1 U	0.13	0.1 U					

NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit

█: Concentration exceeds Standard/Guidance Value

J: Reported value is estimated due to variance from quality control limits

Appendix A-1

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 LEACHATE INDICATORS

CONSTITUENT		Standards/Guidance Values		CAS #	UNITS:	SITE :	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D
		GA Groundwater				DATE :	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D
		NYSDEC Class				10/31/1997	12/08/2000	02/07/2001	08/22/2002	11/21/2002	03/06/2003	06/04/2003	08/21/2003			
Color (APHA Units)	-	-	(mg/l)	5 U	(mg/l)	5 U	5 U	NS	NS	5	NS	NS	5			
Alkalinity (as CaCO ₃)	-	-	(mg/l)	19.3	(mg/l)	7.3	7.8	6.7	6.8	8.4	7.9	8.1	0.1 U			
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.02 U	(mg/l)	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U			
Biochemical Oxygen Demand	-	-	(mg/l)	3	(mg/l)	7	4	2 U	2 U	2 U	4	7	0.5 U			
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	(mg/l)	0.5 U	0.5 U	0.5 U	0.9	0.5 U	0.5 U	0.5 U	0.5 U			
Chemical Oxygen Demand	-	-	(mg/l)	15 U	(mg/l)	10 U	10 U	15.1	10 U	10 U	10 U	10 U	10 U			
Chloride	250 ST	16887-00-6	(mg/l)	11.7	(mg/l)	4.7	5.71	3.1	4.3	5.6	8.9	6.2				
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	34	(mg/l)	15	28	16	36	64	34	36				
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.32	(mg/l)	0.38	0.31	0.13	0.24	0.58	0.66	0.63				
Phenols, total	0.001 ST	-	(mg/l)	0.002	(mg/l)	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U				
Sulfate	250 ST	14808-79-8	(mg/l)	19.5	(mg/l)	20.1	12.8	6.9	11.9	17.1	15.6	16.6				
Total Organic Carbon	-	-	(mg/l)	0.5 U	(mg/l)	2.1	1 U	1 U	1 U	1 U	1 U	1 U				
Total Dissolved Solids	-	-	(mg/l)	45	(mg/l)	77	380	37	69	78	58	88				
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.2 U	(mg/l)	0.1 U	8.54	0.16	0.1 U	0.2 U	0.1 U	0.1 U				

CONSTITUENT		Standards/Guidance Values		CAS #	UNITS:	SITE :	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D
		GA Groundwater				DATE :	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D
		NYSDEC Class				11/03/2003	03/01/2004	05/21/2004								
Color (APHA Units)	-	-	(mg/l)	NS	(mg/l)	NS	NS	5 U	6.8	6.8						
Alkalinity (as CaCO ₃)	-	-	(mg/l)	7.4	(mg/l)	6.7	6.8									
Ammonia (as N)	2 ST	7727-37-9	(mg/l)	0.1 U	(mg/l)	0.1 U	0.1 U	0.1 U	2 U	2 U						
Biochemical Oxygen Demand	-	-	(mg/l)	2 U	(mg/l)	2 U	2 U	0.5 U	0.5 U	0.5 U						
Bromide	2 GV	24959-67-9	(mg/l)	0.5 U	(mg/l)	0.5 U	0.5 U	0.5 U	10 U	10 U						
Chemical Oxygen Demand	-	-	(mg/l)	11.9	(mg/l)	10 U	10 U	3.6	4.8	3.6						
Chloride	250 ST	16887-00-6	(mg/l)	4.2	(mg/l)	33	22	36	4.8	3.6						
Hardness (as CaCO ₃)	-	471-34-1	(mg/l)	0.54	(mg/l)	0.75	0.29									
Nitrate (as N)	10 ST	14797-55-8	(mg/l)	0.005 U	(mg/l)	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U						
Phenols, total	0.001 ST	-	(mg/l)	0.005 U	(mg/l)	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U						
Sulfate	250 ST	14808-79-8	(mg/l)	13.5	(mg/l)	8.3	11.3									
Total Organic Carbon	-	-	(mg/l)	1 U	(mg/l)	1 U	1 U									
Total Dissolved Solids	-	-	(mg/l)	50	(mg/l)	10 U	25									
Total Kjeldahl nitrogen (as N)	-	7727-37-9	(mg/l)	0.1 U	(mg/l)	0.1 U	0.1 U									


NOTES:

NS: Not sampled

U: Analyzed for but not detected, value shown is instrument detection limit


: Concentration exceeds Standard/Guidance Value

U: Reported value is estimated due to variance from quality control limits



APPENDIX A-2

**HISTORIC AND CURRENT
GROUNDWATER SAMPLE RESULTS -
INORGANIC PARAMETERS**



Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: 10/24/1997	SITE: MW-01S	UNITS: (ug/l)	(ug/l)							
						MW-01S 11/30/2000	MW-01S 01/29/2001	MW-01S 08/21/2002	MW-01S 11/20/2002	MW-01S 03/05/2003	MW-01S 06/03/2003	MW-01S 08/21/2003	
Aluminum	-				ug/l	378	21 B	32.1	NA	101 B	NA	NA	30.7 B
Antimony	3 GV				ug/l	3.0 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U
Arsenic	25 ST				ug/l	2.5	2.5 U	5.9	NA	4.5 U	NA	NA	3.2 U
Barium	1000 ST				ug/l	75.5	52.7 B	58	NA	67.4 B	NA	NA	66.9 B
Beryllium	3 GV				ug/l	0.2	0.1 U	0.1 U	NA	0.40 U	NA	NA	0.20 U
Boron	1000 ST				ug/l	NA	622	553	NA	271	NA	NA	140
Cadmium	5 ST				ug/l	0.3 U	0.4 U	0.2 U	0.10 U	0.50 U	0.10 U	0.10 U	0.30 U
Calcium	-				ug/l	93000	53000	63900	65400	82400	87700	81200	92000
Chromium Hexavalent	50 ST				ug/l	20 U	20 U	20 U	NA	20 U	NA	NA	20 U
Chromium Total	50 ST				ug/l	2.7	3.5 U	1.5	NA	1.1 B	NA	NA	0.70 U
Cobalt	-				ug/l	2.5	2.8 B	4.8	NA	5.4 B	NA	NA	3.4 B
Copper	200 ST				ug/l	3.2	1.5 U	2.4	NA	3.5 B	NA	NA	3.4 B
Iron	300 ST				ug/l	6710	4360	4870	13300	14000	13100	7870	3040
Lead	25 ST				ug/l	12.7	1.4 U	6.5	2.2 B	1.4 B	1.5 U	1.9 B	0.80 U
Magnesium	35000 GV				ug/l	8940	6010	7240	7530	8980	10700	9690	9000
Manganese	300 ST				ug/l	944	1220	2270	1850	2740	2670	925	814
Mercury	0.7 ST				ug/l	0.12	0.1 U	0.1 U	NA	0.10 U	NA	NA	0.10 U
Nickel	100 ST				ug/l	1.3 U	1.9 U	1.4 U	NA	1.2 B	NA	NA	4.6 B
Potassium	-				ug/l	10000	16200	15700	8380	11000	9900	13600	9910
Selenium	10 ST				ug/l	2.8 U	1.7 U	5.5 N	NA	2.4 U	NA	NA	3.8 U
Silver	50 ST				ug/l	0.9 U	0.58 B	1.6 U	NA	1 U	NA	NA	1.0 U
Sodium	20000 ST				ug/l	51400	35400	39700	29400	38100	49600	82800	43500
Thallium	0.5 GV				ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	3.0 B
Vanadium	-				ug/l	1.2	0.7 U	1.7 U	NA	0.65 B	NA	NA	1.8 U
Zinc	2000 ST				ug/l	37	2.2 U	22.4	NA	40.6	NA	NA	66.9
Cyanide	200 ST				ug/l	10 U	10 U	5 U	NA	10 U	NA	NA	10 U
Iron + Manganese	500 ST*				ug/l	-	-	-	-	-	-	-	-

NOTES:

NS: Not sampled
 ST*: Standard for the sum of iron and manganese is 500 ug/l

U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B : Compound detected above instrument detection

limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-01S 11/10/2003 (ug/l)	MW-01S 02/26/2004 (ug/l)	MW-01S 05/20/2004 (ug/l)	MW-01S (ug/l)	MW-01S (ug/l)	MW-01S (ug/l)	MW-01S (ug/l)	MW-01S (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	30.3 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	46.1 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	168 B					
Cadmium	5 ST	7440-43-9	ug/l	0.30 U	0.20 U	0.3 U					
Calcium	-	7440-70-2	ug/l	133000	93100	83800					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	1.8 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	5.2 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	3.3 B					
Iron	300 ST	7439-89-6	ug/l	4890	5300	7980					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	1.3 B					
Magnesium	35000 GV	7439-95-4	ug/l	14000	13300	9930					
Manganese	300 ST	7439-96-5	ug/l	969	1900	2280					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	2.2 B					
Potassium	-	7440-09-7	ug/l	16600	8580	8960					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.6 B					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	90400	62800	45700					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	40.7					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	5859	7200	10260					

NOTES:

NS: Not sampled

█: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection
limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS**

Appendix A-2

CONSTITUENT	NYSDEC Class GA Groundwater		Standards/Guidance Values									
	CAS #	DATE: SITE:	UNITS:	MW-011 11/30/2000	MW-011 01/30/2001	MW-011 08/21/2002	MW-011 11/20/2002	MW-011 03/05/2003	MW-011 06/03/2003	MW-011 08/21/2003	(ug/l)	(ug/l)
Aluminum	-	7429-90-5	ug/l	60.8	12.5 B	27.7	NA	19 B	NA	NA	13.9 U	NA
Antimony	3 GV	7440-36-0	ug/l	3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U	NA
Arsenic	25 ST	7440-38-2	ug/l	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	NA	3.2 U	NA
Barium	1000 ST	7440-39-3	ug/l	93.2	4.3 B	7.8	NA	26.2 B	NA	NA	38.9 B	NA
Beryllium	3 GV	7440-41-7	ug/l	0.1	0.1 U	0.1 U	NA	0.40 U	NA	NA	0.2 U	NA
Boron	1000 ST	7440-42-8	ug/l	NA	65.8 B	94.3	NA	68.1 B	NA	NA	176	NA
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.4 U	0.2 U	0.21 B	0.50 U	0.16 B	0.10 U	0.30 U	NA
Calcium	-	7440-70-2	ug/l	7510	723 B	1350	4840 B	10200	5850	2520 B	13200	NA
Chromium Hexavalent	50 ST	18540-29-9	ug/l	20 U	20 U	20 U	NA	20 U	NA	NA	20 U	NA
Chromium Total	50 ST	7440-47-3	ug/l	0.4 U	3.5 U	0.6 U	NA	0.80 U	NA	NA	0.70 U	NA
Cobalt	-	7440-48-4	ug/l	2.7	2.2 B	1.7 U	NA	5.7 B	NA	NA	5.8 B	NA
Copper	200 ST	7440-50-8	ug/l	0.93	2.1 B	1.7	NA	2.0 B	NA	NA	1.1 U	NA
Iron	300 ST	7439-89-6	ug/l	80.1	13.3 B	22.8	242	78.8 B	105	45.2 B	23.6 U	NA
Lead	25 ST	7439-92-1	ug/l	1	1.4 U	1.1 U	1.3 B	1.4 U	1.5 U	1.6 B	0.80 U	NA
Magnesium	35000 GV	7439-95-4	ug/l	3720	154 B	266	904 B	1910 B	1160 B	439	2490 B	NA
Manganese	300 ST	7439-96-5	ug/l	286	1.3 B	3.9	32.4	24	16.5	7.4 B	24.4	NA
Mercury	0.7 ST	7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	NA	0.10 U	NA	NA	0.10 U	NA
Nickel	100 ST	7440-02-0	ug/l	5.1	1.9 U	1.4 U	NA	8.2 B	NA	NA	6.1 B	NA
Potassium	-	7440-09-7	ug/l	4250	951 B	1510	1370 B	1770 B	1970 B	1250 B	2700 B	NA
Selenium	10 ST	7782-49-2	ug/l	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U	NA
Silver	50 ST	7440-22-4	ug/l	0.9 U	0.5 U	2.6	NA	1 U	NA	NA	1.0 U	NA
Sodium	20000 ST	7440-23-5	ug/l	120000	50600	68000	16100	43000	64400	37000	83500	NA
Thallium	0.5 GV	7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	3.4 B	NA
Vanadium	-	7440-62-2	ug/l	1.2 U	0.7 U	1.7	NA	0.60 U	NA	NA	1.8 U	NA
Zinc	2000 ST	7440-66-6	ug/l	29.5	2.2 U	8.6	NA	27.6	NA	NA	3.4 B	NA
Cyanide	200 ST	0057-12-5	ug/l	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	NA
Iron + Manganese	500 ST*	-	ug/l	366.1	14.6	26.7	274.4	102.8	121.5	52.6	48	NA

ST*: Standard for the sum of iron and manganese is 500 ug/l

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-01I 11/10/2003 (ug/l)	MW-01I 02/26/2004 (ug/l)	MW-01I 05/20/2004 (ug/l)	MW-01I (ug/l)	MW-01I (ug/l)	MW-01I (ug/l)	MW-01I (ug/l)	MW-01I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	21.5 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	9.2 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	229 B					
Cadmium	5 ST	7440-43-9	ug/l	0.30 U	0.20 U	0.3 U					
Calcium	-	7440-70-2	ug/l	25100	17300	2720 B					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.6 U					
Cobalt	-	7440-48-4	ug/l	NA	NA	11 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	3.6 B					
Iron	300 ST	7439-89-6	ug/l	44.1 B	31.6 B	82.6 B					
Lead	25 ST	7439-92-1	ug/l	1.2 B	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	4750 B	3560 B	559 B					
Manganese	300 ST	7439-96-5	ug/l	71.2	70.6	16					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	7.4 B					
Potassium	-	7440-09-7	ug/l	3040 B	3860	1640 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	49900	74100	33800					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	13.3 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	115.3	102.2	98.6					

NOTES:

NS: Not sampled

█: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: 10/24/1997	MW-01D 11/30/2000	MW-01D 01/30/2001	MW-01D 08/21/2002	MW-01D 11/20/2002	MW-01D 03/05/2003	MW-01D 06/03/2003	MW-01D 08/21/2003
			UNITS: (ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-		7429-90-5	105	59.6 B	79.6 B	NA	131 B	NA	39.8 B
Antimony	3 GV		7440-36-0	3 U	1.7 U	12.3 U	NA	4.4 B	NA	3.5 U
Arsenic	25 ST		7440-38-2	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	3.2 U
Barium	1000 ST		7440-39-3	111	124 B	87.6	NA	93	NA	22.4 B
Beryllium	3 GV		7440-41-7	0.13	0.1 U	0.21	NA	0.4 U	NA	0.20 U
Boron	1000 ST		7440-42-8	NA	102	161	NA	113	NA	139
Cadmium	5 ST		7440-43-9	0.3 U	0.4 U	0.2 U	0.11 B	0.5 U	0.81 B	0.30 U
Calcium	-		7440-70-2	35300	19500	15200	26400	24400	15800	5650
Chromium Hexavalent	50 ST		18540-29-9	20 U	20 U	20 U	NA	20 U	NA	20 U
Chromium Total	50 ST		7440-47-3	0.53	3.5 U	0.6 U	NA	3.6 B	NA	0.70 U
Cobalt	-		7440-48-4	1.3	2.1 B	1.7 U	NA	5 B	NA	5.0 B
Copper	200 ST		7440-50-8	1.9	2 B	2.1	NA	7 B	NA	2.3 B
Iron	300 ST		7439-89-6	110	32 B	34.2	205	301	120	63.1 B
Lead	25 ST		7439-92-1	1.3	1.4 U	1.1 U	0.8 U	1.4 U	1.7 B	0.80 U
Magnesium	35000 GV		7439-95-4	10700	6010	4800	9680	8130	5740	1710 B
Manganese	300 ST		7439-96-5	132	9.9 B	7.3	34.3	28.6	67.5	3.6 B
Mercury	0.7 ST		7439-97-6	0.1 U	0.1 U	0.1 U	NA	0.10 U	NA	0.10 U
Nickel	100 ST		7440-02-0	2.2	1.9 U	1.4 U	NA	7.5 B	NA	6.0 B
Potassium	-		7440-09-7	6780	10400	9240	7740	20500	6830	2390 B
Selenium	10 ST		7782-49-2	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	3.8 U
Silver	50 ST		7440-22-4	0.9 U	0.77 B	1.6 U	NA	1 U	NA	1.0 U
Sodium	20000 ST		7440-23-5	61000	490000	390000	445000	327000	346000	156000
Thallium	0.5 GV		7440-28-0	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	3.0 B
Vanadium	-		7440-62-2	1.2 U	0.7 U	1.7 U	NA	1.4 B	NA	1.8 U
Zinc	2000 ST		7440-66-6	39	3.8 B	5.1	NA	190	NA	33.2
Cyanide	200 ST		0057-12-5	17	17	20.4	NA	30.4	NA	29
Iron + Manganese	500 ST*		-	242	41.9	41.5	239.3	329.6	368.5	66.7

ST*: Standard for the sum of iron and manganese is 500 ug/l

NOTES:
 NS: Not sampled
 Concentration exceeds Standard/Guidance Value
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-01D 11/10/2003 (ug/l)	MW-01D 02/26/2004 (ug/l)	MW-01D 05/20/2004 (ug/l)	MW-01D (ug/l)	MW-01D (ug/l)	MW-01D (ug/l)	MW-01D (ug/l)	MW-01D (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	52.5 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	123 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	173 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.3 U					
Calcium	-	7440-70-2	ug/l	1420 B	19500	27800					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.63 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	7.2 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	3.6 B					
Iron	300 ST	7439-89-6	ug/l	119	79.6 B	96.9 B					
Lead	25 ST	7439-92-1	ug/l	2.5 B	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	504 B	6270	9620					
Manganese	300 ST	7439-96-5	ug/l	3.6 B	9.3 B	17.6					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	5.1 B					
Potassium	-	7440-09-7	ug/l	1380 B	5480	7230					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	103000	416000	448000					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	32.4					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	122.6	88.9	114.5					

NOTES:

NS: Not sampled

█ : Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA	Groundwater	Standards/Guidance Values	CAS #	DATE: 10/27/1997	SITE: MW-02S	UNITS: (ug/l)	DATE: 01/31/2001	SITE: MW-02S	UNITS: (ug/l)	DATE: 08/21/2002	SITE: MW-02S	UNITS: (ug/l)	DATE: 11/20/2002	SITE: MW-02S	UNITS: (ug/l)	DATE: 03/05/2003	SITE: MW-02S	UNITS: (ug/l)	DATE: 06/03/2003	SITE: MW-02S	UNITS: (ug/l)	DATE: 08/25/2003	SITE: MW-02S	UNITS: (ug/l)	
Aluminum	-	7429-90-5	146	15.8 B	11.8 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Antimony	3 GV	7440-36-0	3 U	1.7 U	12.3 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Arsenic	25 ST	7440-38-2	2.4 U	2.5 U	1.9 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Barium	1000 ST	7440-39-3	26.3	34.1 B	31.9	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Beryllium	3 GV	7440-41-7	0.77	0.1 U	0.14	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Boron	1000 ST	7440-42-8	NA	59.7 B	87.8	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Cadmium	5 ST	7440-43-9	0.57	0.4 U	0.2 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Calcium	-	7440-70-2	27000	30300	33100	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Chromium Hexavalent	50 ST	18540-29-9	20 U	20 U	20 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Chromium Total	50 ST	7440-47-3	1.1	3.5 U	0.6 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Cobalt	-	7440-48-4	1.5	0.9 U	1.7 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Copper	200 ST	7440-50-8	4	2.6 B	1.5 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Iron	300 ST	7439-89-6	312	18.7 B	13.8	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Lead	25 ST	7439-92-1	2.1	1.4 U	1.1 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Magnesium	35000 GV	7439-95-4	2890	2360 B	2750	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Manganese	300 ST	7439-96-5	5.6	61.1	68.4	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Mercury	0.7 ST	7439-97-6	0.1 U	0.1 U	0.1 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Nickel	100 ST	7440-02-0	1.3	1.9 U	1.4 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Potassium	-	7440-09-7	4660	7850	7600	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Selenium	10 ST	7782-49-2	2.8 U	4 B	1.5 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Silver	50 ST	7440-22-4	0.9 U	0.93 B	1.6 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Sodium	20000 ST	7440-23-5	18900	12900	13100	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Thallium	0.5 GV	7440-28-0	2.6 U	2.3 B	2.8 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Vanadium	-	7440-62-2	1.2 U	0.7 U	1.7 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Zinc	2000 ST	7440-66-6	20.8	2.8 B	3.6 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Cyanide	200 ST	0057-12-5	10 U	10 U	5 U	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS
Iron + Manganese	500 ST*	-	317.6	79.8	82.2	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS	NS

NOTES:

NS: Not sampled
ST*: Standard for the sum of iron and manganese is 500 ug/l

U: Analyzed for but not detected, value shown is instrument detection limit
NA: Not analyzed
B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-02S 11/11/2003 (ug/l)	MW-02S 02/26/2004 (ug/l)	MW-02S 05/20/2004 (ug/l)	MW-02S (ug/l)	MW-02S (ug/l)	MW-02S (ug/l)	MW-02S (ug/l)	MW-02S (ug/l)
Aluminum	-	7429-90-5	ug/l	NS	NS	NS					
Antimony	3 GV	7440-36-0	ug/l	NS	NS	NS					
Arsenic	25 ST	7440-38-2	ug/l	NS	NS	NS					
Barium	1000 ST	7440-39-3	ug/l	NS	NS	NS					
Beryllium	3 GV	7440-41-7	ug/l	NS	NS	NS					
Boron	1000 ST	7440-42-8	ug/l	NS	NS	NS					
Cadmium	5 ST	7440-43-9	ug/l	NS	NS	NS					
Calcium	-	7440-70-2	ug/l	NS	NS	NS					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NS	NS	NS					
Chromium Total	50 ST	7440-47-3	ug/l	NS	NS	NS					
Cobalt	-	7440-48-4	ug/l	NS	NS	NS					
Copper	200 ST	7440-50-8	ug/l	NS	NS	NS					
Iron	300 ST	7439-89-6	ug/l	NS	NS	NS					
Lead	25 ST	7439-92-1	ug/l	NS	NS	NS					
Magnesium	35000 GV	7439-95-4	ug/l	NS	NS	NS					
Manganese	300 ST	7439-96-5	ug/l	NS	NS	NS					
Mercury	0.7 ST	7439-97-6	ug/l	NS	NS	NS					
Nickel	100 ST	7440-02-0	ug/l	NS	NS	NS					
Potassium	-	7440-09-7	ug/l	NS	NS	NS					
Selenium	10 ST	7782-49-2	ug/l	NS	NS	NS					
Silver	50 ST	7440-22-4	ug/l	NS	NS	NS					
Sodium	20000 ST	7440-23-5	ug/l	NS	NS	NS					
Thallium	0.5 GV	7440-28-0	ug/l	NS	NS	NS					
Vanadium	-	7440-62-2	ug/l	NS	NS	NS					
Zinc	2000 ST	7440-66-6	ug/l	NS	NS	NS					
Cyanide	200 ST	0057-12-5	ug/l	NS	NS	NS					
Iron + Manganese	500 ST*	-	ug/l	NS	NS	NS					

NOTES:

NS: Not sampled

█: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: 10/27/1997	UNITS:	MW-01 12/01/2000 (ug/l)	MW-02 01/30/2001 (ug/l)	MW-01 08/21/2002 (ug/l)	MW-02 11/20/2002 (ug/l)	MW-01 03/07/2003 (ug/l)	MW-02 06/03/2003 (ug/l)	MW-01 08/21/2003 (ug/l)
Aluminum	-		7429-90-5	ug/l	80.2	26.4 B	11.8 U	NA	70.4 B	NA	48.0 B
Antimony	3 GV		7440-36-0	ug/l	3 U	1.7 U	12.3 U	NA	3.1 U	NA	3.5 U
Arsenic	25 ST		7440-38-2	ug/l	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	3.2 U
Barium	1000 ST		7440-39-3	ug/l	47.9	39.9 B	36.9	NA	30.8 B	NA	35.5 B
Beryllium	3 GV		7440-41-7	ug/l	0.1	0.1 U	0.1 U	NA	0.4 U	NA	0.20 U
Boron	1000 ST		7440-42-8	ug/l	NA	126	97.2	NA	105	NA	103
Cadmium	5 ST		7440-43-9	ug/l	0.3 U	0.4 U	0.2 U	0.43 B	0.5 U	0.19 B	0.30 U
Calcium	-		7440-70-2	ug/l	4990	10700	10500	7090	6060	11600	9450
Chromium Hexavalent	50 ST		18540-29-9	ug/l	20 U	20 U	20 U	NA	20 U	NA	20 U
Chromium Total	50 ST		7440-47-3	ug/l	0.7	3.5 U	0.6 U	NA	0.8 U	NA	0.70 U
Cobalt	-		7440-48-4	ug/l	1.1	0.9 U	1.7 U	NA	1 U	NA	2.1 U
Copper	200 ST		7440-50-8	ug/l	3.6	1.5 U	1.5 U	NA	5.9 B	NA	1.4 B
Iron	300 ST		7439-89-6	ug/l	249	6.9 B	5.4	207	173	44.3 B	99.8 B
Lead	25 ST		7439-92-1	ug/l	3.5	1.4 U	1.1 U	1.2 B	1.7 B	1.5 U	0.80 U
Magnesium	35000 GV		7439-95-4	ug/l	685	2670 B	2600	1900 B	1780	3240 B	2680 B
Manganese	300 ST		7439-96-5	ug/l	40.9	406	417	181	504	328	295
Mercury	0.7 ST		7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	0.10 U
Nickel	100 ST		7440-02-0	ug/l	1.3 U	1.9 U	1.4 U	NA	1.1	NA	1.5 U
Potassium	-		7440-09-7	ug/l	3100	1630 B	1680	1740 B	3600	3070 B	1480 B
Selenium	10 ST		7782-49-2	ug/l	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	3.8 U
Silver	50 ST		7440-22-4	ug/l	0.9 U	1 B	1.6 U	NA	1 U	NA	1.0 U
Sodium	20000 ST		7440-23-5	ug/l	15300	8700	7580	7370	7100	12300	6460
Thallium	0.5 GV		7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	2.5 U
Vanadium	-		7440-62-2	ug/l	1.2 U	0.7 U	1.7 U	NA	0.60 U	NA	1.8 U
Zinc	2000 ST		7440-66-6	ug/l	37	2.2 U	3.6 U	NA	36	NA	9.8 B
Cyanide	200 ST		0057-12-5	ug/l	10 U	10 U	5 U	NA	10 U	NA	10 U
Iron + Manganese	500 ST*		-	ug/l	289.9	423.9	411.4	388	677	547.3	394.8

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B : Compound detected above instrument detection
 limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-02I 11/11/2003 (ug/l)	MW-02I 02/26/2004 (ug/l)	MW-02I 05/20/2004 (ug/l)	MW-02I (ug/l)	MW-02I (ug/l)	MW-02I (ug/l)	MW-02I (ug/l)	MW-02I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	133 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	31.2 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	39.5 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.41 B	0.3 U					
Calcium	-	7440-70-2	ug/l	9840	11200	17700					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	1.7 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	8.3 B					
Iron	300 ST	7439-89-6	ug/l	121	94.5 B	177					
Lead	25 ST	7439-92-1	ug/l	1.9 B	1.6 U	3.2					
Magnesium	35000 GV	7439-95-4	ug/l	2310 B	2400	2980 B					
Manganese	300 ST	7439-96-5	ug/l	390	360	266					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	2.2 B					
Potassium	-	7440-09-7	ug/l	1670 B	1760 B	3100 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.50 U					
Sodium	20000 ST	7440-23-5	ug/l	6510	9210	6970					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	36.4					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	511	454.5	443					

NOTES:

NS: Not sampled

ST*: Standard for the sum of iron and manganese is 500 ug/l

[shaded box]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater		Standards/Guidance Values		CAS #	UNITS:	SITE:	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	
	DATE: 10/27/1997	DATE: 12/01/2000	DATE: 01/30/2001	DATE: 08/21/2002																		DATE: 11/20/2002
Aluminum	-	7429-90-5	ug/l	33.5	15.3 B	16	NA	NA	21.9 B	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	22.3 B
Antimony	3 GV	7440-36-0	ug/l	3 U	1.7 U	12.3 U	NA	NA	3.1 U	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	3.5 U
Arsenic	25 ST	7440-38-2	ug/l	2.4 U	2.5 U	1.9 U	NA	NA	4.5 U	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	3.2 U
Barium	1000 ST	7440-39-3	ug/l	6.9	5.2 B	5	NA	NA	7.4 B	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	6.0 B
Beryllium	3 GV	7440-41-7	ug/l	0.1	0.1 U	0.1 U	NA	NA	0.40 U	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	0.20 U
Boron	1000 ST	7440-42-8	ug/l	NA	5.1 B	32.9	NA	NA	18 B	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	22.4 B
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.4 U	0.2 U	0.17 B	0.5 U	0.29 B	0.10 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U
Calcium	-	7440-70-2	ug/l	4750	6070	5720	6040	8290	8530	8370	7610	7610	7610	7610	7610	7610	7610	7610	7610	7610	7610	7610
Chromium Hexavalent	50 ST	18540-29-9	ug/l	20 U	20 U	20 U	NA	20 U	20 U	NA	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U
Chromium Total	50 ST	7440-47-3	ug/l	0.4 U	3.5 U	0.6 U	NA	1.6 B	NA	NA	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B
Cobalt	-	7440-48-4	ug/l	1.1 U	0.9 U	1.7 U	NA	1 U	NA	NA	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U
Copper	200 ST	7440-50-8	ug/l	0.7 U	1.5 U	1.5 U	NA	8.7 B	NA	NA	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B	1.4 B
Iron	300 ST	7439-89-6	ug/l	33.2	4.2 B	12.3	139	89.1 B	119	52.6 B	96.2	96.2	96.2	96.2	96.2	96.2	96.2	96.2	96.2	96.2	96.2	96.2
Lead	25 ST	7439-92-1	ug/l	1 U	1.4 U	1.1 U	0.8 U	1.4 U	1.5 U	1.5 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U
Magnesium	35000 GV	7439-95-4	ug/l	2220	2840 B	2680	2600 B	3530 B	3640 B	3610 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B	3250 B
Manganese	300 ST	7439-96-5	ug/l	54.8	1.6 B	1.1 U	30.6	11 B	7.3 B	3.4 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B	5.9 B
Mercury	0.7 ST	7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U
Nickel	100 ST	7440-02-0	ug/l	1.3 U	1.9 U	1.4 U	NA	1.5 B	NA	NA	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U
Potassium	-	7440-09-7	ug/l	636	740 B	806	741 B	710 B	768 B	895 B	736 B	736 B	736 B	736 B	736 B	736 B	736 B	736 B	736 B	736 B	736 B	736 B
Selenium	10 ST	7782-49-2	ug/l	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U
Silver	50 ST	7440-22-4	ug/l	0.9 U	0.5 U	1.6 U	NA	1 U	NA	NA	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Sodium	20000 ST	7440-23-5	ug/l	8120	8460	7560	6780	8170	8210	8650	7640	7640	7640	7640	7640	7640	7640	7640	7640	7640	7640	7640
Thallium	0.5 GV	7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B	3.0 B
Vanadium	-	7440-62-2	ug/l	1.2 U	0.7 U	1.7 U	NA	0.6 U	NA	NA	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U
Zinc	2000 ST	7440-66-6	ug/l	27.5	3.6 B	5.3	NA	57.8	NA	NA	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B	9.9 B
Cyanide	200 ST	0057-12-5	ug/l	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U	10 U
Iron + Manganese	500 ST*	-	ug/l	88	5.8	12.3	169.6	100.1	126.3	56	102.1	102.1	102.1	102.1	102.1	102.1	102.1	102.1	102.1	102.1	102.1	102.1

NOTES:

NS: Not sampled

: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-02D 11/11/2003 (ug/l)	MW-02D 02/27/2004 (ug/l)	MW-02D 05/20/2004 (ug/l)	MW-02D (ug/l)	MW-02D (ug/l)	MW-02D (ug/l)	MW-02D (ug/l)	MW-02D (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	20.7 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	6.9 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	16.7 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.3 U					
Calcium	-	7440-70-2	ug/l	7640	7800	7980					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	1.5 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	4.2 B					
Iron	300 ST	7439-89-6	ug/l	62.4 B	26.8 B	103					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	3340 B	3420 B	3260 B					
Manganese	300 ST	7439-96-5	ug/l	3.7 B	1.2 B	14.9 B					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.6 U					
Potassium	-	7440-09-7	ug/l	697 B	674 B	883 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	7590	8450	7760					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	15.2 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	66.1	28	117.9					

NOTES:

NS: Not sampled

[REDACTED]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: 10/30/1997	DATE: 12/06/2000	DATE: 02/02/2001	DATE: 08/22/2002	DATE: 11/22/2002	DATE: 03/07/2003	DATE: 06/03/2003	DATE: 08/25/2003
			UNITS: (ug/l)	UNITS: (ug/l)	UNITS: (ug/l)	UNITS: (ug/l)	UNITS: (ug/l)	UNITS: (ug/l)	UNITS: (ug/l)	UNITS: (ug/l)
Aluminum	-	7429-90-5	1080	16.5 B	53.7	NA	803	NA	NA	46.0 B
Antimony	3 GV	7440-36-0	3 U	1.7 U	12.3 U	NA	3.4 B	NA	NA	3.5 U
Arsenic	25 ST	7440-38-2	3.2	2.5 U	1.9 U	NA	4.5 U	NA	NA	3.2 U
Barium	1000 ST	7440-39-3	136	125 B	125	NA	176 B	NA	NA	158 B
Beryllium	3 GV	7440-41-7	0.1 U	0.1 U	0.24	NA	0.80 B	NA	NA	0.20 U
Boron	1000 ST	7440-42-8	NA	128	153	NA	139	NA	NA	222
Cadmium	5 ST	7440-43-9	0.3 U	0.4 U	0.22	0.13 B	0.5 U	0.10 U	0.10 U	0.30 U
Calcium	-	7440-70-2	50800	51200	57700	67400	92400	112000	84900	91600
Chromium Hexavalent	50 ST	18540-29-9	20 U	20 U	20 U	NA	20 U	NA	NA	20 U
Chromium Total	50 ST	7440-47-3	3.1	3.5 U	0.6	NA	2.9 B	NA	NA	1.2 B
Cobalt	-	7440-48-4	1.1	0.9 U	1.7 U	NA	13.1 B	NA	NA	2.1 U
Copper	200 ST	7440-50-8	3.3	2.6 B	1.5 U	NA	11.5 B	NA	NA	5.2 B
Iron	300 ST	7439-89-6	12700	10200	7390	30600	80600	85800	21100	16800
Lead	25 ST	7439-92-1	1.4	1.4 U	1.1 U	0.8 U	2.1 B	1.5 U	1.8 B	0.84 B
Magnesium	35000 GV	7439-95-4	7970	7620	8320	9840	16000	21700	14100	14600
Manganese	300 ST	7439-96-5	1270	5840	5930	8430	11500	8190	2930	3770
Mercury	0.7 ST	7439-97-6	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.10 U
Nickel	100 ST	7440-02-0	2.6	1.9 U	1.4 U	NA	23.4 B	NA	NA	2.8 B
Potassium	-	7440-09-7	7870	8310	9590	8680	7850	12200	19300	14100
Selenium	10 ST	7782-49-2	2.8 U	2.8 B	2 N	NA	6	NA	NA	3.8 U
Silver	50 ST	7440-22-4	0.9 U	1.7 B	1.6 U	NA	1 U	NA	NA	1 U
Sodium	20000 ST	7440-23-5	40400	20500	21500	27100	25200	22900	17600	22600
Thallium	0.5 GV	7440-28-0	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U
Vanadium	-	7440-62-2	3.7	0.7 U	1.7 U	NA	2.9 B	NA	NA	1.8 U
Zinc	2000 ST	7440-66-6	34	3.5 B	3.6 U	NA	799	NA	NA	57.5
Cyanide	200 ST	0057-12-5	10 U	10 U	5 U	NA	10 U	NA	NA	10 U
Iron + Manganese	500 ST*	-	ug/l	19970	16040	13320	39030	92100	93990	24030
			ug/l	1970	16040	13320	39030	92100	93990	24030

ST*: Standard for the sum of iron and manganese is 500 ug/l

NS: Not sampled
 : Concentration exceeds Standard/Guidance Value
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B : Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS**

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S
				11/13/2003 (ug/l)	03/02/2004 (ug/l)	05/24/2004 (ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	57.5 B				
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U				
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	5.1 B				
Barium	1000 ST	7440-39-3	ug/l	NA	NA	147 B				
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U				
Boron	1000 ST	7440-42-8	ug/l	NA	NA	171 B				
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.92 B				
Calcium	-	7440-70-2	ug/l	76200	66200	67100				
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U				
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.9 B				
Cobalt	-	7440-48-4	ug/l	NA	NA	0.9 U				
Copper	200 ST	7440-50-8	ug/l	NA	NA	2.1 B				
Iron	300 ST	7439-89-6	ug/l	34900	28800	27400				
Lead	25 ST	7439-92-1	ug/l	1.1 U	0.70 U	0.7 U				
Magnesium	35000 GV	7439-95-4	ug/l	11800	9800	10100				
Manganese	300 ST	7439-96-5	ug/l	5500	4860	4630				
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U				
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.5 B				
Potassium	-	7440-09-7	ug/l	15900	12900	10800				
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U				
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U				
Sodium	20000 ST	7440-23-5	ug/l	50000	27400	20900				
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U				
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U				
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	20.7 B				
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U				
Iron + Manganese	500 ST*	-	ug/l	40400	33860	32030				

NOTES:

NS: Not sampled

: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA	Groundwater	Standards/Guidance Values	CAS #	DATE:	SITE:	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S
					10/29/1997	12/06/2000	02/01/2001	08/23/2002	11/22/2002	03/06/2003	06/03/2003	08/25/2003								
					UNITS:	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)								
Aluminum	-	7429-90-5	574	28.8 B	37.4	NA	102 B	NA	NA	27.2 B	NA	NA	27.2 B	NA	NA	NA	NA	NA	NA	NA
Antimony	3 GV	7440-36-0	3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U	NA	NA	3.5 U	NA	NA	NA	NA	NA	NA	NA
Arsenic	25 ST	7440-38-2	11.4	3.7 B	7.8	NA	4.5 U	NA	NA	8.1 B	NA	NA	8.1 B	NA	NA	NA	NA	NA	NA	NA
Barium	1000 ST	7440-39-3	441	278	285	NA	316	NA	NA	240	NA	NA	240	NA	NA	NA	NA	NA	NA	NA
Beryllium	3 GV	7440-41-7	0.2	0.12 B	0.18	NA	0.4 U	NA	NA	0.20 U	NA	NA	0.20 U	NA	NA	NA	NA	NA	NA	NA
Boron	1000 ST	7440-42-8	NA	263	296	NA	320	NA	NA	273	NA	NA	273	NA	NA	NA	NA	NA	NA	NA
Cadmium	5 ST	7440-43-9	0.3 U	0.4 U	0.2 U	0.10 U	0.5 U	0.10 U	0.10 U	0.30 U	0.10 U	0.10 U	0.30 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U
Calcium	-	7440-70-2	152000	99400	109000	115000	123000	139000	138000	109000	138000	109000	109000	138000	109000	138000	109000	138000	109000	138000
Chromium Hexavalent	50 ST	18540-29-9	20 U	20 U	20 U	NA	20 U	NA	NA	20 U	NA	NA	20 U	NA	NA	NA	NA	NA	NA	NA
Chromium Total	50 ST	7440-47-3	1.6	3.5 U	0.6 U	NA	0.92 B	NA	NA	1.0 B	NA	NA	1.0 B	NA	NA	NA	NA	NA	NA	NA
Cobalt	-	7440-48-4	2.1	0.9 U	1.7 U	NA	1 U	NA	NA	2.8 B	NA	NA	2.8 B	NA	NA	NA	NA	NA	NA	NA
Copper	200 ST	7440-50-8	2.5	1.5 U	2.2	NA	6.7 B	NA	NA	2.7 B	NA	NA	2.7 B	NA	NA	NA	NA	NA	NA	NA
Iron	300 ST	7439-89-6	56800	44800	49600	56400	46900	57600	47300	43100	47300	43100	43100	47300	43100	47300	43100	47300	43100	47300
Lead	25 ST	7439-92-1	1.0 U	1.4 U	2.8	2.8 B	1.4 U	1.5 U	1.6 B	0.80 U	1.6 B	0.80 U	0.80 U	1.6 B	0.80 U	1.6 B	0.80 U	1.6 B	0.80 U	1.6 B
Magnesium	35000 GV	7439-95-4	22600	14400	15300	14000	13700	16300	16100	11900	16100	11900	11900	16100	11900	16100	11900	16100	11900	16100
Manganese	300 ST	7439-96-5	1520	1770	2040	2140	1670	1960	3000	1690	3000	1690	1690	3000	1690	3000	1690	3000	1690	3000
Mercury	0.7 ST	7439-97-6	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.10 U	NA	NA	0.10 U	NA	NA	NA	NA	NA	NA	NA
Nickel	100 ST	7440-02-0	1.3 U	1.9 U	1.4 U	NA	4.3 B	NA	NA	4.7 B	NA	NA	4.7 B	NA	NA	NA	NA	NA	NA	NA
Potassium	-	7440-09-7	30800	19800	21800	17900	17500	20300	21800	14300	21800	14300	14300	21800	14300	21800	14300	21800	14300	21800
Selenium	10 ST	7782-49-2	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U	NA	NA	3.8 U	NA	NA	NA	NA	NA	NA	NA
Silver	50 ST	7440-22-4	0.9 U	1.3 B	1.6 U	NA	1 U	NA	NA	1 U	NA	NA	1 U	NA	NA	NA	NA	NA	NA	NA
Sodium	20000 ST	7440-23-5	29900	32100	33300	32500	29700	31600	33900	26400	33900	26400	26400	33900	26400	33900	26400	33900	26400	33900
Thallium	0.5 GV	7440-28-0	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U	NA	NA	2.5 U	NA	NA	NA	NA	NA	NA	NA
Vanadium	-	7440-62-2	3.2	1.1 B	1.7 U	NA	2.6 B	NA	NA	2.1 B	NA	NA	2.1 B	NA	NA	NA	NA	NA	NA	NA
Zinc	2000 ST	7440-66-6	32.3	2.2 U	3.6 U	NA	10 B	NA	NA	14.9 B	NA	NA	14.9 B	NA	NA	NA	NA	NA	NA	NA
Cyanide	200 ST	0057-12-5	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	NA	NA	10 U	NA	NA	NA	NA	NA	NA	NA
Iron + Manganese	500 ST*	-	ug/l	58320	46570	51640	58540	48570	56560	44790	56560	44790	44790	56560	44790	56560	44790	56560	44790	56560

NOTES:

NS: Not sampled
 ST*: Standard for the sum of iron and manganese is 500 ug/l
 : Concentration exceeds Standard/Guidance Value
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B : Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-04S 11/12/2003 (ug/l)	MW-04S 03/02/2004 (ug/l)	MW-04S 05/24/2004 (ug/l)	MW-04S (ug/l)	MW-04S (ug/l)	MW-04S (ug/l)	MW-04S (ug/l)	MW-04S (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	43.2 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	11.4					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	191 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	261 B					
Cadmium	5 ST	7440-43-9	ug/l	0.30 U	0.20 U	2.2 B					
Calcium	-	7440-70-2	ug/l	139000	122000	124000					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.6 U					
Cobalt	-	7440-48-4	ug/l	NA	NA	5 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	0.9 U					
Iron	300 ST	7439-89-6	ug/l	48600	62600	79200					
Lead	25 ST	7439-92-1	ug/l	1.1 U	0.70 U	0.7 U					
Magnesium	35000 GV	7439-95-4	ug/l	18100	13600	14600					
Manganese	300 ST	7439-96-5	ug/l	3690	2360	2180					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	4.4 B					
Potassium	-	7440-09-7	ug/l	20000	17200	16700					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	28600	32000	26700					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.1 B					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	14.7 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	52290	64960	81380					

NOTES:

NS: Not sampled

██████████: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class	Groundwater Values	CAS #	DATE:	SITE:	UNITS:	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041	MW-041
Aluminum	-	7429-90-5		10/29/1997	MW-041	(ug/l)	365	19.9 B	18.7	NA	13.9 B	NA	NA	NA	NA	NA	NA	17.7 B
Antimony	3 GV	7440-36-0		12/06/2000	MW-041	(ug/l)	3	1.7 U	12.3 U	NA	3.1 B	NA	NA	NA	NA	NA	NA	3.5 U
Arsenic	25 ST	7440-38-2		02/01/2001	MW-041	(ug/l)	10.1	14.6	17.1	NA	11.5	NA	NA	NA	NA	NA	NA	17.5
Barium	1000 ST	7440-39-3		08/23/2002	MW-041	(ug/l)	128	175 B	107	NA	135 B	NA	NA	NA	NA	NA	NA	124 B
Beryllium	3 GV	7440-41-7		11/22/2002	MW-041	(ug/l)	0.1	0.14	0.4 U	NA	0.4 U	NA	NA	NA	NA	NA	NA	0.20 U
Boron	1000 ST	7440-42-8		03/06/2003	MW-041	(ug/l)	NA	300	285	NA	231	NA	NA	NA	NA	NA	NA	211
Cadmium	5 ST	7440-43-9		03/06/2003	MW-041	(ug/l)	0.3 U	0.4 U	0.2 U	0.25 B	0.50 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.10 U	0.30 U
Calcium	-	7440-70-2		06/03/2003	MW-041	(ug/l)	53200	92000	62200	41700	85700	85500	101000	90100				
Chromium Hexavalent	50 ST	18540-29-9		08/22/2003	MW-041	(ug/l)	20 U	20 U	20 U	NA	20 U	NA	NA	20 U				20 U
Chromium Total	50 ST	7440-47-3				(ug/l)	0.3 U	3.5 U	0.6 U	NA	1 B	NA	NA	NA	NA	NA	NA	0.70 U
Cobalt	-	7440-48-4				(ug/l)	2.5	1.7 B	1.7 U	NA	1 U	NA	NA	NA	NA	NA	NA	2.1 U
Copper	200 ST	7440-50-8				(ug/l)	5.2	1.5 U	1.5 U	NA	2.8 B	NA	NA	NA	NA	NA	NA	2.2 B
Iron	300 ST	7439-89-6				(ug/l)	31800	55200	38200	29000	56200	53000	62500	56900				
Lead	25 ST	7439-92-1				(ug/l)	3.7	1.9 B	1.9	0.8 U	1.4 U	1.5 U	1.6 B	0.80 U				
Magnesium	35000 GV	7439-95-4				(ug/l)	9580	15700	9960	5690	10700	11100	12800	10400				
Manganese	300 ST	7439-96-5				(ug/l)	480	884	592	576	1410	1270	1640	1420				
Mercury	0.7 ST	7439-97-6				(ug/l)	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.1 U				0.1 U
Nickel	100 ST	7440-02-0				(ug/l)	3.9	1.9 U	1.4 U	NA	3.5 B	NA	NA	5.0 B				
Potassium	-	7440-09-7				(ug/l)	69400	21700	19400	10100	14800	15400	18900	13600				
Selenium	10 ST	7782-49-2				(ug/l)	2.8 U	1.7 U	1.5 U	NA	3.9 B	NA	NA	3.8 U				
Silver	50 ST	7440-22-4				(ug/l)	0.9 U	0.5 U	1.6 U	NA	1 U	NA	NA	1 U				1 U
Sodium	20000 ST	7440-23-5				(ug/l)	29200	32500	22700	13400	26800	25700	34000	27800				
Thallium	0.5 GV	7440-28-0				(ug/l)	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U				
Vanadium	-	7440-62-2				(ug/l)	4.4	0.7 U	1.7 U	NA	1.8 B	NA	NA	2.0 B				
Zinc	2000 ST	7440-66-6				(ug/l)	96.1	6.8 B	3.6 U	NA	19.3 B	NA	NA	7.1 B				
Cyanide	200 ST	0057-12-5				(ug/l)	10 U	10 U	5 U	NA	10 U	NA	NA	10 U				
Iron + Manganese	500 ST*	-				(ug/l)	32280	56084	38792	29576	57610	54270	64140	58320				

NOTES:

NS: Not sampled
 Concentration exceeds Standard/Guidance Value :
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-04I 11/12/2003 (ug/l)	MW-04I 03/01/2004 (ug/l)	MW-04I 05/24/2004 (ug/l)	MW-04I (ug/l)	MW-04I (ug/l)	MW-04I (ug/l)	MW-04I (ug/l)	MW-04I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	50.8 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	17.4					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	100 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.10 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	177 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	1.4 B					
Calcium	-	7440-70-2	ug/l	91200	99100	78500					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.6 U					
Cobalt	-	7440-48-4	ug/l	NA	NA	0.9 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	0.9 U					
Iron	300 ST	7439-89-6	ug/l	56100	61600	50500					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	0.7 U					
Magnesium	35000 GV	7439-95-4	ug/l	10500	10600	8680					
Manganese	300 ST	7439-96-5	ug/l	1510	1790	1420					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.8 B					
Potassium	-	7440-09-7	ug/l	16000	14000	11700					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	29500	30800	22000					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	26.2 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	57610	63390	51920					

NOTES:

NS: Not sampled

ST*: Standard for the sum of iron and manganese is 500 ug/l

█ : Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection
limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: SITE:	UNITS: (ug/l)	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D
					02/01/2001	12/06/2000	08/23/2002	11/21/2002	03/07/2003	06/03/2003	08/25/2003		
Aluminum	-		729-90-5	ug/l	17.7 B	15.7	NA	29.4 B	NA	NA	27.3 B	NA	27.3 B
Antimony	3 GV		7440-36-0	ug/l	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U	NA	3.5 U
Arsenic	25 ST		7440-38-2	ug/l	7.6	11.9	14.4	7.2 B	NA	NA	13.7	NA	13.7
Barium	1000 ST		7440-39-3	ug/l	186	249	224	90.8 B	NA	NA	108 B	NA	108 B
Beryllium	3 GV		7440-41-7	ug/l	0.1	0.1 U	0.16	0.4 U	NA	NA	0.20 U	NA	0.20 U
Boron	1000 ST		7440-42-8	ug/l	NA	291	326	170	NA	NA	120	NA	120
Cadmium	5 ST		7440-43-9	ug/l	0.3 U	0.4 U	0.37	0.5 U	0.1 B	0.1 U	0.30 U	0.10 U	0.30 U
Calcium	-		7440-70-2	ug/l	56100	60000	59100	24700	30800	24000	30900	27500	30900
Chromium Hexavalent	50 ST		18540-29-9	ug/l	20 U	20 U	20 U	20 U	NA	NA	20 U	NA	20 U
Chromium Total	50 ST		7440-47-3	ug/l	0.4 U	3.5 U	0.6 U	1.3 B	NA	NA	0.70 U	NA	0.70 U
Cobalt	-		7440-48-4	ug/l	14.9	17.7 B	14.4	4.3 B	NA	NA	4.4 B	NA	4.4 B
Copper	200 ST		7440-50-8	ug/l	0.7 U	1.5 U	1.5 U	3.4 B	NA	NA	1.6 B	NA	1.6 B
Iron	300 ST		7439-89-6	ug/l	66000	75500	69500	20400	24500	24800	34500	28300	34500
Lead	25 ST		7439-92-1	ug/l	1 U	4	3.6	1.4 U	0.88 B	1.5 U	0.80 U	1.5 U	0.80 U
Magnesium	35000 GV		7439-95-4	ug/l	8830	11500	11100	4060 B	5380	4080 B	4840 B	4550 B	4840 B
Manganese	300 ST		7439-96-5	ug/l	1700	2900	2470	690	589	725	829	764	829
Mercury	0.7 ST		7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	0.1 U	NA	NA	0.10 U	NA	0.10 U
Nickel	100 ST		7440-02-0	ug/l	7.4	7.1 B	5.4	2.3 B	NA	NA	2.6 B	NA	2.6 B
Potassium	-		7440-09-7	ug/l	14000	14900	16200	8650	10700	8970	8800	10500	8800
Selenium	10 ST		7782-49-2	ug/l	2.8 U	2.2 B	1.5 U	2.4 U	NA	NA	3.8 U	NA	3.8 U
Silver	50 ST		7440-22-4	ug/l	0.9 U	1.3 B	1.6 U	1 U	NA	NA	1 U	NA	1 U
Sodium	20000 ST		7440-23-5	ug/l	21100	26500	27500	13700	15300	14000	13300	14900	13300
Thallium	0.5 GV		7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	4.2 U	NA	NA	2.5 U	NA	2.5 U
Vanadium	-		7440-62-2	ug/l	1.2 U	0.7 U	1.7 U	0.82 B	NA	NA	1.8 U	NA	1.8 U
Zinc	2000 ST		7440-66-6	ug/l	85.9	5.9 B	3.6 U	16.7 B	NA	NA	22.8	NA	22.8
Cyanide	200 ST		0057-12-5	ug/l	10 U	10 U	5 U	10 U	NA	NA	10 U	NA	10 U
Iron + Manganese	500 ST*		-	ug/l	67700	78400	71970	25089	21090	2525	35329	29064	35329

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B : Compound detected above instrument detection limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS**

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D
				11/11/2003 (ug/l)	03/01/2004 (ug/l)	05/24/2004 (ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	30.3 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	16.8					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	135 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	96.7 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	1.5 B					
Calcium	-	7440-70-2	ug/l	34000	43400	45500					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.6 U					
Cobalt	-	7440-48-4	ug/l	NA	NA	4.7 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	0.9 U					
Iron	300 ST	7439-89-6	ug/l	35300	45700	48900					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	0.7 U					
Magnesium	35000 GV	7439-95-4	ug/l	5720	7110	7730					
Manganese	300 ST	7439-96-5	ug/l	972	1270	1280					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.5 B					
Potassium	-	7440-09-7	ug/l	11000	10500	10400					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	13900	16400	15000					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	18 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	36272	46970	50180					

NOTES:

NS: Not sampled

: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA	CAS #	DATE:	SITE:	UNITS:	Standards/Guidance Values					
						MW-05S	MW-05S	MW-05S	MW-05S	MW-05S	
Aluminum	-		7429-90-5	ug/l	121	234	313	NA	540	NA	534
Antimony	3 GV		7440-36-0	ug/l	3 U	1.7 U	12.3 U	NA	4.5 B	NA	3.5 U
Arsenic	25 ST		7440-38-2	ug/l	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	6.0 B
Barium	1000 ST		7440-39-3	ug/l	296	214	206	NA	164 B	NA	326
Beryllium	3 GV		7440-41-7	ug/l	0.13	0.23	0.3	NA	0.4 U	NA	0.59 B
Boron	1000 ST		7440-42-8	ug/l	NA	254	226	NA	153	NA	376
Cadmium	5 ST		7440-43-9	ug/l	0.3 U	0.4 U	0.2 U	0.10 U	0.5 U	0.10 U	0.30 U
Calcium	-		7440-70-2	ug/l	105000	93500	90500	71800	74500	74600	102000
Chromium Hexavalent	50 ST		18540-29-9	ug/l	20 U	20 U	20 U	NA	20 U	NA	20 U
Chromium Total	50 ST		7440-47-3	ug/l	6.5	3.5 U	1.7	NA	6 U	NA	1.5 B
Cobalt	-		7440-48-4	ug/l	1.3	0.9 U	1.7 U	NA	1 U	NA	7.4 B
Copper	200 ST		7440-50-8	ug/l	0.7 U	1.5 U	1.5 U	NA	5.4 B	NA	2.9 B
Iron	300 ST		7439-89-6	ug/l	32000	28300	29800	28300	26100	22700	38000
Lead	25 ST		7439-92-1	ug/l	1.0 U	2.9	2.5	0.80 U	1.7 B	1.5 U	1.1 B
Magnesium	35000 GV		7439-95-4	ug/l	17900	13300	12900	8580	7910	9790	14700
Manganese	300 ST		7439-96-5	ug/l	3370	3860	3940	5100	5260	5500	3460
Mercury	0.7 ST		7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	0.10 U
Nickel	100 ST		7440-02-0	ug/l	4.6	1.9 U	1.4 U	NA	8.0 B	NA	5.3 B
Potassium	-		7440-09-7	ug/l	20600	14000	14300	10600	9940	11500	13000
Selenium	10 ST		7782-49-2	ug/l	2.8 U	3.1	2.4	NA	2.4 U	NA	3.8 U
Silver	50 ST		7440-22-4	ug/l	0.9 U	2.1	1.6 U	NA	1 U	NA	1 U
Sodium	20000 ST		7440-23-5	ug/l	35000	28500	27300	28300	27700	25900	24500
Thallium	0.5 GV		7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	2.5 U
Vandium	-		7440-62-2	ug/l	1.8	2.5	2.6	NA	3.6 B	NA	1.9 B
Zinc	2000 ST		7440-66-6	ug/l	25	2.2 U	3.6 U	NA	33.9	NA	112
Cyanide	200 ST		0057-12-5	ug/l	10 U	10 U	5 U	NA	10 U	NA	10 U
Iron + Manganese	500 ST*		-	ug/l	35370	32160	33740	33400	31360	28200	41460

ST*: Standard for the sum of iron and manganese is 500 ug/l

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

NOTES:

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-05S 11/12/2003 (ug/l)	MW-05S 03/02/2004 (ug/l)	MW-05S 05/25/2004 (ug/l)	MW-05S (ug/l)	MW-05S (ug/l)	MW-05S (ug/l)	MW-05S (ug/l)	MW-05S (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	721					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	5 B					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	163 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.68 B					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	122 B					
Cadmium	5 ST	7440-43-9	ug/l	0.30 U	0.20 U	1.2 B					
Calcium	-	7440-70-2	ug/l	102000	69500	49800					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	2.5 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	14.7 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	0.96 B					
Iron	300 ST	7439-89-6	ug/l	23600	26000	31500					
Lead	25 ST	7439-92-1	ug/l	1.1 U	0.70 U	0.7 U					
Magnesium	35000 GV	7439-95-4	ug/l	14200	9650	7280					
Manganese	300 ST	7439-96-5	ug/l	6780	4470	2570					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	7.7 B					
Potassium	-	7440-09-7	ug/l	14900	12500	8370					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	27600	18600	14600					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	25 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	30380	30570	34070					

NOTES:

NS: Not sampled

██████████: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater		Standards/Guidance Values		CAS #	DATE:	SITE:	UNITS:	CONCENTRATION	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
									(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	7429-90-5	-	330	12.2 U	15.8	MW-05I	02/02/2001	(ug/l)	143 B	NA	NA	287	NA	NA	NA	NA	NA	NA	NA
Antimony	7440-36-0	3 GV	3 U	1.7 U	12.3 U	MW-05I	08/23/2002	(ug/l)	3.5 U	NA	NA	3.1 U	NA	NA	NA	NA	NA	NA	NA
Arsenic	7440-38-2	25 ST	4.3	3.5	5.5	MW-05I	11/22/2002	(ug/l)	3.2 U	NA	NA	4.5 U	NA	NA	NA	NA	NA	NA	NA
Barium	7440-39-3	1000 ST	17.8	50.4	57.7	MW-05I	03/07/2003	(ug/l)	50.5 B	NA	NA	43.2 B	NA	NA	NA	NA	NA	NA	NA
Beryllium	7440-41-7	3 GV	0.1	0.1 U	0.1 U	MW-05I	06/03/2003	(ug/l)	0.20 U	NA	NA	0.4 U	NA	NA	NA	NA	NA	NA	NA
Boron	7440-42-8	1000 ST	NA	176	138	MW-05I	08/23/2002	(ug/l)	99.8 B	NA	NA	86 B	NA	NA	NA	NA	NA	NA	NA
Cadmium	7440-43-9	5 ST	0.3 U	0.4 U	0.36	MW-05I	11/22/2002	(ug/l)	0.30 U	NA	NA	0.5 U	NA	NA	NA	NA	NA	NA	NA
Calcium	7440-70-2	-	8280	39200	45300	MW-05I	03/07/2003	(ug/l)	34500	NA	NA	34500	NA	NA	NA	NA	NA	NA	NA
Chromium Hexavalent	18540-29-9	50 ST	20 U	20 U	20 U	MW-05I	06/03/2003	(ug/l)	20 U	NA	NA	20 U	NA	NA	NA	NA	NA	NA	NA
Chromium Total	7440-47-3	50 ST	3.3	3.5 U	0.6 U	MW-05I	08/23/2002	(ug/l)	1.4 B	NA	NA	2.1 B	NA	NA	NA	NA	NA	NA	NA
Cobalt	7440-48-4	-	1.1 U	0.9 U	1.7 U	MW-05I	03/07/2003	(ug/l)	2.1 U	NA	NA	1 U	NA	NA	NA	NA	NA	NA	NA
Copper	7440-50-8	200 ST	2.5	1.5 U	1.5 U	MW-05I	06/03/2003	(ug/l)	3.8 B	NA	NA	2.3 B	NA	NA	NA	NA	NA	NA	NA
Iron	7439-89-6	300 ST	7250	14600	15400	MW-05I	08/23/2002	(ug/l)	1.6 B	NA	NA	9080	NA	NA	NA	NA	NA	NA	NA
Lead	7439-92-1	25 ST	3	1.4 U	1.1 U	MW-05I	11/22/2002	(ug/l)	1.6 B	NA	NA	2.9 B	NA	NA	NA	NA	NA	NA	NA
Magnesium	7439-95-4	35000 GV	1260	6780	8460	MW-05I	03/07/2003	(ug/l)	5460	NA	NA	5940	NA	NA	NA	NA	NA	NA	NA
Manganese	7439-96-5	300 ST	1080	1160	1380	MW-05I	06/03/2003	(ug/l)	1170	NA	NA	1150	NA	NA	NA	NA	NA	NA	NA
Mercury	7439-97-6	0.7 ST	0.1 U	0.1 U	0.1 U	MW-05I	08/23/2002	(ug/l)	0.10 U	NA	NA	0.1 U	NA	NA	NA	NA	NA	NA	NA
Nickel	7440-02-0	100 ST	3.6	1.9 U	1.4 U	MW-05I	03/07/2003	(ug/l)	1.6 B	NA	NA	1.8 B	NA	NA	NA	NA	NA	NA	NA
Potassium	7440-09-7	-	4820	14900	15300	MW-05I	06/03/2003	(ug/l)	12900	NA	NA	8270	NA	NA	NA	NA	NA	NA	NA
Selenium	7782-49-2	10 ST	2.8 U	2.1	1.6	MW-05I	11/22/2002	(ug/l)	3.8 U	NA	NA	2.4 U	NA	NA	NA	NA	NA	NA	NA
Silver	7440-22-4	50 ST	0.9 U	1.1	1.6 U	MW-05I	08/23/2002	(ug/l)	1 U	NA	NA	1 U	NA	NA	NA	NA	NA	NA	NA
Sodium	7440-23-5	20000 ST	12500	20100	24100	MW-05I	03/07/2003	(ug/l)	20700	NA	NA	23600	NA	NA	NA	NA	NA	NA	NA
Thallium	7440-28-0	0.5 GV	2.6 U	2.3 U	2.8 U	MW-05I	06/03/2003	(ug/l)	2.5 U	NA	NA	4.2 U	NA	NA	NA	NA	NA	NA	NA
Vanadium	7440-62-2	-	1.2 U	0.7 U	1.7 U	MW-05I	08/23/2002	(ug/l)	1.8 U	NA	NA	0.67 B	NA	NA	NA	NA	NA	NA	NA
Zinc	7440-66-6	2000 ST	95.3	4.6	3.6 U	MW-05I	03/07/2003	(ug/l)	149	NA	NA	57.4	NA	NA	NA	NA	NA	NA	NA
Cyanide	0057-12-5	200 ST	10 U	10 U	5 U	MW-05I	06/03/2003	(ug/l)	10 U	NA	NA	10 U	NA	NA	NA	NA	NA	NA	NA
Iron + Manganese	500 ST*	-	8330	15760	16780	MW-05I	08/23/2002	(ug/l)	6160	NA	NA	10230	NA	NA	NA	NA	NA	NA	NA

ST*: Standard for the sum of iron and manganese is 500 ug/l

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit
 U: Analyzed for but not detected, value shown is instrument detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-05I 11/12/2003 (ug/l)	MW-05I 03/02/2004 (ug/l)	MW-05I 05/25/2004 (ug/l)	MW-05I (ug/l)	MW-05I (ug/l)	MW-05I (ug/l)	MW-05I (ug/l)	MW-05I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	49 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.3 B					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	7 B					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	83.3 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	139 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.56 B					
Calcium	-	7440-70-2	ug/l	43700	48100	49000					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.6 U					
Cobalt	-	7440-48-4	ug/l	NA	NA	0.9 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	0.9 U					
Iron	300 ST	7439-89-6	ug/l	14500	9820	11300					
Lead	25 ST	7439-92-1	ug/l	1.1 U	0.70 U	0.7 U					
Magnesium	35000 GV	7439-95-4	ug/l	7340	8540	9360					
Manganese	300 ST	7439-96-5	ug/l	1360	883	1170					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.1 U					
Potassium	-	7440-09-7	ug/l	22300	25500	21500					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	34400	36400	29700					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	24.9 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	15860	10703	12470					

NOTES:

NS: Not sampled

█ : Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection
limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA	Groundwater	Standards/Guidance Values	CAS #	DATE:	SITE:	UNIT:	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D
Aluminum	-	7429-90-5	ug/l				241	12.2 U	11.8 U	NA	365	NA	NA	NA	20.8 B	NA	NA	20.8 B
Antimony	3 GV	7440-36-0	ug/l				3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	NA	3.5 U	NA	NA	3.5 U
Arsenic	25 ST	7440-38-2	ug/l				2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	NA	NA	3.2 U	NA	NA	3.2 U
Barium	1000 ST	7440-39-3	ug/l				117	206	190	NA	53.9 B	NA	NA	NA	28.3 B	NA	NA	28.3 B
Beryllium	3 GV	7440-41-7	ug/l				0.17	0.1 U	0.17	NA	0.4 U	NA	NA	NA	0.20 U	NA	NA	0.20 U
Boron	1000 ST	7440-42-8	ug/l				NA	324	292	NA	83.1 B	NA	NA	NA	57.8 B	NA	NA	57.8 B
Cadmium	5 ST	7440-43-9	ug/l				0.3	0.77	0.69	0.30 B	0.5 U	0.10 U	0.25 B	0.30 U	0.30 U	0.30 U	0.30 U	0.30 U
Calcium	-	7440-70-2	ug/l				47300	107000	99900	39500	36900	33700	27800	21600	21600	21600	21600	21600
Chromium Hexavalent	50 ST	18540-29-9	ug/l				20 U	20 U	20 U	NA	20 U	NA	NA	20 U	20 U	20 U	20 U	20 U
Chromium Total	50 ST	7440-47-3	ug/l				2.9	3.5 U	0.85	NA	2.3 B	NA	NA	0.70 U	0.70 U	0.70 U	0.70 U	0.70 U
Cobalt	-	7440-48-4	ug/l				4.6	5.3	4.6	NA	1.6 B	NA	NA	2.1 U	2.1 U	2.1 U	2.1 U	2.1 U
Copper	200 ST	7440-50-8	ug/l				4.8	6.3	4.6	NA	4.9 B	NA	NA	1.2 B	1.2 B	1.2 B	1.2 B	1.2 B
Iron	300 ST	7439-89-6	ug/l				374	101	23.2	763	751	122	60.6 B	53.8 B	53.8 B	53.8 B	53.8 B	53.8 B
Lead	25 ST	7439-92-1	ug/l				1.2	2.1	1.1 U	0.80 U	8.1	1.5 U	1.5 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U
Magnesium	35000 GV	7439-95-4	ug/l				12400	26200	23300	7740	7250	8000	6820	4800 B	4800 B	4800 B	4800 B	4800 B
Manganese	300 ST	7439-96-5	ug/l				17200	21300	17500	8380	8390	7900	7010	5130	5130	5130	5130	5130
Mercury	0.7 ST	7439-97-6	ug/l				0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U
Nickel	100 ST	7440-02-0	ug/l				5.1	7.7	6.7	NA	3.5 B	NA	NA	1.5 U	1.5 U	1.5 U	1.5 U	1.5 U
Potassium	-	7440-09-7	ug/l				20200	33100	33000	13500	11100	9080	8860	5700	5700	5700	5700	5700
Selenium	10 ST	7782-49-2	ug/l				2.8 U	9.3	7.4	NA	3.6 B	NA	NA	3.8 U	3.8 U	3.8 U	3.8 U	3.8 U
Silver	50 ST	7440-22-4	ug/l				0.9 U	5.5	2.9	NA	1 U	NA	NA	1 U	1 U	1 U	1 U	1 U
Sodium	20000 ST	7440-23-5	ug/l				26500	62500	43400	30300	30100	24700	19400	13700	13700	13700	13700	13700
Thallium	0.5 GV	7440-28-0	ug/l				2.6 U	4.6 U	2.8 U	NA	4.2 U	NA	NA	2.5 U	2.5 U	2.5 U	2.5 U	2.5 U
Vanadium	-	7440-62-2	ug/l				1.2 U	0.7 U	1.7 U	NA	1.1 B	NA	NA	1.8 U	1.8 U	1.8 U	1.8 U	1.8 U
Zinc	2000 ST	7440-66-6	ug/l				283	18.7	6	NA	193	NA	NA	12 B	12 B	12 B	12 B	12 B
Cyanide	200 ST	0057-12-5	ug/l				10 U	10 U	5 U	NA	10 U	NA	NA	10 U	10 U	10 U	10 U	10 U
Iron + Manganese	500 ST*	-	ug/l				17574	21401	17522.2	9143	9141	8022	7070.6	5183.8	5183.8	5183.8	5183.8	5183.8

ST*: Standard for the sum of iron and manganese is 500 ug/l

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

NOTES:

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-05D 11/12/2003 (ug/l)	MW-05D 03/02/2004 (ug/l)	MW-05D 05/25/2004 (ug/l)	MW-05D (ug/l)	MW-05D (ug/l)	MW-05D (ug/l)	MW-05D (ug/l)	MW-05D (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	32 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	2.1 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	24.3 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.14 B					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	38 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.25 B	0.5 B					
Calcium	-	7440-70-2	ug/l	20400	26000	17600					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	1.9 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	1.3 B					
Iron	300 ST	7439-89-6	ug/l	257	893	99.9 B					
Lead	25 ST	7439-92-1	ug/l	2.5 B	1.5 B	1.1 B					
Magnesium	35000 GV	7439-95-4	ug/l	4110 B	5030	3630 B					
Manganese	300 ST	7439-96-5	ug/l	3570	3750	4750					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	2.1 B					
Potassium	-	7440-09-7	ug/l	6410	8980	5710					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	12500	21100	12800					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	14.7 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	3827	4643	4849.9					

NOTES:

NS: Not sampled

: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: 10/28/1997	UNITS: (ug/l)	MW-06S 12/05/2000	MW-06S 02/01/2001	MW-06S 08/21/2002	MW-06S 11/20/2002	MW-06S 03/05/2003	MW-06S 06/05/2003	MW-06S 08/22/2003
Aluminum	-		7229-90-5	ug/l	96.2	45.5 B	12.1	143 B	NA	NA	77.2 B
Antimony	3 GV		7440-36-0	ug/l	3 U	1.7 U	12.3 U	3.9 B	NA	NA	3.5 U
Arsenic	25 ST		7440-38-2	ug/l	9.6	3.2 B	8	5.2 B	NA	NA	6.0 B
Barium	1000 ST		7440-39-3	ug/l	306	121 B	101	121 B	NA	NA	219
Beryllium	3 GV		7440-41-7	ug/l	0.1	0.1 U	0.1 U	0.4 U	NA	NA	0.20 U
Boron	1000 ST		7440-42-8	ug/l	NA	162	183	167	NA	NA	362
Cadmium	5 ST		7440-43-9	ug/l	0.3 U	0.4 U	0.2 U	0.5 U	0.10 U	0.10 U	0.30 U
Calcium	-		7440-70-2	ug/l	131000	64500	53100	61000	59500	571000	62400
Chromium Hexavalent	50 ST		18540-29-9	ug/l	20 U	20 U	20 U	20 U	NA	NA	20 U
Chromium Total	50 ST		7440-47-3	ug/l	1.3	3.5 U	0.6 U	1.9 B	NA	NA	1.8 B
Cobalt	-		7440-48-4	ug/l	2.2	0.9 U	1.7 U	2.9 B	NA	NA	5.0 B
Copper	200 ST		7440-50-8	ug/l	0.7 U	1.5 U	1.5 U	2.9 B	NA	NA	2.9 B
Iron	300 ST		7439-89-6	ug/l	58700	48000	40000	37700	31900	25400	46700
Lead	25 ST		7439-92-1	ug/l	1.0 U	1.4 B	1.9	1.3 B	1.4 U	1.5 U	0.86 B
Magnesium	35000 GV		7439-95-4	ug/l	16400	6280	4680	5550	5080	5480	12300
Manganese	300 ST		7439-96-5	ug/l	837	543	430	804	1050	1790	2570
Mercury	0.7 ST		7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	NA	0.1 U
Nickel	100 ST		7440-02-0	ug/l	1.3 U	1.9 U	1.4 U	2.9 B	NA	NA	4.8 B
Potassium	-		7440-09-7	ug/l	18200	8250	8050	7460	6980	7490	10900
Selenium	10 ST		7782-49-2	ug/l	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	3.8 U
Silver	50 ST		7440-22-4	ug/l	0.9 U	0.63 B	1.6 U	NA	1 U	NA	1 U
Sodium	20000 ST		7440-23-5	ug/l	18900	12800	13200	14900	13500	10300	19100
Thallium	0.5 GV		7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	2.5 U
Vanadium	-		7440-62-2	ug/l	1.2 U	0.7 U	1.7 U	NA	2 B	NA	1.8 U
Zinc	2000 ST		7440-66-6	ug/l	14.2	2.2 U	3.6 U	NA	6.1 B	NA	67.6
Cyanide	200 ST		0057-12-5	ug/l	10 U	10 U	5 U	NA	10 U	NA	10 U
Iron + Manganese	500 ST*		-	ug/l	59537	48543	40430	38504	32950	26330	49270

ST*: Standard for the sum of iron and manganese is 500 ug/l

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit
 U: Analyzed for but not detected, value shown is instrument detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-06S 11/11/2003 (ug/l)	MW-06S 02/27/2004 (ug/l)	MW-06S 05/24/2004 (ug/l)	MW-06S (ug/l)	MW-06S (ug/l)	MW-06S (ug/l)	MW-06S (ug/l)	MW-06S (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	34.7 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	6.4 B					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	125 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	279 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.61 B					
Calcium	-	7440-70-2	ug/l	78800	96000	69000					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	1.2 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	3 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	0.9 U					
Iron	300 ST	7439-89-6	ug/l	26500	43900	20700					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	0.7 U					
Magnesium	35000 GV	7439-95-4	ug/l	8330	10800	9770					
Manganese	300 ST	7439-96-5	ug/l	2250	3190	1350					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.6 B					
Potassium	-	7440-09-7	ug/l	9660	13400	13200					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	20400	17700	10400					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	8.4 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	28750	47090	22050					

NOTES:

NS: Not sampled

ST*: Standard for the sum of iron and manganese is 500 ug/l

[shaded box]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection

limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	DATE: 10/28/1997	MW-061 12/05/2000	MW-061 02/01/2001	MW-061 08/21/2002	MW-061 11/21/2002	MW-061 03/05/2003	MW-061 06/05/2003	MW-061 08/22/2003
			UNITS: (ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-		140	17.6 B	16.4	NA	38.8 B	NA	NA	14.2 B
Antimony	3 GV	7440-36-0	3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U
Arsenic	25 ST	7440-38-2	4.3	2.5 U	2.6	NA	4.5 U	NA	NA	3.2 U
Barium	1000 ST	7440-39-3	107	88.4 B	91.4	NA	39.9 B	NA	NA	51.5 B
Beryllium	3 GV	7440-41-7	0.1	0.1 U	0.14	NA	0.4 U	NA	NA	0.2 U
Boron	1000 ST	7440-42-8	NA	149	186	NA	209	NA	NA	357
Cadmium	5 ST	7440-43-9	0.3 U	0.4 U	0.2 U	0.29 B	0.5 U	0.10 U	0.10 U	0.30 U
Calcium	-	7440-70-2	33300	36900	36000	19700	19100	20500	20300	22400
Chromium Hexavalent	50 ST	18540-29-9	20 U	20 U	20 U	NA	20 U	NA	NA	20 U
Chromium Total	50 ST	7440-47-3	0.73	3.5 U	0.6 U	NA	1.5 B	NA	NA	0.70 U
Cobalt	-	7440-48-4	6.4	3 B	2.3	NA	1.1 B	NA	NA	2.5 B
Copper	200 ST	7440-50-8	3.9	2.6 B	1.5 U	NA	9.6 B	NA	NA	2.2 B
Iron	300 ST	7439-89-6	6490	5150	3660	2660	1510	2320	1230	4740
Lead	25 ST	7439-92-1	1	1.4 U	1.1 U	1.9 B	1.4 U	1.5 U	1.9 B	0.80 U
Magnesium	35000 GV	7439-95-4	3810	4020 B	3680	1890 B	1980 B	1790 B	1970 B	2000 B
Manganese	300 ST	7439-96-5	2100	805	807	383	277	392	278	843
Mercury	0.7 ST	7439-97-6	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.1 U
Nickel	100 ST	7440-02-0	2	1.9 U	1.4 U	NA	2.7 B	NA	NA	1.5 B
Potassium	-	7440-09-7	7680	8540	9670	5500	4310 B	5080	5200	5290
Selenium	10 ST	7782-49-2	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U
Silver	50 ST	7440-22-4	0.9 U	0.75 B	1.6 U	NA	1 U	NA	NA	1 U
Sodium	20000 ST	7440-23-5	14000	19600	17400	10700	9230	9870	10000	11400
Thallium	0.5 GV	7440-28-0	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U
Vanadium	-	7440-62-2	1.2 U	0.7 U	1.7 U	NA	0.62 B	NA	NA	1.8 U
Zinc	2000 ST	7440-66-6	61.4	5 B	3.6 U	NA	36.6	NA	NA	9.3 B
Cyanide	200 ST	0057-12-5	10 U	10 U	5 U	NA	10 U	NA	NA	10 U
Iron + Manganese	500 ST*	-	ug/l	8590	5955	4467	3043	1787	2712	5613

NOTES:

NS: Not sampled
 Concentration exceeds Standard/Guidance Value
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-06I	MW-06I	MW-06I	MW-06I	MW-06I	MW-06I	MW-06I
				11/11/2003 (ug/l)	02/27/2004 (ug/l)	05/24/2004 (ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	59 B				
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U				
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.7 B				
Barium	1000 ST	7440-39-3	ug/l	NA	NA	32.7 B				
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U				
Boron	1000 ST	7440-42-8	ug/l	NA	NA	398 B				
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.2 U				
Calcium	-	7440-70-2	ug/l	21600	19700	18700				
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U				
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.69 B				
Cobalt	-	7440-48-4	ug/l	NA	NA	1.2 B				
Copper	200 ST	7440-50-8	ug/l	NA	NA	9.3 B				
Iron	300 ST	7439-89-6	ug/l	4570	4510	2250				
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	0.7 U				
Magnesium	35000 GV	7439-95-4	ug/l	2100 B	1930 B	2200 B				
Manganese	300 ST	7439-96-5	ug/l	861	807	325				
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U				
Nickel	100 ST	7440-02-0	ug/l	NA	NA	4.5 B				
Potassium	-	7440-09-7	ug/l	5990	4200 B	4520 B				
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U				
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U				
Sodium	20000 ST	7440-23-5	ug/l	9000	9820	8590				
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U				
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U				
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	26.8 B				
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U				
Iron + Manganese	500 ST*	-	ug/l	5431	5317	2575				

NOTES:

NS: Not sampled

██████████: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection
limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater		Standards/Guidance Values		CAS #	DATE: 10/28/1997	SITE: MW-06D	UNITS: (ug/l)	MW-06D 12/05/2000	MW-06D 01/31/2001	MW-06D 08/22/2002	MW-06D 11/20/2002	MW-06D 03/05/2003	MW-06D 06/05/2003	MW-06D 08/22/2003
	Groundwater	Guidance Values	Groundwater	Guidance Values											
Aluminum	-	320	12.2 U	14.9	NA	19.3 B	NA	NA	NA	NA	17.2 B	NA	NA	NA	17.2 B
Antimony	3 GV	3 U	1.7 U	12.3 U	NA	4.6 B	NA	NA	NA	NA	3.5 U	NA	NA	NA	3.5 U
Arsenic	25 ST	3.2	2.5 U	1.9 U	NA	4.5 U	NA	NA	NA	NA	3.2 U	NA	NA	NA	3.2 U
Barium	1000 ST	15.1	23.8 B	20.1	NA	19 B	NA	NA	NA	NA	20.4 B	NA	NA	NA	20.4 B
Beryllium	3 GV	0.1 U	0.1 U	0.1 U	NA	0.4 U	NA	NA	NA	NA	0.20 U	NA	NA	NA	0.20 U
Boron	1000 ST	NA	44.7 B	63.6	NA	63.2 B	NA	NA	NA	NA	54.9 B	NA	NA	NA	54.9 B
Cadmium	5 ST	0.3 U	0.4 U	0.2 U	0.16 B	0.5 U	0.10 U	0.10 U	0.10 U	0.10 U	0.30 U	0.10 U	0.10 U	0.10 U	0.30 U
Calcium	-	5070	4640 B	4290	7740	6460	7600	6200	5050	5050	5050	5050	5050	5050	5050
Chromium Hexavalent	50 ST	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U	20 U
Chromium Total	50 ST	1.3	3.5 U	0.6 U	NA	1.5 B	NA	NA	NA	NA	0.70 U	NA	NA	NA	0.70 U
Cobalt	-	6.6	5.7 B	5.3	NA	6.2 B	NA	NA	NA	NA	5.3 B	NA	NA	NA	5.3 B
Copper	200 ST	2.5	2.1 B	1.5 U	NA	6.6 B	NA	NA	NA	NA	1.3 B	NA	NA	NA	1.3 B
Iron	300 ST	5220	5040	4000	6820	4120	6150	5330	4360	4360	4360	4360	4360	4360	4360
Lead	25 ST	1.0 U	1.4 U	1.1 U	0.80 U	1.4 U	1.5 U	2.6 B	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U
Magnesium	35000 GV	2040	1930 B	1800	4020 B	3300 B	3580 B	2740 B	2080 B	2080 B	2080 B	2080 B	2080 B	2080 B	2080 B
Manganese	300 ST	6800	8160	7680	12800	9440	11700	11200	8720	8720	8720	8720	8720	8720	8720
Mercury	0.7 ST	0.1 U	0.1 U	0.1 U	0.1 U	0.1 U	NA	NA	0.1 U	0.1 U	0.1 U	NA	NA	NA	0.1 U
Nickel	100 ST	3.3	2.3 B	2	NA	5.2 B	NA	NA	2.8 B	2.8 B	2.8 B	NA	NA	NA	2.8 B
Potassium	-	1140	1220 B	1260	1560 B	1180 B	1540 B	1680 B	1140 B	1140 B	1140 B	1140 B	1140 B	1140 B	1140 B
Selenium	10 ST	2.8 U	4.3 B	2.9	NA	5.2	NA	NA	3.8 U	3.8 U	3.8 U	NA	NA	NA	3.8 U
Silver	50 ST	0.9 U	2.4 B	1.8	NA	1 U	NA	NA	1 U	1 U	1 U	NA	NA	NA	1 U
Sodium	20000 ST	11600	20400	17700	11800	11000	11400	10900	8960	8960	8960	8960	8960	8960	8960
Thallium	0.5 GV	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U	2.5 U	2.5 U	NA	NA	NA	2.5 U
Vanadium	-	1.2 U	0.7 U	1.7 U	NA	0.63 B	NA	NA	1.8 U	1.8 U	1.8 U	NA	NA	NA	1.8 U
Zinc	2000 ST	75.1	3.8 B	3.6 U	NA	31.8	NA	NA	8.8 B	8.8 B	8.8 B	NA	NA	NA	8.8 B
Cyanide	200 ST	0057-12-5	10 U	10 U	5 U	10 U	NA	NA	10 U	10 U	10 U	NA	NA	NA	10 U
Iron + Manganese	500 ST*	-	12020	13200	11680	19620	17850	16530	13080	13080	13080	13080	13080	13080	13080

NOTES:

NS: Not sampled
 : Concentration exceeds Standard/Guidance Value
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B : Compound detected above instrument detection
 limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS**

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-06D 11/11/2003 (ug/l)	MW-06D 02/27/2004 (ug/l)	MW-06D 05/24/2004 (ug/l)	MW-06D (ug/l)	MW-06D (ug/l)	MW-06D (ug/l)	MW-06D (ug/l)	MW-06D (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	87.6 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	1.6 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.4 B					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	4 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.1 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	55.8 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.23 B					
Calcium	-	7440-70-2	ug/l	5600	5820	6590					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.96 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	0.9 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	5.8 B					
Iron	300 ST	7439-89-6	ug/l	5030	5120	1610					
Lead	25 ST	7439-92-1	ug/l	2.4 B	1.6 U	1.8 B					
Magnesium	35000 GV	7439-95-4	ug/l	2390 B	2470 B	2530 B					
Manganese	300 ST	7439-96-5	ug/l	12500	10000	3730					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	5.7 B					
Potassium	-	7440-09-7	ug/l	1930 B	1340 B	1570 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	1.8 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	8940	9980	7930					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	1.9 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	45.8					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	17530	15120	5340					

NOTES:

NS: Not sampled

██████████: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection
limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater	Standards/Guidance Values	CAS #	DATE: 10/28/1997	SITE: MW-01	DATE: 12/01/2000	SITE: MW-01	DATE: 01/31/2001	SITE: MW-01	DATE: 08/21/2002	SITE: MW-01	DATE: 11/20/2002	SITE: MW-01	DATE: 03/05/2003	SITE: MW-01	DATE: 06/03/2003	SITE: MW-01	DATE: 08/22/2003	SITE: MW-01
				UNITS:	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	7429-90-5		ug/l	90.1	16 B	23.6	NA	37.1 B	NA	NA	37.1 B	NA	NA	NA	NA	NA	13.9	NA
Antimony	3 GV	7440-36-0		ug/l	3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.1 U	NA	NA	NA	NA	NA	3.5 U	NA
Arsenic	25 ST	7440-38-2		ug/l	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	NA	4.5 U	NA	NA	NA	NA	NA	3.2 U	NA
Barium	1000 ST	7440-39-3		ug/l	32.2	39.6 B	29.3	NA	15.4 B	NA	NA	15.4 B	NA	NA	NA	NA	NA	21.6 B	NA
Beryllium	3 GV	7440-41-7		ug/l	0.1 U	0.1 U	0.1 U	NA	0.4 U	NA	NA	0.4 U	NA	NA	NA	NA	NA	0.20 U	NA
Boron	1000 ST	7440-42-8		ug/l	NA	33 B	45.4	NA	30.1 B	NA	NA	30.1 B	NA	NA	NA	NA	NA	38.1 B	NA
Cadmium	5 ST	7440-43-9		ug/l	0.47	0.4 U	0.2 U	0.29 B	0.5 U	0.12 B	0.5 U	0.12 B	0.5 U	0.10 U	0.10 U	0.30 U	0.30 U	8160	NA
Calcium	-	7440-70-2		ug/l	8890	20000	14700	9820	7360	8670	7360	8670	8420	8420	8160	8160	8160	8160	8160
Chromium Hexavalent	50 ST	18540-29-9		ug/l	20 U	20 U	20 U	NA	20 U	NA	NA	20 U	NA	NA	NA	20 U	20 U	20 U	20 U
Chromium Total	50 ST	7440-47-3		ug/l	0.8	3.5 U	0.6 U	NA	0.8 U	NA	NA	0.8 U	NA	NA	NA	0.70 U	0.70 U	0.70 U	0.70 U
Cobalt	-	7440-48-4		ug/l	2.3	0.9 U	1.7 U	NA	1 U	NA	NA	1 U	NA	NA	NA	2.1 U	2.1 U	1.3 B	NA
Copper	200 ST	7440-50-8		ug/l	1.6	1.5 U	1.5 U	NA	3.9 B	NA	NA	3.9 B	NA	NA	NA	1.3 B	1.3 B	1.3 B	1.3 B
Iron	300 ST	7439-89-6		ug/l	396	26.2 B	35.2	350	172	53.9 B	41.4 B	53.9 B	45.0 B	45.0 B	45.0 B	45.0 B	45.0 B	45.0 B	45.0 B
Lead	25 ST	7439-92-1		ug/l	2.8	1.4 U	1.1 U	1.6 B	1.5 B	1.5 U	1.5 U	1.5 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U	0.80 U
Magnesium	35000 GV	7439-95-4		ug/l	1300	4310 B	3080	1630 B	1150 B	1470	1410 B	1150 B	1060 B	1060 B	1060 B	1060 B	1060 B	1060 B	1060 B
Manganese	300 ST	7439-96-5		ug/l	519	6510	5140	2620	1390	2340	3320	2210	2210	2210	2210	2210	2210	2210	2210
Mercury	0.7 ST	7439-97-6		ug/l	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.1 U	NA	NA	NA	0.10 U	0.10 U	0.10 U	0.10 U
Nickel	100 ST	7440-02-0		ug/l	1.8	1.9 U	1.4 U	NA	1.1 U	NA	NA	1.1 U	NA	NA	NA	1.5 U	1.5 U	1.5 U	1.5 U
Potassium	-	7440-09-7		ug/l	3840	2590 B	2460	2230B	2000 B	2020 B	2580 B	2000 B	2100 B	2100 B	2100 B	2100 B	2100 B	2100 B	2100 B
Selenium	10 ST	7782-49-2		ug/l	2.8 U	1.7 U	1.8	NA	2.4 U	NA	NA	2.4 U	NA	NA	NA	3.8 U	3.8 U	3.8 U	3.8 U
Silver	50 ST	7440-22-4		ug/l	0.9 U	1 B	1.6 U	NA	1 U	NA	NA	1 U	NA	NA	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U
Sodium	20000 ST	7440-23-5		ug/l	6950	22300	19600	10700	7960	9570	21100	10200	10200	10200	10200	10200	10200	10200	10200
Thallium	0.5 GV	7440-28-0		ug/l	2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	4.2 U	NA	NA	NA	2.5 U	2.5 U	2.5 U	2.5 U
Vanadium	-	7440-62-2		ug/l	1.2 U	0.7 U	1.7 U	NA	0.6 U	NA	NA	0.6 U	NA	NA	NA	1.8 U	1.8 U	1.8 U	1.8 U
Zinc	2000 ST	7440-66-6		ug/l	51.7	3.8 B	3.6 U	NA	27.9	NA	NA	27.9	NA	NA	8.4 B	8.4 B	8.4 B	8.4 B	8.4 B
Cyanide	200 ST	0057-12-5		ug/l	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	NA	NA	10 U	10 U	10 U	10 U	10 U
Iron + Manganese	500 ST*	-		ug/l	915	6536.2	5155.2	2970	1562	2393.9	3361.4	2255	2255	2255	2255	2255	2255	2255	2255

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit
 ST*: Standard for the sum of iron and manganese is 500 ug/l
 Concentration exceeds Standard/Guidance Value

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-07I 11/11/2003 (ug/l)	MW-07I 02/27/2004 (ug/l)	MW-07I 05/20/2004 (ug/l)	MW-07I (ug/l)	MW-07I (ug/l)	MW-07I (ug/l)	MW-07I (ug/l)	MW-07I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	16.3 U					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	34.3 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	28.9 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.36 B	0.3 U					
Calcium	-	7440-70-2	ug/l	7020	12400	13300					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	1.2 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	4.2 B					
Iron	300 ST	7439-89-6	ug/l	172	55.0 B	65.2 B					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	1290 B	1960 B	2150 B					
Manganese	300 ST	7439-96-5	ug/l	1210	4770	5700					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.6 U					
Potassium	-	7440-09-7	ug/l	1730 B	2600 B	2450 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 B					
Sodium	20000 ST	7440-23-5	ug/l	7950	13200	15700					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	20.4 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	1382	4825	5765.2					

NOTES:

NS: Not sampled

ST*: Standard for the sum of iron and manganese is 500 ug/l

[shaded box]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection

limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class CA Groundwater Standards/Guidance Values	CAS #	DATE: 10/31/1997	DATE: 12/13/2000	DATE: 02/07/2001	DATE: 08/22/2002	DATE: 11/21/2002	DATE: 03/06/2003	DATE: 06/04/2003	DATE: 08/21/2003
			UUNITS: (ug/l)	UUNITS: (ug/l)	UUNITS: (ug/l)	UUNITS: (ug/l)	UUNITS: (ug/l)	UUNITS: (ug/l)	UUNITS: (ug/l)	UUNITS: (ug/l)
Aluminum	-		7429-90-5	703	31.7	47.7	NA	127 B	NA	17.4 B
Antimony	3 GV		7440-30-0	3 U	1.7 U	12.3 U	NA	3.1 U	NA	3.5 U
Arsenic	25 ST		7440-38-2	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	3.2 U
Barium	1000 ST		7440-39-3	30.5	27.3	24.1	NA	28.3 B	NA	8.8 B
Beryllium	3 GV		7440-41-7	0.1 U	0.1 U	0.1 U	NA	0.4 U	NA	0.20 U
Boron	1000 ST		7440-42-8	NA	635	630	NA	206	NA	160
Cadmium	5 ST		7440-43-9	0.3 U	0.4 U	0.2 U	0.10 U	0.5 U	0.10 U	0.30 U
Calcium	-		7440-70-2	39100	58600	53800	46600	51800	78300	9900
Chromium Hexavalent	50 ST		18540-29-9	20 U	20 U	20 U	NA	20 U	NA	20 U
Chromium Total	50 ST		7440-47-3	0.73	3.5 U	9.8	NA	38.9	NA	0.70 U
Cobalt	-		7440-48-4	2.1	1.4	1.8	NA	1.8 B	NA	18.2 B
Copper	200 ST		7440-50-8	3.2	3.2	3	NA	2.9 B	NA	1.8 B
Iron	300 ST		7439-89-6	739	45.6	65.1	4820	575	193	107
Lead	25 ST		7439-92-1	1 U	1.4 U	1.1 U	0.80 U	1.4 U	1.5 B	0.80 U
Magnesium	35000 GV		7439-95-4	4000	6250	5770	4090 B	5250	5880	1750 B
Manganese	300 ST		7439-96-5	1820	5290	4340	1230	1270	843	624
Mercury	0.7 ST		7439-97-6	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	0.10 U
Nickel	100 ST		7440-02-0	2.6	3.1	3.3	NA	3.9 B	NA	39.3 B
Potassium	-		7440-09-7	8620	9070	7980	6970	6570	9540	1390 B
Selenium	10 ST		7782-49-2	2.8 U	3	3	NA	2.4 U	NA	3.8 U
Silver	50 ST		7440-22-4	0.9 U	3.6	1.6 U	NA	1 U	NA	1 U
Sodium	20000 ST		7440-23-5	43700	27900	26900	15000	16700	20300	13800
Thallium	0.5 GV		7440-28-0	3.2	2.3 U	2.8 U	NA	4.2 U	NA	3.2 B
Vanadium	-		7440-62-2	1.8	0.98	1.7 U	NA	0.97 B	NA	1.8 U
Zinc	2000 ST		7440-66-6	12.7	2.2 U	3.6 U	NA	15.2 B	NA	6.6 B
Cyanide	200 ST		0057-12-5	10 U	10 U	5 U	NA	10 U	NA	10 U
Iron + Manganese	500 ST*		-	ug/l	2559	5335.6	4405.1	6050	1845	731

ST*: Standard for the sum of iron and manganese is 500 ug/l

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-11S 11/13/03 (ug/l)	MW-11S 3/1/04 (ug/l)	MW-11S 5/21/04 (ug/l)	MW-11S (ug/l)	MW-11S (ug/l)	MW-11S (ug/l)	MW-11S (ug/l)	MW-11S (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	39.9 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	31.4 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	176 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.3 U					
Calcium	-	7440-70-2	ug/l	66600	94900	53300					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	647					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.8 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	8 B					
Iron	300 ST	7439-89-6	ug/l	636	1310	772					
Lead	25 ST	7439-92-1	ug/l	1.1 U	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	5100	7510	5430					
Manganese	300 ST	7439-96-5	ug/l	207	172	348					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	10.2 B					
Potassium	-	7440-09-7	ug/l	15100	13700	12000					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.3 B					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	70700	47700	34300					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	3.9 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	843	1482	1120					

NOTES:

NS: Not sampled

: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA	Groundwater Standards/Guidance Values	CAS #	DATE: 10/31/1997	SITE: MW-III	UNITS: (ug/l)						
						MW-III 12/13/2000	MW-III 02/07/2001	MW-III 08/22/2002	MW-III 11/21/2002	MW-III 03/06/2003	MW-III 06/04/2003	MW-III 08/21/2003
Aluminum	-	7429-90-5	ug/l	113	22.3	11.8 U	NA	32.8 B	NA	NA	23.8 B	
Antimony	3 GV	7440-36-0	ug/l	3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U	
Arsenic	25 ST	7440-38-2	ug/l	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	NA	3.2 U	
Barium	1000 ST	7440-39-3	ug/l	22.2	1.1	10.3	NA	12.3 B	NA	NA	46.1 B	
Beryllium	3 GV	7440-41-7	ug/l	0.1 U	0.1 U	0.1 U	NA	0.4 U	NA	NA	0.20 U	
Boron	1000 ST	7440-42-8	ug/l	NA	98.2	84	NA	207	NA	NA	124	
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.4 U	0.23	0.20 B	0.5 U	0.10 U	0.10 U	0.30 U	
Calcium	-	7440-70-2	ug/l	10200	9570	9150	8810	15000	15400	16400	77300	
Chromium Hexavalent	50 ST	18540-29-9	ug/l	20 U	20 U	20 U	NA	20 U	NA	NA	20 U	
Chromium Total	50 ST	7440-47-3	ug/l	0.4 U	3.5 U	0.6 U	NA	2.2 B	NA	NA	177	
Cobalt	-	7440-48-4	ug/l	4.7	4	3.2	NA	5 B	NA	NA	2.1 U	
Copper	200 ST	7440-50-8	ug/l	3.1	2.4	1.5 U	NA	2.8 B	NA	NA	7.7 B	
Iron	300 ST	7439-89-6	ug/l	191	24.1	10.2	313	130	63.3 B	58 B	908	
Lead	25 ST	7439-92-1	ug/l	1.7 U	1.4 U	1.1 U	0.80 U	1.4 U	1.5 U	1.5 U	0.80 U	
Magnesium	35000 GV	7439-95-4	ug/l	6510	2670	2670	2620 B	3740 B	3120 B	3180 B	6750	
Manganese	300 ST	7439-96-5	ug/l	245	1590	1340	394	327	1000	1500	248	
Mercury	0.7 ST	7439-97-6	ug/l	0.3 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.10 U	
Nickel	100 ST	7440-02-0	ug/l	4.3	3.5	2.5	NA	8.4 B	NA	NA	14.7 B	
Potassium	-	7440-09-7	ug/l	3870	2690	2270	1640 B	1740 B	1830 B	2050 B	14700	
Selenium	10 ST	7782-49-2	ug/l	8.4 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U	
Silver	50 ST	7440-22-4	ug/l	2.8 U	1.7	1.6 U	NA	1 U	NA	NA	1 U	
Sodium	20000 ST	7440-23-5	ug/l	11100	13200	10400	6680	9510	11400	12600	78800	
Thallium	0.5 GV	7440-28-0	ug/l	2.3 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U	
Vanadium	-	7440-62-2	ug/l	2.6 U	0.95	1.7 U	NA	0.6 U	NA	NA	1.8 U	
Zinc	2000 ST	7440-66-6	ug/l	100	5.4	4.1	NA	51.4	NA	NA	8.6	
Cyanide	200 ST	0057-12-5	ug/l	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	
Iron + Manganese	500 ST*	-	ug/l	436	16141	13502	707	457	1063.3	1558	1156	

ST*: Standard for the sum of iron and manganese is 500 ug/l

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit
 public\Milligan\Sonia 2nd Q04\REPORT\INORGANIC\2ndq04\Detec

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-11I 11/13/2003 (ug/l)	MW-11I 03/01/2004 (ug/l)	MW-11I 05/21/2004 (ug/l)	MW-11I (ug/l)	MW-11I (ug/l)	MW-11I (ug/l)	MW-11I (ug/l)	MW-11I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	16.3 U					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	8.8 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	148 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.29 B	0.3 U					
Calcium	-	7440-70-2	ug/l	7960	16400	14000					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.6 U					
Cobalt	-	7440-48-4	ug/l	NA	NA	25.9 B					
Copper	200 ST	7440-50-8	ug/l	NA	NA	3.8 B					
Iron	300 ST	7439-89-6	ug/l	56.5 B	31.2 B	29.7 B					
Lead	25 ST	7439-92-1	ug/l	1.2 B	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	1400 B	2840 B	2480 B					
Manganese	300 ST	7439-96-5	ug/l	247	1630	1350					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	33.8 B					
Potassium	-	7440-09-7	ug/l	1420 B	1690 B	1300 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.6 B					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	13900	14400	6370					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	4.7 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	303.5	1661.2	1379.7					

NOTES:

NS: Not sampled

█: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS**

Appendix A-2

CONSTITUENT	NYSDEC Class GA Groundwater		Standards/Guidance Values										
	CAS #	DATE:	SITE:	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D
		UNITS:		(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	ug/l	473	578	581	NA	717	NA	NA	NA	629	NA	629
Antimony	3 GV	ug/l	3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	NA	3.5 U	NA	3.5 U
Arsenic	25 ST	ug/l	2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	NA	NA	3.2 U	NA	3.2 U
Barium	1000 ST	ug/l	27.8	34	31.9	NA	37.1 B	NA	NA	NA	38.4 B	NA	38.4 B
Beryllium	3 GV	ug/l	0.1 U	0.22	0.13	NA	0.4 U	NA	NA	NA	0.20 U	NA	0.20 U
Boron	1000 ST	ug/l	NA	42.2	32.6	NA	311	NA	NA	NA	144	NA	144
Cadmium	5 ST	ug/l	0.3 U	0.4 U	0.22	0.28 B	0.5 U	0.10 U	0.10 U	0.11 B	0.30 U	0.30 U	0.30 U
Calcium	-	ug/l	7300	4290	5130	7280	6940	5900	6120	6990	6990	6990	6990
Chromium Hexavalent	50 ST	ug/l	20 U	20 U	20 U	NA	20 U	NA	NA	20 U	20 U	NA	20 U
Chromium Total	50 ST	ug/l	0.43	3.5 U	1.6	NA	1.6 B	NA	NA	NA	1.3 B	NA	1.3 B
Cobalt	-	ug/l	1.1 U	0.9 U	1.7 U	NA	1 U	NA	NA	NA	2.1 U	NA	2.1 U
Copper	200 ST	ug/l	0.7 U	2.3	1.5 U	NA	1.9 B	NA	NA	NA	1.1 U	NA	1.1 U
Iron	300 ST	ug/l	153	16.7	30.6	566	261	155	59.9 B	43.5 B	43.5 B	59.9 B	43.5 B
Lead	25 ST	ug/l	1 U	1.4 U	1.1 U	2.0 B	1.4 B	1.5 U	1.5 U	0.8 U	0.8 U	1.5 U	0.8 U
Magnesium	3500 GV	ug/l	1330	1340	1440	1480 B	1810 B	1580 B	1650 B	1940 B	1940 B	1650 B	1940 B
Manganese	300 ST	ug/l	74.6	76.7	83.5	398	188	143	144	178	178	144	178
Mercury	0.7 ST	ug/l	0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.10 U	0.10 U	NA	0.10 U
Nickel	100 ST	ug/l	2.1	5.3	5.8	NA	12 B	NA	NA	12.4 B	12.4 B	NA	12.4 B
Potassium	-	ug/l	10000	6950	7120	2530 B	5190	5200	6460	5530	5530	6460	5530
Selenium	10 ST	ug/l	2.8 U	1.7 U	2	NA	2.4 U	NA	NA	3.8 U	3.8 U	NA	3.8 U
Silver	50 ST	ug/l	0.9 U	1.2	1.6 U	NA	1 U	NA	NA	1 U	1 U	NA	1 U
Sodium	20000 ST	ug/l	8050	7840	7610	6010	9640	9940	10900	10500	10500	10900	10500
Thallium	0.5 GV	ug/l	2.7	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U	2.5 U	NA	2.5 U
Vanadium	-	ug/l	1.4	0.7 U	1.7 U	NA	0.6 U	NA	NA	1.8 U	1.8 U	NA	1.8 U
Zinc	2000 ST	ug/l	19	2.8	13.6	NA	21	NA	NA	6.0 B	6.0 B	NA	6.0 B
Cyanide	200 ST	ug/l	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	10 U	NA	10 U
Iron + Manganese	500 ST*	-	227.6	93.4	114.1	964	449	298	203.9	221.5	221.5	203.9	221.5

NOTES:

NS: Not sampled
ST*: Standard for the sum of iron and manganese is 500 ug/l

: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection

limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-11D 11/13/2003 (ug/l)	MW-11D 03/01/2004 (ug/l)	MW-11D 05/21/2004 (ug/l)	MW-11D (ug/l)	MW-11D (ug/l)	MW-11D (ug/l)	MW-11D (ug/l)	MW-11D (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	1250					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	47.4 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.22 B					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	61 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.22 B	0.3 U					
Calcium	-	7440-70-2	ug/l	7920	8560	11800					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	2.7 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	3.3 B					
Iron	300 ST	7439-89-6	ug/l	162	38.0 B	556					
Lead	25 ST	7439-92-1	ug/l	1.2 B	1.6 U	4.2					
Magnesium	35000 GV	7439-95-4	ug/l	2140 B	2330 B	2080 B					
Manganese	300 ST	7439-96-5	ug/l	171	227	233					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	14 B					
Potassium	-	7440-09-7	ug/l	7020	7170	6450					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	11000	13300	10600					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	13 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	333	265	789					

NOTES:

NS: Not sampled

[shaded box]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class CA	Standards/Guidance Values	CAS #	UNITS:	DATE:	SITE:	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S							
Aluminum	-	7429-90-5		ug/l	10/31/1997	MW-12S	135 B	109	NA	NA	182 B	NA	NA	NA	13.9 U	Antimony	7440-36-0	ug/l	3 U	1.7 U	12.3 U	NA	NA	NA	3.5 U		
Arsenic	25 ST	7440-38-2		ug/l	10/31/1997	MW-12S	2.5 U	1.9 U	NA	NA	4.5 U	NA	NA	NA	3.2 U	Barium	7440-39-3	ug/l	24.7	35.5 B	32.6	NA	NA	NA	29.1 B		
Beryllium	3 GV	7440-41-7		ug/l	10/31/1997	MW-12S	0.1 U	0.1 U	NA	NA	0.4 U	NA	NA	NA	0.20 U	Boron	7440-42-8	ug/l	NA	102	108	NA	94.5 B	NA	103		
Cadmium	5 ST	7440-43-9		ug/l	10/31/1997	MW-12S	0.4 U	0.2 U	0.10 U	0.10 U	0.5 U	0.10 U	0.10 U	0.30 U	0.30 U	Calcium	7440-70-2	ug/l	32500	38700	45800	45600	42500	40400	28700	46600	
Chromium Hexavalent	50 ST	18540-29-9		ug/l	10/31/1997	MW-12S	20 U	20 U	NA	NA	20 U	NA	NA	20 U	20 U	Chromium Total	7440-47-3	ug/l	8.3	8.7 B	3	NA	NA	NA	9.5 B		
Cobalt	-	7440-48-4		ug/l	10/31/1997	MW-12S	0.9 U	1.7 U	NA	NA	1 U	NA	NA	2.1 U	2.1 U	Copper	7440-50-8	ug/l	0.7 U	3.2 B	1.5 U	NA	NA	NA	1.3 B		
Copper	200 ST	7440-50-8		ug/l	10/31/1997	MW-12S	0.7 U	3.2 B	1.5 U	NA	2.8 B	NA	NA	1.3 B	1.3 B	Iron	7439-89-6	ug/l	326	170	88.4	23200	2390	504	63.5 B		
Lead	25 ST	7439-92-1		ug/l	10/31/1997	MW-12S	1.0 U	1.4 U	1.1 U	0.8 U	1.4 U	1.5 U	1.5 U	0.80 U	0.80 U	Magnesium	7439-95-4	ug/l	1730	1990 B	2280	2530 B	2080 B	2070 B	1720 B	2470 B	
Manganese	300 ST	7439-96-5		ug/l	10/31/1997	MW-12S	29.2	45	14.1	36.2	20.3	45.8	4.8 B	3.4 B	3.4 B	Mercury	7439-97-6	ug/l	0.1 U	0.1 U	0.1 U	NA	NA	0.1 U	0.1 U		
Nickel	100 ST	7440-02-0		ug/l	10/31/1997	MW-12S	1.3 U	3.5 B	1.4 U	NA	2.7 B	NA	NA	2.6 B	2.6 B	Potassium	7440-09-7	ug/l	14700	14900	15400	14400	1200	10700	9400	10700	
Selenium	10 ST	7782-49-2		ug/l	10/31/1997	MW-12S	2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U	3.8 U	Silver	7440-22-4	ug/l	0.9 U	0.5 U	1.6 U	NA	NA	1 U	1 U		
Sodium	20000 ST	7440-23-5		ug/l	10/31/1997	MW-12S	17800	18000	21100	20200	14300	75400	27000	16200	16200	Thallium	7440-28-0	ug/l	2.6 U	2.3 U	2.8 U	NA	NA	4.2 U	NA	2.5 U	
Vanadium	0.5 GV	7440-62-2		ug/l	10/31/1997	MW-12S	1.2 U	0.98 B	1.7 U	NA	1.6 B	NA	NA	1.8 U	1.8 U	Zinc	7440-66-6	ug/l	15	2.2 U	3.6 U	NA	NA	13.9 B	NA	5.3 B	
Zinc	2000 ST	7440-66-6		ug/l	10/31/1997	MW-12S	10 U	10 U	5 U	NA	10 U	NA	NA	10 U	10 U	Cyanide	0057-12-5	ug/l	10 U	10 U	5 U	NA	NA	NA	NA	10 U	
Iron + Manganese	500 ST*	-		ug/l	10/31/1997	MW-12S	355.2	215	102.5	23447	24262	5243	276.8	86.6	66.9	Iron + Manganese	500 ST*	ug/l	355.2	215	102.5	23447	24262	5243	276.8	86.6	66.9

NOTE: NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit
 ST*: Standard for the sum of iron and manganese is 500 ug/l
 F: Filtered by lab for dissolved metals

CONCENTRATION EXCEEDS STANDARD/GUIDANCE VALUE
 :
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S
				11/13/2003 (ug/l)	03/01/2004 (ug/l)	05/21/2004 (ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	22.3 B						
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U						
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U						
Barium	1000 ST	7440-39-3	ug/l	NA	NA	26.8 B						
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U						
Boron	1000 ST	7440-42-8	ug/l	NA	NA	57.3 B						
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.20 U	0.3 U						
Calcium	-	7440-70-2	ug/l	43000	46700	36300						
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U						
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	41.6						
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U						
Copper	200 ST	7440-50-8	ug/l	NA	NA	3.9 B						
Iron	300 ST	7439-89-6	ug/l	40.6 B	324	330						
Lead	25 ST	7439-92-1	ug/l	1.6 B	1.6 U	1.2 U						
Magnesium	35000 GV	7439-95-4	ug/l	2260 B	2580 B	1880 B						
Manganese	300 ST	7439-96-5	ug/l	6.2 B	33.7	22.8						
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U						
Nickel	100 ST	7440-02-0	ug/l	NA	NA	10.6 B						
Potassium	-	7440-09-7	ug/l	26900	17500	15000						
Selenium	10 ST	7782-49-2	ug/l	NA	NA	3.1 B						
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U						
Sodium	20000 ST	7440-23-5	ug/l	25900	38000	30300						
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U						
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U						
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	6 B						
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U						
Iron + Manganese	500 ST*	-	ug/l	46.8	357.7	352.8						

NOTES:

NS: Not sampled

[shaded box]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection
limit but below contract required detection limit

"F": Filtered by lab for dissolved metals

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class CA Groundwater Standards/Guidance Values	CAS #	DATE: 1031/1997	SITE: MW-121	DATE: 12/07/2000	SITE: MW-121	DATE: 02/08/2001	SITE: MW-121	DATE: 08/22/2002	SITE: MW-121	DATE: 11/21/2002	SITE: MW-121	DATE: 03/06/2003	SITE: MW-121	DATE: 06/04/2003	SITE: MW-121	DATE: 08/21/2003
			UNITS: (ug/l)		UNITS: (ug/l)		UNITS: (ug/l)		UNITS: (ug/l)		UNITS: (ug/l)		UNITS: (ug/l)		UNITS: (ug/l)		UNITS: (ug/l)
Aluminum	-		281		38.1 B		13.5		NA		88.5 B		NA		23.4 B		23.4 B
Antimony	3 GV		7440-36-0		3 U		1.7 U		12.3 U		3.1 U		NA		3.5 U		3.5 U
Arsenic	25 ST		7440-38-2		2.4 U		2.5 U		1.9 U		4.5 U		NA		3.2 U		3.2 U
Barium	1000 ST		7440-39-3		25.1		20.2 B		12.6		16.8 B		NA		4.9 B		4.9 B
Beryllium	3 GV		7440-41-7		0.1 U		0.1 U		0.1 U		0.4 U		NA		0.20 U		0.20 U
Boron	1000 ST		7440-42-8		NA		865		423		47.6 B		NA		42.4 B		42.4 B
Cadmium	5 ST		7440-43-9		0.3 U		0.4 U		0.2 U		0.5 U		0.10 U		0.30 U		0.30 U
Calcium	-		7440-70-2		13000		13500		9680		4240 B		6480		4020 B		4020 B
Chromium Hexavalent	50 ST		18540-29-9		20 U		20 U		20 U		20 U		NA		20 U		20 U
Chromium Total	50 ST		7440-47-3		0.4 U		3.5 U		0.6 U		2.7 B		NA		0.70 U		0.70 U
Cobalt	-		7440-48-4		1.1 U		0.9 U		1.7 U		1.2 B		NA		2.1 U		2.1 U
Copper	200 ST		7440-50-8		1		2.4 B		1.5 U		2.8 B		NA		1.1 U		1.1 U
Iron	300 ST		7439-89-6		213		20.9 B		12.4		257		312		25.8 B		25.8 B
Lead	25 ST		7439-92-1		1 U		1.4 U		1.1 U		1.9 B		1.5 U		0.80 U		0.80 U
Magnesium	35000 GV		7439-95-4		4930		3600 B		2400		1220 B		1680 B		1260 B		1260 B
Manganese	300 ST		7439-96-5		1290		1300		1070		345		289		132		132
Mercury	0.7 ST		7439-97-6		0.1 U		NA		0.1 U		0.1 U		NA		0.1 U		0.1 U
Nickel	100 ST		7439-02-0		1.5		1.9 U		1.4 U		3 B		NA		1.5 U		1.5 U
Potassium	-		7440-09-7		1520		2110 B		1810		915 B		1330 B		692 B		692 B
Selenium	10 ST		7782-49-2		2.8 U		1.7 U		1.5 U		2.4 U		NA		3.8 U		3.8 U
Silver	50 ST		7440-22-4		0.9 U		0.65 B		1.6 U		1 U		NA		1 U		1 U
Sodium	20000 ST		7440-23-5		10800		22500		13900		5820		6080		5990		5990
Thallium	0.5 GV		7440-28-0		2.6 U		2.3 U		2.8 U		4.2 U		NA		2.5 U		2.5 U
Vanadium	-		7440-62-2		1.2 U		0.7 U		1.7 U		1.4 B		NA		1.8 U		1.8 U
Zinc	2000 ST		7440-66-6		39.2		13.7 B		9		44.9		NA		8.2 B		8.2 B
Cyanide	200 ST		0057-12-5		10 U		10 U		5 U		NA		NA		10 U		10 U
Iron + Manganese	500 ST*		-		1503		13209		10824		602		601		157.8		157.8

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit
 *: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

**SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS**

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-12I 11/13/2003 (ug/l)	MW-12I 03/01/2004 (ug/l)	MW-12I 05/21/2004 (ug/l)	MW-12I (ug/l)	MW-12I (ug/l)	MW-12I (ug/l)	MW-12I (ug/l)	MW-12I (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	18.2 B					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	6 B					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	36.8 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.21 B	0.3 U					
Calcium	-	7440-70-2	ug/l	4040 B	3880 B	3270 B					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.7 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	3 B					
Iron	300 ST	7439-89-6	ug/l	30.1 B	63.3 B	61.8 B					
Lead	25 ST	7439-92-1	ug/l	1.5 B	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	1280 B	1160 B	982 B					
Manganese	300 ST	7439-96-5	ug/l	125	127	86.4					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.6 U					
Potassium	-	7440-09-7	ug/l	688 B	757 I	658 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.5 B					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	5900	5350	4700 B					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	19 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	155.1	190.3	148.2					

NOTES:

NS: Not sampled

██████████: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B : Compound detected above instrument detection

limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class	Groundwater	Standards/Guidance Values	CAS #	UNITS:	SITE:	DATE:	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D	MW-12D
								(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Aluminum	-	7429-90-5			ug/l		10/31/1997	288	149	18.6	NA	43.5 B	NA	NA	19.9 B				
Antimony	3 GV	7440-36-0			ug/l			3 U	1.7 U	12.3 U	NA	3.1 U	NA	NA	3.5 U				
Arsenic	25 ST	7440-38-2			ug/l			2.4 U	2.5 U	1.9 U	NA	4.5 U	NA	NA	3.2 U				
Barium	1000 ST	7440-39-3			ug/l			6.5	1.5	2.9 U	NA	3.4 B	NA	NA	2.2 B				
Beryllium	3 GV	7440-41-7			ug/l			0.1 U	0.1 U	0.1 U	NA	0.4 U	NA	NA	0.20 U				
Boron	1000 ST	7440-42-8			ug/l			NA	29.4	25.2	NA	16.1 B	NA	NA	24.8 B				
Cadmium	5 ST	7440-43-9			ug/l			0.3 U	0.4 U	0.2 U	0.10 U	0.5 U	0.10 U	0.10 U	0.30 U				
Calcium	-	7440-70-2			ug/l			8460	3180	3660	2580 B	3860 B	5990	6940	6600				
Chromium Hexavalent	50 ST	18540-29-9			ug/l			20 U	20 U	20 U	NA	20 U	NA	NA	20 U				
Chromium Total	50 ST	7440-47-3			ug/l			0.87	3.5 U	1	NA	2 B	NA	NA	0.70 U				
Cobalt	-	7440-48-4			ug/l			1.1 U	0.9 U	1.7 U	NA	1 U	NA	NA	2.1 U				
Copper	200 ST	7440-50-8			ug/l			2.4	1.5 U	1.5 U	NA	1.8 B	NA	NA	1.1 U				
Iron	300 ST	7439-89-6			ug/l			312	20.9	16.5	129	132	12.4 B	33.2 B	23.6 U				
Lead	25 ST	7439-92-1			ug/l			1 U	1.4 U	1.1 U	0.80 U	1.4 U	1.5 U	1.5 U	0.80 U				
Magnesium	35000 GV	7439-95-4			ug/l			2330	1520	1760	1000 B	1590 B	2630 B	3080 B	2900 B				
Manganese	300 ST	7439-96-5			ug/l			82.5	1.8	1.4	11.6 B	4.7 B	3.9 B	1.9 B	1.3 B				
Mercury	0.7 ST	7439-97-6			ug/l			0.1 U	0.1 U	0.1 U	NA	0.1 U	NA	NA	0.10 U				
Nickel	100 ST	7440-02-0			ug/l			1.3 U	1.9 U	1.4 U	NA	1.5 B	NA	NA	1.5 U				
Potassium	-	7440-09-7			ug/l			837	554	673	552 B	438 B	551 B	833 B	481 B				
Selenium	10 ST	7782-49-2			ug/l			2.8 U	1.7 U	1.5 U	NA	2.4 U	NA	NA	3.8 U				
Silver	50 ST	7440-22-4			ug/l			0.9 U	1.4	1.6 U	NA	1 U	NA	NA	1 U				
Sodium	20000 ST	7440-23-5			ug/l			8400	8610	9340	6450	6010	5770	6120	5490				
Thallium	0.5 GV	7440-28-0			ug/l			2.6 U	2.3 U	2.8 U	NA	4.2 U	NA	NA	2.5 U				
Vanadium	-	7440-62-2			ug/l			1.2	0.7 U	1.7 U	NA	0.60 U	NA	NA	1.8 U				
Zinc	2000 ST	7440-66-6			ug/l			311	2.2 U	3.6 U	NA	24.1	NA	NA	2.4 B				
Cyanide	200 ST	0057-12-5			ug/l			10 U	10 U	5 U	NA	10 U	NA	NA	10 U				
Iron + Manganese	500 ST*	-			ug/l			394.5	22.7	17.9	129	136.7	16.3	35.1	24.9				

NOTES:

NS: Not sampled
 U: Analyzed for but not detected, value shown is instrument detection limit
 NA: Not analyzed
 B: Compound detected above instrument detection limit but below contract required detection limit

ST*: Standard for the sum of iron and manganese is 500 ug/l

Appendix A-2

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
INORGANIC PARAMETERS

CONSTITUENT	NYSDEC Class GA Groundwater Standards/Guidance Values	CAS #	SITE: DATE: UNITS:	MW-12D 11/13/2003 (ug/l)	MW-12D 03/01/2004 (ug/l)	MW-12D 05/21/2004 (ug/l)	MW-12D (ug/l)	MW-12D (ug/l)	MW-12D (ug/l)	MW-12D (ug/l)	MW-12D (ug/l)
Aluminum	-	7429-90-5	ug/l	NA	NA	16.3 U					
Antimony	3 GV	7440-36-0	ug/l	NA	NA	2.4 U					
Arsenic	25 ST	7440-38-2	ug/l	NA	NA	3.6 U					
Barium	1000 ST	7440-39-3	ug/l	NA	NA	4 U					
Beryllium	3 GV	7440-41-7	ug/l	NA	NA	0.2 U					
Boron	1000 ST	7440-42-8	ug/l	NA	NA	19.4 B					
Cadmium	5 ST	7440-43-9	ug/l	0.3 U	0.57 B	0.3 U					
Calcium	-	7440-70-2	ug/l	5460	4550 B	3540 B					
Chromium Hexavalent	50 ST	18540-29-9	ug/l	NA	NA	20 U					
Chromium Total	50 ST	7440-47-3	ug/l	NA	NA	0.89 B					
Cobalt	-	7440-48-4	ug/l	NA	NA	1.5 U					
Copper	200 ST	7440-50-8	ug/l	NA	NA	2 B					
Iron	300 ST	7439-89-6	ug/l	21.9 B	58.3 B	33 B					
Lead	25 ST	7439-92-1	ug/l	1.3 B	1.6 U	1.2 U					
Magnesium	35000 GV	7439-95-4	ug/l	2340 B	1940 B	1530 B					
Manganese	300 ST	7439-96-5	ug/l	1.8 B	3.1 B	2.6 B					
Mercury	0.7 ST	7439-97-6	ug/l	NA	NA	0.1 U					
Nickel	100 ST	7440-02-0	ug/l	NA	NA	1.6 U					
Potassium	-	7440-09-7	ug/l	440 B	474 B	403 B					
Selenium	10 ST	7782-49-2	ug/l	NA	NA	2.1 U					
Silver	50 ST	7440-22-4	ug/l	NA	NA	0.5 U					
Sodium	20000 ST	7440-23-5	ug/l	5090	5530	4890 B					
Thallium	0.5 GV	7440-28-0	ug/l	NA	NA	2.8 U					
Vanadium	-	7440-62-2	ug/l	NA	NA	1.7 U					
Zinc	2000 ST	7440-66-6	ug/l	NA	NA	3 B					
Cyanide	200 ST	0057-12-5	ug/l	NA	NA	10 U					
Iron + Manganese	500 ST*	-	ug/l	23.7	61.4	35.6					

NOTES:

NS: Not sampled

ST*: Standard for the sum of iron and manganese is 500 ug/l

[REDACTED]: Concentration exceeds Standard/Guidance Value

U: Analyzed for but not detected, value shown is instrument detection limit

NA: Not analyzed

B: Compound detected above instrument detection
limit but below contract required detection limit

APPENDIX A-3

**HISTORIC AND CURRENT GROUNDWATER SAMPLE RESULTS -
VOLATILE ORGANIC COMPOUNDS**



APPENDIX A-3

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
Ethylbenzene	10/24/1997	000100-414	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Styrene	010061-015	010061-015	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
trans-1,3-Dichloropropene	010061-026	010061-026	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
cis-1,3-Dichloropropene	000106-934	000106-934	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
1,2-Dibromethane	000107-062	000107-062	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Acrylonitrile	000107-131	000107-131	NA	NA	NA	50 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Vinyl Acetate	000108-054	000108-054	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
4-Methyl-2-pentanone	000108-101	000108-101	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Toluene	000108-883	000108-883	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Chlorobenzene	000108-907	000108-907	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
trans-1,4-Dichloro-2-butene	000110-576	000110-576	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Dibromochloromethane	000124-481	000124-481	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Tetrachloroethene	000127-184	000127-184	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Xylene (total)	001330-207	001330-207	0.6 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,2-Dichloroethane (total)	000540-590	000540-590	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
cis-1,2-Dichloroethene	000156-592	000156-592	NA	NA	NA	7.8 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
trans-1,2-Dichloroethene	000156-605	000156-605	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Carbon tetrachloride	000056-235	000056-235	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
2-Hexanone	000591-786	000591-786	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,1,1,2-Tetrachloroethane	000630-206	000630-206	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Acetone	000067-641	000067-641	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Chloroform	000067-663	000067-663	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Benzene	000071-432	000071-432	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,1,1-Trichloroethane	000071-556	000071-556	0.6 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Bromomethane	000074-839	000074-839	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Chloromethane	000074-873	000074-873	0.6 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Iodomethane	000074-884	000074-884	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Dibromomethane	000074-953	000074-953	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Bromodichloromethane	000075-274	000075-274	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Chloroethane	000075-003	000075-003	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Vinyl chloride	000075-014	000075-014	0.6 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Methylene chloride	000075-092	000075-092	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Carbon disulfide	000075-150	000075-150	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Bromoform	000074-252	000074-252	0.6 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Bromochloromethane	000074-975	000074-975	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,1-Dichloroethane	000075-343	000075-343	0.6 U	10.0 U	5.0 U	3.1 U	2.2 U	2.2 U	2.2 U	3.1 U	5.0 U	5.0 U
1,1-Dichloroethane	000075-354	000075-354	0.6 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
Trichlorofluoromethane	000075-694	000075-694	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,2-Dichloropropane	000078-875	000078-875	0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
2-Butanone	000078-933	000078-933	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,1,2-Trichloroethane	000079-005	000079-005	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,1,2-Trichloroethane	000079-016	000079-016	0.4 U	10.0 U	5.0 U	2.1 U	3.3 U	3.3 U	3.3 U	5.0 U	5.0 U	5.0 U
1,1,2,2-Tetrachloroethane	000079-345	000079-345	0.2 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,2-Dichlorobenzene	000085-501	000085-501	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,2-Dibromo-3-chloropropane	000096-128	000096-128	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,2,3-Trichloropropane	000096-184	000096-184	NA	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U
1,1-Dichloropropene	000563-586	000563-586	NA	NA	NA	10 U	10 U	10 U	10 U	10 U	10 U	10 U
TOTAL VOCs			0.4 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U

NOTES

NS: Not Sampled

ST: Standard

NA: Not Analyzed

: Parameter exceeds Standard/Guidance Value

QUALIFIERS
 B: Compound was analyzed for but not detected at the detection limit shown.
 U: Compound was found at a concentration below the detection limit, value estimated.

E: Concentration exceeds instrument range; value estimated.

D: Result taken from analysis at a secondary dilution.

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I	MW-01I		NYSDEC Class GA GROUNDWATER STANDARD/GUIDANCE VALUE
Date of Collection		10/24/1997	01/28/1998	11/30/2000	01/30/2001	11/20/2002	08/21/2003	05/20/2004		
Volatiles Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		(ug/l)
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	0.4 U	10.0 U	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	22	51	14	8.0 J	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	14	13	13	8.5 J	53	2 J	5 U		5 ST
1,1-Dichloroethene	000075-35-4	2 J	10.0 U	2 J	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		38	18.1	29	16.5	53	2	0		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	STANDARD/GUIDANCE VALUE											
Volatile Organic Compounds		(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
			MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D	MW-01D
			05/20/2004	08/21/2003	11/20/2002	01/30/2001	01/30/2000	11/30/2000	01/28/1998	10/24/1997				
Ethylbenzene	000100-414	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Styrene	000100-425	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
trans-1,3-Dichloropropene	010061-015	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
trans-1,3-Dichlorobenzene	010061-026	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,4-Dichlorobenzene	000106-467	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2-Dibromobenzene	000106-834	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2-Dichloroethane	000107-062	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Acrylonitrile	000107-131	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Vinyl Acetate	000108-054	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
4-Methyl-2-pentanone	000108-101	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Toluene	000108-883	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Chlorobenzene	000108-907	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
trans-1,4-Dichloro-2-butene	000110-576	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Dibromochloromethane	000124-481	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	000127-184	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Xylene (total)	001330-207	0.6 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2-Dichloroethene (total)	000540-590	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
cis-1,2-Dichloroethene	000156-605	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
trans-1,2-Dichloroethene	000156-605	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon tetrachloride	000056-235	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	000591-786	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1,2-Tetrachloroethane	000630-206	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Acetone	000067-641	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Chloroform	000067-663	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Benzene	000071-432	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	000071-556	0.6 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Bromomethane	000074-839	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Chloromethane	000074-873	0.6 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Iodomethane	000074-884	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Dibromomethane	000074-953	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Bromodichloromethane	000075-274	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Chloroethane	000075-003	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Vinyl chloride	000075-014	0.6 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Methylene chloride	000075-092	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon disulfide	000075-150	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Bromoform	000074-252	0.6 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Bromochloromethane	000074-975	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethane	000075-343	13	3.3 J	3 J	3.3 J	3 J	3.3 J	3 J	3.3 J	3 J	3.3 J	3 J	3.3 J	3 J
1,1-Dichloroethane	000075-354	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Trichlorofluoromethane	000075-694	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Butanone	000078-933	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2-Dichloropropane	000078-875	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,2-Trichloroethane	000079-005	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Trichloroethene	000079-016	0.4 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,2,2-Tetrachloroethane	000079-345	0.2 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2-Dichlorobenzene	000095-501	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2-Dibromo-3-chloropropane	000096-128	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,2,3-Trichloropropane	000096-184	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloropropene	000563-586	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
TOTAL VOCs														

NOTES

NS: Not Sampled

ST: Standard

NA: Not Analyzed

: Parameter exceeds Standard/Guidance Value

B: Compound was analyzed for but not detected at the detection limit shown.
 U: Compound was found at a concentration below the detection limit, value estimated.
 J: Concentration exceeds instrument calibration range; value estimated.

D: Result taken from analysis at a secondary dilution.

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S	MW-02S		NYSDEC Class GA
Date of Collection		10/27/1997	01/28/1998	11/30/2000	01/31/2001	11/20/2003	08/21/2003	05/20/2004		GROUNDWATER
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	NS	NS	NS		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	NS	NS	NS		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	NS	NS	NS		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	NS	NS	NS		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Chlorobenzene	000108-90-7	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	NS	NS	NS		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		50 GV
Tetrachloroethene	000127-18-4	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
1,2-Dichloroethene (total)	000540-59-0	0.4 U	10.0 U	NA	10 U	NS	NS	NS		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	NS	NS	NS		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	NS	NS	NS		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	NS	NS	NS		5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	NS	NS	NS		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	NS	NS	NS		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		50 GV
Chloroethane	000075-00-3	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	10 U	NS	NS	NS		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	NS	NS	NS		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	NS	NS	NS		5 ST
1,1-Dichloroethane	000075-34-3	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
1,1-Dichloroethene	000075-35-4	0.6 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	NS	NS	NS		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	NS	NS	NS		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	NS	NS	NS		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	NS	NS	NS		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	NS	NS	NS		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NS	NS	NS		5 ST
TOTAL VOCs		0	0	0	0	NS	NS	NS		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
 HISTORIC AND CURRENT SAMPLE RESULTS
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	Volatile Organic Compounds	0	0	0	1.8	0	0	4
				(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
		000100-414	Ethylbenzene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000100-425	Styrene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		010061-015	cis-1,3-Dichloropropene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		010061-026	trans-1,3-Dichloropropene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000106-46-7	1,4-Dichlorobenzene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000106-93-4	1,2-Dibromoethane	NA	NA	NA	10 U	5 U	5 U	5 U
		000107-06-2	1,2-Dichloroethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000107-13-1	Acrylonitrile	NA	NA	NA	50 U	5 U	5 U	5 U
		000108-05-4	Vinyl Acetate	NA	NA	NA	10 U	5 U	5 U	5 U
		000108-10-1	4-Methyl-2-pentanone	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000108-88-3	Toluene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000108-90-7	Chlorobenzene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000110-57-6	trans-1,4-Dichloro-2-butene	NA	NA	NA	10 U	5 U	5 U	5 U
		000124-48-1	Dibromochloromethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000127-18-4	Tetrachloroethene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		001330-20-7	Xylene (total)	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000540-59-0	1,2-Dichloroethene (total)	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000156-59-2	cis-1,2-Dichloroethene	NA	NA	NA	10 U	5 U	5 U	5 U
		000156-60-5	trans-1,2-Dichloroethene	NA	NA	NA	10 U	5 U	5 U	5 U
		000559-1-78-6	2-Hexanone	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000630-20-6	1,1,1,2-Tetrachloroethane	NA	NA	NA	10 U	5 U	5 U	5 U
		000667-64-1	Acetone	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		000674-83-9	Bromomethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00074-87-3	Chloromethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00074-88-4	Iodomethane	NA	NA	NA	10 U	5 U	5 U	5 U
		00074-95-3	Dibromomethane	NA	NA	NA	10 U	5 U	5 U	5 U
		00075-00-3	Chloroethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00075-01-4	Vinyl chloride	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00075-09-2	Methylene chloride	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00075-15-0	Carbon disulfide	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00074-25-2	Bromoform	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00074-97-5	Bromochloromethane	NA	NA	NA	10 U	5 U	5 U	5 U
		00075-34-3	1,1-Dichloroethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00075-35-4	1,1-Dichloroethene	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00075-69-4	Tchlorofluoromethane	NA	NA	NA	10 U	5 U	5 U	5 U
		00078-87-5	1,2-Dichloropropane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00078-93-3	2-Butanone	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00079-00-5	1,1,2-Trichloroethane	10.0 U	5 U	5 U	10 U	5 U	5 U	5 U
		00079-01-6	Trichloroethene	10.0 U	5 U	5 U	1.8 U	5 U	5 U	5 U
		00079-34-5	1,1,2,2-Tetrachloroethane	0.2 U	5 U	5 U	10 U	5 U	5 U	5 U
		00096-12-8	1,2-Dibromo-3-chloropropane	NA	NA	NA	10 U	5 U	5 U	5 U
		00096-18-4	1,2,3-Trichloropropane	NA	NA	NA	10 U	5 U	5 U	5 U
		00096-50-1	1,2-Dichlorobenzene	NA	NA	NA	10 U	5 U	5 U	5 U
		000563-58-6	1,1-Dichloropropene	NA	NA	NA	10 U	5 U	5 U	5 U
			TOTAL VOCs							

NOTES

GT: Guidance Value
 ST: Standard
 NA: Not Analyzed
 NS: Not Sampled

Q: Compound was analyzed for but not detected at the detection limit, value estimated.
 U: Compound was found at a concentration below the detection limit, value estimated.
 E: Concentration exceeds instrument call range; value estimated.

D: Result taken from analysis at a secondary dilution.

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D	MW-02D		NYSDEC Class GA
Date of Collection		10/27/1997	01/28/1998	12/01/2000	01/30/2001	11/20/2002	08/22/2003	05/20/2004		GROUNDWATER
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	1 J	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	0.4 U	10.0 U	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		0	0	0	0	1	0	0		

QUALIFIERS

- B: Compound was found in the method blank as well as the sample
- U: Compound was analyzed for but not detected at the detection limit shown.
- J: Compound was found at a concentration below the detection limit, value estimated
- E: Concentration exceeds instrument calibration range; value estimated.
- D: Result taken from analysis at a secondary dilution.

NOTES

- GV: Guidance Value
- NS: Not Sampled
- ST: Standard
- NA: Not Analyzed
- █ : Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	STANDARD/GUIDANCE VALUE
NYSDEC Class GA GROUNDWATER	STANDARD/GUIDANCE VALUE								
	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S	MW-03S
Ethylbenzene	000100-414	100 U	10 U	5 U	5 U	5 U	5 U	5 U	5 ST
Styrene	000100-425	100 U	10 U	5 U	5 U	5 U	5 U	5 U	5 ST
cis-1,3-Dichloropropene	010061-015	100 U	10 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
trans-1,3-Dichloropropene	010061-026	180 U	100 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
trans-1,4-Dichlorobutene	000110-576	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
Chlorobenzene	000108-907	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
trans-1,4-Dichloro-2-butene	000110-576	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
Dibromochloromethane	000124-481	220 U	100 U	5 U	5 U	5 U	5 U	5 U	50 GV
Tetrachloroethene	000127-184	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Xylene (total)	001330-207	160 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
1,2-Dichloroethene (total)	000540-590	260 U	100 U	NA	NA	NA	NA	NA	5 ST
cis-1,2-Dichloroethene	000156-592	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
trans-1,2-Dichloroethene	000156-605	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
Carbon tetrachloride	000056-235	180 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
2-Hexanone	000591-786	140 U	100 U	5 U	5 U	5 U	5 U	5 U	50 GV
1,1,1,2-Tetrachloroethane	000630-206	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
Acetone	000067-641	340 U	100 U	5 U	5 U	5 U	5 U	5 U	50 GV
Chloroform	000067-663	140 U	100 U	5 U	5 U	5 U	5 U	5 U	7 ST
Benzene	000071-432	140 U	100 U	5 U	5 U	5 U	5 U	5 U	1 ST
1,1,1-Trichloroethane	000071-556	180 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Bromomethane	000074-839	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Chloromethane	000074-873	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Iodomethane	000074-884	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
Dibromomethane	000074-953	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
Bromodichloromethane	000075-274	180 U	100 U	5 U	5 U	5 U	5 U	5 U	50 GV
Chloroethane	000075-003	4 U	100 U	3 U	2.8 U	5 U	5 U	5 U	5 ST
Vinyl chloride	000075-014	140 U	100 U	5 U	5 U	5 U	5 U	5 U	2 ST
Methylene chloride	000075-092	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Carbon disulfide	000075-150	120 U	100 U	5 U	5 U	5 U	5 U	5 U	60 GV
Bromoforn	000074-252	180 U	100 U	5 U	5 U	5 U	5 U	5 U	50 GV
Bromochloromethane	000074-975	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
1,1-Dichloroethane	000075-343	120 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
1,1-Dichloroethane	000075-354	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Trichlorofluoromethane	000075-694	NA	NA	5 U	5 U	5 U	5 U	5 U	5 ST
1,2-Dichloropropane	000078-875	140 U	100 U	5 U	5 U	5 U	5 U	5 U	1 ST
2-Butanone	000078-933	220 U	100 U	5 U	5 U	5 U	5 U	5 U	50 GV
1,1,2-Trichloroethane	000079-005	200 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
Trichloroethene	000079-016	140 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
1,1,2,2-Tetrachloroethane	000079-345	220 U	100 U	5 U	5 U	5 U	5 U	5 U	5 ST
1,2-Dichlorobenzene	000095-501	NA	NA	5 U	5 U	5 U	5 U	5 U	3 ST
1,2-Dibromo-3-chloropropane	000096-128	NA	NA	5 U	5 U	5 U	5 U	5 U	0.04 ST
1,2,3-Trichloropropane	000096-184	NA	NA	5 U	5 U	5 U	5 U	5 U	0.04 ST
1,1-Dichloropropane	000563-586	NA	NA	NA	NA	NA	NA	NA	5 ST
TOTAL VOCs				4	0	3	2.8	0	

NOTES

GT: Guidance Value
ST: Standard
NS: Not Sampled

B: Compound was analyzed for but not detected at the detection limit shown.
U: Compound was found at a concentration below the detection limit, value estimated.
E: Concentration exceeds instrument calibration range; value estimated.

D: Result taken from analysis at a secondary dilution.

: Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S	MW-04S		NYSDEC Class GA
Date of Collection		10/29/1997	02/02/1998	12/06/2000	02/01/2001	11/22/2002	08/25/2003	05/24/2004		GROUNDWATER
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	1 J	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	4 J	3.0 J	3 J	2.9 J	5.5	3 J	2 J		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	0.4 U	10.0 U	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	3.4 J	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	0.2 U	7.2	5 J	3.8 J	5 U	3 J	5 U		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5.7	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		12	13.6	8	6.7	11.2	7	2		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D	MW-04D		NYSDEC Class GA
Date of Collection		10/28/1997	01/28/1998	12/06/2000	02/01/2001	11/21/2002	08/25/2003	05/24/2004		GROUNDWATER
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	1 J	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	1 J	10.0 U	5 U	10 U	5 U	5 U	1 J		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	4 J	2.5 J	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0		3.0 J	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	1 J	2.7 J	4 J	2.5 J	5 U	3 J	3 J		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		23	32.5	4	2.5	1	3	4		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3
 SONIA ROAD LANDFILL
 POST-CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-414	000100-414	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Styrene	000100-425	000100-425	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
cis-1,3-Dichloropropene	010061-015	010061-015	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.4 ST
trans-1,3-Dichloropropene	010061-026	010061-026	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.4 ST
1,4-Dichlorobenzene	000106-467	000106-467	NA	NA	5.0 U	1.2 J	5.0 U	5.0 U	5.0 U	1 J	3 ST
1,2-Dibromethane	000106-934	000106-934	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichloroethane	000107-062	000107-062	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.6 ST
Acrylonitrile	000107-131	000107-131	NA	NA	5.0 U	50.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Vinyl Acetate	000108-054	000108-054	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
4-Methyl-2-pentanol	000108-101	000108-101	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	-
Toluene	000108-883	000108-883	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Chlorobenzene	000108-907	000108-907	5 J	2.4 J	3 J	4.9 J	5.0 U	5.0 U	5.0 U	2 J	5 ST
trans-1,4-Dichloro-2-butene	000110-576	000110-576	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Tetrachloroethene	000127-184	000127-184	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Xylene (total)	001330-207	001330-207	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichloroethene (total)	000540-590	000540-590	0.4 U	10.0 U	NA	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
cis-1,2-Dichloroethene	000156-592	000156-592	NA	NA	5.0 U	NA	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
trans-1,2-Dichloroethene	000156-605	000156-605	NA	NA	5.0 U	NA	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Carbon tetrachloride	000056-235	000056-235	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
2-Hexanone	000591-786	000591-786	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
1,1,1,2-Tetrachloroethane	000630-206	000630-206	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Acetone	000067-641	000067-641	0.4 U	10.0 U	5.0 U	2 J	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Chloroform	000067-663	000067-663	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	7 ST
Benzene	000071-432	000071-432	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	1 ST
1,1,1-Trichloroethane	000071-556	000071-556	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Bromomethane	000074-839	000074-839	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Chloromethane	000074-873	000074-873	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Iodomethane	000074-884	000074-884	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Dibromomethane	000074-953	000074-953	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Bromodichloromethane	000075-274	000075-274	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Chloroethane	000075-003	000075-003	8 J	5 J	3 J	6.2 J	6.6	5.0 U	5.0 U	5.0 U	5 ST
Vinyl chloride	000075-014	000075-014	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	2 ST
Methylene chloride	000075-092	000075-092	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Carbon disulfide	000075-150	000075-150	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	60 GV
Bromoform	000074-252	000074-252	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Bromochloroethane	000074-975	000074-975	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,1-Dichloroethane	000075-343	000075-343	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,1-Dichloroethene	000075-354	000075-354	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Trichlorofluoromethane	000075-694	000075-694	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichloropropane	000078-875	000078-875	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	1 ST
2-Butanone	000078-833	000078-833	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
1,1,2-Trichloroethane	000079-005	000079-005	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Trichloroethene	000079-016	000079-016	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,1,2,2-Tetrachloroethane	000079-345	000079-345	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichlorobenzene	000095-501	000095-501	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	3 ST
1,2-Dibromo-3-chloropropane	000096-128	000096-128	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.04 ST
1,2,3-Trichloropropane	000096-184	000096-184	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.04 ST
1,1-Dichloropropane	000563-586	000563-586	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated.
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES
 GV: Guidance Value
 NS: Not Sampled
 ST: Standard
 NA: Not Analyzed

: Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I	MW-05I		NYSDEC Class GA
Date of Collection		10/29/1997	02/02/1998	12/08/2000	02/02/2001	11/22/2002	08/25/2003	05/25/2004		GROUNDWATER
Volatiles Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	4 J	4.2 J	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	1 J	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	3.5 J	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	4 J	2.2 J	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		8	9.9	0	0	1	0	0		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	Volatile Organic Compounds (ug/l)	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	MW-05D	NYSDEC Class GA
			(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	STANDARD/GUIDANCE VALUE
	10/29/1997	02/03/1998	02/08/2000	02/02/2001	11/22/2002	08/25/2003	05/25/2004	5.0	5.0	5.0	5.0	GROUNDWATER
												GROUNDWATER
												STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	NA	1 J	2.4 J	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	3 ST
1,2-Dibromomethane	000106-93-4	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5.0 U	50.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Vinyl Acetate	000108-05-4	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	-
Toluene	000108-88-3	0.4 U	10.0 U	5.0 U	10.0 U	1 J	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Chlorobenzene	000108-90-7	2 J	3.9 J	2 J	3.4 J	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Tetrachloroethene	000127-18-4	3 J	10.0 U	5.0 U	1.2 J	2 J	1 J	2 J	2 J	2 J	2 J	5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichloroethene (total)	000540-59-0	0.4 U	10.0 U	NA	10.0 U	NA	NA	NA	NA	NA	NA	5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Chloromethane	000074-88-4	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Iodomethane	000074-95-3	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Dibromomethane	000074-95-3	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Chloroethane	000075-00-3	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
Bromochloromethane	000074-97-5	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,1-Dichloroethane	000075-34-3	1 J	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,1-Dichloroethane	000075-35-4	0.6 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Tchlorofluoromethane	000075-69-4	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5 ST
1,2-Dichlorobenzene	000085-50-1	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.04 ST
1,2,3-Trichloropropene	000096-18-4	NA	NA	5.0 U	10.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA	NA	NA	NA	5 ST

NOTES

NS: Not Sampled
ST: Standard

NA: Not Analyzed
: Parameter exceeds Standard/Guidance Value

U: Compound was analyzed for but not detected at the detection limit shown.
J: Compound was found at a concentration below the detection limit, value estimated.

E: Concentration exceeds instrument range; value estimated.

D: Result taken from analysis at a secondary dilution.

QUALIFIERS

B: Compound was found in the method blank as well as the sample

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S	MW-06S		NYSDEC Class GA GROUNDWATER STANDARD/GUIDANCE VALUE
Date of Collection		10/28/1997	01/28/1998	12/05/2000	02/01/2001	11/20/2002	08/22/2003	05/24/2004		
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	1 J	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	4 J	6.2 J	5 U	1.1 J	2 J	2 J	1 J		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	0.4 U	10.0 U	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	1 J	6	1 J	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000830-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	5 U	4.1 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	1 J	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	0.6 U	10.0 U	5 U	2.6 J	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		9	10.3	1	9.7	3	3	1		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3
 SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)
			000100-41-4	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Ethylbenzene	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Styrene	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			cis-1,3-Dichloropropene	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
			trans-1,3-Dichloropropene	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
			1,4-Dichlorobenzene	NA	NA	NA	NA	NA	NA	NA	NA	3 ST
			1,2-Dibromethane	NA	NA	NA	NA	NA	NA	NA	NA	0.4 ST
			1,2-Dichloroethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	0.6 ST
			Acrylonitrile	NA	NA	NA	NA	NA	NA	NA	NA	5 ST
			Vinyl Acetate	NA	NA	NA	NA	NA	NA	NA	NA	5 ST
			4-Methyl-2-pentanone	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	-
			Toluene	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Chlorobenzene	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			trans-1,4-Dichloro-2-butene	NA	NA	NA	NA	NA	NA	NA	NA	5 ST
			Dibromochloromethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			Tetrachloroethene	3 J	10.0 U	2 J	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	50 GV
			Xylene (total)	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			1,2-Dichloroethene (total)	0.4 U	10.0 U	NA	NA	NA	NA	NA	NA	5 ST
			cis-1,2-Dichloroethene	NA	NA	4 J	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			trans-1,2-Dichloroethene	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			Carbon tetrachloride	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			2-Hexanone	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			1,1,1,2-Tetrachloroethane	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			Acetone	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			Chloroform	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	7 ST
			Benzene	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	1 ST
			1,1,1-Trichloroethane	4 J	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Bromomethane	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Chloromethane	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Chloromethane	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Iodomethane	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			Dibromomethane	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			Bromochloromethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			Bromodichloromethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			Chloroethane	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Vinyl chloride	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	2 ST
			Methylene chloride	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Carbon disulfide	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	60 GV
			Bromoform	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			Bromochloromethane	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	1 ST
			2-Butanone	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			1,1,2-Trichloroethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Trichloroethane	0.4 U	10.0 U	23	3.1 J	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			1,1,2,2-Tetrachloroethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			1,2-Dichlorobenzene	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	3 ST
			1,2-Dibromo-3-chloropropane	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	0.04 ST
			1,2,3-Trichloropropane	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	0.04 ST
			1,1-Dichloropropene	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			1,1-Dichloroethane	5 J	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			1,1-Dichloroethane	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			Trichlorofluoromethane	NA	NA	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	5 ST
			1,2-Dichloropropane	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
			2-Butanone	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			1,1,2-Trichloroethane	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
			TOTAL VOCs	12	0	29	3.1	0	0	0	0	0

NOTES

NS: Not Sampled

ST: Standard

NA: Not Analyzed

: Parameter exceeds Standard/Guidance Value

U: Compound was found in the method blank as well as the sample

J: Compound was analyzed for but not detected at the detection limit shown

E: Concentration exceeds instrument range; value estimated

D: Result taken from analysis at a secondary dilution

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D	MW-06D		NYSDEC Class GA GROUNDWATER STANDARD/GUIDANCE VALUE
Date of Collection		10/28/1997	01/28/1998	12/05/2000	01/31/2001	11/20/2002	08/22/2003	05/24/2004		
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		(ug/l)
Ethylbenzene	000100-41-4	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	1 J	10.0 U	5 U	10 U	2 J	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	300 D	500 D			5	2 J	5 U		5 ST
Xylene (total)	001330-20-7	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	480 D	360 D	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	1 J	1	1 J	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	23	17	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	19	19	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	0.6 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	4 J	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	4 J	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	0.4 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	45	36	2 J	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	0.2 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		1776	2032	18	12	8	2	0		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 J: Compound was found at a concentration below the detection limit, value estimated
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	Standard/Guidance Value	Notes
		000100-414	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000100-425	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		010061-015	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
		010061-026	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
		000106-467	NA	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U*	3 ST
		000106-934	NA	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000107-062	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	0.6 ST
		000107-131	NA	50 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000108-054	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000108-101	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	-
		000108-88-3	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000108-90-7	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U*	5 U*	5 ST
		000110-57-6	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000124-48-1	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000127-18-4	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	1 J	5 ST
		001330-20-7	0.6 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000540-59-0	0.4 U	10.0 U	NA	NA	NA	NA	NA	NA	5 ST
		000156-59-2	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000156-60-5	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000056-23-5	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000591-78-6	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000630-20-6	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000067-64-1	0.4 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000067-66-3	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	7 ST
		000071-43-2	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	1 ST
		000071-55-6	0.6 U	10.0 U	2.6 J	6	5 U	5 U	5 U	5 U	5 ST
		000074-83-9	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-87-3	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-88-4	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-95-3	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-27-4	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000075-00-3	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-01-4	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	2 ST
		000075-09-2	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-15-0	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	60 GV
		000074-25-2	0.6 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000074-97-5	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-34-3	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-69-4	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000078-87-5	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	1 ST
		000078-93-3	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000079-00-5	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000079-01-6	0.4 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000079-34-5	0.2 U	10.0 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000095-50-1	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	3 ST
		000096-12-8	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	0.04 ST
		000096-18-4	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	0.04 ST
		000563-58-6	NA	10 U	5 U	5 U	5 U	5 U	5 U	5 U	5 ST
		TOTAL VOCs									

QUALIFIERS
 B: Compound was analyzed for but not detected at the detection limit shown.
 U: Compound was found at a concentration below the detection limit, value estimated.
 E: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.
 U*: Result qualified as non-detected based on validation criteria

NOTES
 ST: Standard
 GV: Guidance Value
 NS: Not Sampled
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S	MW-11S		NYSDEC Class GA GROUNDWATER STANDARD/GUIDANCE VALUE
Date of Collection		10/31/1997	01/28/1998	12/13/2000	02/07/2001	11/21/2002	08/21/2003	05/21/2004		
Volatiles Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		
Ethylbenzene	000100-41-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	1.60 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	24	10	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	22	5 J	5 U	5 U	10		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	3.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	3 J	22	5 U	2.0 J	2 J	2 J	5 U		5 ST
1,1-Dichloroethene	000075-35-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	2.00 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	12	6.5	9	2.2 J	5 U	5 U	1 J		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		39	29.7	31	9.2	2	2	11		

QUALIFIERS

- B: Compound was found in the method blank as well as the sample
- U: Compound was analyzed for but not detected at the detection limit shown.
- J: Compound was found at a concentration below the detection limit, value estimated
- E: Concentration exceeds instrument calibration range; value estimated.
- D: Result taken from analysis at a secondary dilution.

NOTES

- GV: Guidance Value
- NS: Not Sampled
- ST: Standard
- NA: Not Analyzed
- : Parameter exceeds Standard/Guidance Value

SONIA ROAD LANDFILL
 POST CLOSURE GROUNDWATER MONITORING PROGRAM
 HISTORIC AND CURRENT SAMPLE RESULTS
 VOLATILE ORGANIC COMPOUNDS

APPENDIX A-3

Sample ID	Date of Collection	CAS #	Volatile Organic Compounds											
			(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	
		000100-41-4	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000100-42-5	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		010061-01-5	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		010061-02-6	1.80 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000106-46-7	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000106-93-4	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000107-06-2	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000107-13-1	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000108-05-4	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000108-10-1	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000108-88-3	1.20 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000108-90-7	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000110-57-6	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000112-44-1	2.20 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000127-18-4	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		001330-20-7	1.60 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000540-59-0	2.60 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000156-59-2	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000156-60-5	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000566-23-5	1.80 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000591-78-6	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000630-20-6	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		00067-64-1	3.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000077-66-3	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000071-43-2	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000071-55-6	2.1	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
		000074-83-9	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000074-87-3	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000074-88-4	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000074-95-3	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-27-4	1.80 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-00-3	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-01-4	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-09-2	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-15-0	1.20 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000074-25-2	1.80 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000074-97-5	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-34-3	3.2 J	52	100	100	100	100	100	100	100	100	100	
		000075-35-4	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000075-69-4	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000078-87-5	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000078-93-3	2.20 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000079-00-5	2.00 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000079-01-6	1.40 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000079-34-5	2.20 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000095-50-1	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000096-12-8	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000096-18-4	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		000563-58-6	NA	NA	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	
		TOTAL VOCs	9	3.2	62	120.6	0	2	12					

QUALIFIERS
 U: Compound was analyzed for but not detected at the detection limit shown.
 B: Compound was found in the method blank as well as the sample
 J: Compound was found at a concentration below the detection limit, value estimated.
 E: Concentration exceeds instrument range; value estimated.
 D: Result taken from analysis at a secondary dilution.
 NOTES
 ST: Standard
 GV: Guidance Value
 NS: Not Sampled
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D	MW-11D		NYSDEC Class GA GROUNDWATER STANDARD/GUIDANCE VALUE
Date of Collection		10/31/1997	01/28/1998	12/13/2000	02/07/2001	11/21/2002	08/21/2003	05/21/2004		
Volatiles Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		
Ethylbenzene	000100-41-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U*		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	1.60 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	2.60 U	10.0 U	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	2 J	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		7 ST
Benzene	000071-43-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	1.20 U	10.0 U	5 U	10 U	1 J	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	2.00 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		2	0	0	0	1	0	0		

QUALIFIERS

- B: Compound was found in the method blank as well as the sample
- U: Compound was analyzed for but not detected at the detection limit shown.
- J: Compound was found at a concentration below the detection limit, value estimated
- E: Concentration exceeds instrument calibration range; value estimated.
- D: Result taken from analysis at a secondary dilution.
- U*: Result qualified as non-detect based on validation criteria

NOTES

- GV: Guidance Value
- NS: Not Sampled
- ST: Standard
- NA: Not Analyzed
- : Parameter exceeds Standard/Guidance Value

SONIA ROAD LANDFILL
 HISTORIC AND CURRENT SAMPLE RESULTS
 POST-CLOSURE GROUNDWATER MONITORING PROGRAM
 VOLATILE ORGANIC COMPOUNDS

APPENDIX A-3

Sample ID	Date of Collection	CAS #	Standard/Guidance Value							
		(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	
			MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	MW-12S	
			05/21/2004	08/21/2003	11/21/2002	02/05/2001	12/07/2000	01/30/1998	10/31/1997	
			GROUNDWATER							NYSDEC Class GA
			STANDARD/GUIDANCE VALUE							
Volatile Organic Compounds										
Ethylbenzene		000100-4-4	5 U	5 U	5 U	5 U	5 U	5 U	5 U	
Styrene		000100-4-5	5 U	5 U	5 U	5 U	5 U	5 U	5 U	
cis-1,3-Dichloropropene		010061-01-5	5 U	5 U	5 U	5 U	5 U	5 U	5 U	
trans-1,3-Dichloropropene		010061-02-6	1.80 U	1.80 U	1.80 U	1.80 U	1.80 U	1.80 U	1.80 U	
1,4-Dichlorobenzene		000106-46-7	NA	NA	NA	NA	NA	NA	NA	
1,2-Dibromomethane		000106-93-4	NA	5 U	5 U	5 U	5 U	5 U	5 U	
1,2-Dichloroethane		000107-08-2	1.40 U	1.40 U	1.40 U	1.40 U	1.40 U	1.40 U	1.40 U	
Acrylonitrile		000107-13-1	NA	50 U	5 U	5 U	5 U	5 U	5 U	
Vinyl Acetate		000108-05-4	NA	5 U	5 U	5 U	5 U	5 U	5 U	
4-Methyl-2-pentanone		000108-10-1	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
Toluene		000108-88-3	1.20 U	5 U	5 U	5 U	5 U	5 U	5 U	
Chlorobenzene		000108-90-7	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
trans-1,4-Dichloro-2-butene		000110-57-6	NA	5 U	5 U	5 U	5 U	5 U	5 U	
Dibromochloromethane		000124-48-1	2.20 U	5 U	5 U	5 U	5 U	5 U	5 U	
Tetrachloroethene		000127-18-4	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
Xylenes (total)		001330-20-7	1.60 U	5 U	5 U	5 U	5 U	5 U	5 U	
1,2-Dichloroethene (total)		000540-59-0	2.60 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
cis-1,2-Dichloroethene		000156-59-2	NA	5 U	5 U	5 U	5 U	5 U	5 U	
trans-1,2-Dichloroethene		000156-60-5	NA	5 U	5 U	5 U	5 U	5 U	5 U	
Carbon tetrachloride		000556-23-5	1.80 U	5 U	5 U	5 U	5 U	5 U	5 U	
2-Hexanone		000591-78-6	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
1,1,1,2-Tetrachloroethane		000630-20-6	NA	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Acetone		000067-64-1	3.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
Chloroform		000067-68-3	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
Benzene		000071-43-2	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
1,1,1-Trichloroethane		000071-55-6	1.80 U	5 U	5 U	5 U	5 U	5 U	5 U	
Bromomethane		000074-83-9	1.40 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Chloromethane		000074-87-3	1.40 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Iodomethane		000074-88-4	NA	5 U	5 U	5 U	5 U	5 U	5 U	
Dibromomethane		000074-95-3	NA	5 U	5 U	5 U	5 U	5 U	5 U	
Bromodichloromethane		000075-27-4	1.80 U	5 U	5 U	5 U	5 U	5 U	5 U	
Chloroethane		000075-00-3	1.40 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Vinyl chloride		000075-01-4	1.40 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Methylene chloride		000075-09-2	1.40 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Carbon disulfide		000075-15-0	1.20 U	5 U	5 U	5 U	5 U	5 U	5 U	
Bromoform		000074-25-2	1.80 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Bromochloromethane		000074-97-5	NA	5 U	5 U	5 U	5 U	5 U	5 U	
1,1-Dichloroethane		000075-34-3	1.20 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
1,1-Dichloroethane		000075-35-4	1.40 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
Trichlorofluoromethane		000075-69-4	NA	5 U	5 U	5 U	5 U	5 U	5 U	
2-Butanone		000078-93-3	2.20 U	5 U	5 U	5 U	5 U	5 U	5 U	
1,2-Dichloropropane		000078-87-5	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
1,1,2-Trichloroethane		000079-00-5	2.00 U	5 U	5 U	5 U	5 U	5 U	5 U	
Trichloroethene		000079-01-6	1.40 U	5 U	5 U	5 U	5 U	5 U	5 U	
1,1,2,2-Tetrachloroethane		000079-34-5	2.20 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	10.0 U	
1,2-Dichlorobenzene		000095-50-1	NA	5 U	5 U	5 U	5 U	5 U	5 U	
1,2-Dibromo-3-chloropropane		000096-12-8	NA	5 U	5 U	5 U	5 U	5 U	5 U	
1,2,3-Trichloropropane		000096-18-4	NA	5 U	5 U	5 U	5 U	5 U	5 U	
1,1-Dichloropropene		000563-58-6	NA	10 U	10 U	10 U	10 U	10 U	10 U	
TOTAL VOCs			0	0	2	0	0	0	0	

NOTES

ST: Standard
 NS: Not Sampled
 GV: Guidance Value

B: Compound was analyzed for but not detected at the detection limit shown.
 U: Compound was found at a concentration below the detection limit, value estimated.
 E: Concentration exceeds instrument callibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

Parameter exceeds Standard/Guidance Value
 NA: Not Analyzed

APPENDIX A-3

SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID		MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I	MW-12I		NYSDEC Class GA
Date of Collection		10/31/1997	01/30/1998	12/07/2000	02/08/2001	11/21/2002	08/21/2003	05/21/2004		GROUNDWATER
Volatile Organic Compounds	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)		STANDARD/GUIDANCE VALUE
Ethylbenzene	000100-41-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Styrene	000100-42-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
cis-1,3-Dichloropropene	010061-01-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
trans-1,3-Dichloropropene	010061-02-6	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.4 ST
1,4-Dichlorobenzene	000106-46-7	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromoethane	000106-93-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethane	000107-06-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		0.6 ST
Acrylonitrile	000107-13-1	NA	NA	5 U	50 U	5 U	5 U	5 U		5 ST
Vinyl Acetate	000108-05-4	NA	NA	5 U	10 U	5 U	5 U	5 U		-
4-Methyl-2-pentanone	000108-10-1	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		-
Toluene	000108-88-3	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chlorobenzene	000108-90-7	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,4-Dichloro-2-butene	000110-57-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromochloromethane	000124-48-1	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Tetrachloroethene	000127-18-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Xylene (total)	001330-20-7	1.60 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloroethene (total)	000540-59-0	2.60 U	10.0 U	NA	10 U	NA	NA	NA		5 ST
cis-1,2-Dichloroethene	000156-59-2	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
trans-1,2-Dichloroethene	000156-60-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon tetrachloride	000056-23-5	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
2-Hexanone	000591-78-6	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,1,2-Tetrachloroethane	000630-20-6	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Acetone	000067-64-1	3.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroform	000067-66-3	1.40 U	10.0 U	5 U	10 U	5 U	2 J	1 J		7 ST
Benzene	000071-43-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
1,1,1-Trichloroethane	000071-55-6	1 J	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Bromomethane	000074-83-9	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Chloromethane	000074-87-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Iodomethane	000074-88-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Dibromomethane	000074-95-3	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
Bromodichloromethane	000075-27-4	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Chloroethane	000075-00-3	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Vinyl chloride	000075-01-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		2 ST
Methylene chloride	000075-09-2	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Carbon disulfide	000075-15-0	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		60 GV
Bromoform	000074-25-2	1.80 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
Bromochloromethane	000074-97-5	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethane	000075-34-3	1.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1-Dichloroethene	000075-35-4	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichlorofluoromethane	000075-69-4	NA	NA	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichloropropane	000078-87-5	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		1 ST
2-Butanone	000078-93-3	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		50 GV
1,1,2-Trichloroethane	000079-00-5	2.00 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
Trichloroethene	000079-01-6	1.40 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,1,2,2-Tetrachloroethane	000079-34-5	2.20 U	10.0 U	5 U	10 U	5 U	5 U	5 U		5 ST
1,2-Dichlorobenzene	000095-50-1	NA	NA	5 U	10 U	5 U	5 U	5 U		3 ST
1,2-Dibromo-3-chloropropane	000096-12-8	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,2,3-Trichloropropane	000096-18-4	NA	NA	5 U	10 U	5 U	5 U	5 U		0.04 ST
1,1-Dichloropropene	000563-58-6	NA	NA	NA	10 U	NA	NA	NA		5 ST
TOTAL VOCs		1	0	0	0	0	2	1		

QUALIFIERS

B: Compound was found in the method blank as well as the sample
 U: Compound was analyzed for but not detected at the detection limit shown.
 E: Compound was found at a concentration below the detection limit, value estimated
 J: Concentration exceeds instrument calibration range; value estimated.
 D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value NS: Not Sampled
 ST: Standard
 NA: Not Analyzed
 : Parameter exceeds Standard/Guidance Value

APPENDIX A-3
SONIA ROAD LANDFILL
POST CLOSURE GROUNDWATER MONITORING PROGRAM
HISTORIC AND CURRENT SAMPLE RESULTS
VOLATILE ORGANIC COMPOUNDS

Sample ID	Date of Collection	CAS #	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	(ug/l)	STANDARD/GUIDANCE VALUE
		000100-414	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000100-425	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		010061-015	1.40 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
		010061-026	1.80 U	5 U	5 U	5 U	5 U	5 U	0.4 ST
		000106-467	NA	NA	5 U	5 U	5 U	5 U	3 ST
		000106-934	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000107-062	1.40 U	5 U	5 U	5 U	5 U	5 U	0.6 ST
		000107-131	NA	NA	50 U	5 U	5 U	5 U	5 ST
		000108-054	NA	NA	5 U	5 U	5 U	5 U	-
		000108-101	1.40 U	5 U	5 U	5 U	5 U	5 U	-
		000108-883	1.20 U	5 U	5 U	2 J	5 U	5 U	5 ST
		000108-907	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000110-576	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000124-481	2.20 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000127-184	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		001330-207	1.60 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000540-590	2.60 U	10.0 U	NA	NA	NA	NA	5 ST
		000156-592	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000156-605	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000056-235	1.80 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000591-786	1.40 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000630-206	NA	NA	5 U	5 U	5 U	5 U	5 ST
		00067-641	3.40 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000067-663	1.40 U	5 U	5 U	5 U	5 U	5 U	7 ST
		000071-432	1.40 U	5 U	5 U	5 U	5 U	5 U	1 ST
		000071-556	1.80 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-839	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-873	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-884	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000074-953	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000075-274	1.80 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000075-003	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-092	1.40 U	5 U	5 U	5 U	5 U	5 U	2 ST
		000075-150	1.20 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000074-252	1.80 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000074-975	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000075-343	1.20 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-354	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000075-694	NA	NA	5 U	5 U	5 U	5 U	5 ST
		000078-875	1.40 U	5 U	5 U	5 U	5 U	5 U	1 ST
		000078-933	2.20 U	5 U	5 U	5 U	5 U	5 U	50 GV
		000079-005	2.00 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000079-016	1.40 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000079-345	2.20 U	5 U	5 U	5 U	5 U	5 U	5 ST
		000095-501	NA	NA	5 U	5 U	5 U	5 U	3 ST
		000096-128	NA	NA	5 U	5 U	5 U	5 U	0.04 ST
		000096-184	NA	NA	5 U	5 U	5 U	5 U	0.04 ST
		000563-586	NA	NA	10 U	NA	NA	NA	5 ST

QUALIFIERS

- B: Compound was found in the method blank as well as the sample
- C: Compound was analyzed for but not detected at the detection limit shown.
- J: Compound was found at a concentration below the detection limit, value estimated.
- E: Concentration exceeds instrument calibration range; value estimated.
- D: Result taken from analysis at a secondary dilution.

NOTES

GV: Guidance Value

NS: Not Sampled

ST: Standard

NA: Not Analyzed

: Parameter exceeds Standard/Guidance Value




APPENDIX A-4


**HISTORIC TREND GRAPHS - ALKALINITY, IRON PLUS MANGANESE,
TOTAL DISSOLVED SOLIDS AND SPECIFIC CONDUCTIVITY
RESULTS FROM SELECTED MONITORING WELLS**




HISTORIC SPECIFIC CONDUCTIVITY RESULTS IN SELECTED SHALLOW WELLS

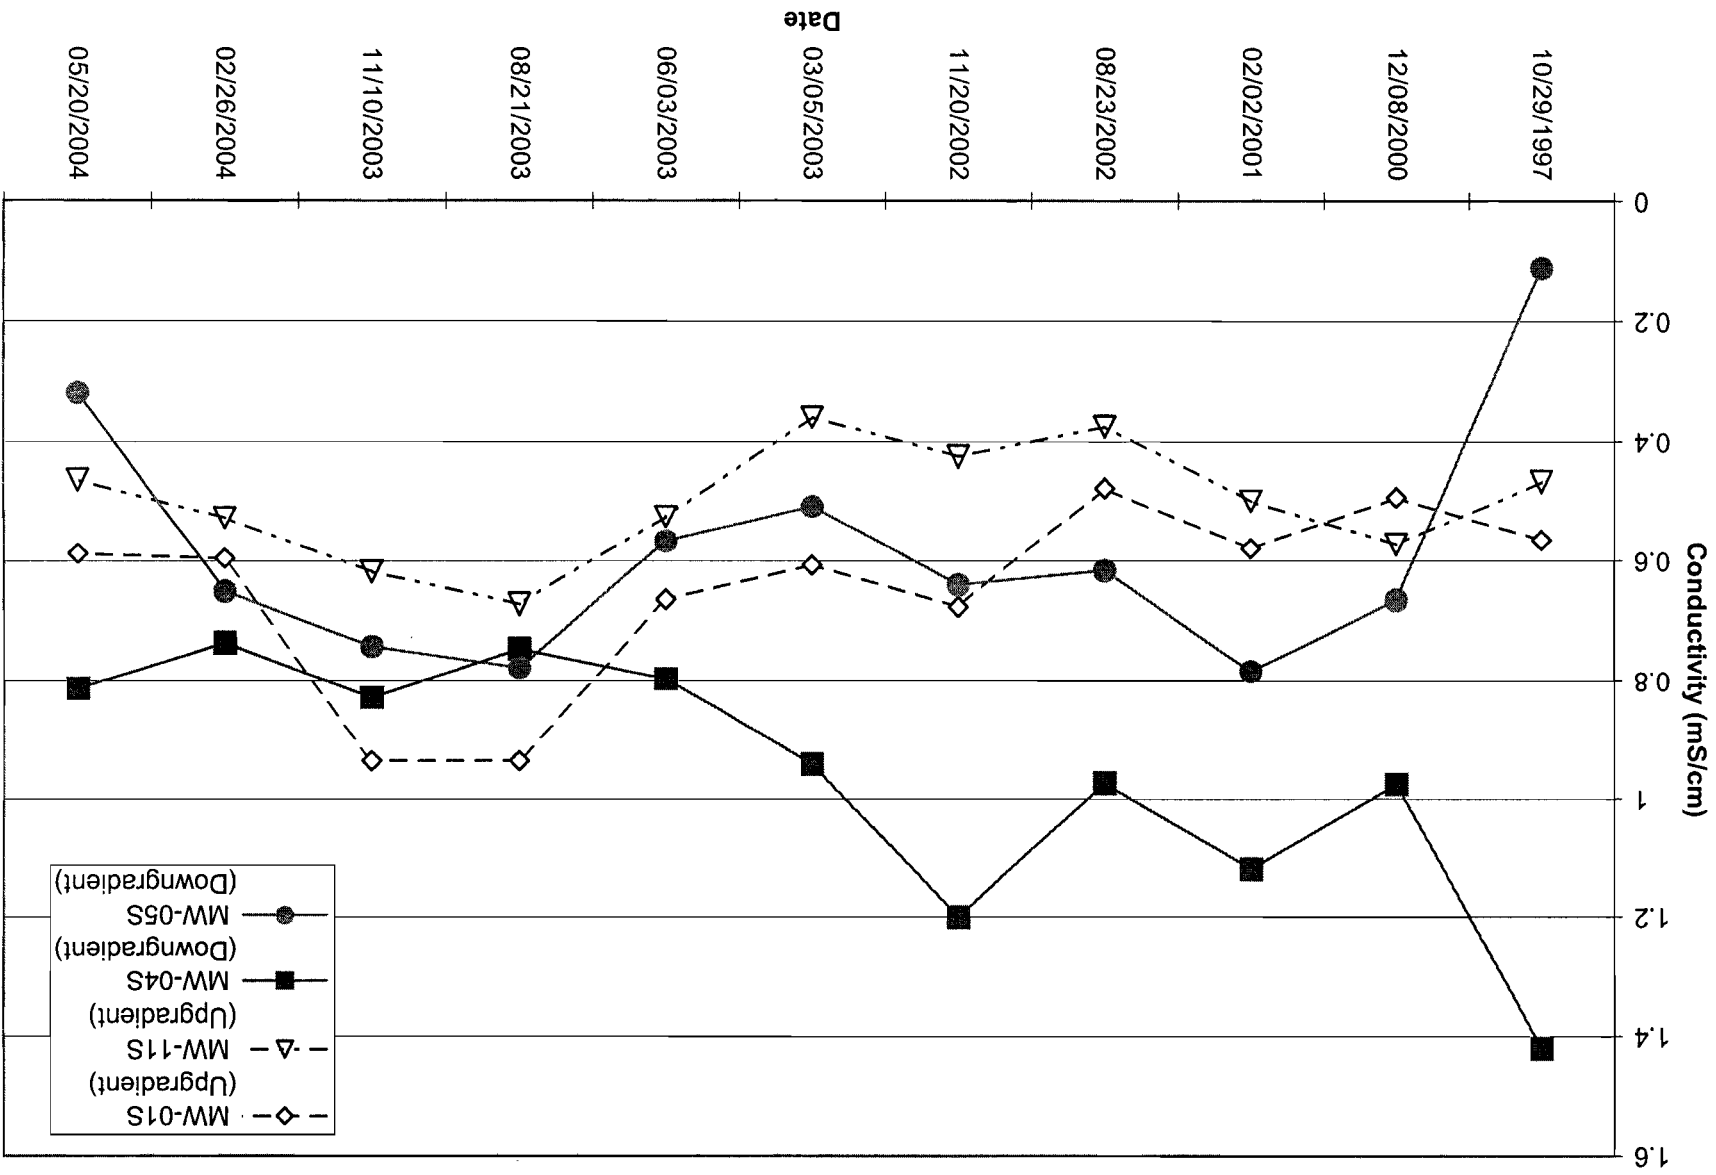


HISTORIC IRON + MANGANESE RESULTS IN SELECTED SHALLOW WELLS

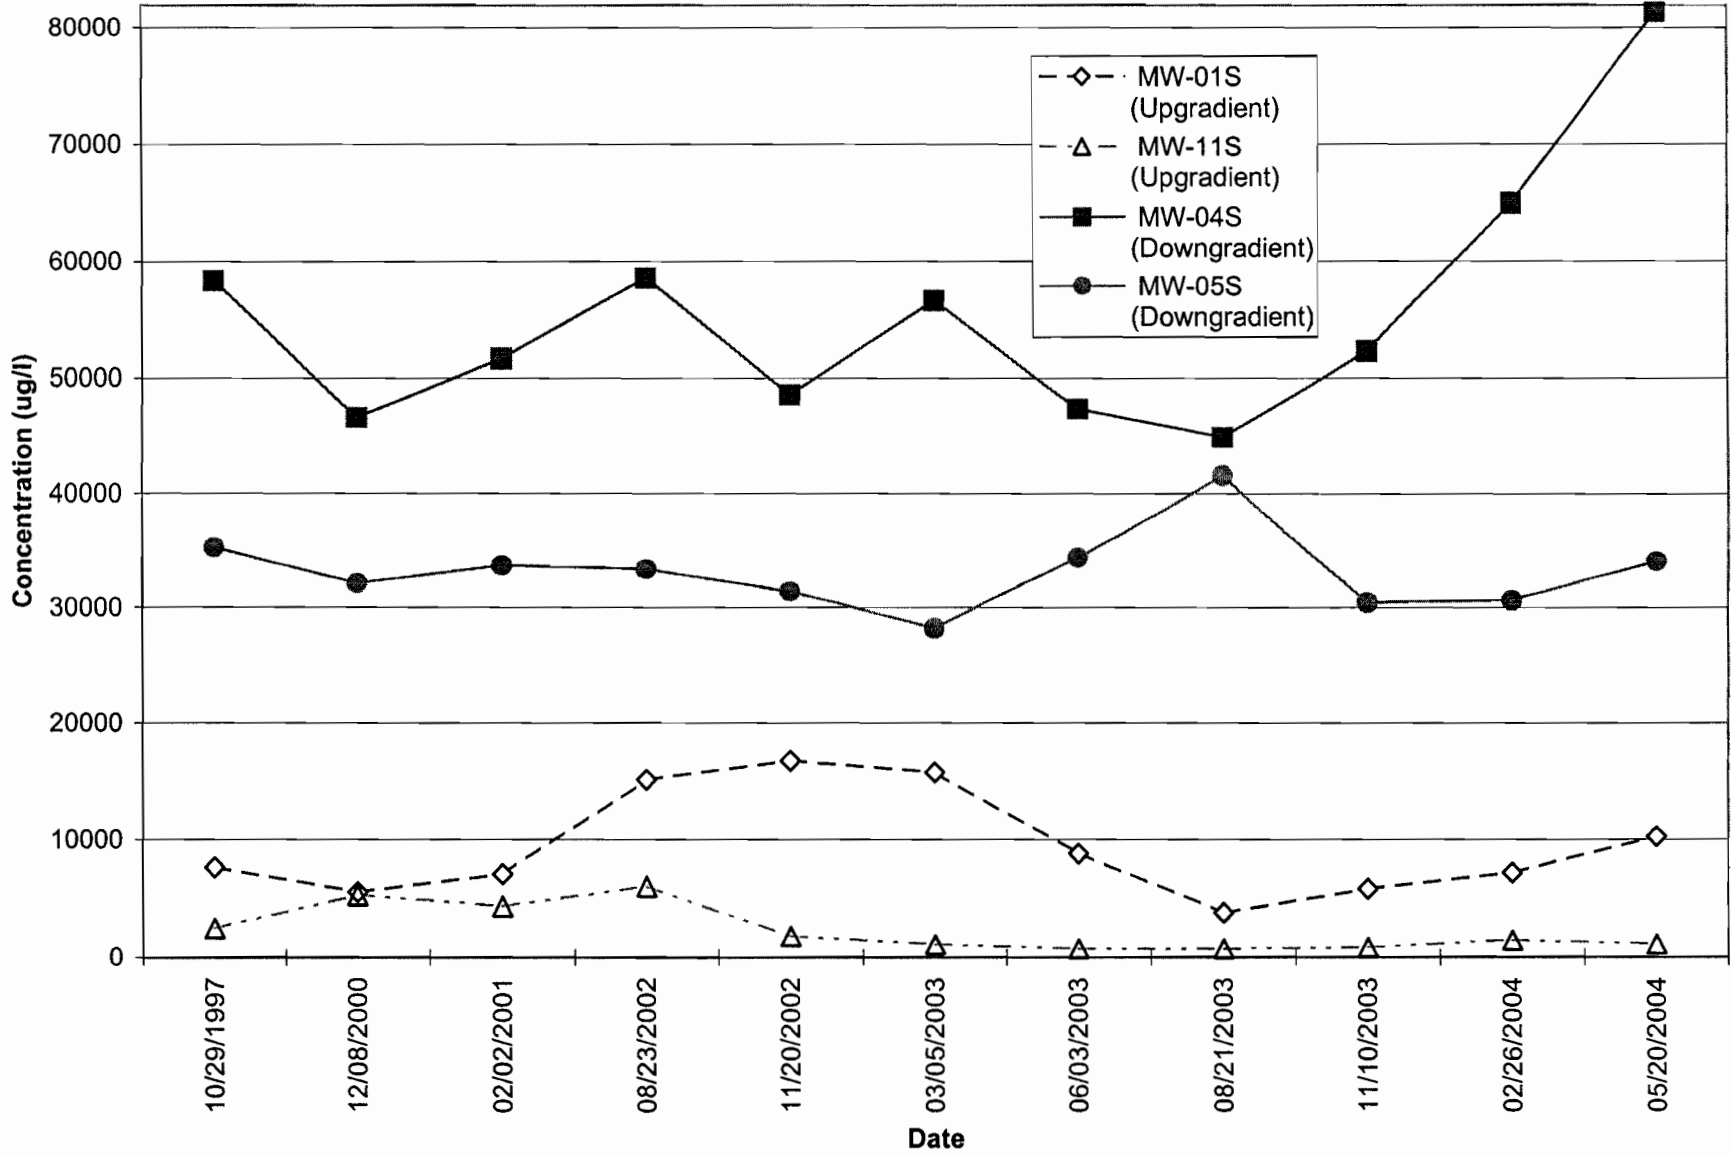


HISTORIC ALKALINITY RESULTS IN SELECTED SHALLOW WELLS

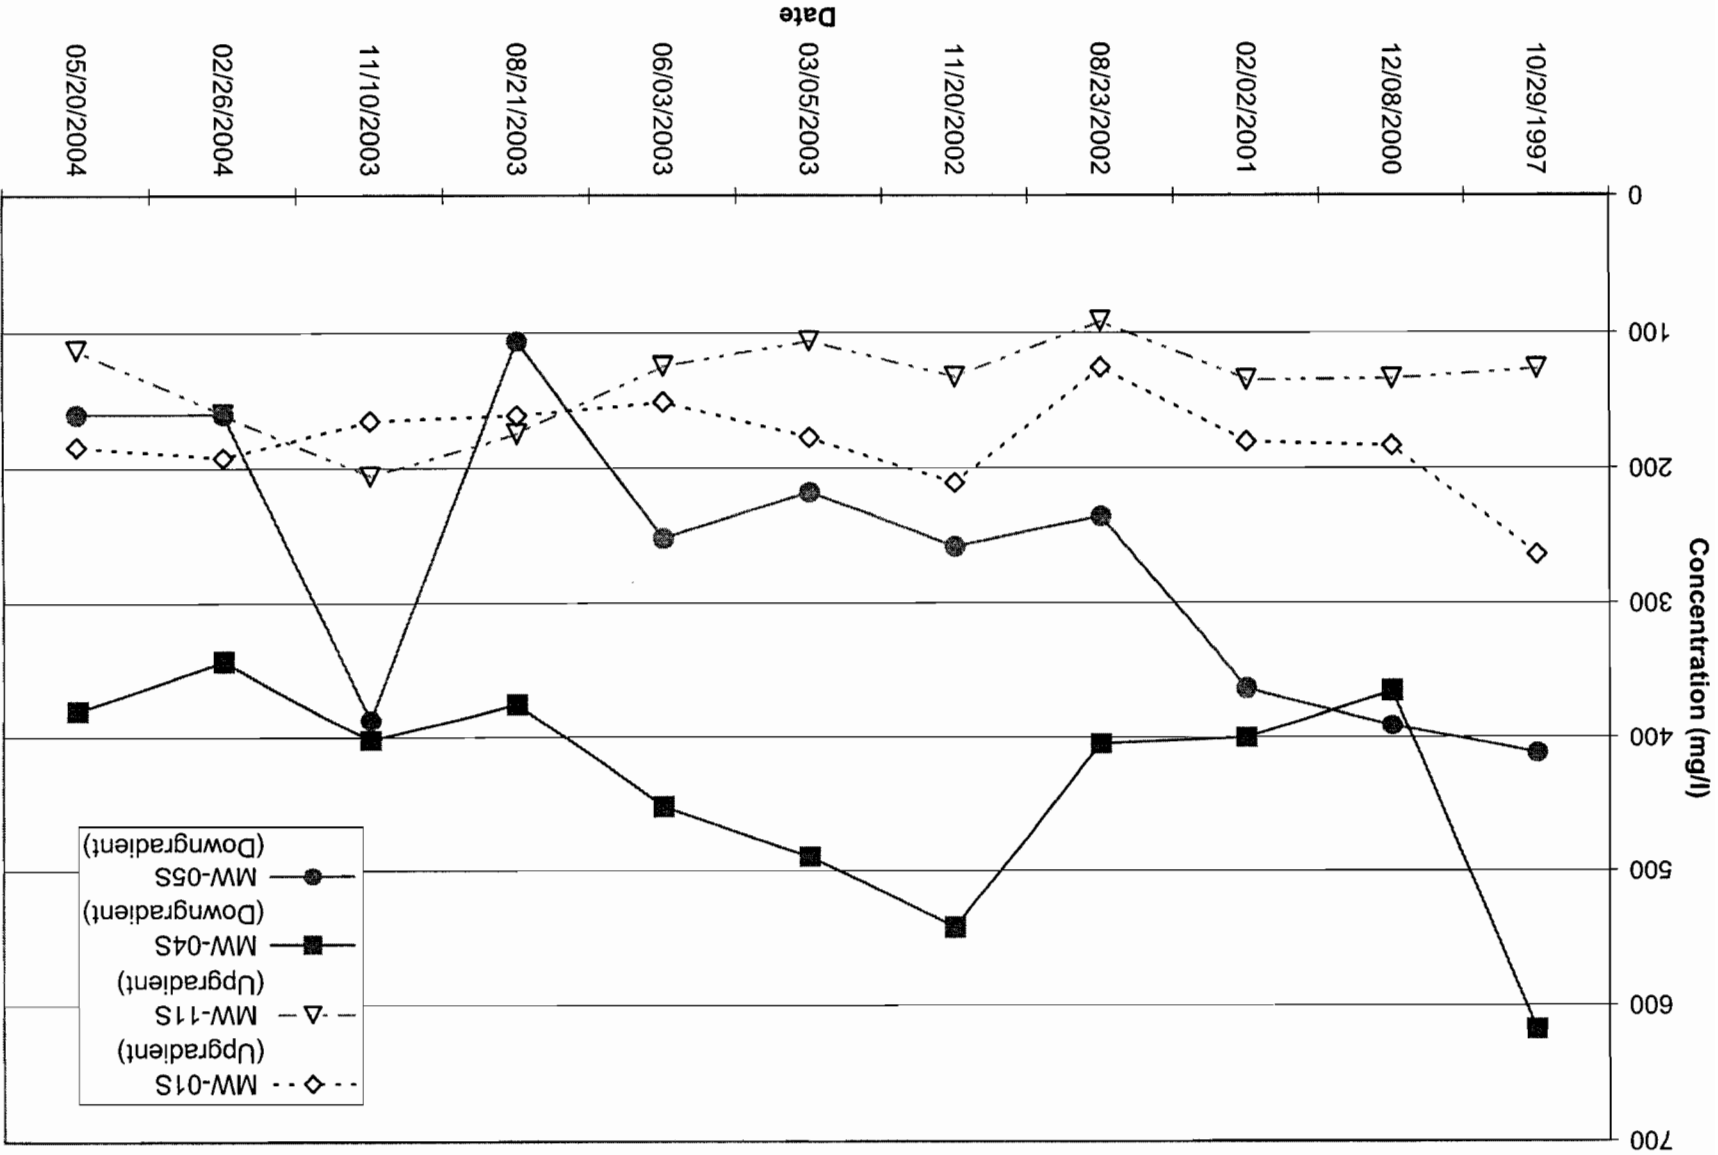


HISTORIC TOTAL DISSOLVED SOLID RESULTS IN SELECTED SHALLOW WELLS

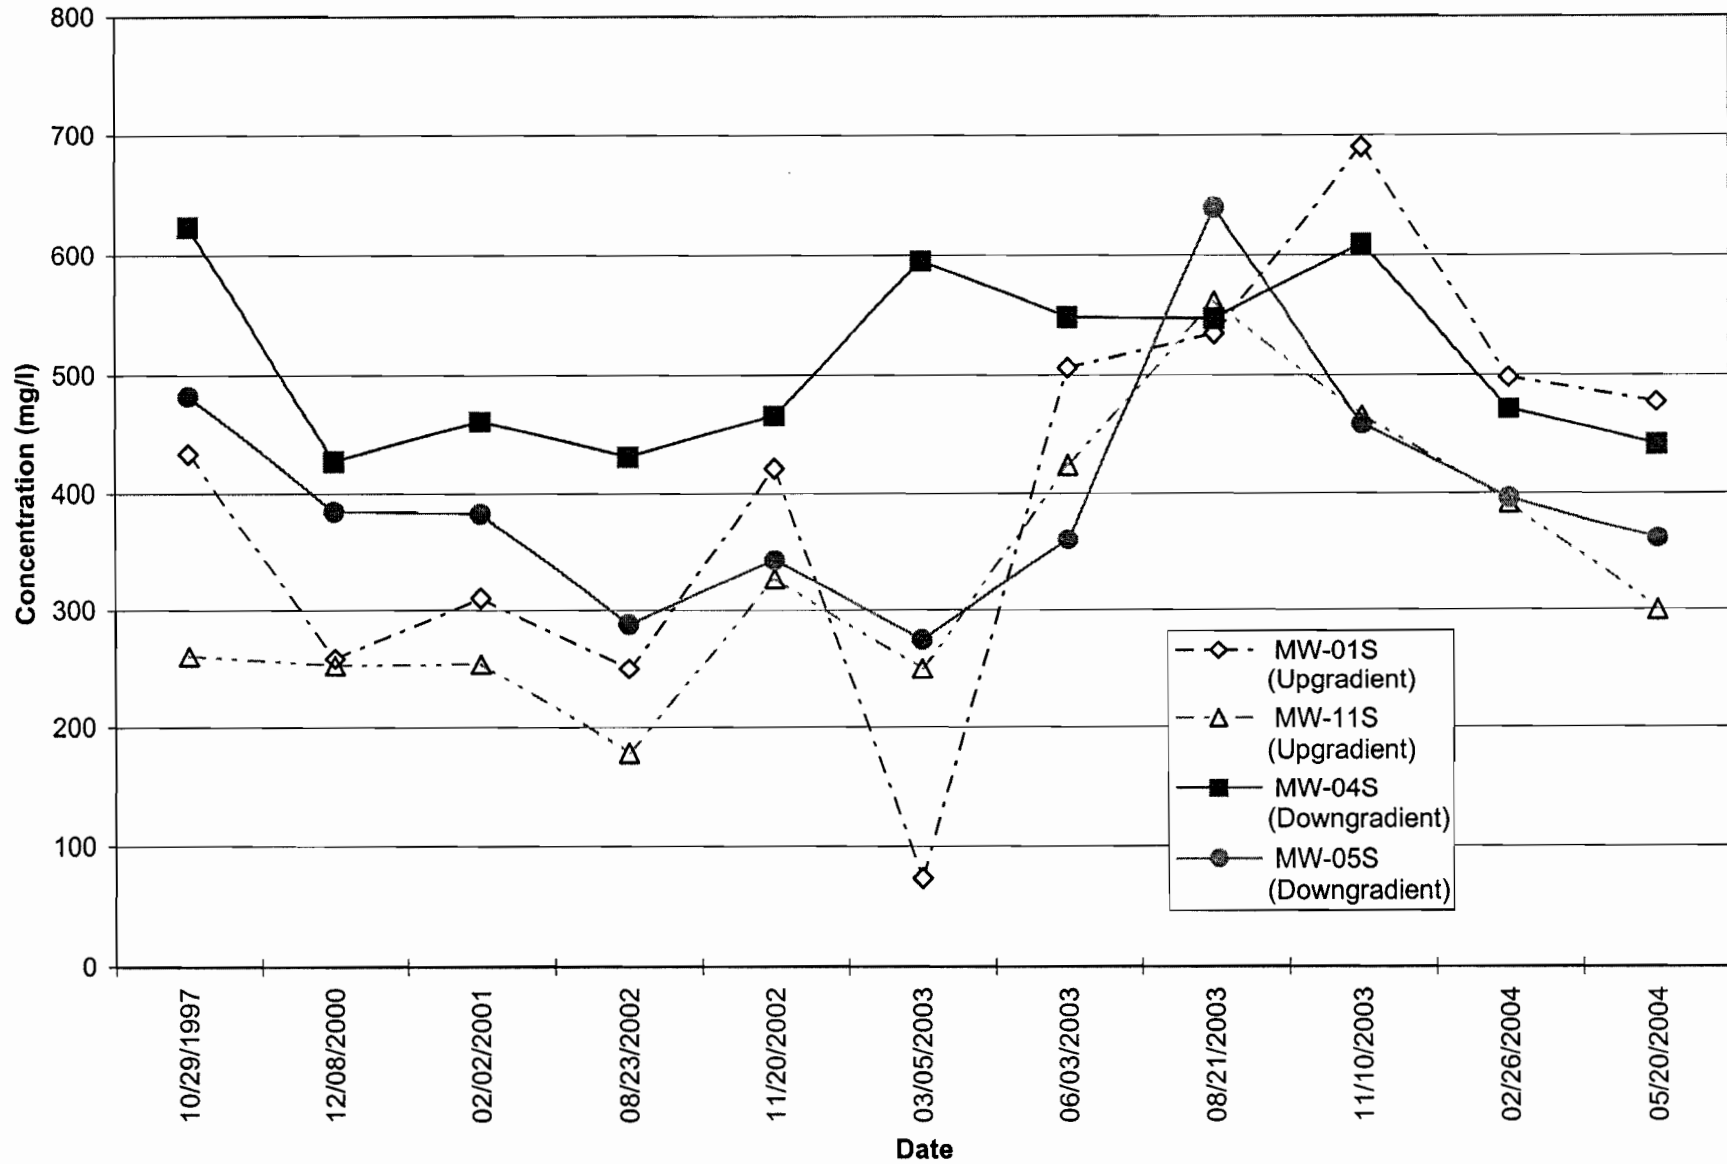


HISTORIC SPECIFIC CONDUCTIVITY RESULTS IN SELECTED INTERMEDIATE WELLS

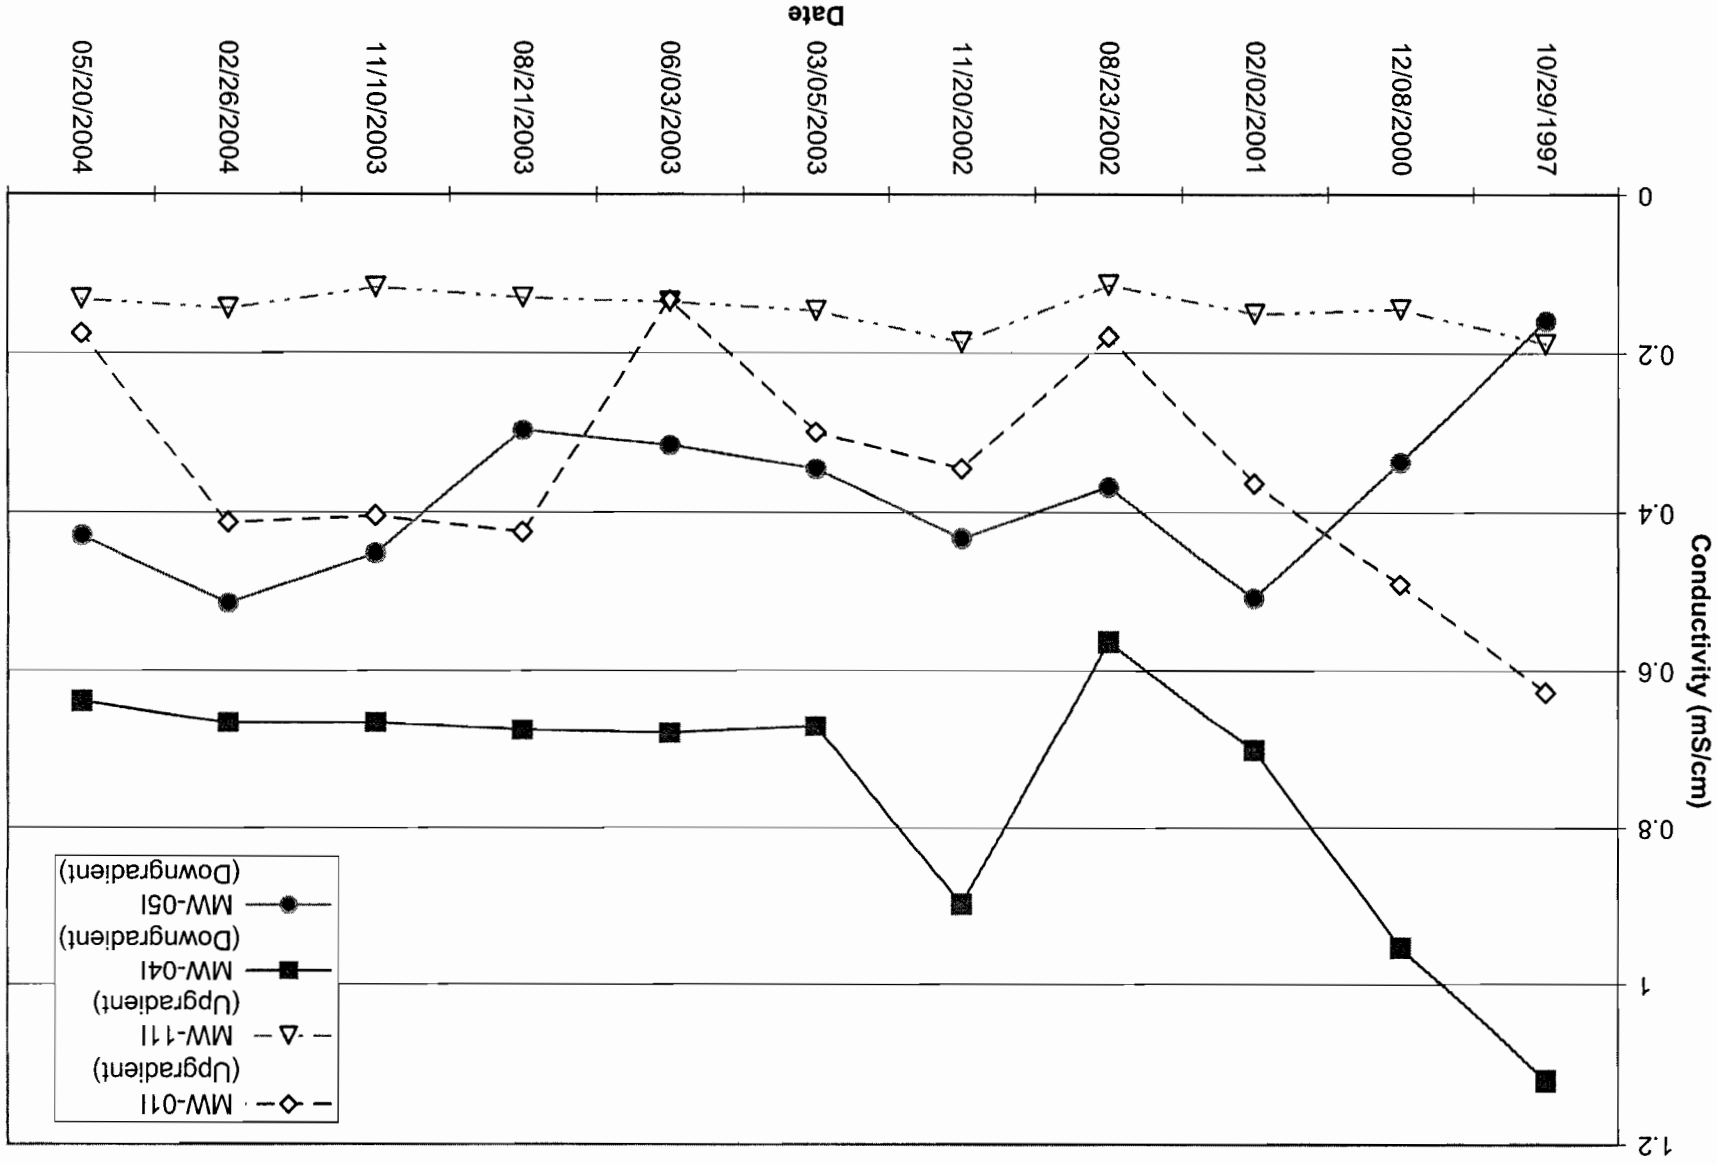


HISTORIC IRON + MANGANESE RESULTS IN SELECTED INTERMEDIATE WELLS

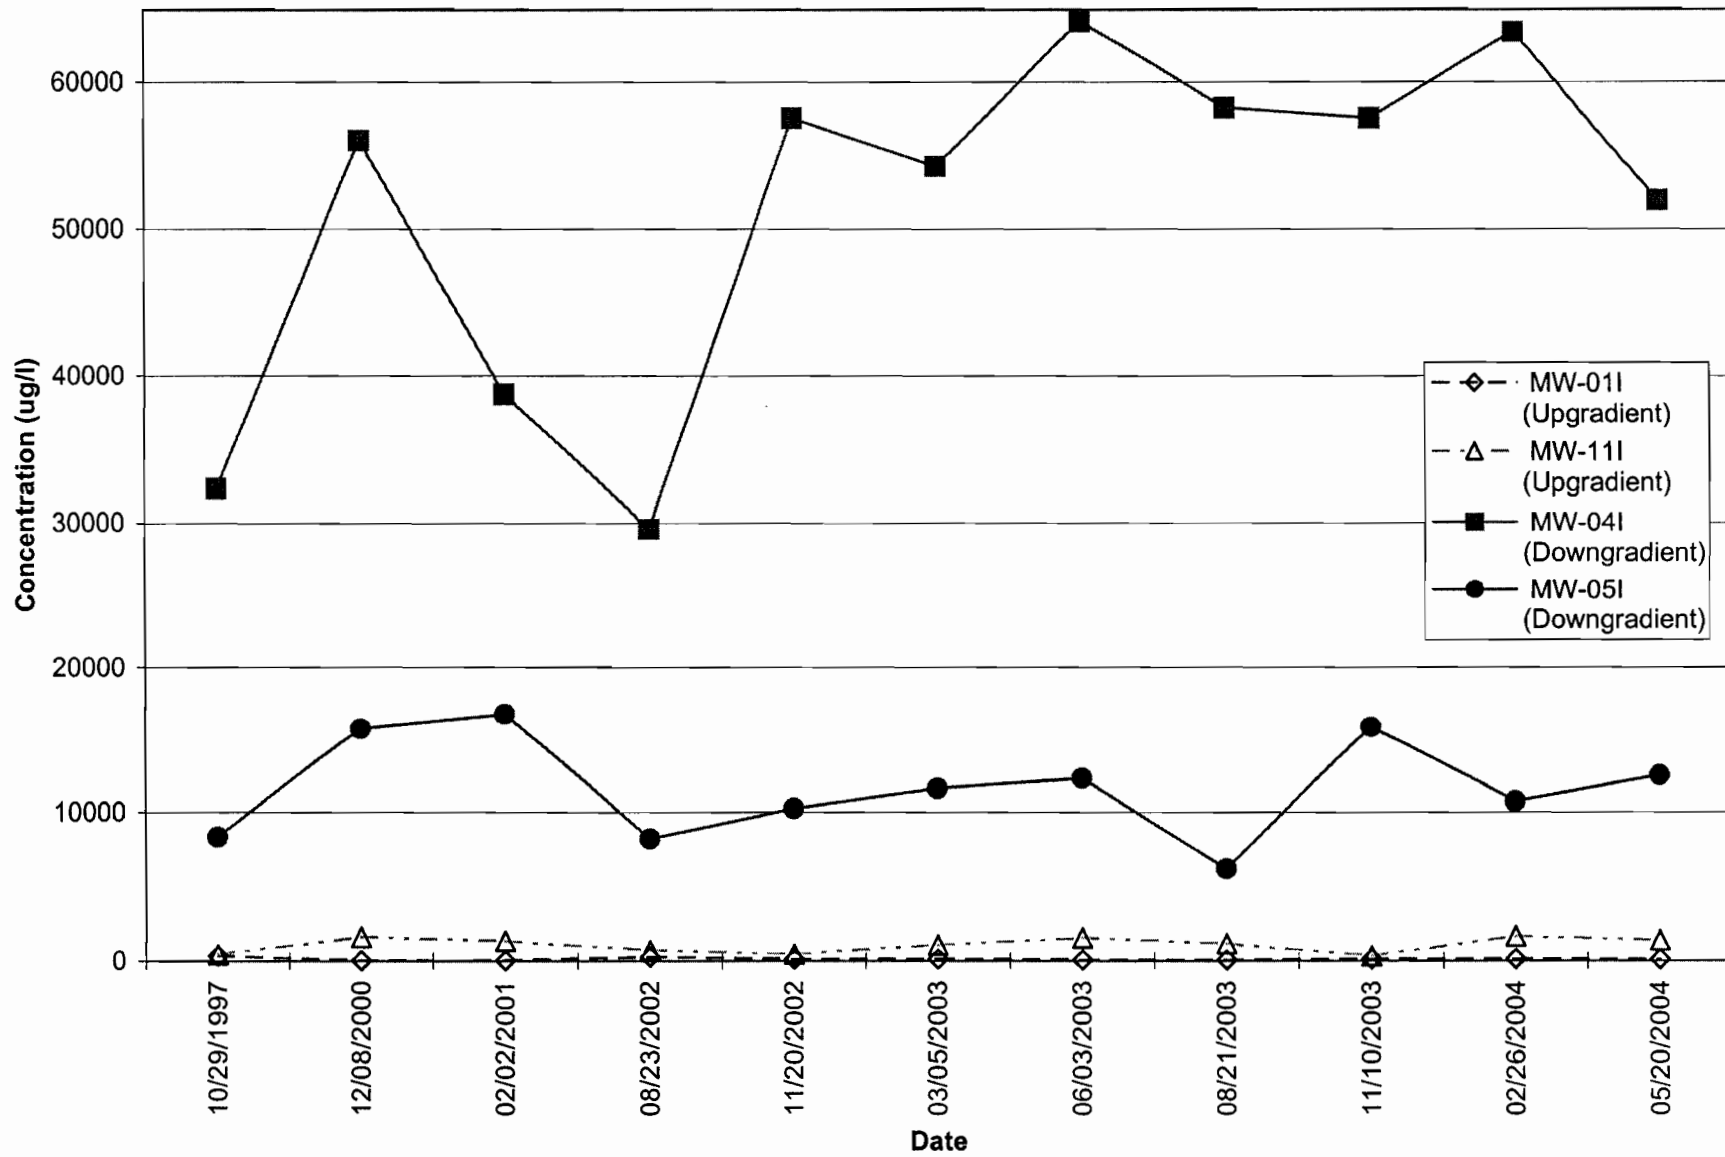


HISTORIC ALKALINITY RESULTS IN SELECTED INTERMEDIATE WELLS

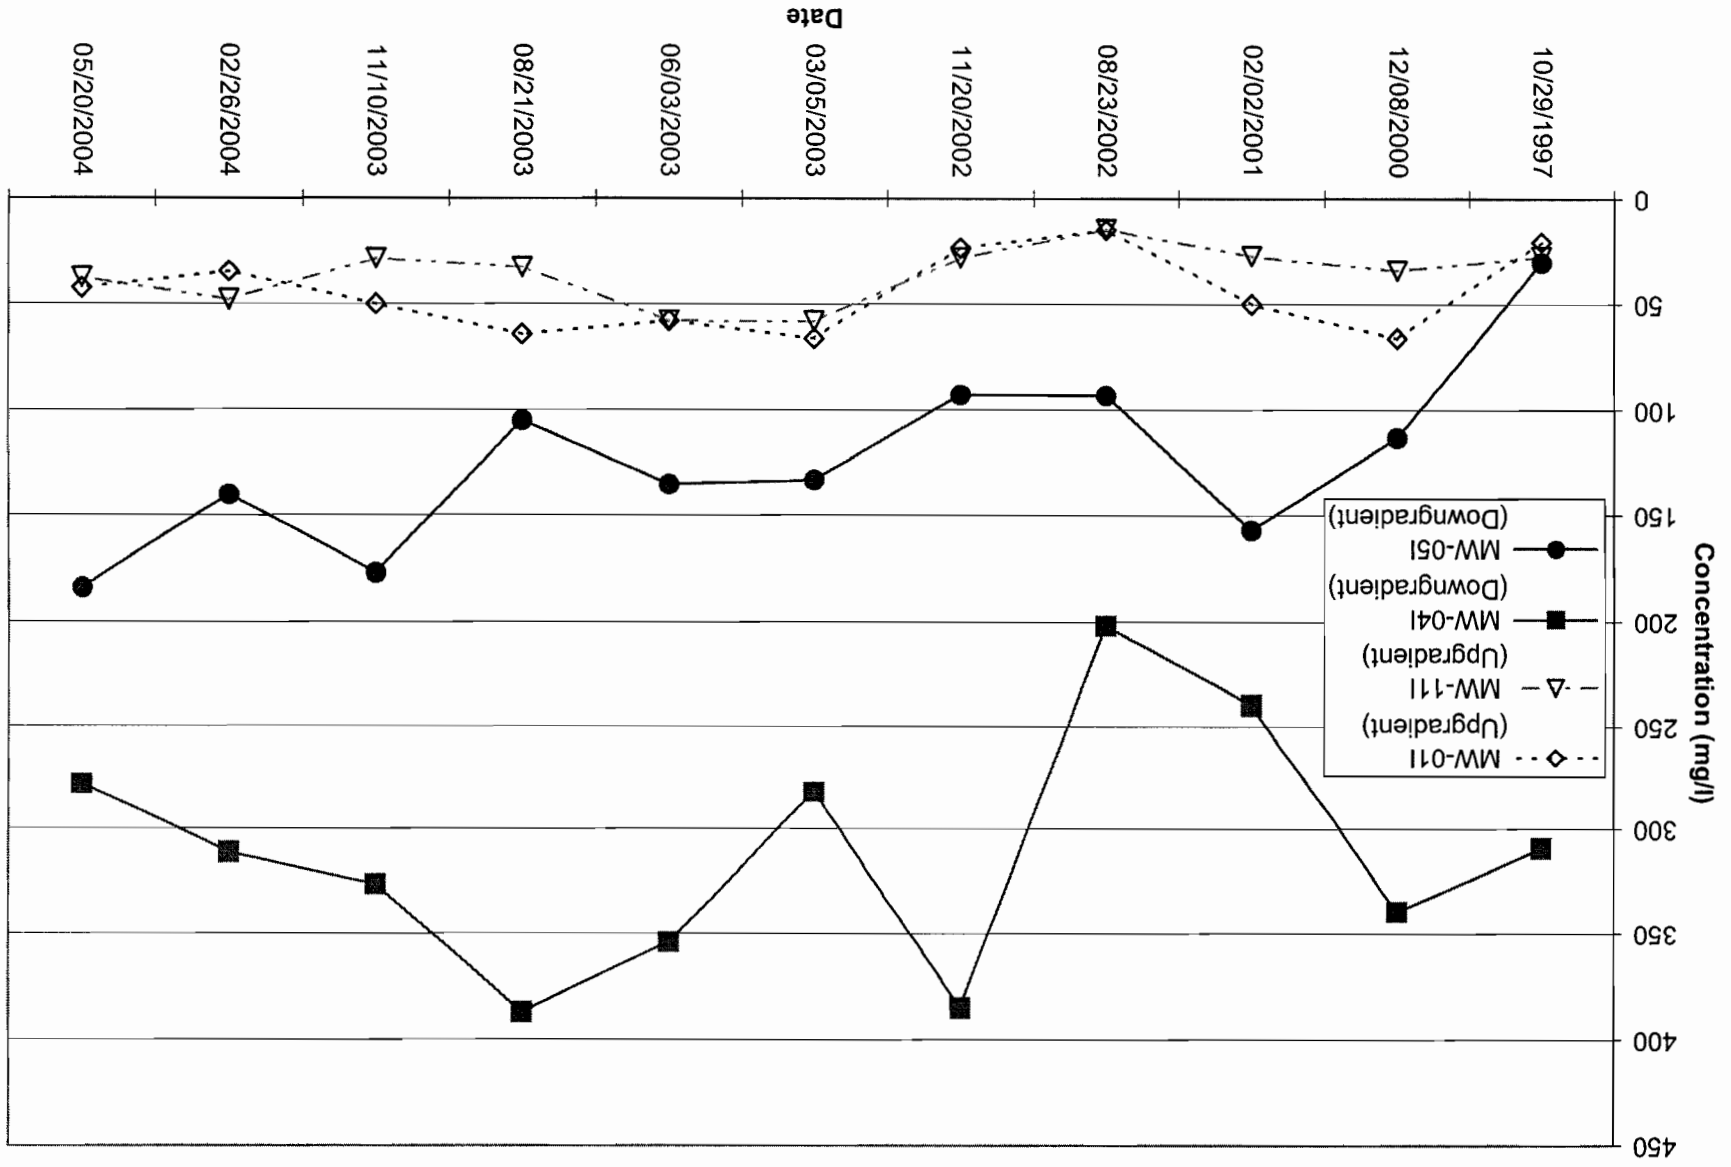


HISTORIC TOTAL DISSOLVED SOLID RESULTS IN SELECTED INTERMEDIATE WELLS

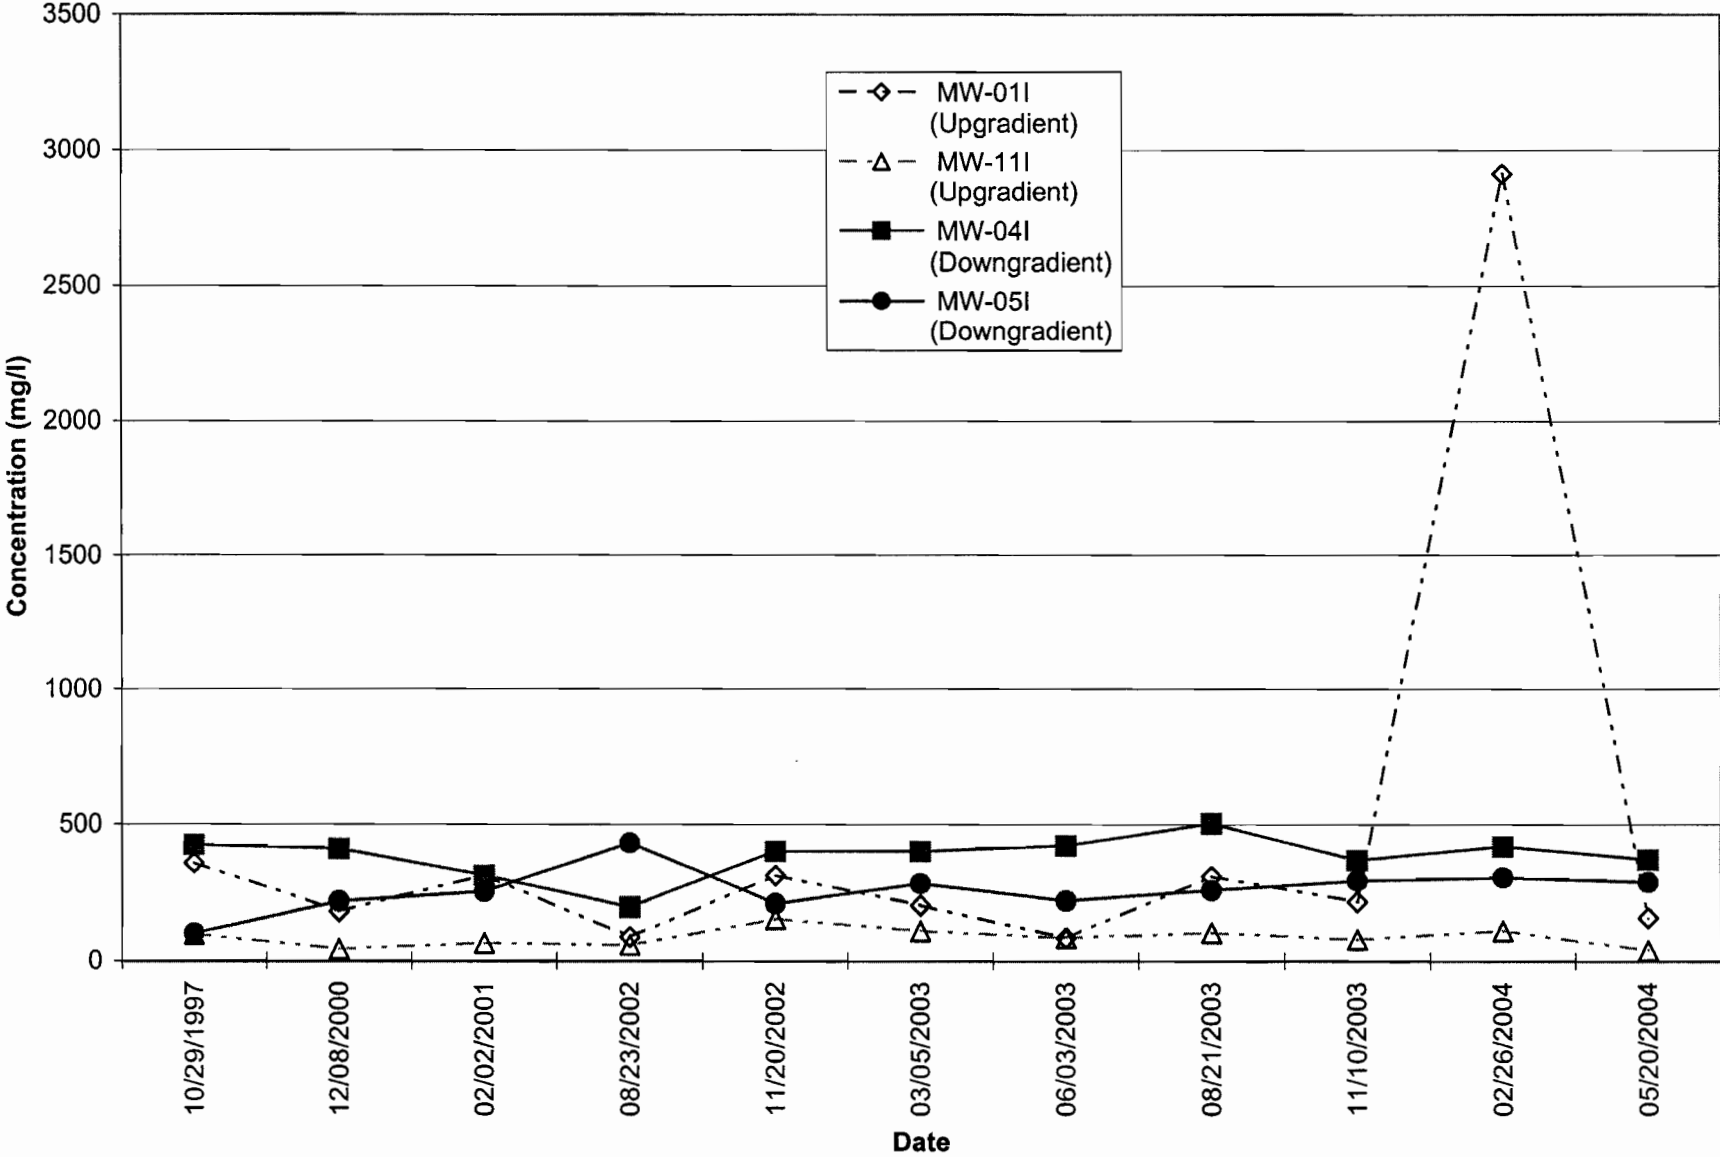


HISTORIC SPECIFIC CONDUCTIVITY RESULTS IN SELECTED DEEP WELLS

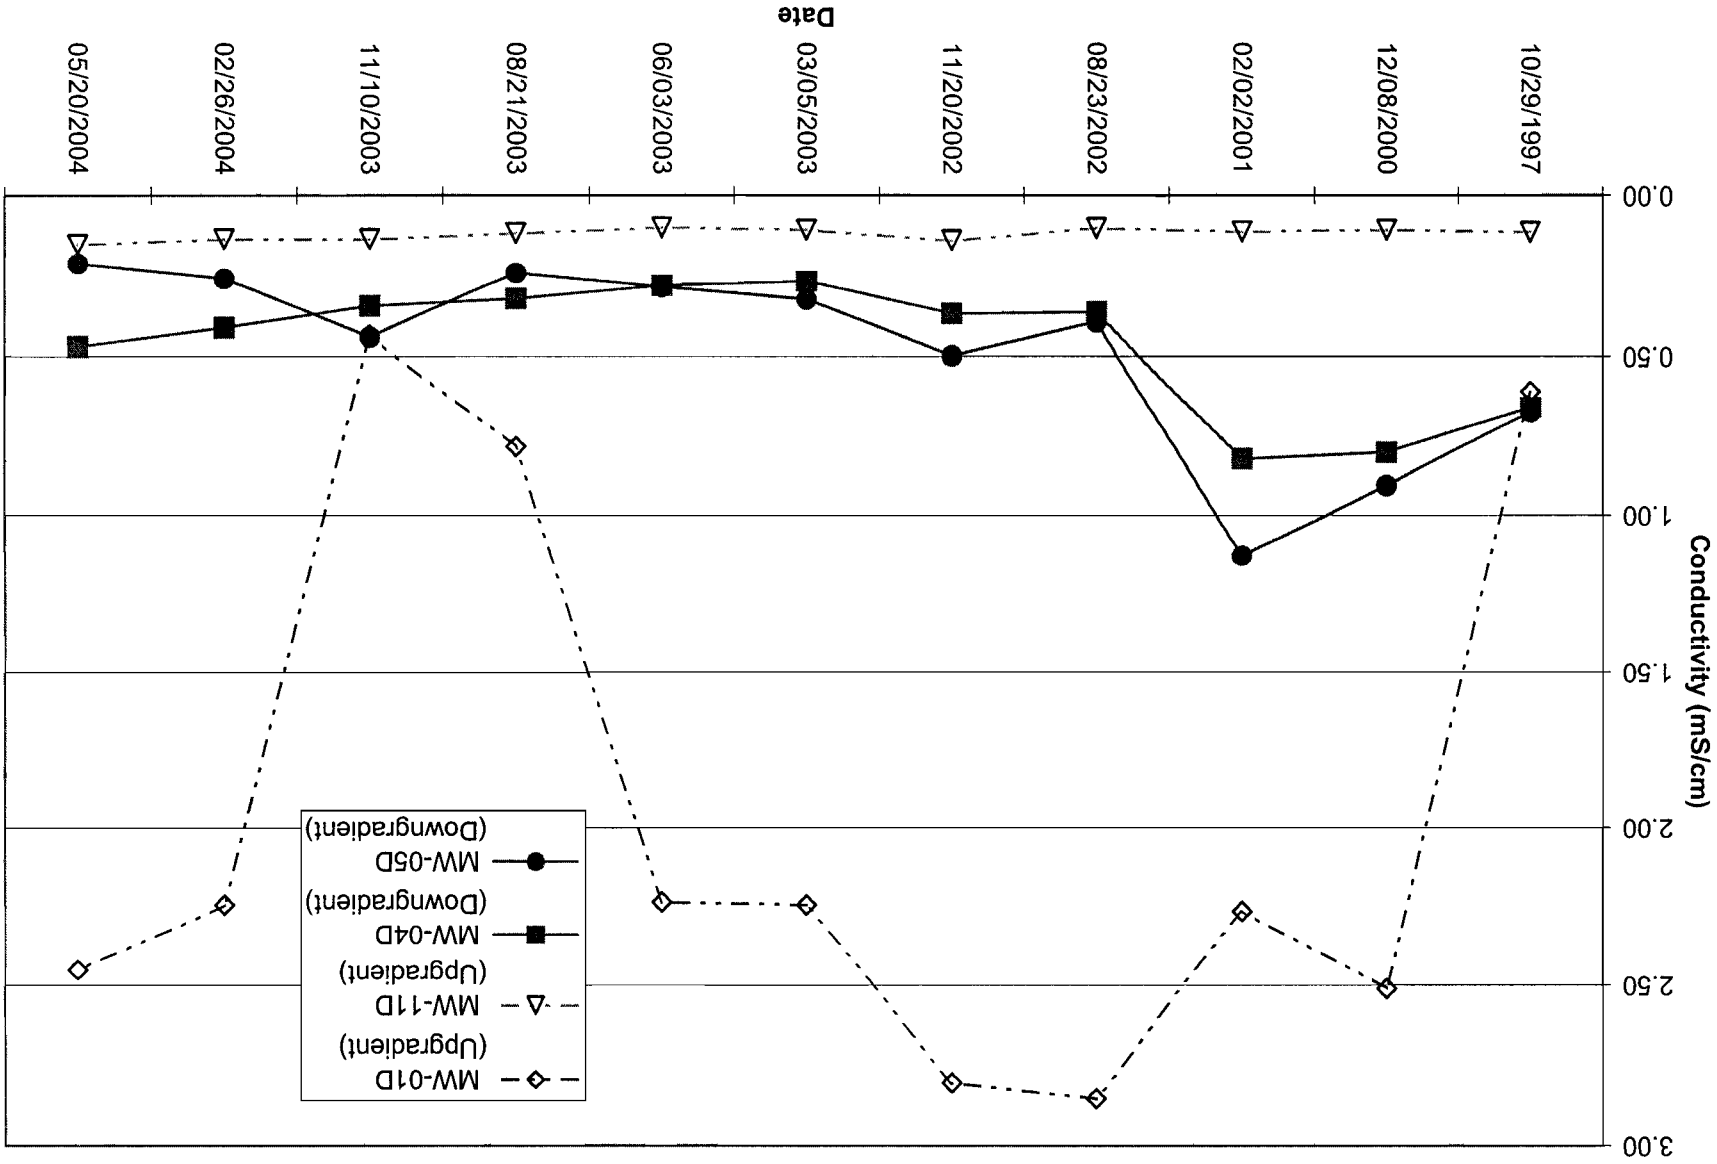


HISTORIC IRON + MANGANESE RESULTS IN SELECTED DEEP WELLS

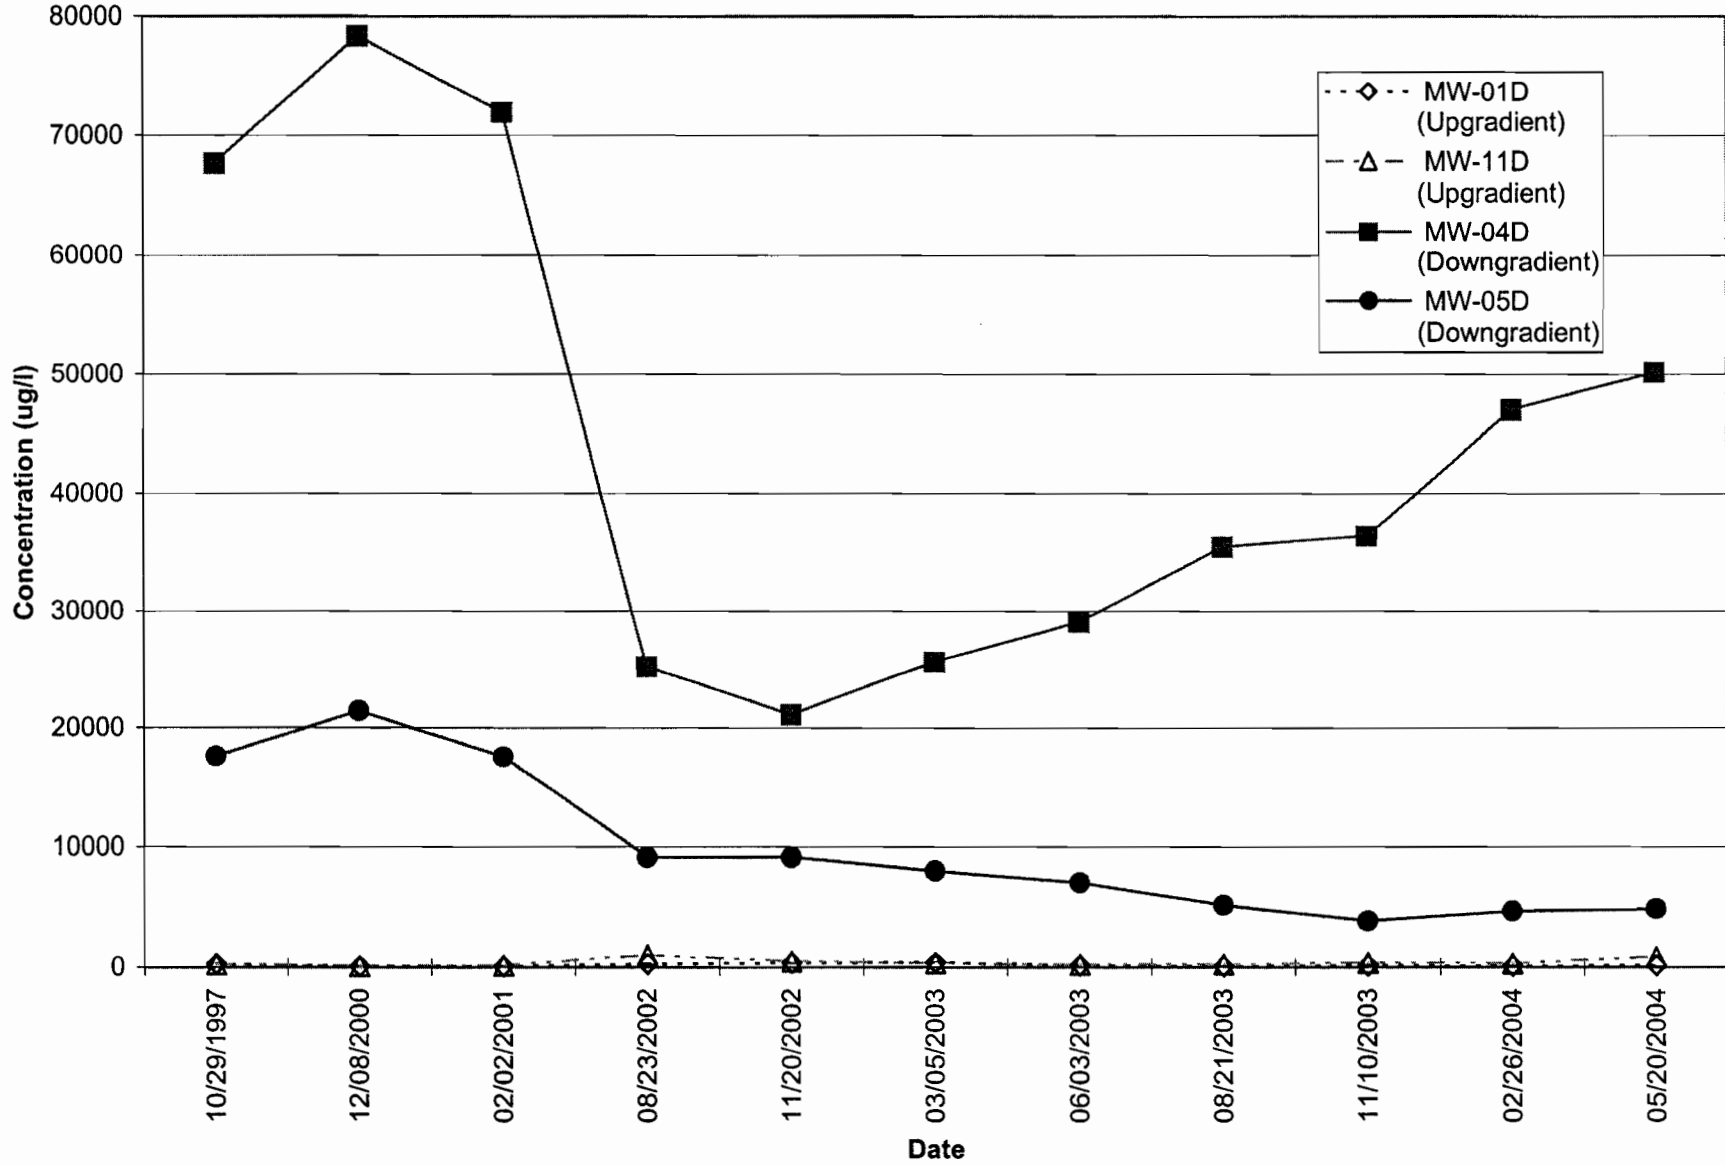

HISTORIC ALKALINITY RESULTS IN SELECTED DEEP WELLS

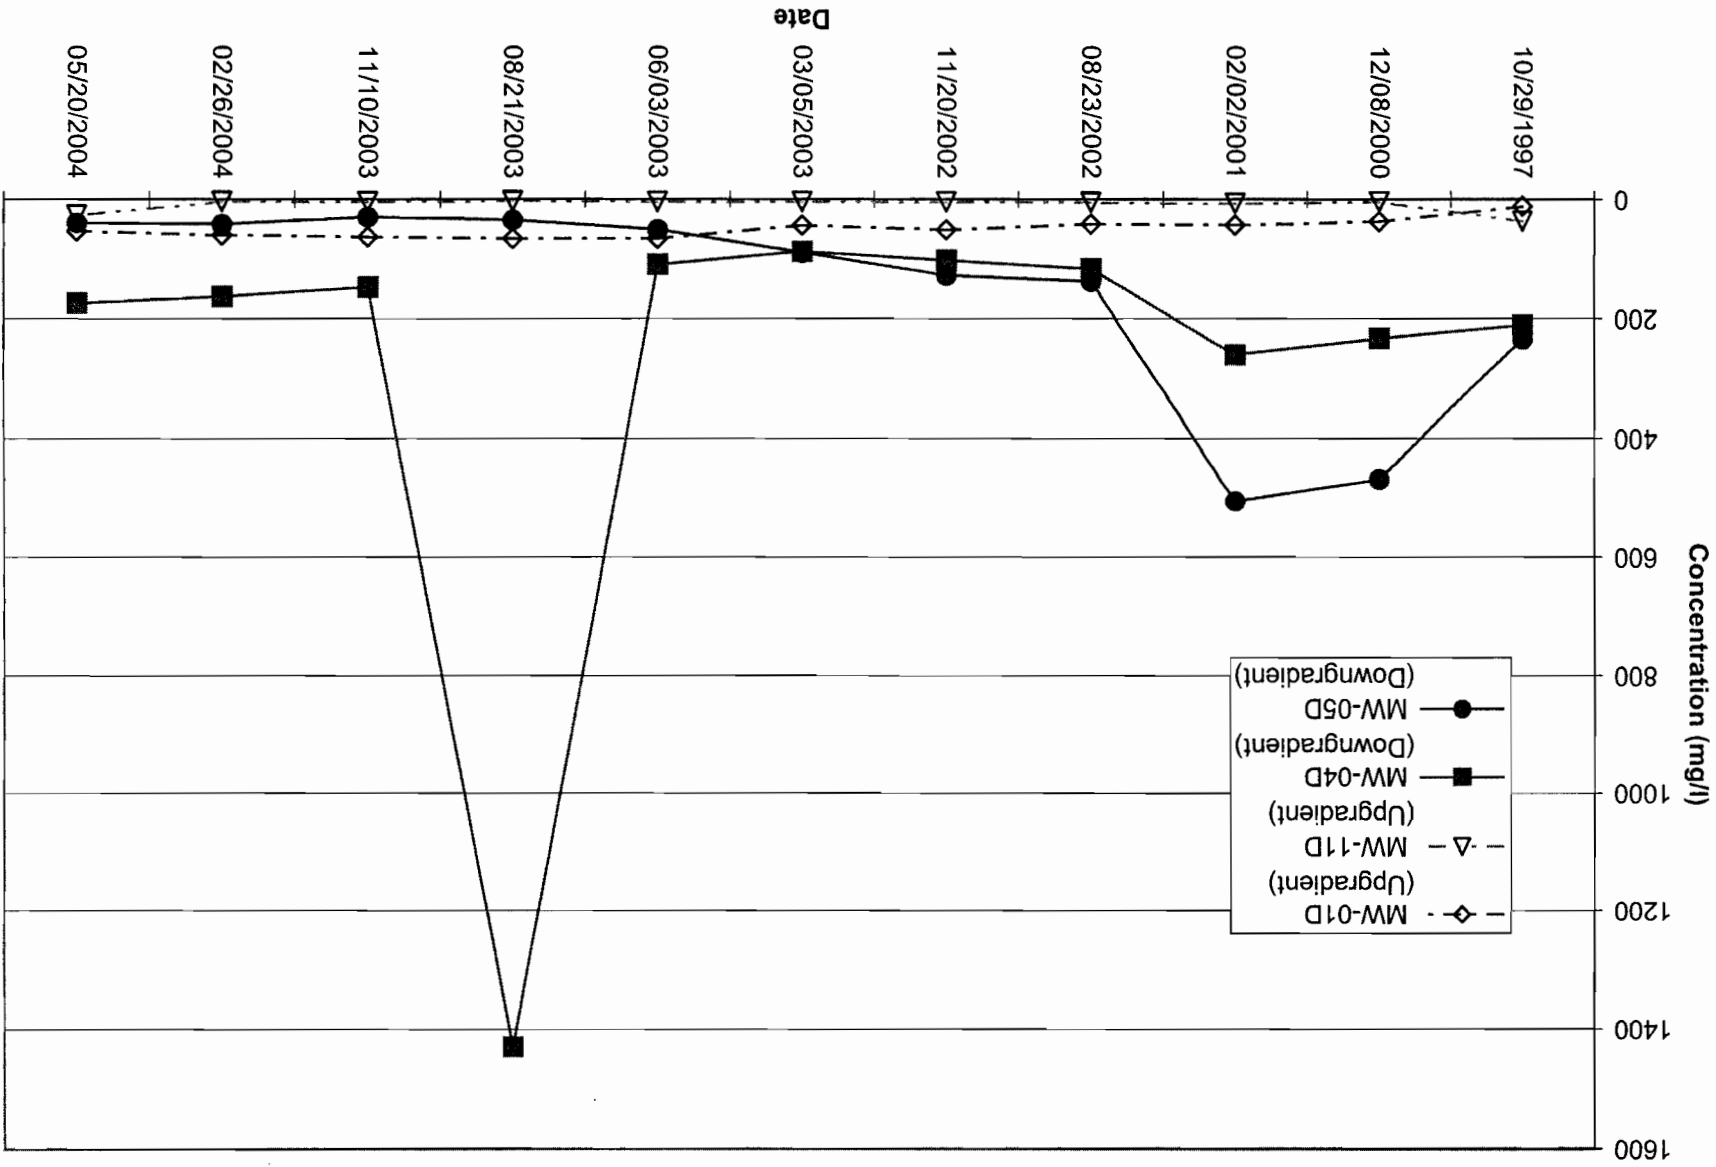

HISTORIC TOTAL DISSOLVED SOLID RESULTS IN SELECTED DEEP WELLS

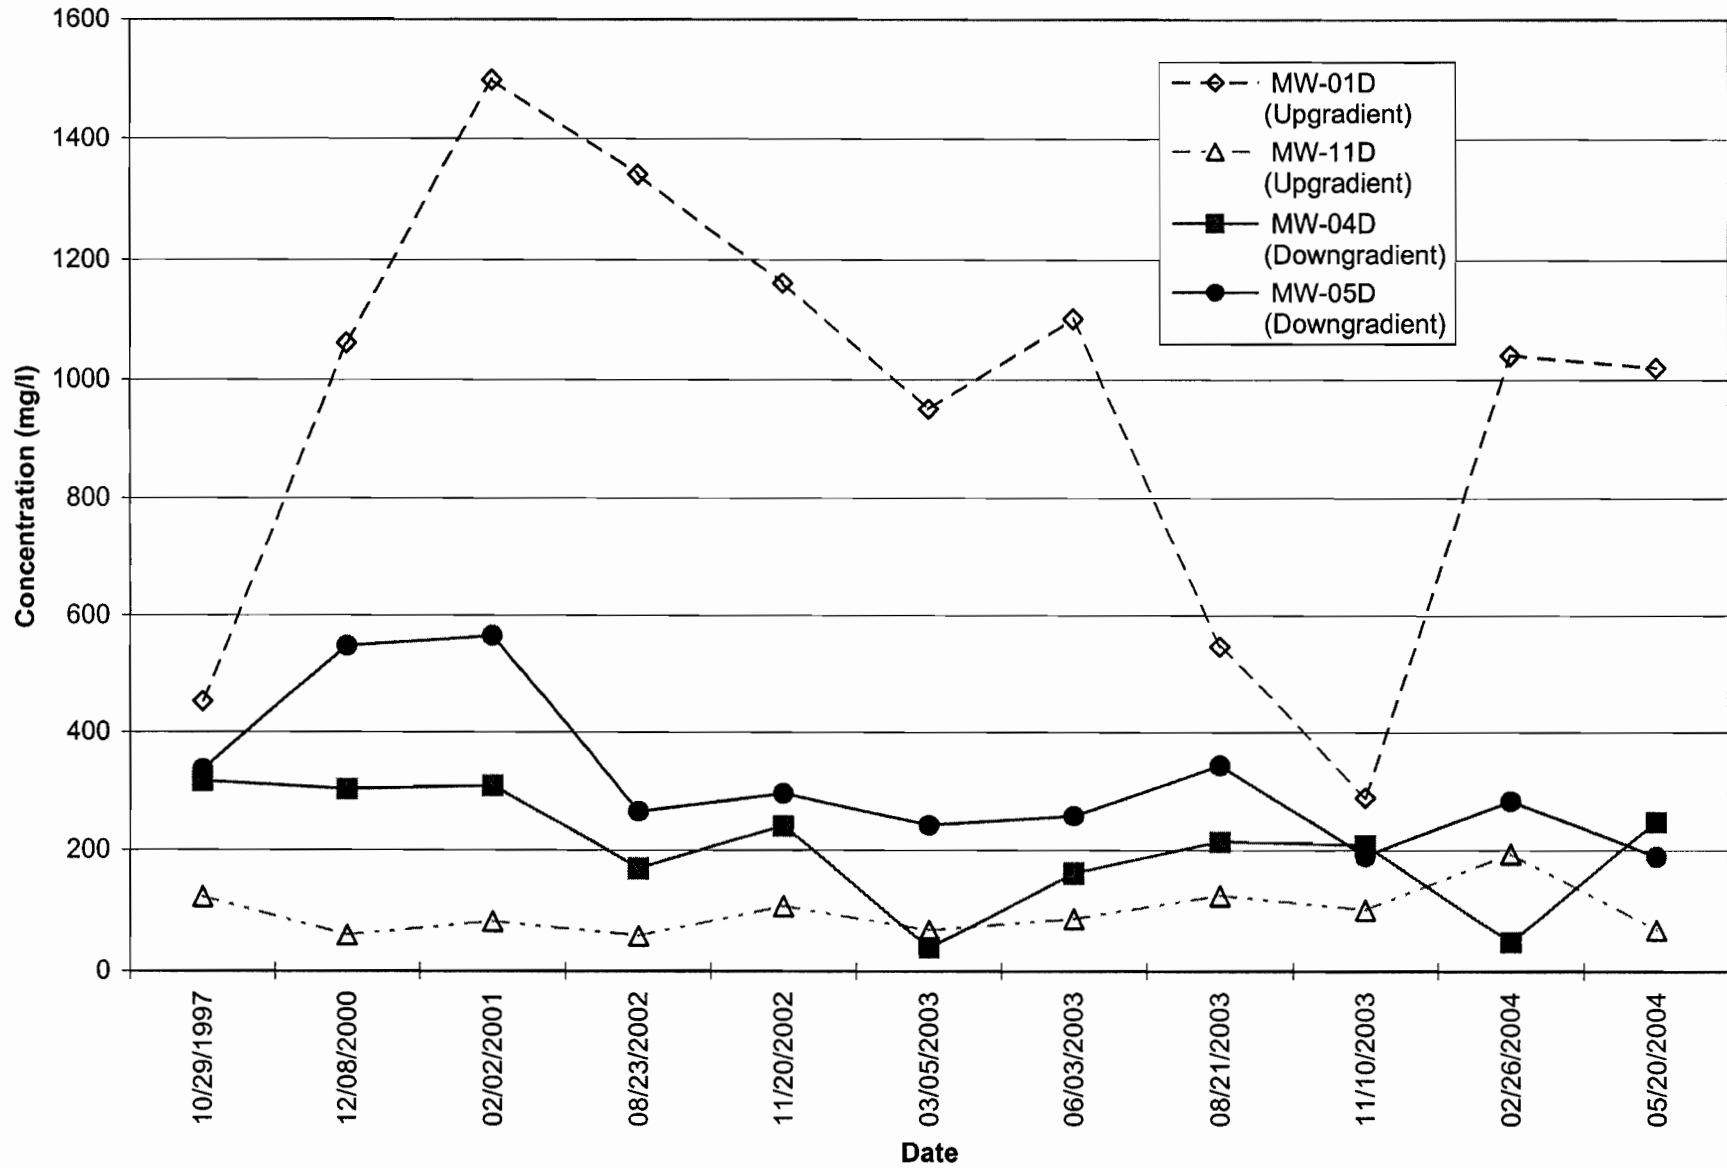

Appendix B





APPENDIX B-1

FIELD FORMS - FIELD OBSERVATION LOGS

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/20/04

SAMPLE ID: 2023-MW-01S (29) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-01S 1000 1110
 SAMPLERS: Stephen Tauss 1000 1110
Kristen Penella

Depth of well (from top of casing) 28.86 ft Time: _____
 Initial static water level (from top of casing) 14.68 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation:
 Bailer _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Submersible X Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 14.18 ft. of water x 0.65 = 9.22 gallons

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.05	10.19	0.635	11.7	4.61	83
5	6.22	10.20	0.633	3.8	3.29	35
18	6.31	10.21	0.631	4.6	2.78	12
30	6.33	10.21	0.632	4.6	2.91	6
48	6.36	10.22	0.631	5.0	2.49	2
54	6.36	10.22	0.631	6.5	2.45	0
60	6.38	10.22	0.631	6.0	2.37	-2
Sample	6.04	13.77	0.587	0.1	3.74	75

Sampling

Time of Sample Collection: 1100

Method: _____ Stainless steel bailer _____ Analyses: _____
 _____ Teflon bailer _____ VOCs _____ 602 _____ 503 _____ Other _____
 _____ Pos. Disp. Pump _____ SVOCs _____
X Disposable bailer _____ Metals _____
 Dedicated pump _____ PCB/Pest. _____
 Other: _____ Physical _____
 _____ X Other _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Clear, 70 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments:

3 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/20/04

SAMPLE ID: 2023-MW-011 (78)

WELL ID: MW-011

SAMPLERS: Stephen Tauss

Kristen Penella

Time On-site:

0900

0900

Time Off-site:

1020

1020

Depth of well (from top of casing) 78.75 ft Time: _____

Initial static water level (from top of casing) 14.00 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation:

Bailer _____ Pos. Disp. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons

Submersible Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons

4 in. casing: 64.75 ft. of water x 0.65 = 42.09 gallons

Volume of water removed: 150 gal. >3 volumes: yes no _____ purged dry? yes _____ no

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.50	13.82	0.171	0.10	4.80	257
15	5.98	13.67	0.179	0.10	2.81	240
30	5.59	13.67	0.174	0.10	2.56	231
75	5.86	13.69	0.177	0.10	2.17	217
120	5.84	13.71	0.178	0.10	1.88	201
135	5.83	13.72	0.179	0.10	1.84	200
150	5.82	13.73	0.179	0.10	1.78	196
Sample	6.31	13.98	0.175	7.3	3.25	163

Sampling

Time of Sample Collection: 1015

Method: _____ Stainless steel bailer _____ Analyses: _____

_____ Teflon bailer _____ VOCs _____ 602 _____ 503 _____ Other _____

_____ Pos. Disp. Pump _____ Metals _____

Disposable bailer _____ PCB/Pest. _____

_____ Dedicated pump _____ Physical _____

Other: _____ Other _____

BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Clear, 75 degrees F

Sample description: Clear, colorless, no odor

Free Product? yes _____ no describe _____

Sheen? yes _____ no describe _____

Odor? yes _____ no describe _____

Comments: 5 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/20/04

SAMPLE ID: 2023-MW-01D (106)
 WELL ID: MW-01D
 SAMPLERS: Stephen Taus
Kristen Penella

Time On-site: 0800 Time Off-site: 0930
0800 0930

Depth of well (from top of casing) 105.86 ft Time: _____
 Initial static water level (from top of casing) 13.20 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____
 Bailer _____ Pos. Displ. _____
 Submersible X Ded. Pump _____

Well Volume Calculation:

2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 92.60 ft. of water x 0.65 = 60.19 gallons

Volume of water removed:
200 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.53	13.47	1.57	0.10	5.98	356
20	5.64	13.41	2.12	0.10	4.86	352
60	5.66	13.34	3.24	0.10	4.07	332
100	5.67	13.24	3.29	0.10	3.43	318
140	5.68	13.33	3.29	0.10	3.06	310
160	5.69	13.33	3.29	0.10	2.93	305
180	5.69	13.31	3.29	0.10	2.81	303
200	5.70	13.31	3.29	0.10	2.65	299
Sample	5.63	12.59	2.45	2.7	6.35	262

Sampling

Time of Sample Collection: 0915

Method: _____ Stainless steel bailer _____ Analyses: _____ VOCs _____ 602 _____ 503 _____ Other _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump _____ Metals _____
X _____ Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 _____ Other: X _____ Other BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Clear, 70 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 5 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/20/04

SAMPLE ID: 2023-MW-021 (72)

WELL ID: MW-021

Time On-site: 1105

Time Off-site: 1200

SAMPLERS: Stephen Tauss

1105

1200

Kristen Penella

1105

1200

Depth of well (from top of casing) 72.20 ft Time: _____
 Initial static water level (from top of casing) 28.24 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation:
 Bailer _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Submersible X Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 43.96 ft. of water x 0.65 = 28.57 gallons

Volume of water removed: 90 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.15	14.93	0.122	50.7	7.67	189
10	5.92	15.02	0.122	40.2	6.78	190
30	5.02	14.83	0.110	4.8	5.65	218
50	4.97	14.82	0.110	0.10	4.77	222
70	4.92	14.80	0.110	0.10	4.15	224
80	4.93	14.80	0.110	0.10	4.06	224
90	4.92	14.80	0.111	0.10	3.99	224
Sample	5.59	15.72	0.139	14.3	5.74	257

Sampling

Time of Sample Collection: 1515

Method: _____ Analyses: _____
 Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump _____ Metals _____
X Disposable bailer _____ PCB/Pest. _____
 Dedicated pump _____ Physical _____
 Other: _____ X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness _____

Observations

Weather/Temperature: Clear, 70 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 4 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/20/04

SAMPLE ID: 2023-MW-02D (116) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-02D 0830 0915
 SAMPLERS: Stephen Tauss 0830 0915
Kristen Penella

Depth of well (from top of casing) 116 ft Time: _____
 Initial static water level (from top of casing) 28.36 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ Pos. Displ. _____ ft. of water x 0.36 = _____ gallons
 Submersible X Ded. Pump _____ 4 in. casing: 87.64 ft. of water x 0.65 = 56.97 gallons

Well Volume Calculation:

Volume of water removed: 220 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.23	13.80	0.096	0.1	9.29	285
20	5.23	13.80	0.096	0.1	9.27	287
60	5.23	13.80	0.096	0.1	9.16	293
100	5.22	13.80	0.096	0.1	9.09	295
140	5.22	13.80	0.096	0.1	9.02	299
180	5.22	13.80	0.096	0.1	9.06	302
200	5.22	13.80	0.096	0.1	9.01	304
220	5.22	13.80	0.096	0.1	9.01	307
Sample	5.49	17.40	0.101	0.4	8.25	303

Sampling

Time of Sample Collection: 1245

Method: _____ Analyses: _____
 Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump X Metals _____
X Disposable bailer PCB/Pest. _____
 Dedicated pump Physical _____
 Other: X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Clear, 70 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 10 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-03S (32) Time On-site: 1500 Time Off-site: 1540
 WELL ID: MW-03S Stephen Tauss 1500
 SAMPLERS: James Milligan 1500 1540

Depth of well (from top of casing) 31.60 ft Time: _____
 Initial static water level (from top of casing) 20.97 ft Time: _____

Purging Method Well Volume Calculation:
 Airlift _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Bailor _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 Submersible X _____ 4 in. casing: 10.63 ft. of water x 0.65 = 6.91 gallons

Volume of water removed: 32 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests	Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
	Initial	6.63	16.12	0.500	15.9	3.90	-26
	4	6.55	16.15	0.517	12.2	3.06	-25
	8	6.52	16.13	0.515	6.8	3.05	-34
	12	6.50	16.14	0.515	7.1	2.63	-38
	16	6.50	16.14	0.517	7.3	2.58	-41
	20	6.50	16.16	0.514	6.0	2.48	-43
	24	6.50	16.16	0.514	6.0	2.46	-44
	28	6.50	16.16	0.513	5.9	2.45	-44
	32	6.50	16.16	0.514	6.0	2.45	-42
	Sample	6.53	16.80	0.516	15.1	4.10	-51

Sampling Time of Sample Collection: 1530

Method: _____ Analyzes: _____
 _____ Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump X Metals _____
X Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 Other: _____ X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations Weather/Temperature: Rain, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes no X describe _____
 Sheen? yes no X describe _____
 Odor? yes no X describe _____

Comments: 4 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-04S (34) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-04S 1335 1400
 SAMPLERS: Stephen Tauss 1335 1400
James Milligan

Depth of well (from top of casing) 33.70 ft Time: _____
 Initial static water level (from top of casing) 22.40 ft Time: _____

Purging Method

Airift _____ Centrifugal _____
 Bailer _____ Pos. Displ. _____ gallons
 Submersible X Ded. Pump _____ gallons

Well Volume Calculation:

2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 11.30 ft. of water x 0.65 = 7.35 gallons

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.32	14.36	0.840	9.2	4.87	-28
10	6.30	14.34	0.816	2.3	4.30	-31
20	6.30	14.35	0.816	17.1	4.36	-32
30	6.31	14.37	0.813	14.0	4.18	-34
40	6.31	14.36	0.812	13.9	4.17	-35
Sample	6.32	14.37	0.813	20.1	4.15	-30

Sampling

Time of Sample Collection: 1355

Method: _____ Stainless steel bailer _____ Analyses: _____
 _____ Teflon bailer _____ VOCs _____ 602 _____ 503 _____ Other _____
 _____ Pos. Disp. Pump _____ SVOCs _____
X Disposable bailer _____ Metals _____
 _____ Dedicated pump _____ PCB/Pest. _____
 _____ Other: _____ Physical _____
 _____ X _____ Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Rain, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 5 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-041 (71)

WELL ID: MW-041

SAMPLERS: Stephen Tauss 1235 Time On-site: 1340 Time Off-site: 1340
James Milligan 1235

Depth of well (from top of casing) 71.30 ft Time: _____
 Initial static water level (from top of casing) 20.68 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation: _____ ft. of water x 0.16 = _____ gallons
 Bailor _____ Pos. Displ. _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 Submersible Ded. Pump _____ 4 in. casing: 50.62 ft. of water x 0.65 = 32.90 gallons

Volume of water removed: 120 gal. >3 volumes: yes no _____ purged dry? yes _____ no

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.33	14.27	0.554	9.8	6.12	24
20	6.24	14.84	0.600	3.3	3.76	0
40	6.21	14.88	0.631	4.7	3.24	-9
60	6.23	14.86	0.635	5.6	2.63	-22
80	6.25	14.87	0.636	5.2	2.43	-26
100	6.26	14.91	0.636	5.9	2.53	-30
120	6.26	14.90	0.636	5.3	2.64	-30
Sample	6.28	14.93	0.637	5.1	2.70	-41

Sampling Time of Sample Collection: 1330

Method: _____ Analyses: _____
 Stainless steel bailer VOCs 602 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump Metals _____
 Disposable bailer _____ PCB/Pest. _____
 Dedicated pump _____ Physical _____
 Other: _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations
 Weather/Temperature: Rain, 60 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no describe _____
 Sheen? yes _____ no describe _____
 Odor? yes _____ no describe _____

Comments: 5 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-04D (114) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-04D 1120 1215
 SAMPLERS: Stephen Tauss 1120 _____
James Milligan 1120 1215

Depth of well (from top of casing) 114.10 ft Time: _____
 Initial static water level (from top of casing) 20.31 ft Time: _____

Purging Method
 Airlift _____ Centrifugal _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ Pos. Displ. _____ ft. of water x 0.36 = _____ gallons
 Submersible X Ded. Pump _____ 4 in. casing: 93.79 ft. of water x 0.65 = 60.96 gallons

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.41	13.92	0.459	4.2	4.43	-66
50	6.43	13.92	0.459	3.3	3.29	-68
100	6.45	13.93	0.459	8.9	3.28	-73
150	6.52	13.98	0.465	0.5	2.35	-80
200	6.54	13.93	0.466	8.9	2.21	-83
250	6.56	13.92	0.463	8.1	1.97	-87
300	6.59	13.96	0.468	6.1	1.81	-89
350	6.60	13.94	0.468	6.2	1.81	-98
Sample	6.65	13.95	0.470	10.3	2.50	-91

Sampling
 Time of Sample Collection: 1210

Method: _____ Stainless steel bailer _____ Analyses: _____ VOCs _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump _____ Metals _____
X Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 _____ Other: _____ X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations
 Weather/Temperature: Rain, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 20 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/25/04

SAMPLE ID: 2023-MW-05S (34) Time On-site: 1100 Time Off-site: 1200
 WELL ID: MW-05S Stephen Tauss 1100 1200
 SAMPLERS: Anthony Caniano 1100 1200

Depth of well (from top of casing) 33.20 ft Time: _____
 Initial static water level (from top of casing) 21.33 ft Time: _____

Purging Method _____ Well Volume Calculation:
 Airlift _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 Submersible 4 in. casing: 11.87 ft. of water x 0.65 = 7.72 gallons

Volume of water removed: _____ gal. >3 volumes: yes no _____ purged dry? yes _____ no

Field Tests	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Volume of Purge Water (in gallons)						
Initial	6.29	18.13	0.632	999	5.60	4
10	6.14	16.55	0.633	111	3.74	-17
20	6.13	16.59	0.623	0.1	3.11	-27
30	6.12	16.49	0.626	0.1	2.82	-30
40	6.13	16.69	0.626	0.1	2.64	-33
50	6.14	16.68	0.628	0.1	2.52	-35
60	6.15	16.67	0.627	0.1	2.49	-36
Sample	6.16	16.65	0.316	276	5.08	30

Sampling Time of Sample Collection: 1140

Method: _____ Analyses: _____
 Stainless steel bailer VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump Metals _____
 Disposable bailer _____ PCB/Pest _____
 Dedicated pump _____ Physical _____
 Other: _____ Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations
 Weather/Temperature: Overcast, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes describe _____
 Sheen? yes describe _____
 Odor? yes describe _____

Comments: 2 GPM
MS/MSD location

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/25/04

SAMPLE ID: 2023-MW-5I (34) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-05I 0940 1040
 SAMPLERS: Stephen Tauss 0940 1040
Anthony Caniano

Depth of well (from top of casing) 70.20 ft Time: _____
 Initial static water level (from top of casing) 21.31 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ Pos. Displ. _____ ft. of water x 0.36 = _____ gallons
 Submersible X Ded. Pump _____ 4 in. casing: 48.89 ft. of water x 0.65 = 31.78 gallons

Well Volume Calculation:

2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 48.89 ft. of water x 0.65 = 31.78 gallons

Volume of water removed: _____ gal.
 >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.85	16.52	0.424	62.7	7.40	216
20	6.13	15.30	0.563	0.1	3.30	-16
40	6.22	15.26	0.554	0.1	2.96	-28
60	6.26	15.22	0.548	0.1	2.57	-38
80	6.30	15.23	0.546	0.1	2.41	-42
100	6.32	15.27	0.541	0.1	2.24	-46
120	6.33	15.27	0.537	0.1	2.11	-49
140	6.34	15.28	0.535	0.1	2.04	-50
160	6.34	15.28	0.537	0.1	2.04	-52
Sample	6.46	16.51	0.428	48.0	1.98	53

Sampling

Time of Sample Collection: 1030

Method: _____ Analyses: _____
 _____ Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump X Metals _____
X Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 _____ Other: X Other _____
 _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Overcast, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments:

5 GPM Blind Duplicate #2

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/25/04

SAMPLE ID: 2023-MW-5D (116)

WELL ID: MW-05D

Time On-site:

Time Off-site:

SAMPLERS: Stephen Tauss

0830

0930

Anthony Carliano

0830

0930

Depth of well (from top of casing) 115.7 ft Time: _____
 Initial static water level (from top of casing) 21.77 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation:
 Bailor _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Submersible X Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 93.93 ft. of water x 0.65 = 61.05 gallons

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (mS/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.47	15.61	0.155	0.1	7.52	339
40	5.69	13.85	0.180	0.1	5.76	336
80	5.76	13.81	0.182	0.1	5.02	333
120	5.80	13.82	0.184	0.1	4.72	331
160	5.83	13.82	0.187	0.1	4.25	327
200	5.85	13.83	0.190	0.1	4.03	324
280	5.87	13.83	0.195	0.1	3.71	318
320	5.88	13.81	0.196	0.1	3.58	316
360	5.90	17.82	0.200	0.1	3.55	311
Sample	6.10	14.35	0.211	0.1	4.40	332

Sampling

Time of Sample Collection: 0920

Method: _____ Analyses: _____
 Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump _____ X Metals _____
X Disposable bailer _____ PCB/Pest. _____
 Dedicated pump _____ Physical _____
 Other: _____ X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Overcast, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 20 GPM

Field blank location

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-06S (37) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-06S 0815 _____ 0910 _____
 SAMPLERS: Stephen Tauss 0815 _____ 0910 _____
James Milligan

Depth of well (from top of casing) 37.90 ft Time: _____
 Initial static water level (from top of casing) 25.23 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____
 Bailer _____ Pos. Displ. _____
 Submersible X Ded. Pump _____

Well Volume Calculation:

2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 12.67 ft. of water x 0.65 = 8.24 gallons

Volume of water removed: _____ gal.
 >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.86	16.75	0.446	68.5	527	68
6	6.01	16.77	0.450	22.6	4.06	29
12	6.07	16.76	0.450	2.3	3.56	3
18	6.13	16.76	0.456	5.6	3.33	-16
24	6.17	16.77	0.461	6.0	3.02	-30
30	6.18	16.77	0.464	9.0	2.87	-34
36	6.20	16.76	0.467	9.1	2.88	-41
42	6.23	16.76	0.469	9.4	2.69	-43
Sample	6.27	16.76	0.470	9.2	2.61	-46

Sampling

Time of Sample Collection: 0900

Method: _____ Analyses: _____
 Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump X Metals _____
X Disposable bailer PCB/Pest. _____
 Dedicated pump Physical _____
 Other: X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Rain, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 3 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-061 (76) Time On-site: 0910 Time Off-site: 1005

WELL ID: MW-061 Stephen T auss James Milligan 0910 1005

SAMPLERS: James Milligan 0910 1005

Depth of well (from top of casing) 76.40 ft Time: _____
 Initial static water level (from top of casing) 25.40 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation:
 Bailor _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Submersible X Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 51.00 ft. of water x 0.65 = 33.15 gallons

Volume of water removed: 140 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (m/s/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.02	15.71	0.194	64.1	2.99	15
20	5.90	15.57	0.215	5.2	2.60	19
40	5.86	15.58	0.215	2.1	2.65	20
60	5.85	15.57	0.216	2.6	2.44	21
80	5.83	15.57	0.216	4.1	2.35	22
100	5.87	15.59	0.216	5.1	2.30	20
120	5.79	15.61	0.216	5.6	2.31	25
140	5.81	15.58	0.216	4.0	2.30	26
Sample	5.81	15.59	0.216	3.2	2.30	20

Sampling

Time of Sample Collection: 1000

Method: _____ Analyses: _____
 Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump X Metals _____
X Disposable bailer _____ PCB/Pest _____
 Dedicated pump _____ Physical _____
 Other: _____ X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Rain, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments:

5 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/24/04

SAMPLE ID: 2023-MW-06D (112) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-06D 1018 _____ 1110 _____
 SAMPLERS: Stephen Tauss 1018 _____ 1110 _____
James Milligan

Depth of well (from top of casing) 117.00 ft Time: _____
 Initial static water level (from top of casing) 28.79 ft Time: _____

Purging Method
 Airlift _____ Centrifugal _____
 Bailer _____ Pos. Displ. _____
 Submersible X Ded. Pump _____

Well Volume Calculation:
 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 91.31 ft. of water x 0.65 = 59.35 gallons

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Volume of Purge Water (in gallons)						
Initial	5.83	14.44	0.113	2.3	2.70	38
40	5.84	14.44	0.113	1.6	2.42	36
80	5.84	14.43	0.112	1.8	2.16	34
120	5.86	14.44	0.112	3.1	2.03	31
180	5.84	14.43	0.112	1.8	1.76	29
200	5.84	14.43	0.112	1.8	1.72	29
220	5.82	14.43	0.112	1.0	1.76	30
Sample	5.80	14.45	0.113	5.8	2.02	31

Sampling Time of Sample Collection: 1110

Method: _____ Analyses: _____
 _____ Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump X Metals _____
X Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 _____ Other: X Other _____
 _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness _____

Observations
 Weather/Temperature: Rain, 65 degrees F
 Sample description: Clear, colorless, sulfur odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes X no _____ describe Sulfur

Comments: 5 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/20/04

SAMPLE ID: 2023-MW-071 (74) Time On-site: 1250 Time Off-site: 1350
 WELL ID: MW-071
 SAMPLERS: Stephen Tauss 1250 1350
Kristen Penella 1250

Depth of well (from top of casing) 74.2 ft Time: _____
 Initial static water level (from top of casing) 23.50 ft Time: _____

Purging Method _____ Well Volume Calculation: _____ gallons
 Airlift _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Bailor _____ Pos. Displ. _____ ft. of water x 0.36 = _____ gallons
 Submersible Ded. Pump _____ 4 in. casing: 50.70 ft. of water x 0.65 = 32.96 gallons

Volume of water removed: _____ gal. >3 volumes: yes no _____ purged dry? yes _____ no

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.30	13.98	0.191	0.1	6.41	315
20	5.30	14.10	0.190	0.1	5.67	313
40	5.33	14.23	0.189	0.1	4.92	308
60	5.33	14.31	0.187	0.1	4.14	301
80	5.37	14.35	0.185	0.1	3.24	286
100	5.59	14.35	0.186	0.1	3.35	280
120	5.56	14.35	0.186	0.1	3.04	278
Sample	5.50	15.01	0.186	0.1	5.91	231

Sampling Time of Sample Collection: 1345

Method: _____ Analyses: _____
 Stainless steel bailer VOCS _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump Metals _____
 Disposable bailer _____ PCB/Pest. _____
 Dedicated pump _____ Physical _____
 Other: Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness _____

Observations
 Weather/Temperature: Clear, 70 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes no describe _____
 Sheen? yes no describe _____
 Odor? yes no describe _____

Comments: 5 GPM
MS/MSD location

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/21/04

SAMPLE ID: 2023-MW-11S (19) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-11S 1440 1520
 SAMPLERS: Stephen Tauss 1440 1520
Kristen Penella

Depth of well (from top of casing) 19.59 ft Time: _____
 Initial static water level (from top of casing) 6.93 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ Pos. Displ. _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 Submersible X Ded. Pump _____ 4 in. casing: 12.66 ft. of water x 0.65 = 8.23 gallons

Well Volume Calculation:

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.18	11.09	0.478	0.1	3.41	302
10	6.31	11.08	0.484	0.1	2.62	298
20	6.45	11.06	0.480	0.1	2.15	290
30	6.46	11.05	0.480	0.1	2.13	289
40	6.48	11.05	0.480	0.1	2.10	287
50	6.49	11.06	0.482	0.1	2.06	286
Sample	6.58	12.00	0.462	0.1	3.75	279

Sampling

Time of Sample Collection: 1515

Method:

Stainless steel bailer _____ Analyses: _____
 Teflon bailer _____ X VOCs _____ 602 _____ 503 _____ Other _____
 Pos. Disp. Pump _____ X SVOCs _____
X Disposable bailer _____ Metals _____
 Dedicated pump _____ PCB/Pest. _____
 Other: _____ X Physical _____
 _____ Other _____
 _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Clear, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments:

5 GPM

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/21/04

SAMPLE ID: 2023-MW-111 (71)

WELL ID: MW-111

SAMPLERS: Stephen Tauss

Kristen Penella

Time On-site: 1400

1400

Time Off-site: 1500

1500

Depth of well (from top of casing) 71.29 ft Time: _____

Initial static water level (from top of casing) 7.41 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation:
 Bailer _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Submersible X Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 63.88 ft. of water x 0.65 = 41.52 gallons

Volume of water removed: 240 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.70	13.57	0.129	18.3	7.08	349
40	5.74	13.59	0.128	1.4	6.09	348
80	5.74	13.60	0.128	0.1	5.21	348
120	5.75	13.60	0.128	0.1	4.10	346
160	5.74	13.60	0.128	0.1	3.89	344
200	5.74	13.60	0.129	0.1	2.86	341
240	5.75	13.60	0.128	0.1	2.73	340
Sample	6.00	15.65	0.131	3.7	4.85	307

Sampling

Time of Sample Collection: 1445

Method: _____ Analyzes: _____
 Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 Teflon bailer _____ SVOCs _____
 Pos. Disp. Pump _____ X Metals _____
X Disposable bailer _____ PCB/Pest. _____
 Dedicated pump _____ Physical _____
 Other: _____ X Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness _____

Observations

Weather/Temperature: Clear, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 20 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/21/04

SAMPLE ID: 2023-MW-11D (94) Time Off-site: _____
 WELL ID: MW-11D Time On-site: _____
 SAMPLERS: Stephen Tauss 1315
Kristen Penella 1315

Depth of well (from top of casing) 93.90 ft Time: _____
 Initial static water level (from top of casing) 7.19 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ Pos. Displ. _____ ft. of water x 0.36 = _____ gallons
 Submersible X Ded. Pump _____ 4 in. casing: 86.91 ft. of water x 0.65 = 56.36 gallons

Well Volume Calculation:

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.54	13.47	0.166	454	7.05	312
80	5.94	13.36	0.166	999	6.85	296
200	5.18	13.36	0.137	96.3	5.24	325
400	5.08	13.37	0.136	69.5	4.74	332
520	4.96	13.38	0.133	19.1	4.53	339
560	4.98	13.37	0.133	20.0	4.50	340
600	4.97	13.38	0.133	18.6	4.54	341
Sample	5.50	14.21	0.150	30.1	7.16	333

Sampling

Time of Sample Collection: 1310

Method: _____ Analyses: _____
 _____ Stainless steel bailer X VOCs _____ 602 _____ 503 _____ Other _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump X Metals _____
X Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 _____ Other: X Other _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Overcast, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments:

20 GPM
Field blank location

FIELD OBSERVATION LOG GROUNDWATER SAMPLING RECORD

SITE Sonia Road Landfill DATE 5/21/04

SAMPLE ID: 2023-MW-12S (19) Time On-site: _____ Time Off-site: _____

WELL ID: MW-12S 0900 0940

SAMPLERS: Stephen Tauss 0900 0940

Kristen Penella 0900 0940

Depth of well (from top of casing) 18.40 ft Time: _____

Initial static water level (from top of casing) 7.08 ft Time: _____

Purging Method

Airlift _____ Centrifugal _____ Well Volume Calculation: _____ gallons

Bailer _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons

Submersible Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons

4 in. casing: 11.72 ft. of water x 0.65 = 7.62 gallons

Volume of water removed: _____ gal. >3 volumes: yes no _____ purged dry? yes _____ no

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	6.15	12.74	0.347	16.2	7.14	363
6	6.19	12.75	0.343	14.5	6.96	362
12	6.25	12.73	0.339	0.1	6.51	362
18	6.30	12.73	0.337	28.1	6.21	365
24	6.35	12.71	0.335	5.6	6.01	366
30	6.43	12.74	0.336	31.0	6.19	370
36	6.45	12.73	0.336	0.1	6.19	370
Sample	6.58	14.00	0.338	16.2	7.21	341

Sampling
Time of Sample Collection: 0930

Method: Stainless steel bailer **Analyses:** VOCs 602 SVOCs 503 Other _____

Teflon bailer Metals

Pos. Disp. Pump PCB/Pest

Disposable bailer Physical

Dedicated pump Other BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations
Weather/Temperature: Clear, 60 degrees F

Sample description: Clear, colorless, no odor

Free Product? yes no describe _____

Sheen? yes no describe _____

Odor? yes no describe _____

Comments: 2 GPM

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/21/04

SAMPLE ID: 2023-MW-12I (70) Time On-site: _____ Time Off-site: _____
 WELL ID: MW-12I 0950 1050
 SAMPLERS: Stephen Tauss 0950
Kristen Penella

Depth of well (from top of casing) 70.40 ft Time: _____
 Initial static water level (from top of casing) 7.19 ft Time: _____

Purging Method
 Airlift _____ Centrifugal _____ ft. of water x 0.16 = _____ gallons
 Bailer _____ Pos. Displ. _____ ft. of water x 0.36 = _____ gallons
 Submersible X Ded. Pump _____ 4 in. casing: 63.21 ft. of water x 0.65 = 41.09 gallons

Volume of water removed: _____ gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.10	14.42	0.050	0.1	8.17	394
20	5.00	14.40	0.050	0.1	8.12	397
40	4.87	14.38	0.050	0.1	7.87	400
60	4.84	14.39	0.050	0.1	7.57	403
80	4.75	14.38	0.050	0.1	7.26	407
100	4.75	14.39	0.050	0.1	7.24	409
120	4.75	14.38	0.050	0.1	7.11	412
160	4.77	14.39	0.050	0.1	7.07	413
180	4.77	14.41	0.050	0.1	7.00	416
Sample	5.16	15.43	0.053	0.1	8.45	338

Sampling

Time of Sample Collection: 1045

Method: _____ Stainless steel bailer _____ Analyses: _____ VOCs _____ 503 _____ Other _____
 _____ Teflon bailer _____ SVOCs _____
 _____ Pos. Disp. Pump _____ Metals _____
X Disposable bailer _____ PCB/Pest. _____
 _____ Dedicated pump _____ Physical _____
 _____ Other: X _____ Other _____
 BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations

Weather/Temperature: Overcast, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments:

2 GPM
Blind duplicate #1 taken

**FIELD OBSERVATION LOG
GROUNDWATER SAMPLING RECORD**

SITE Sonia Road Landfill DATE 5/21/04

SAMPLE ID: 2023-MW-12D (98) Time On-site: 1150 Time Off-site: 1150

WELL ID: MW-12D Stephen Tauss 1100 1150

SAMPLERS: Kristen Penella 1100 1150

Depth of well (from top of casing) 98.32 ft Time: _____
 Initial static water level (from top of casing) 6.91 ft Time: _____

Purging Method
 Airlift _____ Centrifugal _____ Well Volume Calculation:
 Bailer _____ Pos. Displ. _____ 2 in. casing: _____ ft. of water x 0.16 = _____ gallons
 Submersible X Ded. Pump _____ 3 in. casing: _____ ft. of water x 0.36 = _____ gallons
 4 in. casing: 91.41 ft. of water x 0.65 = 59.41 gallons

Volume of water removed: 320 gal. >3 volumes: yes X no _____ purged dry? yes _____ no X

Field Tests

Volume of Purge Water (in gallons)	pH	Temp (c°)	Spec. Cond. (ms/cm)	Turbidity (NTUs)	Dissolved Oxygen (mg/l)	Eh (mv)
Initial	5.00	13.69	0.054	4.8	8.14	361
40	5.01	13.69	0.054	0.1	8.16	361
120	5.02	13.69	0.055	0.1	7.94	363
200	5.04	13.69	0.055	1.0	7.87	366
240	5.05	13.69	0.055	0.9	7.70	368
280	5.05	13.69	0.055	0.1	7.40	370
320	5.07	13.69	0.055	0.1	7.46	373
Sample	5.47	14.00	0.056	0.1	9.37	321

Sampling
 Time of Sample Collection: 1145

Method: _____ **Analyses:** _____
 _____ X VOCS 602 _____ 503 _____ Other _____
 _____ X SVOCs _____
 _____ Teflon bailer _____ X Metals _____
 _____ Pos. Disp. Pump _____ X PCB/Pest. _____
X Disposable bailer _____ Physical _____
 _____ Dedicated pump _____ X Other _____
 _____ Other: _____ BOD, Bromide, Chloride, Sulfate, Alkalinity, TDS, COD, Ammonia, Nitrate, Total phenols, TKN, TOC, Hardness

Observations
 Weather/Temperature: Clear, 65 degrees F
 Sample description: Clear, colorless, no odor
 Free Product? yes _____ no X describe _____
 Sheen? yes _____ no X describe _____
 Odor? yes _____ no X describe _____

Comments: 20 GPM

APPENDIX B-2

FIELD FORMS - DAILY EQUIPMENT CALIBRATION LOGS

DAILY EQUIPMENT CALIBRATION LOG

Project Name: Sonia Road Landfill

Project Number: 2023-08A

Calibrated by: K. Robins

Instrument Name and Model Number	Calibration Method	Time	Readings and Observations
Neotronics multigas meter serial # 105703501	factory calibrated 10/03	-	Ok
Foxboro OVA-128	95 ppm methane	4 pm	Cal ok
Neotronics multigas meter	factory calibrated 10/03	-	Ok

DAILY EQUIPMENT CALIBRATION LOG

Project Name: Sonia Road Landfill

Project Number: 2023-08A

Calibrated by: S. Tauss

Instrument Name and Model Number	Calibration Method	Time	Readings and Observations
Solinst Water level Meter Serial # 1355	Battery test	1400	Ok

DAILY EQUIPMENT CALIBRATION LOG

Project Name: Sonia Road Landfill

Project Number: 2023-08A

Calibrated by: S. Tauss

Instrument Name and Model Number	Calibration Method	Time	Readings and Observations
Horiba water meter U-22	Buffer 4.0 solution	0830	Cal ok
Serial # 928021015	Autocal		
Solinst Water level Meter	Battery test	0830	Ok
Serial # 1355			

DAILY EQUIPMENT CALIBRATION LOG

Project Name: Sonia Road Landfill

Project Number: 2023-08A

Calibrated by: S. Tauss

Instrument Name and Model Number	Calibration Method	Time	Readings and Observations
Horiba water meter U-22 Serial # 928021015	Buffer 4.0 solution Autocal	0830	Cal ok
Solinist Water level Meter Serial # 1355	Battery test	0830	Ok



Date: 5/24/04

DAILY EQUIPMENT CALIBRATION LOG

Project Name: Sonia Road Landfill

Project Number: 2023-08A

Calibrated by: S. Tauss

Instrument Name and Model Number	Calibration Method	Time	Readings and Observations
Horiba water meter U-22	Buffer 4.0 solution	0830	Cal ok
Serial # 928021015	Autocal		
Solinst Water level Meter	Battery test	0830	Ok
Serial # 1355			

DAILY EQUIPMENT CALIBRATION LOG

Project Name: Sonia Road Landfill


Project Number: 2023-08A

Calibrated by: S. Tausss

Instrument Name and Model Number	Calibration Method	Time	Readings and Observations
Horiba water meter U-22 Serial # 928021015	Buffer 4.0 solution Autocal	0830	Cal ok
Solinst Water level Meter Serial # 1355	Battery test	0830	OK

Appendix C





APPENDIX C

CHAIN-OF-CUSTODY FORMS



CLIENT: H2M

H2M SDG NO:

PROJECT NAME/NUMBER

SONA Road Lane Fill

AIB Job# 2023-084

SAMPLES (signature)/Client
Town of Islip
James Milligan
Steve Tass
Resource Recovery

DELIVERABLES:

B5-70D

TURNAROUND TIME: 21 Days

Sample Container Description

Total No. of Containers

40ml Vial/In Permeant

1 Liter HDPE

40ml Vial H2SO4

250ml Glass - H2SO4

250ml HDPE - H2O3

1 Liter HDPE - H2O3

250ml HDPE Wash

ANALYSIS REQUESTED

ORGANIC

INORG.

VOA
BNA
A11 FOR
TOC
75007
A11
Metal
CN

LAB I.D. NO.

REMARKS:

VX only

DATE TIME MATRIX
5/15/04 0000 W 2023-Trip Blank #1
5/19/04 1530 W LF6 Condensate 001A

Retinquished by: (Signature)

Date

Time

Received by: (Signature)

Date

Time

Retinquished by: (Signature)

Date

Time

Received by: (Signature)

Date

Time

Retinquished by: (Signature)

Date

Time

Received by: (Signature)

Date

Time

Retinquished by: (Signature)

Date

Time

Received by: (Signature)

Date

Time

Discrepancies Between Sample Labels and COC Record? Y or N

Explain:

Samples were:

1. Shipped or Hand Delivered Airbill#
2. Ambient or chilled
3. Received in good condition: Y or N
4. Properly preserved: Y or N
5. Samples returned to lab Hrs from collection.

COC Tape was:

1. Present on outer package: Y or N
2. Unbroken on outer package: Y or N
3. COC record present & complete upon sample receipt: Y or N

LABORATORY USE ONLY

Project Contact: James Milligan
Phone Number: (516) 364-9890

NOTES: NYSDEC
Ref 360
Baseline
Permeants

H2M LABS, INC.

575 Broad Hollow Rd, Melville, NY 11747-5076

Tel: (516) 694-3040 Fax: (516) 420-8436

14106

EXTERNAL CHAIN OF CUSTODY

CLIENT: *IRS*

H2M SDG NO:

PROJECT NAME/NUMBER

Sonia R. L. F.
2023-08A

SAMPLERS: (signature)/Client

Stephen Taus / *Tony J. Slip*
RAA

DELIVERABLES:

BS-70P

TURNAROUND TIME:

21 Day

Sample Container Description	<i>40ml vial unperf</i>											
	<i>1L HDPE</i>											
	<i>40ml vial H₂SO₄</i>											
	<i>250ml HDPE</i>											
	<i>250ml Glass H₂SO₄</i>											
	<i>1L HDPE HNO₃</i>											
	<i>250ml HDPE HNO₃</i>											

NOTES:

MYSDEL
Part 360
Baseline

Project Contact:

James T. Milligan

Phone Number:

516 364-9890

DATE	TIME	MATRIX	FIELD I.D.	Total No. of Containers	ANALYSIS REQUESTED								LAB I.D. NO.	REMARKS:
					ORGANIC				INORG.					
					VOA	BNA	PCB			Metal	CN			
<i>5/20/04</i>	<i>0900</i>	<i>AQ</i>	<i>2023-Top Blank #2</i>	<i>2</i>	<i>2</i>									
	<i>0915</i>	<i>GW</i>	<i>2023-MW-01D (106)</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
	<i>1015</i>		<i>2023-MW-01E (78)</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
	<i>1100</i>		<i>2023-MW-01S (29)</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
	<i>1150</i>		<i>2023-MW-02E (72)</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
	<i>1245</i>		<i>2023-MW-02D (116)</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
	<i>1345</i>		<i>2023-MW-07E (74)</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
<i>5/20/04</i>	<i>1345</i>	<i>GW</i>	<i>2023-MW-07E (74) MS</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			
	<i>1345</i>		<i>2023-MW-07E (74) MSB</i>	<i>11</i>	<i>2</i>	<i>2</i>	<i>3</i>	<i>1</i>	<i>1</i>	<i>1</i>	<i>1</i>			

Relinquished by: (Signature) <i>Stephen Taus</i>	Date <i>5/20/04</i>	Time <i>1500</i>	Received by: (Signature) <i>[Signature]</i>	Date <i>5/20/04</i>	Time <i>1500</i>
Relinquished by: (Signature)	Date	Time	Received by: (Signature)	Date	Time
Relinquished by: (Signature)	Date	Time	Received by: (Signature)	Date	Time
Relinquished by: (Signature)	Date	Time	Received by: (Signature)	Date	Time

LABORATORY USE ONLY	
Discrepancies Between Sample Labels and COC Record? Y or N	Explain:
Samples were:	
1. Shipped ___ or Hand Delivered ___ Airbill# _____	
2. Ambient or chilled	
3. Received in good condition: Y or N	
4. Properly preserved: Y or N	
5. Samples returned to lab ___ Hrs from collection.	
COC Tape was:	
1. Present on outer package: Y or N	
2. Unbroken on outer package: Y or N	
3. COC record present & complete upon sample receipt: Y or N	

14104

EXTERNAL CHAIN OF CUSTODY

H2M SDG NO:

CLIENT: *IRIS*

PROJECT NAME/NUMBER <i>Sonia Rd L.F.</i> <i>2023-08A</i>		SAMPLES: (signature)/Client <i>Stephen Tross</i> <i>Tony Isip</i> <i>RZA</i>	
DELIVERABLES: <i>BS-70D</i> <i>21 box</i>		TURNAROUND TIME:	
DATE	TIME	MATRIX	FIELD I.D.
<i>5/10/24</i>	<i>0000</i>	<i>AG</i>	<i>2023-Tip Blank #3</i>
<i>0930</i>	<i>6w</i>		<i>2023-MW-12.5 (19)</i>
<i>1045</i>			<i>2023-MW-12 I (70)</i>
<i>0000</i>			<i>2023-Blind Duplicate -</i>
<i>1145</i>			<i>2023-MW-12 D (98)</i>
<i>1310</i>			<i>2023-MW-11 D (94)</i>
<i>1345</i>			<i>2023-Field Blank -</i>
<i>1445</i>			<i>2023-MW-11 F (71)</i>
<i>1515</i>			<i>2023-MW-11.5 (19)</i>

Sample Container Description	Total No. of Containers	ANALYSIS REQUESTED				Metal	CN	LAB I.D. NO.	REMARKS:
		ORGANIC	INORG.	VOA	BNA				
<i>40ml vial unpreserved</i>	<i>2</i>			<i>2</i>			<i>1</i>		
<i>1L HDPE</i>	<i>2</i>			<i>2</i>			<i>1</i>		
<i>40ml vial H₂O</i>	<i>2</i>			<i>2</i>			<i>1</i>		
<i>250ml Glass H₂O</i>	<i>2</i>			<i>2</i>			<i>1</i>		
<i>250ml HDPE</i>	<i>2</i>			<i>2</i>			<i>1</i>		
<i>1L HDPE HD03</i>	<i>2</i>			<i>2</i>			<i>1</i>		
<i>250ml HDPE HD04</i>	<i>2</i>			<i>2</i>			<i>1</i>		

NOTES:
NYSDC
Pat 360
305/1/2

Project Contact: *Tomis T. Miller*
Phone Number: *516 364-9892*

LABORATORY USE ONLY

Discrepancies Between Sample Labels and COC Record? Y or N _____

1. Shipped _____ or Hand Delivered _____ Airbill# _____

2. Ambient or chilled _____

3. Received in good condition: Y or N _____

4. Properly preserved: Y or N _____

5. Samples returned to lab _____ Hrs from collection.

COC Tape was: _____

1. Present on outer package: Y or N _____

2. Unbroken on outer package: Y or N _____

3. COC record present & complete upon sample receipt: Y or N _____

H2M LABS, INC.

575 Broad Hollow Rd, Melville, NY 11747-5076

Tel: (516) 694-3040 Fax: (516) 420-8436

14105

EXTERNAL CHAIN OF CUSTODY

CLIENT: JRS H2M SDG NO:

PROJECT NAME/NUMBER
Sonia Rd. L.F.
2023-084

Sample Container Description	Total No. of Containers	ANALYSIS REQUESTED							
		ORGANIC				INORG.			
		VOA	BNA	Pest/PCB				Metal	CN
40ml vial unpreserved									
1L H ₂ O HAPE									
40ml vial H ₂ SO ₄									
250ml glass H ₂ SO ₄									
250ml H ₂ OPE HNO ₃									
1L H ₂ O HAPE HNO ₃									
250ml H ₂ OPE HNO ₃									

Project Contact:
Jim T. Milligan
Phone Number:
516 364-9890

SAMPLERS: (signature)/Client
Stephen Taus Town of ISIP
RRA

DELIVERABLES:
BS-70-D

TURNAROUND TIME:
21 Day

DATE	TIME	MATRIX	FIELD I.D.	Total No. of Containers	VOA	BNA	Pest/PCB				Metal	CN	LAB I.D. NO.	REMARKS:
5/24/04	0900	AQ	2023-Trip Blank #4	2	2									
	0900	BW	2023-MW-06S (37)	11	2			2	3	1	1	1		
	1000		2023-MW-06 I (76)	11	2			2	3	1	1	1		
	1100		2023-MW-06 D (117)	11	2			2	3	1	1	1		
	1210		2023-MW-04 D (114)	11	2			2	3	1	1	1		
	1330		2023-MW-04 I (71)	11	2			2	3	1	1	1		
	1355		2023-MW-04 S (34)	11	2			2	3	1	1	1		
	1520		2023-MW-03 S (32)	11	2			2	3	1	1	1		

Relinquished by: (Signature) <u>Stephen Taus</u>	Date <u>5/24/04</u>	Time <u>16:00</u>	Received by: (Signature) <u>Mary M...</u>	Date <u>5/24/04</u>	Time <u>16:00</u>
Relinquished by: (Signature)	Date	Time	Received by: (Signature)	Date	Time
Relinquished by: (Signature)	Date	Time	Received by: (Signature)	Date	Time
Relinquished by: (Signature)	Date	Time	Received by: (Signature)	Date	Time

LABORATORY USE ONLY

Discrepancies Between Sample Labels and COC Record? Y or N Explain:

Samples were:

- Shipped ___ or Hand Delivered ___ Airbill# _____
- Ambient or chilled
- Received in good condition: Y or N
- Properly preserved: Y or N
- Samples returned to lab ___ Hrs from collection.

COC Tape was:

- Present on outer package: Y or N
- Unbroken on outer package: Y or N
- COC record present & complete upon sample receipt: Y or N

PROJECT NAME/NUMBER
Sonja Rd. L.F.

2023-08A

SAMPLERS: (signature)/Client
Sylvia Jones
Town of Islip RFA

DELIVERABLES:

B5-70-D

TURNAROUND TIME:

21 Day

CLIENT: ERS H2M SDG NO:

EXTERNAL CHAIN OF CUSTODY

11101

Sample Container Description	Total No. of Containers	ANALYSIS REQUESTED			Metal	CN	LAB I.D. NO.	REMARKS:
		ORGANIC	INORG.					
40ml vial unpreserved	2							
IL HAPE	2							
40ml vial H ₂ SO ₄	2							
250ml Glass H ₂ SO ₄	2							
250ml HAPE HNO ₃	2							
IL HAPE HNO ₃	2							
250ml HAPE NaOH	2							

DATE	TIME	MATRIX	FIELD I.D.	VOA	BNA	Past/PCB
0920	GW		2023-MW-05D (116)	2		
1000	AO		2023-FW Blank - 2	2		
1030	GW		2023-MW-05 E (70)	2		
0000			2023-Blind Duplicate-2	2		
1140			2023-MW-05 S (34)	2		
			2023-MW-05 S (34)	2		
			2023-MW-05 S (34)	2		

Date	Time	Received by: (Signature)	Date	Time	Received by: (Signature)
5/25/04	14:00	[Signature]	5/25/04	17:00	[Signature]

Discrepancies Between Sample Labels and COC Record? Y or N	Explain:	1. Shipped or Hand Delivered Airbill#	2. Ambient or chilled	3. Received in good condition: Y or N	4. Properly preserved: Y or N	5. Samples returned to lab Hrs from collection	COC Tape was:	1. Present on outer package: Y or N	2. Unbroken on outer package: Y or N	3. COC record present & complete upon sample receipt: Y or N

LABORATORY USE ONLY

Appendix D




APPENDIX D

DATA VALIDATION FORMS

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

I. Data Deliverable Requirements

- | | |
|----------------------------|-----|
| A. Legible | Yes |
| B. Paginated | Yes |
| C. Arranged in order | Yes |
| D. Consistent dates | Yes |
| E. Case Narrative | Yes |
| F. Chain-of-Custody Record | Yes |
| G. Sample Data Complete | Yes |
| H. Standard Date Complete | Yes |
| I. Raw QC Data Complete | Yes |

Comments: IRS029 & IRS030

22 wells, 2 FB, 2 MS/MSD's and 2 duplicates were collected and analyzed for Baseline parameters, % trip blanks were collected and analyzed for VOCs

Blind dup#1 is a duplicate of MW-12I, Blind dup#2 is a duplicate of MW-05I

For Blind dup#2 the all results were comparable with the exception of alkalinity and hardness which had alkalinity higher in the duplicate (184 vs 439) and hardness lower on the duplicate (750 vs 220)

RESULTS OF BLIND DUP#1 were comparable to the sample results for MW-12I

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

II. Holding Times

Sample I.D.	Date	Date	Date	Holding Time Exceeded?
	Received	Extracted	Analyzed	
TB#1	5/19/04		5/26/04	No
MW-01D	5/20/04		5/25/04	No
MW-01I	5/20/04		5/25/04	No
MW-01S	5/20/04		5/25/04	No
MW-02I	5/20/04		5/25/04	No
MW-02I	5/20/04		5/25/04	No
MW-02I*	5/20/04		5/26/04	No
TB#2	5/20/04		5/26/04	No
BLIND DUP#1	5/21/04		5/27/04	No
MW-11D	5/21/04		5/27/04	No
MW-11I	5/21/04		5/27/04	No
MW-11S	5/21/04		5/27/04	No
MW-12D	5/21/04		5/27/04	No
MW-12I	5/21/04		5/27/04	No
MW-12S	5/21/04		5/27/04	No
FB#1	5/21/04		5/28/04	No
TB#3	5/21/04		5/28/04	No
MW-03S	5/24/04		5/27/04	No
MW-04D	5/24/04		5/28/04	No
MW-04I	5/24/04		5/28/04	No
MW-04S	5/24/04		5/28/04	No
MW-04S	5/24/04		5/28/04	No
MW-06D	5/24/04		5/28/04	No
MW-06I	5/24/04		5/28/04	No

DATA VALIDATION – ORGANICS

MW-06S	5/24/04	5/28/04	No
TB#4	5/24/04	5/28/04	No
BLIND DUP#2	5/25/04	5/28/04	No
MW-05D	5/25/04	5/28/04	No
MW-05I	5/25/04	5/28/04	No
MW-05S*	5/25/04	5/28/04	No
FB#2	5/25/04	5/28/04	No
TB#5	8/25/03	8/25-8/29	No

* Sample
utilized as the
MS/MSD

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill

Laboratory Name: H2M

Reviewer: R.Petrella

Date of Review: 7/2/04


Fraction: VOA

III. Tune Summary

Tune File I.D. Number	Acceptable ?	Comments
1. F17780	YES	INITIAL
2. F18009	YES	SAMPLES
3. F18059	YES	SAMPLES
4. F18082	YES	SAMPLES
5. P26036	YES	INITIAL
6. P26157	YES	SAMPLES
7. P26175	YES	SAMPLES
8.		
9.		
10.		

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

Fraction: VOA

IV. Initial Calibration Summary (GC/MS)

Date of Calibration: 5/5/04, 5/14/04

A. Standard Data Files

Standard 1 ID: <u>F17783, P26039</u>	Conc: <u>10</u>
Standard 2 ID: <u>F17784, P26038</u>	Conc: <u>20</u>
Standard 3 ID: <u>F17785, P26040</u>	Conc: <u>50</u>
Standard 4 ID: <u>F17786, P26041</u>	Conc: <u>100</u>
Standard 5 ID: <u>F17787, P26042</u>	Conc: <u>200</u>

B. 1. All SPCC met Criteria ?

Yes

2. Calculate a SPCC average RRF

Comments: _____

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill

Laboratory Name: H2M

Reviewer: R.Petrella

Date of Review: 7/2/04

Fraction: VOA

Date of Calibration: 5/5/04, 5/14/04

IV. Initial Calibration Summary (continued)

2. All CCC met Criteria ?

Yes

Comments: _____

Calculate a CCC % RSD

- C. 1. Was the tune for the initial calibration acceptable ?

Yes

2. Was the calibration conducted within 12 hours of the tune

Yes

Comments: _____

- D. Overall assessment of the initial calibration:
(list the associated samples)

Initial Calibration ok

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R.Petrella  Date of Review: 7/2/04

Fraction: VOA

VI. Continuing Calibration Summary (GC/MS)

Date of Initial Calibration: 5/5/04, 5/14/04

Date of Continuing Calibration: 5/24/04, 5/26/04, 5/27/04, 5/27/04, 5/28/04 File ID: F18010, F18060, F18083, P26158, P26176

A. 1. All SPCC met criteria ?
Yes

Calculate a SPCC RRF

Comments: _____

2. All CCC met criteria ?
Yes

Calculate a CCC % D

Comments: _____

B. Overall assessment of Continuing Calibration
(list associated samples)

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

Fraction: VOA

VIII. Internal Standard Area Summary (GC/MS)

Were all internal standard peak areas within the contract limits ?

Yes

If No, please note below

<u>Sample</u>	<u>Internal Standard</u>	<u>Amount Above</u>	<u>Contract Requirement</u>	<u>Comments</u>
---------------	--------------------------	---------------------	-----------------------------	-----------------

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R.Petrella  Date of Review: 7/2/04

Fraction: VOA

IX. Blank Summary

Date/Time of Analysis: _____ File ID: _____

<u>Compound</u>	<u>Concentration</u>	<u>≤ CROL</u>	<u>Comments</u>
Chlorobenzene in VBLK5/26	2 UG/L		Chlorobenzene results for samples MW-071, MW-11D and MW-11I have been qualified as non-detect.
1,4-Dichlorobenzene	2 UG/L		1,4-dichlorobenzene for sample MW-071 has been qualified as non-detect
MeCl in VBLK5/24	2 UG/L		Compound was not detected in any of the associated samples

List the samples associated with this method blank.

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill

Laboratory Name: H2M

Reviewer: R. Petrella

Date of Review: 7/2/04

Fraction: VOA

X. Surrogate Recovery Summary

Were all surrogate recoveries within the contract limits ?


Yes

If No, please note below.

<u>Sample</u>	<u>Surrogate Compound</u> <u>Outside Recovery Limits</u>	<u>Amount Above</u> <u>Contract Requirement</u>	<u>Comments</u>
---------------	---	--	-----------------

DATA VALIDATION – ORGANICS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R.Petrella  Date of Review: 7/2/04

Fraction: VOA

XI. Matrix Spike/Matrix Spike Duplication Summary

Sample ID: MW-5S, MW-071 Matrix: WATER

Did the MS/MSD recovery data meet the contract recommended requirements ?

Yes*

If No, please note below.

For MW-5S all recoveries were within limits, however the 3 RPDs were slightly above limits, qualification of the data is not required

For MW-071 all recoveries and RPDs were within limits

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill

Laboratory Name: H2M

Reviewer: R. Petrella

Date of Review: 7/2/04



I. Holding times

Sample	Date	Date	Date	Holding Time Exceeded?
	Received	Digested	Analyzed	
MW-01D	5/20/04		5/04-6/04	No
MW-01I	5/20/04		5/04-6/04	No
MW-01S	5/20/04		5/04-6/04	No
MW-02I	5/20/04		5/04-6/04	No
MW-02I	5/20/04		5/04-6/04	No
MW-07I*	5/20/04		5/04-6/04	No
BLIND DUP#1	5/21/04		5/04-6/04	No
MW-11D	5/21/04		5/04-6/04	No
MW-11I	5/21/04		5/04-6/04	No
MW-11S	5/21/04		5/04-6/04	No
MW-12D	5/21/04		5/04-6/04	No
MW-12I	5/21/04		5/04-6/04	No
MW-12S	5/21/04		5/04-6/04	No
FB#1	5/21/04		5/04-6/04	No
MW-03S	5/24/04		5/04-6/04	No
MW-04D	5/24/04		5/04-6/04	No
MW-04I	5/24/04		5/04-6/04	No
MW-04S	5/24/04		5/04-6/04	No
MW-04S	5/24/04		5/04-6/04	No
MW-06D	5/24/04		5/04-6/04	No
MW-06I	5/24/04		5/04-6/04	No
MW-06S	5/24/04		5/04-6/04	No
BLIND DUP#2	5/25/04		5/04-6/04	No
MW-05D	5/25/04		5/04-6/04	No
MW-05I	5/25/04		5/04-6/04	No
MW-05S*	5/25/04		5/04-6/04	No

DATA VALIDATION – METALS

FB#2	5/25/04	5/04-6/04	No
	* Sample utilized as the MS/MSD		

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

Associated Samples: _____

II. Initial Calibration

1. Were all initial instrument calibrations performed?

Yes

Comments:

2. Were the initial calibration verification standards analyzed at the contract specified frequency?

Yes

Comments:

3. Were the initial calibration results within the control limits listed below?

For tin and mercury: 80-120% of the true value
For all other metals: 90-110% of the true value

Yes

If "No", note analytes _____

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

Associated Samples: _____

III. Continuing Calibration

1. Were the continuing calibration verification standards analyzed at the contract specified frequency?
Yes

Comments: _____

2. Were the continuing calibration results within the control limits listed below?


For tin and mercury: 80-120% of the true value
For all other metals: 90-110% of the true value

Yes
If "No", note analytes _____

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella Date of Review: 7/2/04



IV. Blank Summary

A. Method Blanks

1. Was a method blank prepared and analyzed at the contract specified frequency?
Yes
2. Were all the analytes below the CRDL in the method blank?
Yes

Comments:


B. Calibration Blanks

1. Were all initial and continuing calibration blanks analyzed at the contract specified frequency/
Yes
2. Were all the analytes below the CRDL in all the calibration blanks?
Yes

Comments:

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

MW-5S, MW-071

V. Duplicate Analysis

1. Was a duplicate prepared and analyzed at the contract specified frequency?
Yes

Comments:

2. Were control limits for the relative percent differences (RPD) met for each analyte?

Yes

Comments:

For sample values >5 times the CRDL, the RPD control limit is $\pm 20\%$.

For sample values >5 times the CRDL, the RPD control limit is $\pm CRDL$.

If sample results were outside of the control limits, all data associated with that duplicate sample should have been flagged with a "u.s.".

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R.Petrella  Date of Review: 7/2/04

MW-5S, MW-071

VI. Matrix Spike Analysis

1. Was a matrix spike prepared and analyzed at the contract specified frequency?
Yes

Comments:

2. Were the matrix spike recoveries within the contract specified control limits (75-125%)?
Yes

If "No", note analytes _____

Data should have been flagged with "N" for analytes out of control limits. If the sample concentration exceeds the spike concentration by a factor of four or more, no flag is required.

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella  Date of Review: 7/2/04

VII. ICP Interference Check Sample Summary

1. Was the ICP serial dilution analyzed at the contract specified frequency?
Yes

Comments:

2. Were the serial dilution differences within the contract specified limits of \pm 10%?
Yes

Comments:

3. Was the ICP CRDL check standard analyzed at the contract specified frequency for the analytes required?
Yes

Comments:

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R. Petrella Date of Review: 7/2/04

VII. ICP Interference Check Sample Summary (continued):

4. Was the ICP interference check sample analyzed at the contract specified frequency:

Yes

Comments:


5. Were the ICP interference check sample results within the control limit of \pm w-20% of the mean value?

Yes

If “No”, not analytes _____

DATA VALIDATION – METALS

Site Name: Sonia Rd Landfill Laboratory Name: H2M

Reviewer: R.Petrella  Date of Review: 7/2/04

VIII. Laboratory Control Sample Analysis

1. Was a laboratory control sample analyzed at the contract required frequency?
Yes

Comments:

2. Were the percent recoveries within the control limits of 80-120% (except for Ag and Sb) for each analyte?
Yes

Comments:

