


LBG ENGINEERING SERVICES, P.C.

Professional Environmental & Civil Engineers



126 Monroe Turnpike
Trumbull, CT 06611
(203) 452-3110
(203) 452-3119 (FAX)

July 31, 2003



Mr. Jeffery Trad
Project Manager
New York State Department of Environmental Conservation
Division of Environmental Remediation, Construction Services
625 Broadway, 12th floor
Albany, NY 12233-7013

RE: June 2003 Status Report
Ground-Water Remedial Action
Rowe Industries Superfund Site
Sag Harbor, New York

Dear Mr. Trad:

The enclosed letter report details the operation status of the full-scale ground-water pump and treat system at the above referenced site. As discussed in our telephone conversation, LBG has enclosed an additional copy of the report to be forwarded to the Chief of the Operation Maintenance and Support Section.

Should you or the Operation Maintenance and Support Section have any questions, please feel free to contact myself or Al Kovalik at (203) 452-3100.

Very truly yours,

LEGGETTE, BRASHEARS & GRAHAM, INC.

Laura R. Zirna
Environmental Engineer

LZ:ng
Enclosures

H:\NABIS\2003\monthly reports\June\trad_jun2003_report.doc

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 03-06

TO: Pamela Tames, USEPA

FROM: Laura R. Zima,
Alfred N. Kovalk, P.E.

DATE: July 31, 2003

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
June 2003 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of the operation, maintenance and monitoring activities for the site from June 1, 2003 through June 30, 2003. The report includes a summary of system operational parameters, tasks completed during the reporting period, anticipated tasks for the following month, analytical results for ground-water and system effluent samples, air quality results, and a summary of stream/estuary, wetland, and ground-water monitoring data.

SUMMARY OF SYSTEM OPERATION

(June 1, 2003 through June 30, 2003)

Reporting Period: 30 days

Total Flow During Period: 13,087,550 gallons

Average Effluent Flow: 383 gallons per minute (gpm) while operating

Mass of VOCs Recovered: 5.7 pounds

Cumulative VOCs Recovered: 60.7 pounds

Hours of Operation: 469 hours during reporting period (65 percent)
(based on number of hours registering flow from RW-1)

Alarm Conditions: See Table 1 : Maintenance Log

Discharge Criteria: Effluent water and air quality criteria met

SCHEDULE

Completed Tasks

During the June 2003 reporting period, LBG completed the following tasks:

- monitored system operations by completing routine inspections;
- completed ground-water recovery and treatment system troubleshooting and maintenance;
- collected ground-water samples from recovery wells (6/11/03);
- monitored select parameters in streams, estuary, wetlands, and ground water;
- completed air sampling events for carbon units;
- updated static ground-water elevations for accurate drawdown calculations;
- prepared monthly project status report; and
- completed project management administrative duties.

Upcoming Tasks

During the next reporting period, LBG anticipates completing the following tasks:

- monitor system operations by completing routine inspections;
- complete ground-water recovery and treatment system maintenance;
- collect ground-water samples from recovery wells;
- measure fluid levels and evaluate drawdown in aquifer;
- conduct monitoring of streams, estuary, wetlands, and ground water;
- complete air sampling events for carbon units;
- calculate contaminant recovery totals for the system;
- coordinate changes to system programming;
- prepare monthly project status report;
- complete project management administrative duties;
- replaced transducer in RW-9; and,
- run computer model with modified well flow to determine capture zone.

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Additional well operation information is included on the weekly operation reports, which are attached as Appendix I. A graph depicting the individual well flowrates over time is attached as Figure 1. RW-4 flow is not accurate due to a sensor power source malfunction. Figure 2 shows individual well pressures over time. Recovery well RW-6 average flow is reduced due to an increase in backpressure in the combined recovered water pipeline. The average flow for other wells is less than associated design values because flow adjustments were made in order to extend bag filter life. A computer model will be re-run with lower well flows to evaluate the long term effect of the lower flows on remediation of the aquifer, including capture zones and remediation time.

Based on analytical results for samples collected from the influent to the air stripper and water flow totalizer readings, approximately 5.7 pounds of volatile organic compounds (VOCs) were recovered by the system in June. The cumulative recovery of VOCs by the system since the start of

operation is 60.7 pounds. The VOC recovery calculation for June is attached as Appendix II and is based on four sampling events. Laboratory analytical reports are attached as Appendix III.

Well	Volume Pumped (gal)	Average Flow (gpm)	Design Flow (gpm)	Total VOC Concentration (ug/L)	VOC Recovery (lbs)
RW-1	818,642	35.0	35	0	0
RW-2	818,126	30.0	45	15.6	0.11
RW-3	818,177	30.0	30	7.6	0.05
RW-4*	1,070,000	50	50	174.8	2.05
RW-5	1,636,420	54.9	55	21.0	0.29
RW-6	818,197	34.9	50	120.7	0.82
RW-7	1,634,040	69.8	80	142.0	1.94
RW-8	1,201,210	43.5	90	62.8	0.63
RW-9	2,257,630	77.9	100	24.4	0.46

*Estimated volume and flow due to sensor power supply malfunction.

GROUND-WATER TREATMENT SYSTEM STATUS SUMMARY

System Operation

The two major components of the ground-water treatment system are the three multi-unit bag filter units and the packed-tower air stripper.

The filter units, with eight filter bags per unit, are located downstream of the equalization tank and upstream from the air stripper. The multi-bag filter units operate in parallel. The average flow from the equalization tank transfer pumps into the bag unit system was 380 gpm during the reporting period. The inlet, outlet and differential pressures for each filter unit are recorded on an hourly basis. Figure 3 illustrates the differential pressure readings over time across each of the three units. As indicated on this figure and as shown in the operations log, filter bag changeouts were conducted about three times a week. Alternate operating scenarios have been tried during the past reporting period to increase the lifespan of the filter bags and minimize system maintenance requirements. The scenario that worked to increase the life-span of the bag filters is to remove the filter sock from the last housing in each bank of filters, so filter socks are in the first seven housings in each bank of the filters. This reduced required change-outs of the filter socks from daily to approximately three times a week.

The average air flowrate through the air stripper during the reporting period was 2,100 scfm (standard cubic feet per minute). A graph of the air stripper air flow and air pressure over time is attached as Figure 4. The air flow and pressure readings have declined slightly. The graph does indicate the beginning of fouling of the air stripper packing, however the effluent quality and removal efficiency have not declined which indicates performance of the air stripper has not been reduced. The acid backwash system was not utilized during the reporting period. The water discharge

from the air stripper was sampled weekly. As shown on the attached Table 2, the treated ground water met the water-quality requirements set forth in the SPDES criteria. Figure 5 illustrates that the daily system effluent flowrate in gallons per day (gpd) was below the SPDES limit of 1,023,000 gpd.

AIR TREATMENT AND EMISSIONS MONITORING

Air sampling was conducted during the reporting period to ensure that VOC emissions do not exceed limits and to monitor the granular activated carbon units for breakthrough. The air stripper off-gas is treated by two carbon units, which are currently being operated in series. During system start-up, photoionization detector (PID) readings and air samples for laboratory analysis were collected from the effluent from the stripper, carbon unit 1 and carbon unit 2 on a weekly basis. Table 3 summarizes the air quality results for the initial system testing phase and all sampling done during the system operation. As shown in the table, the PCE laden air from the air stripper was effectively treated by the carbon units; therefore, no carbon changeout activities were conducted during the reporting period. According to the calculation in Appendix IV, the air emission rate from the carbon units (based on the June 5th analytical data) was 0.00166 pounds per hour. Trichloroethene was not detected and chloroform was below limits in the effluent vapor stream from the carbon unit system; therefore, the allowable concentrations of these compounds corresponding to the Ambient Guideline Concentration (AgC) at the property line were not exceeded.

GROUND-WATER SAMPLING

Ground-water samples were collected from the nine recovery wells on June 11, 2003. The samples were collected to estimate VOC mass recovery rates from each well. Table 4 summarizes the VOC analytical data for all ground-water samples collected during the operation of the system. The highest tetrachloroethene concentration for the most recent sampling round was 170 micrograms per liter in RW-4. Ground-water quality trends will be analyzed throughout the duration of the remedial action to evaluate the effectiveness of the pump and treat system in reducing the VOC concentration ion the aquifer. A comprehensive evaluation of ground-water quality (and ground-water levels) will be presented in the 2003 Annual Report.

STREAM/ESTUARY SALINITY MONITORING

Salinity and temperature levels were measured at predetermined locations perpendicular to the flow of water in the Ligonee Creek. The selected locations are considered representative of the section of Sag Harbor Cove downgradient of the VOC plume being captured and potentially affected by the operation of the recovery wells. The salinity and temperature profiles are monitored at the surface and various depths. Measurements were made at each location during, or close to, average daily high and low tide. Recorded temperature and salinity data for June at the various monitoring points was lost and therefore an evaluation relative to historical trends could not be completed this months. Salinity and temperature data collected during the next monthly monitoring event and throughout the duration of the ground-water remedial action will be evaluated against the historical monitoring data to determine if there is any measurable negative effect on the estuary.

WATER-LEVEL MONITORING

Water-level monitoring is conducted in the Crooked, Whaler's Road, Lily and Round Ponds and the Ligonee Brook to assess the impacts of the ground-water recovery system on water levels. Ground-water levels and pond water levels are measured in the piezometers and staff gages to determine the difference between the potentiometric heads in the underlying aquifer and the pond water levels. The ground-water elevation data were collected on June 5, 2003. The water-level measurements are shown on the hydrographs attached as Appendix VI. Water-level data collected during the next monthly monitoring event and throughout the duration of the ground-water remedial action will be evaluated against the baseline data.

Monitor well static water-level measurements were collected on June 30, 2003 and are summarized in Table 5. The collection of water level data from the monitor wells coincide with the collection of Greenbelt Pond water-level measurements. The drawdowns were calculated for June using this data and are shown in Table 5. Recovery well drawdown data for the nine recovery wells is approximated using data log files collected by the computer. The recovery well drawdowns presented in Table 5 are an average of the calculated drawdowns while the system was operating. It should be noted that drawdowns measured in monitor wells MW-49A, B and C are influenced by tidal fluctuations in the nearby cove. Negative or very low drawdown is believed to be the result of the collection of drawdown measurements during high tide conditions. Also presented in Table 5 are the simulated drawdowns according to the numerical ground-water flow model. Based on the comparison of the measured drawdowns in the monitor wells and the anticipated drawdowns generated by the model, the ground-water recovery system is capturing the plume.

Figures 6 through 14 show calculated drawdown for each of the nine recovery wells for the month of June. The calculated drawdowns in the recovery wells have remained stable throughout the period of operation. The decreasing trend and negative numbers observed in the figures are a result of seasonal fluctuation of the water table. The static ground-water elevation, which is used to calculate the drawdown, has not been updated since February 27 resulting in the negative drawdown values when the system is not recovering ground water. The static ground-water elevations will be updated during the next extended maintenance shutdown period.

cc: Paul Jobmann, LBGES, P.C.
Terry Gerrish, CH2M Hill
Mark Lucas, CH2M Hill
Phil McAndrew, Kraft Foods, N.A.
Jeff Trad, NYSDEC
Chief-Operation Maintenance and Support Section
(figure 4, table 2 and Appendix III)
Robert Schneck, RWE, R-1, NYSDEC
David Gilmartin, Jr., Esq., Town of Southampton

LRZ:ng

Attachments

H:\NABIS\2003\monthly reports\June\Status0306Jun.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(June 1, 2003 through June 30, 2003)

Date	Time	System Changes/Modifications	Personnel
6/1/03		Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used. Used bank 3 during changeout, then shut off.	PJ
6/3/03	1:36 PM	Shutdown recovery wells for O&M (test ACP flow vs. pressure)	PJ
		Switch TP1A/B lead pump from TP1B to TP1A, and TP2A/B lead pump from TP2B to TP2A.	PJ
	1:53 PM	Restarted recovery wells.	PJ
6/5/03	10:30 AM	Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used. Used bank 3 during changeout, then shut off.	LZ
	11:15 AM	Sampled NP2-6, NP2-7, NP2-10, NP4-1, NP4-2, and NP4-3.	LZ
		Measured water levels in all recovery wells and monitor wells while system was running.	LZ
6/6/03	10:39 AM	Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used. Used bank 3 during changeout, then shut off.	LZ
	8:45 PM	Booster blower failure alarm, motor starter tripped. System shut down	TF
6/9/03		Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used.	TF
		Restarted system.	TF
		Sampled NP2-6, NP2-7, NP2-10, and all recovery wells including horiba parameters.	PH
	2:11 PM	Booster blower failure alarm. System shut down.	PH
6/11/03	9:53 AM	Restarted system.	PH
6/12/03		Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used.	PH
		Removed acid circulation pump from system, turned pump off locally.	PH
6/13/03	1:03 PM	Booster blower failure alarm.	ASH
	4:23 PM	Booster blower failure alarm.	ASH
	5:47 PM	Booster blower failure alarm.	ASH
	6:58 PM	Booster blower failure alarm.	ASH
6/14/03	7:05 AM	Booster blower failure alarm.	ASH
	11:00 AM	Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used.	ASH
		Equalization high level alarm and bank 2 warning and alarm while changing bank 1. Alarms did not go on log or shut system down. System shut down manually.	ASH

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(June 1, 2003 through June 30, 2003)

Date	Time	System Changes/Modifications	Personnel
6/16/03	9:40 AM	Turned off transfer pumps to confirm proper operation of equalization tank high high position. Light on panel came on and pumps were restarted.	PH
	10:25 AM	Equalization tank goes high high and overflows. Turned off system and vacuumed water up and pumped it back into equalization tank.	PH
		Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used.	PH
6/17/03		Troubleshooting alarm system. Alarms had been turned off alarming on alarm page. Alarms tested and reset.	PJ
		Pumped out transfer tank containment basin. Treated water leaking from flanges removed to access ACP impeller. Installed blind flanges at both locations to stop water leak.	PJ
6/18/03	9:50 AM	Restarted system.	PJ
	11:15 AM	Filter bank 3 high pressure warning. Problem with communication to PLC because bank 3 is not running.	PJ
		Cleaned flowmeter chambers in RW-2, 4, 8, and 9.	PJ
6/19/03		Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used.	PJ
		Filter bank 3 high pressure warning. Bank 3 being used during changeout of banks 1 and 2.	PJ
		Created offsets for bag filter pressures and differential pressures in order to get correct numbers from field/local displays to PLC.	
	11:40 AM	Changed to primary recharge basin. Secondary recharge basin had approximately 2.5 feet of water in it.	PJ
		Changed secondary recharge basin setpoint to 36 inches. Changed primary recharge basin setpoint to 54 inches.	PJ
		Sampled NP2-6 , NP2-7, and NP2-10.	PJ
6/21/03	11:45 AM	Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings.	ASH
		Alarms did not energize when filter bank 2 pressure exceeded warning and alarm levels.	ASH
6/22/03	5:12 AM	Power failure alarm.	PH
	4:16 PM	Booster blower failure alarm.	PH
	4:17 PM	Air stripper blower low pressure alarm.	PH
6/23/03	9:30 AM	Restarted system.	PH
	1:27 PM	Booster blower low pressure alarm.	PJ
6/23/03	1:27 PM	Air stripper blower low pressure alarm.	PJ
		Checked tension of ASB and BB belts. Tightened both.	PJ
		Changed pump offset point on transfer tank from 35 to 38 inches.	PJ

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(June 1, 2003 through June 30, 2003)

Date	Time	System Changes/Modifications	Personnel
6/26/03	10:26 AM	Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings used, and bank 3 all housings used.	LZ
6/29/03	6:00 AM	Eqalization tank high high level alarm. Forced in order to shut system down for water level measurements when the system is not running.	LZ
	9:56 AM	System communication/PLC failure.	LZ
6/30/03	9:00 AM	Measuring static water levels in recovery wells and monitor wells while system was shut down.	LZ
	11:10 AM	Changed multi-bag filter socks (200 µm) on bank 1 and 2, seven of eight housings.	LZ
	11:46 AM	System communication/PLC failure.	LZ
	12:01PM	Restarted system.	LZ
	12:30 PM	Sampled NP2-6, NP2-7, and NP2-10.	LZ

TABLE 2

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

DISCHARGE WATER QUALITY RESULTS

Date Sampled	pH ^{2/}	TDS (mg/L)	PCE (ug/L)	1,1,1-TCA (ug/L)	TCE (ug/L)	1,1-DCA (ug/L)	1,1-DCE (ug/L)	1,2-DCE (ug/L)	Xylene (ug/L)	Toluene (ug/L)	Ethyl-benzene (ug/L)	Methylene Chloride (ug/L)	Freon 113 (ug/L)	Naphthalene (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)
SPDES Limits	6.5 to 8.5	---	1	5	5	5	5	5	5	5	5	5	---	10	7	---	---	---
5-Jun-03	7.9	100	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.45	0.185
11-Jun-03	NM	110	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	0.668	0.0538
19-Jun-03	6.85	80	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	0.348	0.352
23-Jun-03	NM	94	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.10	0.234
30-Jun-03	7.8	120	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	1.92	0.122

SPDES: State Pollutant Discharge Elimination System

mg/L: Milligrams per liter

ug/L: Micrograms per liter

---: Not established

NM: Not Measured

TDS: Total dissolved solids

PCE: Tetrachloroethylene

TCE: Trichloroethylene

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl tert-butyl ether

Notes:

1. TDS & Freon 113 added to parameter analysis with February 2003 Samples.
2. pH measured in field using hand held pH meter.
3. "Discharge" samples were collected from sample port labeled NP2-10.

TABLE 3

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Precarbon

Sample Name	Date	Time	Parameters (mg/m ³)											
			PCE	TCE	Toluene	Benzene	Chloroform	m&p-Xylenes	Methylene Chloride	o-Xylene	Chloromethane	Carbon Disulfide	Styrene	
Precarbon (ITPP A)	10/8/02	11:05	6.6	0.18	0.06	0.02	ND	ND	ND	ND	ND	ND	ND	ND
Precarbon (ITPP B)	10/9/02	12:31	5.6	0.18	0.04	0.06	ND	ND	ND	ND	ND	ND	ND	ND
Precarbon 112002	11/20/02	21:45	2.8	0.09	0.03	0.04	ND	ND	0.01	ND	0.54	ND	ND	ND
Precarbon 112602	11/26/02	20:10	6.8	0.18	0.06	ND	ND	ND	ND	ND	0.88	ND	ND	ND
AQ1219022120NP4-1	12/19/02	21:20	2.9	0.12	0.02	0.03	0.01	ND	ND	ND	ND	ND	ND	ND
AQ0109031120NP4-1	1/9/03	11:20	2.3	0.07	0.06	ND	ND	ND	ND	ND	ND	ND	ND	ND
AQ0220030932NP4-1	2/20/03	9:32	1.5	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
AQ0312031131NP4-1	3/12/03	11:31	1.3	0.04	0.02	0.009	ND	ND	ND	ND	0.09	ND	ND	ND
AQ0409030942NP4-1	4/9/03	9:42	0.72	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
AQ060503:1155NP4-1	6/5/03	11:55	0.6	0.02	0.003	0.003	ND	ND	0.097	ND	ND	ND	ND	ND

Midcarbon

Sample Name	Date	Time	Parameters (mg/m ³)											
			PCE	TCE	Toluene	Benzene	Chloroform	m&p-Xylenes	Methylene Chloride	o-Xylene	Chloromethane	Carbon Disulfide	Styrene	
Midcarbon (ITPP A)	10/8/02	11:07	0.004	ND	0.05	0.009	ND	0.008	ND	ND	ND	ND	ND	ND
Midcarbon (ITPP B)	11/9/02	12:30	0.002	ND	0.038	0.003	ND	0.005	ND	ND	ND	ND	0.002	
Midcarbon 112002	11/20/02	21:50	ND	ND	0.22	0.06	ND	0.07	0.19	ND	0.77	ND	ND	ND
Midcarbon 112602	11/26/02	21:12	0.005	ND	0.015	0.004	ND	0.003	0.017	ND	0.07	ND	ND	ND
AQ1219022120NP4-2	12/19/02	21:20	0.04	ND	0.027	0.004	ND	0.006	0.03	ND	ND	ND	ND	ND
AQ0109031122NP4-2	1/9/03	11:22	0.006	ND	0.044	ND	ND	0.004	0.013	ND	ND	ND	ND	ND
AQ0220030932NP4-2	2/20/03	9:32	0.008	ND	ND	ND	0.011	ND	ND	ND	ND	ND	ND	ND
AQ0312031131NP4-2	3/12/03	11:31	0.01	0.003	0.03	0.005	0.012	0.006	ND	0.002	ND	0.002	0.002	0.002
AQ0409030943NP4-2	4/9/03	9:43	0.006	0.003	0.008	0.001	0.011	0.004	0.081	ND	ND	0.019	ND	
AQ060503:1156NP4-2	6/5/03	11:56	0.032	0.001	0.002	0.001	0.004	ND	0.018	ND	0.002	ND	ND	ND

Postcarbon

Sample Name	Date	Time	Parameters (mg/m ³)											
			PCE	TCE	Toluene	Benzene	Chloroform	m&p-Xylenes	Methylene Chloride	o-Xylene	Chloromethane	Carbon Disulfide	Styrene	
Postcarbon (ITPP A)	10/8/02	11:09	0.002	ND	0.048	0.003	ND	0.005	0.049	ND	ND	0.016	ND	
Postcarbon (ITPP B)	10/9/02	12:27	0.002	ND	0.04	0.006	ND	0.004	0.002	0.004	ND	0.021	0.002	
Postcarbon 112002	11/20/02	21:51												Sample lost due to lab error
Postcarbon 112602	11/26/02	20:13	ND	ND	0.012	0.004	ND	0.002	0.017	ND	0.087	ND	ND	ND
AQ1219022120NP4-3	12/19/02	21:20	ND	ND	0.045	0.006	0.001	0.006	0.022	0.002	ND	ND	ND	ND
AQ0109031124NP4-3	1/9/03	11:24	0.001	ND	0.06	ND	ND	0.004	0.018	ND	ND	ND	ND	ND
AQ0220030932NP4-3	2/20/03	9:32	ND	ND	0.015	ND	ND	ND	ND	ND	ND	ND	ND	ND
AQ0312031132NP4-3	3/12/03	11:32	ND	ND	0.01	0.002	0.006	0.002	ND	ND	ND	0.003	ND	
AQ0409030944NP4-3	4/9/03	9:44	ND	ND	0.005	ND	0.009	0.002	0.023	ND	ND	0.019	ND	
AQ060503:1157NP4-3	6/5/03	11:57	ND	ND	0.011	0.019	0.031	0.005	0.028	ND	ND	0.041	ND	

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropyl-benzene (ug/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)
RW-1	5-Sep-02	ND<1	ND<1	ND<1	27	1.9	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-1	5-Sep-02	ND<1	ND<1	ND<1	ND<1	2.6	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-1	8-Oct-02	ND<1	ND<1	ND<1	ND<1	2.2	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-1	9-Oct-02	ND<1	ND<1	ND<1	ND<1	2.8	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-1	26-Nov-02	-	-	-	-	-	-	0.032	ND<0.02	-	-	-	-
RW-1	3-Jan-03	ND<1	ND<1	ND<1	ND<1	2.4	16	-	-	ND<1	ND<1	ND<1	ND<1
RW-1	23-Jan-03	ND<1	ND<1	ND<1	ND<1	2.0	9.8	-	-	ND<1	ND<1	ND<1	ND<1
RW-1	21-Mar-03	ND<1	ND<1	ND<1	ND<1	1.4	4.3	0.566	ND<0.02	ND<1	ND<1	ND<1	10
RW-1	23-Apr-03	ND<1	ND<1	ND<1	ND<1	1.2	8.6	0.053	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-1	13-May-03	ND<1	ND<1	ND<1	ND<1	1.8	8.7	0.051	ND<0.02	ND<1	ND<1	ND<1	3.6
RW-1	11-Jun-03	ND<1	ND<1	ND<1	ND<1	ND<1	8.1	0.0290	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-2	5-Sep-02	190	2.9	ND<1	ND<1	ND<1	21	-	-	ND<1	ND<1	ND<1	ND<1
RW-2	5-Sep-02	120	1.4	ND<1	ND<1	ND<1	18	-	-	ND<1	ND<1	ND<1	ND<1
RW-2	8-Oct-02	140	2	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-2	9-Oct-02	110	1.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	6.6
RW-2	26-Nov-02	-	-	-	-	-	-	50.9	0.188	-	-	-	-
RW-2	3-Jan-03	38	1.3	ND<1	ND<1	ND<1	7.5	-	-	ND<1	ND<1	ND<1	ND<1
RW-2	23-Jan-03	31	ND<1	ND<1	ND<1	ND<1	6.7	-	-	ND<1	ND<1	ND<1	ND<1
RW-2	21-Mar-03	26	1.8	ND<1	ND<1	ND<1	ND<1	11.4	0.059	ND<1	ND<1	ND<1	ND<1
RW-2	23-Apr-03	14	1.3	ND<1	ND<1	ND<1	ND<1	6.31	0.212	ND<1	ND<1	ND<1	ND<1
RW-2	13-May-03	21	2	ND<1	ND<1	ND<1	ND<1	3.8	5.51	0.052	ND<1	ND<1	3.7
RW-2	11-Jun-03	15	0.6	ND<1	ND<1	ND<1	ND<1	3.01	0.885	ND<1	ND<1	ND<1	ND<1
RW-3	5-Sep-02	23	1.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-3	5-Sep-02	30	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-3	8-Oct-02	18	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-3	9-Oct-02	19	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-3	26-Nov-02	-	-	-	-	-	-	2.23	2.34	-	-	-	-
RW-3	3-Jan-03	2.8	8.5	4.8	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-3	23-Jan-03	2.7	5.8	2.4	ND<1	ND<1	1.8	-	-	ND<1	ND<1	ND<1	ND<1
RW-3	21-Mar-03	2.4	3.6	1.1	ND<1	ND<1	ND<1	1.84	0.013	ND<1	ND<1	ND<1	ND<1
RW-3	23-Apr-03	1.1	1.2	ND<1	ND<1	ND<1	ND<1	1.81	0.395	ND<1	ND<1	ND<1	ND<1
RW-3	13-May-03	2.2	2.5	1.1	ND<1	ND<1	ND<1	ND<1	1.68	0.166	ND<1	ND<1	3.7
RW-3	11-Jun-03	2.4	3.4	1.8	ND<1	ND<1	ND<1	ND<1	2.37	0.517	ND<1	ND<1	ND<1
RW-4	23-Sep-02	550	8.5	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-4	23-Sep-02	590	9.5	1.6	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-4	8-Oct-02	670	11	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropyl-benzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	Methylene Chloride (ug/L)
RW-4	9-Oct-02	450	9.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-4	26-Nov-02	-	-	-	-	-	-	11	2.41	-	-	-	-
RW-4	3-Jan-03	190	3.8	7.1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-4	23-Jan-03	130	6.5	0.7	ND<1	ND<1	4.3	-	-	ND<1	ND<1	ND<1	ND<1
RW-4	21-Mar-03	150	3.6	ND<1	ND<1	ND<1	ND<1	1.36	0.041	ND<1	ND<1	ND<1	ND<1
RW-4	23-Apr-03	110	3.1	ND<1	ND<1	ND<1	ND<1	3.18	0.136	ND<1	ND<1	ND<1	ND<1
RW-4	13-May-03	170	5.4	1.0	ND<1	ND<1	3.4	2.38	0.023	ND<1	ND<1	ND<1	3.3
RW-4	11-Jun-03	170	4.8	ND<1	ND<1	ND<1	ND<1	1.03	0.572	ND<1	ND<1	ND<1	ND<1
RW-5	12-Sep-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-5	12-Sep-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-5	8-Oct-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-5	9-Oct-02	ND<1	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-5	26-Nov-02	-	-	-	-	-	-	ND<0.02	ND<0.02	-	-	-	-
RW-5	3-Jan-03	5.5	ND<1	ND<1	ND<1	1.9	1.5	-	-	ND<1	ND<1	ND<1	ND<1
RW-5	23-Jan-03	5.8	ND<1	ND<1	ND<1	1.1	3.5	-	-	ND<1	ND<1	ND<1	ND<1
RW-5	21-Mar-03	19	ND<1	ND<1	ND<1	ND<1	ND<1	0.489	0.013	ND<1	ND<1	ND<1	ND<1
RW-5	23-Apr-03	12	ND<1	ND<1	ND<1	ND<1	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-5	13-May-03	21	ND<1	ND<1	ND<1	0.8	6.7	0.146	ND<0.02	ND<1	ND<1	ND<1	3.6
RW-5	11-Jun-03	21	ND<1	ND<1	ND<1	ND<1	ND<1	6.2	0.76	0.0356	ND<1	ND<1	ND<1
RW-6	12-Sep-02	69	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-6	12-Sep-02	140	1.1	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-6	8-Oct-02	120	1.7	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-6	9-Oct-02	130	ND<1	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-6	26-Nov-02	-	-	-	-	-	-	0.37	ND<0.02	-	-	-	-
RW-6	3-Jan-03	110	1.1	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-6	23-Jan-03	97	1.6	ND<1	ND<1	0.6	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-6	21-Mar-03	130	1.0	ND<1	ND<1	ND<1	ND<1	3.05	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-6	23-Apr-03	79	1.0	ND<1	ND<1	ND<1	ND<1	0.028	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-6	13-May-03	120	1.8	ND<1	ND<1	0.6	ND<1	0.068	ND<0.02	ND<1	ND<1	ND<1	3.5
RW-6	11-Jun-03	120	0.7	ND<1	ND<1	ND<1	ND<1	0.0097	0.011	ND<1	ND<1	ND<1	ND<1
RW-7	12-Sep-02	270	4.1	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-7	12-Sep-02	350	5.2	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-7	8-Oct-02	360	4.7	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-7	9-Oct-02	370	4.9	ND<1	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-7	26-Nov-02	-	-	-	-	-	-	0.075	ND<0.02	-	-	-	-
RW-7	3-Jan-03	160	2.5	1.3	ND<1	ND<1	ND<1	-	-	ND<1	ND<1	ND<1	ND<1
RW-7	23-Jan-03	120	2.3	1.1	ND<1	0.5	1.4	-	-	ND<1	ND<1	ND<1	ND<1

TABLE 4

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	Isopropyl-benzene (ug/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	Methylene Chloride (ug/L)
RW-7	21-Mar-03	160	2.3	ND<1	ND<1	ND<1	ND<1	0.405	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-7	23-Apr-03	100	1.8	ND<1	ND<1	ND<1	ND<1	0.016	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-7	13-May-03	140	3.1	1.0	ND<1	ND<1	ND<1	0.032	ND<0.02	ND<1	ND<1	ND<1	4.0
RW-7	11-Jun-03	140	2.0	ND<1	ND<1	ND<1	ND<1	0.0246	0.0086	ND<1	ND<1	ND<1	ND<1
RW-8	23-Sep-02	130	7.1	ND<1	ND<1	ND<1	-	-	-	1.1	ND<1	ND<1	ND<1
RW-8	23-Sep-02	100	6.6	ND<1	ND<1	ND<1	-	-	-	1.4	ND<1	ND<1	ND<1
RW-8	8-Oct-02	100	7.5	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-8	9-Oct-02	94	6.6	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-8	26-Nov-02	-	-	-	-	-	-	12.1	1.43	-	-	-	-
RW-8	3-Jan-03	59	4.3	4	ND<1	ND<1	ND<1	-	-	ND<1	2.4	ND<1	ND<1
RW-8	23-Jan-03	58	4.2	3.2	ND<1	ND<1	ND<1	-	-	ND<1	1.8	0.6	ND<1
RW-8	21-Mar-03	70	2.9	2.7	ND<1	ND<1	ND<1	0.544	0.141	ND<1	1.4	ND<1	ND<1
RW-8	23-Apr-03	41	2.0	1.8	ND<1	ND<1	ND<1	11.8	0.352	ND<1	ND<1	ND<1	ND<1
RW-8	13-May-03	61	3.9	3.8	ND<1	ND<1	ND<1	10.1	0.068	ND<1	1.8	ND<1	3.4
RW-8	11-Jun-03	57	3.1	2.7	ND<1	ND<1	ND<1	9.14	1.10	ND<1	ND<1	ND<1	ND<1
RW-9	23-Sep-02	12	2.9	ND<1	ND<1	ND<1	-	-	-	ND<1	ND<1	ND<1	ND<1
RW-9	23-Sep-02	11	3	3.5	ND<1	ND<1	-	-	-	ND<1	5.3	ND<1	ND<1
RW-9	8-Oct-02	9.2	2.5	3.5	ND<1	ND<1	-	-	-	ND<1	6	1.1	ND<1
RW-9	9-Oct-02	16	3.4	6.6	ND<1	ND<1	-	-	-	ND<1	5.2	ND<1	ND<1
RW-9	26-Nov-02	-	-	-	-	-	-	2.99	1.72	-	-	-	-
RW-9	3-Jan-03	17	2.5	6.9	ND<1	ND<1	ND<1	-	-	ND<1	3.1	ND<1	ND<1
RW-9	23-Jan-03	23	2.8	4.3	ND<1	ND<1	ND<1	-	-	ND<1	2.5	0.6	ND<1
RW-9	21-Mar-03	23	2.2	2.8	ND<1	ND<1	ND<1	11.0	0.013	ND<1	1.7	ND<1	ND<1
RW-9	23-Apr-03	15	1.2	1.8	ND<1	ND<1	ND<1	3.55	1.97	ND<1	ND<1	ND<1	ND<1
RW-9	13-May-03	21	1.8	3.6	ND<1	ND<1	ND<1	2.95	0.046	ND<1	1.9	ND<1	3.2
RW-9	11-Jun-03	18	1.6	4.8	ND<1	ND<1	ND<1	2.75	1.74	ND<1	ND<1	ND<1	ND<1

ND: Not detected

<#: Less than method detection limit

ug/L: Micrograms per liter

-: Not analyzed

PCE: Tetrachloroethylene

TCE: Trichloroethylene

TCA: 1,1,1-Trichloroethane

1,1-DCA: 1,1-Dichloroethane

1,1-DCE: 1,1-Dichloroethene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

TABLE 5
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

STATIC WATER-LEVELS AND DRAWDOWN
FOR MONITOR AND RECOVERY WELLS

Well	Static Depth to Water (feet)	Drawdown (feet)*	Simulated Drawdown (feet)***
MW-43A	18.42	-	0.51
MW-43B	18.35	-	0.52
MW-43C	17.98	-	0.35
MW-45A	17.96	-	0.02
MW-46A	4.98	0.01	0.01
MW-46B	5.47	-0.32	0.01
MW-48A	22.25	-	0
MW-48B	19.29	-	0
MW-49A	7.84	-0.23	0.71
MW-49B	7.95	-0.20	0.68
MW-49C	7.84	-0.23	0.56
MW-50A	5.93	-	0.16
MW-50B	5.51	-	0.16
MW-50C	5.79	-	0.16
RW-1	23.45	0.64	1.28
RW-2	15.57	6.88	1.95
RW-3	2.85	0.83	0.98
RW-4**	11.2	-	1.57
RW-5	17.95	-0.10	1.51
RW-6	15.84	20.02	0.96
RW-7	13.04	-0.92	1.05
RW-8	6.72	1.93	1.18
RW-9**	3.64	-	1.34
MW B1	17.71	-13.26	-0.84

*Drawdown for recovery wells approximated using data-logged drawdown.
 Drawdown for monitor wells calculated from DTW measured on 6/5/03.

** Sensor malfunction.

***Drawdown based on model simulation.

FIGURES

FIGURE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL FLOW DATA
(June 1, 2003 through June 30, 2003)

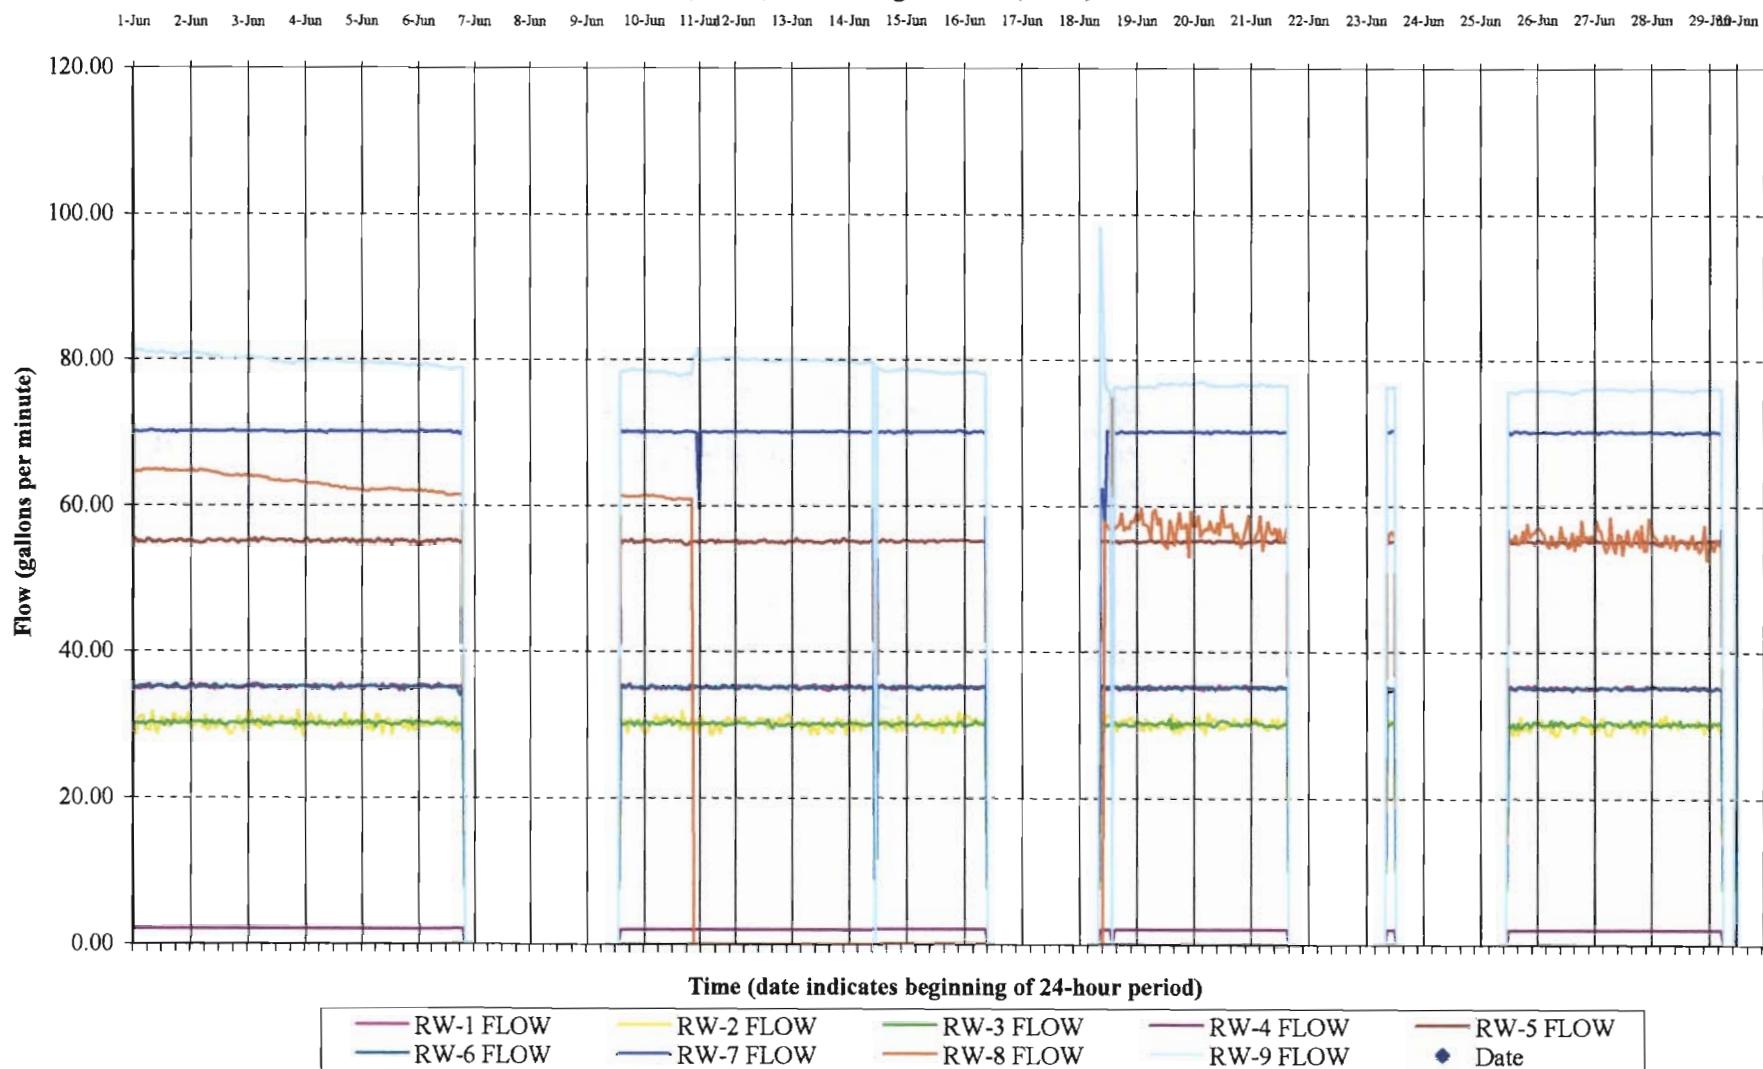


FIGURE 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PRESSURE DATA
(June 1, 2003 through June 30, 2003)

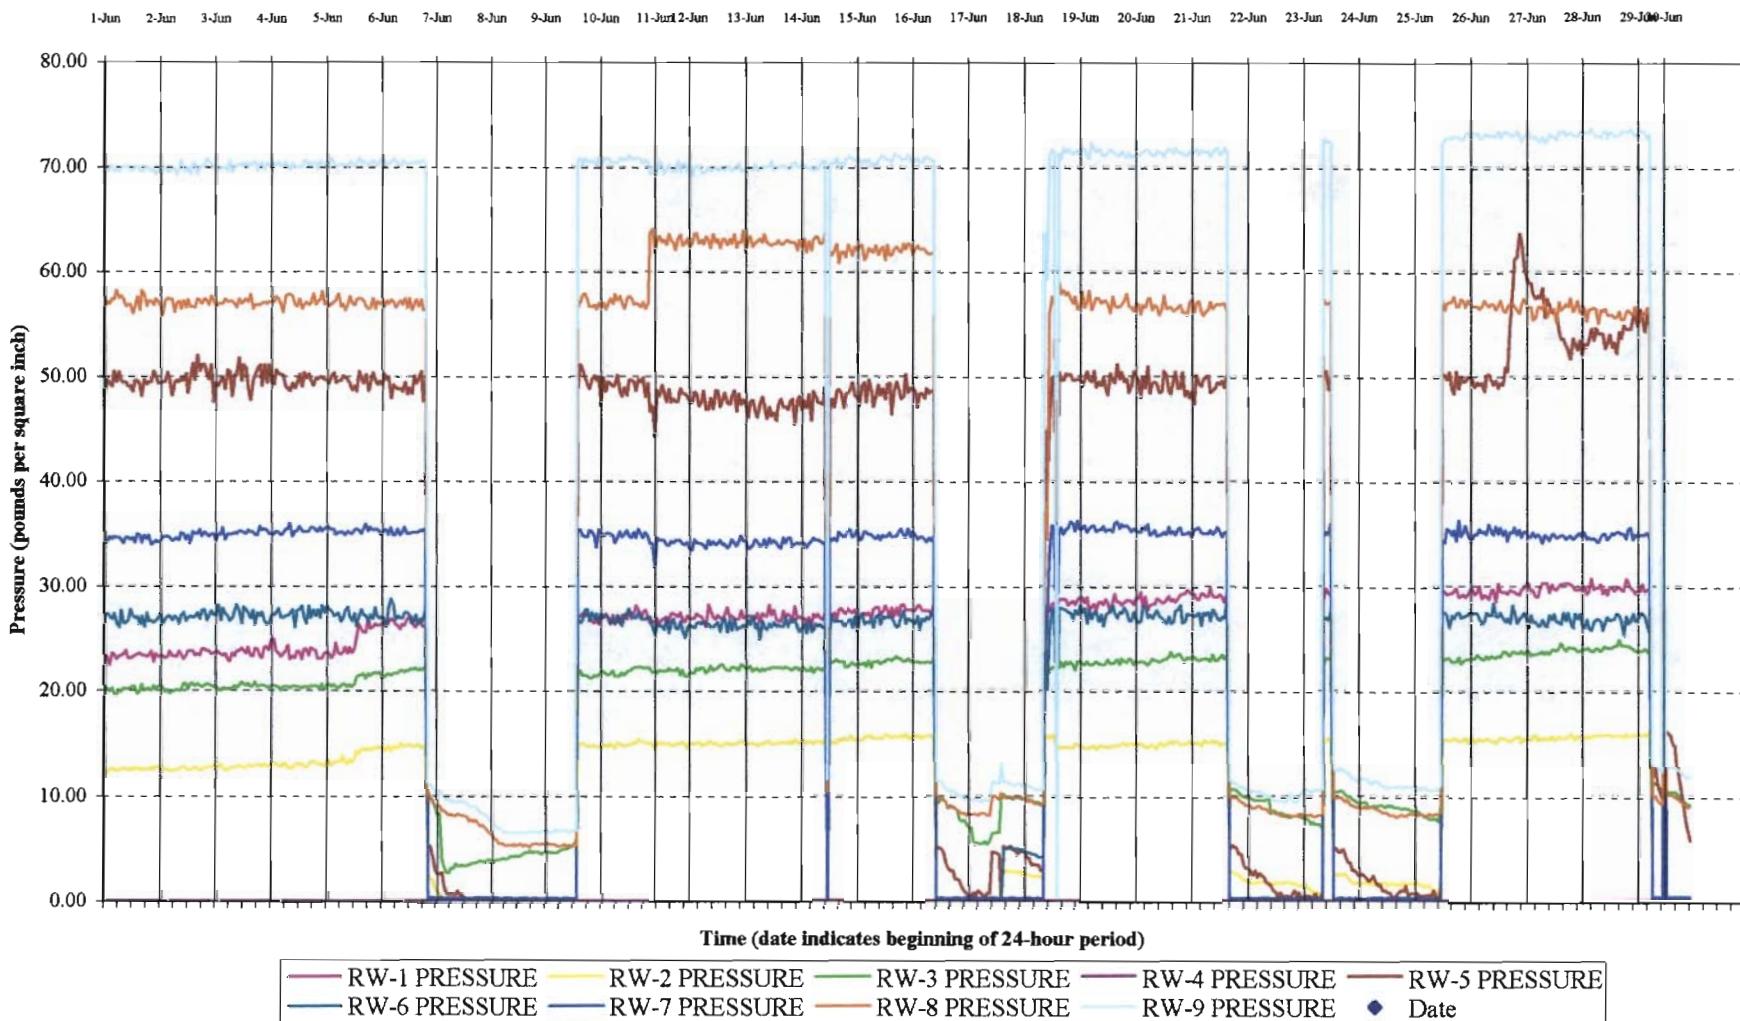


FIGURE 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

FILTER BANK DIFFERENTIAL PRESSURE
 (June 1, 2003 through June 30, 2003)

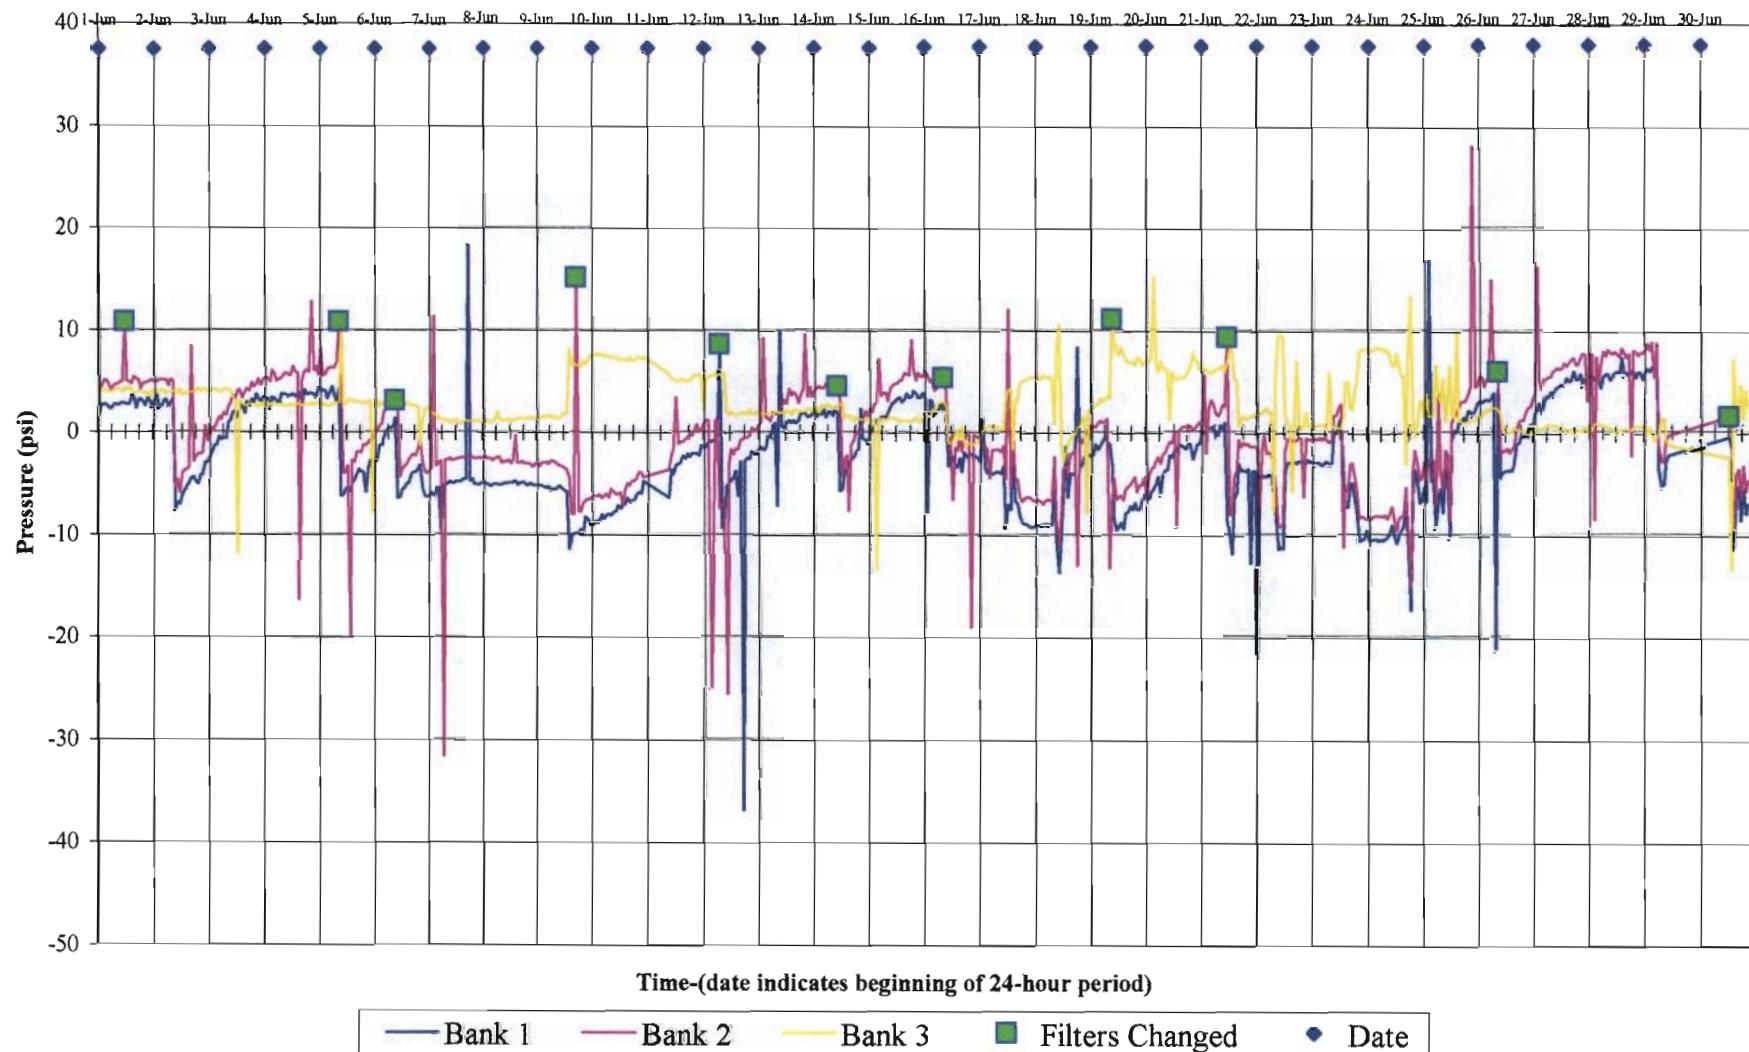


FIGURE 4
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

AIR STRIPPER BLOWER: FLOW AND PRESSURE

(June 1, 2003 through June 30, 2003)

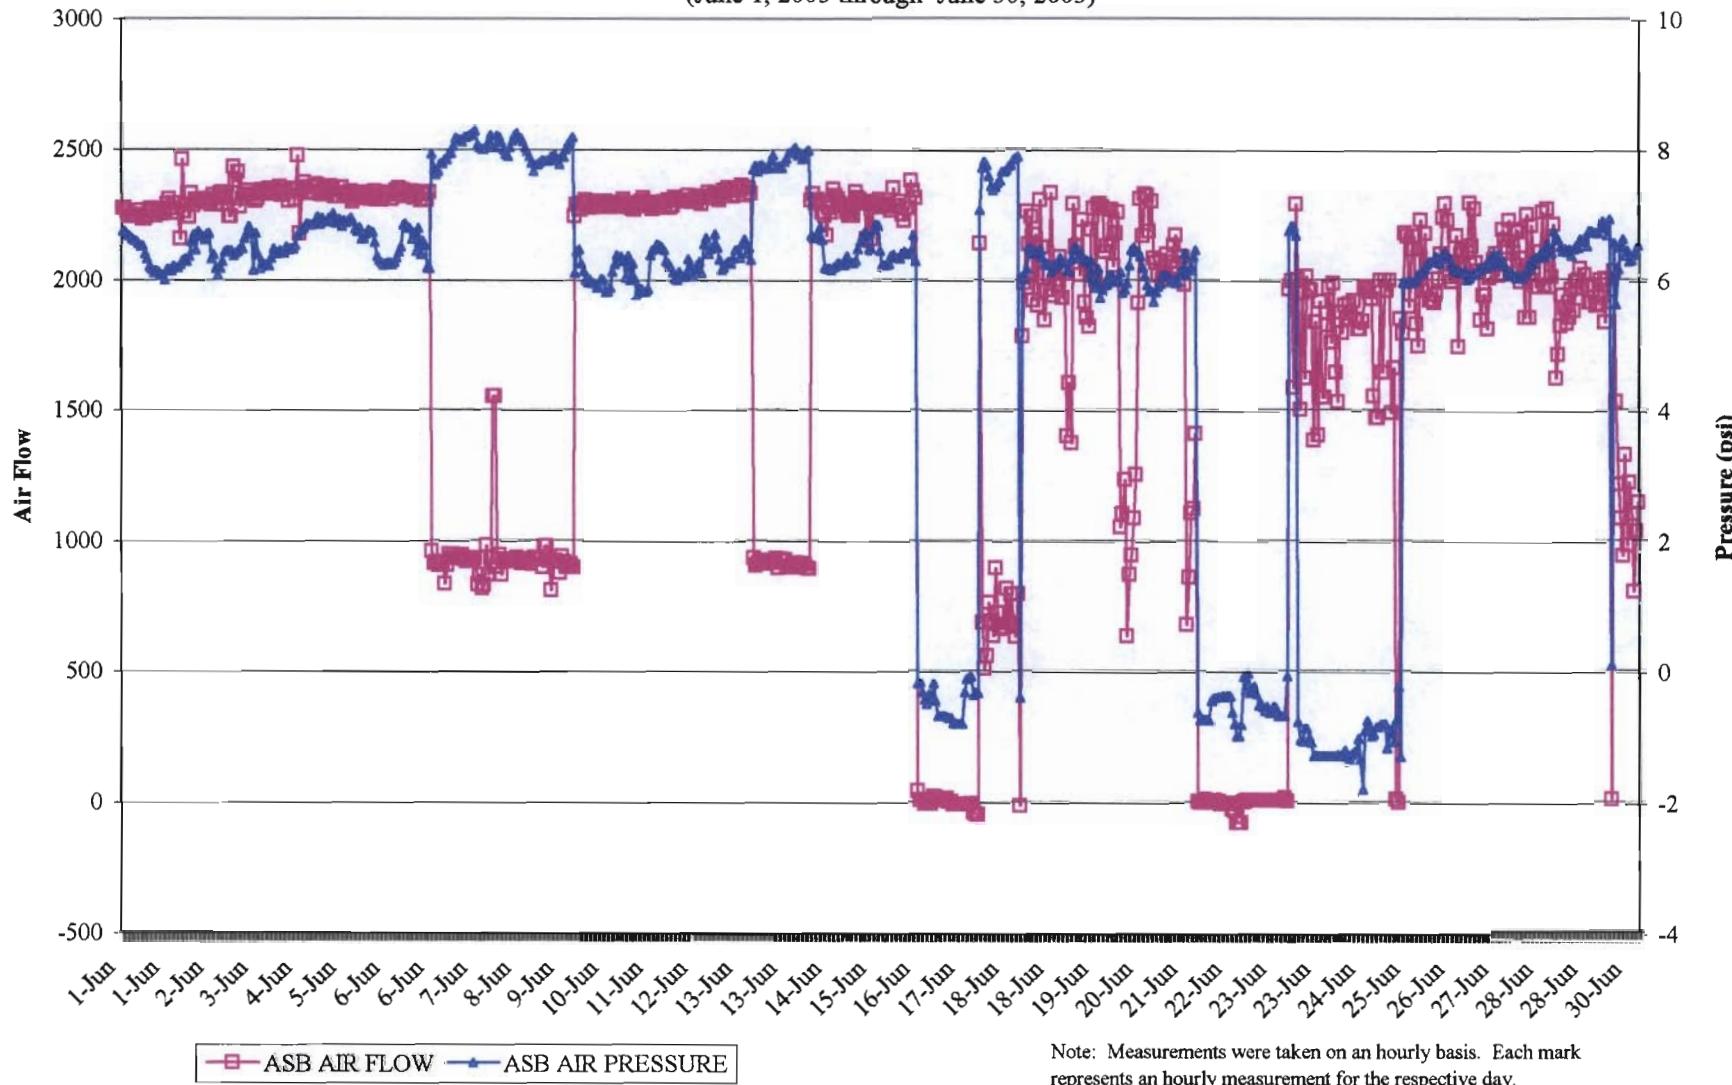


FIGURE 5
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

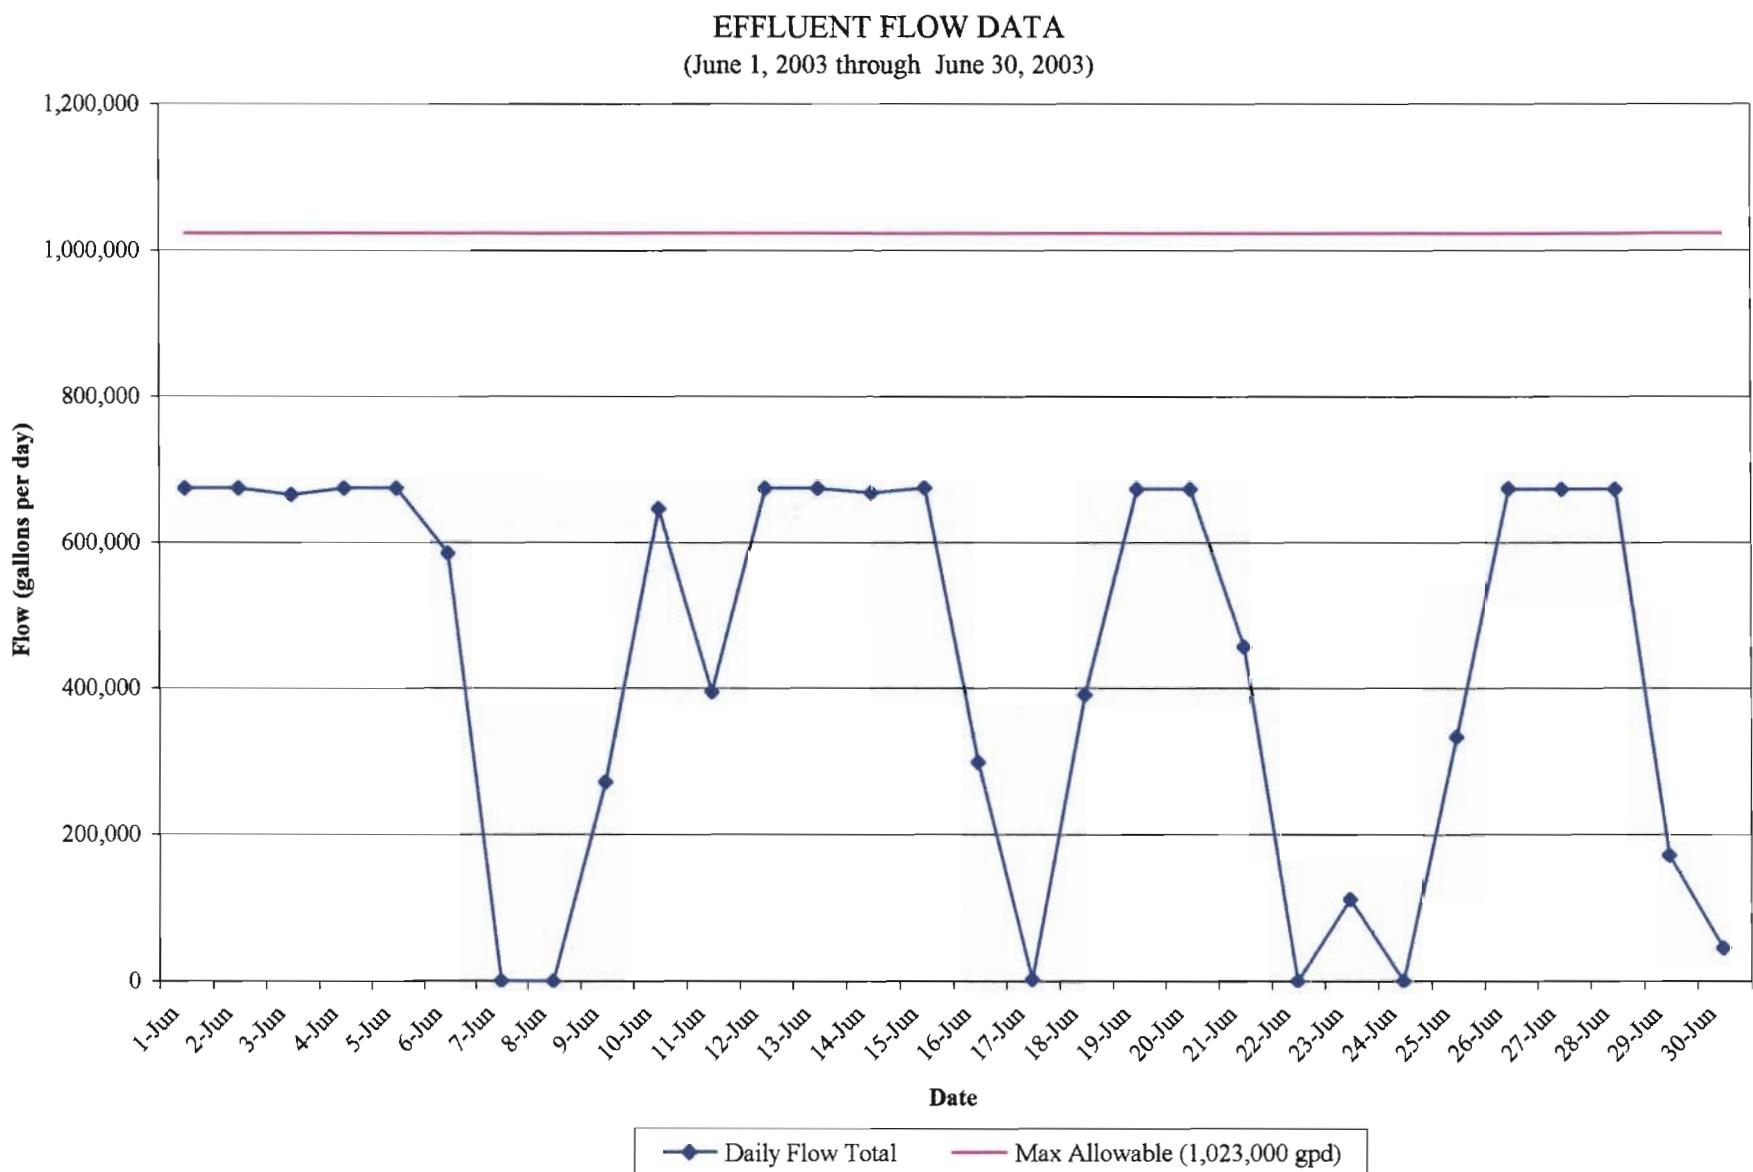


FIGURE 6
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-1 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

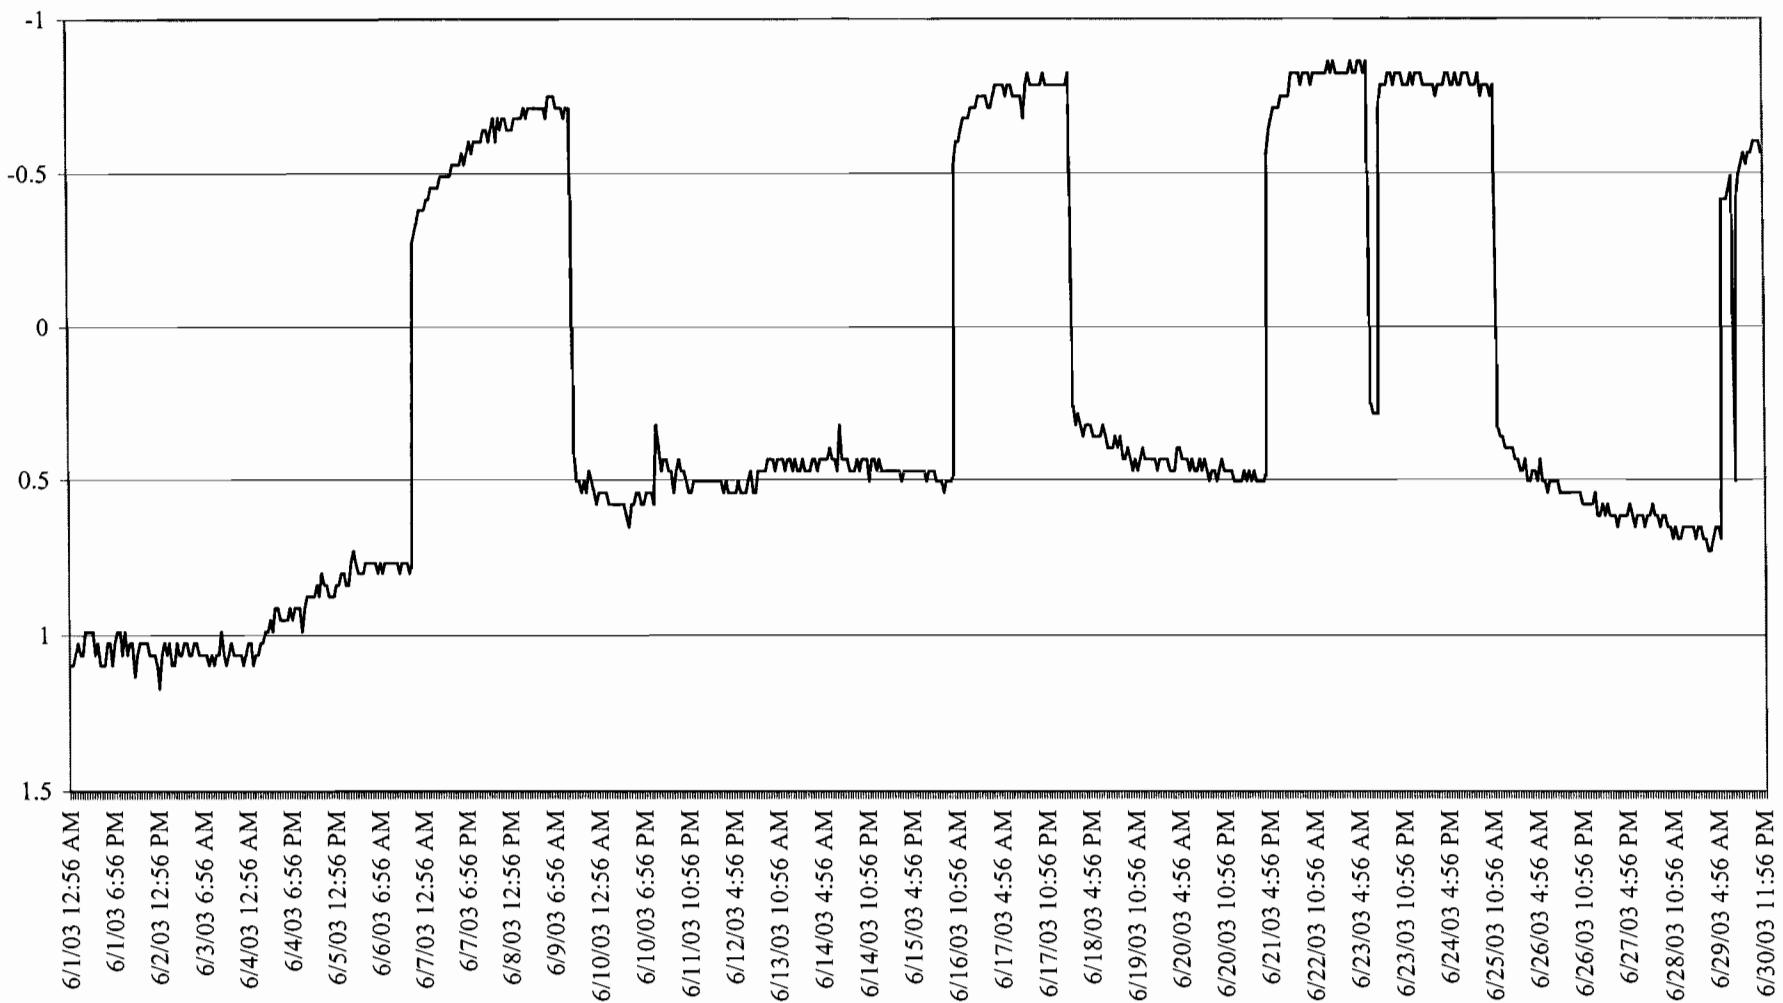


FIGURE 7
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-2 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

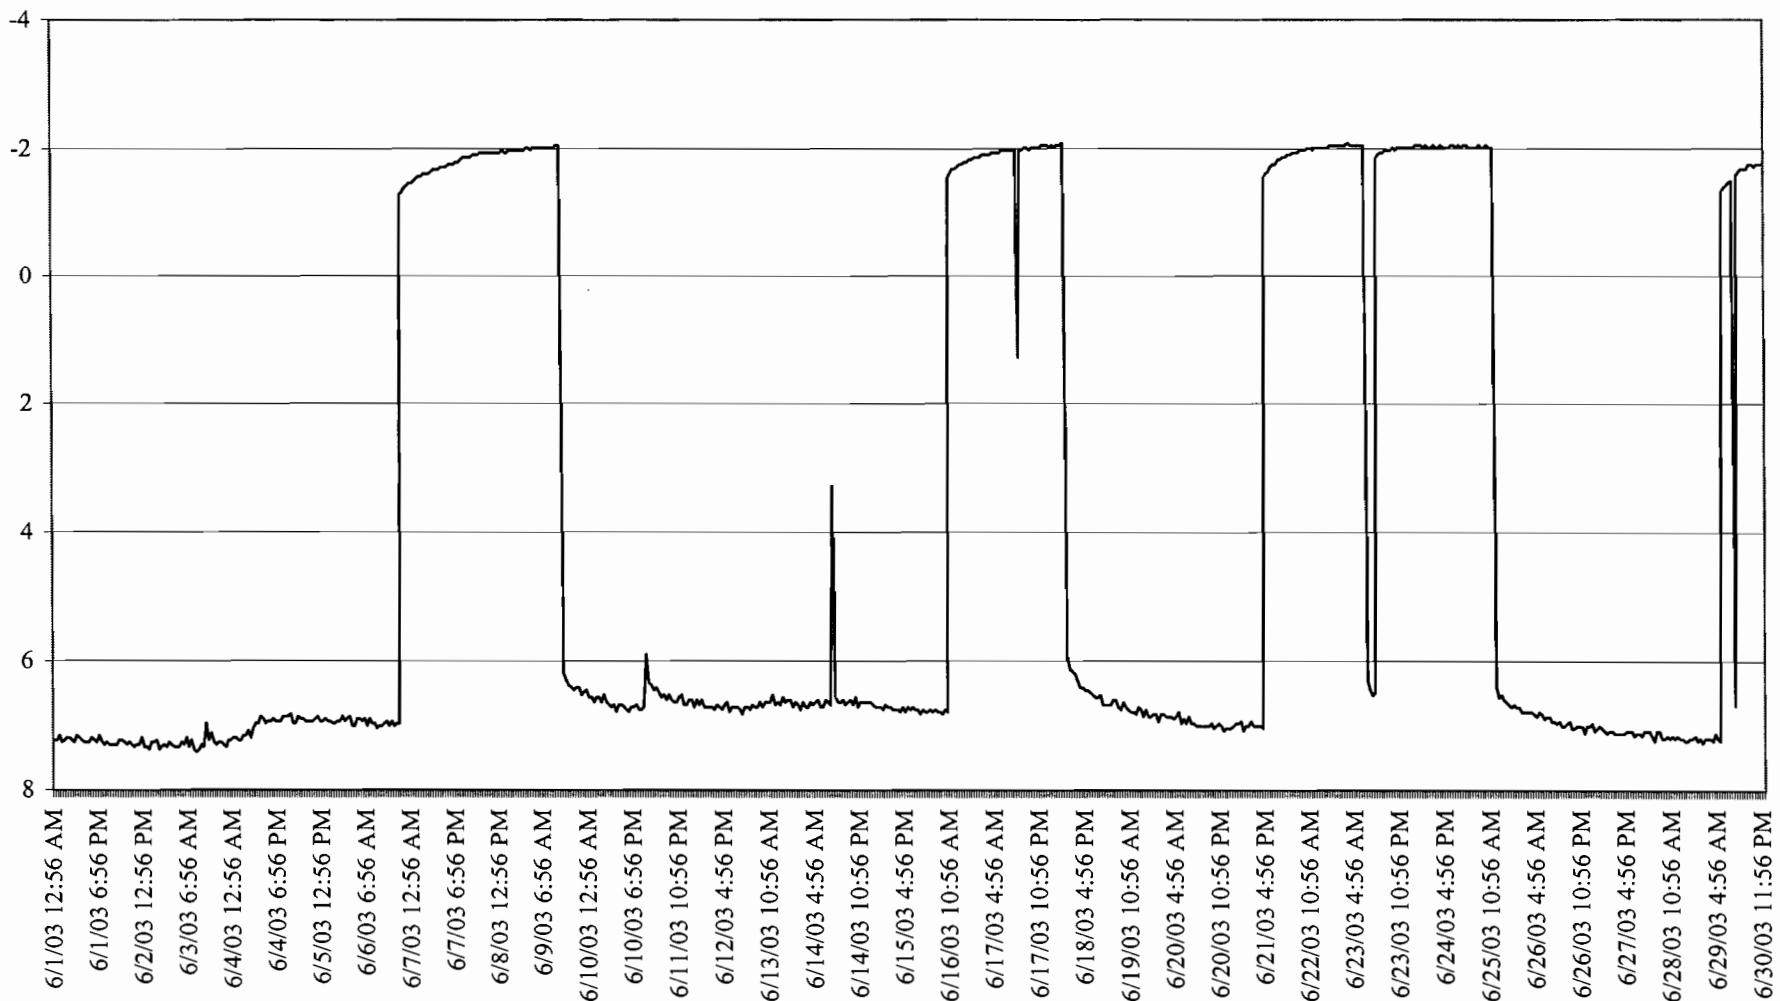


FIGURE 8
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-3 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

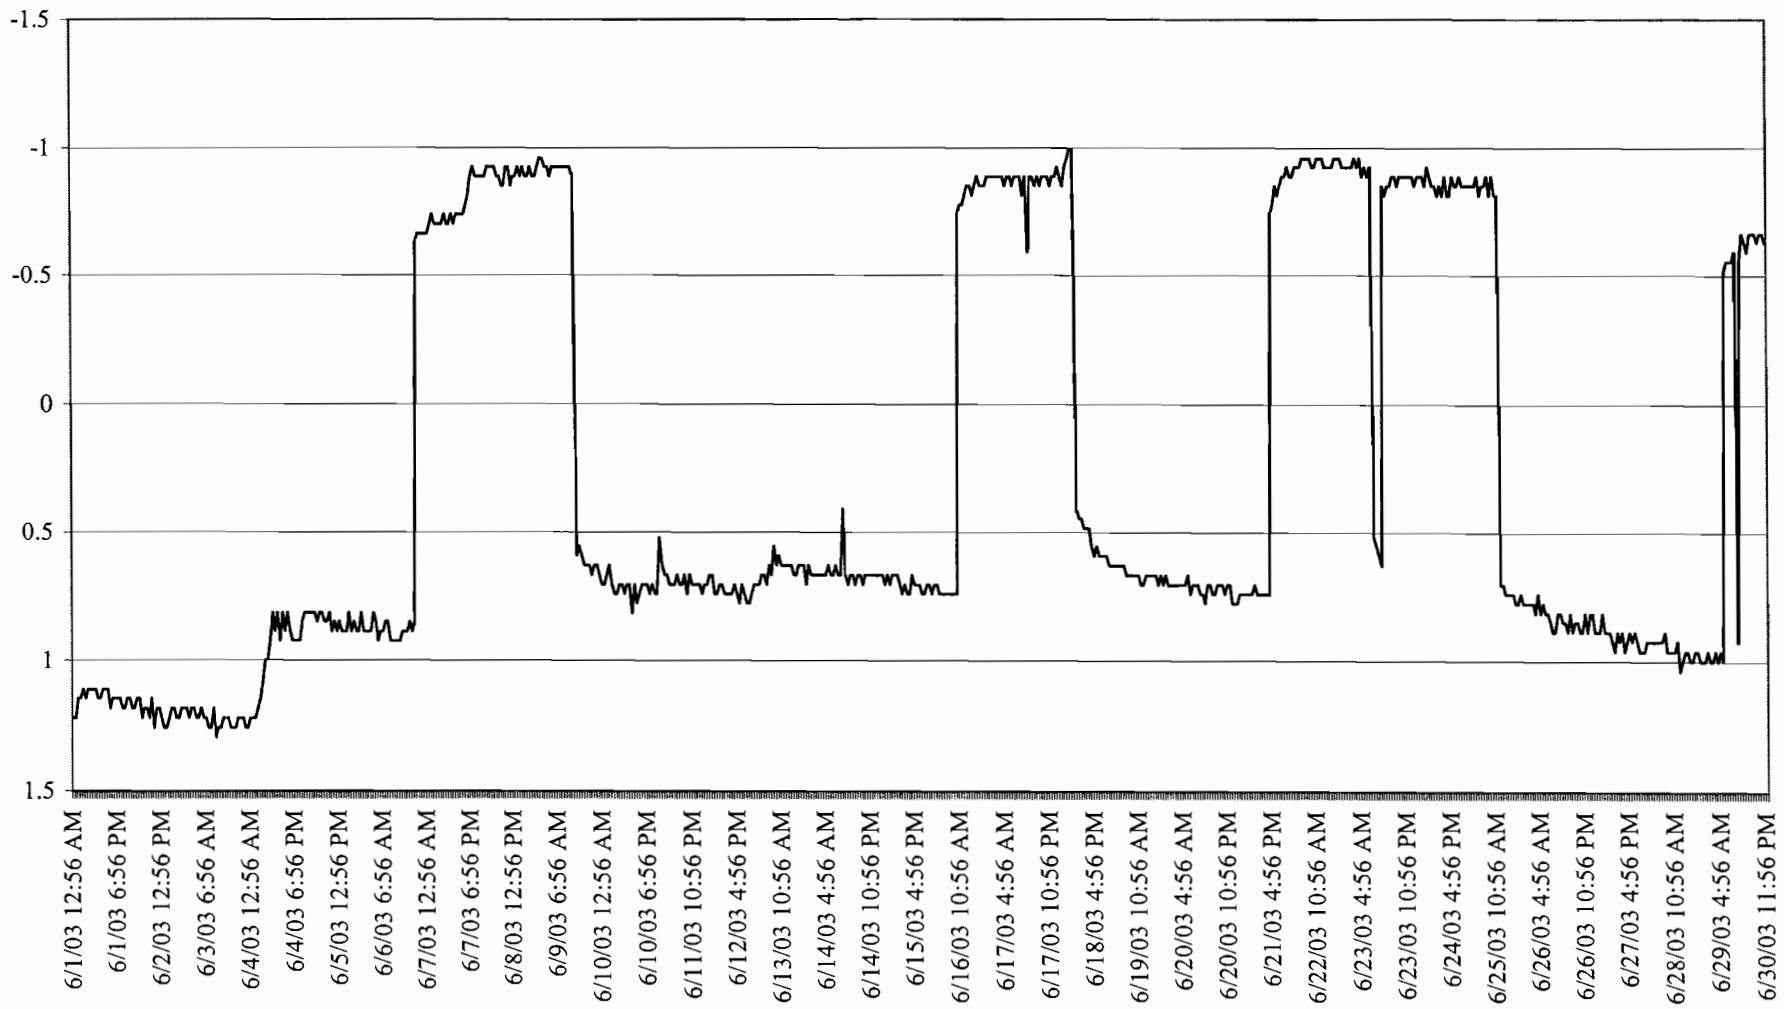


FIGURE 9
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-4 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

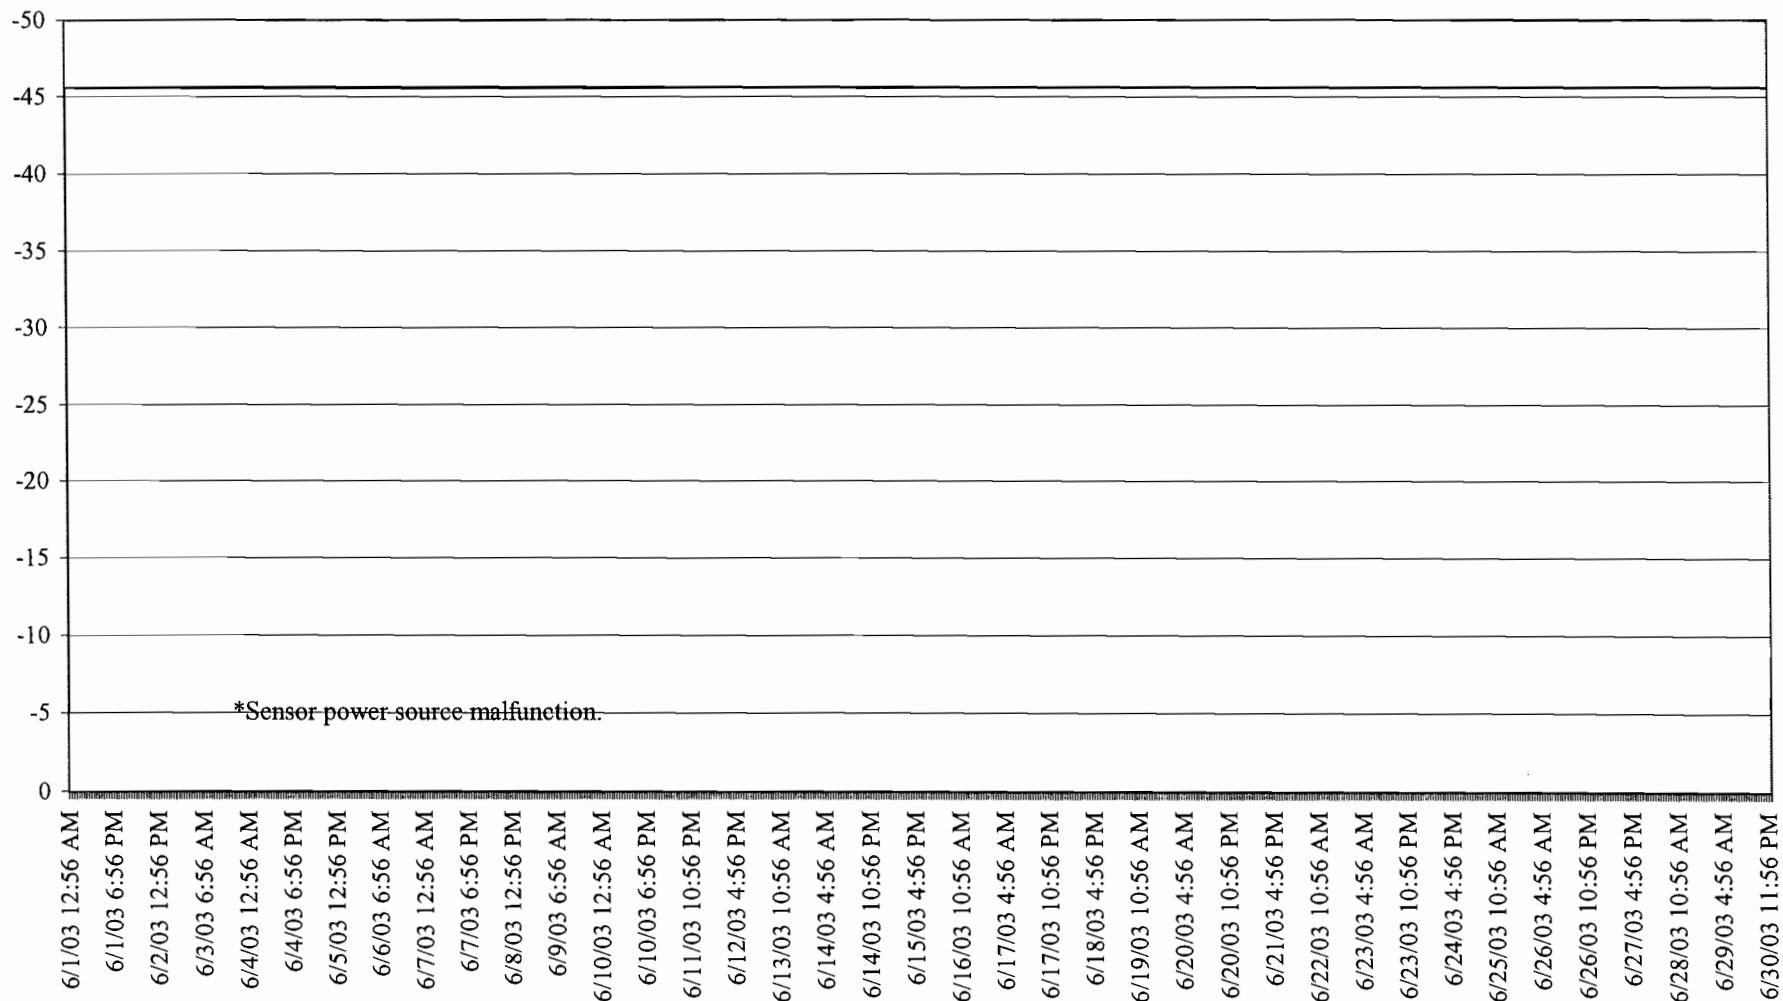


FIGURE 10
GROUN-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-5 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

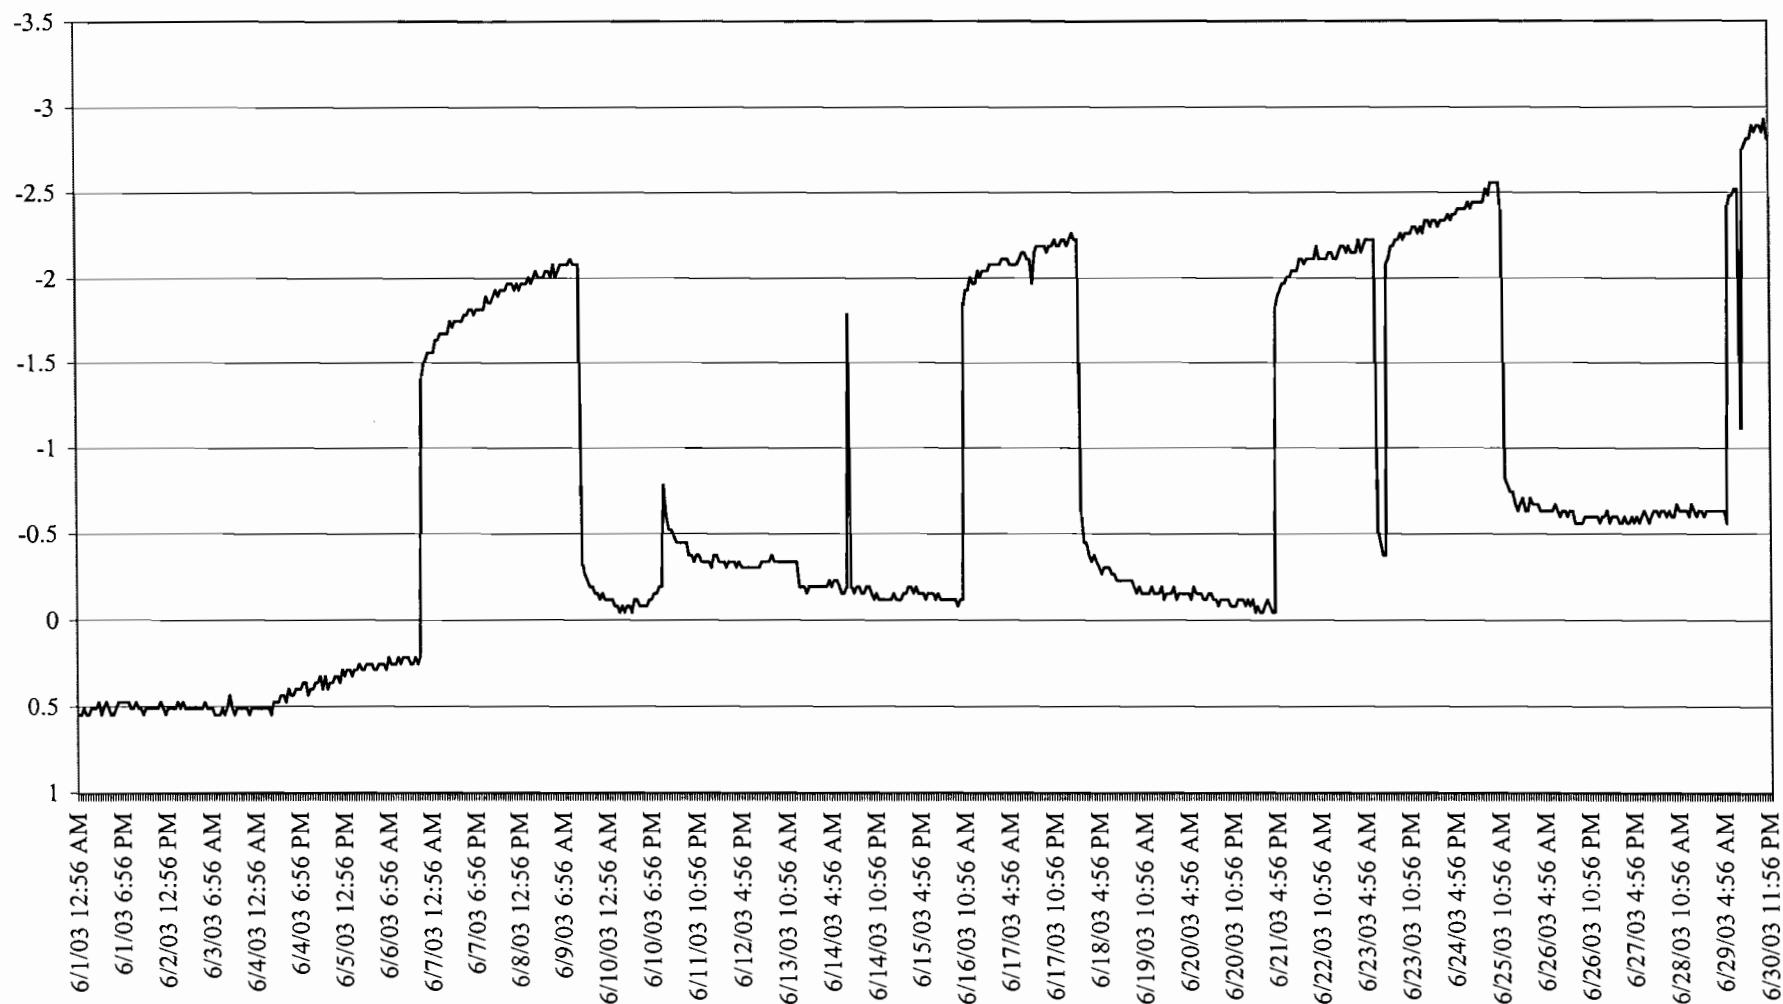


FIGURE 11
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-6 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

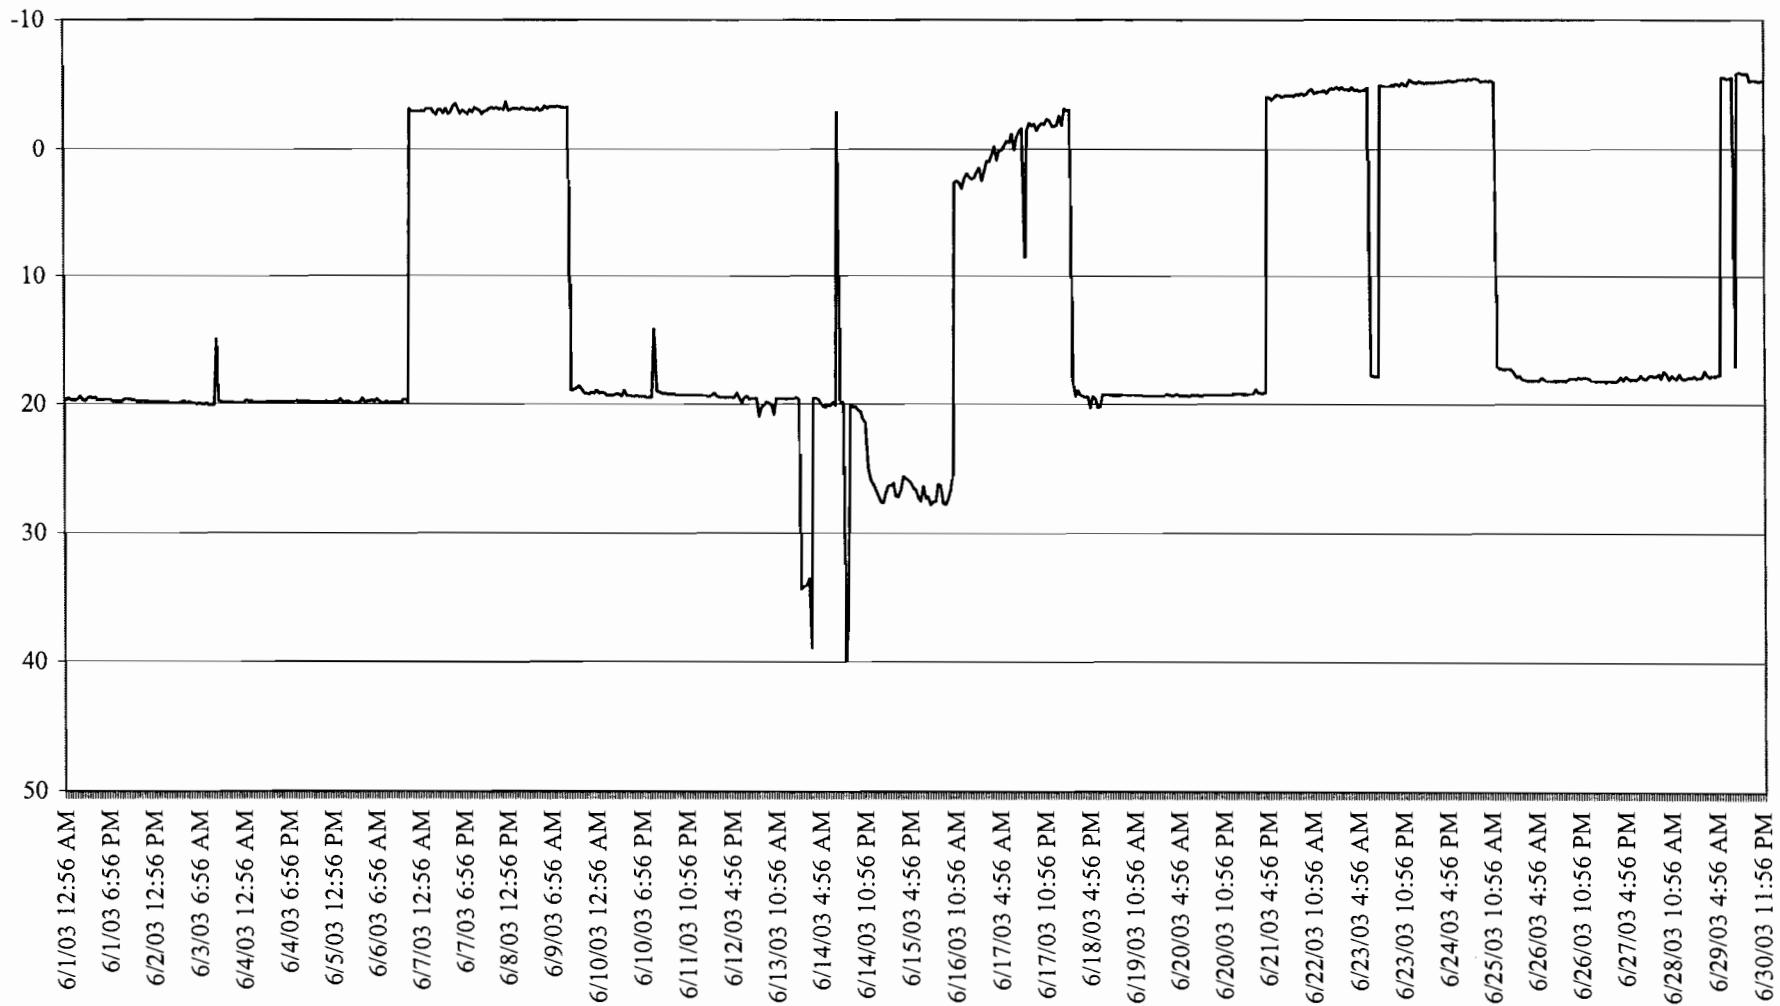


FIGURE 12
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-7 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

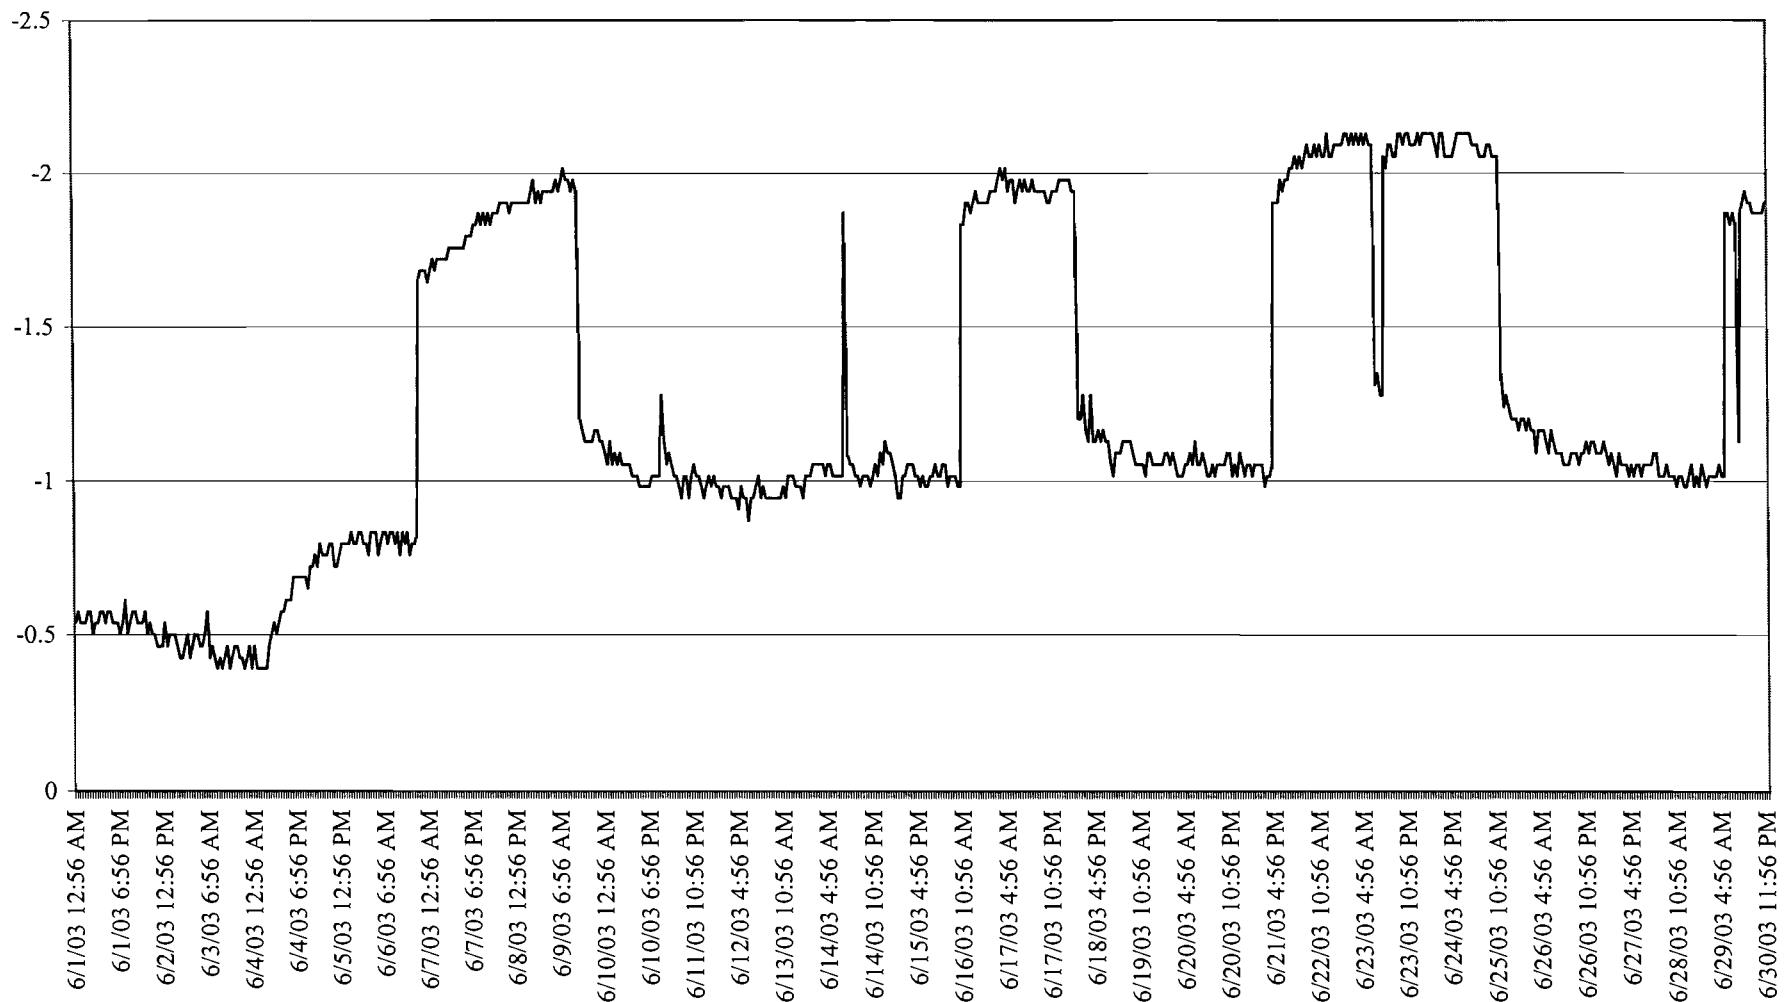


FIGURE 13
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-8 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)


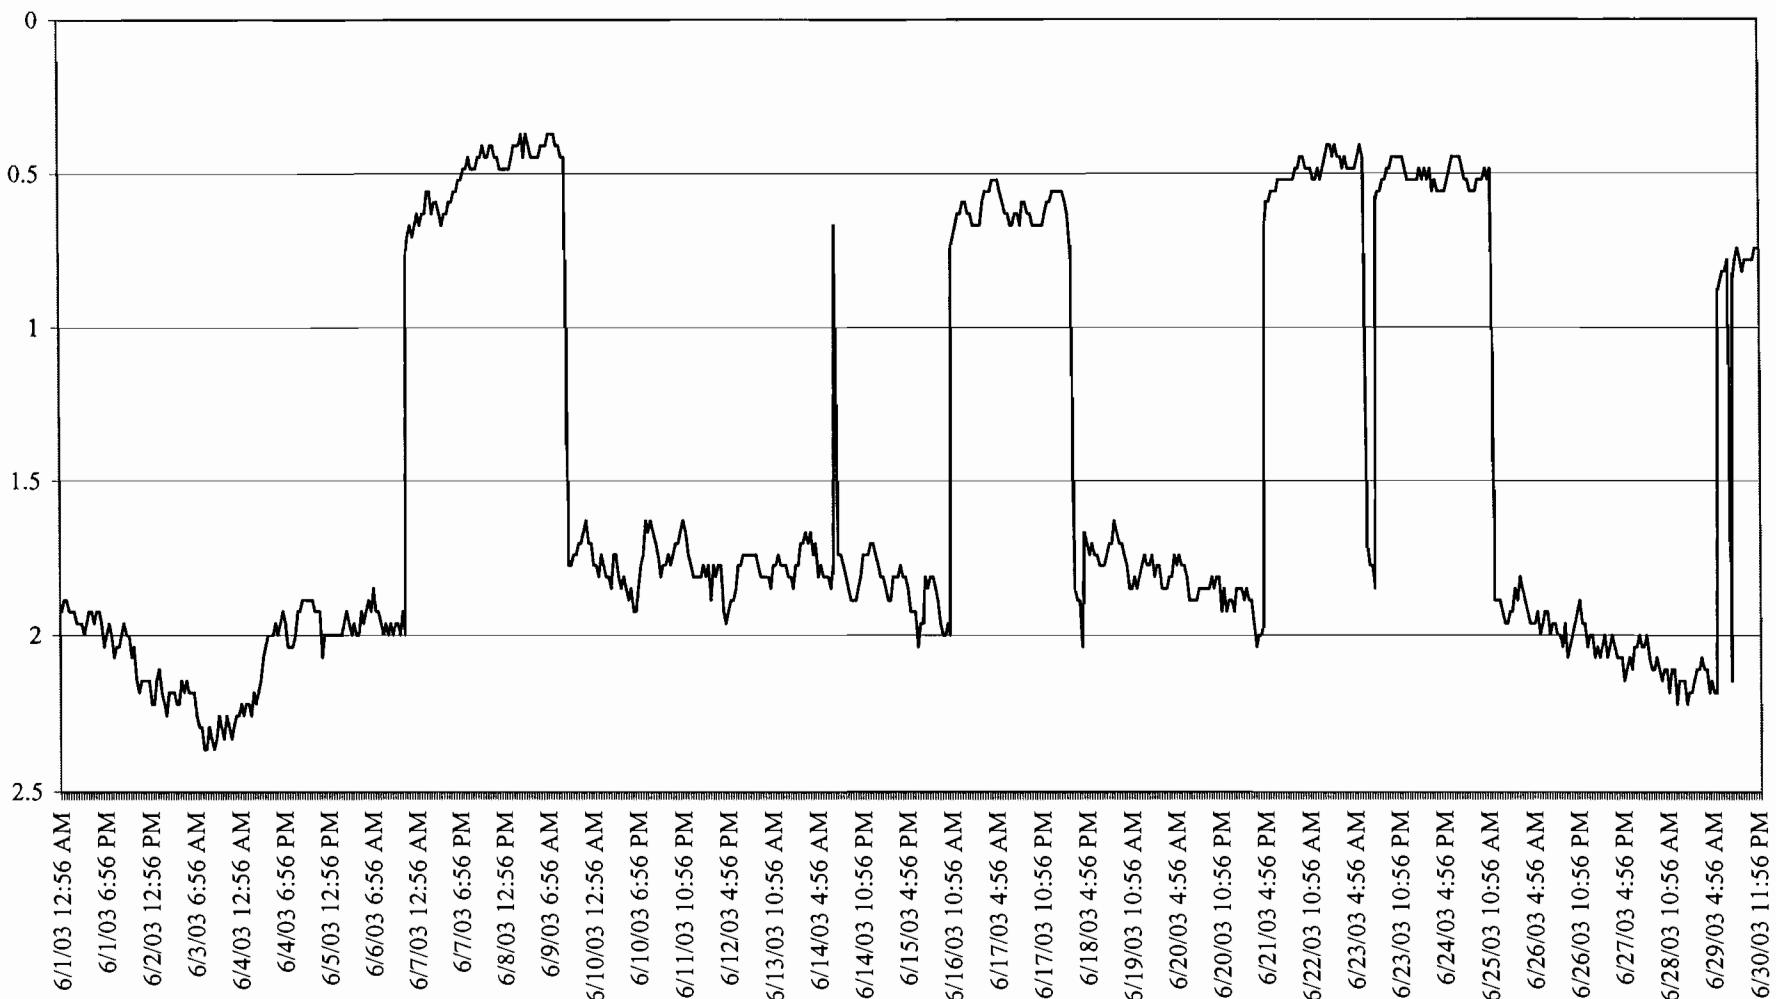


FIGURE 14
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RW-9 GROUND-WATER DRAWDOWN
(June 1, 2003 through June 30, 2003)

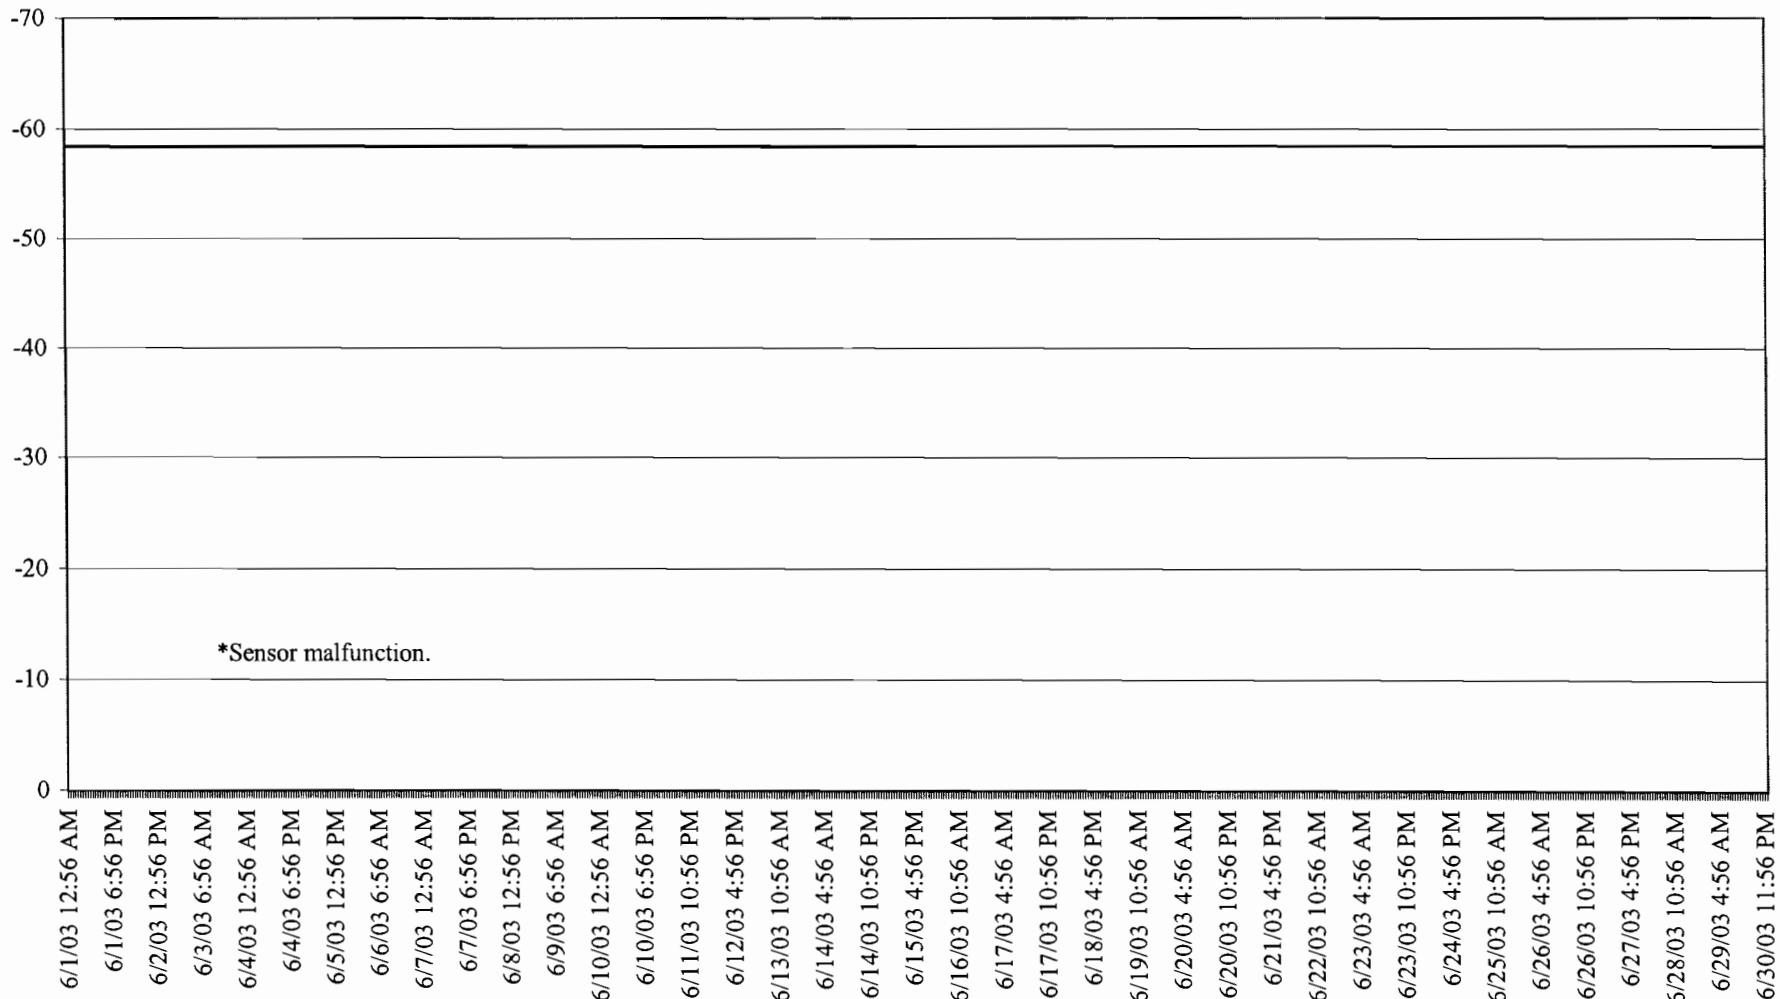

APPENDIX I:
WEEKLY OPERATIONS REPORTS

Ground-Water Remedial Action
 Ground-Water Pump and Treat
 Rowe Industries Superfund Site
 SAG HARBOR, NEW YORK

WEEKLY OPERATIONS REPORT

Report Period: 5/26/03 - 6/2/03
 Report Generated Sunday - Date: 6/2/03 6:56 AM

Recovery Wells											
Process Value	Units	RW1	RW2	RW3	RW4 ^{1/}	RW5	RW6	RW7	RW8	RW9 ^{2/}	
Well Status	Dilution/ Conc.	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	
Flow	gpm	34.99	28.83	29.81	1.92	54.86	34.88	70.11	64.62	80.57	
Motor Speed	rpm	1624.00	1392.00	1537.00	1305.00	1595.00	1711.00	1508.00	1740.00	1740.00	
Percent Speed	%	93.30	79.97	88.30	74.97	91.63	98.29	86.63	99.96	99.96	
Motor Current	amps	1.70	2.30	1.50	2.40	2.70	2.70	5.70	6.10	9.10	
Discharge Pressure	psi	23.73	12.59	19.97	0.00	49.36	27.09	34.38	56.09	69.86	
Static Groundwater Elev.	ft - MSL	57.60	41.65	16.11	30.23	43.54	37.63	31.53	17.97	11.40	
Groundwater Drawdown	ft	1.03	7.27	1.18	-45.60	0.51	19.82	-0.54	2.15	-58.45	

Transfer Pumps					
Process Value	Units	TP 1A	TP 1B	TP 2A	TP2B
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto
Pump Status	on/off	Off	On	Off	On
Run Time	hours	1407	1928	1650	1474
Motor Speed	rpm	0.00	1595.00	0.00	1073.00
Percent Speed	%	0.00	91.63	0.00	61.64
Motor Current	amps	0.00	17.80	0.00	15.70
Flow	gpm	377.78		379.54	
Discharge Pressure	psi				
Equalization Tank Level	inches	62.60			
Transfer Tank Level	inches			39.02	
Transfer Tank pH				5.90	
Transfer Tank Conductivity	uS			-10764.58	

Multi - Bag Filters				
Process Value	Units	Filter 1	Filter 2	Filter 3
Inlet Pressure	psi	20.33	20.57	10.64
Outlet Pressure	psi	16.96	16.18	6.80
Differential Pressure	psi	3.37	4.38	3.84

Air Stripper Elbows			
Process Value	Units	AS. Blower	Booster B.
Blower Control Mode	Hand/Off/Auto	Auto	Auto
Air Flow	scfm	2243.95	3445.53
Discharge Pressure	in WC	6.36	20.57
Motor Current	amps	7.83	22.38
Valve EBV-1 Position	% open	Open	
Valve EBV-2 Position	% open	Open	

Recharge Basins			
Process Value	Units	Primary	Secondary
Basin Flow	gpm	0.00	409.57
Basin Level	inches	-0.36	16.95
Static Groundwater Elev.	ft - MSL		
Groundwater Mounding	ft	3.58	

Notes:

1/ RW-4 flow and drawdown incorrect due to sensor power supply malfunction.

2/ RW-9 drawdown incorrect due to sensor malfunction.

**Ground-Water Remedial Action
Ground-Water Pump and Treat
Rowe Industries Superfund Site
SAG HARBOR, NEW YORK**

WEEKLY OPERATIONS REPORT

Report Period: 6/2/03 - 6/9/03
Report Generated Sunday - Date: 6/9/03 6:56 AM

Recovery Wells											
Process Value	Units	RW1	RW2	RW3	RW4 ^{1/}	RW5	RW6	RW7	RW8	RW9 ^{2/}	
Well Status	Dilution/ Conc.	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	
Flow ^{3/}	gpm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Motor Speed	rpm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Percent Speed	%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Motor Current	amps	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Discharge Pressure	psi	0.18	0.10	4.74	0.00	0.18	0.18	0.18	5.22	6.58	
static Groundwater Elev.	ft - MSL	57.60	41.65	16.11	30.23	43.54	37.63	31.53	17.97	11.40	
groundwater Drawdown	ft	-0.75	-2.02	-0.93	-45.60	-2.08	-3.28	-1.94	0.41	-58.45	

Transfer Pumps					
Process Value	Units	TP 1A	TP 1B	TP 2A	TP2B
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto
Pump Status	on/off	Off	Off	Off	Off
Run Time	hours	1486	1959	1729	1505
Motor Speed	rpm	0.00	0.00	0.00	0.00
Percent Speed	%	0.00	0.00	0.00	0.00
Motor Current	amps	0.00	0.00	0.00	0.00
Flow	gpm	0.00		0.00	
Discharge Pressure	psi				
Qualification Tank Level	inches	49.19			
Transfer Tank Level	inches			34.51	
Transfer Tank pH				6.01	
Transfer Tank Conductivity	uS			-6464.03	

Multi - Bag Filters				
Process Value	Units	Filter 1	Filter 2	Filter 3
Inlet Pressure	psi	10.38	11.18	13.15
Outlet Pressure	psi	15.90	14.20	11.90
Differential Pressure	psi	-5.52	-3.02	1.25

Air Stripper Blowers			
Process Value	Units	AS. Blower	Booster B.
Blower Control Mode	Hand/Off/Auto	Auto	Auto
Air Flow	scfm	914.12	1281.14
Discharge Pressure	in WC	7.83	2.56
Motor Current	amps	6.74	0.00
Valve EBV-1 Position	% open	Open	
Valve EBV-2 Position	% open	Open	

Recharge Basins			
Process Value	Units	Primary	Secondary
Basin Flow	gpm	0.00	6.44
Basin Level	inches	-0.32	0.39
static Groundwater Elev.	ft - MSL		
Groundwater Mounding	ft	1.18	

Notes:

1/ RW-4 flow and drawdown incorrect due to sensor power supply malfunction.

2/ RW-9 drawdown incorrect due to sensor malfunction.

3/ System is not operating at time of data collection.

**Ground-Water Remedial Action
Ground-Water Pump and Treat
Rowe Industries Superfund Site
SAG HARBOR, NEW YORK**

WEEKLY OPERATIONS REPORT

Report Period: 6/9/03 - 6/16/03
Report Generated Sunday - Date: 6/16/03 6:56 AM

Recovery Wells											
Process Value	Units	RW1	RW2	RW3	RW4 ^{1/}	RW5	RW6	RW7	RW8	RW9 ^{2/}	
Well Status	Dilution/ Conc.	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	
Flow	gpm	34.71	29.59	30.08	1.92	55.02	34.99	69.95	0.00	78.18	
Motor Speed	rpm	1653.00	1479.00	1595.00	1305.00	1595.00	1711.00	1508.00	1740.00	1740.00	
Percent Speed	%	94.96	84.97	91.63	74.97	91.63	98.29	86.63	99.96	99.96	
Motor Current	amps	1.70	2.40	1.60	2.40	2.70	2.70	5.80	6.00	9.10	
Discharge Pressure	psi	27.57	15.71	22.69	0.00	48.48	27.01	34.14	61.78	70.74	
Static Groundwater Elev.	ft - MSL	57.60	41.65	16.11	30.23	43.54	37.63	31.53	17.97	11.40	
Groundwater Drawdown	ft	0.51	6.79	0.74	-45.60	-0.12	27.77	-1.02	2.00	-58.45	

Transfer Pumps					
Process Value	Units	TP 1A	TP 1B	TP 2A	TP2B
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto
Pump Status	on/off	On	Off	On	Off
Run Time	hours	1635	2011	1879	1505
Motor Speed	rpm	1537.00	0.00	1073.00	0.00
Percent Speed	%	88.30	0.00	61.64	0.00
Motor Current	amps	17.70	0.00	14.60	0.00
Flow	gpm	383.78		364.15	
Discharge Pressure	psi				
Equalization Tank Level	inches	57.15			
Transfer Tank Level	inches			39.02	
Transfer Tank pH				5.90	
Transfer Tank Conductivity	uS			-8857.58	

Multi - Bag Filters				
Process Value	Units	Filter 1	Filter 2	Filter 3
Inlet Pressure	psi	20.10	20.51	6.31
Outlet Pressure	psi	17.30	15.58	3.59
Differential Pressure	psi	2.80	4.92	2.72

Air Stripper Blowers			
Process Value	Units	AS. Blower	Booster B.
Blower Control Mode	Hand/Off/Auto	Auto	Auto
Air Flow	scfm	2269.32	3461.13
Discharge Pressure	in WC	6.38	21.78
Motor Current	amps	7.94	22.94
Valve EBV-1 Position	% open	Open	
Valve EBV-2 Position	% open	Open	

Recharge Basins			
Process Value	Units	Primary	Secondary
Basin Flow	gpm	0.00	363.25
Basin Level	inches	-0.41	31.90
Static Groundwater Elev.	ft - MSL		
Groundwater Mounding	ft	3.53	

Notes:

1/ RW-4 flow and drawdown incorrect due to sensor power supply malfunction.

2/ RW-9 drawdown incorrect due to sensor malfunction.

Ground-Water Remedial Action
Ground-Water Pump and Treat
Rowe Industries Superfund Site
SAG HARBOR, NEW YORK

WEEKLY OPERATIONS REPORT

Report Period: 6/16/03 - 6/23/03
Report Generated Sunday - Date: 6/23/03 6:56 AM

Recovery Wells											
Process Value	Units	RW1	RW2	RW3	RW4 ^{1/}	RW5	RW6	RW7	RW8	RW9 ^{2/}	
Well Status	Dilution/ Conc.	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	Dilution	
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	Auto	
Flow ^{3/}	gpm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Motor Speed	rpm	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Percent Speed	%	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Motor Current	amps	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Discharge Pressure	psi	0.18	0.74	7.22	0.00	0.33	0.18	0.26	8.10	10.43	
Static Groundwater Elev.	ft - MSL	57.60	41.65	16.11	30.23	43.54	37.63	31.53	17.97	11.40	
Groundwater Drawdown	ft	-0.86	-2.05	-0.96	-45.60	-2.23	-4.53	-2.13	0.45	-58.45	

Transfer Pumps				
Process Value	Units	TP 1A	TP 1B	TP 2A
Pump Control Mode	Hand/Off/Auto	Auto	Auto	Auto
Pump Status	on/off	Off	Off	Off
Run Time	hours	1718	2012	1961
Motor Speed	rpm	0.00	0.00	0.00
Percent Speed	%	0.00	0.00	0.00
Motor Current	amps	0.00	0.00	0.00
Flow	gpm	0.00		0.00
Discharge Pressure	psi			
Equalization Tank Level	inches	44.19		
Transfer Tank Level	inches			34.51
Transfer Tank pH				6.08
Transfer Tank Conductivity	uS			-2814.83

Multi - Bag Filters				
Process Value	Units	Filter 1	Filter 2	Filter 3
Inlet Pressure	psi	12.63	12.97	-0.02
Outlet Pressure	psi	15.57	13.85	-0.35
Differential Pressure	psi	-2.93	-0.88	0.34

Air Stripper Blowers			
Process Value	Units	AS. Blower	Booster B.
Blower Control Mode	Hand/Off/Auto	Auto	Auto
Air Flow	scfm	0.34	2.26
Discharge Pressure	in WC	-0.71	-1.06
Motor Current	amps	0.00	0.00
Valve EBV-1 Position	% open	Open	
Valve EBV-2 Position	% open	Open	

Recharge Basins			
Process Value	Units	Primary	Secondary
Basin Flow	gpm	8.52	6.37
Basin Level	inches	-0.41	-0.12
Static Groundwater Elev.	ft - MSL		
Groundwater Mounding	ft	1.23	

Notes:

1/ RW-4 flow and drawdown incorrect due to sensor power supply malfunction.

2/ RW-9 drawdown incorrect due to sensor malfunction.

3/ System is not operating at time of data collection.

**Ground-Water Remedial Action
 Ground-Water Pump and Treat
 Rowe Industries Superfund Site
 SAG HARBOR, NEW YORK**

WEEKLY OPERATIONS REPORT

Report Period: ^{1/}

Report Generated Sunday - Date:

6/23/03 - 6/30/03

6/30/03 6:56 AM

Recovery Wells										
Process Value	Units	RW1	RW2	RW3	RW4	RW5	RW6	RW7	RW8	RW9
Well Status	Dilution/ Conc.	#N/A								
Pump Control Mode	Hand/Off/Auto	#N/A								
Flow	gpm	#N/A								
Motor Speed	rpm	#N/A								
Percent Speed	%	#N/A								
Motor Current	amps	#N/A								
Discharge Pressure	psi	#N/A								
Static Groundwater Elev.	ft - MSL	#N/A								
Groundwater Drawdown	ft	#N/A								

Transfer Pumps					
Process Value	Units	TP 1A	TP 1B	TP 2A	TP2B
Pump Control Mode	Hand/Off/Auto	#N/A	#N/A	#N/A	#N/A
Pump Status	on/off	#N/A	#N/A	#N/A	#N/A
Run Time	hours	#N/A	#N/A	#N/A	#N/A
Motor Speed	rpm	#N/A	#N/A	#N/A	#N/A
Percent Speed	%	#N/A	#N/A	#N/A	#N/A
Motor Current	amps	#N/A	#N/A	#N/A	#N/A
Flow	gpm	#N/A		#N/A	
Discharge Pressure	psi				
Equalization Tank Level	inches	#N/A			
Transfer Tank Level	inches			#N/A	
Transfer Tank pH				#N/A	
Transfer Tank Conductivity	uS			#N/A	

Multi - Bag Filters				
Process Value	Units	Filter 1	Filter 2	Filter 3
Inlet Pressure	psi	#N/A	#N/A	#N/A
Outlet Pressure	psi	#N/A	#N/A	#N/A
Differential Pressure	psi	#N/A	#N/A	#N/A

Air Stripper Blowers			
Process Value	Units	AS. Blower	Booster B.
Blower Control Mode	Hand/Off/Auto	#N/A	#N/A
Air Flow	scfm	#N/A	#N/A
Discharge Pressure	in WC	#N/A	#N/A
Motor Current	amps	#N/A	#N/A
Valve EBV-1 Position	% open	#N/A	
Valve EBV-2 Position	% open	#N/A	

Recharge Basins			
Process Value	Units	Primary	Secondary
Basin Flow	gpm	#N/A	#N/A
Basin Level	inches	#N/A	#N/A
Static Groundwater Elev.	ft - MSL		
Groundwater Mounding	ft	#N/A	

Notes:
 1/ PLC communication failure prior to data collection. #N/A represents errors due to lack of communication with PLC.

APPENDIX II:
CALCULATIONS OF VOC RECOVERY BY GROUND-WATER SYSTEM

APPENDIX II

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

CALCULATION OF VOC RECOVERY BY THE GROUND-WATER RECOVERY SYSTEM

Calculated by: Laura R. Zima

Checked by: Alfred N. Kovalik

STATEMENT OF PROBLEM:

Calculate the quantity of VOCs recovered from the ground-water recovery system. VOC concentrations are from samples collected from system influent. Concentrations reported as below the method detection limit are shown as 0.

PROBLEM CONSTRAINTS:


Date	PCE (ug/l)	TCE (ug/l)	TCA (ug/l)	cis-1,2-dichloroethene (ug/l)	Isopropyl benzene (ug/l)	Chloroform (ug/l)	Toluene (ug/l)
11/26/02 - 5/30/03	1378	42.6	36.9	1.1	0	1.5	0
6/5/03	29	0.7	0.6	0	0	0	0
6/11/03	50	0.8	1.6	0	0	0	0
6/19/03	50	1.4	1.5	0	0	0	0
6/23/03	54	1.6	2.1	0	0	0	0
6/30/03	56	2.0	2.4	0	0	0	0

CALCULATION:

$$\text{Recovery (lbs)} = \text{Concentration (ug/l)} \times \text{Volume Pumped (gal)} \times 1 \text{ lb}/453,590,000 \text{ ug} \times 3.785 \text{ l/gal}$$

Date	Volume Pumped (gal)	PCE (lbs)	TCE (lbs)	TCA (lbs)	cis-1,2-dichloroethene (lbs)	Isopropyl benzene (lbs)	Chloroform (lbs)	Toluene (lbs)	Total Contaminants (lbs)	Cumulative VOC's (lbs)
11/26/02 - 5/30/03	91,035,560	52.0	1.6	1.3	0.05	0	0.04	0	55.0	55.0
6/5/03	4,032,420	0.98	0.02	0.02	0	0	0	0	1.0	56.0
6/11/03	1,896,540	0.79	0.01	0.03	0	0	0	0	0.8	56.9
6/19/03	4,052,180	1.69	0.05	0.05	0	0	0	0	1.8	58.6
6/23/03	1,493,200	0.67	0.02	0.03	0	0	0	0	0.7	59.4
6/30/03	2,570,300	1.20	0.04	0.05	0	0	0	0	1.3	60.7
Totals:	105,080,200	57.4	1.7	1.5	0.05	0	0.04	0	60.7	-

Note: Equalization tank totalizer meter reading recorded on 11/26/02 includes groundwater pumped during the Initial Testing Program.

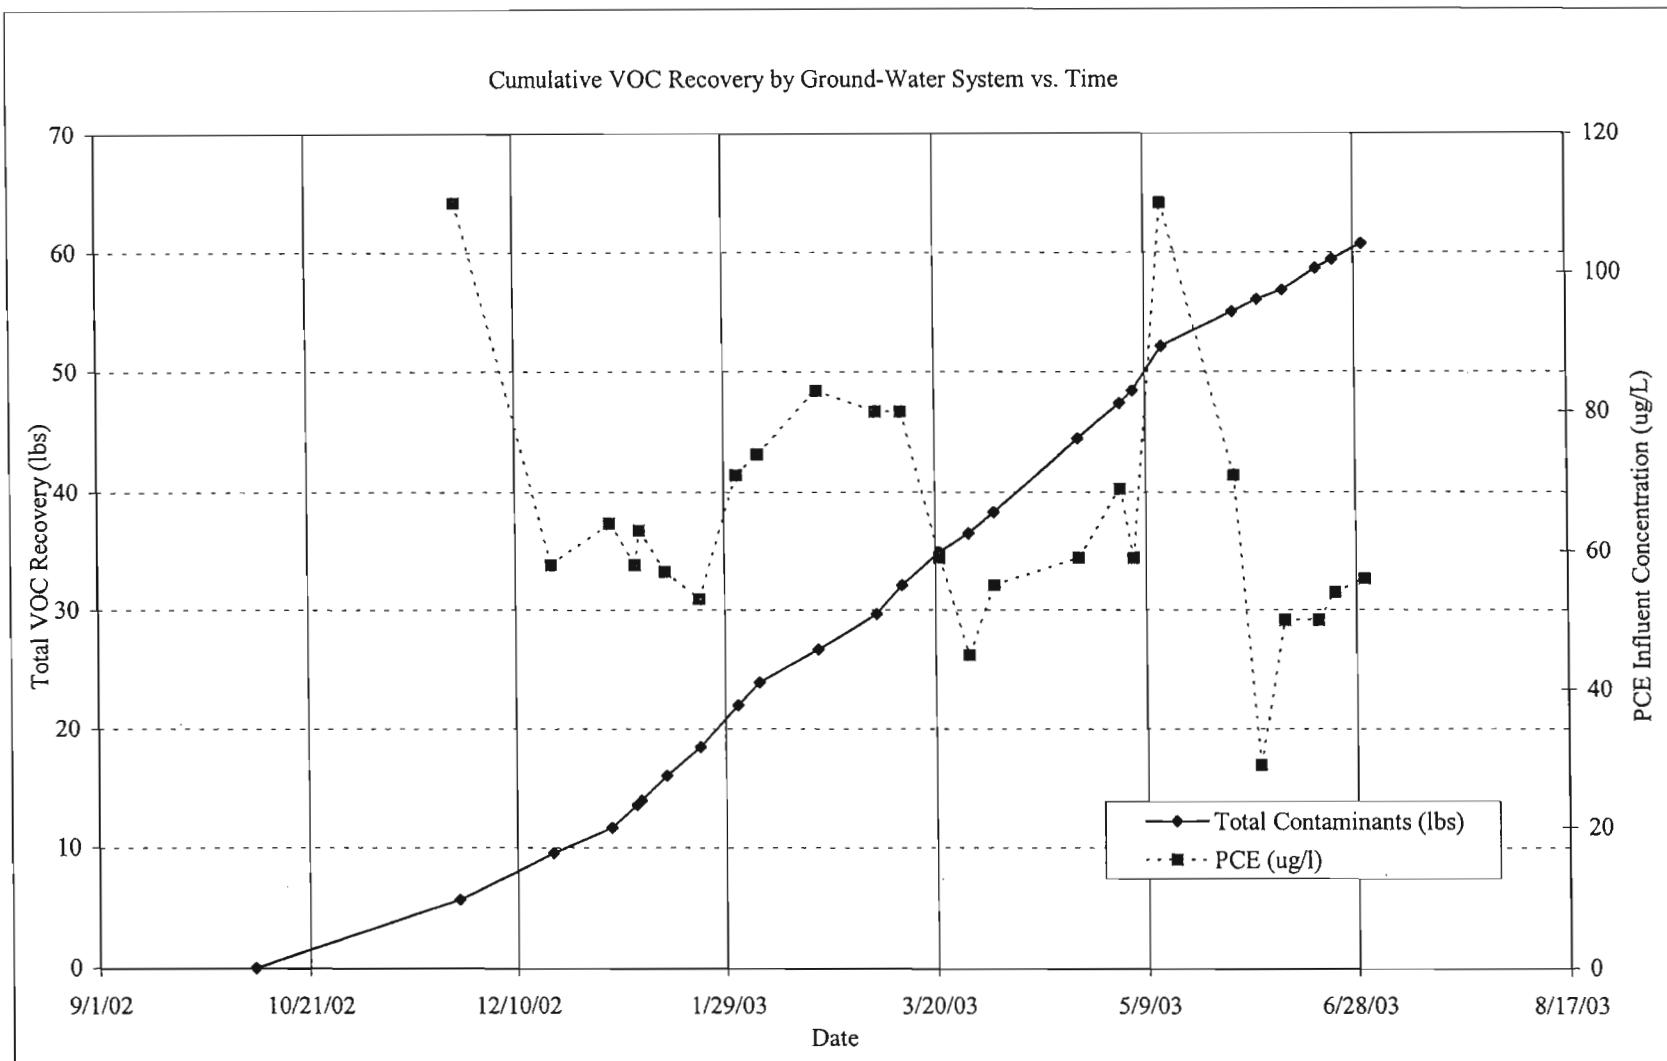

APPENDIX III:
MAY 2003 LABORATORY ANALYTICAL REPORTS

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1115NP2-6
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y..	Collection Date:	6/5/2003
Lab ID:	0306031-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
1,1,1,2-Tetrachloroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1,1-Trichloroethane	0.6	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1,2-Trichloroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1-Dichloroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1-Dichloroethene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,1-Dichloropropene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2,3-Trichloropropane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2-Dibromoethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2-Dichlorobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2-Dichloroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,2-Dichloropropane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,3-Dichlorobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,3-dichloropropane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
1,4-Dichlorobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
2,2-Dichloropropane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
2-Butanone	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
2-Chlorotoluene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
2-Hexanone	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
4-Chlorotoluene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
4-Isopropyltoluene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
4-Methyl-2-pentanone	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Acetone	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Benzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Bromobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Bromochloromethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Bromodichloromethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Bromoform	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Bromomethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Carbon disulfide	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Carbon tetrachloride	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Chlorobenzene	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Chloroethane	< 1.0	1.0	J	µg/L	1	6/7/2003 2:42:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1115NP2-6
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/7/2003 2:42:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Tetrachloroethene	29	1.0		µg/L	1	6/7/2003 2:42:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Trichloroethene	0.7	1.0	J	µg/L	1	6/7/2003 2:42:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/7/2003 2:42:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1115NP2-6
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.77	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 6/9/2003 2:57:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1115NP2-6
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		
Iron	0.153	0.0200		mg/L	1	Analyst: JP 6/9/2003 2:54:54 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT: Legette Brashears & Graham Inc. **Client Sample ID:** WQ060503:1116NP2-7
Lab Order: 0306031 **Tag Number:**
Project: Rowe Industries Sag Harbor, N.Y. **Collection Date:** 6/5/2003
Lab ID: 0306031-02A **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1,1-Trichloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1,2,2-Tetrachloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1,2-Trichloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1-Dichloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1-Dichloroethene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,1-Dichloropropene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2,3-Trichlorobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2,3-Trichloropropane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2,4-Trichlorobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2,4-Trimethylbenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2-Dibromo-3-chloropropane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2-Dibromoethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2-Dichlorobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2-Dichloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,2-Dichloropropane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,3,5-Trimethylbenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,3-Dichlorobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,3-dichloropropane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
1,4-Dichlorobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
2,2-Dichloropropane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
2-Butanone	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
2-Chloroethyl vinyl ether	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
2-Chlorotoluene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
2-Hexanone	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
4-Chlorotoluene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
4-Isopropyltoluene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
4-Methyl-2-pentanone	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Acetone	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Benzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Bromobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Bromochloromethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Bromodichloromethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Bromoform	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Bromomethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Carbon disulfide	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Carbon tetrachloride	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Chlorobenzene	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	
Chloroethane	< 1.0	1.0	μg/L	1	6/7/2003 3:30:00 PM	

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1116NP2-7
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/7/2003 3:30:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Trichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/7/2003 3:30:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1116NP2-7
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		
Iron	0.676	0.0200		mg/L	1	Analyst: JP 6/9/2003 3:01:36 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1116NP2-7
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.141	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 6/9/2003 2:59:25 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1117NP2-10
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
SW8260B						Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
2-Butanone	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
2-Hexanone	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Acetone	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Benzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Bromobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Bromoform	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Bromomethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Chloroethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit

S - Spike Recovery outside accepted recovery limits

J - Analyte detected below quantitation limits

R - RPD outside accepted recovery limits

B - Analyte detected in the associated Method Blank

E - Value above quantitation range

* - Value exceeds Maximum Contaminant Level

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1117NP2-10
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/7/2003 4:18:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Trichloroethene	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/7/2003 4:18:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1117NP2-10
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.45	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 6/9/2003 3:06:40 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 10-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1117NP2-10
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		
Iron	0.185	0.0200		mg/L	1	Analyst: JP 6/9/2003 3:04:14 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	*	- Value exceeds Maximum Contaminant Level

American Analytical Laboratories, Inc.**Date: 10-Jun-03**

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ060503:1117NP2-10
Lab Order:	0306031	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/5/2003
Lab ID:	0306031-03D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	100	0	E160.1	mg/L	1	Analyst: BK 6/6/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306072
Project: Rowe Industries
Lab ID: 0306072-01A

Client Sample ID: WQ0611031030NP2-6
Tag Number:
Collection Date: 6/11/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1,1-Trichloroethane	1.6	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:04:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031030NP2-6
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B		Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 12:04:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Tetrachloroethene	50	1.0		µg/L	1	6/20/2003 12:04:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Trichloroethene	0.8	1.0	J	µg/L	1	6/20/2003 12:04:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 12:04:00 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031030NP2-6
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	1.20	0.0200		mg/L	1	6/20/2003 10:43:26 AM

Qualifiers:	ND - Not Detected at the Reporting Limit J - Analyte detected below quantitation limits B - Analyte detected in the associated Method Blank * - Value exceeds Maximum Contaminant Level	S - Spike Recovery outside accepted recovery limits R - RPD outside accepted recovery limits E - Value above quantitation range
-------------	--	---

American Analytical Laboratories, Inc.**Date:** 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031030NP2-6
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.0841	0.0200		mg/L	1	6/20/2003 10:40:51 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031035NP2-7
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1,1-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,2-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Bromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Bromodichloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 12:44:00 AM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031035NP2-7
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 12:44:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Trichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 12:44:00 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031035NP2-7
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.05	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 10:47:57 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.**Date: 23-Jun-03**

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031035NP2-7
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.103	0.0200		mg/L	1	6/20/2003 10:45:38 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031040NP2-10
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,2-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
2-Butanone	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
2-Hexanone	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Acetone	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Benzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Bromobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Bromoform	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Bromomethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM
Chloroethane	< 1.0	1.0		µg/L	1	6/20/2003 1:23:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031040NP2-10
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Chloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Dibromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Dibromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Dichlorodifluoromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Ethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Hexachlorobutadiene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Isopropylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
m,p-Xylene	< 2.0	2.0	2.0	µg/L	1	6/20/2003 1:23:00 AM
Methyl tert-butyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Methylene chloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Naphthalene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
n-Butylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
n-Propylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
o-Xylene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
sec-Butylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Styrene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
tert-Butylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Tetrachloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Toluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Trichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Trichlorofluoromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Vinyl acetate	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM
Vinyl chloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 1:23:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.**Date:** 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031040NP2-10
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	0.668	0.0200		mg/L	1	6/20/2003 11:01:02 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.**Date:** 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031040NP2-10
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.0538	0.0200		mg/L	1	6/20/2003 10:51:06 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0611031040NP2-10
Lab Order:	0306072	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306072-03D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	110	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1220NP2-6
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1,1-Trichloroethane	1.5	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1,2-Trichloroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1-Dichloroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1-Dichloroethene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,1-Dichloropropene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2,3-Trichloropropane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2-Dibromoethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2-Dichlorobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2-Dichloroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,2-Dichloropropene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,3-Dichlorobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,3-dichloropropane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
1,4-Dichlorobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
2,2-Dichloropropane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
2-Butanone	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
2-Chlorotoluene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
2-Hexanone	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
4-Chlorotoluene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
4-Isopropyltoluene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
4-Methyl-2-pentanone	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Acetone	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Benzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Bromobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Bromochloromethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Bromodichloromethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Bromoform	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Bromomethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Carbon disulfide	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Carbon tetrachloride	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Chlorobenzene	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM
Chloroethane	< 1.0	1.0	μg/L		1	6/24/2003 8:05:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.**Date:** 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1220NP2-6
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/24/2003 8:05:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Tetrachloroethene	50	1.0		µg/L	1	6/24/2003 8:05:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Trichloroethene	1.4	1.0		µg/L	1	6/24/2003 8:05:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/24/2003 8:05:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1220NP2-6
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.12	E200.7	0.0200	(SW3010A) mg/L	1	Analyst: JP 6/24/2003 10:25:34 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.**Date:** 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1220NP2-6
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.719	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 6/24/2003 10:21:53 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1223NP2-7
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
SW8260B						Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1,1-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Bromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Bromodichloromethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/24/2003 8:43:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1223NP2-7
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/24/2003 8:43:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Trichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/24/2003 8:43:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.**Date: 26-Jun-03**

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1223NP2-7
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	0.327	0.0200		mg/L	1	6/24/2003 10:30:47 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.**Date:** 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1223NP2-7
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.279	0.0200		mg/L	1	6/24/2003 10:27:43 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306096
Project: Rowe Industries
Lab ID: 0306096-03A

Client Sample ID: WQ061903:1227NP2-10
Tag Number:
Collection Date: 6/19/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,2-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
2-Butanone	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
2-Hexanone	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Acetone	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Benzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Bromobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Bromoform	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Bromomethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Chloroethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1227NP2-10
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/24/2003 9:22:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Trichloroethene	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/24/2003 9:22:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1227NP2-10
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	0.348	0.0200		mg/L	1	6/24/2003 10:35:38 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.**Date:** 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1227NP2-10
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.352	0.0200		mg/L	1	6/24/2003 10:33:29 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	B - Analyte detected in the associated Method Blank
	J - Analyte detected below quantitation limits	* - Value exceeds Maximum Contaminant Level
		E - Value above quantitation range

S - Spike Recovery outside accepted recovery limits

R - RPD outside accepted recovery limits

American Analytical Laboratories, Inc.

Date: 26-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ061903:1227NP2-10
Lab Order:	0306096	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/19/2003
Lab ID:	0306096-03D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	80	E160.1 1.0		mg/L	1	Analyst: BK 6/25/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0623031025NP2-10
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1,1-Trichloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1,2-Trichloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1-Dichloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1-Dichloroethene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,1-Dichloropropene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2,3-Trichloropropane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2-Dibromoethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2-Dichlorobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2-Dichloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,2-Dichloropropene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,3-Dichlorobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,3-dichloropropane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
1,4-Dichlorobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
2,2-Dichloropropane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
2-Butanone	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
2-Chlorotoluene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
2-Hexanone	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
4-Chlorotoluene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
4-Isopropyltoluene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
4-Methyl-2-pentanone	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Acetone	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Benzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Bromobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Bromochloromethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Bromodichloromethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Bromoform	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Bromomethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Carbon disulfide	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Carbon tetrachloride	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Chlorobenzene	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM
Chloroethane	< 1.0	1.0	μg/L		1	6/27/2003 1:33:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306103
Project: Rowe Industries
Lab ID: 0306103-01A

Client Sample ID: WQ0623031025NP2-10
Tag Number:
Collection Date: 6/23/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/27/2003 1:33:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Trichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/27/2003 1:33:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0623031025NP2-10
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.10	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 6/27/2003 9:40:23 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0623031025NP2-10
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.234	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 6/27/2003 9:38:11 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	94	E160.1 1.0		mg/L	1	Analyst: BK 6/26/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306103
Project: Rowe Industries
Lab ID: 0306103-02A

Client Sample ID: WQ0623031036NP2-6
Tag Number:
Collection Date: 6/23/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B		Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1,1-Trichloroethane	2.1	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,2-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
2-Butanone	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
2-Hexanone	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Acetone	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Benzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Bromobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Bromoform	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Bromomethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM
Chloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:18:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0623031036NP2-6
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Chloromethane	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Dibromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Dibromomethane	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Dichlorodifluoromethane	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Ethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Hexachlorobutadiene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Isopropylbenzene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
m,p-Xylene	< 2.0	2.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Methyl tert-butyl ether	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Methylene chloride	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Naphthalene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
n-Butylbenzene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
n-Propylbenzene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
o-Xylene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
sec-Butylbenzene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Styrene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
tert-Butylbenzene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Tetrachloroethene	54	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Toluene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Trichloroethene	1.6	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Trichlorofluoromethane	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Vinyl acetate	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM
Vinyl chloride	< 1.0	1.0	1.0	µg/L	1	6/27/2003 2:18:00 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0623031036NP2-6
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		Analyst: JP
Iron	2.55	0.0200		mg/L	1	6/27/2003 9:46:02 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ0623031036NP2-6
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.137	0.0200		mg/L	1	6/27/2003 9:43:16 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ062303103503NP2-7
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,2-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
2-Butanone	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
2-Hexanone	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Acetone	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Benzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Bromobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Bromoform	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Bromomethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Chloroethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM

Qualifiers:

- ND - Not Detected at the Reporting Limit
- J - Analyte detected below quantitation limits
- B - Analyte detected in the associated Method Blank
- * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ062303103503NP2-7
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Chloromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Dibromomethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/27/2003 2:58:00 PM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Methylene chloride	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Naphthalene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
o-Xylene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Styrene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Toluene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Trichloroethene	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/27/2003 2:58:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ062303103503NP2-7
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.04	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 6/27/2003 9:51:11 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	B - Analyte detected in the associated Method Blank
	J - Analyte detected below quantitation limits	*
		* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 30-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ062303103503NP2-7
Lab Order:	0306103	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/23/2003
Lab ID:	0306103-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		Analyst: JP
Iron	0.119	0.0200		mg/L	1	6/27/2003 9:49:04 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

AMERICAN ANALYTICAL LABORATORIES, INC.
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFERS

For reporting results, the following "Results Qualifiers" are used:

- | | |
|--------------|---|
| Value | If the result is greater than or equal to the detection limit, report the value |
| U | Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required. |
| J | Indicates an estimated value. The flag is used:
(1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.)
(2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others. |
| B | Indicates the analyte was found in the blank as well as the sample report "10B". |
| E | Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis. |
| D | This flag identifies all compounds identified in an analysis at a secondary dilution factor. |
| P | This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P". |
| N | This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used. |



**AMERICAN
ANALYTICAL
LABORATORIES, INC.**

56 TOLEDO STREET • FARMINGDALE, NEW YORK 11735 • (631) 454-6100 • FAX: (631) 454-8027

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT: Legette Brashears & Graham Inc. **Client Sample ID:** WQ063003:1230NP2-6
Lab Order: 0307008 **Tag Number:**
Project: Rowe Industries Sag Harbor, N.Y. **Collection Date:** 6/30/2003
Lab ID: 0307008-01A **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1,1-Trichloroethane	2.4	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
2-Butanone	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
2-Hexanone	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Acetone	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Benzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Bromobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Bromoform	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Bromomethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Chloroethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1230NP2-6
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Chloromethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Dibromomethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/4/2003 7:43:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Methylene chloride	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Naphthalene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
o-Xylene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Styrene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Tetrachloroethene	56	1.0		µg/L	1	7/4/2003 7:43:00 PM
Toluene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Trichloroethene	2.0	1.0		µg/L	1	7/4/2003 7:43:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/4/2003 7:43:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/4/2003 7:43:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1230NP2-6
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.22	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 7/7/2003 2:53:47 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1230NP2-6
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7		(SW3005A)		
Iron	0.0679	0.0200		mg/L	1	7/7/2003 2:51:31 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT: Legette Brashears & Graham Inc. **Client Sample ID:** WQ063003:1235NP2-7
Lab Order: 0307008 **Tag Number:**
Project: Rowe Industries Sag Harbor, N.Y. **Collection Date:** 6/30/2003
Lab ID: 0307008-02A **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,2-Dichloropropene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
2,2-Dichloropropene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
2-Butanone	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
2-Hexanone	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Acetone	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Benzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Bromobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Bromoform	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Bromomethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Chloroethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1235NP2-7
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Chloromethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Dibromomethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/3/2003 5:24:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Methylene chloride	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Naphthalene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
o-Xylene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Styrene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Toluene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Trichloroethene	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/3/2003 5:24:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/3/2003 5:24:00 PM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1235NP2-7
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		
Iron	1.32	0.0200		mg/L	1	7/7/2003 2:58:28 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	*	- Value exceeds Maximum Contaminant Level

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1235NP2-7
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.118	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 7/7/2003 2:56:20 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	*	- Value exceeds Maximum Contaminant Level

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1240NP2-10
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,2-Dichloropropene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
2-Butanone	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
2-Hexanone	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Acetone	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Benzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Bromobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Bromochloromethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Bromodichloromethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Bromoform	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Bromomethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Carbon disulfide	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Chlorobenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Chloroethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM

Qualifiers:
 ND - Not Detected at the Reporting Limit
 J - Analyte detected below quantitation limits
 B - Analyte detected in the associated Method Blank
 * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1240NP2-10
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Chloromethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Dibromochloromethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Dibromomethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Ethylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Isopropylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
m,p-Xylene	U	2.0		µg/L	1	7/3/2003 6:02:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Methylene chloride	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Naphthalene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
n-Butylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
n-Propylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
o-Xylene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Styrene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Tetrachloroethene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Toluene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Trichloroethene	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Vinyl acetate	U	1.0		µg/L	1	7/3/2003 6:02:00 PM
Vinyl chloride	U	1.0		µg/L	1	7/3/2003 6:02:00 PM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1240NP2-10
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		
Iron	1.92	0.0200		mg/L	1	7/7/2003 3:05:11 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1240NP2-10
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.122	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 7/7/2003 3:02:27 PM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	*	- Value exceeds Maximum Contaminant Level

American Analytical Laboratories, Inc.

Date: 08-Jul-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	WQ063003:1240NP2-10
Lab Order:	0307008	Tag Number:	
Project:	Rowe Industries Sag Harbor, N.Y.	Collection Date:	6/30/2003
Lab ID:	0307008-03D	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	120	E160.1 1.0		mg/L	1	7/2/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031213NP1-1-1
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1,1-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Bromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Bromodichloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 2:02:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031213NP1-1-1
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-01A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 2:02:00 AM
Methyl tert-butyl ether	8.1	1.0		µg/L	1	6/20/2003 2:02:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Tetrachloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Trichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 2:02:00 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031213NP1-1-1
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-01B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	0.0290	E200.7 0.0200		mg/L	1	6/20/2003 11:03:07 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	140	E160.1 0		mg/L	1	6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031213NP1-1-1
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-01C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	< 0.0200	0.0200		mg/L	1	6/20/2003 11:05:18 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306073
Project: Rowe Industries
Lab ID: 0306073-02A

Client Sample ID: GWQ0611031223NP1-1-2
Tag Number:
Collection Date: 6/11/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
2-Butanone	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
2-Hexanone	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Acetone	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Benzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Bromobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Bromoform	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Bromomethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Chloroethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031223NP1-1-2
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-02A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 2:42:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Tetrachloroethene	15	1.0		µg/L	1	6/20/2003 2:42:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Trichloroethene	0.6	1.0	J	µg/L	1	6/20/2003 2:42:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 2:42:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031223NP1-1-2
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-02B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	3.01	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 11:11:14 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	120	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031223NP1-1-2
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-02C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.885	0.0200		mg/L	1	6/20/2003 11:08:59 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031232NP1-1-3
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
SW8260B						Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1,1-Trichloroethane	1.8	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Bromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Bromodichloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 3:21:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031232NP1-1-3
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-03A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 3:21:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Tetrachloroethene	2.4	1.0		µg/L	1	6/20/2003 3:21:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Trichloroethene	3.4	1.0		µg/L	1	6/20/2003 3:21:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 3:21:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031232NP1-1-3
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-03B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.37	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 11:15:52 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	76	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031232NP1-1-3
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-03C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.517	0.0200		mg/L	1	6/20/2003 11:13:41 AM

Qualifiers:	ND - Not Detected at the Reporting Limit
	J - Analyte detected below quantitation limits
	B - Analyte detected in the associated Method Blank
	* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031245NP1-1-4
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-04A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
2-Butanone	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
2-Hexanone	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Acetone	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Benzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Bromobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Bromoform	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Bromomethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Chloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031245NP1-1-4
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-04A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 4:00:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Tetrachloroethene	170	1.0		µg/L	1	6/20/2003 4:00:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Trichloroethene	4.8	1.0		µg/L	1	6/20/2003 4:00:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 4:00:00 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031245NP1-1-4
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-04B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.03	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 11:20:35 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	110	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031245NP1-1-4
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-04C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.572	0.0200		mg/L	1	6/20/2003 11:18:13 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031253NP1-1-5
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-05A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B		Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,2-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
2-Butanone	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
2-Hexanone	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Acetone	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Benzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Bromobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Bromoform	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Bromomethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Chloroethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM

Qualifiers:

- ND - Not Detected at the Reporting Limit
- J - Analyte detected below quantitation limits
- B - Analyte detected in the associated Method Blank
- * - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
 R - RPD outside accepted recovery limits
 E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031253NP1-1-5
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-05A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 4:39:00 AM
Methyl tert-butyl ether	6.2	1.0		µg/L	1	6/20/2003 4:39:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Tetrachloroethene	21	1.0		µg/L	1	6/20/2003 4:39:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Trichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 4:39:00 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031253NP1-1-5
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-05B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	0.760	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 11:32:37 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	120	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ0611031253NP1-1-5
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-05C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.0356	0.0200		mg/L	1	6/20/2003 11:23:01 AM

Qualifiers:	ND - Not Detected at the Reporting Limit
	J - Analyte detected below quantitation limits
	B - Analyte detected in the associated Method Blank
	* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103101NP1-1-6
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-06A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1,1-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Bromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Bromodichloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 5:18:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103101NP1-1-6
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-06A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 5:18:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Tetrachloroethene	120	1.0		µg/L	1	6/20/2003 5:18:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Trichloroethene	0.7	1.0	J	µg/L	1	6/20/2003 5:18:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 5:18:00 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103101NP1-1-6
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-06B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	0.0097	E200.7 0.0200	J	mg/L	1	Analyst: JP 6/20/2003 11:40:26 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	160	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103101NP1-1-6
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-06C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.011	0.0200	J	mg/L	1	6/20/2003 11:36:41 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306073
Project: Rowe Industries
Lab ID: 0306073-07A

Client Sample ID: GWQ061103110NP1-1-7
Tag Number:
Collection Date: 6/11/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B		Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1,1-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,2-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
2-Butanone	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
2-Hexanone	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Acetone	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Benzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Bromobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Bromoform	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Bromomethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Chloroethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103110NP1-1-7
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-07A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 9:28:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Tetrachloroethene	140	1.0		µg/L	1	6/20/2003 9:28:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Trichloroethene	2.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 9:28:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103110NP1-1-7
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-07B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	0.0246	E200.7		mg/L	1	6/20/2003 11:42:42 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	110	E160.1	0	mg/L	1	6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103110NP1-1-7
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-07C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	0.0086	0.0200	J	mg/L	1	6/20/2003 11:44:46 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103123NP1-1-8
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-08A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1				SW8260B		Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1,1-Trichloroethane	2.7	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1,2-Trichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,1-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2,3-Trichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2-Dibromoethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2-Dichloroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,3-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,3-dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
1,4-Dichlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
2,2-Dichloropropane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
2-Butanone	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
2-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
2-Hexanone	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
4-Chlorotoluene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
4-Isopropyltoluene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
4-Methyl-2-pentanone	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Acetone	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Benzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Bromobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Bromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Bromodichloromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Bromoform	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Bromomethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Carbon disulfide	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Carbon tetrachloride	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Chlorobenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Chloroethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103123NP1-1-8
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-08A	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 10:06:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Tetrachloroethene	57	1.0		µg/L	1	6/20/2003 10:06:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Trichloroethene	3.1	1.0		µg/L	1	6/20/2003 10:06:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 10:06:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103123NP1-1-8
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-08B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7				Analyst: JP
Iron	9.14	0.0200		mg/L	1	6/20/2003 11:50:01 AM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: BK
Total Dissolved Solids (Residue, Filterable)	76	0		mg/L	1	6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103123NP1-1-8
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-08C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	1.10	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 11:47:49 AM

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306073
Project: Rowe Industries
Lab ID: 0306073-09A

Client Sample ID: GWQ061103127NP1-1-9
Tag Number:
Collection Date: 6/11/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1,1-Trichloroethane	4.8	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1,2,2-Tetrachloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1,2-Trichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1-Dichloroethene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,1-Dichloropropene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2,3-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2,3-Trichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2,4-Trichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2,4-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2-Dibromo-3-chloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2-Dibromoethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2-Dichloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,3,5-Trimethylbenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,3-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,3-dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
1,4-Dichlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
2,2-Dichloropropane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
2-Butanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
2-Chloroethyl vinyl ether	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
2-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
2-Hexanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
4-Chlorotoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
4-Isopropyltoluene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
4-Methyl-2-pentanone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Acetone	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Benzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Bromobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Bromochloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Bromodichloromethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Bromoform	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Bromomethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Carbon disulfide	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Carbon tetrachloride	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Chlorobenzene	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM
Chloroethane	< 1.0	1.0	1.0	µg/L	1	6/20/2003 10:45:00 AM

Qualifiers: ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT: Legette Brashears & Graham Inc.
Lab Order: 0306073
Project: Rowe Industries
Lab ID: 0306073-09A

Client Sample ID: GWQ061103127NP1-1-9
Tag Number:
Collection Date: 6/11/2003
Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
Chloroform	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Chloromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
cis-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
cis-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Dibromochloromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Dibromomethane	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Dichlorodifluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Ethylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Hexachlorobutadiene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Isopropylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
m,p-Xylene	< 2.0	2.0		µg/L	1	6/20/2003 10:45:00 AM
Methyl tert-butyl ether	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Methylene chloride	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Naphthalene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
n-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
n-Propylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
o-Xylene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
sec-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Styrene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
tert-Butylbenzene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Tetrachloroethene	18	1.0		µg/L	1	6/20/2003 10:45:00 AM
Toluene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
trans-1,2-Dichloroethene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
trans-1,3-Dichloropropene	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Trichloroethene	1.6	1.0		µg/L	1	6/20/2003 10:45:00 AM
Trichlorofluoromethane	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Vinyl acetate	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM
Vinyl chloride	< 1.0	1.0		µg/L	1	6/20/2003 10:45:00 AM

Qualifiers:
ND - Not Detected at the Reporting Limit
J - Analyte detected below quantitation limits
B - Analyte detected in the associated Method Blank
* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103127NP1-1-9
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-09B	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.75	E200.7 0.0200		mg/L	1	Analyst: JP 6/20/2003 11:54:20 AM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	95	E160.1 0		mg/L	1	Analyst: BK 6/18/2003

Qualifiers:	ND - Not Detected at the Reporting Limit	S - Spike Recovery outside accepted recovery limits
	J - Analyte detected below quantitation limits	R - RPD outside accepted recovery limits
	B - Analyte detected in the associated Method Blank	E - Value above quantitation range
	* - Value exceeds Maximum Contaminant Level	

American Analytical Laboratories, Inc.

Date: 23-Jun-03

CLIENT:	Legette Brashears & Graham Inc.	Client Sample ID:	GWQ061103127NP1-1-9
Lab Order:	0306073	Tag Number:	
Project:	Rowe Industries	Collection Date:	6/11/2003
Lab ID:	0306073-09C	Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON		E200.7				Analyst: JP
Iron	1.74	0.0200		mg/L	1	6/20/2003 11:52:10 AM

Qualifiers:	ND - Not Detected at the Reporting Limit
	J - Analyte detected below quantitation limits
	B - Analyte detected in the associated Method Blank
	* - Value exceeds Maximum Contaminant Level

S - Spike Recovery outside accepted recovery limits
R - RPD outside accepted recovery limits
E - Value above quantitation range

Form 1						
STL Connecticut		Client Sample ID	AQ060503:1155NP4-1			
Method: T017		Lab Sample ID	203849-1			
Sample Volume (L)	0.300	Date Sampled	6/5/2003			
Temp (C)	25	Date Analyzed	6/12/2003			
Compound	(ppbv/v)	nL/L Qualifier	RL	mg/M3 Qualifier	RL	
Chloromethane	32.3	U	32.3	0.067	U	0.067
Vinyl Chloride	26.1	U	26.1	0.067	U	0.067
Bromomethane	16.3	JB	17.2	0.063	JB	0.067
Chloroethane	25.3	U	25.3	0.067	U	0.067
1,1-Dichloroethene	8.4	U	8.4	0.033	U	0.033
Carbon Disulfide	10.7	U	10.7	0.033	U	0.033
Methylene Chloride	27.8		9.6	0.097		0.033
trans-1,2-Dichloroethene	8.5	U	8.5	0.033	U	0.033
1,1-Dichloroethane	8.2	U	8.2	0.033	U	0.033
cis-1,2-Dichloroethene	8.5	U	8.5	0.033	U	0.033
Chloroform	6.8	U	6.8	0.033	U	0.033
1,1,1-Trichloroethane	6.1	U	6.1	0.033	U	0.033
Carbon Tetrachloride	5.3	U	5.3	0.033	U	0.033
Benzene	1.0	JB	10.4	0.003	JB	0.033
1,2-Dichloroethane	8.2	U	8.2	0.033	U	0.033
Trichloroethene	3.7	J	6.2	0.020	J	0.033
1,2-Dichloropropane	7.2	U	7.2	0.033	U	0.033
Bromodichloromethane	5.0	U	5.0	0.033	U	0.033
cis-1,3-Dichloropropene	7.3	U	7.3	0.033	U	0.033
Toluene	0.9	J	8.9	0.003	J	0.033
trans-1,3-Dichloropropene	7.3	U	7.3	0.033	U	0.033
1,1,2-Trichloroethane	6.1	U	6.1	0.033	U	0.033
Tetrachloroethene	88.4		4.9	0.600		0.033
Dibromochloromethane	3.9	U	3.9	0.033	U	0.033
Chlorobenzene	7.2	U	7.2	0.033	U	0.033
Ethylbenzene	7.7	U	7.7	0.033	U	0.033
m&p-Xylenes	7.7	U	7.7	0.033	U	0.033
o-Xylene	7.7	U	7.7	0.033	U	0.033
Styrene	7.8	U	7.8	0.033	U	0.033
Bromoform	3.2	U	3.2	0.033	U	0.033
1,1,2,2-Tetrachloroethane	4.9	U	4.9	0.033	U	0.033

0000004

Form 1					
STL Connecticut		Client Sample ID	AQ060503:1156NP4-2		
Method: T017		Lab Sample ID	203849-2		
Sample Volume (L)	1.000	Date Sampled	6/5/2003		
Temp (C)	25	Date Analyzed	6/11/2003		
Compound	nL/L (ppbv/v)	Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	1.0	JB	9.7	0.002	JB
Vinyl Chloride	7.8	U	7.8	0.020	U
Bromomethane	5.4	B	5.1	0.021	B
Chloroethane	7.6	U	7.6	0.020	U
1,1-Dichloroethene	2.5	U	2.5	0.010	U
Carbon Disulfide	3.2	U	3.2	0.010	U
Methylene Chloride	5.2		2.9	0.018	
trans-1,2-Dichloroethene	2.5	U	2.5	0.010	U
1,1-Dichloroethane	2.5	U	2.5	0.010	U
cis-1,2-Dichloroethene	0.5	J	2.5	0.002	J
Chloroform	0.8	J	2.1	0.004	J
1,1,1-Trichloroethane	2.6		1.8	0.014	
Carbon Tetrachloride	1.6	U	1.6	0.010	U
Benzene	0.3	JB	3.1	0.001	JB
1,2-Dichloroethane	2.5	U	2.5	0.010	U
Trichloroethene	0.2	J	1.9	0.001	J
1,2-Dichloropropane	2.2	U	2.2	0.010	U
Bromodichloromethane	1.5	U	1.5	0.010	U
cis-1,3-Dichloropropene	2.2	U	2.2	0.010	U
Toluene	0.5	J	2.7	0.002	J
trans-1,3-Dichloropropene	2.2	U	2.2	0.010	U
1,1,2-Trichloroethane	1.8	U	1.8	0.010	U
Tetrachloroethene	4.7		1.5	0.032	
Dibromochloromethane	1.2	U	1.2	0.010	U
Chlorobenzene	2.2	U	2.2	0.010	U
Ethylbenzene	2.3	U	2.3	0.010	U
m&p-Xylenes	2.3	U	2.3	0.010	U
o-Xylene	2.3	U	2.3	0.010	U
Styrene	2.4	U	2.4	0.010	U
Bromoform	1.0	U	1.0	0.010	U
1,1,2,2-Tetrachloroethane	1.5	U	1.5	0.010	U

0000005

Form 1					
STL Connecticut		Client Sample ID		AQ060503:1157NP4-3	
Method: T017		Lab Sample ID		203849-3	
Sample Volume (L)	1.000	Date Sampled		6/5/2003	
Temp (C)	25	Date Analyzed		6/12/2003	
Compound	nL/L (ppbv/v)	Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	9.7 U	9.7		0.020 U	0.020
Vinyl Chloride	7.8 U	7.8		0.020 U	0.020
Bromomethane	7.7 B	5.1		0.030 B	0.020
Chloroethane	7.6 U	7.6		0.020 U	0.020
1,1-Dichloroethene	9.1	2.5		0.036	0.010
Carbon Disulfide	13.2	3.2		0.041	0.010
Methylene Chloride	8.1	2.9		0.028	0.010
trans-1,2-Dichloroethene	2.5 U	2.5		0.010 U	0.010
1,1-Dichloroethane	13.8	2.5		0.056	0.010
cis-1,2-Dichloroethene	3.6	2.5		0.014	0.010
Chloroform	6.4	2.1		0.031	0.010
1,1,1-Trichloroethane	12.5	1.8		0.068	0.010
Carbon Tetrachloride	1.6 U	1.6		0.010 U	0.010
Benzene	5.9 B	3.1		0.019 B	0.010
1,2-Dichloroethane	2.5 U	2.5		0.010 U	0.010
Trichloroethene	1.9 U	1.9		0.010 U	0.010
1,2-Dichloropropane	2.2 U	2.2		0.010 U	0.010
Bromodichloromethane	1.5 U	1.5		0.010 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
Toluene	2.9	2.7		0.011	0.010
trans-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8		0.010 U	0.010
Tetrachloroethene	1.5 U	1.5		0.010 U	0.010
Dibromochloromethane	1.2 U	1.2		0.010 U	0.010
Chlorobenzene	2.2 U	2.2		0.010 U	0.010
Ethylbenzene	2.3 U	2.3		0.010 U	0.010
m&p-Xylenes	1.2 J	2.3		0.005 J	0.010
o-Xylene	2.3 U	2.3		0.010 U	0.010
Styrene	2.4 U	2.4		0.010 U	0.010
Bromoform	1.0 U	1.0		0.010 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5		0.010 U	0.010

0000006

APPENDIX IV:
CALCULATION OF VOC EMISSIONS FROM CARBON UNITS

APPENDIX IV

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

**CALCULATION OF VOLATILE ORGANIC COMPOUNDS DISCHARGED FROM
VAPOR-PHASE CARBON UNITS**

Calculated by: Laura R. Zima

Checked by: Alfred N. Kovalik

STATEMENT OF PROBLEM:

Calculate the quantity of VOCs discharged from the vapor-phase carbon units based on vapor concentrations and flow rates.

PROBLEM CONSTRAINTS:

Emission Limits: Total VOCs = 0.022 lb/hr

(Acceptable stack discharge concentrations for meeting AgC concentrations at property boundary are included in table below. Allowable concentrations calculated in Appendix IV of the December report.)

Date	PCE (mg/m ³)	TCE (mg/m ³)	Toluene (mg/m ³)	Benzene (mg/m ³)	Chloroform (mg/m ³)	m&p-Xylenes (mg/m ³)
Allowable Conc.	0.0068	0.041	NE	NE	2.1	NE
12/19/02	0	0	0.045	0.006	0.001	0.006
1/9/03	0.001	0	0.060	0	0	0.004
2/20/03	0	0	0.015	0	0	0
3/12/03	0	0	0.010	0.002	0.006	0.002
4/9/03	0	0	0.005	0.000	0.009	0.002
6/5/03	0	0	0.011	0.019	0.031	0.005

Date	Methylene Chloride (mg/m ³)	o-Xylene (mg/m ³)	Chloro-methane (mg/m ³)	Carbon Disulfide (mg/m ³)	Styrene (mg/m ³)	Total VOCs (mg/m ³)
Allowable Conc.	NE	NE	NE	NE	NE	NA
12/19/03	0.022	0	0	0	0	0.082
1/9/03	0.018	0	0	0	0	0.083
2/20/03	0	0	0	0	0	0.015
3/12/03	0	0	0	0.003	0	0.023
4/9/03	0.023	0	0	0.019	0	0.058
6/5/03	0.028	0	0	0.041	0	0.135

- NE : Not Established for Site
- : Not Collected
- 0 : Less than the laboratory method detection limit.
- NA : Not Applicable

CALCULATION:

$$VOC \text{ Emissions}(lb / hr) = C \cdot Q \cdot \frac{60 \text{ min}}{hr} \cdot \frac{1 m^3}{35.31 ft^3} \cdot \frac{1 lb}{453,600 mg}$$

where, Q is the air flowrate in standard cubic feet per minute (scfm) and
 C is the VOC concentration in mg/m³

Date	Operating Time (hours)	Vapor Flow Rate (scfm)*	VOC Vapor Conc. (mg/m ³)	VOC Emissions (lb/hr)	VOC Emissions (lb)
12/17/02	---	---	---	---	---
12/19/02	48	3,359	0.082	0.0010	0.050
1/9/03	504	3,532	0.083	0.0011	0.553
2/20/03	1,008	3,415	0.015	0.00019	0.193
3/12/03	480	3,447	0.023	0.00030	0.143
4/9/03	672	3,490	0.058	0.00076	0.510
6/5/03	463	3,427	0.135	0.00173	0.802
6/5/03	469	3,274	0.135	0.00166	0.777
				Total	3.028

* : Average vapor flow rate used.

CONCLUSIONS:

Emissions from the carbon units were below the VOC emission limit of 0.022 lbs/hr. Concentrations of PCE, TCE and chloroform at the stack were also below the allowable emission rates of those compounds corresponding to the AgC at the property line.