

LBG ENGINEERING SERVICES, P.C.

Professional Environmental & Civil Engineers



4 Research Drive
Suite 301
Shelton, CT 06484
(203) 929-8555
(203) 926-9140 (FAX)

April 12, 2006

Mr. Jeffery Trad
Project Manager
New York State Department of Environmental Conservation
Division of Environmental Remediation, Construction Services
625 Broadway, 12th floor
Albany, NY 12233-7013

RE: January 2006 Status Report
Ground-Water Remedial Action
Rowe Industries Superfund Site
Sag Harbor, New York

Dear Mr. Trad:

The enclosed letter report details the operation status of the full-scale ground-water pump and treat system at the above referenced site. LBG has enclosed an additional copy of the report to be forwarded to the Chief of the Operation Maintenance and Support Section.

Should you or the Operation Maintenance and Support Section have any questions, please feel free to contact myself, Paul Jobmann, or Al Kovalik at (203) 929-8555.


Very truly yours,

LEGGETTE, BRASHEARS & GRAHAM, INC.

Mark M. Goldberg
Mark M. Goldberg, P.E.
Senior Environmental Engineer

MG:ng
Enclosures

H:\NABIS\2006\Monthly Reports\Jan 2006\trad_Jan2006_report.doc

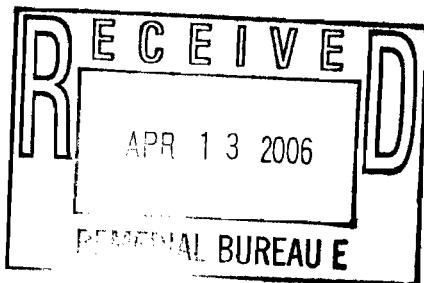

-DRAFT-

PROJECT STATUS MEMORANDUM

NO. 01-06

TO: Pamela Tames, USEPA

FROM: Mark M. Goldberg, P.E.
Paul Jobmann

DATE: April 6, 2006

PROJECT: Rowe Industries Superfund Site
Ground-Water Recovery and Treatment System
January 2006 Status Report
Sag Harbor, New York

LBG Engineering Services, P.C. (LBG) commenced operation of the ground-water remediation system at the above-referenced site on December 17, 2002. This status report presents a summary of system performance, operation and maintenance, and monitoring activities for the site from January 1, 2006 through January 31, 2006. The report includes a summary of system performance parameters, system operation parameters, analytical results for ground water, system effluent samples, and air quality results.

SUMMARY OF SYSTEM PERFORMANCE AND OPERATION
(January 1, 2006 through January 31, 2006)

1. Hours of operation during the reporting period: 544 hours (73%)
2. Alarm conditions during the reporting period: See Table 1
3. Was the SPDES VOC discharge permit criteria achieved: yes, (Table 2)
4. Total volume of water pumped during the reporting period: 14,353,192 gal.
5. Was the system effluent flow below the SPDES limit of 1,023,000 gpd: yes, (Graph 1)
6. Mass of VOCs recovered during the reporting period: 2.4 pounds
7. Cumulative mass of VOCs recovered since startup on 12/17/02:
(calculations can be provided upon request) 178.2 pounds
8. Effluent VOC vapor concentration for the reporting period: 0.202 mg/m³ (Table 3)
9. Was the effluent VOC vapor emission rate below 0.022 lbs/hr.:
(calculations can be provided upon request) yes (0.00198 lbs/hr.)

GROUND-WATER RECOVERY SYSTEM STATUS SUMMARY

The following table summarizes select recovery well parameters for the reporting period. Table 4 presents a summary of the quality results for water samples collected from recovery wells. Graph 2 presents PCE concentrations for each recovery well. For wells with water quality that meets or is approaching remedial criteria, Graph 3 presents PCE concentrations at an expanded scale in order to compare them to the PCE aquifer restoration concentration of 5 ug/L. Laboratory analytical reports are included as Appendix I.

Well	Volume Pumped (gal)	Average Flow (gpm)	Minimum Design Flow (gpm)	Total VOC Concentration ($\mu\text{g}/\text{L}$)	VOC Recovery (lbs)
RW-2	859,102	27	26	13.2	0.09
RW-3	402,300	12	23	26.6	0.09
RW-4 *	1,280,020	39	13	24.5	0.26
RW-5	1,814,618	55	42	4.3	0.07
RW-6	497,697	15	28	58.1	0.24
RW-7	2,362,900	70	54	33.2	0.66
RW-8	1,501,538	46	46	7.0	0.09
RW-9	2,430,266	76	68	1.4	0.03

* The RW-4 flow meter malfunctioned from 1/6/06 to 1/31/06. The volume of water pumped from RW-4 was calculated by adding the non-resettable flow obtained during the RW-4 operation from 1/1/06 to 1/6/06 to the product of the average flow from 1/1/06 to 1/6/06 (39 gpm) and the hours of operation for RW-4 from 1/6/06 to 1/31/06.

Recovery wells RW-3 and RW-6 had average flows below the respective minimum design flows determined to be necessary for capture of the plume.

The pumping rate and specific capacity from RW-3 have both decreased with time. Rehabilitation efforts in 2005 did not improve the specific capacity of this well. Build-up of microbial growth in the formation, in conjunction with the finer soils associated with the aquifer in the immediate vicinity of RW-3, are believed to be causing the decrease in well yield. This well's performance will be addressed during 2006 well rehabilitation activities.

The ground-water drawdown at RW-6 is significant and the drawdown is continuing to increase; therefore, the pumping rate at RW-6 will continue to be 15 gpm as long as well conditions allow. This well's performance will be addressed during 2006 well rehabilitation activities.

The effluent pH values are below the State Pollutant Discharge Elimination System (SPDES) Applicable or Relevant and Appropriate Requirements (ARARs) of 6.5 on a routine basis. January pH readings of water samples from the recovery wells were observed to be in the range of approximately 5.9 to 6.9. The FSP&T system does not use any chemical treatment processes to alter pH. In addition, the effluent water discharge and the recovery well extraction points are located in the same aquifer. As discussed with the New York State Department of Environmental Conservation

(NYSDEC), because the low pH is naturally occurring, and because of the previously mentioned factors, it is not considered an exceedance of the discharge requirements.

BAG FILTER STATUS

The following table presents an operational summary of the bag filter usage and configuration for the reporting period.

Dates	Bank 1	Bank 2	Bank 3
January 1 to 31	7 of 8 housings used with 400 micron bag filters	7 of 8 housings used with 400 micron bag filters	Not active

No modifications were made to the filter bank configuration or operation during this reporting period.

OTHER O&M ACTIVITIES AND FUTURE O&M ACTIVITIES

Other O&M activities conducted in January 2006 include:

- On January 19, 2006, the static water levels in the recovery wells were measured; and
- On January 26 and 27, 2006, recovery well flow meters, riser pipes and vault pipes for RW-2, 8 and 9 were cleaned. In addition, flow meters and check valves in the remediation building were cleaned.

Future O&M activities scheduled for the winter and spring of 2006 include:

- Replace the malfunctioning RW-4 flow meter transmitter in February 2006;
- Troubleshoot the air stripper blower and booster blower air flow meter malfunction and the hardware malfunction;
- Investigate the cause of the red dust observed at the base plate of transfer pump TP-1B; and
- Conduct semi-annual ground-water sampling in March 2006.

cc: Phil McAndrew, Kraft Foods, N.A. – .pdf
Lisa Krogman, Kraft Foods, N.A. (Environ) – .pdf
Jeff Trad, NYSDEC
Chief-Operation Maintenance and Support Section, NYSDEC
William Spitz, RWM, R-1, NYSDEC
Garrett W. Swensen, Jr., Esq., Town of Southampton

MMG:ng

Attachments

H:\NABIS\2006\Monthly Reports\Jan 2006>Status0106Jan.doc

TABLES

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(January 1, 2006 through January 31, 2006)

Date	Time	System Changes/Modifications	Personnel
1/4/2006		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
		Transfer pumps (TP1A, TP1B, TP2A and TP2B), ASB and BB were lubricated with grease.	RD
1/11/2006	7:00 AM	Communication failure alarm and secondary recharge basin high level alarm; system shut down.	
1/12/2006	7:27 AM	Upon arrival, the computer screen indicates a "hardware malfunction". The hardware malfunction problem will be investigated to determine if there is a problem with the computer or the control panel equipment.	RD
		Red dust was observed near the base plate of TP1B; this transfer pump was switched to the lag pump and TP1A is now the lead pump. The source of the red dust will be investigated and repaired if necessary.	RD
		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
	9:30 AM	The computer was rebooted, the alarms were reset and the system was restarted. After the system was re-started, the ASB and BB air flow meter readings from the computer were not reading correctly. In addition, there was no power to the local displays for ASB and BB air flow meter (LED screens were blank). This issue may be related to the hardware malfunction problem cited above. The air is flowing through the tower normally based on the pressure readings for the ASB and BB meters and the lab results for the effluent water. The ASB and BB air flow meter display problem will be investigated.	RD
	10:55 AM	Water is not entering the secondary recharge basin, therefore a malfunctioning pressure transducer is the cause for the secondary recharge basin high level alarm. This pressure transducer is not used so it will not be replaced. The setpoint for the secondary recharge basin level alarm was changed from 72 inches to 720 inches to prevent this alarm from occurring.	RD
1/14/2006	11:53 PM	Booster Blower failure alarm; system shut down.	
1/15/2006	11:22 AM	Power failure alarm; system is already down	
	4:57 PM	Control Room Temperature Alarm	
1/19/2006		Measured static water levels in recovery wells and updated static water level setpoints in the computer.	RD
	11:30 AM	Reset booster blower motor starter, reset alarms and restarted the system.	RD
		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD
1/25/2006		Changed multi-bag filter bags (400 um) in banks 1 and 2 seven of eight housings used. Banks 1 and 2 left open. Bank 3 closed.	RD

TABLE 1
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

MAINTENANCE LOG
(January 1, 2006 through January 31, 2006)

Date	Time	System Changes/Modifications	Personnel
1/26/2006	7:42 AM	Turned off RW-2, 8 and 9 to clean flow meters, riser pipes, and vault pipes in these wells.	SS, ETL
	11:09 AM	A ground fault pump alarm occurred at RW-2 after cleaning the pipes and flow meter. RW-2 is not operating.	
		The flow reading for RW-4 is inaccurate (reading 180 gpm), the RW-4 flow meter will be investigated.	SS
1/27/2006	7:50 AM	A wire in the RW-2 vault was causing a short circuit; re-positioning of the wire fixed the problem. RW-2 is operating.	SS, ETL
		Cleaned remediation building flow meters and check valves.	SS, ETL
1/29/2006	7:00 AM	Communication failure alarm, system shut down.	

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

EFFLUENT WATER QUALITY RESULTS

Date Sampled ^a	pH ^b	TDS (mg/l)	PCE (ug/l)	1,1,1-TCA (ug/l)	TCE (ug/l)	1,1-DCA (ug/l)	1,1-DCE (ug/l)	1,2-DCE (ug/l)	Xylene (ug/l)	Bromotform (ug/l)	Dibromo-chloromethane (ug/l)	Methylene Chloride (ug/l)	Freon 113 (ug/l)	Acetone (ug/l)	Chloroform (ug/l)	MTBE (ug/l)	Total Iron (mg/l)	Dissolved Iron (mg/l)
SPDES Limits	6.5 to 8.5	---	1	5	5	5	5	5	5	---	5	50	7	---	---	---	---	---
4-Jan-06	5.3	232	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	23.3 ^d	0.122
12-Jan-06	5.3	100	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	2.16	0.0953
19-Jan-06	5.3	134	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	82.7 ^d	11.7 ^d
25-Jan-06	5.3	132	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<2.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	ND<1.0	8.79	0.103

SPDES: State Pollutant Discharge Elimination System

mg/l: Milligrams per liter

ug/l: Micrograms per liter

---: Not established

Nf: Not Measured
TDS: Total dissolved solids
PCE: Tetrachloroethylene
TCE: Trichloroethylene

1,1-DCA: 1,1-Dichloroethane
1,1-DCE: 1,1-Dichloroethene
1,2-DCE: 1,2-Dichloroethene
MTBE: Methyl tert-butyl ether

Notes:

1. pH was measured using litmus paper. Influent pH values from recovery wells, which reflect the pH of natural ground water, are below 6.5 on a regular basis.
2. "Effluent" samples were collected from sample port labeled NP2-10.
3. Methylen chloride and acetone detected in these samples are suspected to be from laboratory contamination.
4. High iron concentrations detected in the effluent may be caused by iron sediment build-up in the tower sump, the bottom of the transfer tank, the effluent pipe or the effluent pipe fittings. The cause of the high iron concentrations will be investigated.

GROUNDWATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

CARBON UNIT SYSTEM AIR QUALITY RESULTS

Precarbon	Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	Parameters (mg/m ³)	MC	CM	CD	BM	CB	EB	VC	CT	TOTAL VOCs	
AQ020205:1345NP4-1		2/2/2005	13:45	0.45	0.0325	0.0675	ND	ND	0.02	0.0075	ND	ND	0.0075	0.0325	ND	ND	0.185	ND	ND	ND	ND	ND	ND	ND	0.80	
AQ030205:1105NP4-1		3/2/2005	11:05	0.35	0.0325	0.0725	ND	ND	0.0175	0.005	ND	ND	0.005	0.0825	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	0.58	
AQ040705:1430NP4-1		4/7/2005	14:30	0.34	0.027	0.058	0.006	0.02	0.012	0.003	ND	ND	0.006	0.053	ND	ND	0.015	ND	ND	ND	ND	ND	ND	ND	0.57	
AQ050205:1405NP4-1		5/2/2005	14:05	0.52	0.032	0.116	ND	ND	0.024	0.008	ND	ND	0.024	ND	ND	ND	0.04	ND	ND	ND	ND	ND	ND	ND	0.76	
AQ062405:1240NP4-1		6/24/2005	12:40	0.36	0.028	0.1	ND	ND	0.074	0.046	0.004	ND	ND	0.144	ND	ND	0.054	0.16	ND	ND	ND	ND	ND	ND	0.97	
AQ070705:1409NP4-1		7/7/2005	14:00	0.43	0.026	0.12	ND	ND	0.044	0.04	ND	ND	0.006	0.092	ND	ND	0.19 ¹¹	ND	ND	0.024	ND	ND	ND	ND	0.86	
AQ080205:1400NP4-1		8/2/2005	14:00	0.42	0.034	0.15	ND	ND	0.009	0.05	0.008	ND	0.006	0.017 ¹¹	ND	ND	0.043	ND	ND	ND	ND	ND	ND	ND	0.93	
AQ080805:900NP4-1		9/8/2005	9:00	0.27	0.032	0.1	0.011	ND	0.016	0.079	0.039	0.025	0.013	0.003	ND	ND	1.7 ¹¹	ND	0.021	0.038	0.01	ND	ND	ND	0.81	
AQ100605:1230NP4-1		10/6/2005	12:30	0.28	0.022	0.1	0.007	0.025	0.011	0.015	0.004	ND	0.002	0.005	ND	ND	0.036	ND	0.032	ND	ND	ND	ND	ND	0.54	
AQ111605:1130NP4-1		11/16/2005	11:30	0.76	0.033	0.11	0.008	0.022	0.054	0.44	0.016	0.012	0.004	ND	ND	0.023	ND	0.025	ND	ND	ND	ND	ND	ND	1.59	
AQ120805:930NP4-1		12/8/2005	9:30	0.34	0.016	0.079	0.006	0.02	0.032	0.014	0.003	ND	0.002	0.004	ND	ND	0.015	ND	0.002	ND	ND	ND	ND	ND	0.58	
AQ010406:945NP4-1		1/4/2006	8:45	0.24	0.027	0.094	0.007	0.019	0.009	0.031	0.014	0.01	0.004	0.005	ND	ND	0.018	ND	0.005	ND	ND	ND	ND	ND	0.52	
Midcarbon																										
Precarbon	Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	Parameters (mg/m ³)	MC	CM	CD	BM	CB	EB	VC	CT	TOTAL VOCs	
AQ020205:1350NP4-2		2/2/2005	13:50	ND	0.15	0.011	0.033	0.005	0.019	0.001	ND	ND	0.018	0.019	ND	ND	0.013	ND	0.004	ND	ND	ND	ND	ND	0.27	
AQ030205:1105NP4-2		3/2/2005	11:10	ND	0.14	0.009	0.022	0.004	0.016	0.002	ND	ND	0.011	0.01	ND	ND	0.008	ND	0.021	ND	ND	ND	ND	ND	0.25	
AQ040705:1432NP4-2		4/7/2005	14:32	0.004	ND	0.069	0.005	0.014	0.003	0.012	0.002	ND	ND	0.006	0.05	ND	ND	0.026	ND	0.026	ND	ND	ND	ND	0.19	
AQ050205:1410NP4-2		5/2/2005	14:10	ND	0.085	0.005	ND	ND	0.003	0.016	0.001	ND	ND	0.003	0.006	ND	ND	0.005	ND	0.005	ND	ND	ND	ND	0.13	
AQ062405:1241NP4-2		6/24/2005	12:41	ND	0.063	ND	ND	0.036	0.023	0.005	ND	ND	0.006	0.007	ND	ND	0.096	ND	0.047	ND	ND	ND	ND	ND	0.33	
AQ070705:1415NP4-2		7/7/2005	14:15	ND	0.05	ND	ND	0.051	0.006	0.002	ND	ND	0.006	0.007	ND	ND	0.65 ¹¹	ND	0.49 ¹¹	ND	ND	ND	ND	ND	0.34	
AQ080205:1405NP4-2		8/2/2005	14:05	0.019	ND	0.039	ND	0.039	ND	0.049	0.002	0.024	0.012	ND	0.004	0.029 ¹¹	ND	0.72 ¹¹	ND	0.046	ND	ND	ND	ND	0.27	
AQ090805:905NP4-2		9/8/2005	9:05	0.008	ND	0.007	ND	0.1	0.028	0.009	0.013	0.001	0.003	ND	0.01	0.012	ND	0.018	ND	0.013	ND	0.003	ND	ND	ND	0.27
AQ100605:1232NP4-2		10/6/2005	12:32	0.001	ND	0.058	0.004	0.015	0.004	0.002	0.002	0.002	0.004	0.001	0.005	0.017	ND	0.021	ND	0.049	ND	ND	ND	ND	ND	0.26
AQ111605:1132NP4-2		11/16/2005	11:32	0.003	ND	0.13	0.009	0.023	0.007	0.013	0.002	0.004	0.001	0.003	0.006	0.007 ²	ND	0.021	ND	0.031	ND	ND	ND	ND	ND	0.18
AQ120805:935NP4-2		12/8/2005	9:35	0.006	ND	0.11	0.005	0.017	0.006	0.018	0.001	0.003	ND	0.003	0.005	0.007	ND	0.022	ND	0.009	ND	ND	ND	ND	ND	0.24
AQ130406:950NP4-2		1/4/2006	8:50	0.006	ND	0.11	0.005	0.017	0.006	0.018	0.001	0.003	ND	0.003	0.005	0.007	ND	0.022	ND	0.009	ND	ND	ND	ND	ND	0.21
Postcarbon																										
Precarbon	Sample Name	Date	Time	PCE	TCE	TCA	DCE	DCA	cis-DCE	Toluene	Benzene	m&p-Xylenes	o-Xylene	Styrene	CF	Parameters (mg/m ³)	MC	CM	CD	BM	CB	EB	VC	CT	TOTAL VOCs	
AQ020205:1355NP4-3		2/2/2005	13:55	0.004	ND	0.023	0.009	0.031	0.016	0.002	ND	ND	0.001	ND	ND	0.023	ND	ND	0.013	ND	ND	ND	ND	ND	ND	0.06
AQ030205:1115NP4-3		3/2/2005	11:15	0.001	ND	0.03	0.006	0.016	0.016	0.001	ND	ND	0.001	ND	ND	0.007	ND	ND	0.015	ND	ND	ND	ND	ND	ND	0.12
AQ040705:1434NP4-3		4/7/2005	14:34	ND	0.012	0.007	0.016	ND	0.019	0.01	ND	ND	0.009	ND	ND	0.007	ND	ND	0.012	ND	ND	ND	ND	ND	ND	0.10
AQ050205:1415NP4-3		5/2/2005	14:15	ND	0.012	0.007	0.016	ND	0.035	0.002	ND	ND	0.004	ND	ND	0.005	ND	ND	0.022	ND	0.054	ND	ND	ND	ND	0.11
AQ062405:1242NP4-3		6/24/2005	12:42	ND	0.014	0.014	ND	ND	0.038	0.004	ND	ND	0.005	ND	ND	0.023 ¹¹	ND	ND	0.046	ND	ND	ND	ND	ND	ND	0.20
AQ070705:1420NP4-3		7/7/2005	14:20	ND	0.016	0.014	ND	ND	0.068	0.007	ND	ND	0.008	ND	ND	0.007	ND	ND	0.040 ¹¹	ND	ND	ND	ND	ND	ND	0.23
AQ080205:1410NP4-3		8/2/2005	14:10	ND	0.016	0.014	ND	ND	0.038	0.002	0.022	0.01	0.004	ND	ND	0.025 ¹¹	ND	ND	0.019	ND	0.035	ND	ND	ND	ND	0.22
AQ090805:910NP4-3		9/8/2005	9:10	0.004	ND	0.014	0.004	0.009	0.012	0.002	ND	ND	0.002	ND	ND	0.004	ND	ND	0.084	ND	ND	ND	ND	ND	ND	0.17
AQ100605:1234NP4-3		10/6/2005	12:34	0.004	ND	0.029	0.003	ND	0.014	0.004	0.011	0.004	0.009	ND	ND	0.022	ND	ND	0.016	ND	0.002	ND	ND	ND	0.19	
AQ111605:1134NP4-3		11/16/2005	11:34	0.003	ND	0.075	0.009	0.028	0.004	0.013	0.002	0.003	0.003	0.009	0.009	0.007 ²	ND	0.02	ND	0.002	ND	ND	ND	ND	0.19	
AQ120805:940NP4-3		12/8/2005	9:40	0.004	ND	0.096	0.006	0.022	0.003	0.017	0.004	0.004	0.004	0.004	0.004	0.006	ND	0.022	ND	0.001	ND	ND	ND	ND	0.19	
AQ010406:955NP4-3		1/4/2006	8:55	0.004	ND	0.096	0.006	0.022	0.003	0.017	0.004	0.004	0.004	0.004	0.004	0.006	ND	0.022	ND	0.001	ND	ND	ND	ND	0.20	

Notes: 1. Methylene chloride and/or carbon disulfide concentrations in all three air samples collected during the July 7, August 9 and September 8, 2005 sampling events are greatly elevated due to suspected laboratory contamination.

contamination. The methylene chloride concentration from the June 24, 2005 sampling event was used instead of the July 7, August 9 or September 8, 2005 methylene chloride concentrations to calculate the total VOCs for July, August and September.

2. The methylene chloride concentration in the air samples collected on December 8, 2005 are suspected to be from laboratory contamination.

PCE - Tetrachloroethane

TCE - Trichloroethene

TCA - 1,1-Trichloroethane

cis-DCE - cis-1,2-Dichloroethene

CD - Carbon Disulfide

MC - Methylene Chloride

CM - Chloromethane

EB - Ethylbenzene

VC - Vinyl Chloride

GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethylene (ug/L)	Bromochloromethane (ug/L)	Acetone (ug/L)
		5	5	5	7	7	7	300	300	5	5	5	5	5
RW-1	23-Jan-04	ND<1	ND<1	ND<1	ND<1	4.0	2.2	0.0098	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	ND<1	ND<1	ND<1	ND<1	4.6	5.2	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	ND<1	ND<1	ND<1	ND<1	ND<1	6.1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	ND<1	ND<1	ND<1	ND<1	2.9	6.8	0.0240	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	5-May-04	ND<1	ND<1	ND<1	ND<1	5.6	6.8	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jun-04	ND<1	ND<1	ND<1	ND<1	2.0	3.4	0.0454	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	ND<1	ND<1	ND<1	ND<1	ND<1	3.1	0.0190	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.8	ND<1	0.0865	ND<0.02	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	ND<1	ND<1	ND<1	ND<1	ND<1	2.2	0.0332	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	ND<1	ND<1	ND<1	ND<1	ND<1	1.9	ND<1	0.0133	ND<0.02	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	ND<1	9.8	ND<1	0.0475	0.0229	ND<1	ND<1	ND<1	ND<1
	13-Jan-05	ND<1	ND<1	ND<1	ND<1	ND<1	1.5	2.1	0.0703	0.0326	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	ND<1	ND<1	ND<1	ND<1	4.6	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1
RW-2	15-Mar-05	ND<1	ND<1	ND<1	ND<1	ND<1	2.5	ND<1	0.0285	ND<0.02	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	ND<1	ND<1	ND<1	1.5	ND<1	0.0357	0.0217	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	ND<1	4.0	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	ND<1	ND<1	ND<1	ND<1	ND<1	2.1	ND<1	0.0289	ND<0.02	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	8.7	ND<1	ND<1	ND<1	ND<1	1.1	5.57	0.207	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	5.4	ND<1	ND<1	ND<1	ND<1	3.9	3.77	0.0748	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	4.9	ND<1	ND<1	ND<1	ND<1	3.3	0.343	0.318	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	4.4	ND<1	ND<1	ND<1	ND<1	2.8	5.59	0.224	ND<1	ND<1	ND<1	ND<1	ND<1
	5-May-04	8.2	ND<1	ND<1	ND<1	ND<1	4.7	4.5	0.691	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jun-04	6.5	ND<1	ND<1	ND<1	ND<1	2.0	52.5	1.03	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	12	ND<1	ND<1	ND<1	ND<1	ND<1	3.82	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	10	ND<1	ND<1	ND<1	ND<1	1.5	4.78	0.213	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	11	ND<1	ND<1	ND<1	ND<1	5.21	0.152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	10	ND<1	ND<1	ND<1	ND<1	10.8	0.297	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	25	ND<1	ND<1	ND<1	ND<1	4.81	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	18	ND<1	ND<1	ND<1	ND<1	5.01	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	20	1.1	ND<1	ND<1	ND<1	ND<1	5.28	0.0816	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	5.4	ND<1	ND<1	ND<1	ND<1	4.51	0.128	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jun-05	12.0	ND<1	ND<1	ND<1	ND<1	3.69	0.17	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	7.7	1.1	ND<1	ND<1	ND<1	ND<1	3.5	0.0511	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Aug-05	5.4	ND<1	ND<1	ND<1	ND<1	3.74	0.107	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	16	1.8	ND<1	ND<1	ND<1	ND<1	3.57	0.0704	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	8.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	15	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	12.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	34	2.1	ND<1	ND<1	ND<1	ND<1	4.25	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	5.2	2.0	ND<1	ND<1	ND<1	ND<1	9.15	0.0696	ND<1	ND<1	ND<1	ND<1	ND<1

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled AFAR's	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	MTBE (ug/L)	Chloroform (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloroethane (ug/L)	cis-1,2-Dichloroethene (ug/L)	1,1-Dichloroethylene (ug/L)	Methylene Chloride (ug/L)	Dibromo-chloromethane (ug/L)	Acetone (ug/L) v	
		5	5	5	NE	NE	NE	300	5	5	5	5	5	5	NE	
RW-3	23-Jan-04	2.2	6.9	3.2	ND<1	ND<1	ND<1	1.96	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	11-Feb-04	ND<1	3.6	2.2	ND<1	ND<1	ND<1	1.63	1.43	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Mar-04	1.2	5.0	2.3	ND<1	ND<1	ND<1	3.34	0.542	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	28-Apr-04	1.3	8.8	4.4	ND<1	ND<1	ND<1	3.07	1.32	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	5-May-04	0.9	6.9	3.6	ND<1	ND<1	ND<1	2.07	1.96	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	30-Jun-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.07	1.96	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-04	2.4	6.1	2.6	ND<1	ND<1	ND<1	2.77	0.619	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	26-Aug-04 ***	NM	NM	NM	ND<1	ND<1	ND<1	2.07	1.79	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Sep-04	2.7	8.7	5.0	ND<1	ND<1	ND<1	1.91	0.42	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	2.2	12	5.0	ND<1	ND<1	ND<1	2.09	1.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	1.5	6.5	2.6	ND<1	ND<1	ND<1	1.87	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	3.77	0.489	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.60	2.24	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	1.6	1.3	ND<1	ND<1	ND<1	ND<1	2.10	1.15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	3	13	5.0	ND<1	ND<1	ND<1	1.89	1.36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	ND<1	2.0	ND<1	ND<1	ND<1	ND<1	46.1	0.539	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	2.2	7.7	2.8	ND<1	ND<1	ND<1	1.85	0.82	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	16-Jun-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	9.91	10	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-05	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	2.01	0.649	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	9-Aug-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.50	0.973	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	1	3.6	1.2	ND<1	ND<1	ND<1	2.03	0.71	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Nov-05	1.3	ND<1	ND<1	ND<1	ND<1	ND<1	1.83	0.708	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Dec-05	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	2.11	0.566	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	1.7	7.9	ND<1	ND<1	ND<1	ND<1	1.93	0.455	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	23-Jan-04	270	5.9	ND<1	ND<1	ND<1	ND<1	3.56	0.48	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	11-Feb-04	170	6.9	14.0	ND<1	ND<1	ND<1	3.28	0.353	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Mar-04	170	5.8	4.5	ND<1	ND<1	ND<1	1.61	0.0691	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Apr-04	22	ND<1	ND<1	ND<1	ND<1	ND<1	0.982	0.173	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	5-May-04	470	6.2	7.8	ND<1	ND<1	ND<1	7.08	2.33	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	30-Jun-04	110	3.8	26	ND<1	ND<1	ND<1	4.44	1.11	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-04	110	3.2	29	ND<1	ND<1	ND<1	1.4	5.00	0.157	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Sep-04	120	3.7	18	ND<1	ND<1	ND<1	2.98	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	94	ND<1	14	ND<1	ND<1	ND<1	3.65	0.126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	3-Nov-04	130	4.2	11	ND<1	ND<1	ND<1	4.75	0.205	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	2-May-05	80	2.4	9.8	ND<1	ND<1	ND<1	1.90	1.62	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Dec-04	230	5.7	35	ND<1	ND<1	ND<1	1.90	1.95	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jul-04	160	4.1	7.3	ND<1	ND<1	ND<1	6.11	3.28	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	4-Jan-05	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Feb-05	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	15-Mar-05	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Apr-05	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Sep-05	45	6	ND<1	ND<1	ND<1	ND<1	3.47	0.173	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	19-Oct-05	NM	NM	NM	ND<1	ND<1	ND<1	NM	NM	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	21-Nov-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	3.69	0.0777	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Dec-05	64	2.0	1.5	ND<1	ND<1	ND<1	2.82	0.0302	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	12-Jan-06	15	9.5	ND<1	ND<1	ND<1	ND<1	7.78	0.0412	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	

GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethene (ug/L)	1,1-Dichloro-ethene (ug/L)	Dibromo-chloromethane (ug/L)	Toluene (ug/L)	Acetone (ug/L) ⁱⁱ
	23-Jan-04	14	ND<1	ND<1	0.9	4.0	0.05	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	14	ND<1	ND<1	1.0	6.2	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	14	ND<1	ND<1	1.5	6.1	5.0	0.0852	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	18	ND<1	ND<1	1.5	6.1	0.147	0.015	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-May-04	38	0.8	3.2	1.5	8.0	0.055	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jun-04	17	ND<1	ND<1	4.6	3.9	0.054	0.022	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-5	14-Jul-04	21	ND<1	ND<1	4.6	ND<1	ND<1	3.1	0.0254	0.0265	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1
	15-Sep-04	24	ND<1	ND<1	6.5	ND<1	ND<1	3.2	2.39	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	16	ND<1	ND<1	5.2	ND<1	ND<1	2.4	0.139	0.0163	ND<1	ND<1	ND<1	ND<1	1.4
	3-Nov-04	15	ND<1	ND<1	6.4	ND<1	ND<1	2.2	0.0287	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	28	ND<1	ND<1	28	ND<1	ND<1	ND<1	0.0621	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	12	ND<1	ND<1	5.6	ND<1	ND<1	2.0	0.0269	0.0172	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	11	ND<1	ND<1	4.3	ND<1	ND<1	2.6	0.318	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	14	ND<1	ND<1	4.1	ND<1	ND<1	ND<1	0.0887	0.0187	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	9	ND<1	ND<1	5.7	ND<1	ND<1	ND<1	0.0223	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	13	ND<1	ND<1	4.7	ND<1	ND<1	ND<1	0.0177	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	18	ND<1	ND<1	1.6	ND<1	ND<1	ND<1	0.0358	ND<0.02	ND<1	ND<1	ND<1	ND<1	5.6*
	14-Jul-05	8.2	ND<1	ND<1	3.8	ND<1	ND<1	ND<1	0.0227	0.0303	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Aug-05	2.6	ND<1	ND<1	NM	NM	NM	NM	0.0185	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	8	ND<1	ND<1	3.3	ND<1	ND<1	ND<1	1.7	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	2.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0482	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	ND<1	2.0	ND<1	ND<1	ND<1	0.0468	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	2.3	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0558	0.0119	ND<1	ND<1	ND<1	ND<1	4.6*
	23-Jan-06	160	2.4	ND<1	ND<1	ND<1	ND<1	ND<1	0.0115	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	130	3.3	1.1	ND<1	ND<1	ND<1	ND<1	1.6	0.077	ND<0.02	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	110	2.7	ND<1	ND<1	ND<1	ND<1	ND<1	2.6	0.0116	ND<0.02	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	110	2.9	1.3	ND<1	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	1.8*
	5-May-04	210	4.8	ND<1	ND<1	3.2	ND<1	ND<1	0.719	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jun-04	92	3.6	1.3	ND<1	ND<1	ND<1	ND<1	2.1	0.151	ND<0.02	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	100	2.8	1.2	ND<1	ND<1	ND<1	ND<1	1.7	0.437	ND<0.02	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	15-Sep-04	130	3.3	2.2	ND<1	ND<1	ND<1	ND<1	0.0976	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	94	ND<1	ND<1	1.6	ND<1	ND<1	ND<1	0.214	ND<0.02	ND<1	ND<1	ND<1	ND<1	2.0
	3-Nov-04	94	2.1	2.4	ND<1	ND<1	ND<1	ND<1	0.0111	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	200	3.8	16	ND<1	ND<1	ND<1	ND<1	4.73	0.117	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	86	2.1	3.7	ND<1	ND<1	ND<1	ND<1	2.4	0.0279	ND<0.02	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	110	2.4	7.6	ND<1	ND<1	ND<1	ND<1	0.0294	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	120	2.3	6.6	ND<1	ND<1	ND<1	ND<1	2.7	0.0294	ND<0.02	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	74	ND<1	7.0	ND<1	ND<1	ND<1	ND<1	0.0509	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	96	2.8	8.5	ND<1	ND<1	ND<1	ND<1	4.73	0.0195	ND<0.02	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	69	1.6	13	ND<1	ND<1	ND<1	ND<1	0.067	0.0195	ND<0.02	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	64	1.6	9.5	ND<1	ND<1	ND<1	ND<1	0.0406	ND<0.02	ND<1	ND<1	ND<1	ND<1	7*
	9-Aug-05	49	ND<1	12	ND<1	ND<1	ND<1	ND<1	0.088	0.0366	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	100	1.6	12	ND<1	ND<1	ND<1	ND<1	1.3	0.0143	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	68	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.144	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	100	2.1	20	ND<1	ND<1	ND<1	ND<1	0.139	ND<0.02	ND<1	ND<1	ND<1	ND<1	4.6*
	12-Jan-06	41	1.1	16	ND<1	ND<1	ND<1	ND<1	0.189	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L) 300	Dissolved Iron (mg/L)	1,1-Dichloro-ethane (ug/L)	cis-1,2-Dichloro-ethylene (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L) 5	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L) v	
	23-Jan-04	190	3.7	ND<1	ND<1	ND<1	ND<1	0.0069	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	11-Feb-04	120	2.9	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	8-Mar-04	100	3.0	ND<1	ND<1	ND<1	ND<1	0.0026	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Apr-04	79	2.5	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	5-May-04	130	4.0	ND<1	ND<1	ND<1	ND<1	0.012	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	14-Jun-04	59	2.7	ND<1	ND<1	ND<1	ND<1	0.018	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
RW-7	14-Jul-04	55	2.1	ND<1	ND<1	ND<1	ND<1	0.791	0.017	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
	15-Sep-04	59	2.2	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	
	7-Oct-04	38	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0429	0.0126	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.0214	0.0108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	82	ND<1	4.3	ND<1	ND<1	ND<1	ND<1	0.0272	0.00876	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	37	1.1	ND<1	ND<1	ND<1	ND<1	0.0343	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	45	1.5	ND<1	ND<1	ND<1	ND<1	ND<0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	42	1.5	ND<1	ND<1	ND<1	ND<1	0.0356	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	22	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.107	0.0152	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	30	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.02	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	32	1.0	ND<1	ND<1	ND<1	ND<1	0.0753	0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	32	2.2	ND<1	ND<1	ND<1	ND<1	0.0155	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Aug-05	31	6.2	ND<1	ND<1	ND<1	ND<1	0.0903	0.0409	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	39	3.4	ND<1	ND<1	ND<1	ND<1	0.0452	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
	21-Nov-05	36	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	0.536	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	70	ND<1	12.0	ND<1	ND<1	ND<1	ND<1	0.253	ND<0.02	4.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	26	5.0	ND<1	ND<1	ND<1	ND<1	0.343	ND<0.02	2.2	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	23-Jan-04	16	2.2	4.1	ND<1	ND<1	ND<1	ND<1	0.743	2.72	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	15	2.2	4.7	ND<1	ND<1	ND<1	ND<1	8.74	0.19	4.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Mar-04	22	2.7	4.3	ND<1	ND<1	ND<1	ND<1	11.9	0.23	3.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	14	2.0	6.2	ND<1	ND<1	ND<1	ND<1	10.7	0.14	5.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	5-May-04	27	4.1	8.3	ND<1	ND<1	ND<1	ND<1	8.77	0.21	8.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jun-04	10	2.4	5.8	ND<1	ND<1	ND<1	ND<1	9.15	0.10	4.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04 ***	3	1.0	3.7	ND<1	ND<1	ND<1	ND<1	4.18	0.21	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
	15-Sep-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
	27-Oct-04	4.1	1.0	2.2	ND<1	ND<1	ND<1	ND<1	10.77	0.21	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	5.3	ND<1	4.0	ND<1	ND<1	ND<1	ND<1	10.6	0.271	3.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Dec-04	16	2.9	2.2	ND<1	ND<1	ND<1	ND<1	15.6	0.149	15	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	2.7	ND<1	5.8	ND<1	ND<1	ND<1	ND<1	8.92	2.85	2.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	6.9	1.3	3.9	ND<1	ND<1	ND<1	ND<1	7.06	0.325	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	7.4	ND<1	7.2	ND<1	ND<1	ND<1	ND<1	8.24	ND<0.02	4.7	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	9.0	1.3	4.2	ND<1	ND<1	ND<1	ND<1	7.54	0.075	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	3.5	ND<1	3.5	ND<1	ND<1	ND<1	ND<1	8.89	0.321	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	5.6	ND<1	5.2	ND<1	ND<1	ND<1	ND<1	7.33	0.073	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	2.7	ND<1	5.8	ND<1	ND<1	ND<1	ND<1	7.06	0.325	2.1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	2.6	ND<1	3.4	ND<1	ND<1	ND<1	ND<1	8.33	0.017	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	9-Aug-05	1.8	ND<1	2.9	ND<1	ND<1	ND<1	ND<1	0.24	0.065	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	2.9	ND<1	4.2	ND<1	ND<1	ND<1	ND<1	7.53	0.255	2.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	
	21-Nov-05	1.5	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	7.65	0.106	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	2.4	ND<1	5.0	ND<1	ND<1	ND<1	ND<1	5.19	0.021	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	1.3	ND<1	3.7	ND<1	ND<1	ND<1	ND<1	7.25	0.097	2.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1

**GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK**

RECOVERY WELL WATER QUALITY RESULTS

Recovery Well	Date Sampled	PCE (ug/L)	TCE (ug/L)	TCA (ug/L)	Vinyl Acetate (ug/L)	Chloroform (ug/L)	MTBE (ug/L)	Total Iron (mg/L)	Dissolved Iron (mg/L)	cis-1,2-Dichloro-ethane (ug/L)	1,1-Dichloro-ethene (ug/L)	Methylene Chloride (ug/L)	Toluene (ug/L)	Dibromochloromethane (ug/L)	Acetone (ug/L)
	ARAR's	6	6	5	7	7	5	300	300	5	5	5	5	5	NE
	22-Jan-04	2.3	2.2	13	ND<1	ND<1	0.638	0.029	1.8	ND<1	1.5	ND<1	ND<1	ND<1	ND<1
	11-Feb-04	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1	ND<1
	8-Mar-04	ND<1	2.2	12	ND<1	ND<1	1.24	0.222	3.7	ND<1	1.3	ND<1	ND<1	ND<1	ND<1
	14-Apr-04	5.6	1.7	10	ND<1	ND<1	2.65	1.22	5.9	ND<1	2.0*	ND<1	ND<1	ND<1	ND<1
	5-May-04	3.7	1.7	13	ND<1	ND<1	2.58	1.83	6.7	ND<1	1.7	ND<1	ND<1	ND<1	ND<1
	14-Jun-04	1.8	1.9	8.2	ND<1	ND<1	3.03	1.11	3.0	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-04	3.4	1.3	5.1	ND<1	ND<1	2.6	1.95	1.8	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	26-Aug-04 ***	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	NM	ND<1
	15-Sep-04	3.7	1.0	6.0	ND<1	ND<1	0.049	ND<0.02	1.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	7-Oct-04	3.1	ND<1	5.0	ND<1	ND<1	3.12	0.716	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	3-Nov-04	1.6	ND<1	5.9	ND<1	ND<1	2.97	1.41	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
RW-9	15-Dec-04	1.3	31	ND<1	ND<1	ND<1	2.78	0.497	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	4-Jan-05	ND<1	1.0	6.4	ND<1	ND<1	2.35	1.72	1.6	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Feb-05	ND<1	10	ND<1	ND<1	ND<1	0.0974	ND<0.02	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	15-Mar-05	ND<1	1.4	5.9	ND<1	ND<1	1.55	0.507	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Apr-05	ND<1	ND<1	4.5	ND<1	ND<1	1.59	0.091	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	2-May-05	ND<1	2.9	9.0	ND<1	ND<1	2.89	0.0536	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	16-Jun-05	ND<1	5.8	ND<1	ND<1	ND<1	1.38	0.149	0.9	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	14-Jul-05	3.4	3.1	ND<1	ND<1	ND<1	2.55	0.238	ND<1	ND<1	6.9*	ND<1	ND<1	ND<1	7.3*
	9-Aug-05	ND<1	1.4	ND<1	ND<1	ND<1	0.994	0.9734	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Sep-05	1.2	2.0	ND<1	ND<1	ND<1	3.64	0.161	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	19-Oct-05	NM	NM	NM	ND<1	ND<1	NM	NM	NM	NM	NM	NM	NM	NM	NM
	21-Nov-05	ND<1	ND<1	ND<1	ND<1	ND<1	1.31	0.108	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	8-Dec-05	ND<1	2.9	ND<1	ND<1	ND<1	2.01	0.024	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1	ND<1
	12-Jan-06	ND<1	1.4	ND<1	ND<1	ND<1	2.36	0.0905	ND<1	ND<1	4.9*	ND<1	ND<1	ND<1	ND<1

ND: Not detected

*#: Less than method detection limit
ug/L: Micrograms per liter
-: Not analyzed

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site.
Bold values indicate an exceedance of the ARAR standard established for the site.

PCE: Tetrachloroethylene

TCE: Trichloroethylene

1,1-DCE: 1,1-Dichloroethylene

1,2-DCE: 1,2-Dichloroethene

MTBE: Methyl Tertiary Butyl Ether

NM: Not Measured

ARAR's are chemical specific aquifer restoration goals for ground water at the Former Rowe Industries Superfund Site.

ARAR goal was not established for this compound by the EPA.
*Concentrations with an asterisk following them are due to laboratory contamination.


GRAPHS

GRAPH 1

GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK


EFFLUENT FLOW DATA

(January 1, 2006 through January 31, 2006)

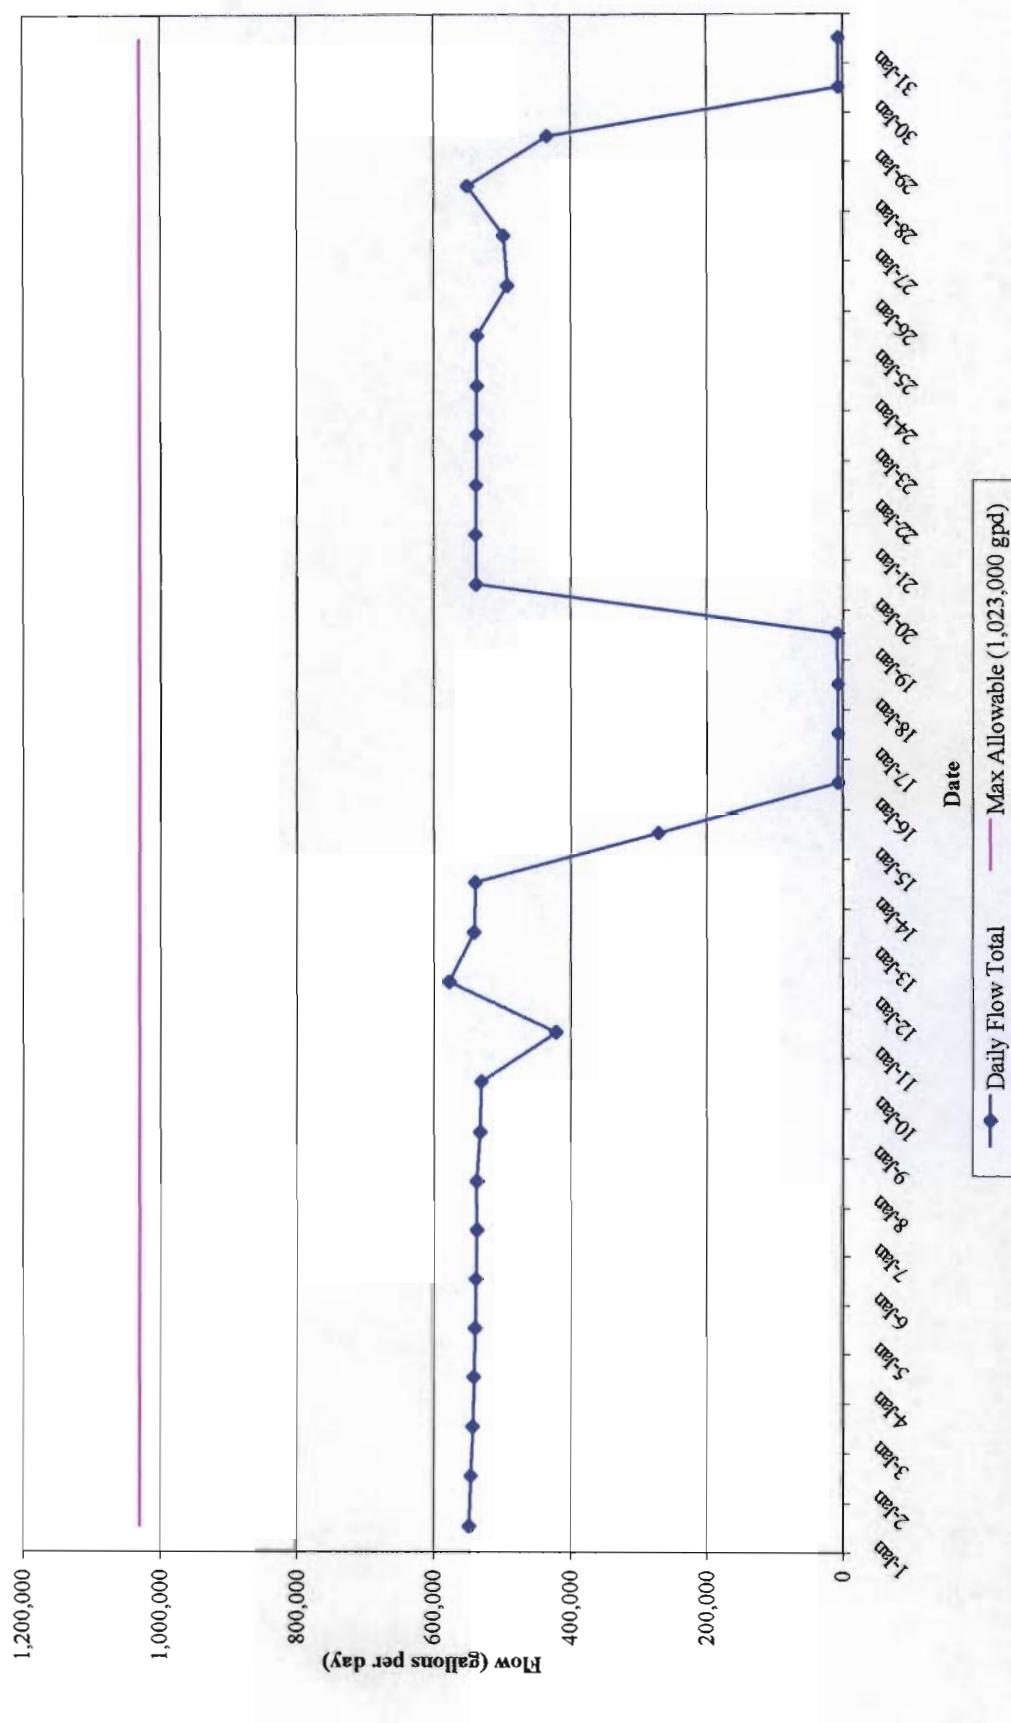


GRAPH 2
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION IN MICROGRAMS PER LITER

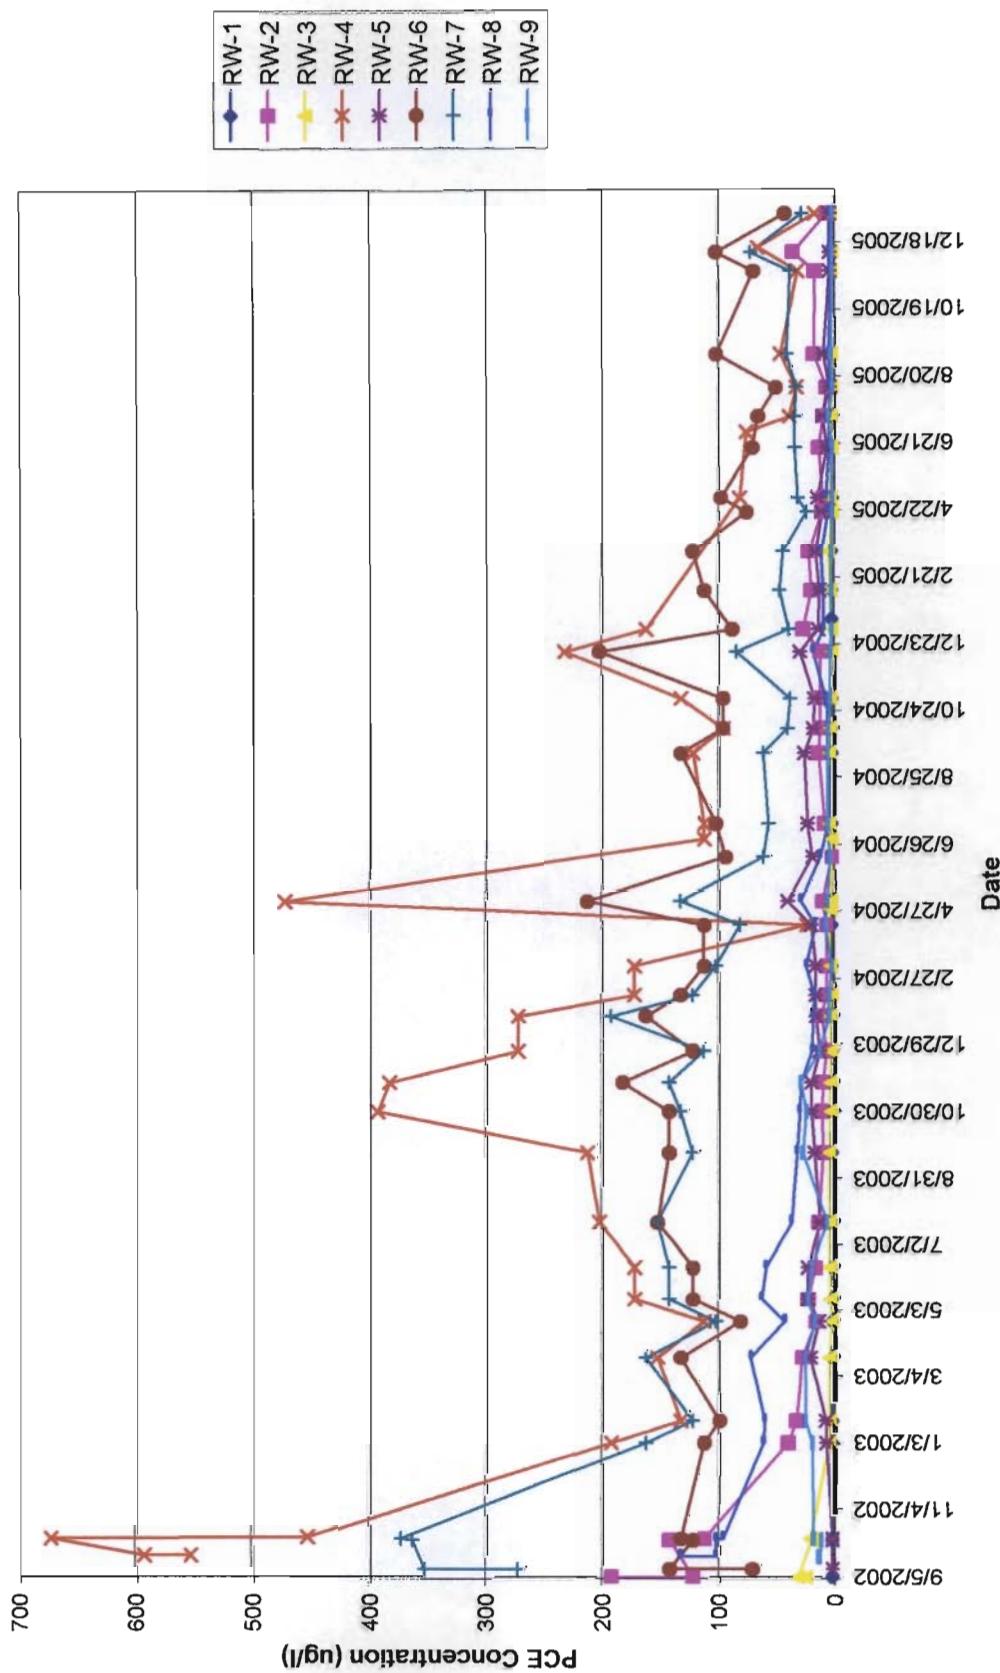

GRAPH 3
GROUND-WATER REMEDIAL ACTION
ROWE INDUSTRIES SUPERFUND SITE
SAG HARBOR, NEW YORK

RECOVERY WELL PCE CONCENTRATION FOR SELECT RECOVERY WELLS

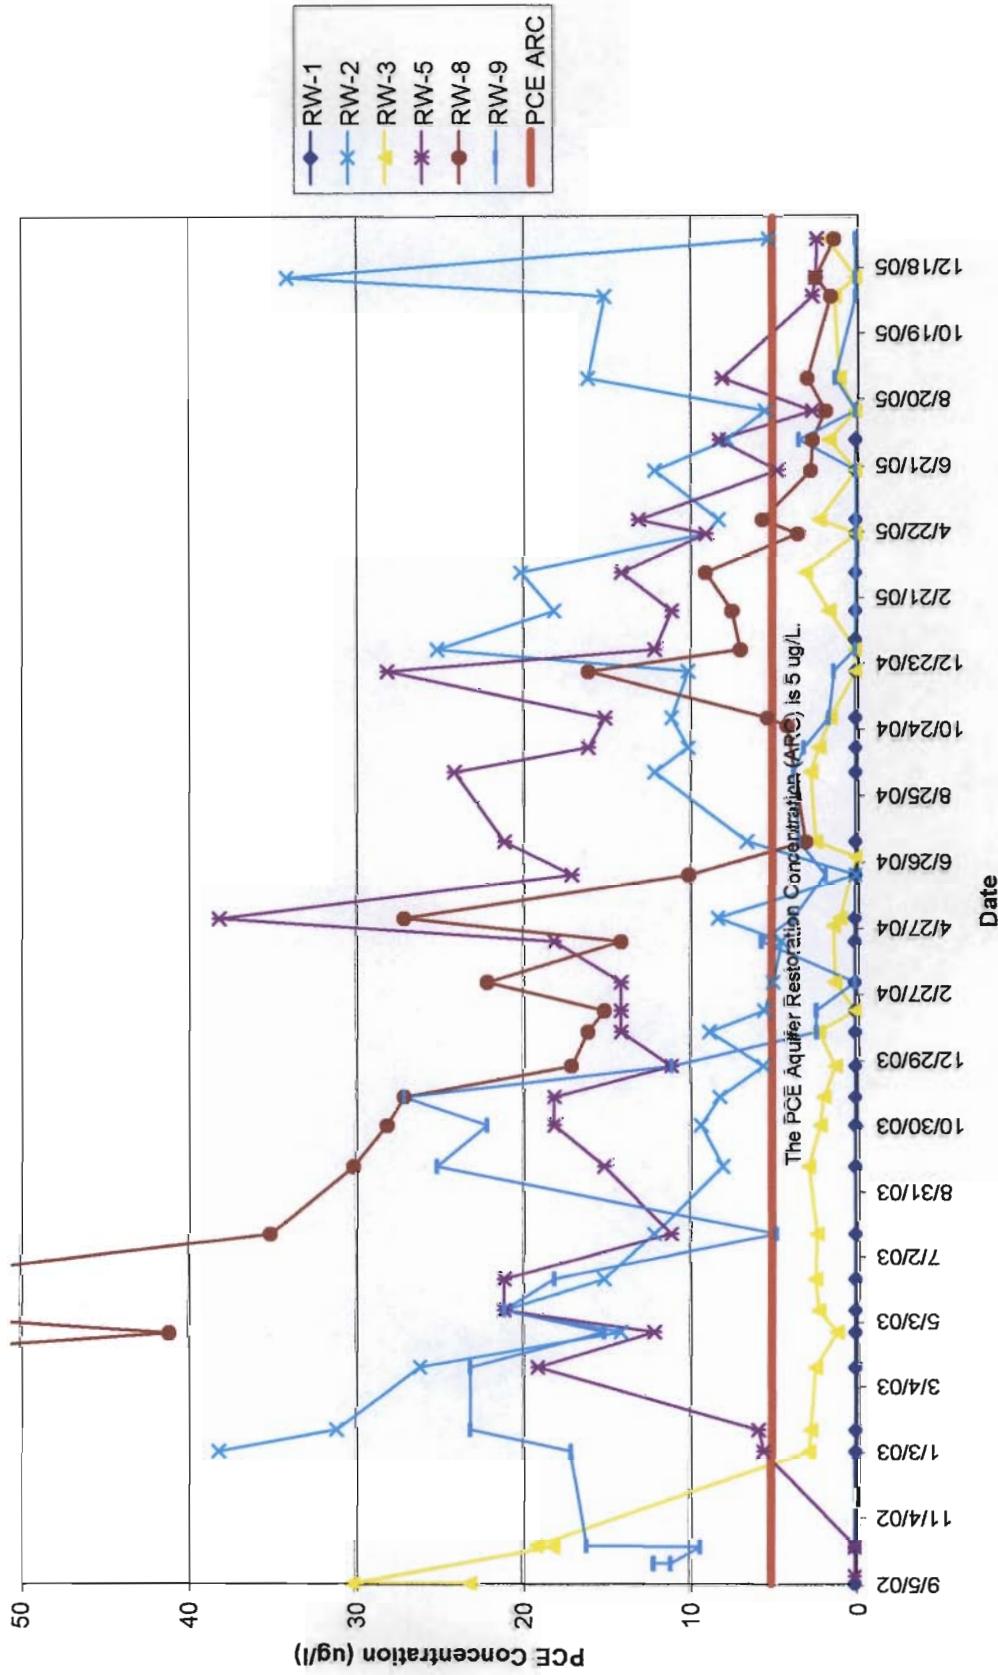

APPENDIX I
JANUARY 2006 LABORATORY ANALYTICAL REPORTS



NYSDOH	11418
NJDEP	NY050
CTDOH	PH-0205
PADEP	68-00573

Wednesday, January 11, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
126 Monroe Turnpike
Trumball, CT 06611

TEL: (203) 452-3110
FAX (203) 452-3111

RE: Rowe Industries-Sag Harbor, N.Y.

Order No.: 0601048

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 1/6/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries-Sag Harbor, N.Y.
Lab Order: 0601048

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0601048-01A	WQ010406:830 NP2-6		1/4/2006	1/6/2006
0601048-01B	WQ010406:830 NP2-6		1/4/2006	1/6/2006
0601048-01C	WQ010406:830 NP2-6		1/4/2006	1/6/2006
0601048-02A	WQ010406:835 NP2-7		1/4/2006	1/6/2006
0601048-02B	WQ010406:835 NP2-7		1/4/2006	1/6/2006
0601048-02C	WQ010406:835 NP2-7		1/4/2006	1/6/2006
0601048-03A	WQ010406:840 NP2-10		1/4/2006	1/6/2006
0601048-03B	WQ010406:840 NP2-10		1/4/2006	1/6/2006
0601048-03C	WQ010406:840 NP2-10		1/4/2006	1/6/2006



NYSDOH ELAP 11418
AIHA PAT, LPAT 15668
OTDRU 51005

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:830 NP2-6
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-01A	Date Received:	1/6/2006

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
				SW8260B		Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1,1-Trichloroethane	5.3	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
2-Butanone	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
2-Hexanone	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Acetone	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Benzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Bromobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Bromoform	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Bromomethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Chloroethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:830 NP2-6
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-01A	Date Received:	1/6/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Chloromethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Dibromomethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/6/2006 4:18:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Methylene chloride	U	1.0	B	µg/L	1	1/6/2006 4:18:00 PM
Naphthalene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
o-Xylene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Styrene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Tetrachloroethene	20	1.0		µg/L	1	1/6/2006 4:18:00 PM
Toluene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Trichloroethene	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/6/2006 4:18:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/6/2006 4:18:00 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:830 NP2-6
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-01B	Date Received:	1/6/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.71	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 1/10/2006 12:25:21 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:830 NP2-6
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-01C	Date Received:	1/6/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.0637	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 1/10/2006 12:23:10 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:835 NP2-7
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-02A	Date Received:	1/6/2006

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
2-Butanone	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
2-Hexanone	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Acetone	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Benzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Bromobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Bromoform	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Bromomethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Chloroethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:835 NP2-7
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-02A	Date Received:	1/6/2006

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Chloromethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Dibromomethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/6/2006 4:54:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Methylene chloride	U	1.0	B	µg/L	1	1/6/2006 4:54:00 PM
Naphthalene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
o-Xylene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Styrene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Toluene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Trichloroethene	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/6/2006 4:54:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/6/2006 4:54:00 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:835 NP2-7		
Lab Order:	0601048	Tag Number:			
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006		
Lab ID:	0601048-02B	Date Received:	1/6/2006		
<hr/>					
Analyses	Result	Limit	Qual Units	DF	Date Analyzed
TOTAL IRON Iron	1.69	E200.7 0.0200	(SW3010A) mg/L	1	Analyst: JP 1/10/2006 12:29:59 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:835 NP2-7
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-02C	Date Received:	1/6/2006
Matrix: LIQUID			
Analyses	Result	Limit	Qual Units DF Date Analyzed
DISSOLVED IRON Iron	0.0878	E200.7 0.0200	(SW3005A) mg/L 1 Analyst: JP 1/10/2006 12:27:36 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E	Value above quantitation range	H Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:840 NP2-10
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-03A	Date Received:	1/6/2006

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
2-Butanone	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
2-Hexanone	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Acetone	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Benzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Bromobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Bromoform	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Bromomethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Chloroethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ010406:840 NP2-10				
Lab Order:	0601048	Tag Number:				
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date: 1/4/2006				
Lab ID:	0601048-03A	Date Received:	1/6/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Chloromethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Dibromomethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/6/2006 5:29:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Methylene chloride	U	1.0	B	µg/L	1	1/6/2006 5:29:00 PM
Naphthalene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
o-Xylene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Styrene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Toluene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Trichloroethene	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/6/2006 5:29:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/6/2006 5:29:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:840 NP2-10
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-03B	Date Received:	1/6/2006

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	23.3	E200.7	0.0200	(SW3010A) mg/L	1	Analyst: JP 1/10/2006 12:35:05 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 11-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ010406:840 NP2-10
Lab Order:	0601048	Tag Number:	
Project:	Rowe Industries-Sag Harbor, N.Y.	Collection Date:	1/4/2006
Lab ID:	0601048-03C	Date Received:	1/6/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.122	0.0200	E200.7	(SW3005A) mg/L	1	Analyst: JP 1/10/2006 12:32:50 PM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	232	1.00	E160.1	mg/L	1	Analyst: VP 1/10/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Monday, January 23, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 452-3100
FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0601197

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 1/17/2006 for the analyses presented in the following report.


Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

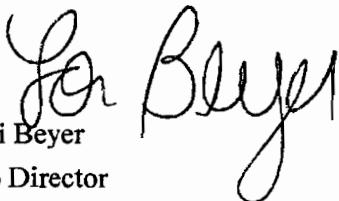
Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0601197

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0601197-01A	WQ011206:930 NP2-6		1/12/2006	1/17/2006
0601197-01B	WQ011206:930 NP2-6		1/12/2006	1/17/2006
0601197-01C	WQ011206:930 NP2-6		1/12/2006	1/17/2006
0601197-02A	WQ011206:935 NP2-7		1/12/2006	1/17/2006
0601197-02B	WQ011206:935 NP2-7		1/12/2006	1/17/2006
0601197-02C	WQ011206:935 NP2-7		1/12/2006	1/17/2006
0601197-03A	WQ011206:940 NP2-10		1/12/2006	1/17/2006
0601197-03B	WQ011206:940 NP2-10		1/12/2006	1/17/2006
0601197-03C	WQ011206:940 NP2-10		1/12/2006	1/17/2006



NYSDOH ELAP 11418
AIHA PAT, LPAT 15668
CTDOH PH-0205

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

V	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ011206:930 NP2-6				
Lab Order:	0601197	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/12/2006				
Lab ID:	0601197-01A	Date Received:	1/17/2006	Matrix: LIQUID		
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1,1-Trichloroethane	3.7	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.					Client Sample ID:	WQ011206:930 NP2-6
Lab Order:	0601197					Tag Number:	
Project:	Rowe Industries					Collection Date:	1/12/2006
Lab ID:	0601197-01A	Date Received:	1/17/2006			Matrix:	LIQUID
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed	
Chloroform	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Chloromethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Dibromomethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 12:26:00 AM	
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Methylene chloride	4.4	1.0	B	µg/L	1	1/18/2006 12:26:00 AM	
Naphthalene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
o-Xylene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Styrene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Tetrachloroethene	10	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Toluene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Trichloroethene	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 12:26:00 AM	

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:930 NP2-6		
Lab Order:	0601197	Tag Number:			
Project:	Rowe Industries	Collection Date:	1/12/2006		
Lab ID:	0601197-01B	Date Received:	1/17/2006		
<hr/>					
Analyses	Result	Limit	Qual Units	DF	Date Analyzed
TOTAL IRON Iron	18.6	E200.7 0.0200	(SW3010A) mg/L	1	Analyst: JP 1/20/2006 3:45:33 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:930 NP2-6		
Lab Order:	0601197	Tag Number:			
Project:	Rowe Industries	Collection Date:	1/12/2006		
Lab ID:	0601197-01C	Date Received:	1/17/2006		
<hr/>					
Analyses	Result	Limit	Qual Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.0607	E200.7 0.0200	(SW3005A) mg/L	1	Analyst: JP 1/20/2006 3:43:01 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ011206:935 NP2-7				
Lab Order:	0601197	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/12/2006				
Lab ID:	0601197-02A	Date Received:	1/17/2006	Matrix: LIQUID		
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1		SW8260B				Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1,1-Trichloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1,2,2-Tetrachloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1,2-Trichloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1-Dichloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1-Dichloroethene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,1-Dichloropropene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2,3-Trichlorobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2,3-Trichloropropane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2,4-Trichlorobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2,4-Trimethylbenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2-Dibromo-3-chloropropane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2-Dibromoethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2-Dichlorobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2-Dichloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,2-Dichloropropane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,3,5-Trimethylbenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,3-Dichlorobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,3-dichloropropane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
1,4-Dichlorobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
2,2-Dichloropropane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
2-Butanone	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
2-Chloroethyl vinyl ether	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
2-Chlorotoluene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
2-Hexanone	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
4-Chlorotoluene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
4-Isopropyltoluene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
4-Methyl-2-pentanone	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Acetone	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Benzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Bromobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Bromochloromethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Bromodichloromethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Bromoform	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Bromomethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Carbon disulfide	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Carbon tetrachloride	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Chlorobenzene	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	
Chloroethane	U	1.0	µg/L	1	1/18/2006 2:12:00 AM	

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:935 NP2-7
Lab Order:	0601197	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601197-02A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 2:12:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Methylene chloride	4.6	1.0	B	µg/L	1	1/18/2006 2:12:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Tetrachloroethene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Trichloroethene	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 2:12:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 2:12:00 AM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	B	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:935 NP2-7			
Lab Order:	0601197	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/12/2006			
Lab ID:	0601197-02B	Date Received:	1/17/2006			
Matrix: LIQUID						
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.08	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 1/20/2006 4:19:46 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:935 NP2-7			
Lab Order:	0601197	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/12/2006			
Lab ID:	0601197-02C	Date Received:	1/17/2006			
<hr/>						
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.220	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 1/20/2006 4:07:19 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	I	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:940 NP2-10
Lab Order:	0601197	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601197-03A	Date Received:	1/17/2006

Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT: Leggette Brashears & Graham Inc. **Client Sample ID:** WQ011206:940 NP2-10
Lab Order: 0601197 **Tag Number:**
Project: Rowe Industries **Collection Date:** 1/12/2006
Lab ID: 0601197-03A **Date Received:** 1/17/2006 **Matrix:** LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 2:47:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Methylene chloride	4.3	1.0	B	µg/L	1	1/18/2006 2:47:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Tetrachloroethene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Trichloroethene	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 2:47:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 2:47:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:940 NP2-10		
Lab Order:	0601197	Tag Number:			
Project:	Rowe Industries	Collection Date:	1/12/2006		
Lab ID:	0601197-03B	Date Received:	1/17/2006		
Matrix: LIQUID					
Analyses	Result	Limit	Qual Units	DF	Date Analyzed
TOTAL IRON Iron	2.16	E200.7 0.0200	(SW3010A) mg/L	1	Analyst: JP 1/20/2006 4:13:25 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011206:940 NP2-10
Lab Order:	0601197	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601197-03C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.0953	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 1/20/2006 4:15:47 PM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	100	E160.1 1.00		mg/L	1	Analyst: VP 1/18/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected



NYSDOH 11418
NJDEP NY050
CTDOH PH-0205
PADEP 68-00573

Thursday, January 26, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 452-3100
FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0601238

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 1/20/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,


Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0601238

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0601238-01A	WQ011906:1000 NP2-6		1/19/2006	1/20/2006
0601238-01B	WQ011906:1000 NP2-6		1/19/2006	1/20/2006
0601238-01C	WQ011906:1000 NP2-6		1/19/2006	1/20/2006
0601238-02A	WQ011906:1005 NP2-7		1/19/2006	1/20/2006
0601238-02B	WQ011906:1005 NP2-7		1/19/2006	1/20/2006
0601238-02C	WQ011906:1005 NP2-7		1/19/2006	1/20/2006
0601238-03A	WQ011906:1010 NP2-10		1/19/2006	1/20/2006
0601238-03B	WQ011906:1010 NP2-10		1/19/2006	1/20/2006
0601238-03C	WQ011906:1010 NP2-10		1/19/2006	1/20/2006



NYSDOH ELAP 11418
AIHA PAT, LPAT 15668
CTDOH PH-0205

56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ011906:1000 NP2-6				
Lab Order:	0601238	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/19/2006				
Lab ID:	0601238-01A	Date Received:	1/20/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1,1-Trichloroethane	4.1	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1-Dichloroethane	1.2	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
2-Butanone	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
2-Hexanone	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Acetone	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Benzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Bromobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Bromoform	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Bromomethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Chloroethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.		Client Sample ID: WQ011906:1000 NP2-6			
Lab Order:	0601238		Tag Number:			
Project:	Rowe Industries		Collection Date: 1/19/2006			
Lab ID:	0601238-01A	Date Received: 1/20/2006	Matrix: LIQUID			
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Chloromethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Dibromomethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/20/2006 4:56:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Methylene chloride	U	1.0	B	µg/L	1	1/20/2006 4:56:00 PM
Naphthalene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
o-Xylene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Styrene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Tetrachloroethene	18	1.0		µg/L	1	1/20/2006 4:56:00 PM
Toluene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Trichloroethene	1.4	1.0		µg/L	1	1/20/2006 4:56:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/20/2006 4:56:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/20/2006 4:56:00 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
E	Value above quantitation range	H Holding times for preparation or analysis exceeded
J	Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1000 NP2-6
Lab Order:	0601238	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/19/2006
Lab ID:	0601238-01B	Date Received:	1/20/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	6.50	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 1/20/2006 4:35:00 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1000 NP2-6		
Lab Order:	0601238	Tag Number:			
Project:	Rowe Industries	Collection Date:	1/19/2006		
Lab ID:	0601238-01C	Date Received:	1/20/2006		
<hr/>					
Analyses	Result	Limit	Qual Units	DF	Date Analyzed

DISSOLVED IRON		E200.7	(SW3005A)		Analyst: JP
Iron	0.352	0.0200	mg/L	1	1/20/2006 4:32:55 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ011906:1005 NP2-7				
Lab Order:	0601238	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/19/2006				
Lab ID:	0601238-02A	Date Received:	1/20/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1,1-Trichloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1,2,2-Tetrachloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1,2-Trichloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1-Dichloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1-Dichloroethene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,1-Dichloropropene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2,3-Trichlorobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2,3-Trichloropropane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2,4-Trichlorobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2,4-Trimethylbenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2-Dibromo-3-chloropropane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2-Dibromoethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2-Dichlorobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2-Dichloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,2-Dichloropropane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,3,5-Trimethylbenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,3-Dichlorobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,3-dichloropropane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
1,4-Dichlorobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
2,2-Dichloropropane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
2-Butanone	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
2-Chloroethyl vinyl ether	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
2-Chlorotoluene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
2-Hexanone	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
4-Chlorotoluene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
4-Isopropyltoluene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
4-Methyl-2-pentanone	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Acetone	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Benzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Bromobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Bromochloromethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Bromodichloromethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Bromoform	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Bromomethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Carbon disulfide	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Carbon tetrachloride	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Chlorobenzene	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	
Chloroethane	U	1.0	μg/L	1	1/20/2006 5:31:00 PM	

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ011906:1005 NP2-7				
Lab Order:	0601238	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/19/2006				
Lab ID:	0601238-02A	Date Received:	1/20/2006	Matrix:	LIQUID	
<hr/>						
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Chloromethane	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Dibromomethane	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/20/2006 5:31:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Methylene chloride	U	1.0	B	µg/L	1	1/20/2006 5:31:00 PM
Naphthalene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
o-Xylene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Styrene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Toluene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Trichloroethene	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/20/2006 5:31:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/20/2006 5:31:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1005 NP2-7
Lab Order:	0601238	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/19/2006
Lab ID:	0601238-02B	Date Received:	1/20/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON		E200.7		(SW3010A)		
Iron	52.2	0.0200		mg/L	1	Analyst: JP 1/20/2006 4:39:53 PM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1005 NP2-7
Lab Order:	0601238	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/19/2006
Lab ID:	0601238-02C	Date Received:	1/20/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	5.05	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 1/20/2006 4:37:12 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ011906:1010 NP2-10				
Lab Order:	0601238	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/19/2006				
Lab ID:	0601238-03A	Date Received:	1/20/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
2-Butanone	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
2-Hexanone	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Acetone	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Benzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Bromobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Bromoform	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Bromomethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Chloroethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1010 NP2-10
Lab Order:	0601238	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/19/2006
Lab ID:	0601238-03A	Date Received:	1/20/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Chloromethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Dibromomethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/20/2006 6:06:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Methylene chloride	U	1.0	B	µg/L	1	1/20/2006 6:06:00 PM
Naphthalene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
o-Xylene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Styrene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Toluene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Trichloroethene	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/20/2006 6:06:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/20/2006 6:06:00 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1010 NP2-10
Lab Order:	0601238	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/19/2006
Lab ID:	0601238-03B	Date Received:	1/20/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	82.7	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 1/20/2006 4:46:08 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

Page 11 of 12

American Analytical Laboratories, LLC.**Date:** 26-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ011906:1010 NP2-10
Lab Order:	0601238	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/19/2006
Lab ID:	0601238-03C	Date Received:	1/20/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	11.7	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 1/20/2006 4:43:41 PM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	134	E160.1 1.00		mg/L	1	Analyst: VP 1/24/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected



NYSDOH	11418
NJDEP	NY050
CTDOH	PH-0205
PADEP	68-00573

Friday, February 03, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484
TEL: (203) 929-8555
FAX (203) 926-9140

RE: Rowe Industries

Order No.: 0601303

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 3 sample(s) on 1/27/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

A handwritten signature in black ink, appearing to read "Lori Beyer".

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0601303

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0601303-01A	WQ012506:800 NP2-6		1/25/2006	1/27/2006
0601303-01B	WQ012506:800 NP2-6		1/25/2006	1/27/2006
0601303-01C	WQ012506:800 NP2-6		1/25/2006	1/27/2006
0601303-02A	WQ012506:805 NP2-7		1/25/2006	1/27/2006
0601303-02B	WQ012506:805 NP2-7		1/25/2006	1/27/2006
0601303-02C	WQ012506:805 NP2-7		1/25/2006	1/27/2006
0601303-03A	WQ012506:810 NP2-10		1/25/2006	1/27/2006
0601303-03B	WQ012506:810 NP2-10		1/25/2006	1/27/2006
0601303-03C	WQ012506:810 NP2-10		1/25/2006	1/27/2006



NYSDOH	ELAP	11418
AIHA	PAT, LPAT	15668
CTDOH	PH-0205	

ES 56 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027 CTDOH

CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

566 TOLEDO STREET • FARMINGDALE, NY 11735 • (516) 454-6100 • FAX (516) 454-8027

卷之三

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:800 NP2-6
Lab Order:	0601303	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/25/2006
Lab ID:	0601303-01A	Date Received:	1/27/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: SB
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1,1-Trichloroethane	4.6	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
2-Butanone	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
2-Hexanone	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Acetone	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Benzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Bromobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Bromoform	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Bromomethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Chloroethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level

E Value above quantitation range

J Analyte detected below quantitation limits

S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank

H Holding times for preparation or analysis exceeded

ND Not Detected at the Reporting Limit

U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:800 NP2-6
Lab Order:	0601303	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/25/2006
Lab ID:	0601303-01A	Date Received:	1/27/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Chloromethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Dibromomethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/31/2006 9:37:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Methylene chloride	25	1.0	B	µg/L	1	1/31/2006 9:37:00 AM
Naphthalene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
o-Xylene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Styrene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Tetrachloroethene	11	1.0		µg/L	1	1/31/2006 9:37:00 AM
Toluene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Trichloroethene	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/31/2006 9:37:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/31/2006 9:37:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level

B Analyte detected in the associated Method Blank

E Value above quantitation range

H Holding times for preparation or analysis exceeded

J Analyte detected below quantitation limits

ND Not Detected at the Reporting Limit

S Spike Recovery outside accepted recovery limits

U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.**Date: 03-Feb-06**

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:800 NP2-6			
Lab Order:	0601303	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/25/2006			
Lab ID:	0601303-01B	Date Received:	1/27/2006			
Matrix: LIQUID						
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	2.41	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 2/1/2006 4:20:30 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:800 NP2-6		
Lab Order:	0601303	Tag Number:			
Project:	Rowe Industries	Collection Date:	1/25/2006		
Lab ID:	0601303-01C	Date Received:	1/27/2006		
Matrix: LIQUID					
Analyses	Result	Limit	Qual Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.0711	E200.7 0.0200	(SW3005A) mg/L	1	Analyst: JP 2/1/2006 4:18:10 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.			Client Sample ID: WQ012506:805 NP2-7		
Lab Order:	0601303			Tag Number:		
Project:	Rowe Industries			Collection Date: 1/25/2006		
Lab ID:	0601303-02A	Date Received:	1/27/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: SB
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
2-Butanone	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
2-Hexanone	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Acetone	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Benzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Bromobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Bromoform	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Bromomethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Chloroethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: WQ012506:805 NP2-7				
Lab Order:	0601303	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/25/2006				
Lab ID:	0601303-02A	Date Received:	1/27/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Chloromethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Dibromomethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/31/2006 11:27:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Methylene chloride	20	1.0	B	µg/L	1	1/31/2006 11:27:00 AM
Naphthalene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
o-Xylene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Styrene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Tetrachloroethene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Toluene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Trichloroethene	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/31/2006 11:27:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/31/2006 11:27:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:805 NP2-7
Lab Order:	0601303	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/25/2006
Lab ID:	0601303-02B	Date Received:	1/27/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	1.92	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 2/1/2006 4:26:02 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:805 NP2-7			
Lab Order:	0601303	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/25/2006			
Lab ID:	0601303-02C	Date Received:	1/27/2006			
Matrix: LIQUID						
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.108	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 2/1/2006 4:23:14 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected
				Page 8 of 12

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:810 NP2-10
Lab Order:	0601303	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/25/2006
Lab ID:	0601303-03A	Date Received:	1/27/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: SB
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1-Dichloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1-Dichloroethene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,1-Dichloropropene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2-Dibromoethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2-Dichloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,2-Dichloropropane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,3-dichloropropane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
2,2-Dichloropropane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
2-Butanone	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
2-Chlorotoluene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
2-Hexanone	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
4-Chlorotoluene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
4-Isopropyltoluene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Acetone	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Benzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Bromobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Bromochloromethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Bromodichloromethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Bromoform	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Bromomethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Carbon disulfide	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Carbon tetrachloride	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Chlorobenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Chloroethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM

Qualifiers: * Value exceeds Maximum Contaminant Level

E Value above quantitation range

J Analyte detected below quantitation limits

S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank

H Holding times for preparation or analysis exceeded

ND Not Detected at the Reporting Limit

U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:810 NP2-10
Lab Order:	0601303	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/25/2006
Lab ID:	0601303-03A	Date Received:	1/27/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Chloromethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Dibromochloromethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Dibromomethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Ethylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Hexachlorobutadiene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Isopropylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
m,p-Xylene	U	2.0		µg/L	1	1/31/2006 12:03:00 PM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Methylene chloride	19	1.0	B	µg/L	1	1/31/2006 12:03:00 PM
Naphthalene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
n-Butylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
n-Propylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
o-Xylene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
sec-Butylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Styrene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
tert-Butylbenzene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Tetrachloroethene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Toluene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Trichloroethene	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Trichlorofluoromethane	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Vinyl acetate	U	1.0		µg/L	1	1/31/2006 12:03:00 PM
Vinyl chloride	U	1.0		µg/L	1	1/31/2006 12:03:00 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.**Date: 03-Feb-06**

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:810 NP2-10			
Lab Order:	0601303	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/25/2006			
Lab ID:	0601303-03B	Date Received:	1/27/2006			
Analyses		Matrix:	LIQUID			
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON Iron	8.79	E200.7 0.0200		(SW3010A) mg/L	1	Analyst: JP 2/1/2006 4:31:24 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 03-Feb-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	WQ012506:810 NP2-10
Lab Order:	0601303	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/25/2006
Lab ID:	0601303-03C	Date Received:	1/27/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON Iron	0.103	E200.7 0.0200		(SW3005A) mg/L	1	Analyst: JP 2/1/2006 4:28:52 PM
TOTAL DISSOLVED SOLIDS Total Dissolved Solids (Residue, Filterable)	132	E160.1 1.00		mg/L	1	Analyst: VP 2/1/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected



NYSDOH	11418
NJDEP	NY050
CTDOH	PH-0205
PADEP	68-00573

Monday, January 23, 2006

Mark Goldberg
Leggette Brashears & Graham Inc.
4 Research Drive
Suite 301
Shelton, CT 06484

TEL: (203) 452-3100
FAX (203) 452-3111

RE: Rowe Industries

Order No.: 0601196

Dear Mark Goldberg:

American Analytical Laboratories, LLC. received 8 sample(s) on 1/17/2006 for the analyses presented in the following report.

Samples were analyzed in accordance with the test procedures documented on the chain of custody and detailed throughout the text of this report.

The limits provided in the data package are analytical reporting limits and not Federal or Local mandated values to which the sample results should be compared.

There were no problems with the analyses and all data for associated QC met laboratory specifications.

If you have any questions regarding these tests results, please do not hesitate to call (631) 454-6100 or email me directly at lbeyer@american-analytical.com.

Sincerely,

A handwritten signature in black ink, appearing to read "Lori Beyer".

Lori Beyer
Lab Director

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT: Leggette Brashears & Graham Inc.
Project: Rowe Industries
Lab Order: 0601196

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Tag Number	Collection Date	Date Received
0601196-01A	GWQ011206:800 NP1-1-2		1/12/2006	1/17/2006
0601196-01B	GWQ011206:800 NP1-1-2		1/12/2006	1/17/2006
0601196-01C	GWQ011206:800 NP1-1-2		1/12/2006	1/17/2006
0601196-01D	GWQ011206:800 NP1-1-2		1/12/2006	1/17/2006
0601196-02A	GWQ011206:810 NP1-1-3		1/12/2006	1/17/2006
0601196-02B	GWQ011206:810 NP1-1-3		1/12/2006	1/17/2006
0601196-02C	GWQ011206:810 NP1-1-3		1/12/2006	1/17/2006
0601196-02D	GWQ011206:810 NP1-1-3		1/12/2006	1/17/2006
0601196-03A	GWQ011206:820 NP1-1-4		1/12/2006	1/17/2006
0601196-03B	GWQ011206:820 NP1-1-4		1/12/2006	1/17/2006
0601196-03C	GWQ011206:820 NP1-1-4		1/12/2006	1/17/2006
0601196-03D	GWQ011206:820 NP1-1-4		1/12/2006	1/17/2006
0601196-04A	GWQ011206:830 NP1-1-5		1/12/2006	1/17/2006
0601196-04B	GWQ011206:830 NP1-1-5		1/12/2006	1/17/2006
0601196-04C	GWQ011206:830 NP1-1-5		1/12/2006	1/17/2006
0601196-04D	GWQ011206:830 NP1-1-5		1/12/2006	1/17/2006
0601196-05A	GWQ011206:840 NP1-1-6		1/12/2006	1/17/2006
0601196-05B	GWQ011206:840 NP1-1-6		1/12/2006	1/17/2006
0601196-05C	GWQ011206:840 NP1-1-6		1/12/2006	1/17/2006
0601196-05D	GWQ011206:840 NP1-1-6		1/12/2006	1/17/2006
0601196-06A	GWQ011206:850 NP1-1-7		1/12/2006	1/17/2006
0601196-06B	GWQ011206:850 NP1-1-7		1/12/2006	1/17/2006
0601196-06C	GWQ011206:850 NP1-1-7		1/12/2006	1/17/2006
0601196-06D	GWQ011206:850 NP1-1-7		1/12/2006	1/17/2006
0601196-07A	GWQ011206:900 NP1-1-8		1/12/2006	1/17/2006
0601196-07B	GWQ011206:900 NP1-1-8		1/12/2006	1/17/2006
0601196-07C	GWQ011206:900 NP1-1-8		1/12/2006	1/17/2006
0601196-07D	GWQ011206:900 NP1-1-8		1/12/2006	1/17/2006
0601196-08A	GWQ011206:910 NP1-1-9		1/12/2006	1/17/2006
0601196-08B	GWQ011206:910 NP1-1-9		1/12/2006	1/17/2006
0601196-08C	GWQ011206:910 NP1-1-9		1/12/2006	1/17/2006
0601196-08D	GWQ011206:910 NP1-1-9		1/12/2006	1/17/2006



CHAIN OF CUSTODY / REQUEST FOR ANALYSIS DOCUMENT

11418
15668
ELAP
PAT, LPAT
PH-0205

NYSDOH
AIHA
CTDOH

11418
15668

LAP
PAT, LPAT
H-0205

CLIENT NAME/ADDRESS

L^{βC}
126 Monroe Turnpike
Tremont, CT 06661

PROJECT LOCATION:

PROJECT LOCATION:		CONTACT:		SAMPLED (SIGNATURE)		DATE		TIME		SAMPLE(S) SEALED		P.O.#	
				<i>Mark Goldberg</i>		<i>1/16/06</i>		<i>7:00</i>		<input checked="" type="checkbox"/> NO		<input checked="" type="checkbox"/> NO	
CLIENT NAME/ADDRESS		PROJECT LOCATION:		SAMPLER NAME (PRINT)		Robert		Drew		CORRECT CONTAINER(S)			
L-BG 126 Moore Turnpike Trumbull, CT 06611		Rowe		ANALYSIS REQUIRED		8260 MTBE		104-1-D35 M3		Hordelus		LRL-6161-14	
LABORATORY ID #	MATRIX	TYPE	PRES.	SAMPLE # - LOCATION		GuQ0112061800 NPI-1-2		X X X X X X		X X X X X X			
12601196-1ABCD	L			:810 NPI-1-3		:820 NPI-1-4		:830 NPI-1-5		:840 NPI-1-6			
2ABCD				:850 NPI-1-7		:900 NPI-1-8		:910 NPI-1-9		:920 NPI-1-10			
3ABCD													
4ABCD													
5ABCD													
6ABCD													
7ABCD													
8ABCD													
REMARKS / INSTRUCTIONS													
MATRIX		S=SOIL; L=LIQUID; SL=SLUDGE; A=AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL		TURNAROUND REQUIRED:		NORMAL		STATO		BY		RECEIVED BY LAB (SIGNATURE)	
TYPE		G=GRAB; C=COMPOSITE; SS=SPLIT SPOON										DATE <i>1/17/06</i>	
RELINQUISHED BY (SIGNATURE)		DATE <i>1/16/06</i> TIME <i>7:00</i>		PRINTED NAME <i>Robert Drew</i>		RECEIVED BY LAB (SIGNATURE)		TIME		PRINTED NAME <i>John J. Moton, Jr.</i>			
RELINQUISHED BY (SIGNATURE)		DATE		PRINTED NAME		RECEIVED BY LAB (SIGNATURE)		DATE		PRINTED NAME			
		TIME											

MATRIX S=SOIL; L=LIQUID; SL=SLUDGE; A=AIR; W=WIPE; P=PAINT CHIPS; B=BULK MATERIAL

TURNAROUND REQUIRED:

COMMENTS / INSTRUCTIONS

TYPE	G=GRAB; C=COMPOSITE, SS=SPLIT SPOON			RECEIVED BY LAB (SIGNATURE)	DATE	TIME	PRINTED NAME
RELINQUISHED BY (SIGNATURE)	DATE 1/6/06	PRINTED NAME R. B. Drew	NORMAL	STATO BY <i>R.B.</i>	1/1/06	11:35	<i>John J. Antonis</i>
RELINQUISHED BY (SIGNATURE)	DATE 1/6/06	PRINTED NAME	RECEIVED BY LAB (SIGNATURE)	DATE	TIME	PRINTED NAME	

WHITE-OFFICE / CANARY-LAB / PINK-SAMPLE CUSTODIAN / GOLDENROD-CLIENT

AMERICAN ANALYTICAL LABORATORIES, LLC
56 TOLEDO STREET
FARMINGDALE, NEW YORK 11735
TELEPHONE: (631) 454-6100 FAX: (631) 454-8027

DATA REPORTING QUALIFIERS

For reporting results, the following "Results Qualifiers" are used:

Value	If the result is greater than or equal to the detection limit, report the value
U	Indicates the compound was analyzed for but was not detected. Report the minimum detection limit for the sample with the U, i.e. "10U". This is not necessarily the instrument detection limit attainable for this particular sample based on any concentration or dilution that may have been required.
J	Indicates an estimated value. The flag is used: (1) When estimating a concentration for a tentatively identified compound (library search hits, where a 1:1 response is assumed.) (2) When the mass spectral data indicated the identification, however the result was less than the specified detection limit greater than zero. If the detection limit was 10ug/L and a concentration of 3ug/L was calculated report as 3J. This flag is used when similar situations arise on any organic parameter i.e. Pesticide, PCBs and others.
B	Indicates the analyte was found in the blank as well as the sample report "10B".
E	Indicates the analytes concentration exceeds the calibrated range of the instrument for that specific analysis.
D	This flag identifies all compounds identified in an analysis at a secondary dilution factor.
P	This flag is used for Pesticide / PCB target analyte when there is >25% difference for detected concentrations between the two GC Columns. The higher of the two values is reported on Form I and flagged with a "P".
N	This flag indicates presumptive evidence of a compound. This is only used for tentatively identified compounds (TICs), where the identification is based on a mass spectral library search. It applies to all TIC results. For generic characterization of a TIC, such as chlorinated hydrocarbon, the flag is not used.
H	Indicates sample was received and/or analyzed outside of The method allowable holding time

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:800 NP1-1-2
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-01A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1						
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1,1-Trichloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:800 NP1-1-2
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-01A	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
cis-1,2-Dichloroethene	5.0	1.0		µg/L	1	1/18/2006 3:24:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 3:24:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Methylene chloride	4.8	1.0	B	µg/L	1	1/18/2006 3:24:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Tetrachloroethene	5.2	1.0		µg/L	1	1/18/2006 3:24:00 AM
Toluene	1.0	1.0		µg/L	1	1/18/2006 3:24:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Trichloroethene	2.0	1.0		µg/L	1	1/18/2006 3:24:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 3:24:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 3:24:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:800 NP1-1-2
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-01B	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	9.15	0.0200		mg/L	1	1/20/2006 2:38:23 PM
Manganese	0.840	0.0200		mg/L	1	1/20/2006 2:38:23 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:800 NP1-1-2
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-01C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0696	0.0200		mg/L	1	1/20/2006 2:36:13 PM
Manganese	0.674	0.0200		mg/L	1	1/20/2006 2:36:13 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	126	1.00		mg/L	1	1/18/2006

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.**Date: 23-Jan-06**

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:800 NP1-1-2
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-01D	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed	Analyst:
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	50.6	1.00		mg/L	1	1/20/2006	JP
TURBIDITY Turbidity	3.10	1.00	H	NTU	1	1/17/2006	KK

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.			Client Sample ID:	GWQ011206:810 NP1-1-3	
Lab Order:	0601196			Tag Number:		
Project:	Rowe Industries			Collection Date:	1/12/2006	
Lab ID:	0601196-02A	Date Received:	1/17/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1,1-Trichloroethane	7.9	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

Page 6 of 40

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:810 NP1-1-3
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-02A	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 4:03:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Methylene chloride	4.6	1.0	B	µg/L	1	1/18/2006 4:03:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Tetrachloroethene	1.7	1.0		µg/L	1	1/18/2006 4:03:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Trichloroethene	17	1.0		µg/L	1	1/18/2006 4:03:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 4:03:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 4:03:00 AM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
E	Value above quantitation range	H Holding times for preparation or analysis exceeded
J	Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:810 NP1-1-3
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-02B	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	1.93	0.0200		mg/L	1	1/20/2006 2:42:29 PM
Manganese	0.114	0.0200		mg/L	1	1/20/2006 2:42:29 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

Page 8 of 40

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ01I206:810 NPI-1-3
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-02C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.455	0.0200		mg/L	1	1/20/2006 2:40:26 PM
Manganese	0.107	0.0200		mg/L	1	1/20/2006 2:40:26 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	114	1.00		mg/L	1	1/18/2006

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:810 NP1-1-3
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-02D	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	41.0	1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	1.70	1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:820 NP1-1-4			
Lab Order:	0601196	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/12/2006			
Lab ID:	0601196-03A	Date Received:	1/17/2006			
		Matrix:	LIQUID			
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1,1-Trichloroethane	9.5	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:820 NP1-1-4
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-03A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 4:39:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Methylene chloride	5.2	1.0	B	µg/L	1	1/18/2006 4:39:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Tetrachloroethene	15	1.0		µg/L	1	1/18/2006 4:39:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Trichloroethene	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 4:39:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 4:39:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:820 NP1-1-4
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-03B	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	7.78	0.0200		mg/L	1	1/20/2006 2:53:59 PM
Manganese	1.33	0.0200		mg/L	1	1/20/2006 2:53:59 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:820 NP1-1-4
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-03C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0412	0.0200		mg/L	1	1/20/2006 2:51:25 PM
Manganese	1.21	0.0200		mg/L	1	1/20/2006 2:51:25 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	110	1.00		mg/L	1	1/18/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:820 NP1-1-4
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-03D	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	35.8	1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	3.00	1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:830 NP1-1-5
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-04A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1			SW8260B			Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1,1-Trichloroethane	2.0	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,3,5-Timethylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
 E Value above quantitation range
 J Analyte detected below quantitation limits
 S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
 H Holding times for preparation or analysis exceeded
 ND Not Detected at the Reporting Limit
 U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:830 NP1-1-5
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-04A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 5:15:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Methylene chloride	4.6	1.0	B	µg/L	1	1/18/2006 5:15:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Tetrachloroethene	2.3	1.0		µg/L	1	1/18/2006 5:15:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Trichloroethene	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 5:15:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 5:15:00 AM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
E	Value above quantitation range	H Holding times for preparation or analysis exceeded
J	Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
S	Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected
		Page 17 of 40

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:830 NP1-1-5
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-04B	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0558	0.0200		mg/L	1	1/20/2006 2:58:21 PM
Manganese	0.00800	0.0200	J	mg/L	1	1/20/2006 2:58:21 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:830 NP1-1-5
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-04C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0119	0.0200	J	mg/L	1	1/20/2006 2:56:13 PM
Manganese	0.00786	0.0200	J	mg/L	1	1/20/2006 2:56:13 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	154	1.00		mg/L	1	1/18/2006

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:830 NP1-1-5
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-04D	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	35.6	1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	1.60	1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:840 NP1-1-6
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-05A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1,1-Trichloroethane	16	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:840 NP1-1-6
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-05A	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 5:50:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Methylene chloride	4.6	1.0	B	µg/L	1	1/18/2006 5:50:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Tetrachloroethene	41	1.0		µg/L	1	1/18/2006 5:50:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Trichloroethene	1.1	1.0		µg/L	1	1/18/2006 5:50:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 5:50:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 5:50:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:840 NP1-1-6
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-05B	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.189	0.0200		mg/L	1	1/20/2006 3:27:28 PM
Manganese	0.170	0.0200		mg/L	1	1/20/2006 3:27:28 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:840 NP1-1-6
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-05C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	U	0.0200		mg/L	1	1/20/2006 3:25:11 PM
Manganese	0.167	0.0200		mg/L	1	1/20/2006 3:25:11 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	120	1.00		mg/L	1	1/18/2006

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:840 NP1-1-6
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-05D	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	30.2	1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	U	1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:850 NP1-1-7
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-06A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1,1-Trichloroethane	5.0	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1-Dichloroethane	2.2	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM

Qualifiers:

- * Value exceeds Maximum Contaminant Level
- E Value above quantitation range
- J Analyte detected below quantitation limits
- S Spike Recovery outside accepted recovery limits

- B Analyte detected in the associated Method Blank
- H Holding times for preparation or analysis exceeded
- ND Not Detected at the Reporting Limit
- U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ01I206:850 NP1-1-7
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-06A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 6:26:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Methylene chloride	5.0	1.0	B	µg/L	1	1/18/2006 6:26:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Tetrachloroethene	26	1.0		µg/L	1	1/18/2006 6:26:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Trichloroethene	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 6:26:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 6:26:00 AM

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:850 NP1-1-7
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-06B	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	0.0343	0.0200		mg/L	1	1/20/2006 3:31:38 PM
Manganese	0.0536	0.0200		mg/L	1	1/20/2006 3:31:38 PM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:850 NP1-1-7			
Lab Order:	0601196	Tag Number:				
Project:	Rowe Industries	Collection Date:	1/12/2006			
Lab ID:	0601196-06C	Date Received:	1/17/2006			
Analyses		Matrix:	LIQUID			
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE					(SW3005A)	Analyst: JP
Iron	U	0.0200		mg/L	1	1/20/2006 3:29:33 PM
Manganese	0.0497	0.0200		mg/L	1	1/20/2006 3:29:33 PM
TOTAL DISSOLVED SOLIDS					E160.1	Analyst: VP
Total Dissolved Solids (Residue, Filterable)	88.0	1.00		mg/L	1	1/18/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:850 NP1-1-7
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-06D	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	28.2	1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	U	1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:900 NP1-1-8
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-07A	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1,1-Trichloroethane	3.7	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1-Dichloroethane	2.0	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.**Date: 23-Jan-06**

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:900 NP1-1-8
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-07A	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
Chloroform	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Chloromethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
cis-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
cis-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Dibromochloromethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Dibromomethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Dichlorodifluoromethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Ethylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Hexachlorobutadiene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Isopropylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
m,p-Xylene	U	2.0		µg/L	1	1/18/2006 7:04:00 AM
Methyl tert-butyl ether	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Methylene chloride	4.9	1.0	B	µg/L	1	1/18/2006 7:04:00 AM
Naphthalene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
n-Butylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
n-Propylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
o-Xylene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
sec-Butylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Styrene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
tert-Butylbenzene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Tetrachloroethene	1.3	1.0		µg/L	1	1/18/2006 7:04:00 AM
Toluene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
trans-1,2-Dichloroethene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
trans-1,3-Dichloropropene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Trichloroethene	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Trichlorofluoromethane	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Vinyl acetate	U	1.0		µg/L	1	1/18/2006 7:04:00 AM
Vinyl chloride	U	1.0		µg/L	1	1/18/2006 7:04:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:900 NP1-1-8
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-07B	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	7.25	0.0200		mg/L	1	1/20/2006 3:36:35 PM
Manganese	0.759	0.0200		mg/L	1	1/20/2006 3:36:35 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:900 NP1-1-8
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-07C	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0969	0.0200		mg/L	1	1/20/2006 3:33:54 PM
Manganese	0.724	0.0200		mg/L	1	1/20/2006 3:33:54 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	78.0	1.00		mg/L	1	1/18/2006

Qualifiers:	* Value exceeds Maximum Contaminant Level	B Analyte detected in the associated Method Blank
	E Value above quantitation range	H Holding times for preparation or analysis exceeded
	J Analyte detected below quantitation limits	ND Not Detected at the Reporting Limit
	S Spike Recovery outside accepted recovery limits	U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID: GWQ011206:900 NP1-1-8				
Lab Order:	0601196	Tag Number:				
Project:	Rowe Industries	Collection Date: 1/12/2006				
Lab ID:	0601196-07D	Date Received:	1/17/2006	Matrix:	LIQUID	
Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	22.7	M2340 B 1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	6.00	E180.1 1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:910 NP1-1-9
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-08A	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
VOLATILES SW-846 8260 PLUS MTBE & FREON1	SW8260B					Analyst: LDS
1,1,1,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,1,1-Trichloroethane		1.4		µg/L	1	1/18/2006 7:46:00 AM
1,1,2,2-Tetrachloroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,1,2-Trichloro-1,2,2-trifluoroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,1,2-Trichloroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,1-Dichloroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,1-Dichloroethene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,1-Dichloropropene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2,3-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2,3-Trichloropropane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2,4-Trichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2,4-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2-Dibromo-3-chloropropane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2-Dibromoethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2-Dichloroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,3,5-Trimethylbenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,3-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,3-dichloropropane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
1,4-Dichlorobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
2,2-Dichloropropane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
2-Butanone	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
2-Chloroethyl vinyl ether	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
2-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
2-Hexanone	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
4-Chlorotoluene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
4-Isopropyltoluene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
4-Methyl-2-pentanone	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Acetone	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Benzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Bromobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Bromochloromethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Bromodichloromethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Bromoform	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Bromomethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Carbon disulfide	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Carbon tetrachloride	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Chlorobenzene	U	1.0		µg/L	1	1/18/2006 7:46:00 AM
Chloroethane	U	1.0		µg/L	1	1/18/2006 7:46:00 AM

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:910 NP1-1-9
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-08B	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
TOTAL IRON,MANGANESE		E200.7		(SW3010A)		Analyst: JP
Iron	2.36	0.0200		mg/L	1	1/20/2006 3:40:59 PM
Manganese	0.798	0.0200		mg/L	1	1/20/2006 3:40:59 PM

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:910 NP1-1-9
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-08C	Date Received:	1/17/2006
			Matrix: LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
DISSOLVED IRON,MANGANESE		E200.7		(SW3005A)		Analyst: JP
Iron	0.0905	0.0200		mg/L	1	1/20/2006 3:38:37 PM
Manganese	0.749	0.0200		mg/L	1	1/20/2006 3:38:37 PM
TOTAL DISSOLVED SOLIDS		E160.1				Analyst: VP
Total Dissolved Solids (Residue, Filterable)	104	1.00		mg/L	1	1/18/2006

Qualifiers:	*	Value exceeds Maximum Contaminant Level	B	Analyte detected in the associated Method Blank
	E	Value above quantitation range	H	Holding times for preparation or analysis exceeded
	J	Analyte detected below quantitation limits	ND	Not Detected at the Reporting Limit
	S	Spike Recovery outside accepted recovery limits	U	Indicates the compound was analyzed for but not detected

American Analytical Laboratories, LLC.

Date: 23-Jan-06

CLIENT:	Leggette Brashears & Graham Inc.	Client Sample ID:	GWQ011206:910 NP1-1-9
Lab Order:	0601196	Tag Number:	
Project:	Rowe Industries	Collection Date:	1/12/2006
Lab ID:	0601196-08D	Date Received:	1/17/2006
		Matrix:	LIQUID

Analyses	Result	Limit	Qual	Units	DF	Date Analyzed
HARDNESS Hardness, Calcium/Magnesium (As CaCO ₃)	23.7	1.00		mg/L	1	Analyst: JP 1/20/2006
TURBIDITY Turbidity	2.00	1.00	H	NTU	1	Analyst: KK 1/17/2006

Qualifiers: * Value exceeds Maximum Contaminant Level
E Value above quantitation range
J Analyte detected below quantitation limits
S Spike Recovery outside accepted recovery limits

B Analyte detected in the associated Method Blank
H Holding times for preparation or analysis exceeded
ND Not Detected at the Reporting Limit
U Indicates the compound was analyzed for but not detected

ANALYTICAL REPORT

JOB NUMBER: 211815


Prepared For:

LEGGETTE, BRASHEARS & GRAHAM
4 Research Drive
Suite 301
Shelton, CT 06484

Project: ROWE INDUSTRIES

Attention: Mark Goldberg

Date: 01/23/2006

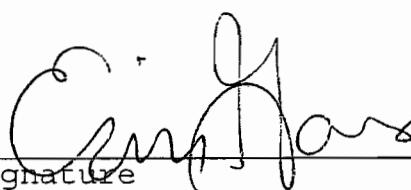

Signature

01/23/06

Date

Name: Erin A. Gaus

STL Connecticut
128 Long Hill Cross Road
Shelton, CT 06484

Title: Project Manager

E-Mail: egaus@stl-inc.com

This Report Contains (127) Pages

STL Report : 211815
LEGGETTE, BRASHEARS, & GRAHAM

Case Narrative

Sample Receipt – All samples were received in good condition.

Volatile Organics – Air volatile organics were determined by purge and trap GC/MS using guidance provided in Method TO-17. The instrumentation used was a Perkin Elmer ATD 50 interfaced with a Hewlett-Packard Model 5972A GC/MS/DS.

The samples in this job were collected in tedlar bags. Samples were transferred by the laboratory to Air Toxic TO-17 tubes and analyzed at sample volumes of 1L. Compound concentrations over the calibration curve in sample AQ010406:845 NP4-1 were flagged with an “A”.

Sample Calculation:

Sample ID- AQ010406:845 NP4-1
Compound-Bromomethane

$$\frac{(7753 \text{ area})(25\text{ng})}{(239055 \text{ area})(.363 \text{ area/ng})} = 2.23 = 2 \text{ ng}$$

$$\frac{(2 \text{ NG})(.08206)(298)}{(1\text{L})(95)(1.0\text{ATM})} = 0.51 = 0.5 \text{ nL/L.}$$

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in the case narrative.

S A M P L E I N F O R M A T I O N
Date: 01/23/2006

Job Number.: 211815
 Customer...: LEGGETTE, BRASHEARS & GRAHAM
 Attn.....: Mark Goldberg

Project Number.....: 20000283
 Customer Project ID....: ROWE INDUSTRIES
 Project Description....: Rowe Industries

Laboratory Sample ID	Customer Sample ID	Sample Matrix	Date Sampled	Time Sampled	Date Received	Time Received
211815-1	AQ010406:845 NP4-1	Air	01/04/2006	08:45	01/06/2006	12:50
211815-2	AQ010406:850 NP4-2	Air	01/04/2006	08:50	01/06/2006	12:50
211815-3	AQ010406:855 NP4-3	Air	01/04/2006	08:55	01/06/2006	12:50

Form 1					
STL Connecticut		Client Sample ID		AQ010406:845 NP4-1	
Method: TO17		Lab Sample ID		211815-1	
Sample Volume (L)	1.000	Date Sampled		1/4/2006	
Temp (C)	25	Date Analyzed		1/17/2006	
Compound	(ppbv/v)	nL/L Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	9.7 U	9.7		0.020 U	0.020
Vinyl Chloride	7.8 U	7.8		0.020 U	0.020
Bromomethane	0.5 JB	5.1		0.002 JB	0.020
Chloroethane	7.6 U	7.6		0.020 U	0.020
1,1-Dichloroethene	1.8 J	2.5		0.007 J	0.010
Carbon Disulfide	8.7	3.2		0.027	0.010
Methylene Chloride	5.2 B	2.9		0.018 B	0.010
trans-1,2-Dichloroethene	2.5 U	2.5		0.010 U	0.010
1,1-Dichloroethane	4.7	2.5		0.019	0.010
cis-1,2-Dichloroethene	2.3 J	2.5		0.009 J	0.010
Chloroform	1.0 J	2.1		0.005 J	0.010
1,1,1-Trichloroethane	17.3	1.8		0.094	0.010
Carbon Tetrachloride	1.6 U	1.6		0.010 U	0.010
Benzene	4.4 B	3.1		0.0140 B	0.010
1,2-Dichloroethane	2.5 U	2.5		0.010 U	0.010
Trichloroethene	5.0	1.9		0.027	0.010
1,2-Dichloropropane	2.2 U	2.2		0.010 U	0.010
Bromodichloromethane	1.5 U	1.5		0.010 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
Toluene	8.2	2.7		0.031	0.010
trans-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8		0.010 U	0.010
Tetrachloroethene	35.4 A	1.5		0.240 A	0.010
Dibromochloromethane	1.2 U	1.2		0.010 U	0.010
Chlorobenzene	2.2 U	2.2		0.010 U	0.010
Ethylbenzene	0.7 J	2.3		0.003 J	0.010
m&p-Xylenes	2.3	2.3		0.010	0.010
o-Xylene	0.9 J	2.3		0.004 J	0.010
Styrene	1.2 J	2.4		0.005 J	0.010
Bromoform	1.0 U	1.0		0.010 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5		0.010 U	0.010

Form 1					
STL Connecticut		Client Sample ID		AQ010406:850 NP4-2	
Method: TO17		Lab Sample ID		211815-2	
Sample Volume (L)	1.000	Date Sampled		1/4/2006	
Temp (C)	25	Date Analyzed		1/17/2006	
Compound	nL/L (ppbv/v)	Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	9.7 U	9.7		0.020 U	0.020
Vinyl Chloride	7.8 U	7.8		0.020 U	0.020
Bromomethane	2.3 JB	5.1		0.009 JB	0.020
Chloroethane	7.6 U	7.6		0.020 U	0.020
1,1-Dichloroethene	1.3 J	2.5		0.005 J	0.010
Carbon Disulfide	7.1	3.2		0.022	0.010
Methylene Chloride	2.0 JB	2.9		0.007 JB	0.010
trans-1,2-Dichloroethene	2.5 U	2.5		0.010 U	0.010
1,1-Dichloroethane	4.2	2.5		0.017	0.010
cis-1,2-Dichloroethene	1.5 J	2.5		0.006 J	0.010
Chloroform	1.0 J	2.1		0.005 J	0.010
1,1,1-Trichloroethane	20.2	1.8		0.110	0.010
Carbon Tetrachloride	1.6 U	1.6		0.010 U	0.010
Benzene	0.3 JB	3.1		0.0010 JB	0.010
1,2-Dichloroethane	2.5 U	2.5		0.010 U	0.010
Trichloroethene	1.9 U	1.9		0.010 U	0.010
1,2-Dichloropropane	2.2 U	2.2		0.010 U	0.010
Bromodichloromethane	1.5 U	1.5		0.010 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
Toluene	4.8	2.7		0.018	0.010
trans-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8		0.010 U	0.010
Tetrachloroethene	0.9 J	1.5		0.006 J	0.010
Dibromochloromethane	1.2 U	1.2		0.010 U	0.010
Chlorobenzene	2.2 U	2.2		0.010 U	0.010
Ethylbenzene	0.2 J	2.3		0.001 J	0.010
m&p-Xylenes	0.7 J	2.3		0.003 J	0.010
o-Xylene	2.3 U	2.3		0.010 U	0.010
Styrene	0.7 J	2.4		0.003 J	0.010
Bromoform	1.0 U	1.0		0.010 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5		0.010 U	0.010

Form 1					
STL Connecticut	Client Sample ID		AQ010406:855 NP4-3		
Method: TO17	Lab Sample ID			211815-3	
Sample Volume (L)	1.000	Date Sampled		1/4/2006	
Temp (C)	25	Date Analyzed		1/17/2006	
Compound	nL/L (ppbv/v)	Qualifier	RL	mg/M3 Qualifier	RL
Chloromethane	9.7 U	9.7		0.020 U	0.020
Vinyl Chloride	7.8 U	7.8		0.020 U	0.020
Bromomethane	5.1 U	5.1		0.020 U	0.020
Chloroethane	7.6 U	7.6		0.020 U	0.020
1,1-Dichloroethene	1.5 J	2.5		0.006 J	0.010
Carbon Disulfide	7.1	3.2		0.022	0.010
Methylene Chloride	4.0 B	2.9		0.014 B	0.010
trans-1,2-Dichloroethene	2.5 U	2.5		0.010 U	0.010
1,1-Dichloroethane	5.4	2.5		0.022	0.010
cis-1,2-Dichloroethene	0.8 J	2.5		0.003 J	0.010
Chloroform	1.2 J	2.1		0.006 J	0.010
1,1,1-Trichloroethane	17.7	1.8		0.096	0.010
Carbon Tetrachloride	1.6 U	1.6		0.010 U	0.010
Benzene	1.3 JB	3.1		0.0040 JB	0.010
1,2-Dichloroethane	2.5 U	2.5		0.010 U	0.010
Trichloroethene	1.9 U	1.9		0.010 U	0.010
1,2-Dichloropropane	2.2 U	2.2		0.010 U	0.010
Bromodichloromethane	1.5 U	1.5		0.010 U	0.010
cis-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
Toluene	4.5	2.7		0.017	0.010
trans-1,3-Dichloropropene	2.2 U	2.2		0.010 U	0.010
1,1,2-Trichloroethane	1.8 U	1.8		0.010 U	0.010
Tetrachloroethene	0.6 J	1.5		0.004 J	0.010
Dibromochloromethane	1.2 U	1.2		0.010 U	0.010
Chlorobenzene	2.2 U	2.2		0.010 U	0.010
Ethylbenzene	0.2 J	2.3		0.001 J	0.010
m&p-Xylenes	0.9 J	2.3		0.004 J	0.010
o-Xylene	2.3 U	2.3		0.010 U	0.010
Styrene	0.7 J	2.4		0.003 J	0.010
Bromoform	1.0 U	1.0		0.010 U	0.010
1,1,2,2-Tetrachloroethane	1.5 U	1.5		0.010 U	0.010

LABORATORY CHRONICLE

Job Number: 211815

Date: 01/23/2006

CUSTOMER: LEGGETTE, BRASHEARS & GRAHAM

PROJECT: ROWE INDUSTRIES

ATTN: Mark Goldberg

Lab ID: 211815-1	Client ID: AQ010406:845 NP4-1	Date Recvd: 01/06/2006	Sample Date: 01/04/2006				
METHOD T017	DESCRIPTION Volatile Organics (Air)	RUN# 1	BATCH# 60334	PREP BT #(S)	DATE/TIME ANALYZED 01/17/2006	DILUTION 1534	1.00000
Lab ID: 211815-2	Client ID: AQ010406:850 NP4-2	Date Recvd: 01/06/2006	Sample Date: 01/04/2006				
METHOD T017	DESCRIPTION Volatile Organics (Air)	RUN# 1	BATCH# 60334	PREP BT #(S)	DATE/TIME ANALYZED 01/17/2006	DILUTION 1612	1.00000
Lab ID: 211815-3	Client ID: AQ010406:855 NP4-3	Date Recvd: 01/06/2006	Sample Date: 01/04/2006				
METHOD T017	DESCRIPTION Volatile Organics (Air)	RUN# 1	BATCH# 60334	PREP BT #(S)	DATE/TIME ANALYZED 01/17/2006	DILUTION 1651	1.00000

AIR
 2A
 WATER VOLATILE SYSTEM MONITORING COMPOUND RECOVERY

Lab Name: STL-CT

Run: 1/19/06

Contract:

Lab Code: STL-CT

Case No.: 211815 SAS No.:

SDG No.: 211815

	EPA SAMPLE NO.	SMC1 #	SMC2 (DCE) #	SMC3 (TOL) #	OTHER (BFB) #	TOT OUT
01	VBLKT1	110	96	117	117	
02	LCS	110	106	111	117	
03	AQ010406:845 NP4-1	105	96	112	116	
04	AQ010406:850 NP4-2	111	105	112	105	
05	AQ010406:855 NP4-3	108	97	112	113	
06						
07						
08						
09						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						

SMC1	= Dibromofluoromethane	QC LIMITS (70-130)
SMC2 (DCE)	= 1,2-Dichloroethane-d4	(70-130)
SMC3 (TOL)	= Toluene-d8	(70-130)
OTHER (BFB)	= Bromofluorobenzene	(70-130)

Column to be used to flag recovery values

* Values outside of contract required QC limits

D System Monitoring Compound diluted out

FORM 3

Data File: \\target1_ct\Files\chem\VOA\mst.i\T065713.b\T5716.D Page 3
 Report Date: 18-Jan-2006 09:40

STL-INC

RECOVERY REPORT

Client Name:
 Sample Matrix: LIQUID
 Lab Smp Id: lcs
 Level: LOW
 Data Type: MS DATA
 SpikeList File: AIRQCS.spk
 Sublist File: all.sub
 Method File: \\target1_ct\Files\chem\VOA\mst.i\T065713.b\TAIRFULL.m
 Misc Info: :lcs ;;;20NG lcs; * 1L* ; AIR

Client SDG: SDGa24843
 Fraction: VOA
 Operator: L.Decker
 SampleType: LCS
 Quant Type: ISTD

SPIKE COMPOUND	CONC ADDED ug/L	CONC RECOVERED ug/L	% RECOVERED	LIMITS
4 Vinyl Chloride	20	12	59.74*	60-140
5 Bromomethane	20	17	84.52	60-140
6 Chloroethane	20	14	68.28	60-140
12 1,1-Dichloroethene	20	13	67.41	60-140
11 Trichlorotrifluoro	20	11	57.31*	60-140
17 Acetone	20	13	63.63	60-140
13 Carbon Disulfide	20	12	60.80	60-140
16 Methylene Chloride	20	9	46.57*	60-140
18 trans-1,2-Dichloro	20	13	65.67	60-140
28 1,1-Dichloroethane	20	13	67.40	60-140
30 cis-1,2-Dichloroet	20	13	64.09	60-140
40 2-Butanone	20	16	81.11	60-140
33 Chloroform	20	13	64.59	60-140
38 1,1,1-Trichloroeth	20	16	78.65	60-140
39 Carbon Tetrachlori	20	18	88.67	60-140
51 1,2-Dichloroethane	20	15	74.62	60-140
48 Benzene	20	13	66.68	60-140
56 Trichloroethene	20	13	65.50	60-140
63 cis-1,3-Dichloropr	20	14	71.57	60-140
72 4-Methyl-2-Pentano	20	15	74.44	60-140
69 Toluene	20	14	68.20	60-140
66 trans-1,3-Dichloro	20	13	63.21	60-140
67 1,1,2-Trichloroeth	20	13	62.83	60-140
73 Tetrachloroethene	20	14	67.69	60-140
75 Dibromochlorometha	20	14	70.52	60-140
80 Chlorobenzene	20	13	65.90	60-140
82 Ethylbenzene	20	15	73.21	60-140
83 Xylene (total)mp	40	27	68.35	60-140
84 Xylene (total)o	20	13	63.71	60-140
85 Styrene	20	13	67.17	60-140
86 Bromoform	20	13	66.12	60-140
89 1,1,2,2-Tetrachlor	20	15	75.74	60-140
101 1,3-Dichlorobenzen	20	15	73.82	60-140
102 1,4-Dichlorobenzen	20	13	67.23	60-140
103 1,2-Dichlorobenzen	20	13	65.77	60-140

QUALITY ASSURANCE METHODS

REFERENCES AND NOTES

REPORT COMMENTS

- 1) All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.
- 2) Soil, sediment and sludge sample results are reported on a "dry weight" basis except when analyzed for landfill disposal or incineration parameters. All other solid matrix samples are reported on an "as received" basis unless noted differently.
- 3) Reporting limits are adjusted for sample size used, dilutions and moisture content if applicable.
- 4) The test results for the noted analytical method(s) meet the requirements of NELAC. Lab Cert. ID# 10604
- 5) According to 40CFR Part 136.3, pH, Chlorine Residual and Dissolved Oxygen analyses are to be performed immediately after aqueous sample collection. When these parameters are not indicated as field (e.g. pH Field) they were not analyzed immediately, but as soon as possible on laboratory receipt.

Glossary of flags, qualifiers and abbreviations

Inorganic Qualifiers (Q-Column)

- U Analyte was not detected at or above the reporting limit.
 - < Not detected at or above the reporting limit.
 - J Result is less than the RL, but greater than or equal to the method detection limit.
 - B Result is less than the CRDL/RL, but greater than or equal to the IDL/MDL.
 - S Result was determined by the Method of Standard Additions.
- Inorganic Flags (Flag Column)**
- ICV,CCV,ICB,CCB,ISA,ISB,CRI,CRA,MRL: Instrument related QC exceed the upper or lower control limits.
 - * LCS, LCD, MD: Batch QC exceeds the upper or lower control limits.
 - + MSA correlation coefficient is less than 0.995.
 - 4 MS, MSD: The analyte present in the original sample is 4 times greater than the matrix spike concentration; therefore, control limits are not applicable.
 - E SD: Serial dilution exceeds the control limits.
 - H MB, EB: Batch QC is greater than reporting limit or had a negative instrument reading lower than the absolute value of the reporting limit.
 - N MS, MSD: Spike recovery exceeds the upper or lower control limits.
 - W PS: Post-digestion spike was outside 85-115% control limits.

Organic Qualifiers (Q - Column)

- U Analyte was not detected at or above the reporting limit.
- ND Compound not detected.
- J Result is an estimated value below the reporting limit or a tentatively identified compound (TIC).
- Q Result was qualitatively confirmed, but not quantified.
- C Pesticide identification was confirmed by GC/MS.
- Y The chromatographic response resembles a typical fuel pattern.
- Z The chromatographic response does not resemble a typical fuel pattern.
- E Result exceeded calibration range, secondary dilution required.

Organic Flags (Flags Column)

- MB,EB, MLE: Batch QC is greater than reporting limit.
- * LCS, LCD, CCV, MS, MSD, Surrogate, RS:Batch QC exceeds the upper or lower control limits.
- A Concentration exceeds the instrument calibration range or below the reporting limit.
- B Compound was found in the blank.
- D Surrogate or matrix spike recoveries were not obtained because the extract was diluted for analysis; also compounds analyzed at a dilution will be flagged with a D.
- H Alternate peak selection upon analytical review
- I Indicates the presence of an interference, recovery is not calculated.
- M Manually integrated compound.
- P The lower of the two values is reported when the % difference between the results of two GC columns is greater than 25%.

QUALITY ASSURANCE METHODS
REFERENCES AND NOTES

Abbreviations

Batch	Designation given to identify a specific extraction, digestion, preparation set, or analysis set
CAP	Capillary Column
CCB	Continuing Calibration Blank
CCV	Continuing Calibration Verification
CF	Confirmation Analysis
CRA	Low Level Standard Check - GFAA; Mercury
CRI	Low Level Standard Check - ICP
Dil, Fac	Dilution Factor
DL	Secondary dilution and analysis
DLFac	Detection Limit Factor
DSH	Distilled Standard - High Level
DSL	Distilled Standard - Low Level
DSM	Distilled Standard - Medium Level
EB	Extraction Blank
ICB	Initial Calibration Blank
ICV	Initial Calibration Verification
IDL	Instrument Detection Limit
ISA	Interference Check Sample A
ISB	Interference Check Sample B
Job No.	The first six digits of the sample ID which refers to a specific client, project and sample group
Lab ID	An 8 number unique laboratory identification
LCD	Laboratory Control Standard Duplicate
LCS	Laboratory Control Standard with reagent grade water or a matrix free from the analyte of interest
MB	Method Blank or (PB) Preparation Blank
MD	Method Duplicate
MDL	Method Detection Limit
MLE	Medium Level Extraction Blank
MRL	Method Reporting Limit Standard
MSA	Method of Standard Additions
MS	Matrix Spike
MSD	Matrix Spike Duplicate
ND	Not Detected
PACK	Packed Column
PREPF	Preparation factor used by the Laboratory's Information Management System (LIMS)
PS	Post Spike
PSD	Post Spike Duplicate
RA	Re-analysis
RE	Re-extraction and analysis
RL	Reporting Limit
RPD	Relative Percent Difference of duplicate (unrounded) analyses
RRF	Relative Response Factor
RS	Reference Standard
RT	Retention Time
RTW	Retention Time Window
SampleID	A 9 digit number unique for each sample, the first six digits are referred as the job number
SCB	Seeded Control Blank
SD	Serial Dilution
UCB	Unseeded Control Blank

One or a combination of these data qualifiers and abbreviations may appear in the analytical report.

STL-Connecticut Certification Summary (as of September 2005)

The laboratory identification numbers for the STL-Connecticut laboratory are provided in the following table. Many states certify laboratories for specific parameters or tests within a category (i.e. method 325.2 for wastewater). The information in the following table indicates the lab is certified in a general category of testing such as drinking water or wastewater analysis. The laboratory should be contacted directly if parameter-specific certification information is required.

State	Reporting Agency	Category	Expiry Date	Lab ID
Connecticut	Department of Health Services	Drinking Water, Wastewater	12/31/06	PH-0497
Maine	Department of Health and Environmental Services	Drinking Water, Wastewater/Solid, Hazardous Waste	04/18/06	CT023
Massachusetts	Department of Environmental Protection	Potable/Non-Potable Water	06/30/06	CT023
New Hampshire	Department of Environmental Services	Drinking Water, Wastewater	08/29/06	2528
New Jersey	Department of Environmental Protection	Drinking Water, Wastewater	06/30/06	CT410
New York	Department of Health	CLP, Drinking Water, Wastewater, Solid/ Hazardous Waste NELAC	04/01/06	10602
Rhode Island	Department of Health	Chemistry...Non- Potable Water and Wastewater	12/30/06	A43
Utah	Department of Health	RCRA	05/31/06	2032614458

MISCELLANEOUS DOCUMENTS

**Chain of
Custody Record**

STL-Connecut
128 Long Hill Cross Road
Shelton, CT 06484
Tel: 203-929-8140

**SEVERN
TRENT**

Severn Trent Laboratories, Inc.

STL-4124 (0901)

Client/ Address	LBC		
City	CONNECTICUT		
Project Name and Location (State)	126 Monroe Turnpike Trumbull, CT 06611		
Contract/Purchase Order/Quote No.	N.Y		
Sample I.D. No. and Description (Containers for each sample may be combined on one line)	Date	Time	Matrix
120111406: 845 MP4-1	1/1/06	8:45 am	Uppers
120111406: 850 MP4-2	1/1/06	8:00 am	NaOH
120111406: 855 MP4-3	1/1/06	8:55 am	ZnAc

Project Manager	Mark M. Goldberg		
Telephone Number (Area Code)/Fax Number	203-452-3100 / 203-452-3111		
Site Contact	Lab Contact Johanna Rauhala		
Carrier/Maybill Number			
Analysis (Attach list if more space is needed)			
Special Instructions/ Conditions of Receipt			
51-02			
Sample I.D. No. and Description (Containers for each sample may be combined on one line)	Date	Time	Matrix
120111406: 845 MP4-1	1/1/06	8:45 am	Uppers
120111406: 850 MP4-2	1/1/06	8:00 am	NaOH
120111406: 855 MP4-3	1/1/06	8:55 am	ZnAc
Possible Hazard Identification	<input type="checkbox"/> Non-Hazard <input type="checkbox"/> Flammable <input type="checkbox"/> Skin Irritant <input type="checkbox"/> Poison A <input checked="" type="checkbox"/> Poison B <input type="checkbox"/> Unknown		
Turn Around Time Required	<input type="checkbox"/> 24 Hours <input type="checkbox"/> 48 Hours <input type="checkbox"/> 7 Days <input type="checkbox"/> 14 Days <input type="checkbox"/> 21 Days <input checked="" type="checkbox"/> Other Standard		
1. Relinquished By	Date	Time	1. Received By
2. Relinquished By	Date	Time	2. Received By
3. Relinquished By	Date	Time	3. Received By
Comments			

211815

01/18/2006

LEGGETTE, BRASHEARS GRAHAM
MARK GOLDBERG
ROWE INDUSTRIES

(A fee may be assessed if samples are retained longer than 1 month)

"PASSED RAD SCREEN"

DISTRIBUTION: WHITE - Returned to Client with Report: CANARY - Stays with the Sample: PINK - Field Copy

rpjsckl	Job Sample Receipt Checklist Report			V2
Job Number.: 211815	Location.: 57207	Check List Number.: 1	Description.:	
Customer Job ID.....:		Job Check List Date.:		Date of the Report..: 01/06/2006
Project Number.: 20000283	Project Description.: Rowe Industries			Project Manager.....: eag
Customer.....: LEGGETTE, BRASHEARS & GRAHAM		Contact.: Mark Goldberg		
Questions ?	(Y/N) Comments			
Chain-of-Custody Present?.....	Y			
...If "yes", completed properly?.....	Y			
Custody seal on shipping container?.....	Y			
...If "yes", custody seal intact?.....	Y			
Custody seals on sample containers?.....	N			
...If "yes", custody seal intact?.....				
Samples iced?.....	N			
Temperature of cooler acceptable? (4 deg C +/- 2). Y				
Samples received intact (good condition)?.....	Y			
Volatile samples acceptable? (no headspace).....	Y			
Correct containers used?.....	Y			
Adequate sample volume provided?.....	Y			
Samples preserved correctly?.....	Y			
Samples received within holding-time?.....	Y			
Agreement between COC and sample labels?.....	Y			
Radioactivity at or below background levels?.....	Y			
A Sample Discrepancy Report (SDR) was needed?.....	N			
Comments.....				
If samples were shipped was there an air bill #?..	N	STL COURIER		
Sample Custodian Signature/Date.....	Y			<i>hd 1/6/06</i>

Page 1