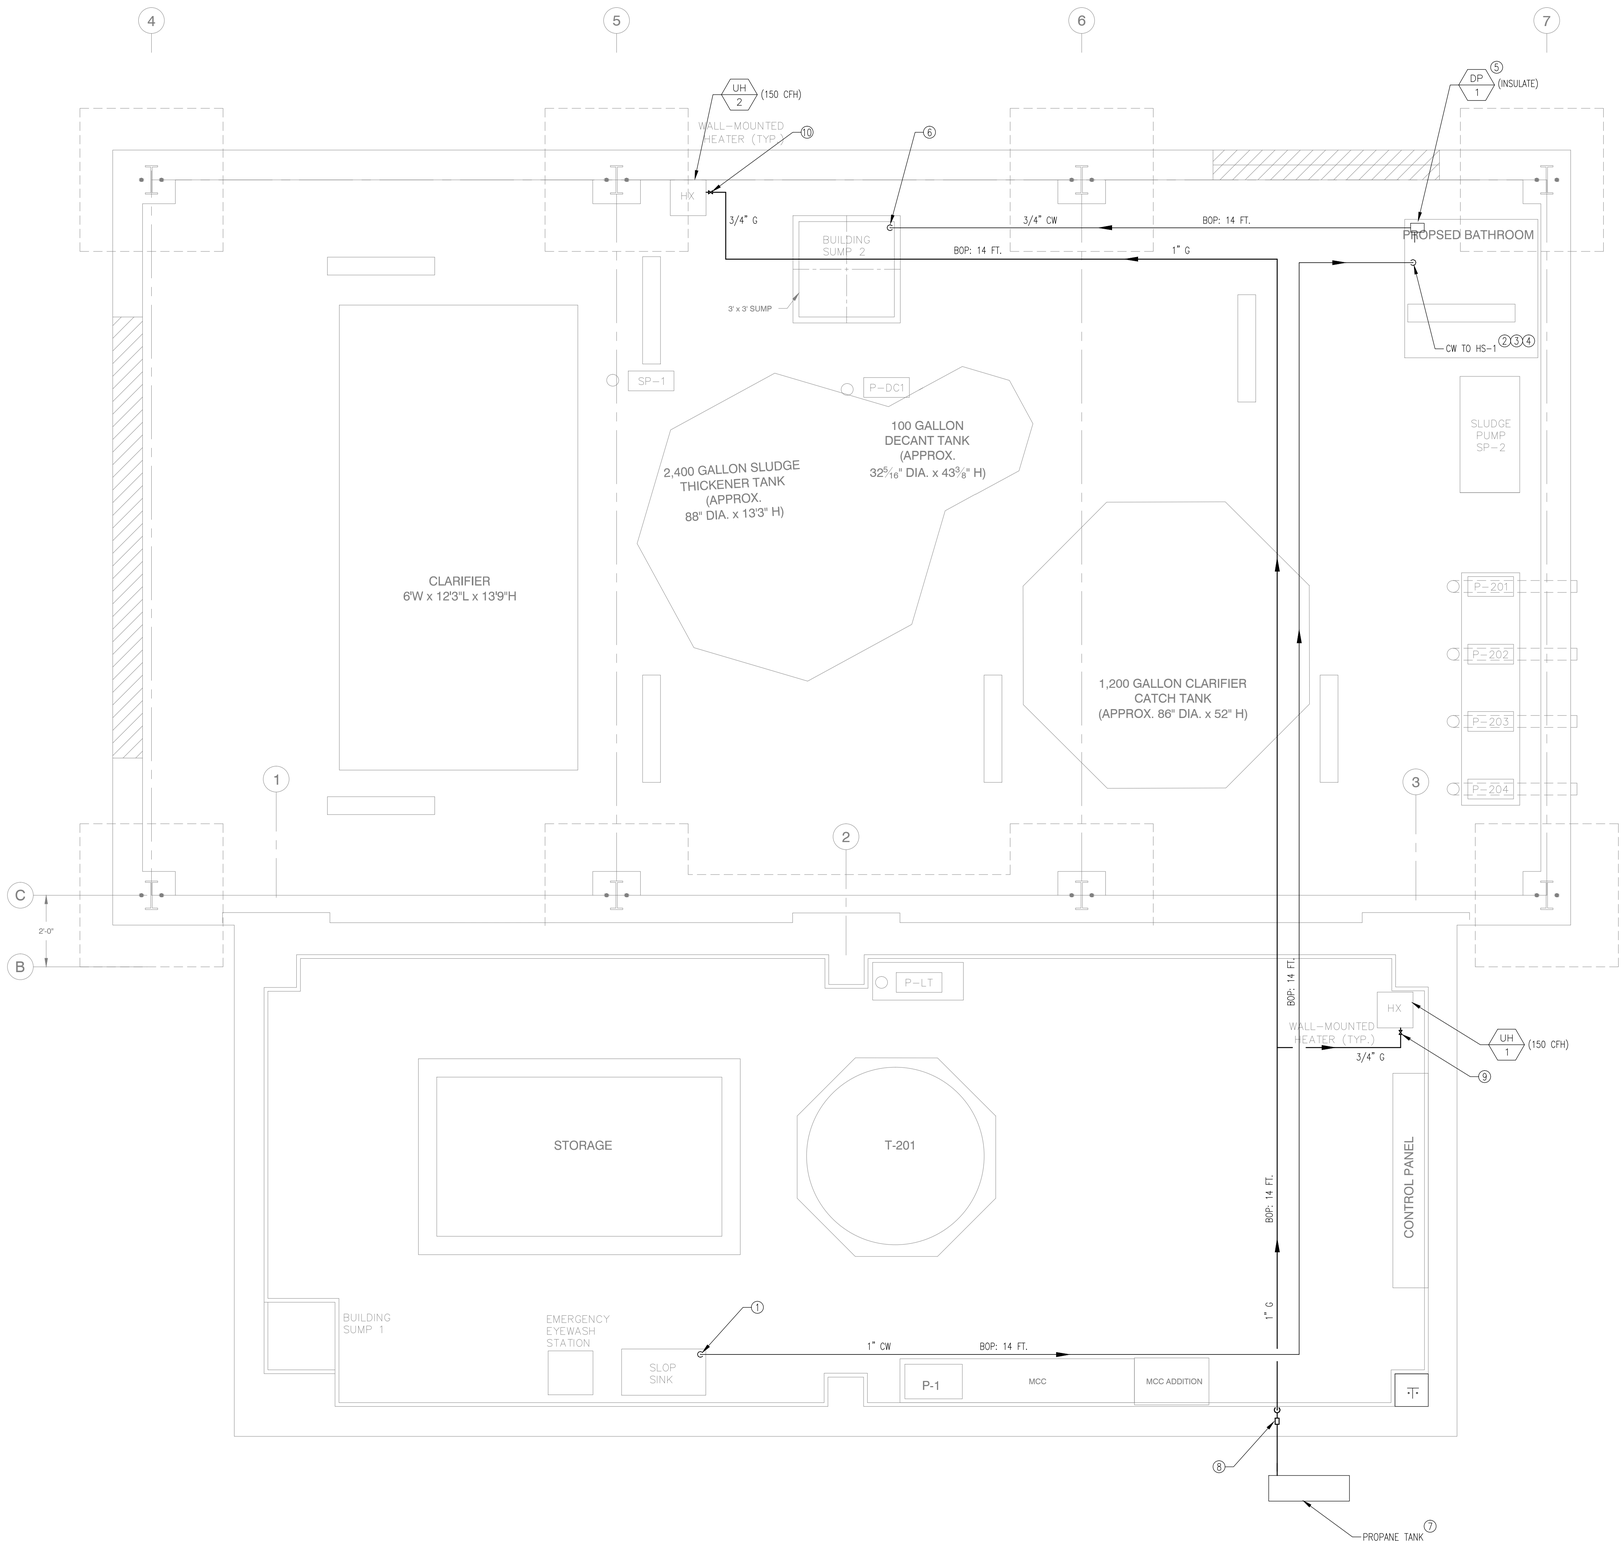

KEYNOTES:

1. POINT OF CONNECTION FOR CW SUPPLY AT NEAR SLOP SINK (FIELD VERIFY).
2. 3/4" CW SUPPLY TO (N) HANDSINK.
3. (N) HANDSINK (WALL MOUNTED).
4. (N) UNDER-THE-SINK HOT WATER HEATER. CONNECT TO CW SUPPLY.
5. (N) SUMP PUMP ABOVE FLOOR. REFER TO DWG. P2.0 DETAIL1.
6. 3/4" COPPER PIPE DOWN TO BUILDING SUMP 2.
7. PROPANE TANK (BY OTHERS).
8. (N) S.O.V., OVERPRESSURE RELIEF VALVE & PRESSURE REGULATOR. REFER TO DWG. P2.0 DETAIL 2.
9. 3/4" GAS SUPPLY TO UNIT HEATER (UH-1). PROVIDE S.O.V. WITH TEECO FLEXIBLE STAINLESS STEEL CONNECTOR.
10. 3/4" GAS SUPPLY TO UNIT HEATER (UH-2). PROVIDE S.O.V. WITH TEECO FLEXIBLE STAINLESS STEEL CONNECTOR.

PLUMPGROUP.com
ARCHITECTURE & ENGINEERING
a division of Plump Engineering, Inc.
914 E. KATELLA AVENUE
ANAHEIM, CALIFORNIA 92805
P (714) 385-1835 F (714) 385-1834
www.plumpgroup.com

Consultant:

Client:

HRP Associates, Inc.
dba HRP Engineering P.C.
Environmental and Engineering & Hydrogeology
Creating the Right Solutions Together
Offices in CT, SC, NY, FL, MA, TX and PA
1 Fairchild Square, Suite 110
Clifton Park, NY 12065
Ph:(518)877-7101 Fax:(518)877-8561
www.hrpassociates.com

Project Location:
FORT EDWARD LANDFILL LEAVY HOLLOW ROAD
FORT EDWARD, NEW YORK NYSDEC SITE 558001

STAMP

REVISIONS

Date: 07/01/14
Scale: AS NOTED
Project Number: NEW9622.OM
Project Manager:
Drawn By:

Sheet Title:
PLUMBING FLOORPLAN

SHEET NUMBER
P-1.0

THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF THE PLUMP ENGINEERING, INC. NO PART OF THESE DOCUMENTS, INCLUDING DESIGN CONCEPT, MAY BE USED, REPRODUCED OR DISCLOSED IN ANY FORM WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF PLUMP ENGINEERING, INC.