



Safety
Products

Tyco Safety Products
6600 Congress Avenue
Boca Raton, FL 33487

Tele: 561 912 6097
Fax: 561 912 6000

November 9, 2009

Ms. Nicole Elliott
Southtowns Sewage Treatment Plant
S-3690 Lakeshore Blvd.
Buffalo, New York 14219

RE: Fourth Quarter 2009 Discharge Monitoring Report
Scott Technologies, Inc., Groundwater Remediation Site
NYSDEC Site 9-15-149
EC/BPDES Permit No. 08-02-E4045

Dear Ms. Elliott:

Scott Technologies, Inc. is pleased to provide you with the enclosed Fourth Quarter 2009 Discharge Monitoring Report for the Scott Technologies, Inc., Groundwater Remediation Site located at AVOX Systems Inc., 25A Walter Winter Drive, Lancaster, New York. This report is submitted in partial fulfillment of Erie County/Buffalo Pollution Discharge Elimination System (EC/BPDES) Permit No. 08-02-E4045, effective April 1, 2008. Scott Technologies, Inc. commissioned AECOM, with an office located in Amherst, New York, to perform the required EC/BPDES quarterly sampling during the month of October 2009.

We certify under the penalty of law that this document and all attachments were prepared under our direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on our inquiry of the person or persons who manage the system or those directly responsible for gathering the information, the information submitted is, to the best of our knowledge and belief, true, accurate, and complete. We are aware that there are significant penalties for submitting false information, including the possibility of a fine and imprisonment for known violations. We will continue to monitor the influent and effluent of the active remediation system located at the Site on a quarterly basis. The next scheduled quarterly discharge monitoring report is due by February 28, 2010.

If you have any questions regarding this submission, please do not hesitate to contact me.

Very truly yours,
Scott Technologies, Inc.

Mark Mitchell
Chief Financial Officer
Tyco Safety Products

Enclosures

Ms. Nicole Elliott
November 9, 2009
Page 2

cc: Mr. Jim Kruszka, Buffalo Sewer Authority
Ms. Linda Ross, NYSDEC Region 9 (e-copy will be sent via email by AECOM)
Ms. Tamara Girard, NYSDOH Western Region
Mr. William Saskowski, AVOX Systems Inc.
Mr. John Perkins, Tyco Safety Products (w/out enclosures)
Facility File, Lancaster, NY (c/o AECOM, Amherst, NY)

L:\work\71149\ADMIN\Reports\EC-BPDES 4Q09 Rpt\4Q-09 compliance rpt Elliott (final).doc

TABLE

**Scott Technologies, Inc. - Groundwater Remediation Site
Lancaster, New York**

EC/BPDES Permit No. 08-02-E4045


**Fourth Quarter 2009 Discharge Monitoring Report
Sample Date - October 12, 2009**

Parameter	Units	Discharge Limitations Daily Max	Calculated Daily Value	Within Limits?
pH (method 160.1)	SU	5 - 12	8.36	Y
Total Extractable Hydrocarbons (method 1664 SGT)	mg/L	100	< 5.0	Y
Total Suspended Solids (method 160.2)	mg/L	250	< 4.0	Y
<u>VOCs (ASP00 method 8260)</u>				
Methylene Chloride	lbs/day	0.12	< 0.00005	Y
1,1,1-Trichloroethane	lbs/day	0.09	< 0.00005	Y
Trichloroethylene	lbs/day	0.04	< 0.00005	Y
Total 1,2-DCE (cis-1,2-DCE and trans-1,2-DCE)	lbs/day	0.02	< 0.00005	Y
1,1-Dichloroethane	lbs/day	0.0025	< 0.00005	Y
Chloroethane	lbs/day	0.025	< 0.00005	Y
Toluene	lbs/day	0.004	< 0.00005	Y
Total Daily Flow (discharge meter reading)	gallons per day	14,000	1,103	Y

Notes:

- SU standard units
- mg/L milligrams per liter
- ug/L micrograms per liter
- lbs/day pounds per day
- J Indicates analyte result was reported as an estimated concentration.
- < (value) Indicates calculated concentration less than the reported value,
using effluent reporting limit as maximum possible concentration
- DPE system was not running during sample collection.


FIGURES

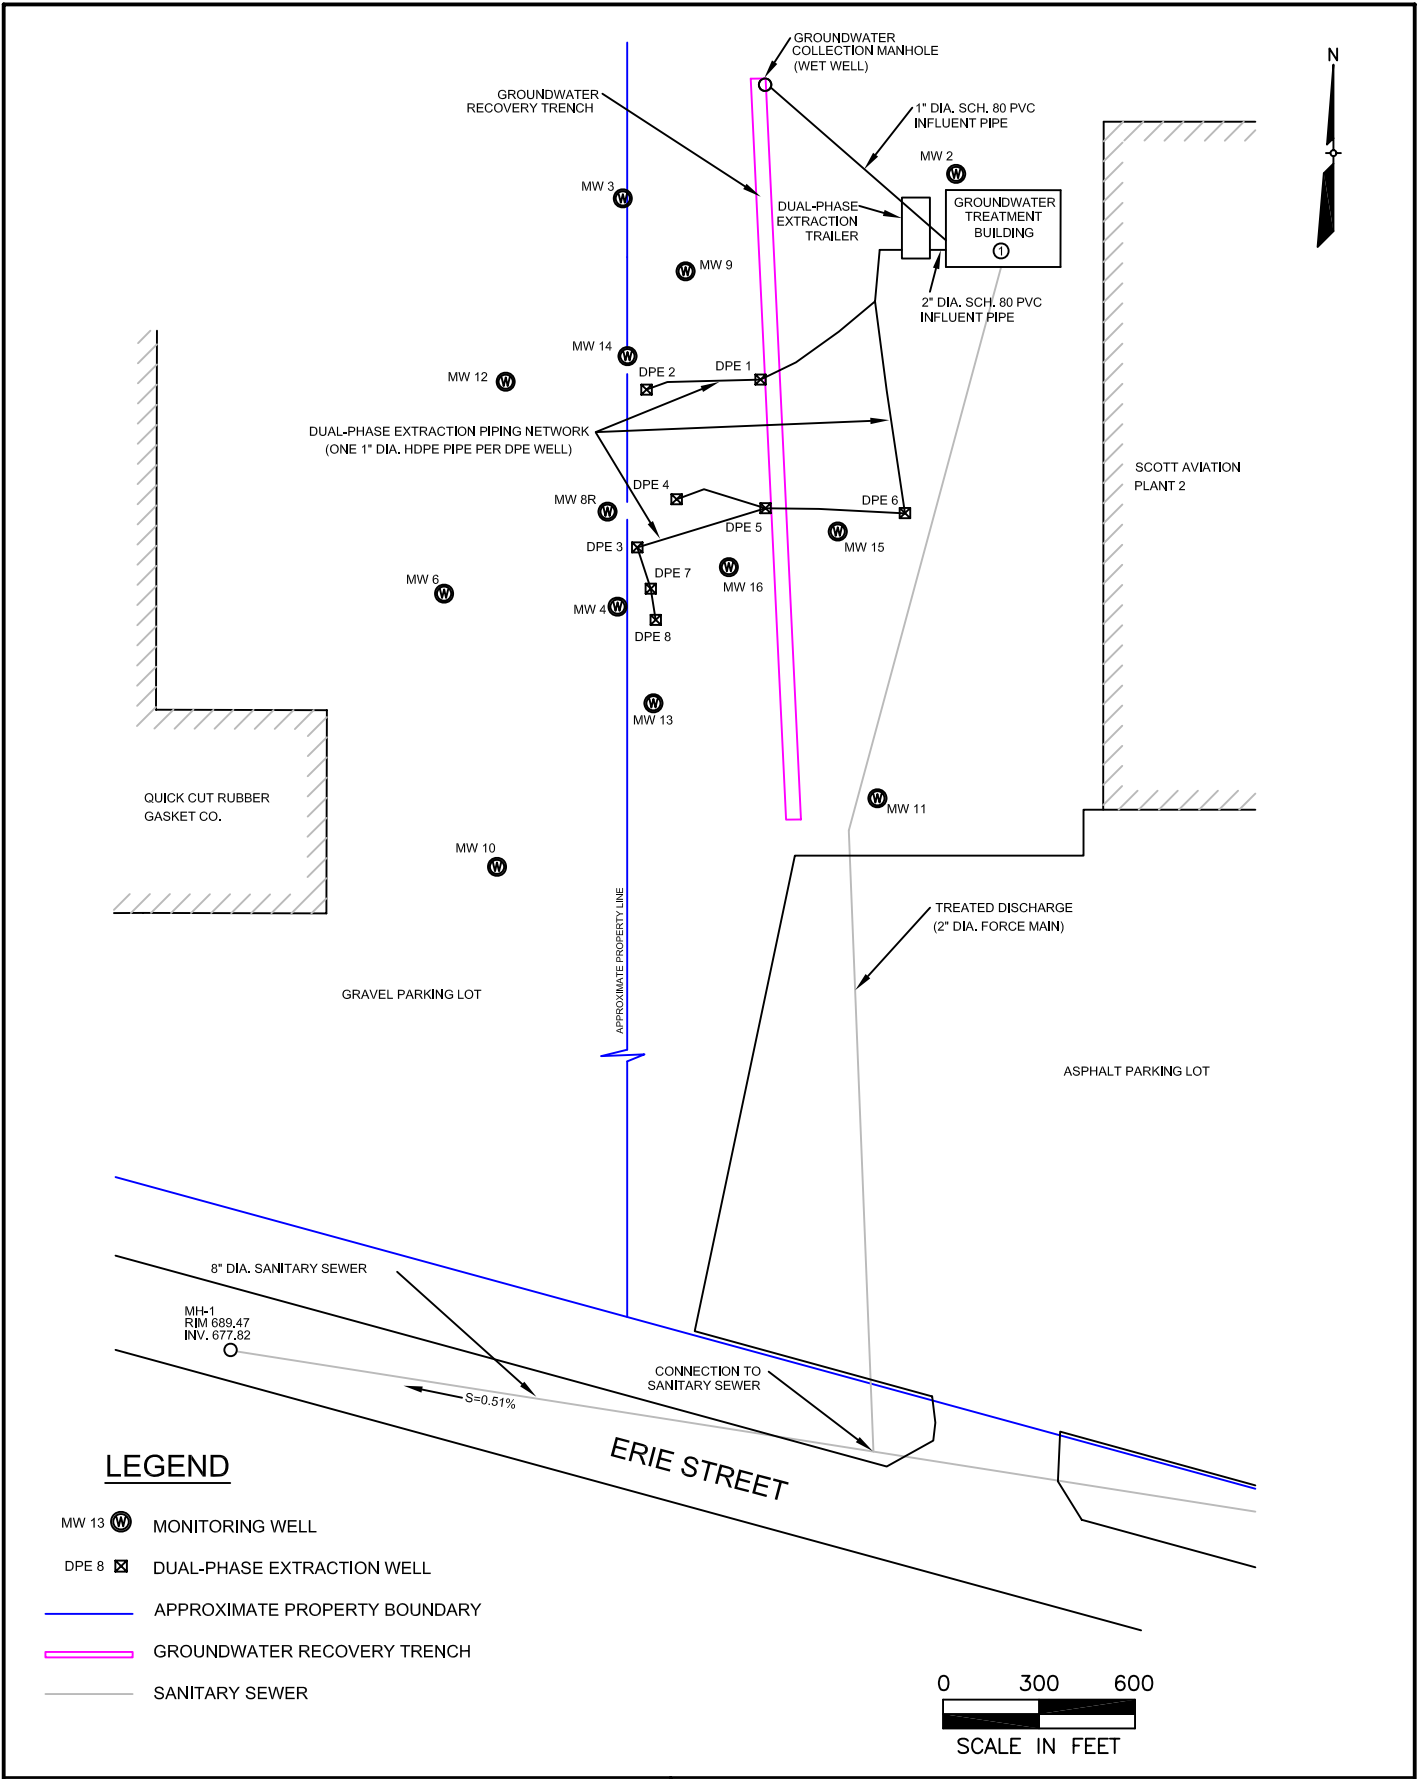

**FIGURE 1
DUAL PHASE EXTRACTION SYSTEM
LOCATION MAP**

FORMER SCOTT AVIATION FACILITY
LANCASTER, NEW YORK



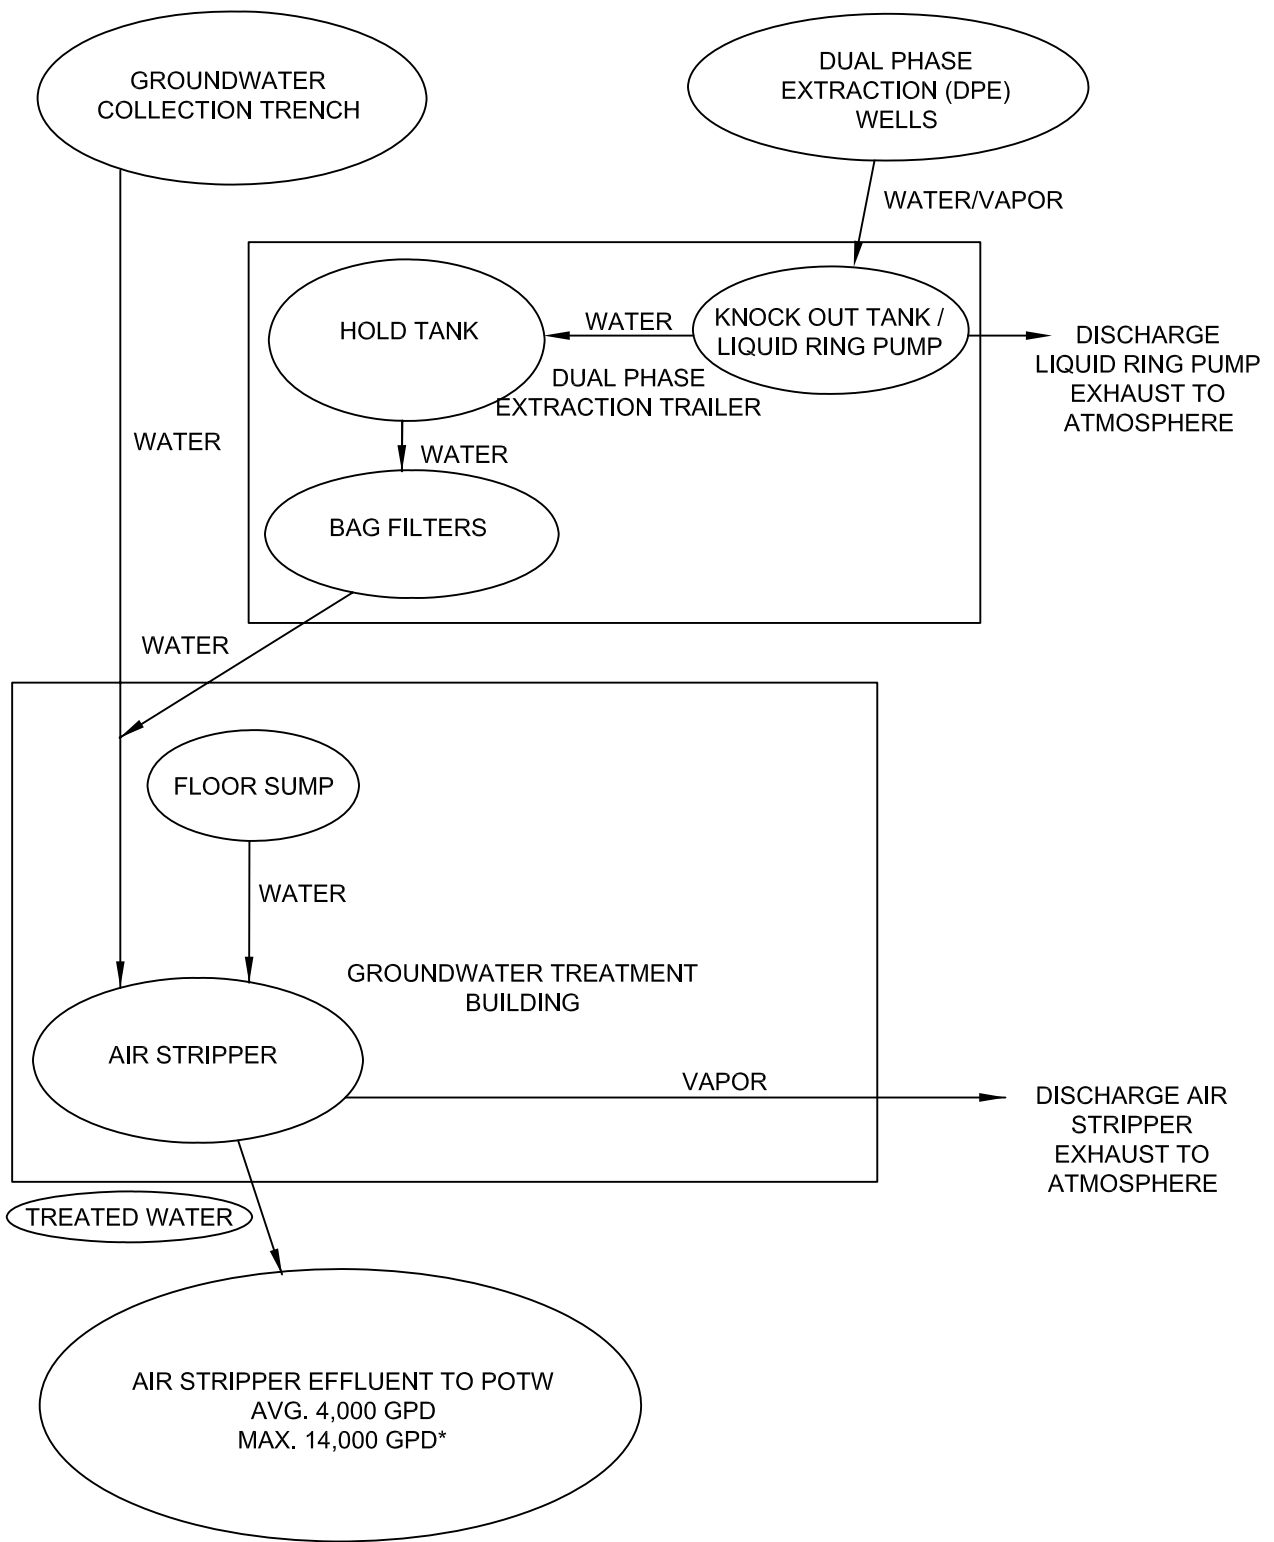

*PER DISCHARGE PERMIT NO. 08-02-E4045



FIGURE 2
COMBINED DUAL PHASE EXTRACTION
REMEDICATION SYSTEM FLOW DIAGRAM

FORMER SCOTT AVIATION FACILITY
 LANCASTER, NEW YORK

DAILY FIELD LOG

DAILY FIELD LOG

AECOM

Project Scott Technologies, Inc., Groundwater Remediation Site, Lancaster, NY
Date 12-Oct-09
Weather Cloudy
Temperature Range 30 - 45 F
AECOM Personnel on Site Dino Zack
Time on Site 06:30hrs to 16:30hrs

Air Stripper Totalizer Before Sampling 15764132 gallons (07:00hrs)
Air Stripper Totalizer After Sampling 15765643 gallons (15:00hrs)

Summary of Sample Activities

Time = 07:00hrs
 pH = 7.8
 Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.

Time = 10:00hrs
 pH = 7.9
 Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1, 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1, 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.

Time = 12:30hrs
 pH = 7.5
 Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1, 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1, 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.


Time = 15:00hrs
 pH = 7.6
 Fill 2, 40-ml vials (preserved with HCl) from influent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, from influent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from influent tap. Fill 1, 250-ml plastic bottle (unpreserved) 1/4 full from influent tap. Water quality is clear with slight odor (no sheen).

Fill 2, 40-ml vials (preserved with HCl) from effluent sample tap. Fill 1, 1-L clear glass bottle (preserved with H₂SO₄) 1/4 full, respectively, from effluent tap. Fill 1, 500-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Fill 1, 250-ml plastic bottle (unpreserved) 1/4 full from effluent tap. Water quality is clear with no discernable odor or sheen.

Comments

DPE system and GWCT running at time of sample collection.
 Air samples were collected at 10:00hrs from AS effluent and LRP effluent.
 Maintain samples at 4 degrees C. Hand deliver samples to TestAmerica Laboratories, Inc. (Amherst, NY) under COC on 10/14/09 for analysis. Request laboratory to composite 40-ml samples and analyze for VOCs (8260; TCL and STARS). Request laboratory to analyze influent and effluent samples for TEH (1664), TSS (160.2), and pH.

Signature:



Date: 12-Oct-09

LABORATORY REPORT

Analytical Report

Work Order: RSJ0852

Project Description

Scott Aviation site - Influent/Effluent

For:

Dino Zack

AECOM - Amherst, NY

100 Corporate Pkwy-Univ Centre

Amherst, NY 14226



Brian Fischer

Project Manager

Brian.Fischer@testamericainc.com

Thursday, October 29, 2009

The test results in this report meet all NELAP requirements for analytes for which accreditation is required or available. Any exception to NELAP requirements are noted in this report. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. All questions regarding this test report should be directed to the TestAmerica Project manager who has signed this report.

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

TestAmerica Buffalo Current Certifications

As of 1/27/2009

STATE	Program	Cert # / Lab ID
Arkansas	CWA, RCRA, SOIL	88-0686
California*	NELAP CWA, RCRA	01169CA
Connecticut	SDWA, CWA, RCRA, SOIL	PH-0568
Florida*	NELAP CWA, RCRA	E87672
Georgia*	SDWA, NELAP CWA, RCRA	956
Illinois*	NELAP SDWA, CWA, RCRA	200003
Iowa	SW/CS	374
Kansas*	NELAP SDWA, CWA, RCRA	E-10187
Kentucky	SDWA	90029
Kentucky UST	UST	30
Louisiana*	NELAP CWA, RCRA	2031
Maine	SDWA, CWA	NY0044
Maryland	SDWA	294
Massachusetts	SDWA, CWA	M-NY044
Michigan	SDWA	9937
Minnesota	SDWA, CWA, RCRA	036-999-337
New Hampshire*	NELAP SDWA, CWA	233701
New Jersey*	NELAP, SDWA, CWA, RCRA,	NY455
New York*	NELAP, AIR, SDWA, CWA, RCRA, CLP	10026
Oklahoma	CWA, RCRA	9421
Pennsylvania*	NELAP CWA, RCRA	68-00281
Tennessee	SDWA	02970
Texas*	NELAP CWA, RCRA	T104704412-08-TX
USDA	FOREIGN SOIL PERMIT	S-41579
USDOE	Department of Energy	DOECAP-STB
Virginia	SDWA	278
Washington*	NELAP CWA, RCRA	C1677
Wisconsin	CWA, RCRA	998310390
West Virginia	CWA, RCRA	252

*As required under the indicated accreditation, the test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in this report.

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Received: 10/14/09
Reported: 10/29/09 15:15

CASE NARRATIVE

According to 40CFR Part 136.3, pH, Chlorine Residual, Dissolved Oxygen, Sulfite, and Temperature analyses are to be performed immediately after aqueous sample collection. When these parameters are not indicated as field (e.g. field-pH), they were not analyzed immediately, but as soon as possible after laboratory receipt.

A pertinent document is appended to this report, 1 page, is included and is an integral part of this report.

Reproduction of this analytical report is permitted only in its entirety. This report shall not be reproduced except in full without the written approval of the laboratory.

TestAmerica Laboratories, Inc. certifies that the analytical results contained herein apply only to the samples tested as received by our Laboratory.

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

DATA QUALIFIERS AND DEFINITIONS

- D08** Dilution required due to high concentration of target analyte(s)
E Concentration exceeds the calibration range and therefore result is semi-quantitative.
HFT The holding time for this test is immediate. It was analyzed in the laboratory as soon as possible after receipt.
J Analyte detected at a level less than the Reporting Limit (RL) and greater than or equal to the Method Detection Limit (MDL). Concentrations within this range are estimated.
P17 Lab to composite samples by date/time/flow.
SL Volatile sample was composited in the laboratory prior to analysis.
NR Any inclusion of NR indicates that the project specific requirements do not require reporting estimated values below the laboratory reporting limit.

AECOM - Amherst, NY
100 Corporate Pkwy- Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Executive Summary - Detections

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-01 (INFLUENT - Water)					Sampled: 10/12/09 07:00			Recvd: 10/14/09 12:30		
<u>Volatile Organic Compounds by EPA 8260B</u>										
1,1,1-Trichloroethane	2.8	SL,J	5.0	0.26	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,1-Dichloroethane	6.2	SL	5.0	0.38	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Acetone	13	SL,J	25	1.3	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Chloroethane	15	SL	5.0	0.32	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
cis-1,2-Dichloroethene	320	SL,E	5.0	0.38	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Trichloroethene	120	SL,E	5.0	0.46	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Vinyl chloride	4.6	SL,J	5.0	0.24	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B

General Chemistry Parameters

pH	8.06	HFT	NR	0.00	SU	1.00	10/14/09 20:17	JFR	9J14133	4500-H+ B
Total Suspended Solids	9.2		4.0	4.0	mg/L	1.00	10/16/09 15:00	AMP	9J16028	2540D

Sample ID: RSJ0852-01RE1 (INFLUENT - Water)

Sampled: 10/12/09 07:00

Recvd: 10/14/09 12:30

Volatile Organic Compounds by EPA 8260B

1,1,1-Trichloroethane	2.8	D08, SL,J	25	1.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,1-Dichloroethane	6.2	D08, SL,J	25	1.9	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Acetone	17	D08, SL,J	120	6.7	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Chloroethane	28	D08, SL	25	1.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
cis-1,2-Dichloroethene	320	D08, SL	25	1.9	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Trichloroethene	120	D08, SL	25	2.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Vinyl chloride	4.6	D08, SL,J	25	1.2	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B

Sample ID: RSJ0852-02 (EFFLUENT - Water)

Sampled: 10/12/09 07:00

Recvd: 10/14/09 12:30

Volatile Organic Compounds by EPA 8260B

Acetone	7.1	J	25	1.3	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
---------	-----	---	----	-----	------	------	----------------	-----	---------	-------

General Chemistry Parameters

pH	8.36	HFT	NR	0.00	SU	1.00	10/14/09 20:17	JFR	9J14133	4500-H+ B
----	------	-----	----	------	----	------	----------------	-----	---------	-----------

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Received: 10/14/09
Reported: 10/29/09 15:15

Sample Summary

Sample Identification	Lab Number	Client Matrix	Date/Time Sampled	Date/Time Received	Sample Qualifiers
INFLUENT	RSJ0852-01	Water	10/12/09 07:00	10/14/09 12:30	P17
EFFLUENT	RSJ0852-02	Water	10/12/09 07:00	10/14/09 12:30	P17
TRIP BLANK	RSJ0852-03	Water	10/12/09	10/14/09 12:30	

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-01 (INFLUENT - Water)							Sampled: 10/12/09 07:00		Recvd: 10/14/09 12:30	
<u>Volatile Organic Compounds by EPA 8260B</u>										
1,1,1-Trichloroethane	2.8	SL,J	5.0	0.26	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,1,2,2-Tetrachloroethane	ND	SL	5.0	0.21	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,1,2-Trichloroethane	ND	SL	5.0	0.23	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	SL	5.0	0.31	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,1-Dichloroethane	6.2	SL	5.0	0.38	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,1-Dichloroethene	ND	SL	5.0	0.29	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,2,4-Trichlorobenzene	ND	SL	5.0	0.41	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,2-Dibromo-3-chloropropane	ND	SL	5.0	0.39	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,2-Dibromoethane	ND	SL	5.0	0.17	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,2-Dichlorobenzene	ND	SL	5.0	0.20	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,2-Dichloroethane	ND	SL	5.0	0.21	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,2-Dichloropropane	ND	SL	5.0	0.32	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,3-Dichlorobenzene	ND	SL	5.0	0.36	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
1,4-Dichlorobenzene	ND	SL	5.0	0.39	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
2-Butanone	ND	SL	25	1.3	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
2-Hexanone	ND	SL	25	1.2	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
4-Methyl-2-pentanone	ND	SL	25	0.91	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Acetone	13	SL,J	25	1.3	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Benzene	ND	SL	5.0	0.41	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Bromodichloromethane	ND	SL	5.0	0.39	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Bromoform	ND	SL	5.0	0.26	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Bromomethane	ND	SL	5.0	0.28	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Carbon disulfide	ND	SL	5.0	0.19	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Carbon Tetrachloride	ND	SL	5.0	0.27	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Chlorobenzene	ND	SL	5.0	0.32	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Dibromochloromethane	ND	SL	5.0	0.32	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Chloroethane	15	SL	5.0	0.32	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Chloroform	ND	SL	5.0	0.34	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Chloromethane	ND	SL	5.0	0.35	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
cis-1,2-Dichloroethene	320	SL,E	5.0	0.38	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
cis-1,3-Dichloropropene	ND	SL	5.0	0.36	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Cyclohexane	ND	SL	5.0	0.53	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Dichlorodifluoromethane	ND	SL	5.0	0.29	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Ethylbenzene	ND	SL	5.0	0.18	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Isopropylbenzene	ND	SL	5.0	0.19	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Methyl Acetate	ND	SL	5.0	0.50	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Methyl-t-Butyl Ether (MTBE)	ND	SL	5.0	0.16	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Methylcyclohexane	ND	SL	5.0	0.50	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Methylene Chloride	ND	SL	5.0	0.44	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Styrene	ND	SL	5.0	0.18	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Tetrachloroethene	ND	SL	5.0	0.36	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Toluene	ND	SL	5.0	0.51	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
trans-1,2-Dichloroethene	ND	SL	5.0	0.42	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
trans-1,3-Dichloropropene	ND	SL	5.0	0.37	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Trichloroethene	120	SL,E	5.0	0.46	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Trichlorofluoromethane	ND	SL	5.0	0.15	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B
Vinyl chloride	4.6	SL,J	5.0	0.24	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B

TestAmerica Buffalo

10 Hazelwood Drive Amherst, NY 14228 tel 716-691-2600 fax 716-691-7991

www.testamericainc.com

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852
Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Received: 10/14/09
Reported: 10/29/09 15:15

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method	
Sample ID: RSJ0852-01 (INFLUENT - Water) - cont.						Sampled: 10/12/09 07:00		Recvd: 10/14/09 12:30			
<u>Volatile Organic Compounds by EPA 8260B - cont.</u>											
Xylenes, total	ND	SL	15	0.66	ug/L	1.00	10/20/09 12:16	DHC	9J20010	8260B	
1,2-Dichloroethane-d4	94 %	SL	<i>Surr Limits: (66-137%)</i>					10/20/09 12:16	DHC	9J20010	8260B
4-Bromofluorobenzene	105 %	SL	<i>Surr Limits: (73-120%)</i>					10/20/09 12:16	DHC	9J20010	8260B
Toluene-d8	106 %	SL	<i>Surr Limits: (71-126%)</i>					10/20/09 12:16	DHC	9J20010	8260B
<u>General Chemistry Parameters</u>											
SGT Total Petroleum Hydrocarbons	ND		5.0	1.9	mg/L	1.00	10/20/09 10:20	RMM	9J19058	1664 SGT	
pH	8.06	HFT	NA	0.00	SU	1.00	10/14/09 20:17	JFR	9J14133	4500-H+ B	
Total Suspended Solids	9.2		4.0	4.0	mg/L	1.00	10/16/09 15:00	AMP	9J16028	2540D	

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-01RE1 (INFLUENT - Water)			Sampled: 10/12/09 07:00				Recvd: 10/14/09 12:30			
<u>Volatile Organic Compounds by EPA 8260B</u>										
1,1,1-Trichloroethane	2.8	D08, SL,J	25	1.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,1,2,2-Tetrachloroethane	ND	D08, SL	25	1.1	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,1,2-Trichloroethane	ND	D08, SL	25	1.2	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,1,2-Trichloro-1,2,2-trifluoroethane	ND	D08, SL	25	1.5	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,1-Dichloroethane	6.2	D08, SL,J	25	1.9	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,1-Dichloroethene	ND	D08, SL	25	1.5	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2,4-Trichlorobenzene	ND	D08, SL	25	2.0	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2-Dibromo-3-chloropropane	ND	D08, SL	25	2.0	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2-Dibromoethane	ND	D08, SL	25	0.83	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2-Dichlorobenzene	ND	D08, SL	25	1.0	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2-Dichloroethane	ND	D08, SL	25	1.1	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2-Dichloropropane	ND	D08, SL	25	1.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,3-Dichlorobenzene	ND	D08, SL	25	1.8	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,4-Dichlorobenzene	ND	D08, SL	25	2.0	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
2-Butanone	ND	D08, SL	120	6.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
2-Hexanone	ND	D08, SL	120	6.2	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
4-Methyl-2-pentanone	ND	D08, SL	120	4.5	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Acetone	17	D08, SL,J	120	6.7	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Benzene	ND	D08, SL	25	2.0	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Bromodichloromethane	ND	D08, SL	25	1.9	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Bromoform	ND	D08, SL	25	1.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Bromomethane	ND	D08, SL	25	1.4	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Carbon disulfide	ND	D08, SL	25	0.97	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Carbon Tetrachloride	ND	D08, SL	25	1.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Chlorobenzene	ND	D08, SL	25	1.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Dibromochloromethane	ND	D08, SL	25	1.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Chloroethane	28	D08, SL	25	1.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Chloroform	ND	D08, SL	25	1.7	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Chloromethane	ND	D08, SL	25	1.7	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
cis-1,2-Dichloroethene	320	D08, SL	25	1.9	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
cis-1,3-Dichloropropene	ND	D08, SL	25	1.8	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Cyclohexane	ND	D08, SL	25	2.7	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Dichlorodifluoromethane	ND	D08, SL	25	1.4	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Ethylbenzene	ND	D08, SL	25	0.92	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Isopropylbenzene	ND	D08, SL	25	0.96	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Methyl Acetate	ND	D08, SL	25	2.5	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Methyl-t-Butyl Ether (MTBE)	ND	D08, SL	25	0.80	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Methylcyclohexane	ND	D08, SL	25	2.5	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Methylene Chloride	ND	D08, SL	25	2.2	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Styrene	ND	D08, SL	25	0.92	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Tetrachloroethene	ND	D08, SL	25	1.8	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Toluene	ND	D08, SL	25	2.6	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
trans-1,2-Dichloroethene	ND	D08, SL	25	2.1	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
trans-1,3-Dichloropropene	ND	D08, SL	25	1.8	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Trichloroethene	120	D08, SL	25	2.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Trichlorofluoromethane	ND	D08, SL	25	0.76	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
Vinyl chloride	4.6	D08, SL,J	25	1.2	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B

TestAmerica Buffalo

10 Hazelwood Drive Amherst, NY 14228 tel 716-691-2600 fax 716-691-7991

www.testamericainc.com

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852
Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Received: 10/14/09
Reported: 10/29/09 15:15

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-01RE1 (INFLUENT - Water) - cont.					Sampled: 10/12/09 07:00			Recvd: 10/14/09 12:30		
<u>Volatile Organic Compounds by EPA 8260B - cont.</u>										
Xylenes, total	ND	D08, SL	75	3.3	ug/L	5.00	10/21/09 11:32	DHC	9J21019	8260B
1,2-Dichloroethane-d4	98 %	D08, SL	Surr Limits: (66-137%)				10/21/09 11:32	DHC	9J21019	8260B
4-Bromofluorobenzene	109 %	D08, SL	Surr Limits: (73-120%)				10/21/09 11:32	DHC	9J21019	8260B
Toluene-d8	107 %	D08, SL	Surr Limits: (71-126%)				10/21/09 11:32	DHC	9J21019	8260B

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-02 (EFFLUENT - Water)						Sampled: 10/12/09 07:00		Recvd: 10/14/09 12:30		
<u>Volatile Organic Compounds by EPA 8260B</u>										
1,1,1-Trichloroethane	ND		5.0	0.26	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,1,2,2-Tetrachloroethane	ND		5.0	0.21	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,1,2-Trichloroethane	ND		5.0	0.23	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		5.0	0.31	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,1-Dichloroethane	ND		5.0	0.38	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,1-Dichloroethene	ND		5.0	0.29	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2,4-Trichlorobenzene	ND		5.0	0.41	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2-Dibromo-3-chloropropane	ND		5.0	0.39	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2-Dibromoethane	ND		5.0	0.17	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2-Dichlorobenzene	ND		5.0	0.20	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2-Dichloroethane	ND		5.0	0.21	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2-Dichloropropane	ND		5.0	0.32	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,3-Dichlorobenzene	ND		5.0	0.36	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,4-Dichlorobenzene	ND		5.0	0.39	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
2-Butanone	ND		25	1.3	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
2-Hexanone	ND		25	1.2	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
4-Methyl-2-pentanone	ND		25	0.91	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Acetone	7.1	J	25	1.3	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Benzene	ND		5.0	0.41	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Bromodichloromethane	ND		5.0	0.39	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Bromoform	ND		5.0	0.26	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Bromomethane	ND		5.0	0.28	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Carbon disulfide	ND		5.0	0.19	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Carbon Tetrachloride	ND		5.0	0.27	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Chlorobenzene	ND		5.0	0.32	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Dibromochloromethane	ND		5.0	0.32	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Chloroethane	ND		5.0	0.32	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Chloroform	ND		5.0	0.34	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Chloromethane	ND		5.0	0.35	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
cis-1,2-Dichloroethene	ND		5.0	0.38	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
cis-1,3-Dichloropropene	ND		5.0	0.36	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Cyclohexane	ND		5.0	0.53	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Dichlorodifluoromethane	ND		5.0	0.29	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Ethylbenzene	ND		5.0	0.18	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Isopropylbenzene	ND		5.0	0.19	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Methyl Acetate	ND		5.0	0.50	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Methyl-t-Butyl Ether (MTBE)	ND		5.0	0.16	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Methylcyclohexane	ND		5.0	0.50	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Methylene Chloride	ND		5.0	0.44	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Styrene	ND		5.0	0.18	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Tetrachloroethene	ND		5.0	0.36	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Toluene	ND		5.0	0.51	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
trans-1,2-Dichloroethene	ND		5.0	0.42	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
trans-1,3-Dichloropropene	ND		5.0	0.37	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Trichloroethene	ND		5.0	0.46	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Trichlorofluoromethane	ND		5.0	0.15	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
Vinyl chloride	ND		5.0	0.24	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B

TestAmerica Buffalo

10 Hazelwood Drive Amherst, NY 14228 tel 716-691-2600 fax 716-691-7991

www.testamericainc.com

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852
Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Received: 10/14/09
Reported: 10/29/09 15:15

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-02 (EFFLUENT - Water) - cont.						Sampled: 10/12/09 07:00		Recvd: 10/14/09 12:30		
<u>Volatile Organic Compounds by EPA 8260B - cont.</u>										
Xylenes, total	ND		15	0.66	ug/L	1.00	10/21/09 11:57	DHC	9J21019	8260B
1,2-Dichloroethane-d4	93 %		<i>Surr Limits: (66-137%)</i>				10/21/09 11:57	DHC	9J21019	8260B
4-Bromofluorobenzene	104 %		<i>Surr Limits: (73-120%)</i>				10/21/09 11:57	DHC	9J21019	8260B
Toluene-d8	102 %		<i>Surr Limits: (71-126%)</i>				10/21/09 11:57	DHC	9J21019	8260B
<u>General Chemistry Parameters</u>										
SGT Total Petroleum Hydrocarbons	ND		5.0	1.9	mg/L	1.00	10/20/09 10:20	RMM	9J19058	1664 SGT
pH	8.36	HFT	NA	0.00	SU	1.00	10/14/09 20:17	JFR	9J14133	4500-H+ B
Total Suspended Solids	ND		4.0	4.0	mg/L	1.00	10/16/09 15:00	AMP	9J16028	2540D

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-03 (TRIP BLANK - Water)							Sampled: 10/12/09		Recvd: 10/14/09 12:30	
<u>Volatile Organic Compounds by EPA 8260B</u>										
1,1,1-Trichloroethane	ND		5.0	0.26	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,1,2,2-Tetrachloroethane	ND		5.0	0.21	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,1,2-Trichloroethane	ND		5.0	0.23	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,1,2-Trichloro-1,2,2-trifluoroethane	ND		5.0	0.31	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,1-Dichloroethane	ND		5.0	0.38	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,1-Dichloroethene	ND		5.0	0.29	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2,4-Trichlorobenzene	ND		5.0	0.41	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2-Dibromo-3-chloropropane	ND		5.0	0.39	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2-Dibromoethane	ND		5.0	0.17	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2-Dichlorobenzene	ND		5.0	0.20	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2-Dichloroethane	ND		5.0	0.21	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2-Dichloropropane	ND		5.0	0.32	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,3-Dichlorobenzene	ND		5.0	0.36	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,4-Dichlorobenzene	ND		5.0	0.39	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
2-Butanone	ND		25	1.3	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
2-Hexanone	ND		25	1.2	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
4-Methyl-2-pentanone	ND		25	0.91	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Acetone	ND		25	1.3	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Benzene	ND		5.0	0.41	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Bromodichloromethane	ND		5.0	0.39	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Bromoform	ND		5.0	0.26	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Bromomethane	ND		5.0	0.28	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Carbon disulfide	ND		5.0	0.19	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Carbon Tetrachloride	ND		5.0	0.27	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Chlorobenzene	ND		5.0	0.32	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Dibromochloromethane	ND		5.0	0.32	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Chloroethane	ND		5.0	0.32	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Chloroform	ND		5.0	0.34	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Chloromethane	ND		5.0	0.35	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
cis-1,2-Dichloroethene	ND		5.0	0.38	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
cis-1,3-Dichloropropene	ND		5.0	0.36	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Cyclohexane	ND		5.0	0.53	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Dichlorodifluoromethane	ND		5.0	0.29	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Ethylbenzene	ND		5.0	0.18	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Isopropylbenzene	ND		5.0	0.19	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Methyl Acetate	ND		5.0	0.50	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Methyl-t-Butyl Ether (MTBE)	ND		5.0	0.16	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Methylcyclohexane	ND		5.0	0.50	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Methylene Chloride	ND		5.0	0.44	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Styrene	ND		5.0	0.18	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Tetrachloroethene	ND		5.0	0.36	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Toluene	ND		5.0	0.51	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
trans-1,2-Dichloroethene	ND		5.0	0.42	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
trans-1,3-Dichloropropene	ND		5.0	0.37	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Trichloroethene	ND		5.0	0.46	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Trichlorofluoromethane	ND		5.0	0.15	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
Vinyl chloride	ND		5.0	0.24	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B

TestAmerica Buffalo

10 Hazelwood Drive Amherst, NY 14228 tel 716-691-2600 fax 716-691-7991

www.testamericainc.com

AECOM - Amherst, NY
100 Corporate Pkwy-Univ Centre
Amherst, NY 14226

Work Order: RSJ0852

Received: 10/14/09
Reported: 10/29/09 15:15

Project: Scott Aviation site - Influent/Effluent
Project Number: EARTH

Analytical Report

Analyte	Sample Result	Data Qualifiers	RL	MDL	Units	Dil Fac	Date Analyzed	Lab Tech	Batch	Method
Sample ID: RSJ0852-03 (TRIP BLANK - Water) - cont.					Sampled: 10/12/09			Recvd: 10/14/09 12:30		
<u>Volatile Organic Compounds by EPA 8260B - cont.</u>										
Xylenes, total	ND		15	0.66	ug/L	1.00	10/20/09 13:07	DHC	9J20010	8260B
1,2-Dichloroethane-d4	99 %		<i>Surr Limits: (66-137%)</i>				10/20/09 13:07	DHC	9J20010	8260B
4-Bromofluorobenzene	110 %		<i>Surr Limits: (73-120%)</i>				10/20/09 13:07	DHC	9J20010	8260B
Toluene-d8	110 %		<i>Surr Limits: (71-126%)</i>				10/20/09 13:07	DHC	9J20010	8260B

