

Attachment C-1

Report Name: Phase I Environmental Site Assessment Report
Site Name: C. R. Huntley Steam Station and C.R Huntley Fly Ash Landfill
Report Dated: February 4, 1998
Prepared by: Fluor Daniel GTI, Inc.
of pages: 658

ENV-10-04
Huntley Station
North America, Northeast

000060711

0
2
0

1998
0002

A NE



Supplemental Phase I ESA, April 1998
Volume 1 of 2
Huntley Station
Niagara Mohawk Power Corporation / NiMo / 1998
ENV-10-04
000060711

NRG019138

CONTENTS

Volume I

	<u>Page</u>
1.0 INTRODUCTION	1
1.1 General	1
1.2 Purpose and Objectives	1
1.3 Work Scope and Report Content Overview	2
1.4 Limitation of Work Product	2
2.0 PROPERTY LOCATION AND DESCRIPTION	3
2.1 C. R. Huntley Steam Station Property	3
2.1.1 Description of Property and Operations	3
2.1.2 Vicinity Description and Environmental Setting	4
2.1.3 Topographic and Geologic Setting	4
2.2 C. R. Huntley Fly Ash Landfill	5
2.2.1 Description of Property and Operations	5
2.2.2 Vicinity Description and Environmental Setting	6
2.2.3 Topographic and Geologic Setting	7
3.0 PHASE 1 ENVIRONMENTAL SITE ASSESSMENT METHODOLOGY	8
3.1 Records Review	8
3.1.1 Environmental Database Records	8
3.1.2 Previous Assessments	10
3.2 Historical Use Sources	10
3.2.1 Aerial Photograph Review	10
3.2.2 Fire Insurance Maps	11
3.3 Site Reconnaissance	11
3.4 Interviews with Owners; Local Officials	11
3.5 Evaluation of Asbestos Containing Materials	12
4.0 RESULTS OF RECORDS REVIEW, SITE RECONNAISSANCE AND INTERVIEWS	14
4.1 C. R. Huntley Steam Station Property	14
4.1.1 Site History and Previous Operations	14
4.1.2 Steam Station Process Areas	15
4.1.2.1 General Description of Process Equipment.	15
4.1.2.2 Wastewater and Industrial Cooling Water Collection and Drainage Systems	16
4.1.2.3 Bulk and Drum Chemical Handling and Storage Areas	17
4.1.2.4 Oil-Containing Hydraulic Systems	19
4.1.2.5 Hazardous Waste Storage Areas.	19
4.1.2.6 Subbasement Area	19

PRIVILEGED AND CONFIDENTIAL - ATTORNEY WORK PRODUCT

4.1.3	Switchyards and Transformers	20
4.1.3.1	Switchyards Transformers and Oil-Containing Circuit Breakers	20
4.1.3.2	Station and Yard Transformers	20
4.1.3.3	Dielectric Oil Cables	21
4.1.3.4	Oil/Water Separators	21
4.1.4	Bulk Fuel Oil Storage and Handling Areas	21
4.1.4.1	Fuel Oil/Diesel Storage Tanks	21
4.1.4.2	Oil Pipelines	22
4.1.4.3	Unit Fuel Oil Pumps	22
4.1.4.4	Underground Fuel Oil/Gasoline Tanks	23
4.1.5	Coal Storage and Handling Areas	23
4.1.5.1	Coal Pile	23
4.1.5.2	Car Dumper Building	24
4.1.5.3	Breaker House, Junction House, Thaw Shed	24
4.1.6	Solid Waste Storage and Handling	24
4.1.6.1	Existing Fly Ash Silo/Flowable Fill Transfer Area	24
4.1.6.2	Boiler Cleaning Wastes	24
4.1.6.3	Used Oil Management	24
4.1.6.4	Miscellaneous Trash and Debris	25
4.1.7	Wastewater and Stormwater Collection and Treatment Facilities	25
4.1.7.1	Wastewater Treatment Building and Equalization Basins	25
4.1.7.2	48-inch and 36-inch storm drains	25
4.1.7.3	Slag Ponds	26
4.1.7.4	Open Drainage Channels	27
4.1.8	Accessory Buildings and General Yard Areas	28
4.1.8.1	Tractor Garage; Storage Buildings	28
4.1.8.2	Transformer Storage Area	28
4.1.8.3	Areas Containing Fill, Yard Waste, Debris	28
4.1.9	Groundwater Quality	29
4.1.10	Adjoining Property Uses	30
4.1.10.1	North	31
4.1.11.2	South	31
4.1.11.3	East	31
4.1.11.4	West	32
4.2	C. R. Huntley Fly Ash Landfill	32
4.2.1	Site History and Previous Operations	32
4.2.2	Stormwater Collection, Monitoring and Discharge	33
4.2.3	Leachate Collection, Monitoring and Discharge	33
4.2.4	Truck Wash Area	34
4.2.5	Flowable Fly Ash/Concrete Mixing Plant	34
4.2.6	Landfill Cell Operation	35
4.2.7	Manhole MH-24 Area	35
4.2.8	Groundwater Quality	36

PRIVILEGED AND CONFIDENTIAL - ATTORNEY WORK PRODUCT

4.2.9	Adjoining Property Uses	37
4.2.9.1	North	37
4.2.9.2	South	37
4.2.9.3	East	37
4.2.9.4	West	38
5.0	SUMMARY	39
5.1	C. R. Huntley Steam Station	39
5.1.1	Steam Station Process Units	39
5.1.2	Switchyards and Transformers	40
5.1.3	Bulk Fuel Oil Storage and Handling Areas	41
5.1.4	Coal Storage and Handling Areas	42
5.1.5	Solid Waste Storage and Handling	42
5.1.6	Wastewater and Stormwater Collection and Treatment Facilities	43
5.1.7	Accessory Buildings and General Yard Areas	43
5.1.8	Groundwater Quality	44
5.1.9	Adjoining Properties	44
5.2	C. R. Huntley Fly Ash Landfill	44
5.2.1	Stormwater Collection, Monitoring and Discharge	44
5.2.2	Leachate Collection, Monitoring and Discharge	44
5.2.3	Truck Wash Area	45
5.2.4	Flowable Fly Ash/Concrete Mixing Plant	45
5.2.5	Manhole 24 Area	45
5.2.6	Groundwater Quality	45
5.2.7	Adjoining Property Uses	45
6.0	REFERENCES	46

Tables

- 1 Records of Spills and Releases

Figures

- 1a Site Location Map - C. R. Huntley Steam Station
1b Site Location Map - C. R. Huntley Steam Station
2a Site Map - C. R. Huntley Steam Station
2b Site Map - C. R. Huntley Fly Ash Landfill

VOLUME II

Appendices

- A1. Environmental Data Resources Report - C. R. Huntley Steam Station
A2. Environmental Data Resources Report - C. R. Huntley Fly Ash Landfill

1.0 INTRODUCTION

1.1 General

Fluor Daniel GTI, Inc. (Fluor Daniel GTI) has prepared this report which presents the procedures, results and conclusions for the modified ASTM Phase 1 Environmental Site Assessment (ESA) Program completed at the C. R. Huntley Steam Station and C. R. Huntley Fly Ash Landfill properties owned by Niagara Mohawk Power Corporation (NMPC). The C. R. Huntley Steam Station is a six-unit coal-fired generating plant located in the Town of Tonawanda, Erie County, New York (figure 1a, Site Location Map). The C. R. Huntley Fly Ash Landfill is also located in the Town of Tonawanda, approximately five miles north of the C. R. Huntley Steam Station (figure 1b, Site Location Map).

This project was completed in response to NMPC's request of May 28, 1997 for a scope of work to evaluate potential environmental liabilities associated with the operation of the C. R. Huntley Steam Station and C. R. Huntley Landfill or from earlier usages, and Fluor Daniel GTI's meetings with NMPC on May 23, 1997 and September 11, 1997. The scope of work was set forth in a proposal prepared by Fluor Daniel GTI, dated September 13, 1997 and subsequent meetings. The Phase 1 ESA work steps were completed in general accordance with the guidelines and accepted practices as set forth by the American Society for the Testing of Materials (ASTM, 1997), and included the review of standard environmental record sources, completion of a site reconnaissance visit, and interviews with site personnel and state regulatory officials.

1.2 Purpose and Objectives

The overall objective of the modified Phase 1 ESA program was to support NMPC's non-nuclear generation divestiture plan, as submitted to the New York State Public Service Commission on November 26, 1997. The scope of the modified Phase 1 ESA program was to report the presence of environmental issues that may have resulted from the operation of the C. R. Huntley Steam

Station and C. R. Huntley Fly Ash Landfill or from property earlier usages. The presence and nature of potential industrial residues in surface soil, subsurface soil, and groundwater was also assessed through the review of available chemical data collected by NMPC.

1.3 Work Scope and Report Content Overview

The modified Phase 1 ESA Program Work Breakdown Structure included the completion of the following major tasks in support of meeting the stated project objectives; 1) records review, 2) site reconnaissance, 3) personnel interviews, and 4) preparation of a Phase 1 ESA report.

The following sections describe the location and setting of each site (section 2.0), the methods and scope completed (section 3.0), the observations produced during the Phase 1 ESA program (section 4.0), a summary of observations regarding areas containing potential environmental issues (section 5.0), and the various documents reviewed and referenced in this report (section 6.0).

1.4 Limitation of Work Product

Fluor Daniel GTI has reviewed the information concerning the environmental conditions at the subject property, and prepared a report in a professional manner using that degree of skill and care exercised for similar projects under similar conditions by reputable and competent environmental consultants. The information contained in this report, including its observations, is based on the information which was made available to Fluor Daniel GTI during the investigation and upon the services described, which were performed within the time and budgetary requirements of the NMPC. Because the report was based on available information, some of its observations could be different if the information upon which it is based is determined to be false, inaccurate, or contradicted by additional information.

Fluor Daniel GTI makes no representation concerning the legal significance of its observations or the value of the property investigated. Fluor Daniel GTI has no liability to third parties for the information or opinions contained in this report. This report is not intended to satisfy the requirements of the National Contingency Plan.

2.0 PROPERTY LOCATION AND DESCRIPTION

The following sections describe the subject properties and industrial operations conducted at each, and their physical and environmental settings. Descriptions were developed from documentation provided by NMPC, available reports, and the physical site inspection.

2.1 C. R. Huntley Steam Station Property

2.1.1 Description of Property and Operations

The C. R. Huntley Steam Station is located on a parcel of land of approximately 90 acres which is adjacent to the Niagara River (figure 1a, Site Location Map). Including the Steam Station and its ancillary structures, approximately 350,000 square feet are under roof. The remainder of the site is covered by grass, pavement, or crushed stone.

The C. R. Huntley Steam Station features six electric-producing boiler/generator sets (Units 63 through 68) (figure 2a). Units 63 through 66 were built between 1942 and 1954, and are located in the north building (Station 2). These units have a generating capacity of 100 megawatts each. Units 67 and 68 were built between 1957 and 1958, and have a generating capacity of 200 megawatts each, bringing the plant total capacity to approximately 800 megawatts. Units 67 and 68 are housed in the Station 1 plant. All six units are coal-fired.

The Steam Station buildings are composed of brick, over concrete block exterior walls. A portion of Station 1 and Station 2 have corrugated metal siding. Supporting columns on piles extend to the underlying bedrock. Interior walls and floors are concrete block throughout the generating station; the administrative offices are finished with painted drywall and linoleum and tile floors.

The Steam Station buildings house the various components required for the transport of fuel, water, and air through the boiler as steam is generated to power the turbines. In general, these include systems to: 1) Transport coal or start-up oil to the burner for combustion, 2) transport, purify, and heat water as it travels through the boiler, 3) heat air and transport it through the boilers, 4) provide

cooling and lubrication to the steam turbines, 5) cool the generators, 6) remove and collect ash from the combustion gas stream, 7) transmit the generated power to the adjacent substation, and 8) control the processes involved in the power generation cycle. These systems are described within this report in the context of observations or information reviewed with respect to their ability to release (or potentially release) substances that may produce residual environmental impacts at the C. R. Huntley Steam Station.

The C. R. Huntley Steam Station parcel also includes petroleum bulk storage tanks for unit start-up, and a coal handling and storage area. Coal is delivered primarily by rail and water. The plant is served by a Conrail line, which enters the parcel from its eastern side. The Niagara River provides access for vessels up to 625 feet in length and 21 feet draft which may dock at the Steam Station. Electric transmission lines enter transformer switchyards (a 115 kV and a 230 kV switchyard) on the parcel from the northeast.

The coal car dumping area is located east of the Steam Station, across River Road. The coal storage area is located just south of the powerhouse. A wastewater treatment system treats metal-containing waters, which are first discharged to two equalization basins south of the coal storage area. A separate system consisting of a pond south of the powerhouse (South Slag Pond) and three ponds northeast of the powerhouse (North Slag Ponds) provide settling and oil skimming capabilities for waters discharged from the powerhouse.

2.1.2 Vicinity Description and Environmental Setting

The C. R. Huntley Steam Station is located in an industrialized area adjacent to the Niagara River, in the Town of Tonawanda, Erie County, New York. The surrounding area to the south and north is commercial and industrial. Industry and a few private residences are located east of the plant. To the west is the Niagara River.

2.1.3 Topographic and Geologic Setting

The C. R. Huntley Steam Station lies within the Erie-Niagara Basin, at an elevation of approximately 576 feet above mean sea level, as interpreted from the United States Geological Survey (USGS) Buffalo Northwest - Ontario Quadrangle (1965). Water in the form of precipitation generally flows west toward the Niagara River as sheet drainage and through on-site storm sewers.

The area around the C. R. Huntley Steam Station is relatively flat and is situated on the floodplain of the Niagara River. Along the Niagara River, the shallow soils underlying the site are generally fill (artificially-emplaced materials including silt, sand, gravel, bricks, fly ash, and bottom ash) overlying recent alluvial deposits (fine sand, some gravel), with a total overburden thickness ranging from 30 to 45 feet. To the east of River Road, the alluvial deposits are not present but the surface fill overlies a downward sequence of glaciolacustrine clay, silt, and a sandy till unit, overlying the Camillus Shale formation of the Salina Group (Recra, 1979). The total overburden thickness in borings east of River Road exceeded 65 feet.

The shallow water table has been encountered at approximately five to nine feet below grade in fill and alluvial sediments in the surficial unconfined water bearing unit (Recra, 1979). Groundwater flow in the surficial materials is described by Recra to flow across the site to the west.

Groundwater within the Camillus shale may be partially confined to the east by the overlying glacial till and clay. Water levels were considerably deeper in wells finished in the bedrock, and may have been influenced by industrial pumping wells which were reported to be present (Recra, 1979). Water quality in the Camillus Shale is notably poor, containing high levels of dissolved solids, sulfate, hardness, and chloride.

2.2 C. R. Huntley Fly Ash Landfill

2.2.1 Description of Property and Operations

The C. R. Huntley Fly Ash Landfill (herein called the Landfill) is located in the Town of Tonawanda, Erie County, New York (figure 1b, Site Location Map). It is located approximately 1.2 miles north of the C. R. Huntley Steam Station (NMPC, 1989) and comprises approximately 117 acres. It is a fully permitted New York State (NYS) 6NYCRR Part 360 solid waste management facility.

NMPC purchased the land that the landfill is currently on in 1969 from the Cherry family. The 1951 aerial photograph shows the parcel as undeveloped land. Operation of the landfill began in 1971, on previously undeveloped land that was part of a farm. The 1972 aerial photograph shows landfilling

operations within the Phase 1 cells. At present a total of 65 acres, has been filled to capacity and closed (Phase 1 areas, figures 2b, site map). The remaining acreage, known as Phase 2, was approved by the NYSDEC for landfill expansion, and is currently being filled (figure 2b, Site Map).

In addition, other major components of the facility include a flow equalization basin, flow retention basin, surface runoff control ditches, leachate collection and control system, flowable fly ash/concrete mixing plant, two access roads (north and south), storage pile (for "borrow" material), and a truck wash area. A chain link security fence with lockable main gates encompasses the Landfill (figure 2b).

The Landfill is designed and operated to accept Steam Station wastes including boiler fly ash, pulverizer rejects, bottom ash, and wastewater treatment sludge. These wastes are predominantly generated by NMPC's C. R. Huntley Steam Station. Projected solid waste disposal rates within the facility during the Phase 2 expansion design were on the order of 164,000 tons per year of fly ash (NMPC, 1989). In 1995, and 1996, total solid waste disposal was reduced at the facility to 77,200 tons and 52,300 tons per year respectively, as a result of successful fly ash marketing efforts.

2.2.2 Vicinity Description and Environmental Setting

The C. R. Huntley Fly Ash Landfill is located in a high density industrial area (Pirnie, 1989). It is bounded on the south by Tonawanda Coke Corporation, and INS Scrapyard (formerly known as Buffalo Slag Company), to the north by NOCO Oil Company (formerly Hambleton Oil Terminal), and to the west by NMPC electrical transmission lines. To the east, the site is bounded by River Road. The Niagara River lies to the east of River Road, and is approximately 1,100 feet from the landfill (Pirnie, 1989).

From adjacent highways (River Road and Grand Island Blvd), the topographic elevation of completed Phase 1 cells and active Phase 2 cells are the dominant physiographic features of the facility. The surface of the closed cells supports a dense (grass) vegetative cover.

2.2.3 Topographic and Geologic Setting

The C.R. Huntley Fly Ash Landfill lies at an elevation of approximately 600 feet above mean sea level, as interpreted from the USGS Buffalo Northwest Ontario Quadrangle (1965), and NMPC-provided facility maps (NMPC, 1993). The area of the Landfill is relatively flat, but the slopes of completed cells (Phase 1) rise to a maximum elevation of approximately 650 feet from various vantage points around the facility. Surface drainage in the area flows to peripheral drains which divert the water to retention basins. Ultimately, flow is toward the west to River Road. There are no natural surface water drainage channels or water bodies present on the site.

The C.R. Huntley Fly Ash Landfill lies within the Erie-Niagra Drainage Basin. The area around the Landfill is relatively flat, lying on the floodplain of the Niagara River. The Erie-Niagara Drainage Basin is comprised of a fine-grained shale from the Camillus formation of the Salina group. The bedrock, which was found on-site at depths ranging from approximately 30 to 50 feet below grade during a hydrogeologic investigation completed by Pirmie (1989), is overlain by unconsolidated glacial deposits. The glacial deposits consist of a lodgement till, glaciolacustrine and glaciofluvial deposits. The overburden material in the area of the Landfill ranges in thickness from 50 feet to several hundred feet. At the Landfill proper, soil boring data indicated that the unconsolidated deposits found on-site ranged from 40 to 50 feet, and consisted of fly ash, miscellaneous fill, glaciolacustrine clays, silts, sands and gravels (Pirmie, 1989).

Based on a review of the Hydrogeologic Report (Pirmie, 1989), groundwater occurs both in the unconsolidated deposits, under water table (unconfined) conditions, and in the underlying bedrock under confined conditions. The glaciolacustrine deposits (clays, silts) and the lodgement till appear to act as a confining layer that separates the bedrock aquifer from the water-table aquifer. Depth to water in the water-table aquifer ranges from approximately 5 to 35 feet below grade. The potentiometric water surface of the bedrock aquifer ranges in depth from 3 to 45 feet below grade. The general direction of groundwater flow is east to west toward the Niagara River (Pirine, 1989).

3.0 PHASE 1 ENVIRONMENTAL SITE ASSESSMENT METHODOLOGY

This section describes the Phase 1 ESA scope of the work completed to identify environmental issues that may have resulted from the operation of the sites or from earlier usage, in accordance with modified ASTM (1997) practices and as proposed by Fluor Daniel GTI. The future potential for existing equipment or operating practices to emit releases, and facility compliance with regulatory requirements were not reviewed during the Phase 1 ESA. As per NMPC direction, a thorough assessment of the transformer switchyards at the C. R. Huntley Steam Station was not included in this work assignment, as these areas are to remain with NMPC's Transmission and Distribution Company.

The major Phase 1 ESA task elements completed for each site included a: 1) review of records available from standard environmental sources and from NMPC, 2) an on-site reconnaissance visit, 3) interviews with site personnel and regulatory officials, and 4) the preparation of a Phase 1 ESA report.

3.1 Records Review

3.1.1 Environmental Database Records

A review of reasonably ascertainable public and regulatory agency records was conducted to identify recognized environmental issues associated with the sites and sites in the vicinity. These records were supplied by a commercial source, Environmental Data Resources, Inc. (EDR, 1997a, 1997b).

The following data bases were searched, at the search distance noted.

- Federal National Priorities List (NPL); 1.25 mile radius.
- Delisted NPL; Subject property only.

- Federal Resource Conservation and Recovery Act - Transportation Storage and Disposal Facilities (RCRA-TSD); 1.25 mile radius.
- NY State Inactive Hazardous Waste Sites (IHWS); 1.25 mile radius
- Federal Comprehensive Environmental Response, Compensation, and Liability Information System (CERCLIS); 1.25 mile radius.
- Corrective Action Reports (CORRACTS); 1.25 mile radius.
- State Landfill (SWF/LF); 1.25 mile radius.
- State Leaking Underground Storage Tank (LUST) Site List; 0.75 mile radius.
- State Underground Storage Tank Registry (UST) Site List; 0.5 mile radius.
- State Aboveground Storage Tank Registry (AST) Site List; 0.5 mile radius.
- RCRA Administrative Tracking System (RAATS); 1.25 mile radius.
- RCRA Sm/Lg. Quan. Generators; 1.25 mile radius.
- Hazardous Materials Information Reporting System (HMIRS); target property only.
- PCB Activity Database System (PADS); Target Property only
- Emergency Response Notification System (ERNS); Target property only.
- Facility Index System (FINDS); 1.25 mile radius.
- Toxic Chemical Release Inventory System (TRIS); Target property only.
- Federal Superfund Liens (NPL Liens); Target property only.
- Toxic Substance Control Act (TSCA); Target Property only.
- Material Licensing Tracking System (MLTS); 1.25 mile radius.

- NY State Spill file (**NY Spills**); 1.25 mile radius.
- Records of Decision (**RODs**); 1.25 mile radius.
- Superfund (CERCLA) Consent Decrees (**CONSENT**); 1.25 mile radius.
- Coal Gas sites; 1 mile radius.

The complete EDR reports for each site, with a list of the sites detected in each database, is included as appendices A1 and A2.

In addition to the data bases identified above, the United States Geological Survey (USGS) 7.5 Minute Buffalo NW, NY - Ontario Quadrangle Topographic Map was reviewed to provide information about the geologic, hydrogeologic, and topographic characteristics of the sites, as described previously.

3.1.2 Previous Assessments

In addition to the review of environmental databases and historical records listed above, available chemical data collected by NMPC regarding the presence and nature of potential industrial residues in surface soil, subsurface soil, and groundwater was evaluated. These data included hydrogeologic and wastewater assessments of the C. R. Huntley Steam Station (Recra, 1979; Stanley Consultants 1982, and Frontier Technical Associates, 1997a). Data reviewed for the C. R. Huntley Landfill included a Hydrogeologic Report (Pimie, 1989), monthly and quarterly sampling and analysis reports (Frontier Technical Associates, 1997b and 1997c), and the Phase 2 Landfill Expansion Application (NMPC, 1989).

3.2 Historical Use Sources

3.2.1 Aerial Photograph Review

In order to develop a history of the previous uses of the property and surrounding area, aerial photographs of the C. R. Huntley Steam Station and C. R. Huntley Landfill for the years 1938-1939, 1951, 1972, 1978, and 1985 were requested from National Aerial Resources, a commercial source of

historical information. The photographs from 1938, 1951, and 1985, were received for the C. R. Huntley Steam Station and reviewed in preparation of this report. Additional photographs for 1972 and 1978 were available for the C. R. Huntley Landfill.

3.2.2 Fire Insurance Maps

Sanborn™ Fire Insurance Maps for the years 1950 and 1986 were obtained and reviewed for the C. R. Huntley Steam Station in preparation of this report. None were available for the Landfill.

3.3 Site Reconnaissance

The intent of the site reconnaissance was to identify environmental issues associated with the sites. A site visit to inspect the C. R. Huntley Steam Station property was conducted by Fluor Daniel GTI on October 22 and 23, 1997. The C. R. Huntley Fly Ash Landfill was also inspected on October 23, 1997. NMPC supervisors with knowledge about the historic operating practices at the sites were present during the site inspections to provide information and answer questions.

The sites were inspected for important surface indications of potential environmental impacts associated with on-site storage, usage, and handling of hazardous substances and petroleum, process units or areas, stained areas, stressed vegetation, etc. Transformers, dielectric systems, oil-containing circuit breakers, and other electrical equipment were also inspected. The general topographic setting and adjoining property uses were noted for comparison with historical data. Asbestos surveys have previously been completed for NMPC, and therefore, at NMPC direction; additional asbestos survey work was not completed during the Phase 1 ESA program.

3.4 Interviews with Owners; Local Officials

The staff and management of the NMPC C. R. Huntley Steam Station and NMPC Corporate Environmental Affairs Department possess valuable information about past practices and potential residual environmental impacts. On-site interviews were conducted with these personnel prior to the site reconnaissance visit. Persons interviewed included David Rengert, Director, Corporate

Environmental Licensing and Planning, Michael Robert, Engineer, Fossil Generation Engineering; Michael Boesi, Senior Environmental Analyst, NMPC C. R. Huntley Steam Station; and Michael Cummings, Auxiliary Waste Water Treatment Plant Operator, NMPC C. R. Huntley Steam Station.

Personnel at the New York State Department of Environmental Conservation (NYSDEC) were contacted on November 28, 1997 and December 5, 1997 and asked about their knowledge of the presence of environmental conditions at the C. R. Huntley Steam Station that might require abatement to mitigate potential risks to public health or the environment, or in response to an applicable state or federal regulation. The persons contacted included Frank Kelly and Mary McIntosh of NYSDEC Region 9, Division of Solid Waste, Robert Leary of NYSDEC, Division of Oil Spill Response, Jim Strickland of NYSDEC Region 9, Division of Hazardous Substances, and Dan King of NYSDEC Region 9, Division of Environmental Remediation. These persons were not aware of any on-going conditions at the C. R. Huntley Steam Station that would require a response action.

Personnel at the NYSDEC were also contacted on November 28, 1997 and asked about their knowledge of the presence of environmental conditions at the C. R. Huntley Fly Ash Landfill that might require abatement to mitigate potential risks to public health or the environment, or in response to an applicable state or federal regulation. Mr. Kelly indicated that he wanted to get additional data from NMPC regarding the landfill liner leak detection flow rate. NMPC is collecting additional flow data in order to evaluate this issue. To the best of his knowledge, the preliminary data he has observed does not indicate that a "problem" with the landfill exists. Ms. McIntosh also expressed concerns over leak detection, and indicated that the "Equalization Basin" has exceeded the design flow rate. Ms. McIntosh relayed that she thought NMPC should evaluate this item. She also stated that the MW-8S well cluster had in the past shown exceedances for chlorinated volatile organic compounds (VOCs), but that it was attributable to off-site sources. NMPC has replaced this well and is conducting additional sampling to further evaluate this issue.

3.5 Evaluation of Asbestos Containing Materials

Entek Environmental & Technical Services, Inc. (Entek, 1990) conducted asbestos surveys and analyzed samples collected from the steam boilers and various operating areas at the C. R. Huntley Steam Station. Executive summaries of the reports were provided to Fluor Daniel GTI by NMPC. A summary of the information presented in these executive summaries follows.

Through inspection and/or sampling, Entek concluded that asbestos was present in areas including shop areas, the electric area, the administration building, 25-cycle area, boilers 63, 64, and 67, and Building 1-4. Asbestos was found in material such as thermal insulation for piping and fittings, vinyl floors and mastic, surface treatment and sprayed-on coatings and duct work insulation. Asbestos was found in debris on grating, concrete floors, and equipment.

Station personnel indicated that in response to the 1900 Entek "Asbestos Survey and Assessment" report, the necessary housekeeping to remove the debris from accessible areas of the plant has been performed. Additionally, accessible damaged insulation was replaced as part of an on-going housekeeping effort. Asbestos was also replaced when maintenance activities and capital improvement projects required the removal of insulation. This work was performed in compliance with Department of Labor Code Rule 56 and EPA guidelines.

According to NMPC personnel, asbestos removal operations are completed as damaged material is identified. NMPC personnel were not able to estimate the percentage of the recommendations made by Entek that have been completed at the C. R. Huntley Steam Station.

4.0 RESULTS OF RECORDS REVIEW, SITE RECONNAISSANCE AND INTERVIEWS

This section includes a description of each major area or process assessed by Fluor Daniel GTI during the completion of the Phase 1 ESA. The description includes all pertinent information obtained by Fluor Daniel GTI for each area during the review of available records during the site inspection, and from interviews with NMPC personnel and regulatory officials.

4.1 C. R. Huntley Steam Station Property

This section presents the description of the C. R. Huntley Steam Station.

4.1.1 Site History and Previous Operations

According to NMPC literature, some of the present buildings at the C. R. Huntley Steam Station date back to 1916. The C. R. Huntley Steam Station began by producing 25-cycle power. The path of the old Erie Canal is shown on NMPC plot maps of the site (figure 2a). The 1938 aerial photograph for the C. R. Huntley Steam Station shows both Station 1 and Station 2 buildings; smoke can be seen emanating from a stack in Station 2. An area north of Station 2 appears to be cleared and may be a small transformer yard but cannot be clearly distinguished as such on this photograph. An access roadway is visible leading out to River Road from the north end of Station 2. An area that may be a slag pond is visible at the south end of the property. The coal conveyor building on the eastern side of River Road is visible, but the car dumpster building is not distinguishable.

The 1950 Sanborn Map for the site shows seven turbo generator sets in the Station 1 building, at the southern end of the Steam Station. Four steam turbine sets are shown in Station 2, which appears to be a larger building than in the 1938 aerial photograph. A transformer yard and transformer repair room are shown along the southern end of the west wall of Station 1. The building that currently houses Units 67 and 68 had not been built. A small (115 kV) switchyard is shown in the area of the current switchyard. The "Terminal C" substation is also shown on this map. Two pump houses for off-site properties (Dunlop Tire and Rubber and the Buffalo Electro Chemical Company, now known as FMC Corp.) are shown west of the Steam Station, along the Niagara River. Dunlop's

water lines are shown as two 12-inch lines running parallel to the underground coal conveyor, which feeds coal from the car dumper building east of River Road to a junction tower, and then inside the Steam Station. Coal storage is shown to the south of the Steam Station, as it is currently stored, and in the north yard area, just east of Station 2. The existing breaker house and junction house do not appear on this map. An access road is shown leading out to an exit to River Road across from Kaufman Avenue across the area now occupied by the north slag ponds. The property east of the Steam Station, now referred to as the Polymer Applications site, is labeled on this map as belonging to Allegheny Ludlum Steel Corp.

The 1951 aerial photograph shows a slag pond at the south end of the property, which is expanded southward relative to the 1938 photograph. An area to the north of the C. R. Huntley Steam Station also appears to be a slag pond, and is located coincident with the western pond of the current system.

The 1985 aerial photograph shows a facility (reported by NMPC to be a flue gas desulphurization plant) at the northeast end of Station 2. The north and south slag ponds appear on this photo as currently configured.

On the 1986 Sanborn map, the portion of the building that houses Unit 67 and 68 electrostatic precipitators are shown, added to the east of Station 1. The coal conveyor is shown feeding from the car dumper building to a breaker house and junction house located at the former junction tower location, just south of Station 1. Coal storage is shown in a pile located south of the breaker building, and also in the north yard area on this map. Water line labeled as belonging to Buffalo Electro Chemical Corp. is shown across the north end of the Steam Station property. A NMPC drawing (1986) from this time period shows the 115 kV and 230 kV switchyards in their current locations. The ownership of the Polymer Applications site is not labeled.

4.1.2 Steam Station Process Areas

4.1.2.1 General Description of Process Equipment. During the inspection of the Steam Station, Fluor Daniel GTI observed the major stationary equipment located on the first floor of the plant. This equipment included boiler feed pumps, water treatment equipment, compressors, blowers for

coal pulverizers, turbine lubrication systems, etc. During the site inspection, minor leaks or spills of oil were observed around several of the larger units, such as soot-blowing and service air compressors, and pulverizer mills.

4.1.2.2 Wastewater and Industrial Cooling Water Collection and Drainage Systems. From the review of wastewater system drawings (Stanley Consultants, 1982) and as corroborated by NMPC personnel, wastewaters within the Steam Station are either directed to the facility's settling (slag) pond system located to the south and northeast of the powerhouse (i.e.; low-volume wastewater), or to the metal-containing wastewater system. The settling pond system and the (metal-containing) water treatment building are described in a later section of this report.

Wastewater from the powerhouse containing ash and oil is collected in a series of sumps, receiver basins, and slag pits, and pumped from either Station 2 to the north slag pond system or from Station 1 to the south slag pond. A few of these collection sumps and pits were inspected by Fluor Daniel GTI; although they were observed to contain ash, no oil was observed. After passing through the slag ponds, the wastewater from Station 2 is discharged through Outfalls H-001 and H-001A to a drainage ditch (River Road drain) running along the northern boundary of the Steam Station property, and discharging to the Niagara River. Waste water from the south slag pond is discharged to the Niagara River through Outfall H-008 as authorized by the facility's NYSDEC SPDES permit. The wastewater treatment building and slag ponds are discussed in greater detail in a later section of this report.

A few sources (Units 63 - 66 precipitator floor drains and induced draft fan cooling water) within the Steam Station discharge to the 48-inch storm drain (Stanley Consultants, 1982) and into the Niagara River (Outfall H-002) as per the SPDES permit. Additional sources, such as boiler feed pump drains, boiler blowdown, evaporator blowdown, electrical duct sump, and neutralized waters from demineralizer regeneration, discharge to the condenser cooling water discharge tunnels (Outfalls H-003, H-004, and H-005) and then to the Niagara River, as per the SPDES permit. In the past, the floor and equipment drains would have discharged to the cooling water discharge tunnels, according to NMPC personnel. A number of minor spills (table 1) have been reported in the past and have traveled through these outfalls. No visible sheens of oil were noted on the condenser cooling water tunnels or stormwater discharge outfalls during Fluor Daniel GTI's site inspection.

Entry into the subbasement at the C. R. Huntley Steam Station can be accomplished through manways and vaults, using ladders and confined-space entry procedures. No entry into the subbasement was performed during Fluor Daniel GTI's site inspection visit, and therefore wastewater piping in the subbasement of the powerhouse was not inspected. Fluor Daniel GTI is not aware that an integrity assessment of the piping has been conducted at the C. R. Huntley Steam Station.

Metal-containing waters from preheater washes at the C. R. Huntley Steam Station are transported to the equalization basin and wastewater treatment building, according to NMPC personnel. After treatment, these waters are discharged to the 36-inch storm drain through Outfall H-007A. Boiler chemical cleaning wastes are piped to four, 40,000-gallon tanks located within the plant. These wastes are then incinerated in the Steam Station boilers, as authorized by NYSDEC.

Process cooling water is taken into the powerhouse through two screenhouses, after passing through a trash rack which removes large pieces of debris (driftwood; etc) from the cooling water stream. The cooling water then passes through traveling screens which remove finer debris material. Screen backwash is returned to the Niagara River through Outfall 006M. Cooling water is returned to the Niagara River through the outfalls listed above after one pass through the Steam Station.

According to NMPC personnel, sanitary waste from within the Steam Station is directed to the Town of Tonawanda Wastewater Treatment Plant. NMPC personnel report that a limited number of floor and equipment drains also discharge to the Tonawanda Wastewater Treatment Plant, as authorized by the agreement with the Town.

4.1.2.3 Bulk and Drum Chemical Handling and Storage Areas. This section does not include a description of bulk fuel oil storage and handling, as these practices are covered in a following section of the report.

The main bulk chemical transfer and storage area at the C. R. Huntley Station is located outside the southeast corner of Station 2. A 7,200 gallon sodium hydroxide tank and a 6,400 gallon sulfuric acid tank are located there. These tanks appeared to be in good condition with no evidence of leaks or spills during Fluor Daniel GTI's site inspection. These tanks have secondary spill containment,

consisting of a concrete berm. A 1,750 gallon spill of sulfuric acid occurred at this location in 1995. Approximately 1,250 gallons were recovered but 500 gallons escaped to Outfall H-002 (table 1). The spill is shown as closed in the NYSDEC spill file (EDR, 1997a).

Inside Station 2, a 250 gallon process tank containing sodium hydroxide and a 287 gallon ferric sulfate tank are also present on the 6th floor. These tanks were not inspected by Fluor Daniel GTI. Two 100-gallon day tanks for temporary storage of sodium hydroxide and sulfuric acid are located on the first floor of Station 2. These tanks were found to be in good condition without evidence of leaks or spills during Fluor Daniel GTI's site inspection, and feature secondary spill containment consisting of a concrete berm.

Oil is stored and used within the Steam Station in various tanks and reservoirs. These vessels include 5,000 or 8,000-gallon capacity turbine oil storage tanks at each Unit, 2,200 to 5,200-gallon turbine oil reservoir tanks in the hotwells located in each Unit's hotwell area, and 300-gallon "Bowser"-type tanks and 500-gallon free-standing tanks that hold hydraulic, transmission, or engine oil located in oil storage rooms at each Station. These areas were generally neat and orderly with minor oil staining apparent during Fluor Daniel GTI's site inspection. These rooms are located on the first floor and are located over the subbasement. No floor drains were noted in the oil storage rooms.

Other chemicals stored in bulk included liquid carbon dioxide and lime. Because these substances were not judged to have the potential to leave significant residual impacts, they are not further discussed in this report.

Chemicals are stored in drums at several locations throughout the powerhouse. A main drum storage room is located at the south end of Station 1. Approximately 60 drums of various types of oil (lube oil, turbine oil, lithium grease, synthetic oil, gear oil, and transformer oil) and solute were observed. The room was very neat and orderly; no oil staining was apparent during Fluor Daniel GTI's site inspection and no floor drains were noted in the room. Two Unit oil drum storage rooms were observed, and were generally orderly with minor oil staining apparent during Fluor Daniel GTI's site inspection. Floor drains were not noted in these rooms. Each drummed oil storage room contained approximately 12 drums of various types of oil.

4.1.2.4 *Oil-Containing Hydraulic Systems.* The actuator system for Units 63 - 68 are hydraulic-oil based, and are not PCB-contaminated, according to NMPC. There are five elevators in the Steam Station, one for Units 67 and 68, two in the administration building, and one in each of the two fly ash hoppers. The base of the elevators extends into the subbasement and could not be inspected.

4.1.2.5 *Hazardous Waste Storage Areas.* The C. R. Huntley Steam Station's 1993 and 1995 hazardous waste generator reports were available for inspection (NMPC, 1994, 1996b). Hazardous waste streams manifested and shipped in 1993 included mineral spirits (Code D001), and waste solvents used for degreasing (F001). These wastes were sent to Safety Kleen Corporation in Lackawanna, NY and Linden, NJ. Hazardous waste streams manifested and shipped in 1995 included corrosive liquid wastes (Code D002), and mercury-contaminated equipment (D009). The EDR report (1997a) lists the C. R. Huntley Steam Station site as a Large Quantity Generator, although the data shown in the report is the 1993 quantity data and averages less than 1,000 kilograms per month. The C. R. Huntley Steam Station has since converted to a water-based non-hazardous solvent cleaning system. A permanent designated hazardous waste storage area was not observed at the C. R. Huntley Steam Station during Fluor Daniel GTI's site inspection. Based on 1997 manifest records, C. R. Huntley Steam Station is a Conditionally Exempt Small Quantity Generator.

Review of the USEPA records (EDR, 1997a) indicated that the C. R. Huntley Station was listed as a CERCLIS site. Subsequent communications with Dan King of the NYSDEC indicated that the C. R. Huntley Steam Station was initially listed together with the C. R. Huntley Fly Ash Landfill as a potential IHWS, but that both sites were subsequently removed from the list, as it was not determined by NYSDEC that hazardous waste had been disposed of on these sites (NYSDEC, 1993).

4.1.2.6 *Subbasement Area.* A full subbasement (approximately 8 to 10 feet deep) underlies the powerhouse and the equipment locations on the first floor. There are numerous openings to the subbasement, such as pipe chases and grates.

Human access to the subbasement may be gained through manholes or vaults. Fluor Daniel GTI was able to inspect portions of the subbasement through these openings. Many areas of the subbasement were observed to be covered with water or ash deposits. An oil spill of approximately 1,300 gallons was reported to have entered the subbasement in 1994, and was observed as a sheen in the south slag pond. The subbasement was pumped out at that time.

4.1.3 Switchyards and Transformers

4.1.3.1 Switchyards Transformers and Oil-Containing Circuit Breakers. Two switchyards are located to the north of the C. R. Huntley Station 2 powerhouse - a 115 kV yard, and a 230 kV yard. The southern (115 kV yard) transmits power for Units 63 to 66, while the northern (230 kV) yard transmits power for Units 67 and 68. Each switchyard contains transformers and oil-filled circuit breakers (OCBs). An aboveground 15,000 gallon cable oil storage and make-up tank is located in the switchyard. According to NMPC, there are currently no switchyard transformers or OCBs that are PCB-containing (greater than 500 ppm PCB content) or PCB-contaminated (PCBs greater than 50 ppm but less than 500 ppm). These appurtenances are to remain with NMPC as part of the Transmission and Distribution Company, and are only described here in general terms relative to their potential to impact the adjacent parts of the Steam Station.

Currently, the equipment contained in the yards appears to be in good condition, with only minor staining evident during Fluor Daniel GTI's site inspection. No spill events have been reported at the switchyards.

4.1.3.2 Station and Yard Transformers. NMPC's SPCC plan (1986) shows a total of 14 service and station transformers outside the station. These transformers are located along the west wall of Stations 1 and Station 2. According to NMPC personnel, none of these transformers are PCB-contaminated, having been retrofilled in the late 1980's. Oil staining was noted at the concrete base of some transformers during Fluor Daniel GTI's site inspection. Drainage from the concrete bases is captured in concrete trench drains, which then flows to two oil/water separators.

According to NMPC personnel, a 15,000-gallon aboveground transformer used oil tank had been mounted along the southern end of Station 1's west wall. According to NMPC, this tank was not PCB-contaminated. The concrete base of the tank was still present during Fluor Daniel GTI's site

inspection. Faint staining was noted on the concrete pad, however, the soils around the pad were not stained. NMPC's SPCC plan shows there are also 64 precipitator transformer rectifier sets, 10 house service transformers, and 80 oil-filled circuit breakers located inside the Steam Station. These units were not inspected by Fluor Daniel GTI.

4.1.3.3 Dielectric Oil Cables. Dielectric cables enter the Steam Station through a vault underlying the west wall of the Steam Station. Two cable oil reservoirs are located adjacent to the west wall of Station 1. Oil staining was observed in the cable vault area during Fluor Daniel GTI's site inspection. Fluor Daniel GTI was not able to ascertain by inspection the source of the oil.

4.1.3.4 Oil/Water Separators. A total of six underground oil/water separator units (tanks) are shown on NMPC's SPCC Plans. These units are located and collect stormwater drainage from the areas near the gate house, the southwest yard, to the west of Stations 1 and 2, from the switchyard, and near the coal car dumper area. The unit adjacent to the gatehouse would serve to contain spillage from the gasoline dispenser located in that area, and discharges to Outfall H-002. The unit located in the southwest yard discharges to Outfall H-007 through the 36-inch storm drain. The units located to the west of the Steam Station collect runoff from around the station transformers and drains from the fire pump house, and discharge to Outfalls H-004 and H-005. The discharge for the unit to the west of the switchyard is shown as "permanently closed" on NMPC's SPCC plan; there is no discharge through the unit currently. The unit to the south of the car dumper area collects water in the coal unloading area, located east of River Road, and discharges to Stormwater Outfall H-007. When inspected by Fluor Daniel GTI, clear water was present in the oil/water separator units located on the west side of the Steam Station.

4.1.4 Bulk Fuel Oil Storage and Handling Areas

4.1.4.1 Fuel Oil/Diesel Storage Tanks. There are six aboveground storage tanks (ASTs) located on the C. R. Huntley Steam Station property. These tanks include (NMPC, 1986):

- The main 30,000-gallon fuel oil AST located east of Station 1. This tank has secondary containment including a clay floor and clay dike.
- A 10,000-gallon fuel oil AST for Units 63 to 66, located at the northeast corner of Station 2. This tank has secondary containment including a 48-inch high concrete dike.

- A 12,000-gallon fuel oil AST for Units 67 and 68, located at the northeast corner of Station 1. This tank has secondary containment including a 48-inch high concrete dike.
- A 10,000-gallon diesel oil AST located west of the wastewater treatment building that supplies fuel to heavy equipment. The dispenser is located on the northeast corner of the Breaker House. This tank has secondary containment including a clay floor and clay dike.
- A 1,500-gallon diesel oil AST supplying fuel to a generator is located along the west wall of Station 1. This tank has secondary containment consisting of a 24-inch steel dike.
- A 5,000-gallon diesel AST is located south of the coal car dumper building. This tank has secondary containment consisting of a 38-inch concrete dike.

According to NMPC, these tanks are visually inspected monthly.

Five spill events are documented in NMPC (1986) and NYSDEC files (EDR, 1997a), adjacent to the main fuel oil tank, the diesel storage tank, and unidentified tanks in the north area. These spills have discharged to the Niagara River through Outfalls H-002 and H-007. The spill history for the C. R. Huntley Station obtained from these sources is included in table 1.

4.1.4.2 Oil Pipelines. Underground oil pipelines convey fuel from the tanks listed above except for the 1,500-gallon diesel generator tank and the 10,000 gal. fuel oil AST, which have aboveground piping systems. The main fuel oil storage tank is the oldest, dating from 1954. Since less than 10% of these tank systems are underground, regulations do not require testing of these lines, and no testing has been completed on these lines. In addition, the main pipeline from the 30,000 gallon AST is cathodically protected and all other underground oil pipelines are plastic coated.

4.1.4.3 Unit Fuel Oil Pumps. Two sets of oil pumps exist at the Steam Station which supply fuel to the boiler units. These pumps are mounted on pedestals on the first floor of the Steam Station. The pumps for Units 63 through 66 are located at the northeast corner of Station 2. The pumps for Unit 67 and 68 are located at the northeast end of Station 1. These units were found to be in reasonably good order; evidence of minor fuel oil leakage on the floor adjacent to these pumps was observed during the site inspection completed by Fluor Daniel GTI.

4.1.4.4 Underground Fuel Oil/Gasoline Tanks. Two 550-gallon underground gasoline tanks are located adjacent to a fuel dispenser island, west of the gate house. These tanks were installed in 1980, and are constructed of fiberglass reinforced plastic (FRP). Daily inventory testing and periodic tightness testing have been performed for this tank system. The last test was completed in 1992, and did not indicate a failure of the system, according to NMPC personnel. A Veeder-Root monitoring system was installed on this tank system in 1995, and has been in use since then; it has not indicated failure of the system.

Several former underground fuel oil storage tanks (USTs) were removed in 1985, according to NMPC personnel. These tanks included two 8,000 gallon USTs located in the southeast yard area, and an 8,000 gallon UST formerly located near the existing Station 2 fuel oil tank. No closure data for these tanks was available during Fluor Daniel GTI's preparation of this report. Three closed 8,700 gallon USTs appear in the NYSDEC Petroleum Bulk Storage (PBS) Registry, as well as a 1,500 gallon fuel oil UST, an unspecified 1,000 gallon UST, and a closed 250 gallon leaded gasoline UST.

4.1.5 Coal Storage and Handling Areas

4.1.5.1. Coal Pile. The yard area south of the powerhouse has been used for the storage and handling of coal as apparent in the 1938 aerial photograph, and probably since the earliest construction of the plant. Maps by Recra (1979), and NMPC (1986) and a 1985 aerial photograph indicate that the coal pile covers an area of approximately eight acres.

The area to the east of Station 2 has also been used extensively as a coal storage area, and appears as such in the earliest Sanborn Map reviewed for the site (1950). This area is presently grass-covered.

Concerns regarding potential surface water and groundwater impacts from coal storage led to a hydrogeologic investigation of the site (Recra, 1979), and on-going monitoring of the groundwater quality in the coalpile area (Frontier, 1997). The results of these investigations are presented in a following section of the report regarding groundwater quality. Currently, wastewater sludges and waste oil are placed on the coal pile and burned with the coal, according to NMPC personnel, as authorized by the NYSDEC.

4.1.5.2 Car Dumper Building. This building houses the coal car dumper mechanism. Several drums of motor oil were present inside the building when inspected by Fluor Daniel GTI. No spills or other indications of obvious releases or potential residual environmental issues were observed during Fluor Daniel GTI's site inspection.

4.1.5.3 Breaker House, Junction House, Thaw Shed. No indications of obvious releases or potential residual environmental issues were observed in these buildings during Fluor Daniel GTI's site inspection.

4.1.6 Solid Waste Storage and Handling

4.1.6.1 Existing Fly Ash Silo/Flowable Fill Transfer Area. A fly ash silo is located at the east side of the precipitators for Units 67 and 68. Fly ash which is stored in the silo is vacuumed into trucks in a 15 - 20% slurry and transported to the C. R. Huntley Fly Ash Landfill by Carmen Pariso Trucking. A flowable fly ash/concrete mixing plant is also operated at this location. The areas underneath and in the vicinity of the fly ash silo were covered with a fine layer of fly ash.

Fly ash is also removed from the settling ponds using a crane-mounted clamshell bucket, and transported to the C. R. Huntley Fly Ash Landfill, as described in a following section of this report.

4.1.6.2 Boiler Cleaning Wastes. Boiler cleaning chemical wastes, when generated, are piped to four 40,000 gallon ASTs located within the Steam Station. Boiler cleaning occurs, approximately, at four-year intervals. These wastes are then burned in the Steam Station boilers as approved by the NYSDEC. No boiler cleaning wastes were stored during Fluor Daniel GTI's site inspection, and the tanks were not inspected.

4.1.6.3 Used Oil Management. Used oil is accumulated in satellite drums throughout the plant. This oil consists of used and recovered oils, including turbine oil, hydraulic oil, and various lubricating oils. Used oil is transported to, and placed on, the coal pile (for incineration) in mobile tank units as authorized by NYSDEC. Used motor oils are accumulated in a 500-gallon skid tank outside the tractor building and are sent off-site for recycling by Bison Oil. Minor staining was observed on floor areas adjacent to oil accumulation drums within the plant during Fluor Daniel GTI's site inspection.

4.1.6.4 Miscellaneous Trash and Debris. Roll-off containers for plant trash and asbestos waste are located in the southeast yard area, east of Station 1. Trash and oily debris are handled by Browning-Ferris Industries.

4.1.7 Wastewater and Stormwater Collection and Treatment Facilities

4.1.7.1 Wastewater Treatment Building and Equalization Basins. A wastewater treatment building exists in the area southeast of Station 1 and east of the coal pile. It is used for the treatment of C. R. Huntley Steam Station metal-containing wastewaters and coal pile surface water runoff. These wastewaters are transferred to the equalization basins and are treated as batches. The wastewater plant appears from drawings (NMPC, 1986) to have been built and completed in the 1985 to 1987 time frame. Process units within the wastewater treatment building include a lime silo, and units for polymer addition, precipitation and settling, filtration, and neutralization. The wastewater treatment building was observed to be operating in an orderly fashion during Fluor Daniel GTI's site inspection. Oil leakage on the floor due to a faulty compressor seal was observed.

The wastewater treatment building is generally within the discharge parameters (Outfall H-007A) required by the facility's SPDES permit. During the site inspection completed by Fluor Daniel GTI, no sheens or visible discharges of oil were present from Outfall H-007 entering the Niagara River.

4.1.7.2 48-inch and 36-inch Storm Drains. Two drains convey stormwater to the Niagara River from the C. R. Huntley Steam Station yard areas, from various operating units within the facility, and from off-site sources.

A 48-inch diameter drain traverses the northern portion of the Steam Station, draining much of the stormwater from the yard to the north, northeast, and northwest of Station 2. The 48-inch drain discharges to the Niagara River through Outfall H-002. This drain conveys discharge from selected sources (Units 63 - 66 precipitator floor drains; induced draft fan cooling water; slag pit emergency overflow; chimney drains) within the Steam Station to the Niagara River (Stanley Consultants, 1982). The 48-inch drain also conveys stormwater from off-site drains along River Road and Sawyer Avenue, along which are located residences and industry, and wastewater or stormwater from the FMC Corporation, located east of River Road, to the Niagara River. FMC Corporation manufactures chemicals including peroxide. No reported exceedances of water quality were attributed to this

outfall in NMPC's records (1996a). During the site inspection completed by Fluor Daniel GTI, no sheens or visible discharges of oil were present from Outfall H-002 entering the Niagara River. However, there have been a number of reported spills and oil sheens that have occurred at this outfall (table 1).

The underdrain system from the switchyard is routed to an oil/water separator unit in the yard area northwest of Station 2. The discharge from this oil/water separator is marked "permanently closed" on a NMPC drawing (1986). Fluor Daniel GTI was not able to ascertain the method for management of accumulated switchyard stormwater during this assessment.

Disposition of stormwater from switchyards will have to be addressed as part of separation agreements negotiated with future buyers.

A 36-inch storm drain discharge traverses the southern portion of the Steam Station, draining much of the stormwater from the yard to the south, southeast, and southwest of Station 1, including the adjacent "Terminal C" substation (which will remain with NMPC's Transmission and Distribution Company). The 36-inch drain discharges to the Niagara River through Outfall H-007. This drain also conveys drainage from selected pieces of equipment (slag pit emergency overflow) within the Steam Station to the Niagara River (Stanley Consultants, 1982). The 36-inch drain conveys stormwater from the surface of River Road and the area to its east, including the coal car dumper area.

During the site inspection completed by Fluor Daniel GTI, no sheens or visible discharges of oil were present from Outfall H-007 entering the Niagara River. However, there have been a number of reported spills and oil sheens that have occurred at this outfall (table 1).

4.1.7.3 Slag Ponds. Steam Station wastewater containing ash and oil is discharged to the north and south slag pond system. The settling ponds provide retention time for the wastewater, allowing the ash to settle and oil to be removed prior to discharge to the Niagara River. The north slag pond system contains three ponds, discharging through Outfalls-H-001A and H-001B. The south slag pond discharges through Outfall H-008.

Fly ash accumulating in the ponds is removed periodically using a crane-mounted clamshell bucket, and is transported to the C. R. Huntley Fly Ash Landfill. An oil boom was placed across each slag pond, and an oil skimmer (rope-type) is located at the outfall for each pond. The skimmers were not operating during the site inspection completed by Fluor Daniel GTI and oil staining was noted on soils adjacent to the drum-size oil storage tanks next to each skimmer unit. The water within the ponds appeared clear and free of oil, other than a light sheen on the edges of each pond during Fluor Daniel GTI's site inspection. According to NMPC personnel, the ponds are inspected daily. One spill event resulted in oil being pumped to the south slag pond, where it was recovered (table 1).

During the past, NMPC personnel report that Dunlop had a 48-inch drain that discharged to the south slag pond. The River Road drain (see below) also discharges to the south slag pond. A review of spill reports indicates that Dunlop and Polymer Applications are listed IHWSs due to past disposal of oil and/or hazardous substances on their property. Samples collected by Recra (1979) detected the presence of phenol in the discharge from the south slag pond (1.23 milligrams per liter, maximum). Currently, Dunlop's drain discharges separately to the Niagara River. Polymer Applications has ceased operations and the discharge was plugged during the mid-1980s.

4.1.7.4 Open Drainage Channels. Two drainage channels have conveyed stormwater and waste water from off-site across NMPC property. To the north is a feature referred to as the North Drainage Channel, which conveys storm water from along and to the east of River Road. Trace phenols (0.020 mg/L, maximum) have been detected in this storm water (Recra, 1979).

Along the east side of the C. R. Huntley Steam Station property is a feature described as the "River Road ditch", according to NMPC personnel. This drainage feature at one time was the discharge point for stormwater and wastewater from the Polymer Applications site. In 1979, NMPC personnel reported seeing a reddish colored discharge and smelling an odor characteristic of phenols in this ditch. Samples from this time period detected phenols at concentrations of 310 mg/L, maximum (Recra, 1979). An Interim Removal Action (IRM), drum removal, was completed at the Polymer Application site by US EPA; additional remediation is planned under the NYSDEC Inactive Hazardous Waste Program. Groundwater wells were installed on NMPC property and monitored for phenol. Results of these analyses revealed that no phenols are present in these wells. A FOIA request was filed and is pending pertaining to the Polymer Applications' site cleanup.

4.1.8 Accessory Buildings and General Yard Areas

4.1.8.1 Tractor Garage; Storage Buildings . A tractor garage where heavy equipment repair and maintenance is performed is located to the southwest of Station 1. This is a brick building with a concrete floor. The maintenance garage contained a compressor, two drums of oil, two drums of used antifreeze, and assorted tools. The maintenance garage was generally observed to be orderly; minor oil staining was observed on the concrete floor during Fluor Daniel GTI's site inspection.

An oil storage building adjacent to the tractor garage was inspected by Fluor Daniel GTI and contained 13 drums of various types of oils, and three tanks containing transmission oil and hydraulic oil. This building was generally orderly with minor staining observed on the concrete floor during Fluor Daniel GTI's site inspection.

An additional storage building was located east of the wastewater treatment plant. This building contained a mobile oil tank, and 49 drums of engine oil, cable oil, and deicer chemicals. Drums were located on pallets, and no spillage or staining was evident during Fluor Daniel GTI's site inspection.

4.1.8.2 Transformer Storage Area. Several large out-of-service transformers were stored by NMPC's Transmission and Distribution service personnel outdoors in an unpaved area of the yard east of Station 1 and west of the Terminal substation. Staining was evident at the base of the transformers.

4.1.8.3 Areas Containing Fill, Yard Waste, Debris. Boring logs included in a hydrogeologic assessment for the site (Recra, 1979) indicate that substantial infilling of the site has occurred using fly ash, bottom ash, and bricks as fill materials. The thickness of the fill material appears to be greatest along the Steam Station property's western boundary, forming a bulkhead to the Niagara River. Thicknesses of fill exceeding 15 feet were reported in this area. Along River Road and on the eastern portion of the C. R. Huntley Station property (coal car dumper area), fill thicknesses on the order of seven to eight feet were encountered.

The use of ash as shallow fill was also noted in the hydrogeologic assessment report in the northeast yard area and area south of the coal pile, where the equalization basins now exist.

Boring logs in the hydrogeologic assessment report did not indicate the presence of other industrial or chemical wastes in the fill material.

4.1.9 Groundwater Quality

Previous investigations of groundwater quality have been completed to characterize the nature and concentrations of substances that may have resulted from the storage and handling of coal at the C. R. Huntley Steam Station.

Recra (1979) reported the results of groundwater and surface water analyses from the C. R. Huntley Steam Station, collected on several dates in 1979. The concentrations of inorganic constituents reported in groundwater and surface water were not exceptional relative to other sites in the Erie-Niagara Basin (LaSala, 1968); however several groundwater constituents exceeded the current NYS Part 703.5 groundwater standards (sulfite and chloride in wells upgradient and downgradient of coal storage activities; lead in upgradient and downgradient wells; arsenic in downgradient wells; iron in upgradient and downgradient wells; zinc in upgradient wells; cadmium upgradient and downgradient wells, and manganese in upgradient and downgradient wells).

Phenol was detected in surface water and groundwater during the investigation. The highest concentrations of phenol (310 mg/L, in surface water; .580 mg/L in groundwater) were detected on the southeast portion of the C. R. Huntley Steam Station, along River Road. NMPC personnel reported that the wastewater released into the drainage ditch along River Road by Polymer Applications had a reddish color and odor characteristic of phenol. The Polymer Applications site later became a listed NYS Inactive Hazardous Waste Site. Data collected by NYSDEC (EDR, 1997a) reported that 3,000 lbs. of phenolic hazardous waste had been disposed of at the site. The site was the subject of a IRM in 1995.

Frontier Technical Associates (1997a) analyzed groundwater samples from eight wells located around the coal pile, and reported that iron was detected in excess of the Part 703.5 Groundwater Standards at all wells except at a well immediately downgradient of the coal pile. Manganese was found in excess of the Part 703.5 standard in wells upgradient and downgradient of the coal pile. Zinc, arsenic, and nickel were found in an upgradient well at levels above the other wells.

As part of a coal pile mitigation study in the mid 1980s, NMPC constructed a slurry wall around the coal pile area and installed a pump and treat system. Groundwater quality is monitored semi-annually from both bedrock wells and overburden wells, upgradient and downgradient from the coal pile area. These results are reported to the NYSDEC as required by the SPDES Permit.

4.1.10 Adjoining Property Uses

The area surrounding the C. R. Huntley Steam Station is heavily industrialized. There are numerous sites that have had reported releases of oil and hazardous substances to the environment, solid/hazardous waste activity, or petroleum and chemical bulk storage. A summary of these sites includes:

- Nine IHWS within a 1.25-mile radius;
- Four CERCLIS (potential NPL) sites within a 1.25-mile radius;
- Three CORRACTS sites within a 1.25-mile radius;
- Two solid waste landfills within a 1.25-mile radius;
- Nine LUST sites within a .75 mile radius;
- Six sites with registered USTs within a .5 mile radius;
- Nine AST sites within a .5 mile radius;
- One RAAT site within a 1.25-mile radius;
- 22 RCRIS-SQGs within a 1.25-mile radius;
- 24 RCRIS-LQGs within a 1.25-mile radius;
- One ERNS site;
- 51 FINDS sites; and
- 47 spill sites within a 1.25 mile radius.

The majority of these sites are located to the east of the C. R. Huntley Steam Station, and according to the regional groundwater flow pattern are hydraulically upgradient of the site. Potable water is supplied to the area by the municipality, although there are reported to be many industrial supply wells (EDR, 1997a). The history of chemical disposal on these properties extends back to 1921 (EDR, 1997a), and has produced numerous soil, surface water, and groundwater impacts in the area.

As a result of the number of these potential source areas for oil and hazardous substances in the vicinity of the C. R. Huntley Steam Station, only the adjoining properties and potential source areas for oil/hazardous substances in immediate proximity to the Steam Station are discussed below.

4.1.10.1 North. To the immediate north of the C. R. Huntley Steam Station property is the Mid River Marina, which features dockage and storage capability for motor yachts. Three USTs are registered at the facility. No spills have been reported.

4.1.11.2 South. South of the C. R. Huntley Steam Station is the Erie County Water Authority Raw Water Pumping Plant. The Town of Tonawanda Treatment Plant lies just south of the raw water pumping station.

4.1.11.3 East. To the east of the Steam Station, starting from the south at the intersection of Sheridan Drive and River Road, are E.I. DuPont De Nemours and Co., Inc., Indeck-Yerkes Energy Services, Dunlop Tire Corp., the former Polymer Applications Corp., and FMC Corporation. DuPont, Dunlop, and Polymer Applications have all had numerous spills and are also listed as NYS IHWSs. DuPont has reportedly had releases of lab chemicals and paint from past disposal practices, with resultant groundwater impacts. Dunlop has reportedly discovered drums and other materials in the ground from past disposal. Polymer Applications, in addition to phenol releases, has had releases of xylenes, other solvents, and PCBs. FMC has had numerous spills and has discovered high concentrations of PCBs in soil on-site.

Just east of FMC Corp. along Sawyer Avenue is Goetz Energy Corp., which has had reported spills and seepage of black oil from an embankment to the Niagara River.

4.1.11.4 *West.* To the west of the Steam Station is the Niagara River. Many spills and industrial discharges have impacted the river upstream from the Steam Station.

4.2 C. R. Huntley Fly Ash Landfill

This section presents the description of the C. R. Huntley Fly Ash Landfill.

4.2.1 *Site History and Previous Operations*

The Landfill has been in operation since 1971. Since the facility began accepting solid waste, approximately 64 acres have been filled and closed. NMPC developed the Landfill in two phases; Phase 1, which consists of the cells comprising the western portion of the site, and Phase 2, the remaining lands east of the closed Phase 1 cells (figure 2b, Site Map). The Landfill was built on previously undeveloped farm land, purchased by NMPC from the Cherry family in 1969. The USGS 7.5 minute quadrangle, dated 1965, indicates that the area of the Landfill was undeveloped, relatively flat, bounded on three sides (north, south and east) by other industrial operations (figure 1b), and River Road and the Niagara River to it's west.

The C. R. Huntley Fly Ash Landfill accepts power plant wastes from the C. R. Huntley Steam Station including boiler fly ash, pulverized rejects, bottom ash, and wastewater treatment sludge. Actual deposition rates for wastes received from the C. R. Huntley Steam Station for the year 1995 and 1996 were approximately 77,700, and 52,300 tons of total ash, according to NMPC personnel, respectively.

According to NMPC personnel, Phase 1 cells (figure 2b) were constructed by excavating into the clay subsurface soils, filling the depressions with solid waste, and then covering with appropriate material. The Phase 2 expansion cells were designed in accordance with the requirements of New York State's 6 NYCRR Part 360 regulations for solid waste management facilities (NMPC, 1989). The Phase 2 cells utilize a compacted soil bottom liner with a drainage blanket for leachate collection. Underlying the compacted soil liner is a sand layer for leak detection, and a second underlying soil bottom liner. The cells also have two synthetic liners as well as clay.

According to NMPC, waste was first placed into Phase 1 Cells, which were closed between 1973 and 1979 in accordance with applicable NYSDEC regulations. Waste is currently being laced in Phase 2 Cell A, and Cell D. Phase 2 Cells B, C and E will be utilized as necessary for future solid waste disposal. According to NMPC, Carmen Periso Trucking, both hauls the solid waste from the C. R. Huntley Steam Station to the Landfill, and maintains the facility with NMPC oversight.

4.2.2 Stormwater Collection, Monitoring and Discharge

Stormwater runoff from the Fly Ash disposal cells is monitored at three surface water outfalls (SPDES permitted outfalls 001, 002, and 003, figure 2b). Catch basins located throughout the facility are interconnected, and piped to one of the three outfall locations. Each outfall is connected to a small sedimentation basin. The basins are used to decrease the suspended solids in the runoff prior to it's eventual discharge to the Niagara River. During the inspection, what appeared to be iron staining was noted in Outfall 003. No other signs of stressed vegetation, staining or obvious environmental conditions were noted at the outfalls.

In addition, a flow retention structure (sedimentation basin), is located in the area of Phase 2 Cell E (figure 2b). Surface water runoff from this undeveloped portion of the Landfill is collected here, and discharged to the stormwater collection system. This sedimentation basin is also designed to increase runoff retention time, in order to reduce the concentration of suspended solids in the discharge stream. No signs of stressed vegetation, staining or obvious environmental conditions were noted in the area of the sedimentation basin during Fluor Daniel GTI's site inspection.

4.2.3 Leachate Collection, Monitoring and Discharge

The leachate generated at the Landfill Phase 2 cells is collected and piped to various manholes located around the facility. Manholes around the perimeter of the landfill allow for sampling and monitoring of Phase 2 leachate from on top of the upper liner and from between the liners (leak detection system) separately. These manholes are accessible by access roads that bisect and skirt the perimeter of the Landfill. In addition, the Flow Equalization Basin collects all Phase 2 leachate and Manhole-24 area leachate (which collects leachate from the closed Phase 1 cell impacted with pheonol - see section 4.2.7). According to NMPC personnel, this basin has a double synthetic liner.

The C. R. Huntley Fly Ash Landfill's leachate collection system is tied into the Town of Tonawanda's Publicly Owned Treatment Works (POTW) sanitary sewer line (via a connection on River Road). NMPC discharges the collected leachate to this system under the Town permit. The discharge to the POTW is monitored on a quarterly basis (Frontier, 1997b). Sampling and analysis by NMPC contractors (Frontier, 1997b) for the second quarter of 1997 indicated that the leachate from the landfill was meeting the requisite Town of Tonawanda POTW permit requirements. Note: Much of Phase 1 has only a limited underdrain leachate collection system (refer to section 4.2.7).

A total of 28 groundwater monitoring wells are located around the perimeter of the Landfill (figure 2b). The monitoring wells were installed in approximately 1987 in order to monitor the groundwater quality in the various hydrogeologic units found beneath and in the area of the Landfill. Of the 28 wells installed, 20 have been sampled historically on a quarterly basis. Wells have recently been repaired and/or replaced, as necessary. A discussion of groundwater quality, as it relates to Landfill operation is detailed in section 4.2.8.

4.2.4 Truck Wash Area

A truck wash area is located just east of the North Access Road gate. The truck wash is used to rinse ash off vehicles and trucks prior to exiting the Landfill. The truck wash consists of a concrete pad and catch basin. The catch basin's discharge is connected to the Town of Tonawanda's POTW. No apparent signs of stressed vegetation, staining or other obvious concerns were noted in this area during Fluor Daniel GTI's inspection.

4.2.5 Flowable Fly Ash/Concrete Mixing Plant

Fly Ash from the Landfill is used in a concrete product distributed by Pine Hill Materials Corporation. The mixing plant is located on the western portion of Phase 2 Cell B (figure 2b). The fly ash is dispensed from hoppers into concrete trucks. No building structures are present in the area of the plant. During the file review completed by Fluor Daniel GTI, a NYSDEC Solid Waste Monitor's daily record (Frank Kelly) indicated that during an inspection on September 15, 1995, a "leachate" from the plant was noted entering a drainage ditch (NYSDEC, 1995). At the time of the Fluor Daniel GTI site inspection, no runoff, obvious signs of stressed vegetation, or staining were noted in the area of the plant.

4.2.6 Landfill Cell Operation

During the site inspection completed by Fluor Daniel GTI, a bulldozer and trucks were present in active Cell D, and recent leveling of Fly Ash in this cell was apparent. All Phase 1 cells have well established vegetative grass cover. A NYSDEC monitor was assigned to the site in March 1994, as a result of statewide NYSDEC policy. The monitor inspects the site on a monthly basis. During Fluor Daniel GTI's review of Mr. Kelly's reports from October 1994 through March 1996, selected items with respect to Landfill operation and monitoring were noted. Items such as rodent burrowing, and lack of periodic leak detection monitoring (July 1995) were recorded. The NYSDEC monitor also noted on September 15, 1995 that dust from the Landfill was going off-site. In December 1995, it was also observed that erosion of temporary cover in the area of Phase 2 Cell A had exposed ash. These items were ultimately addressed and did not appear in subsequent reports.

At the time of Fluor Daniel GTI's site inspection, erosional areas were not noted, and a review of Landfill records (Frontier, 1995 and 1997) indicated that the leachate collection system was being monitored on a regular basis.

4.2.7 Manhole MH-24 Area

On May 15, 1991, leachate suspected to contain phenols was observed breaking through the cover of a portion of a closed Phase 1 cell, in the area of the Flow Equalization Basin. According to NMPC personnel, the leachate was "blood red" in color and had a characteristic phenol odor. The location of the breakout was proximal to MW-3S, Manhole 27, and Manhole 24 (figure 2b). Herein, the location of this discharge is referred to as the "Manhole 24 area". According to NMPC and NYSDEC records (1993), the leachate discharged to a drainage ditch tributary to the Landfill's SPDES permitted stormwater outfall 002. NMPC sampled the leachate, and the results indicated that phenols were indeed present. On May 30, 1991, NMPC notified the NYSDEC of this finding. In July 1992, NMPC entered voluntarily into an Interim Order on Consent to address this matter from a regulatory perspective. A final Order on Consent was drafted and implemented in February 1993.

NMCP undertook remedial activities inclusive of directing the leachate from the impacted cell to the Flow Equalization Basin, installation of pumps in a manhole adjacent to the outbreak (Manhole 24), and construction of a temporary water treatment system (trailer) to treat any affected water as necessary to meet discharge limitations. In addition, during the period of approximately 1992 to

1993 NMPC removed the apparent impacted Landfill materials in the area of the leachate outbreak, inclusive of the road bed in this area. The impacted soils were placed in another portion of the Landfill (figure 2b, Remediation Cell) for remediation. According to NMPC personnel, the soils were placed on a plastic liner, covered and allowed to naturally biodegrade the phenols. The leachate entering the Manhole 24 area collection system (Manhole 2) is periodically sampled. September 1997 sampling results from Manhole 2 (which receives the discharge from the Flow Equalization Basin) indicated that approximately 18 mg/L of total phenols were present (Frontier, 1997). Manhole 2 conveys the leachate to the Town of Tonawanda's POTW.

During Fluor Daniel GTI's site inspection no visible signs of leaching were noted in the Manhole 24 area, nor was there any visible impacts to the Flow Equalization Basin noted. The manhole pumping equipment appeared to be operating properly.

4.2.8 Groundwater Quality

As part of the C. R. Huntley Fly Ash Landfill's Part 360 Permit to Operate, NMPC currently monitors 20 monitoring wells and six components (typically manholes) of the Landfill leachate and leak detection system (Frontier, 1997). The monitoring wells and manholes are sampled on a quarterly basis for total and dissolved metals, sodium, sulfate, total dissolved solids, and total phenolic compounds. In addition, MW-8S and MW-8D are also sampled for volatile organic compounds (Frontier, 1997). The discussion of groundwater quality is limited to a review of the second quarter 1997 results.

Groundwater monitoring data shows that water quality is generally good; i.e. most parameters monitored are not detected above their respective method detection limits, inclusive of total phenolic compounds. However, some detections were noted for iron, molybdenum, boron and arsenic. Volatile organic compounds (VOCs) were not detected in monitoring well 8D, but were present in monitoring well 8S. As stated in the 1997 Quarterly Sampling and Analysis Report, the source of the VOCs is likely not attributable to Landfill operations, but rather to environmental conditions associated with adjacent properties (NOCO). Ms. McIntosh of the NYSDEC confirmed that in her opinion the occurrence of VOCs at this sampling location were likely attributable to other sources, and not from NMPC operations of the Landfill.

The data from the leachate collection system indicated that phenols were present in the Manhole 24 leachate (manhole 2 sampling), as is expected from its intended purpose, and in leachate from the Phase 2 Cell D area. In addition, molybdenum, boron, and arsenic were also detected in the Landfill leachate. Frontier (1997) indicated that the detected metal concentrations will be monitored in subsequent rounds to determine if the occurrences are statistically significant.

4.2.9 Adjoining Property Uses

Over 100 sites with environmental conditions were reported within the vicinity of the C.R. Huntley Fly Ash Landfill within the radius which was searched (EDR, 1997b). Of these sites, seven are New York State Inactive Hazardous Waste Sites (inclusive of adjoining properties owned by INS Scrap, Tonowanda Coke, and the "Cherry Farm" property, in which NMPC has involvement), and 14 have reported leaking underground storage tanks. In addition, a total of 76 spills have also been reported within the search radius, and include spills recorded at NOCO Energy Corporation operations, located just north of the facility. A number of facilities, such as NOCO, have multiple spills reported for a particular property. The affected properties listed in the EDR report (1997b) are included in appendix A2.

4.2.9.1 North. NOCO Energy Corporation borders the C. R. Huntley Fly Ash Landfill on its north. NOCO operated a large petroleum bulk storage facility from this location. The facility was formerly known at the Hambleton Terminal Corporation. Known environmental conditions are present at the NOCO facility, as reported by NYSDEC (1997).

4.2.9.2 South. Lands owned and operated by Tonowanda Coke Corporation and INS Scrap comprise the southern border of the Landfill (figure 2b). Both INS Scrap and Tonowanda Coke are listed as NYSDEC Inactive Hazardous Waste Sites (EDR, 1997a). At the time of the site inspection, scrap metal and junked cars were noted on the INS Scrap property.

4.2.9.3 East. East of the Landfill, are lands owned by NMPC and contain numerous power transmission lines. The lands are undeveloped.

PRIVILEGED AND CONFIDENTIAL - ATTORNEY WORK PRODUCT

Phase 1 Environmental Site Assessment Report - C. R. Huntley Steam Station and Fly Ash Landfill
Niagara Mohawk Power Corporation

Page 38
February 4, 1998

4.2.9.4 West. River Road borders the Landfill on the west, with the Niagara River found west of River Road (figure 2b). Just across River Road, is another parcel of NMPC owned land known as the "Cherry Farm". This parcel was acquired by NMPC at the same time that the Landfill property was acquired. Prior to NMPC ownership, it had been an industrial landfill, used by local industries such as GMC, Allied and TRW. This site is an NYSDEC listed IHWS and is currently subject to remediaton.

5.0 SUMMARY

This section summarizes the observations and information collected during the file review, personnel interviews and on-site inspection of the C. R. Huntley Steam Station and C. R. Huntley Fly Ash Landfill completed by Fluor Daniel GTI. The observations do not include *deminimus* conditions that would not be expected to require a response action if brought to the attention of regulatory personnel.

5.1 C. R. Huntley Steam Station

The following is a summary of the observations made at the C. R. Huntley Steam Station based on the site visit, records review, and personnel interviews conducted as a part of this work scope.

5.1.1 Steam Station Process Units

General Process Equipment During the inspection of the Steam Station, Fluor Daniel GTI observed indications that *de minimis* leaks of oil from major stationary equipment onto the floor have occurred during the span of operations at the Steam Station. The most likely receptors for these chemical impacts were judged to be the subbasement and wastewater systems.

Ongoing releases from process equipment are considered *Best Management Practice* issues, and are not considered further in this Phase 1 ESA. Observations relating to the subbasement and wastewater system are considered later in this section.

Wastewater and Industrial Process Water Collection and Drainage Systems The wastewater piping has, and continues, to convey oil to the slag ponds.

Currently and in the past, certain equipment drains discharge to the condenser cooling water discharge tunnels. During the history of operation of the Steam Station, a number of spills of oil have been discharged to these outfalls (H-003, H-004, and H-005).

Bulk Chemical Handling and Storage Areas The area on the west side of Station 2, where bulk chemicals are stored, was the site of a spill. However, this spill was cleaned up to the satisfaction of NYSDEC. NMPC has taken steps to prevent reoccurrence of this type of failure in the future.

Drummed Material Handling and Storage Areas Minor spills and releases from satellite oil drum storage inside the Steam Station will be considered below relative to their impacts to the subbasement. No indications of significant releases or potential residual environmental issues at locations outside the Steam Station were noted during Fluor Daniel GTI's site inspection.

Oil-Containing Hydraulic Systems These systems were reported to be non-PCB; no indications of significant releases or potential residual environmental issues associated with these systems were noted during Fluor Daniel GTI's site inspection.

Hazardous Waste Storage Areas No significant quantities of hazardous waste are currently generated or stored on-site at this time; no evidence suggesting the presence of residual environmental issues was noted as result of historic hazardous waste storage practices during the inspection completed by Fluor Daniel GTI.

Subbasement Area The subbasement has numerous openings through which *de minimis* quantities of oil and other chemicals may have passed during the span of operations at the Steam Station. Although minor accumulations of these substances is not viewed as particularly detrimental to operations of the Steam Station, significant quantities of oil or other substances may create a hazardous environment for personnel which may impede normal maintenance operations in the subbasement.

5.1.2 Switchyards and Transformers

Switchyards Minor staining is evident on transformers within the switchyard. The switchyard itself, however, is not considered a portion of the subject property.

Station and Yard Transformers The station and yard transformers inspected by Fluor Daniel GTI appeared to be in good condition; however, oil staining below the transformers may have produced residual environmental impacts during the span of operations at the Steam Station.

Dielectric Oil Cables Oil staining was evident in the cable vault during the inspection completed by Fluor Daniel GTI.

Oil/Water Separators No oil was present within the separators on the date inspected Fluor Daniel GTI.

5.1.3 Bulk Fuel Oil Storage and Handling Areas

Fuel Oil/Diesel Oil Storage Tanks Spill events have occurred at the main fuel oil storage tank area and the diesel fuel AST, and may have produced residual environmental impacts during the span of operations at the Steam Station. The spill at the diesel fuel AST was closed to the satisfaction of NYSDEC. The spill at the main fuel storage tank occurred in 1979 and was cleaned up by NMPC. The NYSDEC spill database had not been compiled at this time.

Oil Pipelines Testing data for the underground pipelines to the main fuel oil tank, 12,000-gallon fuel tank, and 10,000-gallon tank at the car dumper building was not available during Fluor Daniel GTI's site inspection. These systems may have produced residual environmental impacts during the span of operations at the Steam Station, although the pipelines are either cathodically protected or plastic coated.

Unit Fuel Oil Pumps Minor spills and releases from the oil pump skids inside the Steam Station are considered relative to their potential impacts to the subbasement. No indications of significant releases at these systems were noted during Fluor Daniel GTI's site inspection.

Underground Fuel Oil/Gasoline Tanks The potential exists for minor, undetected leaks to have occurred from the underground gas tank system; however, this system has been monitored manually and electronically and has not shown indications of failure. Regarding the former underground start-up fuel oil tanks, there are no closure reports or data to document the subsurface conditions adjacent to these tanks.

5.1.4 Coal Storage and Handling Areas

Coal Pile. The coal piles in the yard areas south of Station 1 and east of Station 2 have produced no distinguishable impact to the levels of inorganic constituents in groundwater, especially in consideration of the background water quality particular to the geologic and industrial demographic conditions in the area. Wastewater sludge and waste oil has been disposed of on the coal pile during the span of operations at the Steam Station.

Car Dumper Building. No evidence of obvious releases of hazardous substances or potential residual environmental issues were observed at the car dumper building during Fluor Daniel GTI's site inspection.

Breaker House, Junction House, Thaw Shed. No evidence of obvious releases of hazardous substances or potential residual environmental issues were observed at these buildings during Fluor Daniel GTI's site inspection.

5.1.5 Solid Waste Storage and Handling

Existing Fly Ash Silo/Flowable Fill Transfer Area Areas which are impacted by fly ash are not of particular concern relative to the intended use of the facility, as previous data collected from this site and others do not indicate the presence of significant concentrations of toxic inorganics in the fly ash. No activities other than fly ash management were identified within the area proximate to the fly ash silo.

Boiler Cleaning Wastes No potential residual environmental issues were identified during the review of the C. R. Huntley Steam Station's handling practices for boiler cleaning wastes.

Waste Oil Management The placement of waste oil on the coal pile for incineration has been mentioned previously.

Miscellaneous Trash and Debris No potential residual environmental issues were identified during the review of the C. R. Huntley Steam Station's handling practices for these wastes.

5.1.6 Wastewater and Stormwater Collection and Treatment Facilities

Wastewater Treatment Building and Equalization Basins During Fluor Daniel GTI's site inspection, oil spills were present on the floor, inside the wastewater treatment building.

The wastewater treatment basins are concrete-lined and were built during the mid-1980s. Other than the current use, this area was used for fly ash management.

48-inch and 36-inch Yard Drains These drains conveyed oils to the Niagara River from on-site and off-site in the past, and there have been a number of spills that reached the River through these Outfalls (H-002 and H-007).

Disposition of stormwater from switchyards will have to be addressed as part of separation agreements negotiated with future buyers.

Slag Ponds Wastewater from within the Steam Station and from off-site sources have been discharged to the south slag pond. The north slag pond has only contained discharges of wastewater from the Steam Station.

Open Drainage Channels These structures have been the collection point for industrial stormwater and wastewater from off-site sources along River Road, and measurable chemical impacts have been detected in the past. Sources of off-site contamination have subsequently been eliminated from this drainage system.

5.1.7 Accessory Buildings and General Yard Areas

Tractor Garage: Storage Buildings The tractor garage, oil storage building, and additional storage building inspected by Fluor Daniel GTI were observed to be kept in an orderly manner without evidence of obvious releases of hazardous substances or potential residual environmental issues during Fluor Daniel GTI's site inspection.

Transformer Storage Area Staining was evident at the base of several large transformers stored in the yard during Fluor Daniel GTI's site inspection.



Areas Containing Fill Extensive areas of the plant have been filled during its span of operations. Borings do not indicate the presence of industrial wastes other than brick, flash, and bottom ash.

5.1.8 Groundwater Quality

Off-site sources have potentially impacted groundwater at the C. R. Huntley Steam Station. A variety of target compound organic and inorganic constituents have been released at adjacent IHWS and spill sites.

5.1.9 Adjoining Properties

Numerous spills, hazardous waste facilities, and other environmental conditions were reported on properties adjoining the steam station. Of particular concern are two facilities that immediately adjoin the C. R. Huntley Steam Station: the former Polymer Applications site, and the FMC Corporation. Both sites have documented releases of chemical constituents (FMC: PCBs; ammonia; hydrogen peroxide; pyrophosphate; etc; Polymer: Phenols; Xylenes; MIBK; PCBs).

5.2 C. R. Huntley Fly Ash Landfill

The following is a summary of the observations pertaining to the C. R. Huntley Fly Ash Landfill, based on the site visit, records review, and personnel interviews conducted as a part of this work scope.

5.2.1 Stormwater Collection, Monitoring and Discharge

Review of NMPC records did not reveal that major stormwater permit excursions had taken place. However, in 1991 phenols were reported to be entering the drainage system connected to SPDES permitted outfall 002.

5.2.2 Leachate Collection, Monitoring and Discharge

Review of NMPC records did not reveal that major permit excursions had taken place with regard to leachate discharge to the POTW. Several leachate parameters will be monitored and statistically evaluated with regards to detection significance during future sampling rounds.

5.2.3 Truck Wash Area

The truck wash area effluent is collected and discharged to the Town of Tonawanda's POTW for treatment. Therefore, vehicle wash waters appear to be contained and properly treated.

5.2.4 Flowable Fly Ash/Concrete Mixing Plant

During various NYSDEC inspections of the Landfill, runoff from the plant were noted to be entering drainage ditches. The stormwater from the site is all conveyed to one of three permitted stormwater outfalls, which undergo periodic discharge monitoring. Stormwater monitoring data did not indicate that major excursions occurred.

5.2.5 Manhole 24 Area

Review of NMPC documents with respect to the phenols outbreak in this area, indicates that phenols no longer continue to break out from the closed Phase 1 cell. Phenol leachate from the cell continues to be collected and subsequently treated via the Town of Tonawanda POTW.

5.2.6 Groundwater Quality

A review of the groundwater monitoring results did not reveal that the analytes monitored significantly exceeded groundwater standards. VOCs were detected at MW-8S, but these compounds have been attributed to operations of adjoining property owners and not to NMPC (NYSDEC, 1997).

5.2.7 Adjoining Property Uses

Both the north and south margins of the C. R. Huntley Fly Ash Landfill are bordered by properties known to have recognized environmental issues (NOCO, Tonawanda Coke, and INS Scrap). Two of the properties, are listed as Inactive Hazardous Waste Disposal Sites (Tonawanda Coke and INS Scrap). Impacts from an apparent off-site source has affected the water quality in the area of monitoring well MW-8S.

6.0 REFERENCES

- ASTM Standard Practice for Environmental Site Assessments: *Phase 1 Environmental Site Assessment Process*, E1527-97. 1997.
- Entek, *Executive Summary, C.R. C. R. Huntley Steam Station, Abandoned Area/Shops, Electrical Area, Administration Building, Miscellaneous Buildings, 25 Cycle Area, Boiler Units 63 -67, Boilers 1 - 4*. January 1990.
- Environmental Data Resources, Inc, *The EDR-Radius Map with GeoCheck™, C. R. Huntley Steam Station*, October 6, 1997(a).
- Environmental Data Resources, Inc., *The EDR Radius Map with GeoCheck™, C. R. Huntley Fly Ash Landfill*. October 6, 1997(b).
- Fisher, D. W., Isachson, Y.W; et al., *Geologic Map of New York*, The University of the State of New York; the State Education Department. 1970 (reprinted 1995).
- Frontier Technical Associates, Inc. *Semi-Annual Sampling and Analysis. C. R. Huntley Station Wells.*, May 14, 1997a.
- Frontier Technical Associates, Inc. *Quarterly Sampling and Analysis Report. C. R. Huntley Landfill (Second Quarter 1997)*. Frontier report ET-543-10, dated June 19, 1997b.
- Frontier Technical Associates, Inc. *Monthly Manhole 2 Sampling Results from Niagara Mohawk, C. R. Huntley Landfill*, September 1997c.
- Frontier Technical Associates, Inc. *Site Analytical Plan for Niagara Mohawk Power Corporation, C. R. Huntley Landfill*. Report No. ET-543. May 3, 1995.

PRIVILEGED AND CONFIDENTIAL - ATTORNEY WORK PRODUCT

Phase 1 Environmental Site Assessment Report - C. R. Huntley Steam Station and Fly Ash Landfill
Niagara Mohawk Power Corporation

Page 47
February 4, 1998

LaSala, A.M., Jr. *Ground-Water Resources of the Erie-Niagara Basin, New York*. State of New York, Conservation Department, Water Resources Commission Basin Planning Report ENG-3: 1968.

Malcolm Pimie, Inc. *Hydrogeologic Report for the C. R. Huntley Fly Ash Landfill Phase 2 Expansion*. March 1989.

New York State Department of Environmental Conservation. *Niagara Mohawk Huntley Power Station, Site #915076. Date Delisted: April 16, 1986*. Delisting Report prepared August 5, 1993.

Niagara Mohawk Power Corporation. *DMR Summary Information for the years 1993-1996*. 1997a.

Niagara Mohawk Power Corporation. *Summary of Notices of Violations 1984 -1996*. June 1996a.

Niagara Mohawk Power Corporation. *1995 Generator Report - Electronic File Data. Form GM*. 1996b.

Niagara Mohawk Power Corporation. *1994 Generator Report - Electronic File Data. Form GM*. 1995.

Niagara Mohawk Power Corporation. *1993 Generator Report - Electronic File Data. Form GM*. 1994.

Niagara Mohawk Power Corporation. *C. R. Huntley Steam Station. Oil Spill Prevention and Countermeasure Plan (SPCC). Plot Plan of Potential Spill Sites. Drawing No. F-36100-W*. February 20, 1986 (amended through June 13, 1994).

Niagara Mohawk Power Corporation. Drawing entitled *C. R. Huntley Fly Ash Landfill South Access Road Remediation General Site Plan*. Drawing No. F-54260-W, May 18, 1993a.

Niagara Mohawk Power Corporation. *Order on Consent, No. 91-26 and 91-66*. Huntley Landfill and Dunkirk Steam Station, February 18, 1993b.

NRG019204

PRIVILEGED AND CONFIDENTIAL - ATTORNEY WORK PRODUCT

Phase 1 Environmental Site Assessment Report - C. R. Huntley Steam Station and Fly Ash Landfill
Niagara Mohawk Power Corporation

Page 48
February 4, 1998

Niagara Mohawk Power Corporation. *Application to Construct and Operate the Proposed Phase 2 Expansion of Site, C. R. Huntley Fly Ash Landfill, Erie County, Town of Tonawanda, NY, DEC Facility No. 15S24, April 1989.*

Stanely Consultants, Inc. *Wastewater Management Plan, January 15, 1982.*

Recra Research, Inc. and Wehran Engineering, PC, *Hydrogeologic Investigation, Niagara Mohawk Power Corporation, C. R. Huntley Generating Station and Fly Ash Site, Town of Tonawanda, Erie County, New York. 1979.*

United States Geological Survey, *1965 Topographical Map, Buffalo NW, NY - Ontario Quadrangle, 7.5 Minute Series.*

TABLE 1

Record of Spills and Releases
C. R. Huntley Steam Station¹

Material Spilled	Date of Spill	Location of Spill	Quantity of Spill	Method of Cleanup	Violations Issued (Yes or No)	NYSDEC Closure (Yes or No)
Fuel Oil	9/23/77	Road drain and Niagara River	unknown	Booms and sorbent pads, date not specified.	no	**
Fuel Oil	8/07/78	Outfall 007 and Niagara River	unknown	Booms and sorbent pads, date not specified.	no	**
Oil and Grease	8/27/79	soot blower leaked oil to a floor drain; traveled via Outfall 003 to Niagara River	small quantity	Temporary oil recovery units were installed. Date not specified	no	**
Oil	11/06/79	Boiler feed pump leaked oil to floor drains; traveled through Outfall 003 to the Niagra River	small quantity	Date and method not specified.	no	**
Fuel Oil	12/12/79	Main fuel oil tank (30,000 gal.) was overfilled, oil drained to trench around tank; through Outfall 007 and to the Niagara River	unknown	Sorbent pads, booms and pumping activities, date not specified	no	**
Waste Oil	4/18/80	Oil spilled into floor drains, traveled through Outfall 007 to Niagara River	unknown	Sorbent pads, date not specified	no	**
#2 Fuel Oil	9/26/80	Tank was overfilled; oil ran to 48-inch storm sewer and Niagara River	300 gal.	Absorbent material, Speed-dry and sorbent pads, not date specified	no	**
#2 Fuel Oil	3/09/81	Tank was overfilled; oil ran onto The ground surrounding the tank, through Outfall 002 to the Niagara River	50 gal.	Absorbent material, Speedy-dry, and sorbent pads no date specified	no	**
Oil	4/28/81	Oil accumulated on the hotwell floor area, pumped through Outfall 007, and Niagara River by a sump pump	2 gal.	Sorbent pads and booms, hotwell area cleaned, no date specified	no	**

#371gsadm/hmpc/divest/huntley/phase1.fnt



FLUOR DANIEL GTI

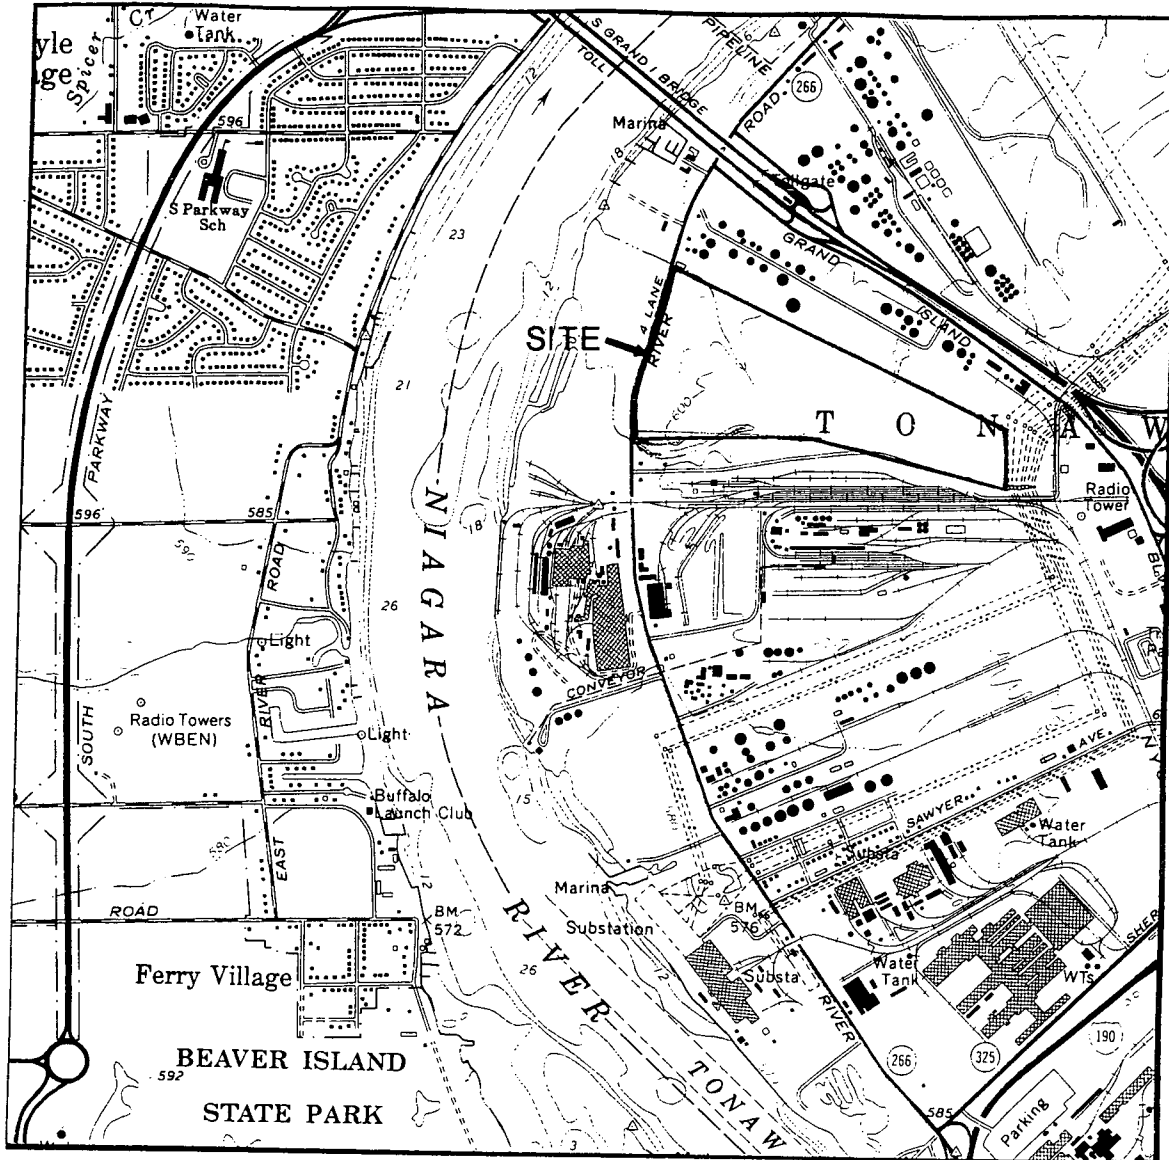


TABLE 1 Record of Spills and Releases C. R. Huntley Steam Station ¹						
Material Spilled	Date of Spill	Location of Spill	Quantity of Spill	Method of Cleanup	Violations Issued (Yes or No)	NYSDEC Closure (Yes or No)
Sheen	7/01/91	A pipe leaked at the 10,000 gal. Diesel tank; contaminated soil caused a sheen on Outfall 007 and Niagara River. Spill containment in dyked area.	4,000 gal	Sorbent and containment booms, pumping performed, groundwater monitoring wells installed, no date specified	yes	yes: 11/19/93
Crystalline Substance	6/10/92	NYTEL Manhole, groundwater	unknown	Corrective action taken, 7/22/92	no	yes: 7/22/92
Sheen	8/03/92	Sheen noticed at Outfall 004 and Niagara River	unknown	Containment booms employed, no date specified	no	no ²
Sheen	9/20/93	Sheen noticed at Outfall 002 and Niagara River	unknown	Outfall inspected regularly	no	yes: 10/04/93
#2 Fuel Oil	4/29/94	A line discharged 1,300 gallons of fuel oil to the subbasement; approximately 130 gallons were discharged to the south slag pond.	1,300 gal.	Booms, absorbent sweeps and vacuum truck, date not specified	no	yes: 9/19/94
Sulfuric Acid (93%)	10/09/95	Sulfuric acid storage tank, piping system, front of building	1,750 gal.	Booms employed, drain traps were pumped by Vac truck and drummed. Drains neutralized with lime and flushed out. Date not specified.	Yes	yes: 11/28/95

¹ = Source: EDR Report (1997A) and NIMPC Steam Station SPCC Plan (1986)
² = Spill closure confirmation was not found in EDR Report (1997A)
 ** = Event occurred prior to NYSDEC spill database compilation



FIGURES




SOURCE: U.S.G.S. TOPOGRAPHIC QUADRANGLE
 BUFFALO NW, NY-ONT. QUADRANGLE
 7.5 MINUTE SERIES
 DATE: 1965

QUAD
 LOCATION



SCALE 1:24,000



FLUOR DANIEL GTI 

1245 KINGS ROAD
 SCHENECTADY, NY 12303
 (518) 370-5631

DESIGNED:
 RAH
 DETAILED:
 DEO
 CHECKED:

SITE LOCATION MAP

CLIENT: NIAGARA MOHAWK
 POWER CORPORATION
 LOCATION: HUNTLEY FLY ASH LANDFILL
 TONAWANDA, NEW YORK

DRAWING DATE:
 11/3/97

FIGURE:
1b

NRG019210

TABLES



FLUOR DANIEL GTI

VOLUME II

**PHASE I ENVIRONMENTAL SITE ASSESSMENT
NIAGARA MOHAWK POWER CORPORATION
C. R. HUNTLEY STEAM STATION AND
C. R. HUNTLEY FLYASH LANDFILL**

APPENDICES

Fluor Daniel GTI Project 100585

February 4, 1998

Submitted to:
Mr. William Holzauer, Esq.
Niagara Mohawk Power Corporation
Senior Environmental Counsel
300 Erie Blvd West
Syracuse, NY 13202

Submitted by:
Fluor Daniel GTI, Inc.
1245 Kings Road
Schenectady, New York 12303

#37tgsadmin/hmpc/divest/huntley/phase1.dec

APPENDIX A1

**Environmental Data Resources Report
C. R. Huntley Steam Station**

**The EDR-Radius Map
with GeoCheck™**

**Huntley Steam Station
3500 River Rd
Tonawanda, NY 14150**

Inquiry Number: 1201713.6p

October 06, 1997


e data resources, inc.

**The Source
For Environmental
Risk Management
Data**

**3530 Post Road
Southport, Connecticut 06490**

Nationwide Customer Service

**Telephone: 1-800-352-0050
Fax: 1-800-231-6802**

NRG019215

EXECUTIVE SUMMARY

A search of available environmental records was conducted by Environmental Data Resources, Inc. (EDR). The report meets the government records search requirements of ASTM Standard Practice for Environmental Site Assessments, E 1527-97. Search distances are per ASTM standard or custom distances requested by the user.

The address of the subject property for which the search was intended is:

3500 RIVER RD
TONAWANDA, NY 14150

No mapped sites were found in EDR's search of available ("reasonably ascertainable ") government records either on the subject property or within the ASTM E 1527-97 search radius around the subject property for the following Databases:

NPL:..... National Priority List
Delisted NPL:..... NPL Deletions
RCRIS-TSD:..... Resource Conservation and Recovery Information System
CERC-NFRAP:..... Comprehensive Environmental Response, Compensation, and Liability Information System
HMIRS:..... Hazardous Materials Information Reporting System
PADS:..... PCB Activity Database System
TRIS:..... Toxic Chemical Release Inventory System
NPL Lien:..... Federal Superfund Liens
TSCA:..... Toxic Substances Control Act
MLTS:..... Material Licensing Tracking System
ROD:..... Records Of Decision
CONSENT:..... Superfund (CERCLA) Consent Decrees
Coal Gas:..... Former Manufactured gas (Coal Gas) Sites.

Unmapped (orphan) sites are not considered in the foregoing analysis.

Search Results:

Search results for the subject property and the search radius, are listed below:

Subject Property:

The subject property was identified in the following government records. For more information on this property see page 9 of the attached EDR Radius Map report:

Site	Database(s)	EPA ID
1 C.R. HUNTLEY GEN. STATION 3500 RIVER RD TONAWANDA, NY	NY Spills	N/A
1 NIAGARA MOHAWK - HUNTLEY 3500 RIVER RD TONAWANDA, NY	NY Spills	N/A
1 C R HUNTLEY GENERATING ST 3500 RIVER RD TONAWANDA, NY	NY Spills	N/A

EXECUTIVE SUMMARY

C R HUNTLEY STEAM STATION
RIVER RD
TONAWANDA, NY 14207

CERCLIS
FINDS
RCRIS-LQG

NYD003909694

C.R. HUNTLEY STEAM STATION
3500 RIVER ROAD
TONAWANDA, NY 14150

AST

N/A

C R HUNTLEY STEAM STATION
3500 RIVER RD
TONAWANDA, NY 14150

UST
AST

N/A

↙ NIAGARA MOHAWK MANHOLE
3500 RIVER RD
TONAWANDA, NY

NY Spills

N/A

↙ C.R.HUNTLY GENERATING STA
3500 RIVER RD
TONAWANDA, NY

NY Spills

N/A

EXECUTIVE SUMMARY

Surrounding Properties:

Elevations have been determined from the USGS 1 degree Digital Elevation Model and should be evaluated on a relative (not an absolute) basis. Relative elevation information between sites of close proximity should be field verified. EDR's definition of a site with an elevation equal to the subject property includes a tolerance of -10 feet. Sites with an elevation equal to or higher than the subject property have been differentiated below from sites with an elevation lower than the subject property (by more than 10 feet). Page numbers and map identification numbers refer to the EDR Radius Map report where detailed data on individual sites can be reviewed.

Sites listed in *bold italics* are in multiple databases.

SHWS: The State Hazardous Waste Sites records are the states' equivalent to CERCLIS. These sites may or may not already be listed on the federal CERCLIS list. Priority sites planned for cleanup using state funds (state equivalent of Superfund) are identified along with sites where cleanup will be paid for by potentially responsible parties. The data comes from the Department of Environmental Conservation's Inactive Hazardous waste Disposal Sites in New York State.

A review of the SHWS list, as provided by EDR, and dated 04/30/1996 has revealed that there are 9 SHWS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
<i>POLYMER APPLICATIONS</i>	<i>3445 RIVER RD</i>	<i>0 - 1/8 SE</i>	<i>B9</i>	<i>26</i>
<i>FMC CORP</i>	<i>34 SAWYER AVE.</i>	<i>1/8 - 1/4 NNW</i>	<i>C13</i>	<i>48</i>
<i>E.I. DUPONT DE NEMOURS</i>	<i>SHERIDAN DRIVE STATION</i>	<i>1/4 - 1/2 SE</i>	<i>169</i>	<i>190</i>
DUNLOP TIRE AND RUBBER	SHERIDAN DRIVE / RIVE	1/4 - 1/2 SE	175	203
O-CEL-O SPONGE PLANT	305 SAWYER AVE	1/2 - 1 NE	L96	250
<i>TONAWANDA COKE INC</i>	<i>3875 RIVER RD</i>	<i>1/2 - 1 NNW</i>	<i>O118</i>	<i>275</i>
RIVER ROAD SITE	4000 RIVER RD	1 - 2 NNW	T148	311
<i>ROBLIN STEEL</i>	<i>4000 RIVER RD</i>	<i>1 - 2 NNW</i>	<i>T149</i>	<i>312</i>
NIAGARA MOHAWK - CHERRY FARM	RIVER ROAD (NEAR 4000 R	1 - 2 NNW	T154	316

CERCLIS: The Comprehensive Environmental Response, Compensation and Liability Information System contains data on potentially hazardous waste sites that have been reported to the USEPA by states, municipalities, private companies and private persons, pursuant to Section 103 of the Comprehensive Environmental Response, Compensation and Liability Act (CERCLA).

CERCLIS contains sites which are either proposed to or on the National Priorities List (NPL) and sites which are in the screening and assessment phase for possible inclusion on the NPL.

A review of the CERCLIS list, as provided by EDR, and dated 04/30/1997 has revealed that there are 4 CERCLIS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
<i>POLYMER APPLICATIONS</i>	<i>3445 RIVER RD</i>	<i>0 - 1/8 SE</i>	<i>B9</i>	<i>26</i>
<i>ASHLAND CHEMICAL CO</i>	<i>3701 RIVER RD</i>	<i>1/2 - 1 NNW</i>	<i>79</i>	<i>206</i>
<i>SHANCO PLASTIC</i>	<i>2716 KENMORE AVE</i>	<i>1/2 - 1 ENE</i>	<i>P122</i>	<i>280</i>
<i>ENVIROTEK</i>	<i>4000 RIVER RD</i>	<i>1 - 2 NNW</i>	<i>T153</i>	<i>315</i>

CORRACTS: CORRACTS is a list of handlers with RCRA Corrective Action Activity. This report shows which nationally-defined corrective action core events have occurred for every handler that has had corrective action activity.

A review of the CORRACTS list, as provided by EDR, and dated 12/01/1996 has revealed that there are 3 CORRACTS sites within approximately 1.25 Miles of the subject property.

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
FMC CORP	34 SAWYER AVE.	1/8 - 1/4NNW	C13	48
ALLIED CORPORATION	3821 RIVER RD	1/2 - 1 NNW	O117	274
ENVIROTEK	4000 RIVER RD	1 - 2 NNW	T153	315

SWF/LF: The Solid Waste Facilities/Landfill Sites records typically contain an inventory of solid waste disposal facilities or landfills in a particular state. The data comes from the list.

A review of the SWF/LF list, as provided by EDR, and dated 12/31/1996 has revealed that there are 2 SWF/LF sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
TONAWANDA COKE INC	3875 RIVER RD	1/2 - 1 NNW	O118	275
TONAWANDA, PLOT 34 P1-30	4111 RIVER RD	1 - 2 NNW	AA177	354

LUST: The Leaking Underground Storage Tank Incident Reports contain an inventory of reported leaking underground storage tank incidents. The data comes from the Department of Environmental Conservation's Spills Information Database.

A review of the LUST list, as provided by EDR, and dated 12/31/1996 has revealed that there are 19 LUST sites within approximately 0.75 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
POLYMER APPLICATIONS	3445 RIVER RD	0 - 1/8 SE	B9	26
FMC	35 SAWYER AVE	1/8 - 1/4NNW	C14	50
FMC CORPORATION	35 SAWYER AVE	1/8 - 1/4NNW	C15	51
FMC CORP-BUFFALO PLANT	37 SAWYER AVE	1/8 - 1/4N	C16	54
GOETZ ENERGY CORP	87 SAWYER AVE	1/8 - 1/4NNE	D25	91
NIAGARA MOHAWK	61 JAMES ST	1/4 - 1/2NNW	G35	97
DUNLOP	10 SHERIDAN DR	1/4 - 1/2SE	I46	132
DUNLOP TIRE COMPANY	10 SHERIDAN DR	1/4 - 1/2SE	I49	144
DUNLOP TIRE	10 SHERIDAN DR	1/4 - 1/2SE	I53	153
DUPONT SHERIDAN + RIVER	SHERIDAN DRIVE / RIVE	1/4 - 1/2SE	I68	189
WNY BARREL & DRUM	225 SAWYER AVE	1/4 - 1/2NE	J76	204
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 NNW	79	206
3M TONAWANDA	305 SAWYER AVENUE	1/2 - 1 NE	L84	213
3M OCELLO	305 SAWYER AVE	1/2 - 1 NE	L85	229
3M O-CEL-O	305 SAWYER AVE	1/2 - 1 NE	L86	231
OCELLO	305 SAWYER AVE	1/2 - 1 NE	L94	247
O-CEL-O	305 SAWYER AVE	1/2 - 1 NE	L100	254
3M COMPANY	305 SAWYER AVE	1/2 - 1 NE	L101	255
ATLANTIC REFINING	3732 RIVER RD	1/2 - 1 NNW	M106	259

UST: The Underground Storage Tank database contains registered USTs. USTs are regulated under Subtitle I of the Resource Conservation and Recovery Act (RCRA). The data comes from the Department of Environmental Conservation's Petroleum Bulk Storage (PBS, CBS, MOSF) Database.

A review of the UST list, as provided by EDR, and dated 12/31/1996 has revealed that there are 6 UST sites within approximately 0.5 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
GOETZ ENERGY CORPORATION	85-87 SAWYER AVE	1/8 - 1/4N	D22	85

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
61 JAMES ST	RIVER RD	1/4 - 1/2 NNW	G36	98
NOCO ENERGY CORP	100 JAMES AVE	1/4 - 1/2 N	H38	100
MID RIVER MARINA, INC.	3670 RIVER RD.	1/4 - 1/2 NW	F39	122
TOWN OF TONAWANDA WATER TREATM	RIVER RD & SHERIDAN DR	1/4 - 1/2 SE	I64	184
EI DUPONT DE NEMOURS & CO INC	SHERIDAN DRIVE & RIVER	1/4 - 1/2 SE	I70	191

AST: The Aboveground Storage Tank database contains registered ASTs. The data comes from the Department of Environmental Conservation's Petroleum Bulk Storage (PBS, CBS, MOSF) Database.

A review of the AST list, as provided by EDR, and dated 09/30/1996 has revealed that there are 12 AST sites within approximately 0.5 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
POLYMER APPLICATIONS INC.	3445 RIVER RD	0 - 1/8 SE	B10	32
TOWN OF TONAWANDA WASTEWATER	12 SAWYER AVE	1/8 - 1/4 NNW	C12	47
FMC CORP.	37 SAWYER AVENUE	1/8 - 1/4 N	C17	61
FMC CORPORATION	37 SAWYER AVE	1/8 - 1/4 N	C18	82
NOCO ENERGY CORP	100 JAMES AVE	1/4 - 1/2 N	H38	100
JEROME D. VAN DE WATER RAW WAT	3300 RIVER RD	1/4 - 1/2 SE	I41	126
DUNLOP TIRE CORP.	10 SHERIDAN DRIVE	1/4 - 1/2 SE	I54	176
DUNLOP TIRE CORP	10 SHERIDAN DR	1/4 - 1/2 SE	I55	176
INDECK-YERKES ENERGY SERVICES	1 SHERIDAN DR	1/4 - 1/2 SE	I62	181
INDECK-YERKES ENERGY CENTER	1 SHERIDAN DR	1/4 - 1/2 SE	I63	183
EI DUPONT DE NEMOURS & CO INC	SHERIDAN DRIVE & RIVER	1/4 - 1/2 SE	I70	191
TONAWANDA (T) WATER TREATMENT	SHERIDAN & RIVER RD.	1/4 - 1/2 SE	I74	199

RAATS: The RCRA Administration Action Tracking System contains records based on enforcement actions issued under RCRA and pertaining to major violators. It includes administrative and civil actions brought by the United States Environmental Protection Agency. The source of this database is the U.S. EPA.

A review of the RAATS list, as provided by EDR, and dated 04/17/1995 has revealed that there is 1 RAATS site within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
ENVIROTEK	4000 RIVER RD	1 - 2 NNW	T153	315

RCRIS: The Resource Conservation and Recovery Act database includes selected information on sites that generate, store, treat, or dispose of hazardous waste as defined by the Act. The source of this database is the U.S. EPA.

A review of the RCRIS-SQG list, as provided by EDR, and dated 04/01/1997 has revealed that there are 22 RCRIS-SQG sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
POLYMER APPLICATIONS	3445 RIVER RD	0 - 1/8 SE	B9	26
GOETZ ENERGY CORP	87 SAWYER AVE	1/8 - 1/4 NNE	D24	90
KURK FUEL OIL CO	130 SAWYER AVE	1/4 - 1/2 NNE	E32	96
TEXACO USA /A DIV OF TEXACO IN	RIVER RD & JAMES ST	1/4 - 1/2 NW	F33	96
CARMEN M PARISO INC	3649 RIVER RD	1/4 - 1/2 NW	F34	97

NRG019220

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
NYSTA AMHERST PAINTING	318 SAWYER RD	1/2 - 1 NE	L104	258
ROADWAY EXPRESS INC	383 SAWYER AVE	1/2 - 1 NE	N114	263
SHANCO PLASTIC	2716 KENMORE AVE	1/2 - 1 ENE	P122	280
DIVISION TIRE CO INC	2750 KENMORE AVE	1/2 - 1 ENE	P125	282
QUACKENBUSH CO INC WAREHOUSE	483 SAWYER AVE	1/2 - 1 NE	Q127	283
B&W HEAT TREATING CO. INC.	2780 KEMORE AVENUE	1/2 - 1 ENE	S130	284
ERIE TRAILER REPAIR CO	2801 KENMORE AVE	1/2 - 1 ENE	S135	289
R W WEAVER CORP DBA ANCHOR MAR	1501 FERRY RD	1/2 - 1 W	U137	290
OVERNITE TRANSPORTATION CO	2580 KENMORE AVE	1 - 2 E	V143	295
RYDER TRUCK RENTAL INC	2834 KENMORE AVE	1 - 2 NE	W144	295
UNIVERSAL JOINT SALES	2843 KENMORE AVE	1 - 2 NE	W145	309
NIAGARA RIVER WORLD	4000 RIVER RD	1 - 2 NNW	T147	311
ASCENSION CHEMICAL OF AMERICA	4000 RIVER ROAD	1 - 2 NNW	T151	315
ENVIROTEK	4000 RIVER RD	1 - 2 NNW	T153	315
A B F FREIGHT SYSTEMS INC	50 FLYDER AVE	1 - 2 NE	Y161	320
LYONS TRAN LINES INC	410 GRAND ISLAND BLVD	1 - 2 NE	AB180	356
ROLLINS LEASING CORP.	155 WOODWARD AVENUE WES	1 - 2 ENE	182	357

RCRIS: The Resource Conservation and Recovery Act database includes selected information on sites that generate, store, treat, or dispose of hazardous waste as defined by the Act. The source of this database is the U.S. EPA.

A review of the RCRIS-LQG list, as provided by EDR, and dated 04/01/1997 has revealed that there are 24 RCRIS-LQG sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
FMC CORP	34 SAWYER AVE.	1/8 - 1/4NNW	C13	48
DUPONT E I DE NEMOURS CO	SHERIDAN DR & RIVER RD	1/4 - 1/2SE	I57	177
DUNLOP TE & RR CN	RIVER RD & SHERIDAN DR	1/4 - 1/2SE	I58	178
WESTERN NEW YORK BARREL & DRUM	225 SAWYER AVE	1/4 - 1/2NE	J77	205
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 NNW	79	206
CHEMCENTRAL/BUFFALO	3709 RIVER RD	1/2 - 1 NNW	K81	211
GENERAL MILLS INC	305 SAWYER AVE	1/2 - 1 NE	L95	248
AMHERST PAINTING INC	318 SAWYER AVE - WEST W	1/2 - 1 NE	L102	257
A R & M CORP TONAWANDA TERM	3733 RIVER RD	1/2 - 1 NNW	M107	259
VAN DE WATER TREATMENT PLT	3750 RIVER RD	1/2 - 1 NNW	M108	259
SUNMARK PETROLEUM MARKETING TE	3755 RIVER RD	1/2 - 1 NNW	M109	260
ALLIED CORPORATION	3821 RIVER RD	1/2 - 1 NNW	O117	274
TONAWANDA COKE CORP	3875 RIVER RD	1/2 - 1 NNW	O119	278
O & K TRUCK REPAIRS LTD	2760 KENMORE AVE	1/2 - 1 ENE	P128	284
MECHTLERS FOREIGN CAR REPAIR	574 SHERIDAN DR	1/2 - 1 ENE	R129	284
NEW YORK WIRE MILLS CORP	3937 RIVER RD	1/2 - 1 NNW	T133	287
ERIE TRAILER REPAIR INC	2801 KENMORE AVE	1/2 - 1 ENE	S136	289
NORTHEAST MACHINE	71 TWO MILE CREEK RD	1 - 2 ENE	146	310
ENVIROTEK II PRP GROUP	4000 RIVER RD	1 - 2 NNW	T150	314
TONAWANDA NEW YORK TERMINAL	4000 RIVER RD	1 - 2 NNW	T152	315
LAKE ERIE ROLLING MILL INC	4000 RIVER RD	1 - 2 NNW	T155	317
CLARENCE MATERIALS CORP	4010 RIVER RD	1 - 2 NNW	158	319
A A M TONAWANDA FORGE	2390 KENMORE AVE	1 - 2 E	X172	331
KENTON CTR	151 TWO MILE RD	1 - 2 ENE	174	351

EXECUTIVE SUMMARY

ERNS: The Emergency Response Notification System records and stores information on reported releases of oil and hazardous substances. The source of this database is the U.S. EPA.

A review of the ERNS list, as provided by EDR, and dated 03/01/1997 has revealed that there are 2 ERNS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
383 SAWYER AVE	383 SAWYER AVE	1/2 - 1 NE	N115	274
383 SAWYER AVE	383 SAWYER AVE	1/2 - 1 NE	N116	274

FINDS: The Facility Index System contains both facility information and "pointers" to other sources of information that contain more detail. These include: RCRIS; Permit Compliance System (PCS); Aerometric Information Retrieval System (AIRS); FATES (FIFRA [Federal Insecticide Fungicide Rodenticide Act] and TSCA Enforcement System, FTTS [FIFRA/TSCA Tracking System]; CERCLIS; DOCKET (Enforcement Docket used to manage and track information on civil judicial enforcement cases for all environmental statutes); Federal Underground Injection Control (FURS); Federal Reporting Data System (FRDS); Surface Impoundments (SIA); TSCA Chemicals in Commerce Information System (CICS); PADS; RCRA-J (medical waste transporters/disposers); TRIS; and TSCA. The source of this database is the U.S. EPA/NTIS.

A review of the FINDS list, as provided by EDR, and dated 09/30/1995 has revealed that there are 53 FINDS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
POLYMER APPLICATIONS	3445 RIVER RD	0 - 1/8 SE	B9	26
FMC CORP	34 SAWYER AVE.	1/8 - 1/4NNW	C13	48
GOETZ ENERGY CORP	87 SAWYER AVE	1/8 - 1/4NNE	D25	91
CENTRAL FOUNDRY	91 SAWYER AVE	1/8 - 1/4NNE	D28	93
KURK FUEL OIL CO	130 SAWYER AVE	1/4 - 1/2NNE	E32	96
TEXACO USA /A DIV OF TEXACO IN	RIVER RD & JAMES ST	1/4 - 1/2NW	F33	96
CARMEN M PARISO INC	3649 RIVER RD	1/4 - 1/2NW	F34	97
DUNLOP TE & RR CN	RIVER RD & SHERIDAN DR	1/4 - 1/2SE	I58	178
E.I. DUPONT DE NEMOURS	SHERIDAN DRIVE STATION	1/4 - 1/2SE	I69	190
WESTERN NEW YORK BARREL & DRUM	225 SAWYER AVE	1/4 - 1/2NE	J77	205
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 NNW	79	206
CHEMCENTRAL/BUFFALO	3709 RIVER RD	1/2 - 1 NNW	K81	211
GENERAL MILLS INC	305 SAWYER AVE	1/2 - 1 NE	L95	248
AMHERST PAINTING INC	318 SAWYER AVE - WEST W	1/2 - 1 NE	L102	257
NYSTA AMHERST PAINTING	318 SAWYER RD	1/2 - 1 NE	L104	258
SCHWABEL FABRICATING CO. INC.	349 SAWYER AVE.	1/2 - 1 NE	105	258
A R & M CORP TONAWANDA TERM	3733 RIVER RD	1/2 - 1 NNW	M107	259
VAN DE WATER TREATMENT PLT	3750 RIVER RD	1/2 - 1 NNW	M108	259
SUNMARK PETROLEUM MARKETING TE	3755 RIVER RD	1/2 - 1 NNW	M109	260
ARCO	3773 RIVER ROAD	1/2 - 1 NNW	M112	262
ROADWAY EXPRESS INC	383 SAWYER AVE	1/2 - 1 NE	N114	263
ALLIED CORPORATION	3821 RIVER RD	1/2 - 1 NNW	O117	274
TONAWANDA COKE INC	3875 RIVER RD	1/2 - 1 NNW	O118	275
SHANCO PLASTICS & CHEM.	2716 KENMORE AVE.	1/2 - 1 ENE	P120	279
SHANCO PLASTIC	2716 KENMORE AVE	1/2 - 1 ENE	P122	280
SYNRES CHEM CORP	2716 KENMORE AVE	1/2 - 1 ENE	P123	281
QUACKENBUSH CO INC WAREHOUSE	483 SAWYER AVE	1/2 - 1 NE	Q127	283
O & K TRUCK REPAIRS LTD	2760 KENMORE AVE	1/2 - 1 ENE	P128	284
MECHTLERS FOREIGN CAR REPAIR	574 SHERIDAN DR	1/2 - 1 ENE	R129	284
B&W HEAT TREATING CO. INC.	2780 KEMORE AVENUE	1/2 - 1 ENE	S130	284
NEW YORK WIRE MILLS CORP	3937 RIVER RD	1/2 - 1 NNW	T133	287
ERIE TRAILER REPAIR CO	2801 KENMORE AVE	1/2 - 1 ENE	S135	289

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
R W WEAVER CORP DBA ANCHOR MAR	1501 FERRY RD	1/2 - 1 W	U137	290
OVERNITE TRANSPORTATION CO	2580 KENMORE AVE	1 - 2 E	V143	295
RYDER TRUCK RENTAL INC	2834 KENMORE AVE	1 - 2 NE	W144	295
UNIVERSAL JOINT SALES	2843 KENMORE AVE	1 - 2 NE	W145	309
NORTHEAST MACHINE	71 TWO MILE CREEK RD	1 - 2 ENE	146	310
NIAGARA RIVER WORLD	4000 RIVER RD	1 - 2 NNW	T147	311
ROBLIN STEEL	4000 RIVER RD	1 - 2 NNW	T149	312
ENVIROTEK II PRP GROUP	4000 RIVER RD	1 - 2 NNW	T150	314
ASCENSION CHEMICAL OF AMERICA	4000 RIVER ROAD	1 - 2 NNW	T151	315
TONAWANDA NEW YORK TERMINAL	4000 RIVER RD	1 - 2 NNW	T152	315
ENVIROTEK	4000 RIVER RD	1 - 2 NNW	T153	315
LAKE ERIE ROLLING MILL INC	4000 RIVER RD	1 - 2 NNW	T155	317
CLARENCE MATERIALS CORP	4010 RIVER RD	1 - 2 NNW	158	319
US AIR FORCE PLANT #40	2450 KENMORE AVENUE	1 - 2 E	X160	320
A B F FREIGHT SYSTEMS INC	50 FLYDER AVE	1 - 2 NE	Y161	320
CHEVROLET-TONAWANDA PLT 1	2390 KENMORE AVE	1 - 2 E	X170	330
A A M TONAWANDA FORGE	2390 KENMORE AVE	1 - 2 E	X172	331
KENTON CTR	151 TWO MILE RD	1 - 2 ENE	174	351
INS EQUIPMENT	RIVER RD	1 - 2 NNW	AA178	355
LYONS TRAN LINES INC	410 GRAND ISLAND BLVD	1 - 2 NE	AB180	356
ROLLINS LEASING CORP.	155 WOODWARD AVENUE WES	1 - 2 ENE	182	357

SPILLS: The Spills Information Database from The Department of Environmental Conservation.

A review of the NY Spills list, as provided by EDR, and dated 12/31/1996 has revealed that there are 95 NY Spills sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
POLYMER APPLICATIONS	3445 RIVER RD	0 - 1/8 SE	B9	26
POLYMER APPLICATIONS	3435 RIVER RD	1/8 - 1/4SE	B11	46
FMC CORPORATION	35 SAWYER AVE	1/8 - 1/4NNW	C15	51
FMC CORP-BUFFALO PLANT	37 SAWYER AVE	1/8 - 1/4N	C16	54
FMC CORPORATION	37 SAWYER AVE	1/8 - 1/4N	C19	82
FMC CORPORATION	39 SAWYER AVE	1/8 - 1/4N	C20	83
NI-MO HUNTLEY STATION	3400 RIVER RD	1/8 - 1/4SE	21	84
GOETZ ENERGY	85 SAWYER AVE	1/8 - 1/4NNE	D23	89
NIAGARA MOHAWK	87 SAWYER AVE	1/8 - 1/4NNE	D26	91
BROSKIN ENTERPRISES, INC.	87 SAWYER AVE	1/8 - 1/4NNE	D27	92
CHEMICAL/OIL ODOR	83 KAUFMAN AVE	1/4 - 1/2N	D29	93
LAUGHLIN	130 SAWYER AVE	1/4 - 1/2NNE	E30	94
Not reported	130 SAWYER AVE	1/4 - 1/2NNE	E31	95
NOCO ENERGY PRODUCTS III	100 JAMES AVE	1/4 - 1/2N	H37	99
RIVER ROAD DITCH	3688 RIVER RD	1/4 - 1/2NW	F40	125
INDUSTRIAL WASTE SYSTEMS	10 SHERIDAN DR	1/4 - 1/2SE	I42	127
DUNLOP TIRE CORP.	10 SHERIDAN DR	1/4 - 1/2SE	I43	128
NOCO ENERGY	10 SHERIDAN DR	1/4 - 1/2SE	I44	129
DUNLOP TIRE CORP	10 SHERIDAN DR	1/4 - 1/2SE	I45	130
DUNLOP	10 SHERIDAN DR	1/4 - 1/2SE	I46	132
DUNLOP TIRE CORPORATION	10 SHERIDAN DR	1/4 - 1/2SE	I47	142
DUNLOP-THREAD CEMENT	10 SHERIDAN DR	1/4 - 1/2SE	I48	143
DUNLOP TIRE COMPANY	10 SHERIDAN DR	1/4 - 1/2SE	I49	144
CONTRACTOR TRUCK	10 SHERIDAN DR	1/4 - 1/2SE	I50	150
DUNLOP TIRE 10 SHERIDAN	10 SHERIDAN DR	1/4 - 1/2SE	I51	151
DUNLOP (BOILER HOUSE)	10 SHERIDAN DR	1/4 - 1/2SE	I52	152

NRG019223

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
DUNLOP TIRE	10 SHERIDAN DR	1/4 - 1/2 SE	I53	153
CROSSETT TRUCK AT DUNLOP	10 SHERIDAN DR	1/4 - 1/2 SE	I56	176
DUPONT	SHERIDAN DRIVE / RIVER	1/4 - 1/2 SE	I59	179
OIL SHEEN - NIAGARA RIVER	RIVER RD. / SHERIDAN	1/4 - 1/2 SE	I60	179
TOWN OF TONAWANDA SEWER	SHERIDAN DR. / RIVER	1/4 - 1/2 SE	I61	180
DUPONT	SHERIDAN DR / RIVER RD	1/4 - 1/2 SE	I65	185
DUNLOP TIRE	1 SHERIDAN DR	1/4 - 1/2 SE	I66	186
INDECK	1 SHERIDAN DR	1/4 - 1/2 SE	I67	187
INDECK-YERKES ENERGY	2 SHERIDAN DR	1/4 - 1/2 SE	I71	197
UNK. SUBST. FROM OUTFALL	SHERIDAN DR. / RIVER	1/4 - 1/2 SE	I72	198
INDEC/ NFG	1 SHERIDAN DR	1/4 - 1/2 SE	I73	198
WESTERN NY DRUM CO.	225 SAWYER AVE	1/4 - 1/2 NE	J78	205
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 NNW	79	206
CHEMCENTRAL/BUFFALO	3709 RIVER RD	1/2 - 1 NNW	K80	209
3M O-CELLO	305 SAWYER AVE	1/2 - 1 NE	L82	212
3M O'CELLO	305 SAWYER AVE	1/2 - 1 NE	L83	212
3M TONAWANDA	305 SAWYER AVENUE	1/2 - 1 NE	L84	213
3M OCELLO	305 SAWYER AVE	1/2 - 1 NE	L85	229
3M O-CEL-O	305 SAWYER AVE	1/2 - 1 NE	L86	231
TRAFFIC ACCIDENT	305 SAWYER AVE	1/2 - 1 NE	L87	232
3M O-CEL-O	305 SAWYER AVE	1/2 - 1 NE	L88	233
3-M COMPANY	305 SAWYER AVE	1/2 - 1 NE	L89	234
3M O-CELL-O	305 SAWYER AVE	1/2 - 1 NE	L90	235
O'CELLO DIVISION	305 SAWYER AVE	1/2 - 1 NE	L91	236
3M CORPORATION	305 SAWYER AVE	1/2 - 1 NE	L92	237
3-M O'CELLO PLANT	305 SAWYER AVE	1/2 - 1 NE	L93	246
OCELLO	305 SAWYER AVE	1/2 - 1 NE	L94	247
GENERAL MILLS INC	305 SAWYER AVE	1/2 - 1 NE	L95	248
O-CELL-O	305 SAWYER AVE	1/2 - 1 NE	L97	251
O-CEL-O 3M	305 SAWYER AVE	1/2 - 1 NE	L98	252
3-M	305 SAWYER AVE	1/2 - 1 NE	L99	253
O-CEL-O	305 SAWYER AVE	1/2 - 1 NE	L100	254
3M COMPANY	305 SAWYER AVE	1/2 - 1 NE	L101	255
WARD TRUCKING	318 SAWYER AVE	1/2 - 1 NE	L103	257
GOETZ OIL	3755 RIVER RD	1/2 - 1 NNW	M110	260
SUN REFINING	3755 RIVER RD	1/2 - 1 NNW	M111	261
ROADWAY TRANSPORTATION	383 SAWYER AVE	1/2 - 1 NE	N113	262
ROADWAY EXPRESS INC	383 SAWYER AVE	1/2 - 1 NE	N114	263
TONAWANDA COKE INC	3875 RIVER RD	1/2 - 1 NNW	O118	275
CORSI FLEET SERVICE	2716 KENMORE AVE	1/2 - 1 ENE	P121	279
CENTRAL TRANSPORT	454 SAWYER AVE	1/2 - 1 NE	Q124	281
MECHTLER'S - JAG SHOP	SHERIDAN / KENMORE	1/2 - 1 ENE	R126	283
SIVACO 3937 RIVER ROAD	3937 RIVER RD	1/2 - 1 NNW	T131	285
SIVACO NY COMPANY	3937 RIVER RD	1/2 - 1 NNW	T132	285
SIVACO NEW YORK INC	3937 RIVER RD	1/2 - 1 NNW	T134	288
ANCHOR MARINE	1501 FERRY ROAD	1/2 - 1 W	U138	290
Not reported	SAWYER / KENMORE	1/2 - 1 ENE	S139	291
VILLAGE INN	1510 FERRY STREET	1 - 2 W	U140	292
ANCHOR MARINE	1509 FERRY STREET	1 - 2 W	U141	293
OVERNIGHT TRUCKING	2580 KENMORE AVENUE	1 - 2 E	V142	294
ROBLIN STEEL	4000 RIVER RD	1 - 2 NNW	T149	312
MARATHON PETROLEUM	4000 RIVER RD	1 - 2 NNW	T156	318
WICK WIRE FACTORY	4000 RIVER RD	1 - 2 NNW	T157	318
THRUWAY AUTHORITY	265 GRAND ISLAND BLVD	1 - 2 NE	NE 159	319
NIAGARA MOHAWK TRANSFORME	140 PARKEDGE AVE	1 - 2 ENE	Z162	321
BOB MILLER-USED OIL	365 ELMWOOD ROAD	1 - 2 W	163	321

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
Not reported	678 SHERIDAN DR	1 - 2 ENE	Z164	322
AMERICAN AXLE AND MANUFAC	2390 KENMORE AVE	1 - 2 E	X165	323
AMERICAN AXLE & MFG	2390 KENMORE AVE	1 - 2 E	X166	324
AMERICAN AXLE & MFG.	2390 KENMORE AVE	1 - 2 E	X167	325
AMERICAN AXLE & MANUFACT.	2390 KENMORE AVE	1 - 2 E	X168	326
GM 2390 KENMORE	2390 KENMORE AVE	1 - 2 E	X169	329
GENERAL MOTORS	2390 KENMORE AVE	1 - 2 E	X171	330
AMERICAN AXLE & MANUFACTURING	2390 KENMORE AVE	1 - 2 E	X173	332
PST VANS INC.	350 GRAND ISLAND BLVD	1 - 2 NE	Y175	352
AMERICAN AXLE	2370 KENMORE AVE	1 - 2 E	176	353
INS SCRAP	4111 RIVER RD	1 - 2 NNW	AA179	355
GRIFFITH OIL	410 GRAND ISLAND BLVD	1 - 2 NE	AB181	356
ED'S AUTO	136 GRAND ISLAND BLVD	1 - 2 ENE	183	357

EXECUTIVE SUMMARY

Due to poor or inadequate address information, the following sites were not mapped:

<u>Site Name</u>	<u>Database(s)</u>
DUNLOP SITE 2	FINDS, CERC-NFRAP
DUPONT BOAT CLUB	LUST
SAGINAW DIVISION - GM	LUST, NY Spills
OCTO MANUFACTURING CO.	LUST
SUN TERMINAL(ATLANTIC)	LUST
TONAWANDA ENGINE PLANT	LUST
NIAGARA MOHAWK	LUST, NY Spills
NOCO ENERGY TANK 122	LUST
AGWAY	LUST
DUPONT YURKEES SITE	LUST
VAN DE WATER WATER PLANT	LUST
NOCO OIL	LUST
NOCO ENERGY	LUST, NY Spills
UNITED REFINING	LUST, NY Spills
CPC GROUP	LUST
CPC TONAWANDA	LUST
CHARLIE FASO BACKYARD	LUST
CHEVROLET ENGINE PLANT	LUST
ROBO STATION	LUST
GOETZ - FMC	LUST, NY Spills
DUNLOP TIRE	LUST, NY Spills
M.L YOUNG MOTOR EXPRESS	LUST
AMERICAN ENVIROMENTAL	LUST
TONAWANDA SECTION MAINTENANCE	UST, AST
DUPONT-YERKES	AST
SHERIDAN PARKSIDE WADING POOL	AST
NATL FUEL GAS CO REG STA TN RM 508	RCRIS-SQG, FINDS
TONAWANDA TOWN OF WATER TREATMENT	RCRIS-SQG, FINDS
US TRANSCO	RCRIS-SQG
NYSTA C O OAKGROVE CONSTRUCTION	FINDS, RCRIS-LQG
STATION 133	FINDS, RCRIS-LQG
NYSDOT BIN 1044960	FINDS, RCRIS-LQG
JAMES ST SVC CTR	FINDS, RCRIS-LQG
SERVICE STATION	FINDS, RCRIS-LQG
NYSDOT BIN 1044980 D256665	RCRIS-LQG
TERMINAL STATION C	FINDS, RCRIS-LQG
NYS THRUWAY AUTH	FINDS, RCRIS-LQG
NYSDOT BIN 4043850 D256665	RCRIS-LQG
NYS THRUWAY AUTH	FINDS, RCRIS-LQG
NYS THRUWAY AUTH	FINDS, RCRIS-LQG
NIAGARA MOHAWK - HUNTLEY	NY Spills
HUNTLEY COAL PLANT	NY Spills
NIAGARA MOHAWK - HUNTLEY	NY Spills

NRG019226

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
Executive Summary.....	ES1
Topographic Map.....	2
GeoCheck Summary.....	3
Overview Map.....	5
Detail Map.....	6
Map Summary - All Sites.....	7
Map Summary - Sites with higher or the same elevation as the Target Property.....	8
Map Findings.....	9
Orphan Summary.....	359
 <u>APPENDICES</u>	
GeoCheck Version 2.1.....	A1
EPA Waste Codes.....	A3
Government Records Searched / Data Currency Tracking Addendum.....	A5

Thank you for your business.
Please contact EDR at 1-800-352-0050
with any questions or comments.

Disclaimer

This Report contains information obtained from a variety of public sources and EDR makes no representation or warranty regarding the accuracy, reliability, quality, or completeness of said information or the information contained in this report. The customer shall assume full responsibility for the use of this report.
No warranty of merchantability or of fitness for a particular purpose, expressed or implied, shall apply and EDR specifically disclaims the making of such warranties. In no event shall EDR be liable to anyone for special, incidental, consequential or exemplary damages. Copyright (c) 1997 by EDR. All rights reserved.

TOPOGRAPHIC MAP - 1201713.6p - Fluor Daniel GTI



- ↘ Major Roads
- ↘ Contour Lines
- ↘ Waterways
- ⊙ Earthquake epicenter, Richter 5 or greater
- ⊙ Closest Federal Well in quadrant
- ⊙ Closest State Well in quadrant
- ⊙ Closest Public Water Supply Well

(HD) Closest Hydrogeological Data

GEOCHECK VERSION 2.1 SUMMARY

TARGET PROPERTY COORDINATES

Latitude (North): 42.970901 - 42° 58' 15.2"
Longitude (West): 78.927597 - 78° 55' 39.3"
Universal Transverse Mercator: Zone 17
UTM X (Meters): 669005.1
UTM Y (Meters): 4759452.0

GEOLOGIC AGE IDENTIFICATION†

Geologic Code: S3
Era: Paleozoic
System: Silurian
Series: Upper Silurian (Cayugan)

ROCK STRATIGRAPHIC UNIT†

Category: Stratified Sequence

GROUNDWATER FLOW INFORMATION

Groundwater flow direction for a particular site is best determined by a qualified environmental professional using site-specific well data. If such data is not reasonably ascertainable, it may be necessary to rely on other sources of information, including well data collected on nearby properties, regional groundwater flow information (from deep aquifers), or surface topography.‡

General Topographic Gradient: General SW
General Hydrogeologic Gradient: No hydrogeologic data available.
Site-Specific Hydrogeological Data*:
Search Radius: 2.0 miles
Status: Not found

USGS TOPOGRAPHIC MAP ASSOCIATED WITH THIS SITE

Target Property: 2442078-H8 BUFFALO NW, NY CA10

FEDERAL DATABASE WELL INFORMATION

<u>WELL</u> <u>QUADRANT</u>	<u>DISTANCE</u> <u>FROM TP</u>	<u>LITHOLOGY</u>	<u>DEPTH TO</u> <u>WATER TABLE</u>
NO WELLS FOUND			

STATE DATABASE WELL INFORMATION

<u>WELL</u> <u>QUADRANT</u>	<u>DISTANCE</u> <u>FROM TP</u>
Southern	1/4 - 1/2 Mile
Western	>2 Miles

PUBLIC WATER SUPPLY SYSTEM INFORMATION (EPA-FRDS)

Searched by Nearest Well.

NOTE: PWS System location is not always the same as well location.

PWS Name: ERIE COUNTY WATER AUTHORITY
ELLICOTT SQUARE BUILDING
BUFFALO, NY 14203

Location Relative to TP: 1/4 - 1/2 Mile South

Well currently has or has had major violation(s): No

NRG019229

GEOCHECK VERSION 2.1 SUMMARY

AREA RADON INFORMATION

EPA Radon Zone for ERIE County: 1.


Note: Zone 1 indoor average level > 4pCi/L.
: Zone 2 indoor average level >= 2pCi/L.
: Zone 3 indoor average level < 2pCi/L.

ERIE COUNTY, NY

Number of sites tested: 622

<u>Area</u>	<u>Average Activity</u>	<u>% <4 pCi/L</u>	<u>% 4-20 pCi/L</u>	<u>% >20 pCi/L</u>
Living Area	1.000 pCi/L	89%	11%	0%
Basement	1.150 pCi/L	87%	11%	2%

DETAIL MAP - 1201713.6p - Fluor Daniel GTI

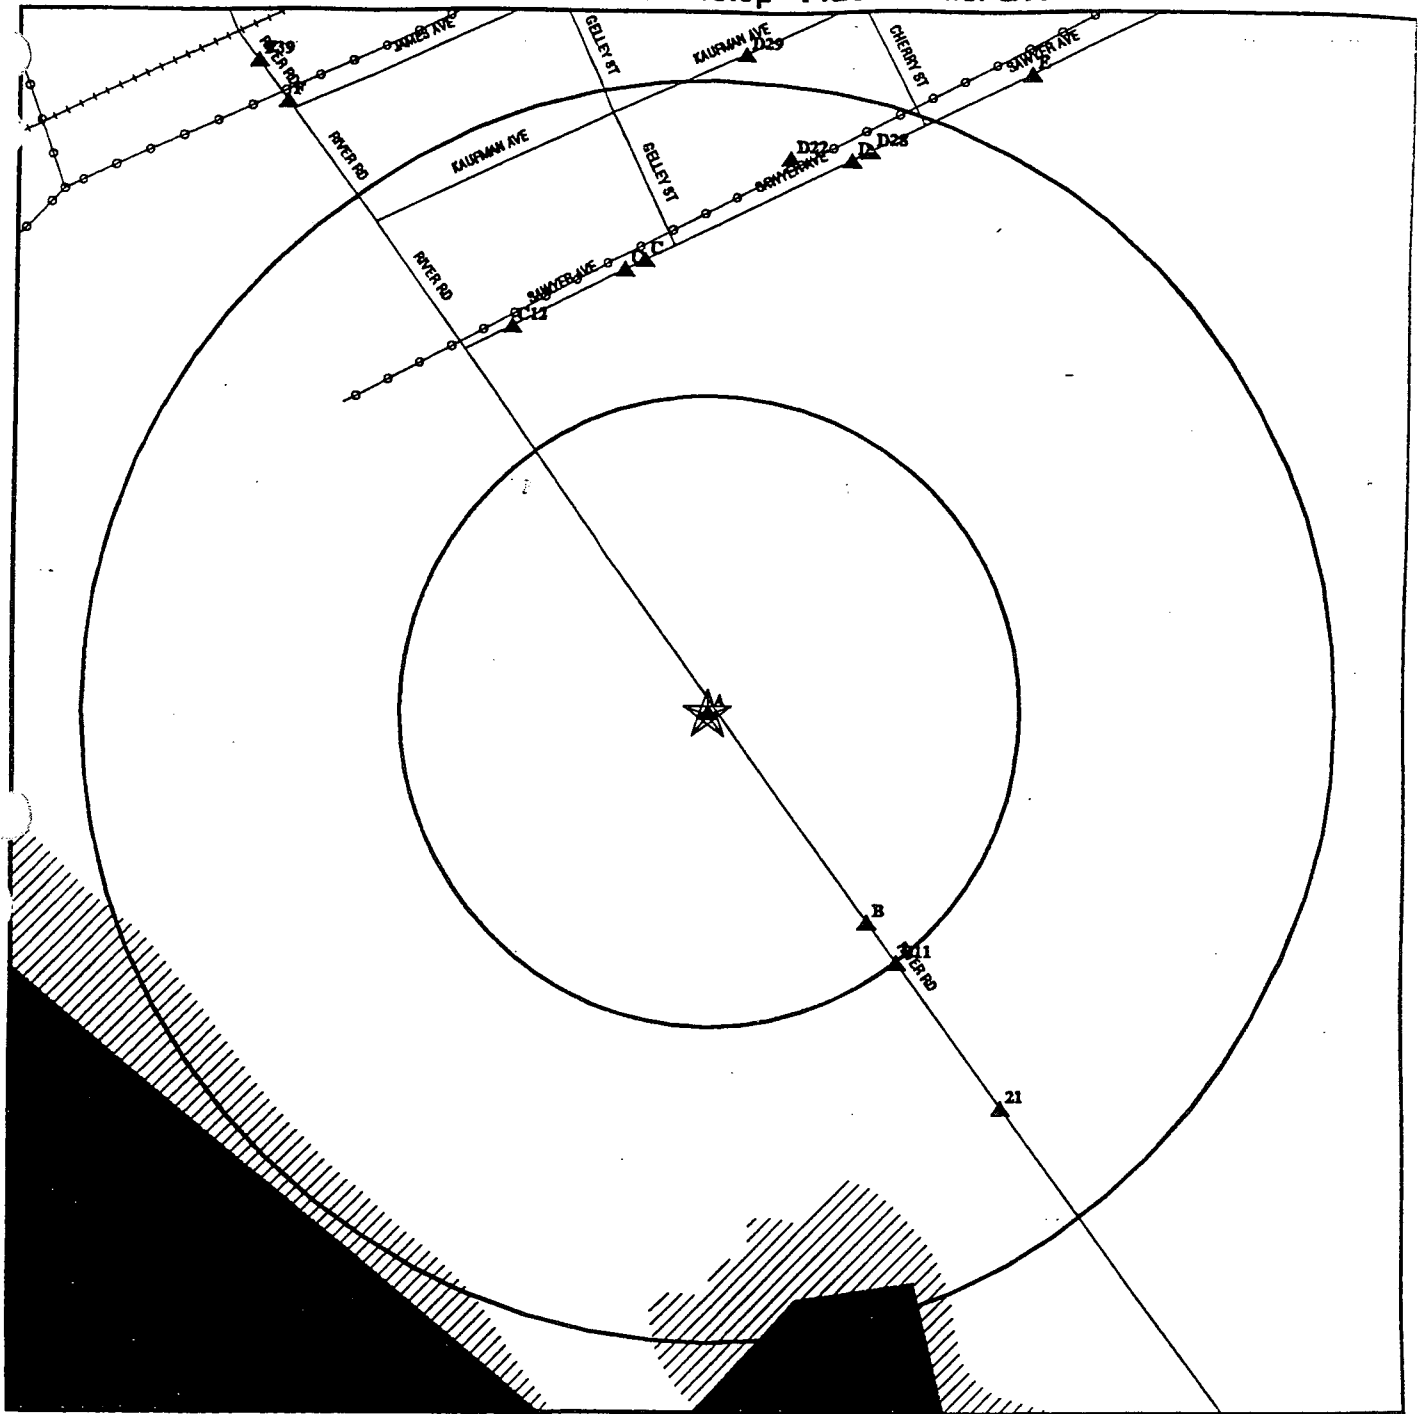

- ★ Target Property
- ▲ Sites at elevations higher than or equal to the target property
- ◊ Sites at elevations lower than the target property
- Coal Gasification Sites (if requested)
- Sensitive Receptors
- National Priority List Sites
- Landfill Sites

- N Power transmission lines
- N Oil & Gas pipelines
- ▨ 100-year flood zone
- 500-year flood zone




OVERVIEW MAP - 1201713.6p - Fluor Daniel GTI



- ★ Target Property
- ▲ Sites at elevations higher than or equal to the target property
- ◊ Sites at elevations lower than the target property
- Coal Gasification Sites (if requested)
- National Priority List Sites
- Landfill Sites

- Power transmission lines
- Oil & Gas pipelines
- 100-year flood zone
- 500-year flood zone



**MAP FINDINGS SUMMARY SHOWING
ALL SITES**

<u>Database</u>	<u>Target Property</u>	<u>Search Distance (Miles)</u>	<u>< 1/8</u>	<u>1/8 - 1/4</u>	<u>1/4 - 1/2</u>	<u>1/2 - 1</u>	<u>> 1</u>	<u>Total Plotted</u>
NPL		1.250	0	0	0	0	0	0
Delisted NPL		TP	NR	NR	NR	NR	NR	0
RCRIS-TSD		1.250	0	0	0	0	0	0
State Haz. Waste		1.250	1	1	2	2	3	9
CERCLIS	X	1.250	1	0	0	2	1	4
CERC-NFRAP		TP	NR	NR	NR	NR	NR	0
CORRACTS		1.250	0	1	0	1	1	3
State Landfill		1.250	0	0	0	1	1	2
LUST		0.750	1	4	6	9	NR	20
UST	X	0.500	0	1	5	NR	NR	6
AST	X	0.500	1	3	8	NR	NR	12
RAATS		1.250	0	0	0	0	1	1
RCRIS Sm. Quan. Gen.		1.250	1	1	3	8	9	22
RCRIS Lg. Quan. Gen.	X	1.250	0	1	3	13	7	24
HMIRS		TP	NR	NR	NR	NR	NR	0
PADS		TP	NR	NR	NR	NR	NR	0
ERNS		1.250	0	0	0	2	0	2
FINDS	X	1.250	1	3	6	23	20	53
TRIS		TP	NR	NR	NR	NR	NR	0
NPL Liens		TP	NR	NR	NR	NR	NR	0
TSCA		TP	NR	NR	NR	NR	NR	0
MLTS		1.250	0	0	0	0	0	0
NY Spills	X	1.250	1	9	28	35	22	95
ROD		1.250	0	0	0	0	0	0
CONSENT		1.250	0	0	0	0	0	0
Coal Gas		1.000	0	0	0	0	NR	0

TP = Target Property

NR = Not Requested at this Search Distance

* Sites may be listed in more than one database

**MAP FINDINGS SUMMARY SHOWING
ONLY SITES HIGHER THAN OR THE SAME ELEVATION AS TP**

Database	Target Property	Search Distance (Miles)	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
NPL		1.250	0	0	0	0	0	0
Delisted NPL		TP	NR	NR	NR	NR	NR	0
RCRIS-TSD		1.250	0	0	0	0	0	0
State Haz. Waste		1.250	1	1	2	2	3	9
CERCLIS	X	1.250	1	0	0	2	1	4
CERC-NFRAP		TP	NR	NR	NR	NR	NR	0
CORRACTS		1.250	0	1	0	1	1	3
State Landfill		1.250	0	0	0	1	1	2
LUST		0.750	1	4	6	9	NR	20
UST	X	0.500	0	1	5	NR	NR	6
AST	X	0.500	1	3	8	NR	NR	12
RAATS		1.250	0	0	0	0	1	1
RCRIS Sm. Quan. Gen.		1.250	1	1	3	8	9	22
RCRIS Lg. Quan. Gen.	X	1.250	0	1	3	13	7	24
HMIRS		TP	NR	NR	NR	NR	NR	0
PADS		TP	NR	NR	NR	NR	NR	0
ERNS		1.250	0	0	0	2	0	2
FINDS	X	1.250	1	3	6	23	20	53
TRIS		TP	NR	NR	NR	NR	NR	0
NPL Liens		TP	NR	NR	NR	NR	NR	0
TSCA		TP	NR	NR	NR	NR	NR	0
MLTS		1.250	0	0	0	0	0	0
NY Spills	X	1.250	1	9	28	35	22	95
ROD		1.250	0	0	0	0	0	0
CONSENT		1.250	0	0	0	0	0	0
Coal Gas		1.000	0	0	0	0	NR	0

TP = Target Property

NR = Not Requested at this Search Distance

* Sites may be listed in more than one database

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

Coal Gas Site Search: No site was found in a search of Real Property Scan's ENVIROHAZ database.

A7	C.R. HUNTLEY GEN. STATION	NY Spills	S102178118
Target	3500 RIVER RD		N/A
Property	TONAWANDA, NY		

SPILLS:

Facility ID: 9307495	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: MJS	Spill Type: - Facility
Caller Name: MICHEAL BOESL	Caller Agency: NIAGARA MOHAWK
Caller Phone: (717) 879-3876	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: Not reported
Spiller: C.R. HUNTLEY GEN. STATION	
Address: 3500 RIVER ROAD	
	TONAWANDA, NY 14150
Spill Class: Known release with minimal potential for fire or hazard. DEC Response.	
	Willing Responsible Party. Corrective action taken.
Spill Closed Dt: 10/04/1993	
Spill Cause: Equipment Failure	Resource Affected: Surface Water
Water Affected: NIAGARA RIVER	Spill Source: Other Commercial/Industrial
Spill Notifier: Affected Persons	PBS Number: Not reported
Spill Date: 09/20/1993 09:00	Reported to Dept: 09/21/1993 10:00
Cleanup Ceased: 10/04/1993	
Last Inspection: 09/22/1993	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 10/15/1993	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 09/21/1993	
Remark: SLIGHT SHEEN NOTICED 9/19/93 & HEAVIER SHEEN NOTICED 9/20/93.	

A8	NIAGARA MOHAWK - HUNTLEY	NY Spills	S102178540
Target	3500 RIVER RD		N/A
Property	TONAWANDA, NY		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NIAGARA MOHAWK - HUNTLEY (Continued)

S102178540

SPILLS:

Facility ID:	9401499	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	MIKE BOESL	Caller Agency:	HUNTLEY STEAM STATION
Caller Phone:	(716) 879-3876	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-3876
Spiller:	NIAGARA MOHAWK		
Address:	3500 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/19/1994		
Spill Cause:	Human Error	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/29/1994 13:00	Reported to Dept:	04/29/1994 14:10
Cleanup Ceased:	09/01/1994		
Last Inspection:	05/02/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/07/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/03/1994		
Remark:	DIESEL FUEL IN POND AND STORM DRAINS.		

A6 C R HUNTLEY GENERATING ST
Target 3500 RIVER RD
Property TONAWANDA, NY

NY Spills S102173914
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY GENERATING ST (Continued)

S102173914

SPILLS:

Facility ID:	9103598	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MICHAEL BOESL	Caller Agency:	NIAGARA MOHAWK
Caller Phone:	(716) 879-3876	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NIAGARA MOHAWK		
Address:	3500 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Known release that creates a file or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/19/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	07/02/1991 13:26
Spill Date:	07/01/1991 10:00		
Cleanup Ceased:	11/19/1993		
Last Inspection:	07/02/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/02/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/08/1991		
Remark:	LEAK FROM 10000 GAL A/G TANK FROM PIPE INSIDE SHED. SPILL CONTAINED WITHIN DIKE AREA. INVENTORY INDICATED 4000 GAL LOSS PRODUCT VACCED UP. WILL BURN.		

**A2
Target
Property**

**C R HUNTLEY STEAM STATION
RIVER RD
TONAWANDA, NY 14207**

**CERCLIS 1000118320
FINDS NYD003909694
RCRIS-LQG**

CERCLIS Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	SITE IS A LANDFILL USED FOR DISPOSAL OF FOUNDRY SAND, SANDCASTS, SLAG AND BLACK SANDY MATERIAL. LANDFILL IS 80% COVERED W/CLAY CAP. GROUNDWATER AND SUBSURFACE SOIL SAMPLES SHOW TRACES OF METALS(LEAD, ARSENIC), BENZOIC ACID, POLYNUCLEAR(PNA)		

CERCLIS Assessment History:

Assessment:	DISCOVERY	Completed:	04/01/80
Assessment:	PRELIMINARY ASSESSMENT	Completed:	09/01/84
Assessment:	PRELIMINARY ASSESSMENT	Completed:	03/03/86
Assessment:	SCREENING SITE INSPECTION	Completed:	03/20/86

CERCLIS Site Status:

This site is currently under investigation by the government to assess the extent of further action

CERCLIS Alias Name(s):

NIAGARA MOHAWK/CR HUNTLY STATION

NRG019237

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

1000118320

RCRIS:

Owner: Not reported
Contact: JOHN TOENNIES
(315) 474-1511
Record Date: 08/15/80
Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	10711.80	F001	591.80

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

**A1
Target
Property**

**C.R. HUNTLEY STEAM STATION
3500 RIVER ROAD
TONAWANDA, NY 14150**

AST

A100085999
N/A

NRG019238

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C.R. HUNTLEY STEAM STATION (Continued)

A100085999

CBS AST:			
Facility ID:	9-000115	Telephone:	(716) 879-3850
Owner:	NIAGARA MOHAWK POWER CORP. 300 ERIE BLVD. WEST SYRACUSE, NY 13202 (315) 474-1511		
Facility Status:	Active	Total AST's:	4
Tank ID:	001		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	06/85	Capacity (Gal):	6429
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	CUT-OFF WALLS	Haz Percent:	93
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-427683
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-001023	ICS Number:	9-167088
Operator:	NIAGARA MOHAWK POWER CORP.	Facility Town:	TONAWANDA
Emrgncy Contact:	MICHAEL L. BOESL	Emrgncy Phone:	(716) 879-3876
Certified Date:	03/25/97	Expiration Date:	06/15/99
Owner type:	Corporate/Commercial	Facility Type:	Other
Owner Sub Type:	Not reported		
Mail Name:	NIAGARA MOHAWK POWER CORP.		
Mail Contact:	MICHAEL L. BOESL C.R. HUNTLEY STEAM STATION 3500 RIVER ROAD TONAWANDA, NY 14150		
Mail Phone:	(716) 879-3890		

NRG019239

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C.R. HUNTLEY STEAM STATION (Continued)

A100085999

Facility ID:	9-000115	Telephone:	(716) 879-3850
Owner:	NIAGARA MOHAWK POWER CORP. 300 ERIE BLVD. WEST SYRACUSE, NY 13202 (315) 474-1511		
Facility Status:	Active	Total AST's:	4
Tank ID:	002		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	06/85	Capacity (Gal):	7180
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING/JACKETED		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	JACKETED		
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-427683
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-001023	ICS Number:	9-167088
Operator:	NIAGARA MOHAWK POWER CORP.	Facility Town:	TONAWANDA
Emrgncy Contact:	MICHAEL L. BOESL	Emrgncy Phone:	(716) 879-3876
Certified Date:	03/25/97	Expiration Date:	06/15/99
Owner type:	Corporate/Commercial	Facility Type:	Other
Owner Sub Type:	Not reported		
Mail Name:	NIAGARA MOHAWK POWER CORP.		
Mail Contact:	MICHAEL L. BOESL C.R. HUNTLEY STEAM STATION 3500 RIVER ROAD TONAWANDA, NY 14150		
Mail Phone:	(716) 879-3890		

NRG019240

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C.R. HUNTLEY STEAM STATION (Continued)

A100085999

Facility ID:	9-000115	Telephone:	(716) 879-3850
Owner:	NIAGARA MOHAWK POWER CORP. 300 ERIE BLVD. WEST SYRACUSE, NY 13202 (315) 474-1511		
Facility Status:	Active	Total AST's:	4
Tank ID:	003		
Tank Status:	Not reported	Capacity (Gal):	250
Tank Location:	ABOVEGROUND	Product Stored:	LEADED GASOLINE
Install Date:	11/85		
Tank Type:	Steel/carbon steel	Pipe Location:	Aboveground
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	RUBBER LINER	Haz Percent:	50
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]		
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Automatic Shut-Off		
Chemical:	Not reported	PBS Number:	9-427683
Tank Closed:	Not reported	SWIS Code:	1464
Region:	STATE	ICS Number:	9-167088
Case Number:	1310732	Facility Town:	TONAWANDA
MOSF Number:	Not reported	Emrgncy Phone:	(716) 879-3876
SPDES Number:	0-001023	Expiration Date:	06/15/99
Operator:	NIAGARA MOHAWK POWER CORP.	Facility Type:	Other
Emrgncy Contact:	MICHAEL L. BOESL		
Certified Date:	03/25/97		
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	NIAGARA MOHAWK POWER CORP.		
Mail Contact:	MICHAEL L. BOESL C.R. HUNTLEY STEAM STATION 3500 RIVER ROAD TONAWANDA, NY 14150		
Mail Phone:	(716) 879-3890		

NRG019241

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C.R. HUNTLEY STEAM STATION (Continued)

A100085999

Facility ID:	9-000115	Telephone:	(716) 879-3850
Owner:	NIAGARA MOHAWK POWER CORP. 300 ERIE BLVD. WEST SYRACUSE, NY 13202 (315) 474-1511		
Facility Status:	Active	Total AST's:	4
Tank ID:	004		
Tank Status:	Not reported	Capacity (Gal):	287
Tank Location:	ABOVEGROUND	Product Stored:	LEADED GASOLINE
Install Date:	11/85		
Tank Type:	Steel/carbon steel		
Extrnl Protection:	PAINTED/ASPHALT COATING	Pipe Location:	Aboveground
Intrnl Protection:	RUBBER LINER		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Haz Percent:	50
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Ferric sulfate		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	10028225	PBS Number:	9-427683
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-001023	ICS Number:	9-167088
Operator:	NIAGARA MOHAWK POWER CORP.	Facility Town:	TONAWANDA
Emrgncy Contact:	MICHAEL L. BOESL	Emrgncy Phone:	(716) 879-3876
Certified Date:	03/25/97	Expiration Date:	06/15/99
Owner type:	Corporate/Commercial	Facility Type:	Other
Owner Sub Type:	Not reported		
Mail Name:	NIAGARA MOHAWK POWER CORP.		
Mail Contact:	MICHAEL L. BOESL C.R. HUNTLEY STEAM STATION 3500 RIVER ROAD TONAWANDA, NY 14150		
Mail Phone:	(716) 879-3890		

A3 C R HUNTLEY STEAM STATION
Target 3500 RIVER RD
Property TONAWANDA, NY 14150

UST U003079700
AST N/A

NRG019242

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

U003079700

PBS UST:

Facility ID:	9-427683	CBS Number:	9-000115
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-3800	Location:	Not reported
Operator:	NIAGARA MOHAWK POWER CORP		
Contact:	Not reported		
Emergency Contact:	MICHAEL BOESL, (716) 879-3876		
Facility Type:	UTILITY		
Total Tanks:	8	Old PBS Num:	Not reported
Owner:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST ENVIRONMENTAL AFFAIRS, A-2 NY 13202 (315) 474-1511 ATTN: JOSEPH MIAKISZ		
Facility Status:	Active	Total Capacity:	1500
Certification:	02/05/1997	Expiration:	12/14/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	YY	Install Date:	01/70
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	OTHER		
Leak Detection:	NONE	Dispenser:	Suction
Overfill Prot:	Product Level Gauge	Next Test Date:	Not reported
Date Tested:	Not reported	Test Method:	Not reported
Date Closed:	00/00		
Database Type:	Not reported		

NRG019243

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

U003079700

Facility ID:	9-427683	CBS Number:	9-000115
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-3800	Location:	Not reported
Operator:	NIAGARA MOHAWK POWER CORP		
Contact:	Not reported		
Emergency Contact:	MICHAEL BOESL, (716) 879-3876		
Facility Type:	UTILITY		
Total Tanks:	8	Old PBS Num:	Not reported
Owner:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST ENVIRONMENTAL AFFAIRS, A-2 NY 13202 (315) 474-1511 ATTN: JOSEPH MIAKISZ		
Facility Status:	Active	Total Capacity:	8700
Certification:	02/05/1997	Expiration:	12/14/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	AAA	Install Date:	01/56
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	OTHER		
Leak Detection:	Not reported		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019244

MAP FINDINGS

ID	Site	Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID N	EPA ID N
----	------	--------	-----------	----------	-----------	------	-------------	----------	----------

C R HUNTLEY STE

C R HUNTLEY STEAM STATION (Continued)

U003079;

Facility ID:
Town:
Telephone:
Operator:
Contact:
Emergency Con
Facility Type:
Total Tanks:
Owner:

Facility ID: 9-427683
Town: Not reported
Telephone: (716) 879-3800
Operator: NIAGARA MOHAWK POWER CORP
Contact: Not reported
Emergency Contact: MICHAEL BOESL, (716) 879-3876
Facility Type: UTILITY
Total Tanks: 8
Owner: NIAGARA MOHAWK POWER CORP
300 ERIE BLVD WEST
SYRACUSE, NY 13202
(315) 474-1511

CBS Number: 9-000115
SWIS ID: 1464
Location: Not reported

Old PBS Num: Not reported

Owner Type:
Owner Subtype:
Mailing Address:

Owner Type: Corporate/Commercial
Owner Subtype: Not reported
Mailing Address: NIAGARA MOHAWK POWER CORP
300 ERIE BLVD WEST
ENVIRONMENTAL AFFAIRS, A-2
NY 13202
(315) 474-1511
ATTN: JOSEPH MIAKISZ

Owner Mark: First Owner

Facility Status:
Certification:
Tank Status:
Tank Location:
Tank ID:
Product Stored:
Tank Internal:
Pipe Location:
Tank External:
Pipe External:
Second Containm
Leak Detection:
Overfill Prot:
Date Tested:
Date Closed:
Database Type:

Facility Status: Active
Certification: 02/05/1997
Tank Status: Closed Before April 1, 1991
Tank Location: UNDERGROUND
Tank ID: BBB
Product Stored: NOS 1,2, OR 4 FUEL OIL
Tank Internal: Not reported
Pipe Location: Not reported
Tank External: Not reported
Pipe External: Not reported
Second Containment: OTHER
Leak Detection: Not reported
Overfill Prot: Product Level Gauge
Date Tested: Not reported
Date Closed: 00/00
Database Type: Not reported

Total Capacity: 8700
Expiration: 12/14/1997

Install Date: 01/56
Tank Type: Steel/carbon steel
Pipe Internal: Not reported
Pipe Type: STEEL/IRON

Dispenser: Suction
Next Test Date: Not reported
Test Method: Not reported

UN

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

U003079700

<p>Facility ID: 9-427683 Town: Not reported Telephone: (716) 879-3800 Operator: NIAGARA MOHAWK POWER CORP Contact: Not reported Emergency Contact: MICHAEL BOESL, (716) 879-3876 Facility Type: UTILITY Total Tanks: 8 Owner: NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511</p> <p>Owner Type: Corporate/Commercial Owner Subtype: Not reported Mailing Address: NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST ENVIRONMENTAL AFFAIRS, A-2 NY 13202 (315) 474-1511 ATTN: JOSEPH MIAKISZ</p> <p>Facility Status: Active Certification: 02/05/1997 Tank Status: In Service Tank Location: UNDERGROUND Tank ID: BB1 Product Stored: UNLEADED GASOLINE Tank Internal: Not reported Pipe Location: Not reported Tank External: Not reported Pipe External: Not reported Second Containment: NONE Leak Detection: NONE Overfill Prot: None Date Tested: Not reported Date Closed: Not reported Database Type: Not reported</p>	<p>CBS Number: 9-000115 SWIS ID: 1464 Location: Not reported</p> <p>Old PBS Num: Not reported</p> <p>Owner Mark: First Owner</p> <p>Total Capacity: 550 Expiration: 12/14/1997</p> <p>Install Date: 01/80 Tank Type: Fiberglass reinforced plastic [FRP] Pipe Internal: Not reported Pipe Type: STEEL/IRON</p> <p>Dispenser: Suction Next Test Date: N.T.R Test Method: Not reported</p>
---	--

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

U003079700

Facility ID:	9-427683	CBS Number:	9-000115
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-3800	Location:	Not reported
Operator:	NIAGARA MOHAWK POWER CORP		
Contact:	Not reported		
Emergency Contact:	MICHAEL BOESL, (716) 879-3876		
Facility Type:	UTILITY	Old PBS Num:	Not reported
Total Tanks:	8		
Owner:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST ENVIRONMENTAL AFFAIRS, A-2 NY 13202 (315) 474-1511 ATTN: JOSEPH MIAKISZ		
Facility Status:	Active	Total Capacity:	550
Certification:	02/05/1997	Expiration:	12/14/1997
Tank Status:	In Service		
Tank Location:	UNDERGROUND	Install Date:	01/80
Tank ID:	BB2	Tank Type:	Fiberglass reinforced plastic [FRP]
Product Stored:	UNLEADED GASOLINE	Pipe Internal:	Not reported
Tank Internal:	Not reported	Pipe Type:	STEEL/IRON
Pipe Location:	Not reported		
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE	Dispenser:	Suction
Leak Detection:	NONE	Next Test Date:	N.T.R
Overfill Prot:	None	Test Method:	Not reported
Date Tested:	Not reported		
Date Closed:	Not reported		
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

U003079700

Facility ID:	9-427683	CBS Number:	9-000115
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-3800	Location:	Not reported
Operator:	NIAGARA MOHAWK POWER CORP		
Contact:	Not reported		
Emergency Contact:	MICHAEL BOESL, (716) 879-3876		
Facility Type:	UTILITY		
Total Tanks:	8	Old PBS Num:	Not reported
Owner:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST ENVIRONMENTAL AFFAIRS, A-2 NY 13202 (315) 474-1511 ATTN: JOSEPH MIAKISZ		
Facility Status:	Active	Total Capacity:	1000
Certification:	02/05/1997	Expiration:	12/14/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	JJ1	Install Date:	01/56
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	OTHER		
Leak Detection:	NONE	Dispenser:	Suction
Overfill Prot:	Product Level Gauge	Next Test Date:	Not reported
Date Tested:	Not reported	Test Method:	Not reported
Date Closed:	00/00		
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C R HUNTLEY STEAM STATION (Continued)

U003079700

Facility ID:	9-427683	CBS Number:	9-000115
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-3800	Location:	Not reported
Operator:	NIAGARA MOHAWK POWER CORP		
Contact:	Not reported		
Emergency Contact:	MICHAEL BOESL, (716) 879-3876		
Facility Type:	UTILITY		
Total Tanks:	8	Old PBS Num:	Not reported
Owner:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST ENVIRONMENTAL AFFAIRS, A-2 NY 13202 (315) 474-1511 ATTN: JOSEPH MIAKISZ		
Facility Status:	Active	Total Capacity:	250
Certification:	02/05/1997	Expiration:	12/14/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	00/00
Product Stored:	LEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	Not reported
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

**A5
Target
Property**

**NIAGARA MOHAWK MANHOLE
3500 RIVER RD
TONAWANDA, NY**

NY Spills

**S102174614
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NIAGARA MOHAWK MANHOLE (Continued)

S102174614

SPILLS:

Facility ID:	9203018	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	JIM MURPHY	Caller Agency:	NEW YORK TELEPHONE
Caller Phone:	(716) 696-3422	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Unknown Responsible Party. Corrective action taken. (ISR)		
Spill Closed Dt:	07/22/1992		
Spill Cause:	Unknown	Resource Affected:	Groundwater
Water Affected:	Not reported	Spill Source:	Unknown
Spill Notifier:	Affected Persons	PBS Number:	Not reported
Spill Date:	06/10/1992 13:00	Reported to Dept:	06/11/1992 15:20
Cleanup Ceased:	07/22/1992		
Last Inspection:	06/12/1992		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/09/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/15/1992		
Remark:	NY TEL CREW FOUND WHITE CRYSTALLINE SUBSTANCE IN MANHOLE THAT CORRODED THEIR FIBER OPTIC CABLES.		

A4
Target
Property

C.R.HUNTLY GENERATING STA
3500 RIVER RD
TONAWANDA, NY

NY Spills

S102180466
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

C.R.HUNTLY GENERATING STA (Continued)

S102180466

SPILLS:

Facility ID:	9508373	Region of Spill:	9
Facility Contact:	MICHAEL BOSEL	Facility Tele:	(716) 879-3876
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MICHAEL BOSEL	Caller Agency:	NIAGARA MOHAWK POWER CORP
Caller Phone:	(716) 879-3876	Caller Extension:	Not reported
Notifier Name:	MICHAEL BOSEL	Notifier Agency:	NIAGARA MOHAWK POWER CORP
Notifier Phone:	(716) 879-3876	Notifier Extension:	Not reported
Spiller Contact:	MICHAEL BOSEL	Spiller Phone:	(716) 879-3876
Spiller:	NIAGARA MOHAWK - HUNTLEY		
Address:	3500 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/28/1995		
Spill Cause:	Equipment Failure	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/09/1995 09:00	Reported to Dept:	10/09/1995 11:24
Cleanup Ceased:	11/28/1995		
Last Inspection:	10/10/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/05/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/09/1995		
Remark:	LEAK IN LINE		

**B9
SE
< 1/8
Higher**

**POLYMER APPLICATIONS
3445 RIVER RD
TONAWANDA, NY 14150**

**CERCLIS 1000441716
RCRIS-SQG NYD045170701
FINDS
SHWS
LUST
NY Spills**

CERCLIS Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS Assessment History:

Assessment:	DISCOVERY	Completed:	04/01/81
Assessment:	PRELIMINARY ASSESSMENT	Completed:	12/30/87
Assessment:	SCREENING SITE INSPECTION	Completed:	08/14/91
Assessment:	REMOVAL ACTION	Completed:	05/23/95
Assessment:	REMOVAL ACTION	Completed:	12/18/96
Assessment:	REMOVAL INVESTIGATION	Completed:	07/22/94
Assessment:	ADMINISTRATIVE RECORD	Completed:	Not reported

CERCLIS Site Status:

EPA has conducted a preliminary assessment on this site and has determined that no further action is necessary and no hazard was identified

NRG019251

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

1000441716

RCRIS:

Owner: Not reported
 Contact: Not reported
 Record Date: 12/31/79
 Classification: Not reported
 Used Oil Recyc: No
 Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility has an active water discharge permit (under PCS)
 - Civil judicial and administrative enforcement case against facility (under DOCKET)

SHWS:

Facility ID:	915044	EPA ID:	NYD045170701
Owner:	Polymer Applications 3445 River Rd. Tonawanda, NY 14207		
Owner Telephone:	Not reported		
Operator:	Polymer Applications 3445 River Rd. Tonawanda, NY 14207		
Contact:	Not reported	Telephone	Not reported
Site Classification:	Significant threat to the public health or environment - action required.		
Region:	9		
Site Type:	Dump		
Acres:	6.7	User:	Polymer Applications
HW Started:	Unknown	HW Ended:	Present
HW Disposed:	Phenol, Xylene, Solvent mixture including xylene, toluene, MIBK, Isobutylene, Aroclor 1260 (PCBs)		
Units:	3000 lbs., 7900 gallons, 1500 gallons, unknown, unknown		
Air Data:	Available	Surf. Water Data:	Unavailable
Gmd. Water Data:	Available	Soil Data:	Available
Sediment Data:	Available		
Ground Water Standards Contravention:	Yes		
Drinking Water Standards Contravention:	No		
Surface Water Standards Contravention:	No		
Air Standards Contravention:	No		
Enforcement Status:	Negotiation In Progress	Legal Action:	No
State Action:	Yes	Fed Action:	No
Remedial Action:	In Progress		
Remed action type:	Removal of solvents, drums, groundwater invest.		
Soil Type:	Fill overlying dense silty clay, reddish		
Gmd Water Depth:	Approximately 4 feet		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

1000441716

Assessment of Environmental Problems:

Soils and groundwater are contaminated with phenols and other organics. Highest levels of contamination are found onsite in soils from 0 to 4 feet in depth and in shallow onsite groundwater.

Assessment of Health Problems:

The site is located in an industrialized area and fenced. Potential routes of exposure include inhalation of contaminated dust and vapors, and direct contact with phenol laden soil and contaminated surface water. The area is supplied with public water. No known private wells exist in the immediate area. Private industrial wells are prevalent in the area, but the water is not used for drinking.

LUST:

Facility ID:	8802943	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	DISPATCHER KERR	Caller Agency:	TONAWANDA FIRE DISPATCH
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 875-0775
Spiller:	POLYMER APPLICATIONS INC		
Address:	3445 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	10/24/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	07/03/1988 23:01
Spill Notifier:	Fire Department		
Spill Date:	07/03/1988 21:26		
Cleanup Ceased:	10/24/1988		
Last Inspection:	07/05/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/14/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/11/1988		
Remark:	FIRE AT POLYMER CAUSED MASSIVE AIR, SOIL AND WATER RELEASES DUE TO FIRE FIGHTING OPERATION		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

1000441716

SPILLS:

Facility ID:	8703104	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 875-0775
Spiller:	POLYMER APPLICATIONS		
Address:	3445 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	09/01/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	07/17/1987 12:05
Spill Notifier:	Responsible Party		
Spill Date:	07/17/1987 09:30		
Cleanup Ceased:	09/01/1987		
Last Inspection:	07/17/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/01/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/20/1987		
Remark:	Not reported		

NRG019254

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

1000441716

Facility ID:	8705724	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 875-0775
Spiller:	POLYMER APPLICATIONS CO.		
Address:	3445 RIVER ROAD		
	TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/19/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	01/07/1987 14:24
Spill Notifier:	Responsible Party		
Spill Date:	10/07/1987 13:40		
Cleanup Ceased:	11/19/1987		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/24/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/08/1987		
Remark:	Not reported		

NRG019255

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

1000441716

Facility ID:	8802863	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	MARGARET CHONG	Caller Agency:	USEPA
Caller Phone:	(201) 906-6904	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 875-0775
Spiller:	POLYMER APPLICATIONS		
Address:	3445 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	07/12/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	06/30/1988 08:38
Spill Notifier:	Federal Government		
Spill Date:	06/29/1988 21:30		
Cleanup Ceased:	07/12/1988		
Last Inspection:	06/30/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/13/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/05/1988		
Remark:	SPILL CONTAINED BY CONCRETE DIKE AND PAD		

NRG019256

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

1000441716

Facility ID:	9401786	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	BETH TORPUI	Caller Agency:	USEPA
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NIAGARA MOHAWK		
Address:	Not reported		
	Not reported		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	04/29/1994		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Federal Government	PBS Number:	Not reported
Spill Date:	04/01/1994 12:00	Reported to Dept:	04/29/1994 10:30
Cleanup Ceased:	04/29/1994		
Last Inspection:	04/29/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/19/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/09/1994		
Remark:	STRONG PETROLEUM ODOR. SEE 9401499		

B10
SE
< 1/8
Higher

POLYMER APPLICATIONS INC.
3445 RIVER RD
TONAWANDA, NY 14150

AST

A100086087
N/A

NRG019257

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

CBS AST:			
Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active		
Tank ID:	27	Total AST's:	14
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	11/88	Capacity (Gal):	10000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	OTHER		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1330207	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019258

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	29		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	60000
Install Date:	07/83	Product Stored:	Not reported
Tank Type:	Steel/carbon steel		
Extrnl Protection:	Not reported		
Intnl Protection:	Not reported		
Tank Containment:	OTHER	Pipe Location:	Not reported
Pipe Type:	STEEL/IRON		
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1330207	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019259

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active		
Tank ID:	30	Total AST's:	14
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	07/83	Capacity (Gal):	60000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	OTHER		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	108952	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporata/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019260

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active		
Tank ID:	31	Total AST's:	14
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	12/84	Capacity (Gal):	25000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	OTHER		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1330207	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019261

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	32		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	25000
Install Date:	12/84	Product Stored:	Not reported
Tank Type:	Steel/carbon steel		
Extrnl Protection:	Not reported	Pipe Location:	Not reported
Intrnl Protection:	Not reported		
Tank Containment:	OTHER	Haz Percent:	0
Pipe Type:	STEEL/IRON		
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported		
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE	PBS Number:	Not reported
Case Number:	1330207	SWIS Code:	1416
MOSF Number:	Not reported	ICS Number:	9-167082
SPDES Number:	Not reported	Facility Town:	TONAWANDA (C)
Operator:	RON VANYO	Emrgncy Phone:	(716) 759-6551
Emrgncy Contact:	KEVAN M. GREEN	Expiration Date:	07/19/91
Certified Date:	07/19/89	Facility Type:	Not reported
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019262

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active		
Tank ID:	33	Total AST's:	14
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND:		
Install Date:	12/84	Capacity (Gal):	25000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	OTHER		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	108952	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019263

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	34		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	25000
Install Date:	12/84	Product Stored:	Not reported
Tank Type:	Steel/carbon steel		
Extrnl Protection:	Not reported	Pipe Location:	Not reported
Intrnl Protection:	Not reported		
Tank Containment:	OTHER	Haz Percent:	0
Pipe Type:	STEEL/IRON		
Pipe Internal:	Not reported	PBS Number:	Not reported
Pipe External:	Not reported	SWIS Code:	1416
Pipe Containment:	Not reported	ICS Number:	9-167082
Leak Detection:	Not reported	Facility Town:	TONAWANDA (C)
Overfill Protection:	Not reported	Emrgncy Phone:	(716) 759-6551
Chemical:	Not reported	Expiration Date:	07/19/91
Tank Closed:	Not reported	Facility Type:	Not reported
Region:	STATE		
Case Number:	108952		
MOSF Number:	Not reported		
SPDES Number:	Not reported		
Operator:	RON VANYO		
Emrgncy Contact:	KEVAN M. GREEN		
Certified Date:	07/19/89		
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019264

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active		
Tank ID:	36	Total AST's:	14
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	12/84	Capacity (Gal):	25000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	OTHER		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overflow Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	108952	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019265

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	51		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	14000
Install Date:	08/85	Product Stored:	Not reported
Tank Type:	Stainless steel alloy		
Extrnl Protection:	Not reported	Pipe Location:	Not reported
Intnl Protection:	Not reported		
Tank Containment:	VAULT	Haz Percent:	0
Pipe Type:	FIBERGLASS [FRP]		
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported		
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported	PBS Number:	Not reported
Tank Closed:	Not reported	SWIS Code:	1416
Region:	STATE	ICS Number:	9-167082
Case Number:	108952	Facility Town:	TONAWANDA (C)
MOSF Number:	Not reported	Emrgncy Phone:	(716) 759-6551
SPDES Number:	Not reported	Expiration Date:	07/19/91
Operator:	RON VANYO	Facility Type:	Not reported
Emrgncy Contact:	KEVAN M. GREEN		
Certified Date:	07/19/89		
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019266

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active		
Tank ID:	52	Total AST's:	14
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	08/85	Capacity (Gal):	14000
Tank Type:	Stainless steel alloy	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	50000	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019267

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	42		
Tank Status:	Not reported	Capacity (Gal):	3400
Tank Location:	ABOVEGROUND	Product Stored:	Not reported
Install Date:	01/87		
Tank Type:	Stainless steel alloy	Pipe Location:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported	Haz Percent:	0
Tank Containment:	NONE		
Pipe Type:	NONE		
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported		
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	108952	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019268

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	50		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	08/85	Capacity (Gal):	14000
Tank Type:	Stainless steel alloy	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	108952	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	9-167082
Operator:	RON VANYO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	KEVAN M. GREEN	Emrgncy Phone:	(716) 759-6551
Certified Date:	07/19/89	Expiration Date:	07/19/91
Owner type:	Corporate/Commercial	Facility Type:	Not reported
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019269

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	53		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	10000
Install Date:	01/86	Product Stored:	Not reported
Tank Type:	Steel/carbon steel		
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT	Pipe Location:	Not reported
Pipe Type:	STEEL/IRON		
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE	PBS Number:	Not reported
Case Number:	108952	SWIS Code:	1416
MOSF Number:	Not reported	ICS Number:	9-167082
SPDES Number:	Not reported	Facility Town:	TONAWANDA (C)
Operator:	RON VANYO	Emrgncy Phone:	(716) 759-6551
Emrgncy Contact:	KEVAN M. GREEN	Expiration Date:	07/19/91
Certified Date:	07/19/89	Facility Type:	Not reported
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

NRG019270

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS INC. (Continued)

A100086087

Facility ID:	9-000226	Telephone:	(716) 875-0775
Owner:	POLYMER APPLICATIONS INC. 3445 RIVER RD. TONAWANDA, NY 14150 (716) 875-0775		
Facility Status:	Active	Total AST's:	14
Tank ID:	54		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	4200
Install Date:	01/87	Product Stored:	Not reported
Tank Type:	Steel/carbon steel		
Extrnl Protection:	Not reported	Pipe Location:	Not reported
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Haz Percent:	0
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported		
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported	PBS Number:	Not reported
Tank Closed:	Not reported	SWIS Code:	1416
Region:	STATE	ICS Number:	9-167082
Case Number:	1330207	Facility Town:	TONAWANDA (C)
MOSF Number:	Not reported	Emrgncy Phone:	(716) 759-6551
SPDES Number:	Not reported	Expiration Date:	07/19/91
Operator:	RON VANYO	Facility Type:	Not reported
Emrgncy Contact:	KEVAN M. GREEN		
Certified Date:	07/19/89		
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	POLYMER APPLICATIONS INC.		
Mail Contact:	KEVAN M. GREEN 3445 RIVER RD. TONAWANDA, NY 14150		
Mail Phone:	(716) 875-0775		

B11
SE
1/8-1/4
Higher

POLYMER APPLICATIONS
3435 RIVER RD
TONAWANDA, NY

NY Spills

S102175191
N/A

NRG019271

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

POLYMER APPLICATIONS (Continued)

S102175191

SPILLS:

Facility ID:	8601606	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	POLYMER APPLICATIONS		
Address:	3435 RIVER ROAD TONAWANDA, N. Y.		

Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	07/11/1986	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	06/06/1986 13:22
Spill Notifier:	Responsible Party		
Spill Date:	06/07/1986 12:00		
Cleanup Ceased:	07/11/1986		
Last Inspection:	06/09/1986		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/02/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/30/1986		
Remark:	FIRE AT POLYMER APPLICATIONS FACILITY		

C12
NNW
1/8-1/4
Higher

TOWN OF TONAWANDA WASTEWATER PUMP STATION
12 SAWYER AVE
TONAWANDA, NY 14150

AST

A100086216
N/A

NRG019272

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TOWN OF TONAWANDA WASTEWATER PUMP STATION (Continued)

A100086216

CBS AST:			
Facility ID:	9-000376	Telephone:	(716) 693-4900
Owner:	TOWN OF TONAWANDA 2919 DELAWARE AVENUE KENMORE, NY 14217 (716) 877-8800		
Facility Status:	Active	Total AST's:	1
Tank ID:	012		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	09/94	Capacity (Gal):	550
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	FIBERGLASS		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	VAULT	Haz Percent:	15
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	Not reported
Operator:	KENNETH F. MAVING	Facility Town:	TONAWANDA
Emrgncy Contact:	KENNETH F. MAVING	Emrgncy Phone:	(716) 693-4900
Certified Date:	03/27/96	Expiration Date:	03/27/98
Owner type:	Local Government	Facility Type:	Utility (i.e. Wastewater Treatment Plant)
Owner Sub Type:	Not reported		
Mail Name:	TOWN OF TONAWANDA WASTEWATER TREATMENT PLANT		
Mail Contact:	KENNETH F. MAVING 779 TWO MILE CREEK ROAD TONAWANDA, NY 14150		
Mail Phone:	(716) 693-4900		

**C13
NNW
1/8-1/4
Higher**

**FMC CORP
34 SAWYER AVE.
TONAWANDA, NY 14150**

**FINDS 1000108779
RCRIS-LQG NYD074033101
TRIS
CORRACTS
CERC-NFRAP
SHWS**

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS-NFRAP Assessment History:

Assessment:	DISCOVERY	Completed:	06/01/81
Assessment:	PRELIMINARY ASSESSMENT	Completed:	09/22/87

CORRACTS Data:

Prioritization:	Low
Status:	RCRA Facility Assessment Completed, Determination of Need for a RCRA Facility Investigation, Referred to a Non-RCRA Authority

NRG019273

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP (Continued)

1000108779

RCRIS:

Owner: FMC CORPORATION
(312) 861-6000

Contact: RICHARD R WISE
(716) 876-8300

Record Date: 03/29/84

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	24369.00	D002	3227210.00
D007	45913.00	D008	9157.00
D009	45453.00	D010	45453.00
D018	1922.00	D039	1922.00
LABP	2880.00		

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

NRG019274

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC (Continued)

S100669681

Investigator:	RMC	Spill Type:	Facility
Caller Name:	AL SCHROEDER	Caller Agency:	TOWN OF TONAWANDA
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release that creates a file or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/06/1993		
Spill Cause:	Other	Resource Affected:	In Sewer
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Police Department	PBS Number:	Not reported
Spill Date:	07/05/1993 17:42	Reported to Dept:	07/05/1993 19:04
Cleanup Ceased:	07/05/1993		
Last Inspection:	07/05/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/23/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/12/1993		
Remark:	CHEMICALS WERE DETERIORATING STARTED FIRE SODIUM PERSULFATE, POTASSIUM PERSULFATE AND AMMONIUM PERSULFATE WERE SPILLED. SEWERS RECEIVED RUNOFF.		

C15
NNW
1/8-1/4
Higher

FMC CORPORATION
35 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S101341681
N/A

LUST:

Facility ID:	9411242	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	RICH WISE	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	11/22/1994		
Spill Cause:	Other	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	11/22/1994 14:18	Reported to Dept:	11/22/1994 14:18
Cleanup Ceased:	11/22/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		

NRG019276

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S101341681

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 12/23/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/23/1994
 Remark: RECEIVED RESULTS FROM EVALUATION OF OLD WASTE SITE. PCB'S FOUND.

SPILLS:

Facility ID:	9604034	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	UST
Caller Name:	RICH WISE	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/15/1996		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	06/24/1996 16:00	Reported to Dept:	06/24/1996 16:15
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/17/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/24/1996		
Remark:	IN ORDER TO DO MAINTENANCE ON A TANK, 20 GALLONS OF HYDROGEN PEROXIDE WILL BE DILUTED AND DRUMMED TO THE TANK DIKE.		

NRG019277

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S101341681

Facility ID:	9611053	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	RICHARD WISE	Caller Agency:	FMC CORP_
Caller Phone:	(716) 879-0427	Caller Extension:	240
Notifier Name:	GERRY WEISS	Notifier Agency:	ENVIORNMENTAL TECH
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	RICHARD WISE	Spiller Phone:	(716) 879-0427
Spiller:	FMC CORP		
Address	35 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/10/1996		
Spill Cause:	Equipment Failure	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	12/07/1996 10:00	Reported to Dept:	12/07/1996 10:25
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/16/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/07/1996		
Remark:	caller was advised that the company went 24 lbs over the limit spdes permit - still investigating - problem has stopped they dont know what caused it		

NRG019278

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S101341681

Facility ID:	9514956	Region of Spill:	9
Facility Contact:	PAT KELLEY	Facility Tele:	(716) 879-0400 Ext. 240
Investigator:	RMC	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC CORP.
Caller Phone:	(716) 879-0400	Caller Extension:	Not reported
Notifier Name:	PAT KELLEY	Notifier Agency:	ENVIROMENTAL STEWART
Notifier Phone:	(716) 879-0400	Notifier Extension:	240
Spiller Contact:	PAT KELLEY	Spiller Phone:	(716) 879-0400 Ext. 240
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/26/1996		
Spill Cause:	Human Error	Resource Affected:	In Sewer
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	02/21/1996 18:00	Reported to Dept:	02/21/1996 20:48
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/28/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/21/1996		
Remark:	PRODUCT WAS BEING UNLOADED INTO A STORAGE TANK. SOMEONE APPEARS LEFT OPEN A VALVE. SOME OF THE PRODUCT WAS SPILLED IN THE NIAGRA RIVER. SPEEDY DRY USED TO CLEAN UP SAME. PAT KELLY CAN BE CALLED UNTIL 6AM. MR WEIS CAN BE CALLED IN AM IF NEEDED 716-879-0405.		

**C16
North
1/8-1/4
Higher**

**FMC CORP-BUFFALO PLANT
37 SAWYER AVE
TONAWANDA, NY 14150**

**TSCA
LUST
NY Spills**

**1000995530
N/A**

LUST:

Facility ID:	9506125	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	UST
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 878-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	RICHARD WISE	Spiller Phone:	(716) 878-8300
Spiller:	FMC		
Address:	37 SAWYER AVENUE TONAWANDA		
Spill Class:	Known release that creates a file or hazard. DEC Response. Unknown Responsible Party. Corrective action taken. (ISR)		
Spill Closed Dt:	02/21/1996		
Spill Cause:	Other	Resource Affected:	On Land
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	08/18/1995 03:00	Reported to Dept:	08/18/1995 03:40

NRG019279

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Cleanup Ceased: 02/21/1996
 Last Inspection: 09/25/1995
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 06/21/1996
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 08/20/1995
 Remark: CHEMICAL WAREHOUSE HAD AN EXPLOSION WITH FIRE

Facility ID:	9013072	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC		
Address	37 SAWYER ROAD TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	03/25/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	03/23/1991 03:34
Spill Notifier:	Responsible Party		
Spill Date:	03/22/1991 23:00		

Cleanup Ceased: 03/25/1991
 Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 04/16/1991
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 03/26/1991
 Remark: DRUMS FILLED WITH AMMONIA SULFATE DECOMPOSED AND LEAKED - STARTED FIRE. WATER ON THE FIRE CREATED SULFURIC ACID. RAN TO SPDES OUTFALL.

NRG019280

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

SPILLS:

Facility ID:	9608272	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	BRUCE WARNER	Caller Agency:	FMC
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	BRUCE WARNER	Spiller Phone:	(716) 876-8300
Spiller:	FMC		
Address:	37 SAWYER AVENUE TOAWANDA, NY 14150		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 10/04/1996

Spill Cause: Equipment Failure

Resource Affected: In Sewer

Water Affected: Not reported

Spill Source: Other Commercial/Industrial

Spill Notifier: Responsible Party

PBS Number: Not reported

Spill Date: 10/03/1996 02:50

Reported to Dept: 10/03/1996 04:56

Cleanup Ceased: Not reported

Last Inspection: Not reported

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 10/09/1996

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 10/03/1996

Remark: ph electrodes in sewer system indicated an elevated ph investigation is underway

NRG019281

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9004065	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC		
Address	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported		
Spill Closed Dt:	07/12/1990		
Spill Cause:	Human Error	Resource Affected:	In Sewer
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/12/1990 10:15	Reported to Dept:	07/12/1990 12:43
Cleanup Ceased:	07/12/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/04/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/13/1990		
Remark:	PUNCTURED DRUMED FLUSHED TO SEWERS TO OUTFALL		

NRG019282

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9113036	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC		
Address	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	03/27/1992	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	03/25/1992 11:35
Spill Notifier:	Responsible Party		
Spill Date:	03/25/1992 10:00		
Cleanup Ceased:	03/27/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/31/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	03/27/1992		
Remark:	SPDES OUTFALL 001, TANK OVERFILLED, RECOVERY NOT POSSIBLE, REFERRED TO SPDES DOW 3/25/92.		

NRG019283

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9304315	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	MARIA HANBY	Caller Agency:	NYSDEC
Caller Phone:	(518) 279-3753	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC CORPORATION		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/08/1993		
Spill Cause:	Equipment Failure	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/06/1993 17:30	Reported to Dept:	07/06/1993 21:47
Cleanup Ceased:	07/08/1993		
Last Inspection:	07/07/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/16/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/12/1993		
Remark:	A LEAKING VALVE CAUSED THE SPILL		

NRG019284

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9402345	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC		
Address:	PO BOX 845 BUFFALO, NY 14240		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/17/1994		
Spill Cause:	Human Error	Resource Affected:	In Sewer
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	05/17/1994 12:15	Reported to Dept:	05/17/1994 13:39
Cleanup Ceased:	05/17/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/27/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/18/1994		
Remark:	VALVE LEFT OPEN ON SYSTEM MATERIAL DRAINED TO FLOOR DRAIN		

NRG019285

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9504238	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	BRUCE WARNER	Caller Agency:	FMC
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC CORPORATION		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/10/1995		
Spill Cause:	Unknown	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/08/1995 11:00	Reported to Dept:	07/08/1995 22:23
Cleanup Ceased:	07/10/1995		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/25/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/10/1995		
Remark:	AMMONIA LEAK FROM FMC, CAUSE UNKNOWN		

C17
North
1/8-1/4
Higher

FMC CORP.
37 SAWYER AVENUE
TONAWANDA, NY 14150

AST

A100085929
N/A

NRG019286

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

CBS AST:			
Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T01	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	10/46	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019287

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T02	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	08/50	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019288

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T03	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	10/46	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019289

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T04		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	25000
Install Date:	08/50	Product Stored:	LEADED GASOLINE
Tank Type:	Other		
Extrnl Protection:	NONE		
Intnl Protection:	NONE		
Tank Containment:	VAULT	Pipe Location:	Aboveground
Pipe Type:	OTHER		
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019290

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T05		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	09/55	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019291

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T06		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	09/55	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019292

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T07	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	11/56	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019293

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T08		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	06/57	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019294

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T09	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	06/57	Capacity (Gal):	25000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	High Level Alarm/Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019295

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T10	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	08/50	Capacity (Gal):	1000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019296

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T11	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/56	Capacity (Gal):	5000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	70
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7722841	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019297

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T12		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	10/46	Capacity (Gal):	8000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	100
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	64197	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019298

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T13	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	10/46	Capacity (Gal):	8000
Tank Type:	Other	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	100
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	64197	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019299

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T14	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	06/53	Capacity (Gal):	1000
Tank Type:	Stainless steel alloy	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	100
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	64197	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019300

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T17		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	30000
Install Date:	10/85	Product Stored:	LEADED GASOLINE
Tank Type:	Stainless steel alloy		
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT	Pipe Location:	Aboveground
Pipe Type:	FIBERGLASS [FRP]		
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	45
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310583	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T18	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	06/60	Capacity (Gal):	30000
Tank Type:	Stainless steel alloy	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	50
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T19		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	06/66	Capacity (Gal):	30000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT	Pipe Location:	Aboveground
Pipe Type:	OTHER		
Pipe Internal:	OTHER		
Pipe External:	NONE	Haz Percent:	93
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T20	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	11/81	Capacity (Gal):	30000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	93
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019304

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T21	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	09/88	Capacity (Gal):	20000
Tank Type:	Stainless steel alloy	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE	Haz Percent:	75
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664382	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019305

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active		
Tank ID:	T22	Total AST's:	21
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/56	Capacity (Gal):	14500
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664417	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

NRG019306

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

FMC CORP. (Continued)

A100085929

Facility ID:	9-000035	Telephone:	(716) 879-0405
Owner:	FMC CORP. 37 SAWYER AVENUE TONAWANDA, NY 14150 (716) 876-8300		
Facility Status:	Active	Total AST's:	21
Tank ID:	T23		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/81	Capacity (Gal):	25000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664417	PBS Number:	9-039322
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-000337	ICS Number:	9-167091
Operator:	RICHARD K. WISE	Facility Town:	TONAWANDA
Emrgncy Contact:	RICHARD K. WISE	Emrgncy Phone:	(716) 876-8300
Certified Date:	02/21/97	Expiration Date:	04/07/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	FMC CORP.		
Mail Contact:	RICHARD K. WISE 37 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 876-8300		

**C18
North
1/8-1/4
Higher**

**FMC CORPORATION
37 SAWYER AVE
TONAWANDA, NY 14150**

AST

**A100071559
N/A**

**C19
North
1/8-1/4
Higher**

**FMC CORPORATION
37 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102176626
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S102176626

SPILLS:

Facility ID:	8900301	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-0405
Spiller:	FMC CORPORATION		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	04/11/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	04/11/1989 09:50
Spill Notifier:	Responsible Party		
Spill Date:	04/11/1989 07:45		
Cleanup Ceased:	04/11/1989		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/11/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/11/1989		
Remark:	OUTFALL 001 DISCHARGE		

C20
North
1/8-1/4
Higher

**FMC CORPORATION
39 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102177810
N/A**

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

FMC CORPORATION (Continued)

S102177810

SPILLS:

Facility ID: 9301378 Facility Contact: Not reported Investigator: RMC Caller Name: BRUCE WARNER Caller Phone: (716) 876-8300 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: FMC CORPORATION Address: 39 SAWYER AVENUE TONAWANDA, NY	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: FMC CORPORATION Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported
--	---

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 04/29/1993 Spill Cause: Human Error Water Affected: NIAGARA RIVER Spill Notifier: Responsible Party Spill Date: 04/29/1993 08:15 Cleanup Ceased: 04/29/1993 Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 05/19/1993 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 05/04/1993	Resource Affected: In Sewer Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 04/29/1993 10:05
---	--

Remark: VALVE LEFT OPEN; WAS DISCOVERED AND CLOSED.

21
SE
1/8-1/4
Higher

NI-MO HUNTLEY STATION
3400 RIVER RD
TONAWANDA, NY

NY Spills

S102176349
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NI-MO HUNTLEY STATION (Continued)

S102176349

SPILLS:

Facility ID:	8804653	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	OFC. LINDSTROM	Caller Agency:	TOWN OF TONAWANDA PD
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-3800
Spiller:	NIAGARA MOHAWK		
Address:	3400 RIVER ROAD TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	08/26/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	08/26/1988 20:20
Spill Notifier:	Police Department		
Spill Date:	08/26/1988 20:17		
Cleanup Ceased:	08/26/1988		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/30/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/29/1988		
Remark:	BLACK SMOKE		

D22
North
1/8-1/4
Higher

GOETZ ENERGY CORPORATION
85-87 SAWYER AVE
TONAWANDA, NY 14150

UST

U001852299
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY CORPORATION (Continued)

U001852299

PBS UST:			
Facility ID:	9-429031	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-4324	Location:	Not reported
Operator:	GOETZ ENERGY CORPORATION		
Contact:	Not reported		
Emergency Contact:	ROBERT L SCHINTZIUS, (716) 876-4324		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	GOETZ ENERGY CORPORATION P.O. BOX A BUFFALO, NY 14217 (716) 876-4324		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	GOETZ ENERGY CORPORATION P.O. BOX A NY 14217 (716) 876-4324 ATTN: ROGER L SCHINTZIUS		
Facility Status:	Active	Total Capacity:	8000
Certification:	02/27/1997	Expiration:	02/13/1902
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	07/81
Product Stored:	KEROSENE	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	FIBERGLASS [FRP]
Tank External:	NONE/PAINTED/ASPHALT COATING		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	GROUNDWATER WELL/NONE		
Overfill Prot:	Float Vent Valve	Dispenser:	Submersible
Date Tested:	01/97	Next Test Date:	01/02
Date Closed:	Not reported	Test Method:	HORNER
Database Type:	Not reported		

NRG019311

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

GOETZ ENERGY CORPORATION (Continued)

U001852299

Facility ID:	9-429031	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-4324	Location:	Not reported
Operator:	GOETZ ENERGY CORPORATION		
Contact:	Not reported		
Emergency Contact:	ROBERT L SCHINTZIUS, (716) 876-4324		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	GOETZ ENERGY CORPORATION P.O. BOX A BUFFALO, NY 14217 (716) 876-4324		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	GOETZ ENERGY CORPORATION P.O. BOX A NY 14217 (716) 876-4324 ATTN: ROGER L SCHINTZIUS		
Facility Status:	Active	Total Capacity:	6000
Certification:	02/27/1997	Expiration:	02/13/1902
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	07/81
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	FIBERGLASS [FRP]
Tank External:	NONE/PAINTED/ASPHALT COATING		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/GROUNDWATER WELL		
Overfill Prot:	Float Vent Valve	Dispenser:	Submersible
Date Tested:	01/97	Next Test Date:	01/02
Date Closed:	Not reported	Test Method:	HORNER
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY CORPORATION (Continued)

U001852299

Facility ID:	9-429031	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-4324	Location:	Not reported
Operator:	GOETZ ENERGY CORPORATION		
Contact:	Not reported		
Emergency Contact:	ROBERT L SCHINTZIUS, (716) 876-4324		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	GOETZ ENERGY CORPORATION P.O. BOX A BUFFALO, NY 14217 (716) 876-4324	Owner Mark:	Second Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	GOETZ ENERGY CORPORATION P.O. BOX A NY 14217 (716) 876-4324 ATTN: ROGER L SCHINTZIUS		
Facility Status:	Active	Total Capacity:	10000
Certification:	02/27/1997	Expiration:	02/13/1902
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	3	Install Date:	07/81
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	FIBERGLASS [FRP]
Tank External:	NONE/PAINTED/ASPHALT COATING		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/GROUNDWATER WELL		
Overfill Prot:	Float Vent Valve	Dispenser:	Submersible
Date Tested:	01/97	Next Test Date:	01/02
Date Closed:	Not reported	Test Method:	HORNER
Database Type:	Not reported		

NRG019313

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY CORPORATION (Continued)

U001852299

Facility ID:	9-429031	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-4324	Location:	Not reported
Operator:	GOETZ ENERGY CORPORATION		
Contact:	Not reported		
Emergency Contact:	ROBERT L SCHINTZIUS, (716) 876-4324		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	GOETZ ENERGY CORPORATION P.O. BOX A BUFFALO, NY 14217 (716) 876-4324		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	GOETZ ENERGY CORPORATION P.O. BOX A NY 14217 (716) 876-4324 ATTN: ROGER L SCHINTZIUS		
Facility Status:	Active	Total Capacity:	12000
Certification:	02/27/1997	Expiration:	02/13/1902
Tank Status:	Temporarily Out Of Service		
Tank Location:	UNDERGROUND		
Tank ID:	4	Install Date:	07/81
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	FIBERGLASS [FRP]
Tank External:	NONE/PAINTED/ASPHALT COATING		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/GROUNDWATER WELL		
Overfill Prot:	Float Vent Valve	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Database Type:	Not reported		

D23
NNE
1/8-1/4
Higher

GOETZ ENERGY
85 SAWYER AVE
TONAWANDA, NY

NY Spills

S102174353
N/A

NRG019314

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY (Continued)

S102174353

SPILLS:

Facility ID:	9110841	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	LEE MCELHINNEY	Caller Agency:	TONAWANDA DISPATCH
Caller Phone:	(716) 876-1212	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-4324
Spiller:	GOETZ ENERGY		
Address:	PO BOX A BUFFALO, NY 14217		
Spill Class:	Known release that creates a file or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/02/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Tank Truck
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	01/18/1992 03:50
Spill Date:	01/18/1992 01:10		
Cleanup Ceased:	09/02/1993		
Last Inspection:	08/18/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/16/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/12/1992		
Remark:	TANKER TRUCK USED FOR STORAGE TIPPED OVER		

D24
NNE
1/8-1/4
Higher

GOETZ ENERGY CORP
87 SAWYER AVE
TONAWANDA, NY 14050

RCRIS-SQG 1000872511
NYD987037256

RCRIS:

Owner: GOETZ ENERGY CORP
(716) 876-4324

Contact: ROGER SCHINTZIUS
(716) 876-4324

Record Date: 07/06/93

Classification: Small Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

Waste	Quantity (Lbs)	Waste	Quantity (Lbs)
D001	50234.36	D008	50234.36
F002	50234.36		

NRG019315

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY CORP (Continued)

1000872511

Used Oil Recyc: No

Violation Status: No violations found

**D25
NNE
1/8-1/4
Higher**

**GOETZ ENERGY CORP
87 SAWYER AVE
TONAWANDA, NY 14050**

**FINDS
LUST**

**1000845347
NYD987037256**

LUST:

Facility ID:	9103953	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	JOHN KUDLA	Caller Agency:	ELMWOOD TANK & PIPING
Caller Phone:	(716) 694-0106	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-4324
Spiller:	GOETZ ENERGY		
Address:	PO BOX A 87 SAWYER AVENUE BUFFALO, NY 14217		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/07/1993	Resource Affected:	Groundwater
Spill Cause:	Tank Test Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Tank Tester	Reported to Dept:	07/12/1991 15:20
Spill Date:	07/16/1991 12:30		
Cleanup Ceased:	09/07/1993		
Last Inspection:	07/18/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	09/16/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/16/1991		
Remark:	FAILED TANK AT GOETZ ENERGY		

**D26
NNE
1/8-1/4
Higher**

**NIAGARA MOHAWK
87 SAWYER AVE
TONAWANDA, NY**

NY Spills

S102173992
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NIAGARA MOHAWK (Continued)

S102173992

SPILLS:

Facility ID:	9101906	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	JIM DONNAGAN	Caller Agency:	NIAGARA MOHAWK
Caller Phone:	(315) 428-3172	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(315) 428-3172
Spiller:	NIAGARA MOHAWK		
Address:	300 ERIE BOULEVARD WEST SYRACUSE, NY 13202		

Spill Class: Not reported
 Spill Closed Dt: 06/04/1991
 Spill Cause: Human Error
 Water Affected: Not reported
 Spill Notifier: Responsible Party
 Spill Date: 05/16/1991 15:40
 Cleanup Ceased: 06/04/1991
 Last Inspection: 05/17/1991

Resource Affected: On Land
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 05/16/1991 23:03

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 06/04/1991
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 05/17/1991
 Remark: TRUCK BACKED OVER CABLE CAUSING POLE AND TRANSFORMER TO FALL

D27
NNE
1/8-1/4
Higher

BROSKIN ENTERPRISES, INC.
87 SAWYER AVE
TONAWANDA, NY

NY Spills

S102175701
N/A

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

BROSKIN ENTERPRISES, INC. (Continued)

S102175701

SPILLS:

Facility ID: 8702321 Facility Contact: Not reported Investigator: JDC Caller Name: Not reported Caller Phone: Not reported Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: BROSKIN ENTERPRISES, INC. Address: 5335 RIVER ROAD TONAWANDA, NY 14150 Spill Class: Not reported Spill Closed Dt: 08/05/1987 Spill Cause: Housekeeping Water Affected: NIAGARA RIVER Spill Notifier: Affected Persons Spill Date: 06/22/1987 10:30 Cleanup Ceased: 08/05/1987 Last Inspection: 06/22/1987 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 08/07/1987 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 06/22/1987 Remark: BLACK OIL SPILLING TO NIAGARA RIVER FROM SEEP IN EMBANKMENT	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: Not reported Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 879-0405 Resource Affected: Surface Water Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 06/22/1987 12:05
--	---

**D28
NNE
1/8-1/4
Higher**

**CENTRAL FOUNDRY
91 SAWYER AVE
TONAWANDA, NY 14150**

FINDS

**1000551623
NYD986939734**

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

**D29
North
1/4-1/2
Higher**

**CHEMICAL/OIL ODOR
83 KAUFMAN AVE
TONAWANDA, NY**

NY Spills

**S102561469
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CHEMICAL/OIL ODOR (Continued)

S102561469

SPILLS:

Facility ID:	9700993	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	KATHY HARRIS	Caller Agency:	CITIZEN
Caller Phone:	(716) 877-5618	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.		
Spill Closed Dt:	04/24/1997		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Unknown
Spill Notifier:	Citizen	PBS Number:	Not reported
Spill Date:	04/23/1997 07:00	Reported to Dept:	04/23/1997 07:14
Cleanup Ceased:	Not reported		
Last Inspection:	04/23/1997		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/24/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/23/1997		
Remark:	CALLER REPORTS A STRONG PETRO ODOR IN AREA - VERY OVERPOWERING REQ SOMEONE TO CHECK AREA		

E30
NNE
1/4-1/2
Higher

LAUGHLIN
130 SAWYER AVE
TONAWANDA, NY

NY Spills

S102177076
N/A

NRG019319

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

LAUGHLIN (Continued)

S102177076

SPILLS:

Facility ID:	8910457	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	PAUL CASTRICONE	Caller Agency:	ANONYMOUS
Caller Phone:	(716) 894-5787	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-0214
Spiller:	DENNIS LAUGHLIN		
Address:	130 SAWYER AVENUE TONAWANDA, NY 14150		

Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	04/16/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Deliberate	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	02/01/1990 14:25
Spill Notifier:	Citizen		
Spill Date:	01/01/1990 12:00		
Cleanup Ceased:	04/16/1990		
Last Inspection:	03/07/1990		

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 05/08/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 02/02/1990

Remark: SLOPPY HOUSEKEEP ALLOWING OIL TO SPILL TO GROUND AND CONTAMINATE SEWER(STORM)

E31
 NNE
 1/4-1/2
 Higher

130 SAWYER AVE
 TONAWANDA, NY

NY Spills S102178909
 N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

(Continued)

S102178909

SPILLS:

Facility ID:	8501822	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	BRT	Spill Type:	UST
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	KNOWN, SEE FILE		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	10/30/1985	Spill Source:	Unknown
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	Not reported
Spill Notifier:	Other		
Spill Date:	08/28/1985		
Cleanup Ceased:	10/30/1985		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/09/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	Not reported		
Remark:	Not reported		

E32
NNE
1/4-1/2
Higher

KURK FUEL OIL CO
130 SAWYER AVE
TONAWANDA, NY 14150

RCRIS-SQG 1000266482
FINDS NYD980755193

RCRIS:

Owner: KURK FUEL OIL COMPANY
(212) 555-1212

Contact: GREG KURK
(716) 892-0359

Record Date: 04/19/83

Classification: Not reported

Used Oil Recyc: No

Violation Status: No violations found

F33
NW
1/4-1/2
Higher

TEXACO USA /A DIV OF TEXACO INC
RIVER RD & JAMES ST
TONAWANDA, NY 14150

RCRIS-SQG 1000144980
FINDS NYD085684264
CERC-NFRAP

NRG019321

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TEXACO USA /A DIV OF TEXACO INC (Continued)

1000144980

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	30 ACRES USED FOR GASOLINE, JET FUEL, & FUEL OIL STORAGE IN ABOVE GRND TNKS. TWO LARGE TNKS, 3 MILLNS GALL EACH, STILL ONSITE AS ARE SMLLR 20,000 TNKS. OIL/WATER SEPARATOR, BUILT FOR DRAINAGE OF LOADNG PLTFORM, STILL EXIST ONSITE & CONTNS OIL.		

CERCLIS-NFRAP Assessment History:

Assessment:	DISCOVERY	Completed:	06/01/81
Assessment:	PRELIMINARY ASSESSMENT	Completed:	04/25/86
Assessment:	SCREENING SITE INSPECTION	Completed:	09/18/86

CERCLIS-NFRAP Alias Name(s):

TEXACO INC TONAWANDA TERMINAL

RCRIS:

Owner: TEXACO-U.S.A.
(609) 667-3800

Contact: H E PHILLIPS
(609) 667-3800

Record Date: 08/18/80

Classification: Not reported

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility has an active water discharge permit (under PCS)

F34
NW
1/4-1/2
Higher

CARMEN M PARISO INC
3649 RIVER RD
TONAWANDA, NY 14150

RCRIS-SQG 1000297443
FINDS NYD057671729

RCRIS:

Owner: Not reported

Contact: TONY PARISO
(716) 875-6168

Record Date: 05/21/85

Classification: Hazardous Waste Transporter

Used Oil Recyc: No

Violation Status: No violations found

G35
NNW
1/4-1/2
Higher

NIAGARA MOHAWK
61 JAMES ST
TONAWANDA, NY

LUST S100155188
N/A

LUST:

Facility ID:	8710189	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	CAMPBELL	Caller Agency:	SOUTHERN TIER TANK TEST

NRG019322

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

NIAGARA MOHAWK (Continued)

S100155188

Caller Phone:	(716) 372-2171	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 831-7492
Spiller:	NIAGARA MOHAWK		
Address:	93 DEWEY STREET BUFFALO, NY 14214		
Spill Class:	Not reported	Resource Affected:	Groundwater
Spill Closed Dt:	12/14/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Test Failure	PBS Number:	9-427691
Water Affected:	Not reported	Reported to Dept:	03/04/1988 17:19
Spill Notifier:	Tank Tester		
Spill Date:	03/04/1988 15:30		
Cleanup Ceased:	12/14/1988		
Last Inspection:	09/02/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	11/06/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/07/1988		
Remark:	TANK TEST FAILURE, POSSIBLE AIR POCKET WILL RETEST.		

G36
NNW
1/4-1/2
Higher

61 JAMES ST
RIVER RD
TONAWANDA, NY 14150

UST

U001328639
N/A

NRG019323

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

61 JAMES ST (Continued)

U001328639

PBS UST:

Facility ID:	9-427691	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(315) 474-1511	Location:	Not reported
Operator:	NIAGARA MOHAWK POWER CORP		
Contact:	Not reported		
Emergency Contact:	WILLIAM J LYONS, (716) 831-7495		
Facility Type:	UTILITY		
Total Tanks:	1	Old PBS Num:	Not reported
Owner:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST SYRACUSE, NY 13202 (315) 474-1511	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	NIAGARA MOHAWK POWER CORP 300 ERIE BLVD WEST NY 13202 (315) 474-1511		
Facility Status:	Inactive	Total Capacity:	15000
Certification:	12/14/1987	Expiration:	12/14/1992
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	001	Install Date:	00/00
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	Not reported
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	03/88	Test Method:	Not reported
Database Type:	Not reported		

**H37
North
1/4-1/2
Higher**

**NOCO ENERGY PRODUCTS III
100 JAMES AVE
TONAWANDA, NY**

NY Spills

**S102178088
N/A**

NRG019324

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

NOCO ENERGY PRODUCTS III (Continued)

S102178088

SPILLS:

Facility ID: 9306748 Facility Contact: Not reported Investigator: MJS Caller Name: RICHARD COWAN Caller Phone: (518) 457-7363 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: NOCO ENERGY Address: 100 JAMES AVENUE TONAWANDA, NY 14051	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: NYSDEC Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported
---	--

Spill Class: Possible release with minimal potential for fire or hazard or Known release with *no damage*. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 02/06/1995 Spill Cause: Housekeeping Water Affected: Not reported Spill Notifier: DEC Spill Date: 08/10/1993 12:00 Cleanup Ceased: 02/06/1995 Last Inspection: 09/08/1993 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 04/20/1995 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 09/02/1993	Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 09/01/1993 11:00
---	---

Remark: 25' X 10' AREA AT LOADING RACK APPEARS CONTAMINATED.

H38
 North
 1/4-1/2
 Higher

NOCO ENERGY CORP
 100 JAMES AVE
 TONAWANDA, NY 14150

UST
 AST

U003079526
 N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

PBS UST:

Facility ID:	9-224413	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6201	Location:	Not reported
Operator:	CURTIS JEFFRIES		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6201		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP		

700 GRAND ISLAND BLVD P.O. BOX 86
TONAWANDA, NY 14150
(716) 874-6200

Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP		

700 GRAND ISLAND BLVD
P.O. BOX 86
NY 14150
(716) 874-6201
ATTN: GARY ROESCH

Facility Status:	Active	Total Capacity:	4000
Certification:	09/06/1995	Expiration:	08/17/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	301	Install Date:	01/56
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019326

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6201	Location:	Not reported
Operator:	CURTIS JEFFRIES		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6201		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 NY 14150 (716) 874-6201 ATTN: GARY ROESCH		
Facility Status:	Active	Total Capacity:	4000
Certification:	09/06/1995	Expiration:	08/17/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	302	Install Date:	01/56
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019327

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6201	Location:	Not reported
Operator:	CURTIS JEFFRIES		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6201		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 NY 14150 (716) 874-6201 ATTN: GARY ROESCH		
Facility Status:	Active	Total Capacity:	6000
Certification:	09/06/1995	Expiration:	08/17/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	303	Install Date:	01/56
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019328

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

PBS AST:

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	313	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	314	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019329

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	315	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		
Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	316	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019330

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	317	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND	Tank Type:	Steel/carbon steel
Product Stored:	LUBE OIL	Tank Internal:	NONE
Install Date:	06/91		
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	318	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND	Tank Type:	Steel/carbon steel
Product Stored:	LUBE OIL	Tank Internal:	NONE
Install Date:	06/91		
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019331

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	319	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	320	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019332

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	321	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	06/91	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	301	Capacity (Gal):	2300
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019333

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	302	Capacity (Gal):	2300
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	303	Capacity (Gal):	2300
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019334

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	304	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	305	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019335

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	306	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		
Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	307	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019336

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID: 9-224413 Telephone: (716) 874-6201
 Facility Status: Active Total Ast's: 37
 Owner: NOCO ENERGY CORP
 700 GRAND ISLAND BLVD P.O. BOX 86
 TONAWANDA, NY 14150
 (716) 874-6200

Tank ID: 308 Capacity (Gal): 5000
 Tank Status: In Service
 Tank Location: ABOVEGROUND
 Product Stored: LUBE OIL Tank Type: Steel/carbon steel
 Install Date: 12/90 Tank Internal: EPOXY LINER
 Tank External: NONE
 Tank Containment: CONCRETE DIKE
 Pipe Location: Aboveground Pipe Type: STEEL/IRON
 Pipe Internal: NONE
 Pipe External: NONE
 Leak Detection: CONCRETE PAD WITH CHANNELS
 Overfill Prot: Product Level Gauge Dispenser: Suction
 Date Tested: Not reported Next Test Date: N.T.R
 Date Closed: Not reported Test Method: Not reported
 Region: ST

Facility ID: 9-224413 Telephone: (716) 874-6201
 Facility Status: Active Total Ast's: 37
 Owner: NOCO ENERGY CORP
 700 GRAND ISLAND BLVD P.O. BOX 86
 TONAWANDA, NY 14150
 (716) 874-6200

Tank ID: 309 Capacity (Gal): 5000
 Tank Status: In Service
 Tank Location: ABOVEGROUND
 Product Stored: LUBE OIL Tank Type: Steel/carbon steel
 Install Date: 12/90 Tank Internal: EPOXY LINER
 Tank External: NONE
 Tank Containment: CONCRETE DIKE
 Pipe Location: Aboveground Pipe Type: STEEL/IRON
 Pipe Internal: NONE
 Pipe External: NONE
 Leak Detection: CONCRETE PAD WITH CHANNELS
 Overfill Prot: Product Level Gauge Dispenser: Suction
 Date Tested: Not reported Next Test Date: N.T.R
 Date Closed: Not reported Test Method: Not reported
 Region: ST

NRG019337

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	310	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	311	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019338

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	312	Capacity (Gal):	5000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	12/90	Tank Internal:	EPOXY LINER
Tank External:	NONE		
Tank Containment:	CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27341	Capacity (Gal):	5600
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019339

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27342	Capacity (Gal):	11600
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27343	Capacity (Gal):	11600
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019340

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27344	Capacity (Gal):	11600
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		
Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27345	Capacity (Gal):	11550
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019341

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27346	Capacity (Gal):	11592
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27347	Capacity (Gal):	11634
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019342

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27348	Capacity (Gal):	11634
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		
Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27349	Capacity (Gal):	11592
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27350	Capacity (Gal):	11634
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27351	Capacity (Gal):	11634
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019344

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27352	Capacity (Gal):	11634
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	27353	Capacity (Gal):	11676
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019345

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		

Tank ID:	27354	Capacity (Gal):	11676
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		

Tank ID:	27355	Capacity (Gal):	11634
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019346

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

U003079526

Facility ID:	9-224413	Telephone:	(716) 874-6201
Facility Status:	Active	Total Ast's:	37
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD P.O. BOX 86 TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	342	Capacity (Gal):	2000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	08/95	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

F39
NW
1/4-1/2
Higher

MID RIVER MARINA, INC.
3670 RIVER RD.
TONAWANDA, NY 14150

UST

U001328835
N/A

NRG019347

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MID RIVER MARINA, INC. (Continued)

U001328835

PBS UST:

Facility ID:	9-438316	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 875-7447	Location:	Not reported
Operator:	JAMES M. BOGNAR		
Contact:	Not reported		
Emergency Contact:	JAMES M. BOGNAR, (716) 775-0411		
Facility Type:	RETAIL GASOLINE SALES		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	MID RIVER MARINA, INC. 3670 RIVER RD. TONAWANDA, NY 14150 (716) 875-7447	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	MID RIVER MARINA, INC. 3670 RIVER RD. NY 14150 (716) 875-7447 Not Reported		
Facility Status:	Active	Total Capacity:	4000
Certification:	08/28/1995	Expiration:	06/28/1998
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	00/00
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Suction
Overfill Prot:	Not reported	Next Test Date:	Not reported
Date Tested:	05/88	Test Method:	AINLAY
Date Closed:	11/93		
Database Type:	Not reported		

NRG019348

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MID RIVER MARINA, INC. (Continued)

U001328835

Facility ID:	9-438316	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 875-7447	Location:	Not reported
Operator:	JAMES M. BOGNAR		
Contact:	Not reported		
Emergency Contact:	JAMES M. BOGNAR, (716) 775-0411		
Facility Type:	RETAIL GASOLINE SALES		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	MID RIVER MARINA, INC. 3670 RIVER RD. TONAWANDA, NY 14150 (716) 875-7447	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	MID RIVER MARINA, INC. 3670 RIVER RD. NY 14150 (716) 875-7447		
	Not Reported		
Facility Status:	Active	Total Capacity:	4000
Certification:	08/28/1995	Expiration:	06/28/1998
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	00/00
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Suction
Overfill Prot:	Not reported	Next Test Date:	Not reported
Date Tested:	05/88	Test Method:	AINLAY
Date Closed:	11/93		
Database Type:	Not reported		

NRG019349

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MID RIVER MARINA, INC. (Continued)

U001328835

Facility ID:	9-438316	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 875-7447	Location:	Not reported
Operator:	JAMES M. BOGNAR		
Contact:	Not reported		
Emergency Contact:	JAMES M. BOGNAR, (716) 775-0411		
Facility Type:	RETAIL GASOLINE SALES		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	MID RIVER MARINA, INC. 3670 RIVER RD. TONAWANDA, NY 14150 (716) 875-7447		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	MID RIVER MARINA, INC. 3670 RIVER RD. NY 14150 (716) 875-7447 Not Reported		
Facility Status:	Active	Total Capacity:	6000
Certification:	08/28/1995	Expiration:	06/28/1998
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	07/94
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	FIBERGLASS [FRP]
Tank External:	PAINTED/ASPHALT COATING/SACRIFICIAL ANODE		
Pipe External:	FIBERGLASS/NONE		
Second Containment:	DOUBLED-WALLED TANK/NONE		
Leak Detection:	INTERSTITIAL MONITORING/NONE		
Overfill Prot:	Catch Basin, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Database Type:	Not reported		

F40
NW
1/4-1/2
Higher

RIVER ROAD DITCH
3688 RIVER RD
TONAWANDA, NY

NY Spills

S102175139
N/A

NRG019350

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RIVER ROAD DITCH (Continued)

S102175139

SPILLS:

Facility ID:	8600786	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	05/02/1986	Resource Affected:	Surface Water
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	05/01/1986 09:15
Spill Date:	04/30/1986 12:00		
Cleanup Ceased:	05/02/1986		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/02/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/29/1986		
Remark:	OTHER SPILL LOCATION-@REFINERY AREA		

I41
SE
1/4-1/2
Higher

JEROME D. VAN DE WATER RAW WATER PUMP STATION
3300 RIVER RD
TONAWANDA, NY 14156

AST

A100086208
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

JEROME D. VAN DE WATER RAW WATER PUMP STATION (Continued)

A100086208

CBS AST:			
Facility ID:	9-000368	Telephone:	(716) 873-8884
Owner:	ERIE COUNTY WATER AUTHORITY 350 ELLICOTT SQUARE BLDG 295 MAIN ST BUFFALO, NY 14203 (716) 849-8484		
Facility Status:	Active		
Tank ID:	001	Total AST's:	1
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	07/80	Capacity (Gal):	850
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	OTHER		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	OTHER	Haz Percent:	100
Leak Detection:	INTERSTITIAL MONITORING		
Overfill Protection:	None		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7782505	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1416
SPDES Number:	Not reported	ICS Number:	Not reported
Operator:	JOHN J. MOGAVERO	Facility Town:	TONAWANDA (C)
Emrgncy Contact:	JAY MEYERS	Emrgncy Phone:	(716) 684-1510
Certified Date:	05/29/97	Expiration Date:	06/20/99
Owner type:	Local Government	Facility Type:	Utility (i.e. Wastewater Treatment Plant)
Owner Sub Type:	Not reported		
Mail Name:	ERIE COUNTY WATER AUTHORITY		
Mail Contact:	ROBERT MENDEZ 3030 UNION ROAD CHEEKTOWAGA, NY 14227		
Mail Phone:	(716) 684-1510		

142
SE
1/4-1/2
Higher

INDUSTRIAL WASTE SYSTEMS
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102174862
N/A

NRG019352

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDUSTRIAL WASTE SYSTEMS (Continued)

S102174862

SPILLS:

Facility ID:	9207861	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	INDUSTRIAL WASTE SYSTEMS		
Address:	Not reported		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/06/1992	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Affected Persons	Reported to Dept:	10/06/1992 13:45
Spill Date:	10/06/1992 12:30		
Cleanup Ceased:	10/06/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/13/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	10/08/1992		
Remark:	IWS TRUCK HYDRAULIC HOSE BREAK; SPEEDY-DRY USED.		

143
SE
1/4-1/2
Higher

DUNLOP TIRE CORP.
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102175461
N/A

NRG019353

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE CORP. (Continued)

S102175461

SPILLS:

Facility ID:	8606766	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 285-9101
Spiller:	SANTA ROSA TRUCKING		
Address:	2445 ALLEN AVE NIA.FALLS		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	03/06/1987	Spill Source:	Tank Truck
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	02/04/1987 12:15
Spill Notifier:	Responsible Party		
Spill Date:	02/04/1987 12:10		
Cleanup Ceased:	03/06/1987		
Last Inspection:	03/06/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/18/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/09/1987		
Remark:	FUEL TRANSFER		

144
SE
1/4-1/2
Higher

**NOCO ENERGY
10 SHERIDAN DR
TONAWANDA, NY**

NY Spills

**S102174985
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY (Continued)

S102174985

SPILLS:

Facility ID:	9210751	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ED HILL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8419	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-2977
Spiller:	NOCO ENERGY		
Address:	700 GRAND ISLAND BLVD TONAWANDA, NY 14150		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	01/08/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Tank Truck
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Affected Persons	Reported to Dept:	12/16/1992 17:26
Spill Date:	12/16/1992 16:45		
Cleanup Ceased:	01/08/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/22/1992		
Remark:	HOSE RUPTURED WHILE UNLOADING A TANK TRUCK. IN CONTAINED AREA, NOCO CLEANING UP.		

I45
SE
1/4-1/2
Higher

DUNLOP TIRE CORP
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102177335
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE CORP (Continued)

S102177335

SPILLS:

Facility ID: 9003692
 Facility Contact: Not reported
 Investigator: LQR
 Caller Name: BRAIN KELLY
 Caller Phone: (716) 879-8546
 Notifier Name: Not reported
 Notifier Phone: Not reported
 Spiller Contact: Not reported
 Spiller: DUNLOP TIRE
 Address: 10 SHERIDAN DRIVE
 TONAWANDA, NY

Region of Spill: 9
 Facility Tele: Not reported
 Spill Type: Facility
 Caller Agency: DUNLOP TIRE
 Caller Extension: Not reported
 Notifier Agency: Not reported
 Notifier Extension: Not reported
 Spiller Phone: Not reported

Spill Class: Not reported
 Spill Closed Dt: 07/02/1990
 Spill Cause: Equipment Failure
 Water Affected: Not reported
 Spill Notifier: Responsible Party
 Spill Date: 07/20/1990 14:00
 Cleanup Ceased: 07/02/1990

Resource Affected: On Land
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 07/02/1990 14:45

Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 12/04/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 07/10/1990
 Remark: EQUIPT. LINE BREAK

NRG019356

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE CORP (Continued)

S102177335

Facility ID:	9208595	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAN PYANOWSKI	Caller Agency:	DUNLOP TIRE CORP
Caller Phone:	(716) 879-8274	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE CORP		
Address:	PO BOX 1109 BUFFALO, NY 14240		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/04/1993		
Spill Cause:	Abandoned Drums	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/23/1992 14:30	Reported to Dept:	10/23/1992 16:00
Cleanup Ceased:	02/04/1993		
Last Inspection:	10/27/1992		
Cleanup Meets Standard:	True		
Recon.mended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/08/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/26/1992		
Remark:	DIGGING FOR SUBBASE FOR DRIVEWAY AND FOUND UNKNOWN DRUMS. DRUMS GASHED AND SPILLED LATEX RUBBER AND UNKNOWN CHEMICAL.		

146
SE
1/4-1/2
Higher

**DUNLOP
10 SHERIDAN DR
TONAWANDA, NY**

**LUST
NY Spills**

**S100492914
N/A**

LUST:

Facility ID:	9102556	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MARK OCWIEJA	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8299	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8200
Spiller:	DUNLOP		
Address:	BOX 1109 BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/21/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Overfill	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	06/04/1991 11:05
Spill Notifier:	Responsible Party		
Spill Date:	06/04/1991 10:05		
Cleanup Ceased:	11/21/1991		
Last Inspection:	06/04/1991		
Cleanup Meets Standard:	True		

NRG019357

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 12/05/1991
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 06/20/1991
 Remark: TANK WAS OVERFILLED DUE TO METER MALFUNCTION. SPILL CONTAINED IN CONCRETE DIKE. EPS CONTACTED TO CLEANUP.

Facility ID:	8607561	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8303
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE BUFFALO, N. Y. 14150		

Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	03/13/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	PLANT SYSTEM	Reported to Dept:	03/11/1987 13:10
Spill Notifier:	Responsible Party		
Spill Date:	03/11/1987 14:35		
Cleanup Ceased:	03/13/1987		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/13/1987		
Remark:	SPILL CAUSED BY FIRE		

Facility ID:	9401501	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NONE		
Address:	Not reported		
	Not reported		

Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	05/02/1994	Resource Affected:	Surface Water
Spill Cause:	Other	Spill Source:	Other Commercial/Industrial
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Responsible Party		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Spill Date: 04/29/1994 11:20 Reported to Dept: 04/29/1994 12:30
 Cleanup Ceased: 05/02/1994
 Last Inspection: 05/02/1994
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 05/19/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 05/03/1994
 Remark: PETROLEUM SHEEN ON TREATMENT PONDS, WAS SCUM

SPILLS:

Facility ID: 8901623	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: CAF	Spill Type: Facility
Caller Name: EDWARD WOJNOWSKI	Caller Agency: DUNLOP
Caller Phone: (716) 879-8200	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: Not reported
Spiller: DUNLOP	
Address: 10 SHERIDAN DRIVE TONAWANDA, NY	
Spill Class: Not reported	
Spill Closed Dt: 09/15/1989	Resource Affected: On Land
Spill Cause: Human Error	Spill Source: Other Commercial/Industrial
Water Affected: Not reported	PBS Number: Not reported
Spill Notifier: Responsible Party	Reported to Dept: 05/17/1989 11:15
Spill Date: 05/17/1989 07:00	
Cleanup Ceased: 09/15/1989	
Last Inspection: 05/17/1989	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 09/18/1989	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 08/09/1989	
Remark: DRUM PUNCTURED BY FORKLIFT,OIL ONTO FLOOR,DUNLOP CLEANING UP,WILL SAMPLE FOR PCB,S.	

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	8904385	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	BRIAN KELLY	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8546
Spiller:	DUNLOP		
Address:	10 SHERIDAN DRIVE BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	08/03/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	9-067202
Water Affected:	LAGOON	Reported to Dept:	08/02/1989 13:00
Spill Notifier:	Responsible Party		
Spill Date:	08/02/1989 12:30		
Cleanup Ceased:	08/03/1989		
Last Inspection:	08/03/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/08/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/02/1989		
Remark:	7 GALLONS RECOVERED & PUT IN HAZ WASTE DRUM. 3 GALLONS WENT INTO SEWER.		

NRG019360

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9101091	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	WILLIAM GRETSINGER	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8551	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8200
Spiller:	DUNLOP		
Address:	BOX 1109		
	BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/21/1991	Spill Source:	Unknown
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/26/1991 09:10
Spill Notifier:	Responsible Party		
Spill Date:	04/26/1991 06:00		
Cleanup Ceased:	11/21/1991		
Last Inspection:	06/04/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/05/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/20/1991		

Remark: SPILL NOTICED THIS MORNING - LOCATED BY LOADING DOCK. SOME MAY HAVE ENTERED A RECEIVER THAT GOES TO THEIR SETTLING POND. NONE HAS SHOWN UP IN POND.

NRG019361

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9107682	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAN PYANOWSKI	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8274	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8200
Spiller:	DUNLOP		
Address:	BOX 1109		
	BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/19/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	10/17/1991 15:10
Spill Notifier:	Responsible Party		
Spill Date:	10/17/1991 12:30		
Cleanup Ceased:	12/19/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/20/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/21/1991		
Remark:	BLDG 4 - DEPT 203. SPILLED IN TRENCH DRAIN FOR SPILL COLLECTION. CLEANED UP WITH SPEEDI DRI. DEBRIS PLACED IN DRUM. WILL BE DISPOSED OF VIA ROUTINE SPENT SOLVENT WASTE STREAM. DUNLOP TO SEND REPORT.		

NRG019362

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9109073	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	MARK OCWIEJA	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8299	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8200
Spiller:	DUNLOP		
Address:	BOX 1109		
	BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/25/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/25/1991 12:53
Spill Notifier:	Responsible Party		
Spill Date:	11/25/1991 10:00		
Cleanup Ceased:	11/25/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/13/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	11/26/1991		
Remark:	EMPLOYEE BLOCKED VALVE OPEN CAUSING TANK OVERFILL		

NRG019363

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9213907	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8200
Spiller:	DUNLOP TIRE CORP		
Address:	BOX 1109		
	BUFFALO, NY 14240		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/05/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	03/18/1993 11:00
Spill Date:	03/18/1993 09:30		
Cleanup Ceased:	04/05/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/14/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/19/1993		
Remark:	FILLING 150-GAL. CONTAINER WHEN RELEASE FAILED. DEPT. 203 USED ABSORBENT TO CLEAN UP, WHICH IS NOW IN 2-1/2 30-GAL. DRUMS. WILL BE DISPOSED IN REGULAR HAZ. WASTE PICK UP TO ENSCO OF ARKANSAS.		

NRG019364

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9308664	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8278	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8200
Spiller:	DUNLOP		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/22/1993		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/17/1993 05:00	Reported to Dept:	10/17/1993 05:25
Cleanup Ceased:	10/22/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/04/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/19/1993		
Remark:	TANK SEAL RUPTURED SPILLING WASTE OIL.		

NRG019365

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9409700	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8530	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8530
Spiller:	DUNLOP		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14240		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/27/1994	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/20/1994 08:30
Spill Date:	10/20/1994 08:00		
Cleanup Ceased:	10/27/1994		
Last Inspection:	10/25/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/14/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/25/1994		
Remark:	OPERATOR ERROR, OVERFILLED ONE TANK INTO ANOTHER, OVERFILLED THAT TANK TO DUMPSTER, OVERFILLED DUMPSTER ON SECOND FLOOR		

NRG019366

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (Continued)

S100492914

Facility ID:	9416334	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8536
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	03/23/1995	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	03/17/1995 11:00
Spill Date:	03/17/1995 10:15		
Cleanup Ceased:	03/23/1995		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/25/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/20/1995		
Remark:	EMPLOYEE DUMPED SOAP SOLUTION INTO WASTE WATER STREAM		

I47
SE
1/4-1/2
Higher

DUNLOP TIRE CORPORATION
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102174383
N/A

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	-------------	--------------------	--

DUNLOP TIRE CORPORATION (Continued)

S102174383

SPILLS:

Facility ID: 9111594 Facility Contact: Not reported Investigator: MJS Caller Name: ED HILL Caller Phone: (716) 879-8419 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: DUNLOP Address: PO BOX 1109 BUFFALO, NY 14240 Spill Class: Not reported Spill Closed Dt: 02/14/1992 Spill Cause: Equipment Failure Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 02/10/1992 12:45 Cleanup Ceased: 02/14/1992 Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: Not reported Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 02/14/1992	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: DUNLOP Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 879-8419 Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 02/10/1992 14:50
--	---

Remark: HOSE CONNECTION BROKE DURING OFF LOADING CONTAINED WITHIN CONCRETE PAD PIT.

148
SE
1/4-1/2
Higher

DUNLOP-THREAD CEMENT
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102176997
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP-THREAD CEMENT (Continued)

S102176997

SPILLS:

Facility ID:	8907776	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	ED WOJNOWSKI	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8303	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8303
Spiller:	DUNLOP		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/06/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/06/1989 11:20
Spill Notifier:	Responsible Party		
Spill Date:	11/06/1989 06:20		
Cleanup Ceased:	11/06/1989		
Last Inspection:	11/06/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/17/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	11/06/1989		
Remark:	MALFUNCTION OF A SENSOR CAUSED 65 GALLONS TO SPILL.		

149
SE
1/4-1/2
Higher

DUNLOP TIRE COMPANY
10 SHERIDAN DR
TONAWANDA, NY

LUST
NY Spills

S100117601
N/A

LUST:

Facility ID:	8910377	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	ED WOJNOWSKI	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8303	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8303
Spiller:	DUNLOP TIRE COMPANY		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14202		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	01/29/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	01/29/1990 11:30
Spill Notifier:	Responsible Party		
Spill Date:	01/25/1990 22:30		
Cleanup Ceased:	01/29/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		

NRG019369

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE COMPANY (Continued)

S100117601

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 03/08/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 02/07/1990
 Remark: TEXTILE CEMENT SPILLED ON CONCRETE FLOOR, CONTAINED & CLEANED UP W/
 SORBENTS & SPEEDY DRY, NOTHING ENTERED SEWERS, WASTE STORED IN HAZ-WASTE
 CONTAINERS FOR LATER DISPOSAL

SPILLS:

Facility ID:	8809283	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	ED WOJNOWSKI	Caller Agency:	DUNLOP TIRE COMPANY
Caller Phone:	(716) 879-8303	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8303
Spiller:	DUNLOP TIRE COMPANY		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	03/01/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	03/01/1989 11:50
Spill Notifier:	Responsible Party		
Spill Date:	03/01/1989 10:00		
Cleanup Ceased:	03/01/1989		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/30/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/01/1989		
Remark:	DRUM TIP OVER		

NRG019370

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE COMPANY (Continued)

S100117601

Facility ID:	8909356	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	WERNER BREHM	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8274	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8274
Spiller:	DUNLOP TIRE COMPANY		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/27/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	12/27/1989 10:45
Spill Notifier:	Responsible Party		
Spill Date:	12/27/1989 09:30		
Cleanup Ceased:	12/27/1989		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/16/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	01/02/1990		
Remark:	FORKLIFT STRUCK LAB WALL SPILLING 1 PINT OF MATERIAL ON FLOOR, EMPLOYEES EVACUATED FROM AREA.		

NRG019371

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE COMPANY (Continued)

S100117601

Facility ID:	8912144	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	BRAIN KELLY	Caller Agency:	DUNLOP TIRE
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	03/22/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	03/22/1990 09:20
Spill Notifier:	Responsible Party		
Spill Date:	03/22/1990 08:30		
Cleanup Ceased:	03/22/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/20/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/11/1990		
Remark:	SPILL TO SUMP PUMP		

NRG019372

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE COMPANY (Continued)

S100117601

Facility ID:	9004746	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	BRAIN KELLY	Caller Agency:	DUNLOP TIRE COMPANY
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8546
Spiller:	DUNLOP TIRE COMPANY		
Address:	PO BOX 1109 BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	07/27/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	07/27/1990 15:40
Spill Notifier:	Responsible Party		
Spill Date:	07/27/1990 14:30		
Cleanup Ceased:	07/27/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/13/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/31/1990		
Remark:	MINOR SPILL AT DUNLOP SEPARATOR SYSTEM		

NRG019373

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

DUNLOP TIRE COMPANY (Continued)

S100117601

Facility ID: 9008750
 Facility Contact: Not reported
 Investigator: MNP
 Caller Name: DAN PARSHALL
 Caller Phone: (716) 879-8275
 Notifier Name: Not reported
 Notifier Phone: Not reported
 Spiller Contact: Not reported
 Spiller: DUNLOP TIRE COMPANY
 Address: 10 SHERIDAN DRIVE
 TONAWANDA, NY

Region of Spill: 9
 Facility Tele: Not reported
 Spill Type: Facility
 Caller Agency: DUNLOP TIRE
 Caller Extension: Not reported
 Notifier Agency: Not reported
 Notifier Extension: Not reported
 Spiller Phone: Not reported

Spill Class: Not reported
 Spill Closed Dt: 11/08/1990
 Spill Cause: Unknown
 Water Affected: Not reported
 Spill Notifier: Responsible Party
 Spill Date: 11/08/1990 16:00
 Cleanup Ceased: 11/08/1990
 Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 11/21/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/20/1990
 Remark: LUBE OR GEAR OIL IN CHILLER PIT AT DUNLOP TIRE

Resource Affected: On Land
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 11/08/1990 13:38

NRG019374

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE COMPANY (Continued)

S100117601

Facility ID:	9011276	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	BRIAN KELLY	Caller Agency:	DUNLOP TIRE COMPANY
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ERGON COMPANY		
Address:	P.O. BOX 1639 PITTSBURGH, PA		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	01/24/1991	Spill Source:	Tank Truck
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	01/24/1991 13:45
Spill Notifier:	Affected Persons		
Spill Date:	01/24/1991 13:15		
Cleanup Ceased:	01/24/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/04/1991		
Remark:	HOSE BROKE ON TANK TRUCK DURING DELIVERY.		

150
SE
1/4-1/2
Higher

CONTRACTOR TRUCK
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102245126
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CONTRACTOR TRUCK (Continued)

S102245126

SPILLS:

Facility ID:	9514246	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	KAH	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 834-3500
Spiller:	KEVIN HAUSRATH CONTRACTOR		
Address:	Not reported		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/09/1996	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Affected Persons	Reported to Dept:	02/08/1996 10:20
Spill Date:	02/08/1996 10:00		
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/15/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/08/1996		
Remark:	contractor (Kevin Hausrath) had leaking hydrolic line on truck used for snow removal at Dunlop call faxed from region 9 on 02/08/96		

151
SE
1/4-1/2
Higher

DUNLOP TIRE 10 SHERIDAN
10 SHERIDAN DR
TONAWANDA, NY

NY Spills

S100782026
N/A

NRG019376

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE 10 SHERIDAN (Continued)

S100782026

SPILLS:

Facility ID:	9402885	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8536
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14240		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/27/1994	Resource Affected:	Surface Water
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	05/27/1994 10:45
Spill Date:	05/27/1994 09:05		
Cleanup Ceased:	05/27/1994		
Last Inspection:	05/27/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/16/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/31/1994		
Remark:	25 GALLONS WASTE OIL LET INTO TREATMENT POND DUE TO OVERFILLED OW SEPARATOR.		

152
SE
1/4-1/2
Higher

**DUNLOP (BOILER HOUSE)
10 SHERIDAN DR
TONAWANDA, NY**

NY Spills

**S102174285
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP (BOILER HOUSE) (Continued)

S102174285

SPILLS:

Facility ID:	9108849	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MARK OCWIEJA	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8299	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8299
Spiller:	DUNLOP		
Address:	BOX 1109 BUFFALO, NY 14240		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/06/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/19/1991 11:36
Spill Notifier:	Responsible Party		
Spill Date:	11/19/1991 09:30		
Cleanup Ceased:	12/06/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/06/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	11/19/1991		
Remark:	VALVE RUPTURED, OIL ON PAVEMENT, CLEAN-UP DONE		

**I53
SE
1/4-1/2
Higher**

**DUNLOP TIRE
10 SHERIDAN DR
TONAWANDA, NY**

**LUST
NY Spills**

**S100669122
N/A**

LUST:

Facility ID:	9309309	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	UST
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8278	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8278
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/19/1994	Resource Affected:	On Land
Spill Cause:	Tank Overfill	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/26/1993 14:20
Spill Date:	10/26/1993 14:00		
Cleanup Ceased:	11/19/1994		
Last Inspection:	10/26/1993		
Cleanup Meets Standard:	True		

NRG019378

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 11/25/1996
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/02/1993
 Remark: NAPTHA SPILL FROM TANK EXPANSION AFTER FILLING; SPILLED INTO DIKED AREA.

Facility ID:	8804602	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ED WOJNOWSKI	Caller Agency:	DUNLOP TIRE
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	09/21/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Overfill	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	08/25/1988 12:15
Spill Notifier:	Responsible Party		
Spill Date:	08/25/1988 07:30		
Cleanup Ceased:	09/21/1988		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/13/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/26/1988		
Remark:	TANK OVERFILL AT TANK FARM AREA		

Facility ID:	8804604	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ED WOJNOWSKI	Caller Agency:	DUNLOP TIRE
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	09/21/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Overfill	PBS Number:	Not reported
Water Affected:	Not reported		
Spill Notifier:	Responsible Party		

NRG019379

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Spill Date: 08/25/1988 07:30 Reported to Dept: 08/25/1988 12:15
 Cleanup Ceased: 09/21/1988
 Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 10/13/1988
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 08/25/1988
 Remark: WASTE OIL TANK OVERFILL

Facility ID:	9008790	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8271	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8271
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	11/13/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Overfill	PBS Number:	Not reported
Water Affected:	SETTLING POND	Reported to Dept:	11/10/1990 09:50
Spill Notifier:	Responsible Party		
Spill Date:	11/10/1990 07:40		
Cleanup Ceased:	11/13/1990		
Last Inspection:	11/12/1990		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/04/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/13/1990		
Remark:	SPILL AT DUNLOP TIRE TO SETTLING POND		

NRG019380

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

SPILLS:

Facility ID:	9608211	Region of Spill:	9
Facility Contact:	DAN PARSHALL	Facility Tele:	(716) 879-8278
Investigator:	JDC	Spill Type:	UST
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8279	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	PO BOX 1109 BUFFALO, NY 14240		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	04/14/1997	Resource Affected:	Surface Water
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	09/03/1909 10:30
Spill Date:	09/29/1996 12:00		
Cleanup Ceased:	10/01/1996		
Last Inspection:	10/01/1996		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/24/1997		

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 10/01/1996

Remark: crack in gear oil heat exchange allowed oil to mix with non-contact cooling water. water discharged to oil containment system and was collected.

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9610611	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	DAN PARSHALL	Spiller Phone:	(716) 879-8536
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/10/1996		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	11/22/1996 14:25	Reported to Dept:	11/22/1996 14:45
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/16/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/25/1996		
Remark:	LEAKING SEAL CAUSED SPILLAGE TO CONCRETE PAD. NOTED PROBLEM AND PLACED DRUM BENEATH SEAL TO CATCH SPILAGE. APPROX 30 GAL CAUGHT IN DRUM AND 4 GALS TO CONCRETE PAD - SPILL FAXED FROM REGION 9		

NRG019382

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9612889	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	MJS	Spill Type:	UST
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE CORPORATION
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	DAN PARSHALL	Spiller Phone:	(716) 879-8536
Spiller:	DUNLOP TIRE CORP		
Address:	POB 1109 BUFFALO, NY 14240		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/03/1997	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	01/30/1997 14:27
Spill Date:	01/30/1997 12:30		
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/10/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	01/30/1997		
Remark:	HYDRALIC LINE BROKE IN DEPT 224 BLDG 8 OIL WENT TO OIL/WATER SEPARATOR. CALL FAXED FROM REGION		

NRG019383

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9613549	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	MF	Spill Type:	UST
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE CORPORATION
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	DAN PARSHALL	Spiller Phone:	(716) 879-8536
Spiller:	DUNLOP TIRE CORP		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/21/1997		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	02/17/1997 22:00	Reported to Dept:	02/18/1997 14:45
Cleanup Ceased:	02/21/1997		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/26/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/18/1997		
Remark:	SPRINKLER LINE BROKE, LINE CONTAINED ETHYL GLYCOL & WATER - SPILL WAS ON DOCK (D) - NO DRAINS WERE AFFECTED - MATERIAL WAS VACUUMED UP AND SPEEDY DRY WAS APPLIED		

NRG019384

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID: 8704236
Facility Contact: Not reported
Investigator: MNP
Caller Name: Not reported
Caller Phone: Not reported
Notifier Name: Not reported
Notifier Phone: Not reported
Spiller Contact: Not reported
Spiller: DUNLOP TIRE
Address: 10 SHERIDAN DRIVE
TONAWANDA, NY

Region of Spill: 9
Facility Tele: Not reported
Spill Type: Facility
Caller Agency: Not reported
Caller Extension: Not reported
Notifier Agency: Not reported
Notifier Extension: Not reported
Spiller Phone: (716) 879-8546

Spill Class: Not reported
Spill Closed Dt: 08/26/1987
Spill Cause: Human Error
Water Affected: Not reported
Spill Notifier: Responsible Party
Spill Date: 08/21/1987 12:15
Cleanup Ceased: 08/26/1987
Last Inspection: Not reported
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 03/10/1993
Corrective Action Plan Submitted: Not reported
Date Spill Entered in Computer Data File: 08/24/1987
Remark: CONTAINER TIPPED OVER ACCIDENTALLY BY DELIVERY DRIVER

Resource Affected: On Land
Spill Source: Other Commercial/Industrial
PBS Number: Not reported
Reported to Dept: 08/21/1987 13:50

NRG019385

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	8706840	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH.	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8303
Spiller:	DUNLOP TIRE COMPANY		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	11/16/1987		
Spill Cause:	Human Error		
Water Affected:	Not reported		
Spill Notifier:	Responsible Party		
Spill Date:	11/12/1987 08:00		
Cleanup Ceased:	11/16/1987		
Last Inspection:	11/13/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/18/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/16/1987		
Remark:	PRODUCT SPILLED INSIDE BUILDING WHEN MATERIAL TRANSFERRED TO DRUM WITH HOLE IN IT		

NRG019386

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	8709941	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	BRIAN KELLEY	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8546
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	04/01/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	02/25/1988 12:58
Spill Notifier:	Responsible Party		
Spill Date:	02/25/1988 12:45		
Cleanup Ceased:	04/01/1988		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/21/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/26/1988		
Remark:	TANK OVERFILL INSIDE BLDG BY FLEET TRUCKING. MATERIAL FLASHES AT 300 F		

NRG019387

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	8804603	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ED WOJNOWSKI	Caller Agency:	DUNLOP TIRE
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	09/21/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	08/25/1988 12:15
Spill Notifier:	Responsible Party		
Spill Date:	08/25/1988 05:00		
Cleanup Ceased:	09/21/1988		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/13/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/26/1988		
Remark:	55 GALLON DRUM OVERFILLED WITH PURGED FUEL AND WATER DURING FUEL SYSTEM REMOVAL PROCESS.		

NRG019388

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	8901968	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ED WOJINOWSKI	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8303	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8303
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	05/26/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	05/26/1989 11:20
Spill Notifier:	Responsible Party		
Spill Date:	05/26/1989 09:15		
Cleanup Ceased:	05/26/1989		
Last Inspection:	05/26/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST involvement:	False		
Spill Record Last Update:	06/05/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/26/1989		
Remark:	SPILL CAUSED AS A RESULT OF FAULTY OVERFLOW SENSOR. ALL SPILLED TAR CONTAINED TO TANK FIELD WITHIN BLDG/ PLANT.		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

<p>Facility ID: 8905081 Facility Contact: Not reported Investigator: MJH Caller Name: BRIAN KELLY Caller Phone: Not reported Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: DUNLOP TIRE Address: 10 SHERIDAN DRIVE TONAWANDA, NY 14151 Spill Class: Not reported Spill Closed Dt: 08/22/1989 Spill Cause: Equipment Failure Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 08/22/1989 09:00 Cleanup Ceased: 08/22/1989 Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 10/02/1989 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 08/24/1989 Remark: SPILL INSIDE BLDG.</p>	<p>Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: DUNLOP TIRE Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 08/22/1989 11:00</p>
--	---

NRG019390

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	8911331	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	BRIAN KELLY	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	03/01/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Traffic Accident	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	03/01/1990 10:45
Spill Notifier:	Responsible Party		
Spill Date:	03/01/1990 10:00		
Cleanup Ceased:	03/01/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/08/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/06/1990		
Remark:	FORKLIFT TRACTOR ACCIDENTALLY HIT TANK COTAINING THE WASTE OIL		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

<p>Facility ID: 9000431 Facility Contact: Not reported Investigator: CAF Caller Name: BRIAN KELLY Caller Phone: (716) 879-8456 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: DUNLOP Address: 10 SHERIDAN DRIVE TONAWANDA, NY Spill Class: Not reported Spill Closed Dt: 05/04/1990 Spill Cause: Traffic Accident Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 04/12/1990 12:00 Cleanup Ceased: 05/04/1990 Last Inspection: 05/04/1990 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 05/08/1990 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 04/12/1990 Remark: TRUCK DRIVER ACCIDENTLY BROKE OFF VALVE, SPILLING DUST STOP OIL TO CON CRETE. SORB-ALL AND CLAY USED IN CLEANUP.</p>	<p>Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: DUNLOP Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 04/12/1990 14:02</p>
---	--

NRG019392

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9001099	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	BRIAN KELLY	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8546
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	05/08/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/30/1990 09:30
Spill Notifier:	Responsible Party		
Spill Date:	04/29/1990 10:00		
Cleanup Ceased:	05/08/1990		
Last Inspection:	04/30/1990		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/08/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/01/1990		
Remark:	TANK OF SOLVENT DUMPED OVER TO BLDG FLOOR.		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9003100	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	BRIAN KELLY	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8546	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	06/21/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	06/18/1990 13:11
Spill Notifier:	Responsible Party		
Spill Date:	06/18/1990 12:00		
Cleanup Ceased:	06/21/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/30/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/21/1990		
Remark:	TANK FELL OF TRUCK SPILLING GASOLINE		

NRG019394

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID: 9006095
 Facility Contact: Not reported
 Investigator: MF
 Caller Name: DAN TATO
 Caller Phone: (716) 879-8200
 Notifier Name: Not reported
 Notifier Phone: Not reported
 Spiller Contact: Not reported
 Spiller: DUNLOP TIRE
 Address: PO BOX 1109
 BUFFALO, NY 14240

Region of Spill: 9
 Facility Tele: Not reported
 Spill Type: Facility
 Caller Agency: DUNLOP
 Caller Extension: Not reported
 Notifier Agency: Not reported
 Notifier Extension: Not reported
 Spiller Phone: (716) 879-8200

Spill Class: Not reported
 Spill Closed Dt: 09/04/1990
 Spill Cause: Equipment Failure
 Water Affected: HOLDING POND
 Spill Notifier: Responsible Party
 Spill Date: 09/03/1990 07:00
 Cleanup Ceased: 09/04/1990
 Last Inspection: 09/03/1990
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 09/19/1990
 Corrective Action Plan Submitted: Not reported

Resource Affected: Surface Water
 Spill Source: Other Commercial/Industrial
 PBS Number: 9-067202
 Reported to Dept: 09/03/1990 09:06

Date Spill Entered in Computer Data File: 09/04/1990
 Remark: EQUIPMENT FAILURE DURING SHUT DOWN. SPEEDY DRY APPLIED, SOME SPILLAGE IN POND.

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9009384	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	BRIAN KELLY	Caller Agency:	DUNLOP
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/28/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/28/1990 13:50
Spill Notifier:	Responsible Party		
Spill Date:	11/28/1990 13:00		
Cleanup Ceased:	11/28/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/30/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/28/1990		
Remark:	HOSE RUPTURED DURING DELIVERY OF PROCESS OIL		

NRG019396

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9009466	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	DAN PYANOWSKI	Caller Agency:	DUNLOP
Caller Phone:	(716) 829-8274	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/03/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/30/1990 10:10
Spill Notifier:	Responsible Party		
Spill Date:	11/30/1990 10:00		
Cleanup Ceased:	12/03/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/11/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/03/1990		
Remark:	HYDRAULIC OIL SPILLED WHEN ROLL OFF TIPPED UOP ONTO TRUCK		

NRG019397

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9011348	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8275	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8275
Spiller:	DUNLOP TIRE		
Address	10 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	02/06/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	01/28/1991 08:55
Spill Notifier:	Responsible Party		
Spill Date:	01/28/1991 08:30		
Cleanup Ceased:	02/06/1990		
Last Inspection:	01/28/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/06/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	01/28/1991		
Remark:	OIL FOUND IN DISCHARGE DITCH LEADING TO HOLDING POND. SOURCE UNKNOWN. DUNLOP HAS HIRED ENVIRONMENTAL PRODUCTS AND SERVICES TO PAD UP THE SHEEN.		

NRG019398

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9200155	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP TIRE
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8536
Spiller:	DUNLOP TIRE		
Address	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/22/1992		
Spill Cause:	Unknown	Resource Affected:	Surface Water
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/06/1992 08:45	Reported to Dept:	04/06/1992 09:00
Cleanup Ceased:	05/22/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/10/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/06/1992		
Remark:	OIL FOUND IN DUNLOP OIL WATER SEPARATOR POND		

NRG019399

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S100669122

Facility ID:	9204608	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8278	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8278
Spiller:	DUNLOP TIRE DEPT. 224		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/23/1992		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/21/1992 22:00	Reported to Dept:	07/21/1992 23:15
Cleanup Ceased:	07/23/1992		
Last Inspection:	07/22/1992		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/06/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/23/1992		
Remark:	MALFUNCTION CAUSED OIL TO GO INTO OIL-WATER SEPARATOR AND THEN TO WASTE WATER TREATMENT POND.		

NRG019400

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
	DUNLOP TIRE (Continued)		S100669122
	There are 12 other records available for this site.		
I54 SE 1/4-1/2 Higher	DUNLOP TIRE CORP. 10 SHERIDAN DRIVE TONAWANDA, NY 14150	AST	A100086054 N/A
I55 SE 1/4-1/2 Higher	DUNLOP TIRE CORP 10 SHERIDAN DR TONAWANDA, NY 14150	AST	A100071565 N/A
I56 SE 1/4-1/2 Higher	CROSSETT TRUCK AT DUNLOP 10 SHERIDAN DR TONAWANDA, NY	NY Spills	S102245247 N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CROSSETT TRUCK AT DUNLOP (Continued)

S102245247

SPILLS:

Facility ID:	9516445	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	(716) 879-8536	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	DUNLOP TIRE		
Address:	10 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	03/22/1996		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Non Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	03/21/1996 11:10	Reported to Dept:	03/21/1996 13:05
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/29/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/21/1996		
Remark:	truck dumping naphthalene distillate hydro treated heavy nathelene distillate pipe union failed faxed entry		

**I57
SE
1/4-1/2
Higher**

**DUPONT E I DE NEMOURS CO
SHERIDAN DR & RIVER RD
TONAWANDA, NY 14150**

**RCRIS-LQG 1000705376
CERC-NFRAP NYD002103513**

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS-NFRAP Assessment History:

Assessment:	HAZARD RANKING DETERMINED	Completed:	05/01/83
Assessment:	SCREENING SITE INSPECTION	Completed:	12/10/84
Assessment:	PRELIMINARY ASSESSMENT	Completed:	04/30/85
Assessment:	DISCOVERY	Completed:	06/01/81
Assessment:	PRELIMINARY ASSESSMENT	Completed:	05/24/90

CERCLIS-NFRAP Alias Name(s):

E.I. DUPONT DE NEMOURS-NYD000521823

NRG019402

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUPONT E I DE NEMOURS CO (Continued)

1000705376

RCRIS:

Owner: E I DUPONT DE NEMOURS CO INC
(302) 774-1011

Contact: WILLIAM ERVIN
(716) 879-4551

Record Date: 10/15/91

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	74402.00	D002	100.00
D003	1049.00	D005	375.00
D006	1102.00	D007	3855.00
D008	1102.00	D010	375.00
D018	3040.00	D021	277.00
D039	2763.00	F002	3230.00
F003	52622.00	F005	200.00
U154	1510.00		

Used Oil Recyc: No

Violation Status: No violations found

158
SE
1/4-1/2
Higher

**DUNLOP TE & RR CN
RIVER RD & SHERIDAN DR
BUFFALO, NY 14240**

**FINDS 1000290530
RCRIS-LQG NYD002111078
TRIS
TSCA**

RCRIS:

Owner: Not reported

Contact: W PODLEWSKI
(716) 879-8200

Record Date: 08/18/80

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	48240.00	D008	75340.00
D018	117940.00	D039	16920.00
D040	92260.00	F003	332.60
LABP	780.10		

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)
- Civil judicial and administrative enforcement case against facility (under DOCKET)

NRG019403

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

I59 SE 1/4-1/2 Higher	DUPONT SHERIDAN DRIVE / RIVER TONAWANDA, NY	NY Spills	S102179651 N/A
--	--	------------------	---------------------------------

SPILLS:

Facility ID: 9506711 Facility Contact: Not reported Investigator: MJS Caller Name: CATHERINE FREGA Caller Phone: (716) 879-4661 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: CATHY FREGA Spiller: DUPONT Address: PO BOX 88 BUFFALO, NY 14207	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: DUPONT Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 879-4661
Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.	
Spill Closed Dt: Not reported Spill Cause: Human Error Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 08/31/1995 11:30 Cleanup Ceased: Not reported Last Inspection: 09/25/1995 Cleanup Meets Standard: False Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 12/12/1995 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 09/13/1995	Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 08/31/1995 12:04
Remark: WORKER STRUCK VALVE CAUSING SPILL ON GRAVEL. IN PROCESS OF CLEANING UP.	

I60 SE 1/4-1/2 Higher	OIL SHEEN - NIAGARA RIVER RIVER RD. / SHERIDAN DR. TONAWANDA, NY	NY Spills	S102178341 N/A
--	---	------------------	---------------------------------

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

OIL SHEEN - NIAGARA RIVER (Continued)

S102178341

SPILLS:

Facility ID: 9312715 Facility Contact: Not reported Investigator: MJS Caller Name: CLIFFORD OLSON Caller Phone: (716) 874-4662 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: UNKNOWN Address: Not reported Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required. Spill Closed Dt: 05/18/1994 Spill Cause: Unknown Water Affected: NIAGARA RIVER Spill Notifier: Affected Persons Spill Date: 01/28/1994 09:30 Cleanup Ceased: 05/18/1994 Last Inspection: 01/31/1994 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 05/27/1994 Corrective Action Plan Submitted: Not reported Date Spill Entered in Computer Data File: 01/31/1994 Remark: OIL SHEEN IN NIAGARA RIVER.	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: DUPONT Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported Resource Affected: Surface Water Spill Source: Unknown PBS Number: Not reported Reported to Dept: 01/28/1994 15:35
--	---

**I61
SE
1/4-1/2
Higher**

**TOWN OF TONAWANDA SEWER
SHERIDAN DR. / RIVER ROAD
TONAWANDA, NY**

NY Spills

**S102177106
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TOWN OF TONAWANDA SEWER (Continued)

S102177106

SPILLS:

Facility ID:	8911361	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	ANONYMOUS	Caller Agency:	CITIZEN
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	TOWN TONAWANDA SEWER DEPT		
Address:	Not reported		
	TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	03/01/1990	Spill Source:	Other Non Commercial/Industrial
Spill Cause:	Deliberate	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	03/01/1990 15:40
Spill Notifier:	Citizen		
Spill Date:	03/01/1990 12:10		
Cleanup Ceased:	03/01/1990		
Last Inspection:	03/01/1990		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/08/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/02/1990		
Remark:	PUMPING SEWAGE FROM PUMP STATION INTO RIVER,EQUIPT. FAILURE		

162
SE
1/4-1/2
Higher

INDECK-YERKES ENERGY SERVICES INC.
1 SHERIDAN DR
TONAWANDA, NY 14150

AST

A100086132
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDECK-YERKES ENERGY SERVICES INC. (Continued)

A100086132

CBS AST:

Facility ID: 9-000277 Telephone: (716) 874-9088
Owner: INDECK-YERKES ENERGY SERVICES INC.

1 SHERIDAN DR.
TONAWANDA, NY 14150
(716) 874-9088

Facility Status: Active

Tank ID: 64554

Total AST's: 2

Tank Status: Not reported

Tank Location: ABOVEGROUND

Install Date: 11/89

Tank Type: Steel/carbon steel

Extrnl Protection: PAINTED/ASPHALT COATING

Intrnl Protection: EPOXY LINER

Tank Containment: VAULT

Pipe Type: STEEL/IRON

Pipe Internal: NONE

Pipe External: PAINTED/ASPHALT COATING

Pipe Containment: NONE

Leak Detection: NONE

Overfill Protection: Product Level Gauge

Chemical: Not reported

Tank Closed: Not reported

Region: STATE

Case Number: 7664939

MOSF Number: Not reported

SPDES Number: Not reported

Operator: JOHN P. DRENNAN

Emrgncy Contact: SHIFT SUPERVISOR

Certified Date: 08/11/95

Owner type: Corporate/Commercial

Owner Sub Type: Not reported

Mail Name: INDECK-YERKES ENERGY SERVICES INC.

Mail Contact: PLANT MANAGER

1 SHERIDAN DR.

TONAWANDA, NY 14150
Mail Phone: (716) 874-9088

Capacity (Gal): 4500
Product Stored: LEADED GASOLINE

Pipe Location: Aboveground

Haz Percent: 50

PBS Number: 9-491497
SWIS Code: 1464
ICS Number: 9-700663
Facility Town: TONAWANDA
Emrgncy Phone: (716) 874-7355
Expiration Date: 11/17/97
Facility Type: Other

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number	EPA ID Number
------	-------------	---------------	---------------

INDECK-YERKES ENERGY SERVICES INC. (Continued)

A100086132

Facility ID:	9-000277	Telephone:	(716) 874-9088
Owner:	INDECK-YERKES ENERGY SERVICES INC. 1 SHERIDAN DR. TONAWANDA, NY 14150 (716) 874-9088		
Facility Status:	Active	Total AST's:	2
Tank ID:	67055		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	4500
Install Date:	11/89	Product Stored:	LEADED GASOLINE
Tank Type:	Steel/carbon steel		
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	EPOXY LINER		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	CUT-OFF WALLS	Haz Percent:	93
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-491497
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-700663
Operator:	JOHN P. DRENNAN	Facility Town:	TONAWANDA
Emrgncy Contact:	SHIFT SUPERVISOR	Emrgncy Phone:	(716) 874-7355
Certified Date:	08/11/95	Expiration Date:	11/17/97
Owner type:	Corporate/Commercial	Facility Type:	Other
Owner Sub Type:	Not reported		
Mail Name:	INDECK-YERKES ENERGY SERVICES INC.		
Mail Contact:	PLANT MANAGER 1 SHERIDAN DR. TONAWANDA, NY 14150		
Mail Phone:	(716) 874-9088		

**163
SE
1/4-1/2
Higher**

**INDECK-YERKES ENERGY CENTER
1 SHERIDAN DR
TONAWANDA, NY 14150**

AST

**A100084106
N/A**

NRG019408

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDECK-YERKES ENERGY CENTER (Continued)

A100084106

PBS AST:

Facility ID:	9-491497	Telephone:	(716) 874-9088
Facility Status:	Active	Total Ast's:	1
Owner:	INDECK-YERKES LIMITED PRTRNSHP 1 SHERIDAN DRIVE TONAWANDA, NY 14150 (716) 874-9088		

Tank ID:	24353	Capacity (Gal):	150000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Install Date:	08/89	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/JACKETED		
Tank Containment:	CONCRETE DIKE/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	SACRIFICIAL ANODE/NONE		
Leak Detection:	CONCRETE PAD WITH CHANNELS/OTHER		
Overfill Prot:	Product Level Gauge, High Level Alarm	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

I64
SE
1/4-1/2
Higher

**TOWN OF TONAWANDA WATER TREATMENT PLANT
RIVER RD & SHERIDAN DR
TONAWANDA, NY 14150**

UST

**U001852192
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TOWN OF TONAWANDA WATER TREATMENT PLANT (Continued)

U001852192

PBS UST:		CBS Number:	Not reported
Facility ID:	9-423211	SWIS ID:	1464
Town:	Not reported	Location:	Not reported
Telephone:	(716) 877-4453		
Operator:	SHELDON MACON		
Contact:	Not reported		
Emergency Contact:	SHELDON MACON, (716) 838-4346		
Facility Type:	UTILITY		
Total Tanks:	1	Old PBS Num:	Not reported
Owner:	TOWN OF TONAWANDA RIVER RD & SHERIDAN DR TONAWANDA, NY 14150 (716) 877-4453	Owner Mark:	First Owner
Owner Type:	Not reported		
Owner Subtype:	Not reported		
Mailing Address:	TOWN OF TONAWANDA RIVER RD & SHERIDAN DR NY 14150 (716) 877-4453 Not Reported		
Facility Status:	Inactive	Total Capacity:	15000
Certification:	06/28/1988	Expiration:	06/28/1993
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	1WT	Install Date:	07/75
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	Not reported
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	10/86	Next Test Date:	Not reported
Date Closed:	08/91	Test Method:	HORNER
Database Type:	Not reported		

**I65
SE
1/4-1/2
Higher**

**DUPONT
SHERIDAN DR / RIVER RD
TONAWANDA, NY**

NY Spills

**S102174760
N/A**

NRG019410

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUPONT (Continued)

S102174760

SPILLS:

Facility ID:	9205746	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	TOM SAMPLES	Caller Agency:	DUPONT
Caller Phone:	(716) 879-4551	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-4551
Spiller:	DUPONT		
Address:	RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	08/18/1992		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	08/18/1992 16:30	Reported to Dept:	08/18/1992 19:20
Cleanup Ceased:	08/18/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/25/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/21/1992		
Remark:	CHILLER JOINT RUPTURED ON ROOF		

166
SE
1/4-1/2
Higher

DUNLOP TIRE
1 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102245279
N/A

NRG019411

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE (Continued)

S102245279

SPILLS:

Facility ID:	9600222	Region of Spill:	9
Facility Contact:	DAN PARSHALL	Facility Tele:	(716) 879-8278
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DAN PARSHALL	Caller Agency:	DUNLOP
Caller Phone:	() 879-8278	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	DAN PARSHALL	Spiller Phone:	(716) 879-8278
Spiller:	DUNLOP TIRE		
Address:	1 SHERIDAN DRIVE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/03/1996	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/03/1996 15:40
Spill Date:	04/03/1996 12:30		
Cleanup Ceased:	04/03/1996		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/15/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/04/1996		
Remark:	55 gallon drum spilled over while being moved material was collected up w/ clay absorbent and will be manifested for disposal in facility waste stream no response no further action faxed entry		

167
SE
1/4-1/2
Higher

INDECK
1 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102179594
N/A

NRG019412

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDECK (Continued)

S102179594

SPILLS:

Facility ID:	9505334	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	TONYA ALEXANDER	Caller Agency:	NATIONAL FUEL GAS
Caller Phone:	(716) 857-7400	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 857-7686
Spiller:	NATIONAL FUEL GAS		
Address:	10 LAFAYETTE SQUARE BUFFALO, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	03/27/1996	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	07/31/1995 11:08
Spill Date:	07/31/1995 10:30		
Cleanup Ceased:	03/27/1996		
Last Inspection:	03/27/1996		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/24/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/07/1995		
Remark:	PRESSURE VALVE FAILED CAUSING OIL TO BE RELEASED FROM SYSTEM.		

NRG019413

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDECK (Continued)

S102179594

Facility ID:	9407732	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	GRIFFING	Caller Agency:	DEC
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NONE		
Address:	Not reported		
	Not reported		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	09/09/1994	Resource Affected:	In Sewer
Spill Cause:	Deliberate	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	09/08/1994 13:30
Spill Date:	09/08/1994 13:15		
Cleanup Ceased:	09/08/1994		
Last Inspection:	09/08/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/15/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/10/1994		
Remark:	CALLER CLAIMS THAT WATER WITH OIL BEING PUMPED TO SEWER		

168
SE
1/4-1/2
Higher

**DUPONT SHERIDAN + RIVER
SHERIDAN DRIVE / RIVER RD
BUFFALO, NY**

LUST

**S100879126
N/A**

LUST:

Facility ID:	9312570	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	KATHLEEN FREGA	Caller Agency:	DUPONT
Caller Phone:	(716) 879-4551	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-4551
Spiller:	E.I. DUPONT, INC.		
Address:	SHERIDAN DRIVE & RIVER RD BUFFALO, NY		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/08/1994	Resource Affected:	On Land
Spill Cause:	Tank Test Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	01/25/1994 16:40
Spill Date:	01/25/1994 15:30		
Cleanup Ceased:	09/02/1994		
Last Inspection:	06/30/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		

NRG019414

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUPONT SHERIDAN + RIVER (Continued)

S100879126

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: True
 Spill Record Last Update: 09/15/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 01/26/1994
 Remark: TANK TEST FAILURE.

169
SE
1/4-1/2
Higher

**E.I. DUPONT DE NEMOURS
 SHERIDAN DRIVE STATION B & RIVER ROAD
 BUFFALO, NY 14207**

FINDS
TRIS
TSCA
SHWS

1000140324
NYD002103513

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility has an active water discharge permit (under PCS)
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

SHWS:

Facility ID:	915019	EPA ID:	NYD000521823
Owner:	E.I. DuPont de Nemours & Company Sheridan Dr., Station B Buffalo, NY 14207		
Owner Telephone:	Not reported		
Operator:	E.I. DuPont de Nemours & Company Sheridan Dr., Station B Buffalo, NY 14207		
Contact:	Not reported	Telephone:	Not reported
Site Classification:	Temporary classification assigned to sites that have inadequate and/or insufficient data for inclusion in any of the other classifications.		
Region:	9		
Site Type:	Dump		
Acres:	30-40	User:	E.I. DuPont de Nemours & Company
HW Started:	1921	HW Ended:	1978
HW Disposed:	Lab Chemicals and paint, Polyvinyl alcohol film, Various organic wastes from, manufacturing processes		
Units:	76 tons, 100 tons, 91,350 tons		
Air Data:	Unavailable	Surf. Water Data:	Unavailable
Gmd. Water Data:	Available	Soil Data:	Available
Sediment Data:	Unavailable		
Ground Water Standards Contravention:	Yes		
Drinking Water Standards Contravention:	No		
Surface Water Standards Contravention:	No		
Air Standards Contravention:	No		
Enforcement Status:	Order Has Been Signed	Legal Action:	No
State Action:	Yes	Fed Action:	No
Remedial Action:	None		
Remed action type:	None		
Soil Type:	Fill overlying dense silty clay, reddish		
Gmd Water Depth:	Approximately 4 feet		

NRG019415

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

E.I. DUPONT DE NEMOURS (Continued)

1000140324

Assessment of Environmental Problems:

Groundwater samples have exceeded standards for sulfate, chloride, barium, lead, mercury, phenol, 4,4-DDD, 4,4-DDT and benzene. Additional data is needed to determine the extent of possible contamination at one of the ten disposal pits that contained elevated contaminant levels.

Assessment of Health Problems:

Access to the plant is limited to plant employees. Groundwater samples have shown low-level metal contamination. No known private drinking wells are present as the area is serviced by public water however, there are numerous industrial wells in the area. The potential for human exposure to contaminants from this site is minimal. Continued monitoring of groundwater is recommended.

170
SE
1/4-1/2
Higher

**EI DUPONT DE NEMOURS & CO INC
SHERIDAN DRIVE & RIVER ROAD
BUFFALO, NY 14207**

**UST
AST**

**U003079400
N/A**

PBS UST:

Facility ID:	9-125407	CBS Number:	9-000025
Town:	Not reported	SWIS ID:	1402
Telephone:	(716) 879-4551	Location:	Not reported
Operator:	EI DU PONT DE NEMOURS & CO INC		
Contact:	Not reported		
Emergency Contact:	WILLIAM W. ERVIN, (718) 876-4420		
Facility Type:	MANUFACTURING		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 NY 14207 (716) 876-4420 ATTN: MR. WILLIAM W ERVIN		
Facility Status:	Active	Total Capacity:	2000
Certification:	11/03/1994	Expiration:	07/20/1997
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	6	Install Date:	01/78
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	NONE/NONE		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	01/93	Next Test Date:	Not reported
Date Closed:	04/94	Test Method:	PETRO-TITE
Database Type:	Not reported		

NRG019416

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

EI DUPONT DE NEMOURS & CO INC (Continued)

U003079400

Facility ID:	9-125407	CBS Number:	9-000025
Town:	Not reported	SWIS ID:	1402
Telephone:	(716) 879-4551	Location:	Not reported
Operator:	EI DU PONT DE NEMOURS & CO INC		
Contact:	Not reported		
Emergency Contact:	WILLIAM W. ERVIN, (718) 876-4420		
Facility Type:	MANUFACTURING		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 NY 14207 (716) 876-4420 ATTN: MR. WILLIAM W ERVIN		
Facility Status:	Active	Total Capacity:	1000
Certification:	11/03/1994	Expiration:	07/20/1997
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	7	Install Date:	01/83
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	NONE/NONE		
Pipe External:	NONE/NONE		
Second Containment:	NONE/DOUBLED-WALLED TANK		
Leak Detection:	NONE/INTERSTITIAL MONITORING		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Database Type:	Not reported		

NRG019417

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

EI DUPONT DE NEMOURS & CO INC (Continued)

U003079400

Facility ID:	9-125407	CBS Number:	9-000025
Town:	Not reported	SWIS ID:	1402
Telephone:	(716) 879-4551	Location:	Not reported
Operator:	EI DU PONT DE NEMOURS & CO INC		
Contact:	Not reported		
Emergency Contact:	WILLIAM W. ERVIN, (718) 876-4420		
Facility Type:	MANUFACTURING		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 NY 14207 (716) 876-4420 ATTN: MR. WILLIAM W ERVIN		
Facility Status:	Active	Total Capacity:	1000
Certification:	11/03/1994	Expiration:	07/20/1997
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	8	Install Date:	00/00
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Underground	Pipe Type:	Not reported
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	Not reported		
Leak Detection:	Not reported	Dispenser:	Not reported
Overfill Prot:	Not reported	Next Test Date:	Not reported
Date Tested:	Not reported	Test Method:	Not reported
Date Closed:	05/92		
Database Type:	Not reported		

NRG019418

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

EI DUPONT DE NEMOURS & CO INC (Continued)

U003079400

PBS AST:

Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total Ast's:	7
Owner:	EI DU PONT DE NEMOURS & CO INC		

P.O. BOX 88
BUFFALO, NY 14207
(716) 876-4420

Tank ID:	1	Capacity (Gal):	28000
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND		
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Install Date:	01/66	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	NATURAL LINER		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	WRAPPED [PIPING]/NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	09/95	Test Method:	Not reported
Region:	ST		

Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total Ast's:	7
Owner:	EI DU PONT DE NEMOURS & CO INC		

P.O. BOX 88
BUFFALO, NY 14207
(716) 876-4420

Tank ID:	2	Capacity (Gal):	48000
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND		
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Install Date:	01/66	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	NATURAL LINER		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	WRAPPED [PIPING]/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	09/95	Test Method:	Not reported
Region:	ST		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

EI DUPONT DE NEMOURS & CO INC (Continued)

U003079400

Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total Ast's:	7
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420		
Tank ID:	3	Capacity (Gal):	48000
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND		
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Install Date:	01/66	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	NATURAL LINER		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	WRAPPED [PIPING]/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	09/95	Test Method:	Not reported
Region:	ST		

Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total Ast's:	7
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420		
Tank ID:	4	Capacity (Gal):	225000
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND		
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Install Date:	01/71	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	NATURAL LINER		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	WRAPPED [PIPING]/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	09/95	Test Method:	Not reported
Region:	ST		

NRG019420

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

EI DUPONT DE NEMOURS & CO INC (Continued)

U003079400

Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total Ast's:	7
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420		
Tank ID:	5	Capacity (Gal):	10000
Tank Status:	Temporarily Out Of Service		
Tank Location:	ABOVEGROUND		
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Install Date:	01/66	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	NATURAL LINER		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	WRAPPED (PIPING)/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Product Level Gauge, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		
Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total Ast's:	7
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420		
Tank ID:	6	Capacity (Gal):	500
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Install Date:	07/94	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	DOUBLED-WALLED TANK/PREFABRICATED STEEL DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	INTERSTITIAL MONITORING/NONE		
Overfill Prot:	High Level Alarm, None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019421

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

EI DUPONT DE NEMOURS & CO INC (Continued)

U003079400

Facility ID:	9-125407	Telephone:	(716) 879-4551
Facility Status:	Active	Total As'ts:	7
Owner:	EI DU PONT DE NEMOURS & CO INC P.O. BOX 88 BUFFALO, NY 14207 (716) 876-4420		
Tank ID:	8	Capacity (Gal):	500
Tank Status:	In Service		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Install Date:	07/90	Tank Internal:	NONE
Tank External:	PAINTED/ASPHALT COATING/NONE		
Tank Containment:	IMPERVIOUS UNDERLAYMENT/NONE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Gravity
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

I71
SE
1/4-1/2
Higher

**INDECK-YERKES ENERGY
2 SHERIDAN DR
TONAWANDA, NY**

NY Spills

**S102177424
N/A**

NRG019422

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDECK-YERKES ENERGY (Continued)

S102177424

SPILLS:

Facility ID: 9005398
Facility Contact: Not reported
Investigator: MJH
Caller Name: JOHN DRENNAN
Caller Phone: (716) 874-9088
Notifier Name: Not reported
Notifier Phone: Not reported
Spiller Contact: Not reported
Spiller: INDECK-YERKES ENERGY
Address: Not reported
TONAWANDA, NY

Region of Spill: 9
Facility Tele: Not reported
Spill Type: Facility
Caller Agency: INDECK
Caller Extension: Not reported
Notifier Agency: Not reported
Notifier Extension: Not reported
Spiller Phone: Not reported

Spill Class: Not reported
Spill Closed Dt: 11/06/1990
Spill Cause: Equipment Failure
Water Affected: Not reported
Spill Notifier: Responsible Party
Spill Date: 06/14/1990 01:32
Cleanup Ceased: 11/06/1990
Last Inspection: Not reported
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 12/04/1990
Corrective Action Plan Submitted: Not reported
Date Spill Entered In Computer Data File: 08/17/1990
Remark: PIPELINE BREAK INTO CONTAINMENT AREA

Resource Affected: On Land
Spill Source: Other Commercial/Industrial
PBS Number: Not reported
Reported to Dept: 08/15/1990 14:25

172
SE
1/4-1/2
Higher

UNK. SUBST. FROM OUTFALL
SHERIDAN DR. / RIVER RD.
TONAWANDA, NY

NY Spills

S102178210
N/A

173
SE
1/4-1/2
Higher

INDEC/ NFG
1 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102178874
N/A

NRG019423

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INDEC/ NFG (Continued)

S102178874

SPILLS:

Facility ID:	9408326	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	CHRIS CEJ	Caller Agency:	NATIONAL FUEL GAS
Caller Phone:	(716) 857-7358	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 857-7358
Spiller:	NATIONAL FUEL GAS		
Address:	Not reported		
	BUFFALO, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/20/1994	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	09/20/1994 14:00
Spill Date:	09/20/1994 12:00		
Cleanup Ceased:	09/20/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/07/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/01/1994		
Remark:	RELIEF VALVE FAILED, SPILL CLEANED UP W/ SPEEDY DRY		

174
SE
1/4-1/2
Higher

TONAWANDA (T) WATER TREATMENT PLANT
SHERIDAN & RIVER RD.
TONAWANDA, NY 14150

AST

A100085924
N/A

NRG019424

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA (T) WATER TREATMENT PLANT (Continued)

A100085924

CBS AST:

Facility ID: 9-000027 Telephone: (716) 877-4453
Owner: TONAWANDA (T) WATER TREATMENT PLANT

218 AQUA LANE
TONAWANDA, NY 14150
(716) 877-4453

Facility Status: Active

Tank ID: 001

Total AST's: 4

Tank Status: Not reported

Tank Location: ABOVEGROUND

Install Date: 00/79

Capacity (Gal): 1750

Tank Type: Fiberglass reinforced plastic [FRP]

Product Stored: LEADED GASOLINE

Extrnl Protection: NONE

Intrnl Protection: NONE

Tank Containment: VAULT

Pipe Type: NOT DEFINED

Pipe Location: Aboveground

Pipe Internal: NONE

Pipe External: NONE

Pipe Containment: VAULT

Haz Percent: 100

Leak Detection: NONE

Overfill Protection: Catch Basin

Chemical: Aluminum sulfate

Tank Closed: Not reported

Region: STATE

Case Number: 10043013

PBS Number: Not reported

MOSF Number: Not reported

SWIS Code: 1464

SPDES Number: Not reported

ICS Number: 9-167080

Operator: OPERATOR

Facility Town: TONAWANDA

Emrgncy Contact: SHELDON MACON

Emrgncy Phone: (716) 877-4453

Certified Date: 03/18/97

Expiration Date: 03/17/99

Owner type: Local Government

Facility Type: EF

Owner Sub Type: Not reported

Mail Name: TONAWANDA (T) WATER TREATMENT PLANT

Mail Contact: SHELDON MACON

218 AQUA LANE
TONAWANDA, NY 14150

Mail Phone: (716) 877-4453

NRG019425

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA (T) WATER TREATMENT PLANT (Continued)

A100085924

Facility ID:	9-000027	Telephone:	(716) 877-4453
Owner:	TONAWANDA (T) WATER TREATMENT PLANT 218 AQUA LANE TONAWANDA, NY 14150 (716) 877-4453		
Facility Status:	Active	Total AST's:	4
Tank ID:	002		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	00/79	Capacity (Gal):	1750
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	VAULT	Haz Percent:	100
Leak Detection:	NONE		
Overfill Protection:	Catch Basin		
Chemical:	Aluminum sulfate		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	10043013	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167080
Operator:	OPERATOR	Facility Town:	TONAWANDA
Emrgncy Contact:	SHELDON MACON	Emrgncy Phone:	(716) 877-4453
Certified Date:	03/18/97	Expiration Date:	03/17/99
Owner type:	Local Government	Facility Type:	EF
Owner Sub Type:	Not reported		
Mail Name:	TONAWANDA (T) WATER TREATMENT PLANT		
Mail Contact:	SHELDON MACON 218 AQUA LANE TONAWANDA, NY 14150		
Mail Phone:	(716) 877-4453		

NRG019426

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA (T) WATER TREATMENT PLANT (Continued)

A100085924

Facility ID:	9-000027	Telephone:	(716) 877-4453
Owner:	TONAWANDA (T) WATER TREATMENT PLANT 218 AQUA LANE TONAWANDA, NY 14150 (716) 877-4453		
Facility Status:	Active	Total AST's:	4
Tank ID:	003		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	1750
Install Date:	00/79	Product Stored:	LEADED GASOLINE
Tank Type:	Fiberglass reinforced plastic [FRP]		
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	VAULT	Haz Percent:	100
Leak Detection:	NONE		
Overfill Protection:	Catch Basin		
Chemical:	Aluminum sulfate		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	10043013	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167080
Operator:	OPERATOR	Facility Town:	TONAWANDA
Emrgncy Contact:	SHELDON MACON	Emrgncy Phone:	(716) 877-4453
Certified Date:	03/18/97	Expiration Date:	03/17/99
Owner type:	Local Government	Facility Type:	EF
Owner Sub Type:	Not reported		
Mail Name:	TONAWANDA (T) WATER TREATMENT PLANT		
Mail Contact:	SHELDON MACON 218 AQUA LANE TONAWANDA, NY 14150		
Mail Phone:	(716) 877-4453		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA (T) WATER TREATMENT PLANT (Continued)

A100085924

Facility ID:	9-000027	Telephone:	(716) 877-4453
Owner:	TONAWANDA (T) WATER TREATMENT PLANT 218 AQUA LANE TONAWANDA, NY 14150 (716) 877-4453		
Facility Status:	Active	Total AST's:	4
Tank ID:	004		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	00/79	Capacity (Gal):	1750
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	VAULT	Haz Percent:	100
Leak Detection:	NONE		
Overfill Protection:	Catch Basin		
Chemical:	Aluminum sulfate		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	10043013	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167080
Operator:	OPERATOR	Facility Town:	TONAWANDA
Emrgncy Contact:	SHELDON MACON	Emrgncy Phone:	(716) 877-4453
Certified Date:	03/18/97	Expiration Date:	03/17/99
Owner type:	Local Government	Facility Type:	EF
Owner Sub Type:	Not reported		
Mail Name:	TONAWANDA (T) WATER TREATMENT PLANT		
Mail Contact:	SHELDON MACON 218 AQUA LANE TONAWANDA, NY 14150		
Mail Phone:	(716) 877-4453		

175
SE
1/4-1/2
Higher

DUNLOP TIRE AND RUBBER
SHERIDAN DRIVE / RIVER ROAD
TONAWANDA, NY 14217

SHWS

S101008661
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DUNLOP TIRE AND RUBBER (Continued)

S101008661

SHWS:

Facility ID:	915018	EPA ID:	NYD980211338
Owner:	Dunlop Tire Corporation P.O. Box 1109 Buffalo, NY 14240		
Owner Telephone:	Not reported		
Operator:	Dunlop Tire & Rubber Corporation Sheridan Drive & River Road Tonawanda, NY 14217		
Contact:	Not reported	Telephone	Not reported
Site Classification:	Site is properly closed - requires continued management		
Region:	9		
Site Type:	Landfill		
Acres:	25	User:	Dunlop Tire and Rubber Corporation
HW Started:	1921	HW Ended:	1979
HW Disposed:	waste solvents and degreasers, rubber products, coal ash, flyash, carbon black, amines and antioxidants		
Units:	unknown, unknown, 400 tons/year, unknown, unknown, unknown		
Air Data:	Unavailable	Surf. Water Data:	Available
Gmd. Water Data:	Available	Soil Data:	Available
Sediment Data:	Available		
Ground Water Standards Contravention:	Yes		
Drinking Water Standards Contravention:	No		
Surface Water Standards Contravention:	Yes		
Air Standards Contravention:	No		
Enforcement Status:	Not reported	Legal Action:	No
State Action:	Yes	Fed Action:	No
Remedial Action:	In Progress		
Remed action type:	closure of three landfills with mod. clay caps		
Soil Type:	fill overlying reddish brown native silty clay		
Gmd Water Depth:	5 ft.		

Assessment of Environmental Problems:

Because the three landfills have been properly closed with Modified Part360 clay caps, and will be maintained and monitored for thirty years, future environmental problems associated with this site are minimal.

Assessment of Health Problems:

The site is fenced and has undergone a modified Part 360 closure which has covered and capped contaminated soil. Therefore, direct contact of on-site workers to contaminated soil has been eliminated. Groundwater exceeds NYS standards for VOCs and metals. Industrial wells are prevalent along River Road; however, the area is served by public water. Monitoring wells have been installed for determining the possibility of off-site migration into the adjacent Niagara River, which is a source of public drinking water.

J76
NE
1/4-1/2
Higher

WNY BARREL & DRUM
225 SAWYER AVE
TONAWANDA, NY

LUST

S100669460
N/A

LUST:

Facility ID:	9000748	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	MIKE GUGETMOF	Caller Agency:	TONAWANDA PD
Caller Phone:	(716) 876-1212	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported

NRG019429

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

WNY BARREL & DRUM (Continued)

S100669460

Notifier Phone: Not reported Spiller Contact: Not reported Spiller: WNY BARREL & DRUM COMPANY Address: 225 SAWYER AVENUE TONAWANDA, NY Spill Class: Not reported Spill Closed Dt: 06/13/1990 Spill Cause: Other Water Affected: Not reported Spill Notifier: Fire Department Spill Date: 04/21/1990 12:00 Cleanup Ceased: 06/13/1990 Last Inspection: 04/21/1990 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 07/05/1990 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 04/24/1990 Remark: FIRE AT FACILITY, RUNOFF ACIDIC	Notifier Extension: Not reported Spiller Phone: (716) 873-4440 Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 04/21/1990 18:43
--	--

**J77
NE
1/4-1/2
Higher**

**WESTERN NEW YORK BARREL & DRUM
225 SAWYER AVE
TONAWANDA, NY 14150**

**FINDS 1000402181
RCRIS-LQG NYD013294947**

RCRIS:
 Owner: CORPORATION
 (212) 555-1212

 Contact: JOHN P HENDERSON
 (716) 873-4440

 Record Date: 08/18/80
 Classification: Large Quantity Generator, Hazardous Waste Transporter
 Used Oil Recyc: No
 Violation Status: No violations found

FINDS:
 Other Pertinent Environmental Activity Identified at Site:
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

**J78
NE
1/4-1/2
Higher**

**WESTERN NY DRUM CO.
225 SAWYER AVE
TONAWANDA, NY**

**NY Spills S102175251
 N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

WESTERN NY DRUM CO. (Continued)

S102175251

SPILLS:

Facility ID:	8602683	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	WESTERN NY DRUM CO.		
Address:	225 SAWYER AVE. TOANAWANDA		
Spill Class:	Not reported		
Spill Closed Dt:	07/22/1986		
Spill Cause:	Deliberate		
Water Affected:	Not reported	Resource Affected:	On Land
Spill Notifier:	Citizen	Spill Source:	Other Commercial/Industrial
Spill Date:	07/07/1986 12:00	PBS Number:	Not reported
Cleanup Ceased:	07/22/1986	Reported to Dept:	07/22/1986 12:00
Last Inspection:	07/22/1986		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/15/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/25/1986		
Remark:	ALLEDGED DUMPING OF DRUMS		

**79
NNW
1/2-1
Higher**

**ASHLAND CHEMICAL CO
3701 RIVER RD
TONAWANDA, NY 14150**

**CERCLIS 1000276708
FINDS NYD000688630
RCRIS-LQG
LUST
NY Spills**

CERCLIS Classification Data:

Site Incident Category:	R	Federal Facility:	NO
Ownership Status:	PRIVATE	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS Assessment History:

Assessment:	DISCOVERY	Completed:	12/15/80
Assessment:	HAZARD RANKING DETERMINED	Completed:	01/15/88
Assessment:	PRELIMINARY ASSESSMENT	Completed:	10/30/88
Assessment:	SCREENING SITE INSPECTION	Completed:	05/31/90

CERCLIS Site Status:

This site is currently under investigation by the government to assess the extent of further action

CERCLIS Alias Name(s):

ASHLAND II

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND CHEMICAL CO (Continued)

1000276708

SPILLS:

Facility ID:	9409029	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	JACK SPICUZZA	Caller Agency:	ASHLAND CHEMICAL
Caller Phone:	(614) 889-3633	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(614) 790-3333
Spiller:	ASHLAND CHEMICAL		
Address:	PO BOX 2219 COLUMBUS, OHIO 43216		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/05/1994 13:00	Reported to Dept:	10/06/1994 10:00
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/26/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	10/17/1994		
Remark:	CONTAMINATED SOIL FOUND UNDER CONCRETE PAD IN OLD DIKE AREA		

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	-------------	--------------------	--

ASHLAND CHEMICAL CO (Continued)

1000276708

<p> Facility ID: 9615049 Facility Contact: JACK SPICUZZA Investigator: SAC Caller Name: JACK SPICUZZA Caller Phone: (614) 790-3633 Notifier Name: DEAN FERRELL Notifier Phone: (716) 873-8294 Spiller Contact: JACK SPICUZZA Spiller: ASHLAND CHEMICAL Address: 3701 RIVER RD TONAWANDA, NY Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken. Spill Closed Dt: Not reported Spill Cause: Unknown Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 03/31/1997 08:30 Cleanup Ceased: Not reported Last Inspection: 04/02/1997 Cleanup Meets Standard: False Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 04/02/1997 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 03/31/1997 Remark: POSSIBLY 10-20 GALLONS MADE IT INTO A DITCH - ALL THE REST WAS CAPTURED IN A CONCRETE TANK FARM AREA - IT IS BELIEVED THAT SOME ONE MAY HAVE VANDALIZED A VALVE CAUSING SPILL </p>	<p> Region of Spill: 9 Facility Tele: (614) 790-3633 Spill Type: UST Caller Agency: ASHLAND CHEMICAL CO Caller Extension: Not reported Notifier Agency: ASHLAND CHEMICAL CO Notifier Extension: Not reported Spiller Phone: (614) 790-3633 Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 03/31/1997 10:35 </p>
---	--

K80
NNW
1/2-1
Higher

CHEMCENTRAL/BUFFALO
3709 RIVER RD
TONAWANDA, NY

NY Spills **S102175460**
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CHEMCENTRAL/BUFFALO (Continued)

S102175460

SPILLS:

Facility ID:	8606758	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-1600
Spiller:	CHEMCENTRAL/BUFFALO		
Address:	3709 RIVER RD. TONAWANDA		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	02/04/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	DITCH	Reported to Dept:	02/04/1987 10:05
Spill Notifier:	Responsible Party		
Spill Date:	02/04/1987 10:00		
Cleanup Ceased:	02/04/1987		
Last Inspection:	02/04/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/09/1987		
Remark:	PROPYLENE GLYCOL METHYL ETHER ACETATE 1-METHOXY-2-PROPANOL,ACETATE.		

NRG019435

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CHEMCENTRAL/BUFFALO (Continued)

S102175460

Facility ID:	9507864	Region of Spill:	9
Facility Contact:	JOSEPH CUTRIE JR.	Facility Tele:	(716) 874-1600
Investigator:	MNP	Spill Type:	Facility
Caller Name:	ANONYMOUS	Caller Agency:	CITIZEN
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	ANONYMOUS	Notifier Agency:	CITIZEN
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	DAVID W. BAUMGART	Spiller Phone:	(716) 874-1600
Spiller:	CHEMCENTRAL		
Address:	PO BOX 90 BUFFALO, NY 14207		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/10/1995		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Tank Truck
Spill Notifier:	Citizen	PBS Number:	Not reported
Spill Date:	09/26/1995 16:00	Reported to Dept:	09/27/1995 10:31
Cleanup Ceased:	11/10/1995		
Last Inspection:	10/19/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/14/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/28/1995		
Remark:	CHEMCENTRAL TANK TRUCK SPILLED XYLENE FROM OPEN DOMES ON TOP OF TANK.		

**K81
NNW
1/2-1
Higher**

**CHEMCENTRAL/BUFFALO
3709 RIVER RD
TOWN OF TONAWANDA, NY 14150**

**FINDS 1000296931
RCRIS-LQG NYD000691154**

RCRIS:
Owner: CHEMCENTRAL CORPORATION
(212) 555-1212

Contact: WILLIAM MULLIKEN
(312) 594-7000

Record Date: 08/18/80

Classification: Large Quantity Generator, Hazardous Waste Transporter

BIENNIAL REPORTS:
Last Biennial Reporting Year: 1993

Waste	Quantity (Lbs)	Waste	Quantity (Lbs)
F001	1644.00	F002	1214.00
F003	6222.00	F005	1460.00

NRG019436

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

CHEMCENTRAL/BUFFALO (Continued)						1000296931	
Used Oil Recyc: No							
Violation Status: No violations found							

L82	3M O-CELLO				NY Spills	S102173972	
NE	305 SAWYER AVE					N/A	
1/2-1	TONAWANDA, NY						
Higher							

SPILLS:

Facility ID:	9101352	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	MARLENE KONIECZNY	Caller Agency:	3M O-CELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M O-CELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	05/10/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	05/02/1991 16:28
Spill Notifier:	Responsible Party		
Spill Date:	05/02/1991 15:25		
Cleanup Ceased:	05/02/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/20/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/10/1991		
Remark:	WELDING CAUSED FLASH FIRE, CAUSING A PRESSURE RELEASE FROM PURGING VESSEL.		

L83	3M O'CELLO				NY Spills	S102174323	
NE	305 SAWYER AVE					N/A	
1/2-1	TONAWANDA, NY						
Higher							

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

3M O'CELLO (Continued)

S102174323

SPILLS:

Facility ID: 9109866 Facility Contact: Not reported Investigator: MJH Caller Name: HERBERT FEDER Caller Phone: (716) 871-6213 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: 3M O'CELLO Address: Not reported Spill Class: Not reported Spill Closed Dt: 12/17/1991 Spill Cause: Unknown Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 12/03/1991 12:00 Cleanup Ceased: 12/17/1991 Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: Not reported Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 12/17/1991	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: 3M O'CELLO Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported Resource Affected: Groundwater Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 12/16/1991 12:30
--	---

Remark: GROUNDWATER FROM TANK PIT TEST RESULT FOUND HIGH LEVEL OF CARBON DISULFIDE

**L84
NE
1/2-1
Higher**

**3M TONAWANDA
305 SAWYER AVENUE
TONAWANDA, NY 14150**

**UST
LUST
NY Spills
AST**

**U003080603
N/A**

LUST:

Facility ID: 9507270 Facility Contact: Not reported Investigator: KAH Caller Name: GREG STUBBS Caller Phone: (716) 876-1597 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: 3M Address: 305 SAWYER AVENUE TONAWANDA, NY Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken. Spill Closed Dt: 09/14/1995 Spill Cause: Other Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 09/13/1995 12:00 Cleanup Ceased: 09/14/1995 Last Inspection: Not reported	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: 3M Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 876-1597 Resource Affected: Air Spill Source: Major Facility 400,000 gallons PBS Number: Not reported Reported to Dept: 09/13/1995 17:15
---	--

NRG019438

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 09/21/1995
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 09/14/1995
 Remark: PRODUCT IN NEW TANK THAT WAS BEING INSTALLED STARTED ON FIRE CAUSING AN AIR RELEASE OF BETWEEN 1/2 AND 14 LBS. OF SULFUR DIOXIDE.

SPILLS:

Facility ID:	9701177	Region of Spill:	9
Facility Contact:	GREGG STUBBS	Facility Tele:	(716) 871-6281
Investigator:	MJS	Spill Type:	UST
Caller Name:	GREG STUBBS	Caller Agency:	3M
Caller Phone:	(716) 871-6281	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREGG STUDDDS	Spiller Phone:	(716) 871-6281
Spiller:	3M COMPANY		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/28/1997		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/26/1997 09:30	Reported to Dept:	04/26/1997 11:23
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/29/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/26/1997		
Remark:	RELEASE INTO AIR - OCCURED OVER A 24 HR PERIOD - STARTING AT 0900 4/25/97 ENDING THIS DATE - UNK WHAT CAUSED THE RELEASE - STILL CHECKING INTO IT - COULD BE JUST AN INSTRUMENT ERROR		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9701182	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	MJS	Spill Type:	UST
Caller Name:	MARGRET CHONG	Caller Agency:	EPA
Caller Phone:	(908) 548-8730	Caller Extension:	Not reported
Notifier Name:	GREG STUBBS	Notifier Agency:	3M
Notifier Phone:	(716) 871-6281	Notifier Extension:	Not reported
Spiller Contact:	GREG STUBBS	Spiller Phone:	(716) 871-6281
Spiller:	3M		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14105		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/28/1997		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Federal Government	PBS Number:	Not reported
Spill Date:	04/26/1997 06:30	Reported to Dept:	04/26/1997 12:48
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/29/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/26/1997		
Remark:	UNK CAUSE OF RELEASE - OPERATIONS BACK TO NORMAL NOW THEY WILL INVESTIGATE ON MONDAY		

NRG019440

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

PBS UST:

Facility ID:	9-508519	CBS Number:	9-000079
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-1596	Location:	Not reported
Operator:	HERBERT FEDER		
Contact:	Not reported		
Emergency Contact:	GREGORY A STUBBS, (716) 876-1596		
Facility Type:	MANUFACTURING		
Total Tanks:	1	Old PBS Num:	001392
Owner:	3M COMPANY BUILDING 41-01-05 BOX 33331 ST PAUL, MN 55133 (612) 778-5563		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	3M COMPANY 305 SAWYER AVE NY 14150 (716) 876-1596 ATTN: GREGORY A. STUBBS		
Facility Status:	Active	Total Capacity:	30000
Certification:	02/14/1996	Expiration:	12/14/1990
Tank Status:	Tank Converted To Non-Regulated Use		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	12/95
Product Stored:	EMPTY	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	NONE
Tank External:	Not reported		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	None
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	12/95	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

CBS AST:			
Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active		
Tank ID:	BL002	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/75	Capacity (Gal):	3400
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	14
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	ACID1		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/72	Capacity (Gal):	5800
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	78
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	ACID2		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES-LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/76	Capacity (Gal):	5800
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	78
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NA0H1	Capacity (Gal):	20000
Tank Status:	Not reported	Product Stored:	LEADED GASOLINE
Tank Location:	ABOVEGROUND		
Install Date:	07/54	Pipe Location:	Aboveground
Tank Type:	Steel/carbon steel	Haz Percent:	50
Extrnl Protection:	JACKETED		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON		
Pipe Internal:	NONE		
Pipe External:	JACKETED		
Pipe Containment:	NONE		
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active		
Tank ID:	CS201	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	02/52	Capacity (Gal):	19000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE		
Leak Detection:	OTHER		
Overfill Protection:	Product Level Gauge/Catch Basin		
Chemical:	Not reported		
Tank Closed:	11/96		
Region:	STATE		
Case Number:	75150	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019446

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active		
Tank ID:	BL001	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	09/89	Capacity (Gal):	3400
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	14
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019447

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	BL003		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	10/85	Capacity (Gal):	384
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	14
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/High Level Alarm		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019448

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	CS202		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	08/77	Capacity (Gal):	300
Tank Type:	Fiberglass coated steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	FIBERGLASS		
Intrnl Protection:	NONE		
Tank Containment:	OTHER/EARTHEN DIKE		
Pipe Type:	FIBERGLASS (FRP)	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	EARTHEN DIKE	Haz Percent:	100
Leak Detection:	INTERSTITIAL MONITORING		
Overfill Protection:	Catch Basin		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE		
Case Number:	75150	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019449

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NA0H2		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	750
Install Date:	08/90	Product Stored:	LEADED GASOLINE
Tank Type:	Steel/carbon steel		
Extrnl Protection:	PAINTED/ASPHALT COATING	Pipe Location:	Aboveground
Intrnl Protection:	NONE		
Tank Containment:	VAULT	Haz Percent:	50
Pipe Type:	STEEL/IRON		
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE		
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/Catch Basin		
Chemical:	Not reported	PBS Number:	9-001392
Tank Closed:	Not reported	SWIS Code:	1464
Region:	STATE	ICS Number:	9-167068
Case Number:	1310732	Facility Town:	TONAWANDA
MOSF Number:	Not reported	Emrgncy Phone:	(716) 876-1596
SPDES Number:	Not reported	Expiration Date:	12/07/98
Operator:	HERBERT FEDER	Facility Type:	Manufacturing
Emrgncy Contact:	GREGORY A STUBBS		
Certified Date:	12/10/96		
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NA0H5		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	05/67	Capacity (Gal):	387
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	19
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A. STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NAOH6		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	06/85	Capacity (Gal):	244
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE		
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active		
Tank ID:	BL001	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/81	Capacity (Gal):	3400
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Catch Basin		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019453

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	CS203		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	06/94	Capacity (Gal):	30000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	OTHER		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	NONE		
Leak Detection:	INTERSTITIAL MONITORING		
Overfill Protection:	High Level Alarm/Automatic Shut-Off		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	75150	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER		
Emrgncy Contact:	GREGORY A STUBBS	Facility Town:	TONAWANDA
Certified Date:	12/10/96	Emrgncy Phone:	(716) 876-1596
Owner type:	Corporate/Commercial	Expiration Date:	12/07/98
Owner Sub Type:	Not reported	Facility Type:	Manufacturing
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

**L85
NE
1/2-1
Higher**

**3M OCELLO
305 SAWYER AVE
TONAWANDA, NY**

**LUST
NY Spills**

**S100667584
N/A**

LUST:

Facility ID:	9110025	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	MARLENE KONIECZNY	Caller Agency:	3M OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M OCELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	12/20/1991		
Spill Cause:	Other		
Water Affected:	Not reported		
		Resource Affected:	Surface Water
		Spill Source:	Other Commercial/Industrial

NRG019454

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M OCELLO (Continued)

S100667584

Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	12/20/1991 10:00	Reported to Dept:	12/20/1991 12:10
Cleanup Ceased:	12/20/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/20/1991		
Remark:	SURFACE WATER ENTERED ONGOING CONTAMINATED SOIL REMEDIATION PROJECT		

SPILLS:

Facility ID:	9010381	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	HERB FEDER	Caller Agency:	OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M OCELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	12/27/1990		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	12/26/1990 13:00	Reported to Dept:	12/26/1990 13:41
Cleanup Ceased:	12/27/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/28/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/27/1990		
Remark:	EQUIPMENT FAILURE ON AIR POLLUTION CONTROL EQUIPMENT RELEASED SULPHUR DIOXIDE INTO THE AIR		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M OCELLO (Continued)

S100667584

Facility ID:	9300606	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	HERBERT FEDER	Caller Agency:	3M OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M OCELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/13/1993	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/13/1993 11:52
Spill Date:	04/13/1993 02:45		
Cleanup Ceased:	04/13/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/28/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/15/1993		
Remark:	MAIN SOURCE OF SULFUR DIOXIDE IS PROCESS DESIGN OF RECOVERY EQUIPMENT		

L86
NE
1/2-1
Higher

3M O-CEL-O
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S100667754
N/A

LUST:

Facility ID:	9202864	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	PAT PENDRAK	Caller Agency:	3M O-CEL-O
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M O-CEL-O DIVISION		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/09/1992	Resource Affected:	On Land
Spill Cause:	Other	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	06/08/1992 09:35
Spill Date:	06/06/1992 12:00		
Cleanup Ceased:	12/09/1992		
Last Inspection:	06/08/1992		

NRG019456

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CEL-O (Continued)

S100667754

Cleanup Meets Standard: False
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 12/17/1992
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 06/10/1992
 Remark: WHILE DIGGING FOR FOOTER FOR EXTENSION OF THE BUILDING, HYDRAULIC OIL WAS FOUND.

SPILLS:

Facility ID:	9108405	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	HERBERT FADER	Caller Agency:	3M O-CEL-O
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M O-CEL-O		
Address:	305 SAWYER AVENUE TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/04/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/06/1991 15:55
Spill Notifier:	Responsible Party		
Spill Date:	11/06/1991 15:00		
Cleanup Ceased:	12/04/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/04/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/07/1991		
Remark:	CONTAMINATED SOIL FOUND DURING SOIL EXCAVATION		

L87
NE
1/2-1
Higher

TRAFFIC ACCIDENT
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102176421
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TRAFFIC ACCIDENT (Continued)

S102176421

SPILLS:

Facility ID:	8806112	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	DISPATCH LINDSTROM	Caller Agency:	TONAWANDA PD
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	10/24/1988	Spill Source:	Passenger Vehicle
Spill Cause:	Traffic Accident	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	10/20/1988 01:05
Spill Notifier:	Police Department		
Spill Date:	10/20/1988 00:36		
Cleanup Ceased:	10/24/1988		
Last Inspection:	10/24/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/25/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/24/1988		
Remark:	TRAFFIC ACCIDENT, MINOR SPILL		

L88
NE
1/2-1
Higher

3M 0-CEL-0
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102179174
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CEL-0 (Continued)

S102179174

SPILLS:

Facility ID:	9411795	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	GREG STUBBS	Caller Agency:	3M O-CEL-0
Caller Phone:	(716) 871-6281	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREG STUBBS	Spiller Phone:	(716) 876-1596
Spiller:	3M O-CEL-0		
Address	305 SAWYER AVENUE TONAWANDA, NY 14150		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	01/28/1997	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	12/02/1994 14:50
Spill Date:	12/02/1994 14:30		
Cleanup Ceased:	Not reported		
Last Inspection:	12/07/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/10/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/05/1994		
Remark:	HIT FUEL LINE WHILE EXCAVATING. INTENT TO REPLACE TANK AND LINES IN NEXT FEW MONTHS.		

L89
NE
1/2-1
Higher

**3-M COMPANY
305 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102178143
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3-M COMPANY (Continued)

S102178143

SPILLS:

Facility ID:	9308044	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	BOB SIEGEL	Caller Agency:	3-M COMPANY
Caller Phone:	(612) 778-6130	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3-M COMPANY		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	10/07/1993	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/01/1993 16:28
Spill Date:	10/01/1993 00:59		
Cleanup Ceased:	10/07/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/18/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/04/1993		
Remark:	DAMPER MALFUNCTION.		

L90
NE
1/2-1
Higher

3M O-CELL-O
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102175037
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CELL-O (Continued)

S102175037

SPILLS:

Facility ID:	9212281	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	GREG STUBBS	Caller Agency:	3M O-CELL-O
Caller Phone:	(716) 871-6281	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NONE		
Address:	Not reported		
	Not reported		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	02/03/1993		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Unknown
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	01/01/1993 12:00	Reported to Dept:	01/26/1993 12:00
Cleanup Ceased:	02/03/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/20/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	01/29/1993		
Remark:	WHILE DIGGING UP CONCRETE FOOTERS, BLACKENED SOIL WAS NOTED		

L91
NE
1/2-1
Higher

O'CELLO DIVISION
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102176905
N/A

NRG019461

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

O'CELLO DIVISION (Continued)

S102176905

SPILLS:

Facility ID: 8905389 Facility Contact: Not reported Investigator: MJH Caller Name: HERBERT FEDDER Caller Phone: (716) 876-1596 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: OCELLO DIVISION Address: 305 SAWYER AVENUE TONAWANDA, NY 14151 Spill Class: Not reported Spill Closed Dt: 08/31/1989 Spill Cause: Equipment Failure Water Affected: Not reported Spill Notifier: Federal Government Spill Date: 08/29/1989 19:40 Cleanup Ceased: 08/31/1989 Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 10/02/1989 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 09/25/1989 Remark: FIRE IN POLLUTION CONTROL EQUIPMENT CAUSED RELEASE OF SEVERAL POLUTANTS	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: O'CELLO DIVISION Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 876-1596 Resource Affected: Air Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 08/31/1989 15:36
--	---

L92
NE
1/2-1
Higher

3M CORPORATION
305 SAWYER AVE
TONAWANDA, NY

NY Spills S102177965
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

SPILLS:

Facility ID:	9609379	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	HERBERT FEDER	Caller Agency:	3M CORPORATION
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREG STUBBS	Spiller Phone:	(716) 871-6281
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/29/1996	Resource Affected:	Air
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/26/1996 23:24
Spill Date:	10/26/1996 22:35		
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/30/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/26/1996		
Remark:	tank being flushed prior to diaposal material carbon disulfide entered atmosphere		

NRG019463

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9609391	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	HERBERT FEDER	Caller Agency:	3M CORPORATION
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREGG STUBBS	Spiller Phone:	(716) 871-6281
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/29/1996		
Spill Cause:	Housekeeping	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/27/1996 22:00	Reported to Dept:	10/27/1996 23:03
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/30/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/27/1996		
Remark:	carbon disulfide released into atmosphere during steaming of tank prior to disposal		

NRG019464

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9304489	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	JIM GLASS	Caller Agency:	ERIE CO. EMERGENCY SVCS.
Caller Phone:	(716) 898-3696	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M CORPORATION		
Address:	305 SAYWER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. No DEC Response. No corrective action required.		
Spill Closed Dt:	07/12/1993		
Spill Cause:	Human Error	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/09/1993 16:30	Reported to Dept:	07/09/1993 16:41
Cleanup Ceased:	07/12/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/12/1993		
Remark:	EXCEEDED AIR PERMIT FOR SULFUR DIOXIDE.		

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9313853	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	KAH	Spill Type:	Facility
Caller Name:	BOB SIEGEL	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 778-6130	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. No DEC Response. No corrective action required.		
Spill Closed Dt:	02/24/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	02/24/1994 09:50	Reported to Dept:	02/24/1994 11:29
Cleanup Ceased:	02/24/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/03/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/24/1994		
Remark:	PIPE THEY WERE PUMPING THROUGH FAILED.		

NRG019466

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9315338	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MIKE FALCO	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 778-4403	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. No DEC Response. No corrective action required.		
Spill Closed Dt:	03/29/1994	Resource Affected:	Air
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	03/28/1994 17:53
Spill Date:	03/28/1994 16:30		
Cleanup Ceased:	03/29/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/31/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/29/1994		
Remark:	AIR RELEASE OF 2000 LBS. EACH OF CARBON DISULFIDE AND HYDROGEN DISULFIDE.		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9315495	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MIKE FALSO	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 738-1451	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/01/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	03/30/1994 12:00	Reported to Dept:	03/30/1994 19:59
Cleanup Ceased:	04/01/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/03/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/05/1994		
Remark:	SOLVENT RECOVERY PROCESS KEEPS FAILING. RELEASE OF 900 LBS. EACH OF HYDROGEN SULFIDE AND CARBON DISULFIDE.		

NRG019468

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9400025	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	HAZEN EL-GAMAL	Caller Agency:	3M CORP.
Caller Phone:	(612) 778-7848	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 871-6281
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/04/1994	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/01/1994 13:20
Spill Date:	04/01/1994 11:30		
Cleanup Ceased:	04/04/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/11/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	04/05/1994		
Remark:	900 LBS. EACH OF CARBON DISULFIDE AND HYDROGEN SULFIDE RELEASED TO AIR.		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9400067	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	BOB FIEGEL	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 739-0011	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 648-2040
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/04/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/01/1994 12:00	Reported to Dept:	04/02/1994 11:19
Cleanup Ceased:	04/04/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/11/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/05/1994		
Remark:	RELEASE OF CARBON DISULFIDE 580 LBS. OVER PERMITTED LIMIT.		

NRG019470

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9400080	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	TERRY HUHENSTEIN	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 770-6334	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/04/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/02/1994 12:00	Reported to Dept:	04/03/1994 11:51
Cleanup Ceased:	04/04/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/11/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/05/1994		
Remark:	AIR RELEASE OF CARBON DISULFIDE 1000 LBS. OVER PERMITTED LIMIT.		

L93
NE
1/2-1
Higher

3-M O'CELLO PLANT
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102173961
N/A

NRG019471

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3-M O'CELLO PLANT (Continued)

S102173961

SPILLS:

Facility ID:	9101014	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	MARLENE KONIECZSY	Caller Agency:	3-M O'CELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3-M O'CELLO		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	04/29/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/25/1991 16:31
Spill Notifier:	Responsible Party		
Spill Date:	04/25/1991 16:00		
Cleanup Ceased:	04/29/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/29/1991		
Remark:	AIR RELEASE FOLLOWUP REFERRED TO DIV. AIR RESOURCES HENRY SANDANATO		

**L94
NE
1/2-1
Higher**

**OCELLO
305 SAWYER AVE
TONAWANDA, NY**

**LUST
NY Spills**

**S102174432
N/A**

LUST:

Facility ID:	9008529	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	HERBERT FEDER	Caller Agency:	OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	OCELLO		
Address:	305 SAWYER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	11/05/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/05/1990 09:10
Spill Notifier:	Responsible Party		
Spill Date:	11/05/1990 08:42		
Cleanup Ceased:	11/05/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		

NRG019472

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

OCELLO (Continued)

S102174432

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 11/21/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/03/1990
 Remark: UNKNOWN SOURCE CAUSED FIRE. DUCT CARRING GAS BURNT THRU CAUSING RELEASE. HYDROGEN SULFIDE & CARBON DISULFIDE COMBINED CAUSING RELEASE OF SO2.

SPILLS:

Facility ID:	9112462	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	MARLENE KONEICZNY	Caller Agency:	3M OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M OCELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.		
Spill Closed Dt:	04/10/1992	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	03/06/1992 15:03
Spill Date:	02/17/1992 09:00		
Cleanup Ceased:	04/10/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/13/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/12/1992		
Remark:	PUMP SEAL FAILED LEAKED ETHYLENE GLYCOL TO PAVEMENT		

L95
NE
1/2-1
Higher

GENERAL MILLS INC
305 SAWYER AVE
TONAWANDA, NY 14150

FINDS 1000212496
RCRIS-LQG NYD002127124
TRIS
TSCA
CERC-NFRAP
NY Spills

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	THE SLUDGE LAGOON IS ALLEGED TO CONTAIN A SULFUR SLUDGE AND SODIUM SULFATE. POSSIBILITY OF OTHER CHEMICALS USED ON SITE SUCH AS HYDRAZINE, SODIUM HYDROXIDE, SULFURIC ACID AND CARBON DISULFIDE PRESENT IN THE LAGOON. CHROMIUM MAY BE PRESENT		

CERCLIS-NFRAP Assessment History:

Assessment:	PRELIMINARY ASSESSMENT	Completed:	03/24/86
-------------	------------------------	------------	----------

NRG019473

MAP FINDINGS

Map ID
Direction
Distance
Elevation

EDR ID Number
EPA ID Number

GENERAL MILLS INC (Continued)

1000212496

Assessment: SCREENING SITE INSPECTION Completed: 05/30/86
 Assessment: DISCOVERY Completed: 02/17/86

CERCLIS-NFRAP Alias Name(s):
 O-CEL-O PRODUCTS

RCRIS:

Owner: 3M
 (612) 778-5380

Contact: HERBERT FEDER
 (716) 876-1596

Record Date: 06/21/94

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	5146.20	D008	260.00
D009	260.00	D028	400.00
D039	2836.20	F005	400.00
P022	1032935.78		

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)
- Civil judicial and administrative enforcement case against facility (under DOCKET)

NRG019474

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GENERAL MILLS INC (Continued)

1000212496

SPILLS:

Facility ID:	8706914	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	GENERAL MILLS		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	11/16/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/05/1987 15:40
Spill Notifier:	Responsible Party		
Spill Date:	11/13/1987 08:15		
Cleanup Ceased:	11/16/1987		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/16/1987		
Remark:	Not reported		

L96
NE
1/2-1
Higher

O-CEL-O SPONGE PLANT
305 SAWYER AVE
TONAWANDA, NY 14150

SHWS

S101008691
N/A

NRG019475

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O SPONGE PLANT (Continued)

S101008691

SHWS:

Facility ID:	915148	EPA ID:	Not reported
Owner:	3M, O-Cel-O Sponge Co. 305 Sawyer Ave Tonawanda, NY 14150 - 5102		
Owner Telephone:	Not reported		
Operator:	O-Cel-O Sponge Co., Div. of Gen. Mills 305 Sawyer Ave. Tonawanda, NY		
Contact:	Not reported	Telephone	Not reported
Site Classification:	Does not present a significant threat to the public health or the environment - action may be deferred.		
Region:	9		
Site Type:	Dump		
Acres:	Not reported	User:	O-Cel-O Sponge Co., Div. of Gen. Mills
HW Started:	1950's	HW Ended:	Present
HW Disposed:	Carbon Disulfide (F005)		
Units:	Unknown		
Air Data:	Unavailable	Surf. Water Data:	Unavailable
Gmd. Water Data:	Available	Soil Data:	Available
Sediment Data:	Unavailable		
Ground Water Standards Contravention:	Yes		
Drinking Water Standards Contravention:	No		
Surface Water Standards Contravention:	No		
Air Standards Contravention:	No		
Enforcement Status:	Order Has Been Signed	Legal Action:	No
State Action:	Yes	Fed Action:	No
Remedial Action:	Under Design		
Remed action type:	IRM Soil Removal		
Soil Type:	Not reported		
Gmd Water Depth:	Not reported		
Assessment of Environmental Problems:	Potential contamination of groundwater from leaching of carbon disulfide impregnated soils and potential for wetland contamination.		
Assessment of Health Problems:	Previous remedial activities in 1991 and 1992 have removed some carbon disulfide contaminated soils to a depth of 1 to 1.5 meters. This action has removed the potential for exposure by direct contact and inhalation. The installation of additional monitoring wells in a downgradient position will be necessary to determine the impact to groundwater and to ensure that contaminated groundwater does not migrate off-site. The area is served by public water.		

L97
NE
1/2-1
Higher

O-CELL-O
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102177491
N/A

NRG019476

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

O-CELL-O (Continued)

S102177491

SPILLS:

<p>Facility ID: 9006754 Facility Contact: Not reported Investigator: MF Caller Name: MARLENE KONIECZNY Caller Phone: (716) 876-1596 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: O-CELL-O Address: 305 SAWYER AVENUE TONAWANDA, NY 14150 Spill Class: Not reported Spill Closed Dt: 09/19/1990 Spill Cause: Human Error Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 09/19/1990 13:00 Cleanup Ceased: 09/19/1990 Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 10/01/1990 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 09/19/1990 Remark: UPSET DURING ACID BASE REACTION. PROBLEM CONTINUING.</p>	<p>Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: O-CELL-O Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 876-1596 Resource Affected: Air Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 09/19/1990 13:48</p>
--	--

L98
NE
1/2-1
Higher

O-CEL-O 3M
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102173910
N/A

NRG019477

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O 3M (Continued)

S102173910

SPILLS:

Facility ID:	9103324	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	JOHN HUNTER	Caller Agency:	3M
Caller Phone:	(612) 778-5251	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	O'CELLO 3-M		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/22/1992		
Spill Cause:	Housekeeping	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	06/01/1991 12:00	Reported to Dept:	06/21/1991 10:30
Cleanup Ceased:	05/22/1992		
Last Inspection:	12/05/1991		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/13/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/25/1991		
Remark:	SITE ASSESMENT FOUND OIL CONTAMINATION IN FORMER DRUM STORAGE AREA HAZARDOUS WASTE REMEDIATION IS ALSO INVOLVED WITH THIS SITE		

L99
NE
1/2-1
Higher

3-M
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102174498
N/A

NRG019478

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site _____ Database(s) _____ EDR ID Number
EPA ID Number

3-M (Continued)

S102174498

SPILLS:

Facility ID:	9200491	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAVID SCHUTT	Caller Agency:	3-M ST PAUL
Caller Phone:	(612) 778-5563	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3-M		

Address 305 SAWYER AVENUE
TONAWANDA, NY

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.

Spill Closed Dt:	04/13/1992	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/13/1992 15:07
Spill Date:	04/13/1992 14:15		
Cleanup Ceased:	04/13/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/10/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/13/1992		

Remark: DURING WASRE GAS PROCESSING ELECTRIC POWER IN PLANT FAILED FOR THREE MINUTES. LOST WATER FLOW TO STACK EMISSIONS SCRUBBER. GAS DISSIPATED. NRC CASE #114095. ERIE CO EMERG MANAGEMENT ALSO NOTIFIED.

L100
NE
1/2-1
Higher

O-CEL-O
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills
S101659612
N/A

LUST:

Facility ID:	8807687	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	TOM WANTUCK	Caller Agency:	NYS DEC
Caller Phone:	(716) 847-4590	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	O-CEL-O		

Address 305 SAWYER AVENUE
TONAWANDA, NY 14150

Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	01/11/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	DITCH	Reported to Dept:	12/20/1988 14:00
Spill Notifier:	DEC		
Spill Date:	12/20/1988 12:00		
Cleanup Ceased:	01/11/1989		

NRG019479

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O (Continued)

S101659612

Last Inspection: 01/11/1989
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 01/23/1989
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 12/21/1988
 Remark: O-CEL-O FLUSHED OILY MATERIAL FROM STORM CULVERT TO DITCH

SPILLS:

Facility ID:	9008670	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	MARLENE KONIECZ	Caller Agency:	O-CEL-O
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	O-CEL-O		
Address:	305 SAWYER AVENUE TONAWANDA, NY		

Spill Class: Not reported
 Spill Closed Dt: 11/13/1990
 Spill Cause: Equipment Failure
 Water Affected: Not reported
 Spill Notifier: Responsible Party
 Spill Date: 11/07/1990 12:00
 Cleanup Ceased: 11/07/1990

Resource Affected: Air
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 11/07/1990 21:10

Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 11/13/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/09/1990
 Remark: AIR RELEASE AT O-CEL-O PLANT

L101
NE
1/2-1
Higher

3M COMPANY
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S101175086
N/A

LUST:

Facility ID:	9407824	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	BOB SIGEL	Caller Agency:	3M COMPANY
Caller Phone:	(612) 778-6130	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 871-6281

NRG019480

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M COMPANY (Continued)

S101175086

Spiller: 3M COMPANY
 Address: 305 SAWYER AVENUE
 TONAWANDA, NY
 Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
 Willing Responsible Party. Corrective action taken.
 Spill Closed Dt: 09/12/1994
 Spill Cause: Other
 Resource Affected: Air
 Water Affected: Not reported
 Spill Source: Other Commercial/Industrial
 Spill Notifier: Responsible Party
 PBS Number: Not reported
 Spill Date: 09/12/1994 15:30
 Reported to Dept: 09/12/1994 16:52
 Cleanup Ceased: 09/12/1994
 Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 09/15/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 09/13/1994
 Remark: FIRE IN CARBON BED RELEASED FUMES TO AIR

NRG019481

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M COMPANY (Continued)

S101175086

SPILLS:

Facility ID:	9310137	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DAVID SCHUTT	Caller Agency:	3M COMPANY
Caller Phone:	(612) 778-5563	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M COMPANY		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	06/10/1994		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	11/19/1993 14:00	Reported to Dept:	11/19/1993 16:09
Cleanup Ceased:	11/19/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/08/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/23/1993		
Remark:	LINE HOSE FAILED. SPILL ON CONCRETE PAD.		

L102
NE
1/2-1
Higher

AMHERST PAINTING INC
318 SAWYER AVE - WEST WING
TONAWANDA, NY 14150

FINDS 1000890447
RCRIS-LQG NY0000365775

RCRIS:

Owner: AMHERST PAINTING INC
(716) 874-9074

Contact: MICHAEL BOUBARIS
(716) 874-9074

Record Date: 06/09/94

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

L103
NE
1/2-1
Higher

WARD TRUCKING
318 SAWYER AVE
TONAWANDA, NY

NY Spills S102561477
N/A

NRG019482

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

WARD TRUCKING (Continued)

S102561477

SPILLS:

Facility ID:	9701254	Region of Spill:	9
Facility Contact:	N/A	Facility Tele:	Not reported
Investigator:	Not reported	Spill Type:	UST
Caller Name:	ANONYMOUS	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	SAME	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	N/A	Spiller Phone:	Not reported
Spiller:	WARD TRUCKING		
Address:	N/A		
	N/A		

Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Cause:	Housekeeping	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/28/1997 17:50
Spill Notifier:	Citizen		
Spill Date:	04/01/1997 12:00		
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/28/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/28/1997		
Remark:	DRUM ON DOCK CONTAINING DAMAGED BOX OF ORGANIC PEROXIDE HAS BEEN THERE APPROX 1 WEEK BETWEEN DOORS 3+4 ALSO DRUM IN GARAGE BY DOORS		

**L104
NE
1/2-1
Higher**

**NYSTA AMHERST PAINTING
318 SAWYER RD
TONAWANDA, NY 14150**

**RCRIS-SQG 1000121006
FINDS NYD046769154**

RCRIS:

Owner: AMHERST PAINTING OF WESTERN NY
(716) 874-9074

Contact: AHMAD IBRAHIM
(518) 382-8029

Record Date: 08/18/92

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**105
NE
1/2-1
Higher**

**SCHWABEL FABRICATING CO. INC.
349 SAWYER AVE.
TONAWANDA, NY 14150**

**FINDS 1000551388
NYD986926475**

NRG019483

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

M106 NNW 1/2-1 Higher	ATLANTIC REFINING 3732 RIVER RD TONAWANDA, NY	LUST	S100669143 N/A
--	--	-------------	---------------------------------

LUST:

Facility ID: 8808535 Facility Contact: Not reported Investigator: MJH Caller Name: SAM KEPPLER Caller Phone: (716) 874-6025 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: ATLANTIC REFINING Address: 3732 RIVER ROAD TONAWANDA, NY 14150 Spill Class: Not reported Spill Closed Dt: 02/01/1989 Spill Cause: Other Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 01/27/1989 12:00 Cleanup Ceased: 02/01/1989 Last Inspection: 01/27/1989 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 02/03/1989 Corrective Action Plan Submitted: Not reported Date Spill Entered in Computer Data File: 02/01/1989 Remark: OVER FILL OF TANK TRUCK AT LOADING RACK	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: ATLANTIC REFINING Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 874-6025 Resource Affected: On Land Spill Source: Major Facility 400,000 gallons PBS Number: Not reported Reported to Dept: 01/27/1989 14:11
---	---

M107 NNW 1/2-1 Higher	A R & M CORP TONAWANDA TERM 3733 RIVER RD TONAWANDA, NY 14150	FINDS RCRIS-LQG	1000137252 NYD059957324
--	--	----------------------------------	--

RCRIS:

Owner: ATLANTIC REFINING & MARKETING
(212) 555-1212

Contact: JAMES PITTS
(215) 339-2120

Record Date: 08/18/80

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

M108 NNW 1/2-1 Higher	VAN DE WATER TREATMENT PLT 3750 RIVER RD TONAWANDA, NY 14150	FINDS RCRIS-LQG	1000457314 NYD980529358
--	---	----------------------------------	--

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

VAN DE WATER TREATMENT PLT (Continued)

1000457314

RCRIS:

Owner: ERIE COUNTY WATER AUTH
(716) 684-1510

Contact: JAY MEYERS
(716) 684-1510

Record Date: 02/28/91

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**M109
NNW
1/2-1
Higher**

**SUNMARK PETROLEUM MARKETING TERMINAL
3755 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000296072
RCRIS-LQG NYD980646665**

RCRIS:

Owner: Not reported

Contact: CHARLES BURNETT
(716) 877-2285

Record Date: 08/18/80

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**M110
NNW
1/2-1
Higher**

**GOETZ OIL
3755 RIVER RD
TONAWANDA, NY**

**NY Spills S102175149
N/A**

NRG019485

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ OIL (Continued)

S102175149

SPILLS:

Facility ID:	8600903	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	GOETZ OIL		
Address:	3755 RIVER RD TONAWANDA		
Spill Class:	Not reported		
Spill Closed Dt:	05/19/1986	Resource Affected:	On Land
Spill Cause:	Housekeeping	Spill Source:	Major Facility 400,000 gallons
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	DEC	Reported to Dept:	05/01/1986 10:00
Spill Date:	05/01/1986 10:00		
Cleanup Ceased:	05/19/1986		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/10/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/29/1986		
Remark:	FACILITY CLEANING UP. DEC MAY REFER TO LEGAL.		

M111
NNW
1/2-1
Higher

SUN REFINING
3755 RIVER RD
TONAWANDA, NY

NY Spills

S102175363
N/A

NRG019486

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

SUN REFINING (Continued)

S102175363

SPILLS:

<p>Facility ID: 8604694 Facility Contact: Not reported Investigator: MJH Caller Name: Not reported Caller Phone: Not reported Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: SUN REFINING Address: 3755 RIVER ROAD TONAWANDA, N. Y. 14150 Spill Class: Not reported Spill Closed Dt: 07/20/1987 Spill Cause: Equipment Failure Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 10/22/1986 09:00 Cleanup Ceased: 07/20/1987 Last Inspection: 06/15/1987 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 07/20/1987 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 10/22/1986 Remark: MAJOR FACILITY LICENSE 09-1360</p>	<p>Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: Not reported Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 877-7846 Resource Affected: On Land Spill Source: Major Facility 400,000 gallons PBS Number: Not reported Reported to Dept: 10/22/1986 09:40</p>
---	---

**M112
NNW
1/2-1
Higher**

**ARCO
3773 RIVER ROAD
TONAWANDA, NY 14150**

FINDS

**1000549989
NYD986868354**

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

**N113
NE
1/2-1
Higher**

**ROADWAY TRANSPORTATION
383 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102175833
N/A**

NRG019487

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY TRANSPORTATION (Continued)

S102175833

SPILLS:

Facility ID:	8705404	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-1170
Spiller:	ROADWAY TRANSPORTATION		
Address:	383 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	09/28/1987		
Spill Cause:	Deliberate	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Citizen	PBS Number:	Not reported
Spill Date:	09/24/1987 12:00	Reported to Dept:	09/28/1987 10:15
Cleanup Ceased:	09/28/1987		
Last Inspection:	09/28/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/02/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/01/1987		
Remark:	ROADWAY CLEANED DITCHES ON THEIR PROPERTY AND DISPOSED OF SOIL ON BACK OF PROPERTY		

**N114
NE
1/2-1
Higher**

**ROADWAY EXPRESS INC
383 SAWYER AVE
TONAWANDA, NY 14150**

**RCRIS-SQG 1000193266
FINDS NYD071475818
UST
LUST
NY Spills**

RCRIS:

Owner: ROADWAY SERVICES
(330) 384-1717

Contact: LORI LEONTI
(330) 384-1717

Record Date: 10/04/96

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

LUST:

Facility ID:	9609817	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	JEFF LAWSON	Caller Agency:	ROADWAY EXPRESS
Caller Phone:	(330) 258-2443	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported

NRG019488

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	JIM LEFAUVE	Caller Agency:	JM LEFAUVE CONSTRUCTION
Caller Phone:	(716) 773-2584	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-1170
Spiller:	ROADWAY		
Address:	383 SAWYER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	Groundwater
Spill Closed Dt:	12/28/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	08/27/1990 10:00
Spill Notifier:	Other		
Spill Date:	08/27/1990 09:00		
Cleanup Ceased:	12/28/1990		
Last Inspection:	12/28/1990		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	12/28/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	08/29/1990		
Remark:	FAILED TANK AT ROADWAY		

Facility ID:	9507129	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	ALAN CUBBERLEY	Caller Agency:	ROADWAY
Caller Phone:	(216) 258-2571	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-1170
Spiller:	ROADWAY EXPRESS		
Address:	383 SAWYER AVENUE TONAWANDA		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/10/1995	Resource Affected:	On Land
Spill Cause:	Tank Overfill	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	09/12/1995 09:06
Spill Date:	09/12/1995 08:00		
Cleanup Ceased:	11/10/1995		
Last Inspection:	11/02/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/28/1995		
Corrective Action Plan Submitted:	Not reported		

NRG019490

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Date Spill Entered In Computer Data File: 09/11/1995
Remark: SADDLE TANK OVERFILLED, CLEANUP UNDERWAY

SPILLS:

Facility ID:	9213803	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	ELLEN BANNER	Caller Agency:	USEPA - EDISON, NJ
Caller Phone:	(908) 321-4348	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ROADWAY EXPRESS		
Address:	Not reported		
	Not reported		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	10/12/1995	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Federal Government	Reported to Dept:	03/16/1993 14:33
Spill Date:	03/16/1993 03:00		

Cleanup Ceased: 10/12/1995
Last Inspection: Not reported
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False

Spill Record Last Update: 10/16/1995
Corrective Action Plan Submitted: Not reported

Date Spill Entered in Computer Data File: 03/17/1993
Remark: 4 30-GALLON DRUMS, UNK. NUMBER OF WHICH ARE LEAKING. NRC #162435, CONTRACTOR ENROUTE TO COMPLETE CLEANUP. CHEMTREC NOTIFIED.

NRG019491

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9312909	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MR. DALVIA	Caller Agency:	USEPA
Caller Phone:	(908) 548-8730	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(908) 548-8730
Spiller:	ROADWAY EXPRESS		
Address:	383 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/18/1994	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Federal Government	Reported to Dept:	02/02/1994 07:59
Spill Date:	02/01/1994 18:00		
Cleanup Ceased:	04/18/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/21/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/03/1994		
Remark:	BAG BROKE OPEN IN BACK OF TRUCK.		

NRG019492

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9504240	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	GERALD MANZELLA	Caller Agency:	ROADWAY EXPRESS
Caller Phone:	(716) 877-1171	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-1170
Spiller:	ROADWAYEXPRESS		
Address:	383 SAWYER AVENUE TONAWANDA		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/10/1995	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	07/09/1995 00:44
Spill Date:	07/08/1995 22:20		
Cleanup Ceased:	07/09/1995		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/20/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/10/1995		
Remark:	BAG OPENED INSIDE TRUCK		

NRG019493

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9507916	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	KAH	Spill Type:	Facility
Caller Name:	LARRY WANAT	Caller Agency:	ROADWAY EXPRESS
Caller Phone:	(716) 877-1170	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ROADWAY EXPRESS		
Address:	Not reported		
	Not reported		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/13/1995		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	09/28/1995 02:00	Reported to Dept:	09/28/1995 07:08
Cleanup Ceased:	10/13/1995		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/16/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/28/1995		
Remark:	PALLET HIT BY FORKLIFT CAUSING APPROX. 1 GAL. OF METHOXYCHLOR TO SPILL TO GROUND.		

NRG019494

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

PBS UST:		CBS Number:	Not reported
Facility ID:	9-033391	SWIS ID:	1416
Town:	Not reported	Location:	Not reported
Telephone:	(716) 877-1170		
Operator:	R E MCMASTER/TERMINAL MANAGER		
Contact:	Not reported		
Emergency Contact:	R E MCMASTER/TERMINAL MANAGER, (716) 877-1170		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	5	Old PBS Num:	Not reported
Owner:	ROADWAY EXPRESS INC 1077 GORGE BLVD AKRON, OH 44309 (216) 384-1717		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	ROADWAY EXPRESS INC 1077 GORGE BLVD PO BOX 471 OH 44309 (216) 384-1717 ATTN: LISA M GERBEC		
Facility Status:	Inactive	Total Capacity:	11000
Certification:	10/15/1996	Expiration:	10/17/1901
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	11/72
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	STEEL/IRON
Tank External:	PAINTED/ASPHALT COATING		
Pipe External:	NONE		
Second Containment:	NONE		
Leak Detection:	OTHER		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	10/92	Next Test Date:	N.T.R
Date Closed:	09/96	Test Method:	LIQUID MANAGER
Database Type:	Not reported		

NRG019495

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9-033391	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 877-1170	Location:	Not reported
Operator:	R E MCMASTER/TERMINAL MANAGER		
Contact:	Not reported		
Emergency Contact:	R E MCMASTER/TERMINAL MANAGER, (716) 877-1170		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	5	Old PBS Num:	Not reported
Owner:	ROADWAY EXPRESS INC 1077 GORGE BLVD AKRON, OH 44309 (216) 384-1717		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	ROADWAY EXPRESS INC 1077 GORGE BLVD PO BOX 471 OH 44309 (216) 384-1717 ATTN: LISA M GERBEC		
Facility Status:	Inactive	Total Capacity:	10000
Certification:	10/15/1996	Expiration:	10/17/1901
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	11/72
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	STEEL/IRON
Tank External:	PAINTED/ASPHALT COATING		
Pipe External:	NONE		
Second Containment:	NONE		
Leak Detection:	OTHER		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	10/92	Next Test Date:	N.T.R
Date Closed:	09/96	Test Method:	LIQUID MANAGER
Database Type:	Not reported		

NRG019496

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9-033391	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 877-1170	Location:	Not reported
Operator:	R E MCMASTER/TERMINAL MANAGER		
Contact:	Not reported		
Emergency Contact:	R E MCMASTER/TERMINAL MANAGER, (716) 877-1170		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	5	Old PBS Num:	Not reported
Owner:	ROADWAY EXPRESS INC 1077 GORGE BLVD AKRON, OH 44309 (216) 384-1717		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	ROADWAY EXPRESS INC 1077 GORGE BLVD PO BOX 471 OH 44309 (216) 384-1717 ATTN: LISA M GERBEC		
Facility Status:	Inactive	Total Capacity:	1000
Certification:	10/15/1996	Expiration:	10/17/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	3	Install Date:	11/72
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019497

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9-033391	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 877-1170	Location:	Not reported
Operator:	R E MCMASTER/TERMINAL MANAGER		
Contact:	Not reported		
Emergency Contact:	R E MCMASTER/TERMINAL MANAGER, (716) 877-1170		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	5	Old PBS Num:	Not reported
Owner:	ROADWAY EXPRESS INC 1077 GORGE BLVD AKRON, OH 44309 (216) 384-1717		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	ROADWAY EXPRESS INC 1077 GORGE BLVD PO BOX 471 OH 44309 (216) 384-1717 ATTN: LISA M GERBEC		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	10/15/1996	Expiration:	10/17/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	4	Install Date:	01/60
Product Stored:	LEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019498

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROADWAY EXPRESS INC (Continued)

1000193266

Facility ID:	9-033391	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 877-1170	Location:	Not reported
Operator:	R E MCMASTER/TERMINAL MANAGER		
Contact:	Not reported		
Emergency Contact:	R E MCMASTER/TERMINAL MANAGER, (716) 877-1170		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	5	Old PBS Num:	Not reported
Owner:	ROADWAY EXPRESS INC 1077 GORGE BLVD AKRON, OH 44309 (216) 384-1717		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	ROADWAY EXPRESS INC 1077 GORGE BLVD PO BOX 471 OH 44309 (216) 384-1717 ATTN: LISA M GERBEC		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	10/15/1996	Expiration:	10/17/1991
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	5	Install Date:	01/60
Product Stored:	LEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

N115
NE
1/2-1
Higher

383 SAWYER AVE
383 SAWYER AVE
TONAWANDA, NY 14150

ERNS

94219782
N/A

N116
NE
1/2-1
Higher

383 SAWYER AVE
383 SAWYER AVE
TONAWANDA, NY 14150

ERNS

93000843
N/A

O117
NNW
1/2-1
Higher

ALLIED CORPORATION
3821 RIVER RD
TONAWANDA, NY 14150

FINDS
RCRIS-LQG
TSCA
CORRACTS
CERC-NFRAP

1000248673
NYD051816262

NRG019499

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ALLIED CORPORATION (Continued)

1000248673

CERCLIS-NFRAP Classification Data:

Site Incident Category: Not reported
Ownership Status: OTHER
EPA Notes: Not reported

Federal Facility: NO
NPL Status: NOT ON NPL

CERCLIS-NFRAP Assessment History:

Assessment: DISCOVERY
Assessment: PRELIMINARY ASSESSMENT
Assessment: SCREENING SITE INSPECTION

Completed: 04/01/80
Completed: 10/01/84
Completed: 05/31/85

CERCLIS-NFRAP Alias Name(s):

ALLIED CORP TONAWANDA A C POLYETHYLENE
ALLIED CHEM SITE 2
ALLIED CHEMICAL SPECIALTY CHEM DIV
ALLIED CHEM SITE 3

CORRACTS Data:

Prioritization: Low
Status: RCRA Facility Assessment Completed

RCRIS:

Owner: ALLIED CHEMICAL CORPORATION
(716) 877-6300

Contact: JACK HONEY
(716) 877-6300

Record Date: 08/18/80

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

O118
NNW
1/2-1
Higher

TONAWANDA COKE INC
3875 RIVER RD
TONAWANDA, NY 14150

FINDS
TRIS
SHWS
SWF/LF
NY Spills

1000160426
NYD088413877

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)
- Civil judicial and administrative enforcement case against facility (under DOCKET)

NRG019500

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE INC (Continued)

1000160426

SHWS:

Facility ID: 915055 EPA ID: NYD088413877

Owner: Tonawanda Coke Corporation
3875 River Road
Tonawanda, NY 14150

Owner Telephone: Not reported
Operator: Allied Chemical-Semet Solvay Div.
Not reported
Solvay, NY

Contact: Not reported Telephone: Not reported

Site Classification: Significant threat to the public health or environment - action required.

Region: 9
Site Type: Dump, Landfill

Acres: 160 User: Allied Chemical Corporation

HW Started: 1930 HW Ended: 1979

HW Disposed: Coal tar wastes including PAHs, Organic solvents, Cyanide, Heavy Metals, Phenols, Benzene

Units: unknown, unknown, unknown, unknown, unknown

Air Data: Unavailable Surf. Water Data: Unavailable

Gmnd. Water Data: Available Soil Data: Available

Sediment Data: Available

Ground Water Standards Contravention: Yes

Drinking Water Standards Contravention: No

Surface Water Standards Contravention: No

Air Standards Contravention: No

Enforcement Status: Negotiation In Progress Legal Action: No

State Action: Yes Fed Action: No

Remedial Action: None

Remed action type: none

Soil Type: Fill overlying dense silty clay, reddish

Gmnd Water Depth: 3 feet

Assessment of Environmental Problems:

Contamination of soils, sediment, surface water and groundwater have been documented at this site. This contamination may be affecting the adjacent Niagara River. Investigation into the extent of contamination across this entire site is needed.

Assessment of Health Problems:

Not reported

NRG019501

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE INC (Continued)

1000160426

LF:

Facility ID:	15S26	Telephone:	Not reported
DEC Region:	9	Permit #:	Not reported
Permit issue date:	Not reported	Permit Expires:	Not reported
Authrzd/Operate Dt:	Not reported	Constrct Perm #:	Not reported
Auth. to Construct:	Not reported	Const Permit Exp:	Not reported
Regulatory Status:	None	Receiving Waste:	False
Started Rec Waste:	Not reported	Stop Rec Waste:	Not reported
Aquifer:	none		
Date Ordered On Consent Signed:			Not reported
Accomplish Date Of Order:			Not reported
Inactive HWS:	True		Inactive HWS Num: 15055
Inactive HWS Class:	Significant threat to the public health or environment - action required.		
Waste type:	Not reported		
Owner Name:	Not reported	Owner Type:	Municipal
Mail Address:	Not reported		
Owner Phone Num:	Not reported	Operator Name:	Not reported
Ny Transverse Mercator Coordinates East:			179666
Ny Transverse Mercator Coordinates North:			4765700
Annual Report Submitted to ALB:			
1989:	False	1990:	False
1991:	False	1992:	False
1993:	False	1994:	False
1995:	False		
1996:	False		
Primary Liner:	Not reported	Secondary Liner:	Not reported
Annual Rprt Waived:	Not reported	Tiping Fee Rprtd:	Not reported

NRG019502

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE INC (Continued)

1000160426

SPILLS:

Facility ID:	9306743	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DICK COWAN	Caller Agency:	NYSDEC
Caller Phone:	(518) 457-7363	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-6222
Spiller:	TONAWANDA COKE CORP.		
Address:	3875 RIVER ROAD TONAWANDA, NY 14051		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/20/1993	Resource Affected:	On Land
Spill Cause:	Unknown	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	DEC	Reported to Dept:	09/01/1993 11:00
Spill Date:	08/10/1993 12:00		
Cleanup Ceased:	09/20/1993		
Last Inspection:	09/20/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/26/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/02/1993		
Remark:	DURING PBS INSPECTION, MR. COWAN DISCOVERED 20' X 15' AREA NEAR DIESEL TANK LOADING AREA THAT APPEARS TO BE CONTAMINATED.		

**O119
NNW
1/2-1
Higher**

**TONAWANDA COKE CORP
3875 RIVER RD
TONAWANDA, NY 14151**

**RCRIS-LQG 1000160428
CERC-NFRAP NYD088413877**

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS-NFRAP Assessment History:

Assessment:	DISCOVERY	Completed:	04/01/80
Assessment:	PRELIMINARY ASSESSMENT	Completed:	06/01/83

CERCLIS-NFRAP Alias Name(s):

TONAWANDA COKE SITE 2
TONAWANDA COKE SITE 3
ALLIED CORP BUFFALO COKE PLT

NRG019503

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
TONAWANDA COKE CORP (Continued)			1000160428
	RCRIS: Owner: TONAWANDA COKE CORPORATION (212) 555-1212 Contact: MARK KAMHOLZ (716) 876-6222 Record Date: 02/19/86 Classification: Large Quantity Generator Used Oil Recyc: No Violation Status: No violations found		
P120 ENE 1/2-1 Higher	SHANCO PLASTICS & CHEM. 2716 KENMORE AVE. TONAWANDA, NY 14190	FINDS TSCA	1000308479 NYD980753487
P121 ENE 1/2-1 Higher	CORSI FLEET SERVICE 2716 KENMORE AVE TONAWANDA, NY	NY Spills	S102173900 N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CORSI FLEET SERVICE (Continued)

S102173900

SPILLS:

Facility ID:	9102835	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	ANONYMOUS	Caller Agency:	CITIZEN
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	CORSI FLEET SERVICE		
Address:	2716 KENMORE AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/02/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Abandoned Drums	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	06/10/1991 14:15
Spill Notifier:	Citizen		
Spill Date:	06/01/1991 12:00		
Cleanup Ceased:	12/02/1991		
Last Inspection:	12/02/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/03/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/13/1991		
Remark:	50 DRUMS HAVE PETROLEUM AND PAINT WASTES SOME ARE LEAKING		

**P122
ENE
1/2-1
Higher**

**SHANCO PLASTIC
2716 KENMORE AVE
TONAWANDA, NY 14150**

**CERCLIS 1000308478
RCRIS-SQG NYD000512897
FINDS**

CERCLIS Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS Assessment History:

Assessment:	SCREENING SITE INSPECTION	Completed:	10/01/83
Assessment:	DISCOVERY	Completed:	11/01/81
Assessment:	PRELIMINARY ASSESSMENT	Completed:	10/01/83
Assessment:	SCREENING SITE INSPECTION	Completed:	10/01/85
Assessment:	PRELIMINARY ASSESSMENT	Completed:	03/09/87

CERCLIS Site Status:

EPA has conducted a preliminary assessment on this site and has determined that no further action is necessary and no hazard was identified

NRG019505

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SHANCO PLASTIC (Continued)

1000308478

RCRIS:

Owner: CORSI DEVINCENTS DEVELOPMENT
(716) 877-0855

Contact: FRANK CORSI
(716) 877-0855

Record Date: 08/07/91

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

P123
ENE
1/2-1
Higher

SYNRES CHEM CORP
2716 KENMORE AVE
TONAWANDA, NY 14150

FINDS 1000356389
CERC-NFRAP NYD980530018

CERCLIS-NFRAP Classification Data:

Site Incident Category: Not reported

Federal Facility: NO

Ownership Status: OTHER

NPL Status: NOT ON NPL

EPA Notes: SITE PRESENTLY A TOWING AND TRUCK REPAIR SHOP LOC IN AND INDUSTRIALIZED AREA OF BUFFALO, ERIE CNTY. CURRENTLY CALLED LARRY TRUCK REPAIR & OWNED BY LARRY LAPAGLIA. PURCHASED PROPERTY FROM SYNRES CHEMICAL CORP IN 1981. SITE INSP SEPTEM '83

CERCLIS-NFRAP Assessment History:

Assessment: DISCOVERY

Completed: 05/01/81

Assessment: PRELIMINARY ASSESSMENT

Completed: 05/30/86

CERCLIS-NFRAP Alias Name(s):

SHANCO PLASTICS

Q124
NE
1/2-1
Higher

CENTRAL TRANSPORT
454 SAWYER AVE
TONAWANDA, NY

LUST S100177376
NY Spills N/A

LUST:

Facility ID: 9104439

Region of Spill: 9

Facility Contact: Not reported

Facility Tele: Not reported

Investigator: JDC

Spill Type: Facility

Caller Name: MARSHALL KIMMONS

Caller Agency: MARSHAL TANK

Caller Phone: (716) 877-5660

Caller Extension: Not reported

Notifier Name: Not reported

Notifier Agency: Not reported

Notifier Phone: Not reported

Notifier Extension: Not reported

Spiller Contact: Not reported

Spiller Phone: (716) 874-7346

Spiller: CENTRAL TRANSPORT

Address: PO BOX 80
WARREN, MICHIGAN 48090

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 12/09/1994

Resource Affected: On Land

Spill Cause: Tank Failure

Spill Source: Other Commercial/Industrial

Water Affected: Not reported

PBS Number: Not reported

Spill Notifier: Other

Reported to Dept: 07/25/1991 11:15

Spill Date: 07/25/1991 10:45

Cleanup Ceased: 08/26/1994

Last Inspection: 12/09/1994

NRG019506

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CENTRAL TRANSPORT (Continued)

S100177376

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: True
 Spill Record Last Update: 12/22/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 07/25/1991
 Remark: CONTAMINATED SOILS AT TANK REMOVAL

SPILLS:

Facility ID:	9612250	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	UST
Caller Name:	DISPATCHER GRELISER	Caller Agency:	TONAWANDA PD
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	BOB CATLIN	Spiller Phone:	(800) 423-9930
Spiller:	PARA-MARINE INC.		
Address:	1001 THOMPSON NUSERY ROAD LAKE WALES, FL 33853		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Unable/unwilling Responsible Party. Corrective action taken. (ISR)		
Spill Closed Dt:	02/28/1997		
Spill Cause:	Traffic Accident	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Commercial Vehicle
Spill Notifier:	Police Department	PBS Number:	Not reported
Spill Date:	01/13/1997 12:00	Reported to Dept:	01/13/1997 12:42
Cleanup Ceased:	Not reported		
Last Inspection:	01/13/1996		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/01/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	01/13/1997		
Remark:	SEMI IN A DITCH. FLORIDA PLATE #A9528H. TWO 100 GALLON SADDLE TANKS JUST FILLED. STEADY LEAK. FIRE DEPARTMENT ON SCENE.		

P125 DIVISION TIRE CO INC
 ENE 2750 KENMORE AVE
 1/2-1 TONAWANDA, NY 14150
 Higher

RCRIS-SQG 1001090187
 NYR000020248

NRG019507

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

DIVISION TIRE CO INC (Continued)

1001090187

RCRIS:

Owner: DIVISION TIRE CO INC
(716) 877-4545

Contact: DANIEL WIK
(716) 434-2885

Record Date: 02/28/96

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**R126
ENE
1/2-1
Higher**

**MECHTLER'S - JAG SHOP
SHERIDAN / KENMORE
TONAWANDA, NY**

NY Spills

**S102174987
N/A**

SPILLS:

Facility ID:	9210831	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	MORSE BURFIELD	Caller Agency:	CITIZEN
Caller Phone:	(716) 874-3260	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-8435
Spiller:	STEVEN MECHTLER		
Address:	574 SHERIDAN DRIVE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	01/05/1993		
Spill Cause:	Deliberate	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Citizen	PBS Number:	Not reported
Spill Date:	12/15/1992 14:50	Reported to Dept:	12/15/1992 15:10
Cleanup Ceased:	01/05/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/29/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	12/18/1992		
Remark:	CALLER WITNESSED EMPLOYEE DUMPING 5-GAL. BUCKET OF OIL INTO USED TIRE PILE. SOIL ON-SITE COVERED W/PLASTIC.		

**Q127
NE
1/2-1
Higher**

**QUACKENBUSH CO INC WAREHOUSE
483 SAWYER AVE
TONAWANDA, NY 14150**

**RCRIS-SQG
FINDS**

**1000912166
NY0000477000**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

QUACKENBUSH CO INC WAREHOUSE (Continued)

1000912166

RCRIS:

Owner: WILLIAM DARIN
(716) 873-8892

Contact: KEVIN WIESS
(716) 886-4355

Record Date: 07/25/94

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

P128
ENE
1/2-1
Higher

O & K TRUCK REPAIRS LTD
2760 KENMORE AVE
TONAWANDA, NY 14150

FINDS 1000121308
RCRIS-LQG NYD106811110

RCRIS:

Owner: SULEV OUN
(212) 555-1212

Contact: OUN SULEV
(716) 874-5450

Record Date: 11/21/86

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

R129
ENE
1/2-1
Higher

MECHTLERS FOREIGN CAR REPAIR
574 SHERIDAN DR
TONAWANDA, NY 14150

FINDS 1000871647
RCRIS-LQG NY0000081646

RCRIS:

Owner: STEPHEN METCHLER
(716) 695-2347

Contact: STEPHEN MECHTLER
(716) 877-8435

Record Date: 02/15/95

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

S130
ENE
1/2-1
Higher

B&W HEAT TREATING CO. INC.
2780 KEMORE AVENUE
TONAWANDA, NY 14150

RCRIS-SQG 1000116952
FINDS NYD002122521

NRG019509

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

B&W HEAT TREATING CO. INC. (Continued)

1000116952

RCRIS:

Owner: ESTATE OF WILLIAM WISSMAN
(212) 555-1212

Contact: CLIFFORD CALVELLO
(716) 876-8184

Record Date: 03/09/87

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

T131
NNW
1/2-1
Higher

**SIVACO 3937 RIVER ROAD
3937 RIVER RD
TONAWANDA, NY**

NY Spills

S102178764
N/A

SPILLS:

Facility ID:	9406083	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO
Caller Phone:	(716) 894-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 894-5681
Spiller:	SIVACO NATIONAL WIRE		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release that creates potential for fire or hazard. (Highly Improbable)		
Spill Closed Dt:	08/05/1994	Resource Affected:	Surface Water
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	SNAKE CREEK	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/04/1994 09:01
Spill Date:	08/03/1994 05:00		
Cleanup Ceased:	08/05/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/12/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	08/05/1994		
Remark:	RUPTURED LINE DURING DEMOLITION		

T132
NNW
1/2-1
Higher

**SIVACO NY COMPANY
3937 RIVER RD
TONAWANDA, NY**

LUST
NY Spills

S100781650
N/A

LUST:

Facility ID: 9008357 Region of Spill: 9

NRG019510

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

SIVACO NY COMPANY (Continued)

S100781650

Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO NY
Caller Phone:	(716) 874-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-5681
Spiller:	SIVACO NY COMPANY		
Address:	3937 RIVER ROAD TONAWANDA, NY 14151		
Spill Class:	Not reported		
Spill Closed Dt:	10/31/1990		
Spill Cause:	Tank Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/31/1990 05:20	Reported to Dept:	10/31/1990 08:37
Cleanup Ceased:	10/31/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/03/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/31/1990		
Remark:	STORAGE TANK SPLIT, WATER/ACID WENT INTO DIKED AREA. SYSTEM SHUT DOWN. PRODUCT WILL BE PUMPED INTO ANOTHER TANK. DIKE AREA TO BE CLEANED.		

NRG019511

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO NY COMPANY (Continued)

S100781650

SPILLS:

Facility ID:	9012166	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	RON BUCHNER	Caller Agency:	SIVACO NY
Caller Phone:	(716) 874-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-5681
Spiller:	SIVACO NEW YORK		
Address:	3937 RIVER ROAD TONAWANDA, NY 14151		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	04/12/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	02/22/1991 10:41
Spill Notifier:	Responsible Party		
Spill Date:	02/22/1991 10:00		
Cleanup Ceased:	03/20/1991		
Last Inspection:	02/25/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/12/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/01/1991		
Remark:	HOSE FITTING BROKE ON EQUIPMENT		

**T133
NNW
1/2-1
Higher**

**NEW YORK WIRE MILLS CORP
3937 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000136922
RCRIS-LQG NYD071478044
TRIS
LUST**

RCRIS:

Owner: Not reported
Contact: ALBERT LYTLE
(716) 874-5681
Record Date: 03/22/82
Classification: Large Quantity Generator
Used Oil Recyc: No
Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

LUST:

Facility ID:	8900993	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	BOB STUFF	Caller Agency:	CITIZEN
Caller Phone:	(716) 692-2015	Caller Extension:	Not reported

NRG019512

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NEW YORK WIRE MILLS CORP (Continued)

1000136922

Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NEW YORK WIRE MILL		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Not reported		
Spill Closed Dt:	05/05/1989		
Spill Cause:	Other	Resource Affected:	In Sewer
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Citizen	PBS Number:	Not reported
Spill Date:	05/01/1989 11:00	Reported to Dept:	05/01/1989 12:45
Cleanup Ceased:	05/05/1989		
Last Inspection:	05/02/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/11/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/02/1989		
Remark:	INADEQUATE FACILITY FOR RIDDING FERRIC HYDROXIDE AFTER MANUFACTURING PROCESS. NON COMPLIANCE WITH SPDES REGULATION.		

T134
NNW
1/2-1
Higher

SIVACO NEW YORK INC
3937 RIVER RD
TONAWANDA, NY

NY Spills

S102178074
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO NEW YORK INC (Continued)

S102178074

SPILLS:

Facility ID:	9306513	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO
Caller Phone:	(716) 874-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	SIVACO		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/17/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/27/1993 12:31
Spill Date:	08/27/1993 11:30		
Cleanup Ceased:	09/17/1993		
Last Inspection:	08/27/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	08/27/1993		
Remark:	SULFURIC ACID PIPE BROKE. CONTAINED ON PAVEMENT		

**S135
ENE
1/2-1
Higher**

**ERIE TRAILER REPAIR CO
2801 KENMORE AVE
TONAWANDA, NY 14150**

**RCRIS-SQG 1000556698
FINDS NYD986992733**

RCRIS:

Owner: UHAUL INTERNATIONAL
(800) 528-0463

Contact: DOUG EPOLITO
(716) 874-9454

Record Date: 02/24/92

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**S136
ENE
1/2-1
Higher**

**ERIE TRAILER REPAIR INC
2801 KENMORE AVE
TONAWANDA, NY 14150**

**RCRIS-LQG 1000994268
NYD071487326**

NRG019514

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

ERIE TRAILER REPAIR INC (Continued)

1000994268

RCRIS:

Owner: U-HAUL INTERNATIONAL
(212) 555-1212

Contact: PETER A COTHARD
(716) 297-7548

Record Date: 06/22/87

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**U137
West
1/2-1
Higher**

**R W WEAVER CORP DBA ANCHOR MARINE
1501 FERRY RD
GRAND ISLAND, NY 14072**

**RCRIS-SQG 1000693604
FINDS NYD986996650**

RCRIS:

Owner: ROBERT W WEAVER
(212) 555-1212

Contact: ROBERT WEAVER
(716) 773-7063

Record Date: 03/26/92

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**U138
West
1/2-1
Higher**

**ANCHOR MARINE
1501 FERRY ROAD
GRAND ISLAND, NY**

**NY Spills S100666740
N/A**

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ANCHOR MARINE (Continued)

S100666740

SPILLS:

Facility ID:	9104017	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	LT. JAMES CUMMING	Caller Agency:	USCG-MSO
Caller Phone:	(716) 846-4168	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address	Not reported		
	Not reported		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	07/15/1991	Spill Source:	Unknown
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	07/15/1991 08:20
Spill Notifier:	Federal Government		
Spill Date:	07/12/1991 18:00		
Cleanup Ceased:	07/15/1991		
Last Inspection:	07/13/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/23/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/15/1991		
Remark:	SHEEN REPORTED IN NIAGARA RIVER AT ANCHOR MARINE		

S139
ENE
1/2-1
Higher

SAWYER / KENMORE
TONAWANDA, NY

NY Spills

S102178916
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

(Continued)

S102178916

SPILLS:

Facility ID:	8502165	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	KNOWN, SEE FILE		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	10/23/1985	Resource Affected:	Surface Water
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Other	Reported to Dept:	Not reported
Spill Date:	09/23/1985		
Cleanup Ceased:	10/23/1985		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	Not reported		
Remark:	Not reported		

U140
West
> 1
Higher

VILLAGE INN
1510 FERRY STREET
GRAND ISLAND, NY

NY Spills

S102132121
N/A

NRG019517

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

VILLAGE INN (Continued)

S102132121

SPILLS:

Facility ID:	9101133	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	BERNIE PINKANS	Caller Agency:	DEC-A DUTY OFFICER
Caller Phone:	(800) 457-7362	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	Not reported		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	04/30/1991	Spill Source:	Vessel
Spill Cause:	Deliberate	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/27/1991 17:55
Spill Notifier:	Citizen		
Spill Date:	04/27/1991 17:50		
Cleanup Ceased:	04/30/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/01/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/01/1991		
Remark:	CALLER ADVISED THAT THE BAS WAS BURNING A BOAT AS PART OF A PARTY AT THE INN - THOUGHT IT SHOULD BE STOPPED.		

U141
West
> 1
Higher

ANCHOR MARINE
1509 FERRY STREET
GRAND ISLAND, NY

NY Spills

S102132324
N/A

NRG019518

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ANCHOR MARINE (Continued)

S102132324

SPILLS:

Facility ID:	9110734	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	TANYA ALEXANDER	Caller Agency:	NFG
Caller Phone:	(716) 857-7410	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ANCHOR MARINE		
Address:	Not reported GRAND ISLAND, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/16/1993		
Spill Cause:	Unknown	Resource Affected:	Groundwater
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Other	PBS Number:	Not reported
Spill Date:	01/15/1992 08:30	Reported to Dept:	01/15/1992 08:47
Cleanup Ceased:	12/16/1993		
Last Inspection:	01/15/1992		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST involvement:	False		
Spill Record Last Update:	12/21/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	01/31/1992		
Remark:	NFG CREW FOUND STRONG PETROLEUM ODOR AND OIL PRODUCT IN EXCAVATION WHILE REPAIRING GAS LINE. SOIL TO BE STOCKPILED.		

V142
East
> 1
Higher

**OVERNIGHT TRUCKING
2580 KENMORE AVENUE
KENMORE, NY**

NY Spills

**S102174792
N/A**

NRG019519

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

OVERNIGHT TRUCKING (Continued)

S102174792

SPILLS:

Facility ID:	9206429	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DWAYNE HARRINGTON	Caller Agency:	USEPA
Caller Phone:	(908) 906-6899	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 875-9133
Spiller:	OVERNIGHT TRUCKING		
Address:	2580 KENMORE AVENUE KENMORE, NEW YORK 14217		
Spill Class:	Known release that creates a file or hazard. (Highly Improbable)		
Spill Closed Dt:	09/28/1992		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Federal Government	PBS Number:	Not reported
Spill Date:	09/03/1992 06:06	Reported to Dept:	09/03/1992 10:40
Cleanup Ceased:	09/28/1992		
Last Inspection:	09/28/1992		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/19/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/02/1992		
Remark:	REFER TO SPILL NO. 9206462 - DUPLICATE OF THIS SPILL		

V143
East
> 1
Higher

OVERNITE TRANSPORTATION CO
2580 KENMORE AVE
TONAWANDA, NY 14150

RCRIS-SQG 1000833476
FINDS NYD987022274

RCRIS:

Owner: OVERNITE TRANSPORTATION CO
(716) 875-9133

Contact: BILLY ROBINETTE
(716) 875-9133

Record Date: 10/27/94

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

W144
NE
> 1
Higher

RYDER TRUCK RENTAL INC
2834 KENMORE AVE
TONAWANDA, NY 14150

RCRIS-SQG 1000833483
FINDS NYD987023199
UST
LUST

NRG019520

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

RCRIS:

Owner: RYDER TRUCK RENTAL INC
(716) 875-5110

Contact: RICHARD BELL
(716) 875-5110

Record Date: 12/04/92

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

LUST:

Facility ID:	8703043	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	DAVID MORGAN	Caller Agency:	HUNTERVIRONMENTAL SERVICE
Caller Phone:	(800) 523-4370	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 875-5110
Spiller:	RYDER TRUCK RENTAL		
Address:	2834 KENMORE AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	05/16/1988	Resource Affected:	Groundwater
Spill Cause:	Tank Test Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Tank Tester	Reported to Dept:	07/15/1987 17:28
Spill Date:	07/15/1987 17:00		
Cleanup Ceased:	05/16/1988		
Last Inspection:	04/29/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	02/22/1988		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	05/19/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/16/1987		
Remark:	2 - 4000 GALS TANKS LEAKING -.200GPH		

Facility ID:	9514650	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	MJS	Spill Type:	UST
Caller Name:	DEREK MEUSE	Caller Agency:	BLASLAND, BOUCK AND LEE
Caller Phone:	(716) 292-6740	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	CHRIS KIERNAN	Spiller Phone:	(716) 875-5110
Spiller:	RYDER TRANSPORTATION SERV		
Address:	2834 KENMORE AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		

NRG019521

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Spill Closed Dt: 01/23/1997
 Spill Cause: Tank Failure
 Water Affected: Not reported
 Spill Notifier: Other
 Spill Date: 02/01/1996 12:00
 Cleanup Ceased: Not reported
 Last Inspection: 10/24/1996
 Cleanup Meets Standard: False
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: True
 Spill Record Last Update: 01/27/1997
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 02/15/1996

Resource Affected: Groundwater
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 02/15/1996 14:15

Remark: TANK WAS TAKING ON WATER. ALL WATER AND PRODUCT HAVE BEEN REMOVED. WILL BE CLOSING TANK IN APRIL AND MAY. PRODUCT INVENTORY WAS RECTIFIED. POTENTIAL LINE LEAK - DISPENSING LINE.

Facility ID: 9609146
 Facility Contact: Not reported
 Investigator: JDC
 Caller Name: FRANK KOZAK
 Caller Phone: (419) 241-7175
 Notifier Name: RYDER TRUCK RENTAL
 Notifier Phone: (609) 896-8066
 Spiller Contact: CARRIE VINCH
 Spiller: RYDER TRANSPORTATION
 Address: 2834 KENMORE AVENUE
 TONAWANDA, NY

Region of Spill: 9
 Facility Tele: () -
 Spill Type: UST
 Caller Agency: TOLTEST
 Caller Extension: Not reported
 Notifier Agency: 2834 KENMORE AVENUE
 Notifier Extension: Not reported
 Spiller Phone: (609) 896-8066

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 10/22/1996
 Spill Cause: Tank Failure
 Water Affected: Not reported
 Spill Notifier: Other
 Spill Date: 10/22/1996 13:45
 Cleanup Ceased: Not reported
 Last Inspection: 10/22/1996
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: True
 Spill Record Last Update: 10/28/1996
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 10/22/1996

Resource Affected: Groundwater
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 10/22/1996 14:15

Remark: caller reports finding sheen on ground water - believed to be coming from leak in underground tank

Facility ID: 9001404
 Facility Contact: Not reported
 Investigator: JDC
 Caller Name: JOE KLOC
 Caller Phone: (716) 694-0106

Region of Spill: 9
 Facility Tele: Not reported
 Spill Type: Facility
 Caller Agency: ELMWOOD TANK
 Caller Extension: Not reported

NRG019522

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	RYDER TRUCK		
Address:	Not reported		
	KENMORE, NY 14217		
Spill Class:	Not reported	Resource Affected:	Groundwater
Spill Closed Dt:	05/24/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	05/07/1990 09:40
Spill Notifier:	Other		
Spill Date:	05/07/1990 09:30		
Cleanup Ceased:	05/24/1991		
Last Inspection:	05/24/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	05/29/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/07/1990		
Remark:	ELMWOOD TANK REMOVING TANKS AT RYDER TRUCK,SIGNIFICANT SOIL AND GROUNDWATER CONTAMINATION FOUND.		

NRG019523

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

PBS UST:			
Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	D1	Install Date:	00/00
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	07/87	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	HUNTER
Database Type:	Not reported		

NRG019524

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	D2	Install Date:	00/00
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	07/87	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	HUNTER
Database Type:	Not reported		

NRG019525

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	D3	Install Date:	00/00
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Submersible
Overfill Prot:	Product Level Gauge	Next Test Date:	Not reported
Date Tested:	07/87	Test Method:	HUNTER
Date Closed:	00/00		
Database Type:	Not reported		

NRG019526

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	12000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	D4	Install Date:	00/80
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	07/92	Next Test Date:	Not reported
Date Closed:	10/96	Test Method:	TANKOLOGY [VACUTECT]
Database Type:	Not reported		

NRG019527

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	12000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	D5	Install Date:	00/80
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Submersible
Overfill Prot:	Product Level Gauge	Next Test Date:	Not reported
Date Tested:	07/92	Test Method:	TANKOLOGY [VACUTECT]
Date Closed:	10/96		
Database Type:	Not reported		

NRG019528

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	G1	Install Date:	00/00
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019529

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	G2	Install Date:	00/00
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019530

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	6000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Tank Converted To Non-Regulated Use		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	00/00
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Submersible
Date Tested:	12/87	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	HUNTER
Database Type:	Not reported		

NRG019531

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RYDER TRUCK RENTAL INC (Continued)

1000833483

Facility ID:	9-022306	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 875-5768	Location:	Not reported
Operator:	BOB DEANGELO		
Contact:	Not reported		
Emergency Contact:	KEVIN SCHENDELL, (716) 894-7100		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	11	Old PBS Num:	Not reported
Owner:	RYDER TRUCK RENTAL 3600 N.W. 82ND AVE MIAMI, FL 33166 (305) 593-3619		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	RYDER TRUCK RENTAL INC 3600 N.W. 82ND AVE FL 33166 (305) 593-3619 ATTN: STEPHEN R. LEWIS		
Facility Status:	Inactive	Total Capacity:	6000
Certification:	08/01/1996	Expiration:	09/02/1901
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	00/80
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Submersible
Overfill Prot:	Product Level Gauge	Next Test Date:	Not reported
Date Tested:	07/92	Test Method:	TANKOLOGY [VACUTECT]
Date Closed:	10/96		
Database Type:	Not reported		

NRG019532

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

BOB MILLER-USED OIL (Continued)

S102133184

SPILLS:

Facility ID:	8710163	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	JEFF WATERSON (ANONYMOUS)	Caller Agency:	CITIZEN
Caller Phone:	(716) 283-4350	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-1564
Spiller:	MRS. MENDOLA		
Address:	308 NORTH PARK AVENUE BUFFALO, NY 14216		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	04/26/1988	Spill Source:	Other Commercial/Industrial
Spill Cause:	Deliberate	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	03/03/1988 16:30
Spill Notifier:	Citizen		
Spill Date:	03/03/1988 16:30		
Cleanup Ceased:	04/26/1988		
Last Inspection:	04/26/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/26/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/04/1988		
Remark:	COMPLAINT OF USED OIL BEING PUMPED ON GAS STATION PROPERTY.		

Z164
ENE
> 1
Higher

678 SHERIDAN DR
TONAWANDA, NY

NY Spills

S102180329
N/A

NRG019533

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

(Continued)

S102180329

SPILLS:

Facility ID:	9509761	Region of Spill:	9
Facility Contact:	N/A	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DISP CONNIFER	Caller Agency:	TONOWANDA FIRE OFFICE
Caller Phone:	(716) 876-1212	Caller Extension:	Not reported
Notifier Name:	SAME	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	N/A		
Address:	Not reported		
	Not reported		

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	11/07/1995	Resource Affected:	On Land
Spill Cause:	Traffic Accident	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Fire Department	Reported to Dept:	11/06/1995 17:30
Spill Date:	11/06/1995 17:02		
Cleanup Ceased:	11/07/1995		
Last Inspection:	11/07/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/28/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/06/1995		

Remark: TRACTOR TRAILER HIT ASTORM DRAIN ON THE ROAD CAUSING THE TANK TO RUPTURE AND LEAK THEY CONTAINED THE LEAK WITH SPEEDY DRY. FIRE DEPT IS ON THE SCENE.THEY DO NOT HAVE A NAME ON THE OWNER OF THE TRACTOR TRAILER.

X165
East
> 1
Higher

AMERICAN AXLE AND MANUFAC
2390 KENMORE AVE
TONAWANDA, NY

NY Spills S102245359
N/A

NRG019534

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE AND MANUFAC (Continued)

S102245359

SPILLS:

Facility ID:	9601650	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	JDC	Spill Type:	UST
Caller Name:	JIM BARCZAK	Caller Agency:	AMERICAN AXLE
Caller Phone:	(716) 879-5060	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	JAMES BARCZAK	Spiller Phone:	(716) 879-5065
Spiller:	AMERICAN AXLE AND MANUFAC		
Address:	2390 KENMORE AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	06/13/1996	Resource Affected:	On Land
Spill Cause:	Housekeeping	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	05/02/1996 10:35
Spill Date:	05/02/1996 09:00		
Cleanup Ceased:	05/15/1996		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/02/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	05/02/1996		
Remark:	additive for sulfuric acid leaked out of a container it was stored in. all material will be disposed of and a report submitted call faxed from region 9 on 05/02/96		

X166
East
> 1
Higher

AMERICAN AXLE & MFG
2390 KENMORE AVE
TONAWANDA, NY

NY Spills

S102178518
N/A

NRG019535

10/20/1996 1:00 PM

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MFG (Continued)

S102178518

SPILLS:

Facility ID:	9401015	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	JIM BARCZAK	Caller Agency:	AMERICAN AXLE & MFG
Caller Phone:	(716) 879-5060	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-5060
Spiller:	AMERICAN AXLE & MFG.		
Address:	PO BOX 1210 BUFFALO, NY 14240		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/12/1994	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/15/1994 13:45
Spill Date:	04/15/1994 11:00		
Cleanup Ceased:	05/12/1994		
Last Inspection:	04/19/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	05/19/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/21/1994		
Remark:	HYDRAULIC POWER SUPPLY ON TANK; TURNED UPSIDE DOWN AND OIL SPILLED.		

**X167
East
> 1
Higher**

**AMERICAN AXLE & MFG.
2390 KENMORE AVE
TONAWANDA, NY**

**LUST
NY Spills**

**S101341718
N/A**

LUST:

Facility ID:	9414139	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	MR. MUNK	Caller Agency:	AMERICAN AXLE
Caller Phone:	(716) 279-5596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-5060
Spiller:	AMERICAN AXLE & MFG.		
Address:	PO BOX 1210 BUFFALO, NY 14240		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	03/28/1995	Resource Affected:	On Land
Spill Cause:	Tank Overfill	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	01/24/1995 13:06
Spill Date:	01/24/1995 12:05		
Cleanup Ceased:	03/28/1995		
Last Inspection:	01/24/1995		

NRG019536

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MFG. (Continued)

S101341718

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: True
 Spill Record Last Update: 04/25/1995
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 01/25/1995
 Remark: CONTAMINATION DISCOVERED DURING 2K GASOLINE TANK REMOVAL.

SPILLS:

Facility ID: 9412438	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: SAC	Spill Type: Facility
Caller Name: JAMES BARSZAK	Caller Agency: AMERICAN AXLE & MFG
Caller Phone: (716) 879-5060	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: (716) 879-5060
Spiller: AMERICAN AXLE & MFG.	
Address: 2390 KENMORE AVENUE TONAWANDA, NY 14150	
Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.	
Spill Closed Dt: 03/28/1995	Resource Affected: On Land
Spill Cause: Human Error	Spill Source: Other Commercial/Industrial
Water Affected: Not reported	PBS Number: Not reported
Spill Notifier: Responsible Party	Reported to Dept: 12/15/1994 12:30
Spill Date: 12/15/1994 12:30	
Cleanup Ceased: 03/28/1995	
Last Inspection: Not reported	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 04/25/1995	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 12/16/1994	
Remark: SMALL AMOUNT OF OIL SPILLED WHILE CHANGING CAPACITOR.	

X168
East
> 1
Higher

AMERICAN AXLE & MANUFACT.
2390 KENMORE AVE
TONAWANDA, NY

NY Spills

S102245396
N/A

NRG019537

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACT. (Continued)

S102245396

SPILLS:

Facility ID:	9602159	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	JDC	Spill Type:	UST
Caller Name:	JIM BARCZAK	Caller Agency:	AMERICAN AXLE & MANUFACT.
Caller Phone:	(716) 879-5060	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	JIM BARCZAK	Spiller Phone:	(716) 879-5060
Spiller:	AMERICAN AXLE & MANUFACT.		
Address:	2390 KENMORE AVENUE TONAWANDA, NY 14240		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	06/13/1996	Resource Affected:	On Land
Spill Cause:	Housekeeping	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	05/02/1996 10:35
Spill Date:	05/02/1996 09:00		
Cleanup Ceased:	05/15/1996		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/26/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/15/1996		
Remark:	MATERIAL IS OIL/RACINE B - ADDITIVE FOR SULFURIC ACID LEAKED OUT OF A CONTAINER IT WAS STORED IN. ALL MATERIAL WILL BE DISPOSED OF AND A REPORT SUBMITTED		

NRG019538

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s) EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACT. (Continued)

S102245396

Facility ID: 9608208	Region of Spill: 9
Facility Contact: JIM BARZACK	Facility Tele: (716) 447-5060
Investigator: MJS	Spill Type: UST
Caller Name: JIM BARZACK	Caller Agency: AMERICAN AXLE & MANUFACT.
Caller Phone: (716) 447-5060	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: Not reported
Spiller: AMERICAN AXLE & MANUFACT.	
Address: Not reported	

Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 01/23/1997	Resource Affected: In Sewer
Spill Cause: Housekeeping	Spill Source: Other Commercial/Industrial
Water Affected: Not reported	PBS Number: Not reported
Spill Notifier: Responsible Party	Reported to Dept: 07/16/1996 12:30
Spill Date: 07/16/1996 12:00	
Cleanup Ceased: Not reported	
Last Inspection: Not reported	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 02/10/1997	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 10/01/1996	
Remark: pcb contamination discovered in subsurface air ventilation shaft. contamination materials involve sludge and water. clean harbors environmental will do clean up work.	

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

AMERICAN AXLE & MANUFACT. (Continued)

S102245396

Facility ID: 9614256 Facility Contact: Not reported Investigator: MJS Caller Name: JIM BARCZAK Caller Phone: (716) 447-5060 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: JAMES BARCZAK Spiller: AMERICAN AXLE & MANUFACT. Address: RIVER ROAD TONAWANDA, NY Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken. Spill Closed Dt: 03/14/1997 Spill Cause: Equipment Failure Water Affected: Not reported Spill Notifier: Affected Persons Spill Date: 03/07/1997 15:15 Cleanup Ceased: Not reported Last Inspection: Not reported Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 03/17/1997 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 03/07/1997 Remark: FUEL TANK ON TRUCK LEAKED-CLEANING UP WITH SPEEDI DRY SECURITY #447-5180	Region of Spill: 9 Facility Tele: () - Spill Type: UST Caller Agency: AMERICAN AXLE Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 447-5060 Resource Affected: On Land Spill Source: Commercial Vehicle PBS Number: Not reported Reported to Dept: 03/07/1997 16:00
--	---

X169
East
> 1
Higher

GM 2390 KENMORE
2390 KENMORE AVE
TONAWANDA, NY

NY Spills

S102178458
N/A

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

GM 2390 KENMORE (Continued)

S102178458

SPILLS:

Facility ID: 9315445 Facility Contact: Not reported Investigator: SAC Caller Name: JIM BARCZAK Caller Phone: (716) 879-5060 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: AMERICAN AXLE MFG., INC. Address: 2390 KENMORE AVE. TONAWANDA, NY 14150	Region of Spill: 9 Facility Tele: Not reported Spill Type: UST Caller Agency: AMERICAN MFG Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 879-5060
---	---

Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: Not reported Spill Cause: Unknown Water Affected: Not reported Spill Notifier: Affected Persons Spill Date: 03/27/1994 11:40 Cleanup Ceased: Not reported Last Inspection: Not reported Cleanup Meets Standard: False Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 03/31/1997 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 03/31/1994 Remark: FREE PRODUCT FOUND IN 8-10' BORING.	Resource Affected: On Land Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 03/28/1994 09:15
---	---

X170
East
> 1
Higher

CHEVROLET-TONAWANDA PLT 1
 2390 KENMORE AVE
 TONAWANDA, NY 14240

FINDS

1000546369
 NYD003940566

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

X171
East
> 1
Higher

GENERAL MOTORS
 2390 KENMORE AVE
 TONAWANDA, NY

NY Spills

S102179133
 N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GENERAL MOTORS (Continued)

S102179133

SPILLS:

Facility ID:	9410371	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	MARK NAPOLITAN	Caller Agency:	GENERAL MOTORS
Caller Phone:	(313) 556-5436	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(313) 556-5436
Spiller:	GENERAL MOTORS		
Address:	1085A ARGONAUT BLDG. DETROIT, MI		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	01/04/1995		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/31/1994 08:30	Reported to Dept:	10/31/1994 11:00
Cleanup Ceased:	01/04/1995		
Last Inspection:	11/03/1995		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/25/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/03/1994		
Remark:	CONTAMINATED SOIL DISCOVERED WHILE INSTALLING A MANHOLE.		

X172
East
> 1
Higher

A A M TONAWANDA FORGE
2390 KENMORE AVE
TONAWANDA, NY 14150

FINDS **1000833397**
RCRIS-LQG **NYD986932457**

RCRIS:

Owner: AMERICAN AXLE & MFG INC
 (313) 974-2750

Contact: JAMES BARCZAK
 (716) 879-5060

Record Date: 02/22/94

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility is a PCB generator, storer, transporter or permitted disposer (under PADS)

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
X173 East > 1 Higher AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE 2390 KENMORE AVE TONAWANDA, NY 14240	UST NY Spills AST	U003079584 N/A

SPILLS:

Facility ID:	9606563	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	JIM BARZACK	Caller Agency:	SAFTY MANAGER
Caller Phone:	(716) 891-7100	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	AMERICAN AXLE		
Address:	EAST DELAVAN AVENUE BUFFALO, NY -		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	03/11/1997		
Spill Cause:	Housekeeping	Resource Affected:	In Sewer
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	08/16/1996 10:30	Reported to Dept:	08/16/1996 10:00
Cleanup Ceased:	03/11/1997		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/14/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/21/1996		
Remark:	subsurpale air transfor tunnel was discovered and found w/ water and pcb contamination clean harbors hires to do clean up, work will begin at the end of the month		

NRG019543

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9609408	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	JDC	Spill Type:	UST
Caller Name:	JIM BARCZACK	Caller Agency:	AMERICAN AXLE
Caller Phone:	(716) 447-5065	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	JIM BARCZACK	Spiller Phone:	(716) 447-5065
Spiller:	AMERICAN AXLE & MANUFACTU		
Address:	2390 KENMORE AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/24/1996	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/21/1996 12:00
Spill Date:	10/12/1996 14:50		
Cleanup Ceased:	10/24/1996		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/18/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/28/1996		
Remark:	MALFUNCTIONING PUMP CAUSED MATERIAL TO SPILL ON THE FACTORY FLOOR TO AN AREA OUTSIDE THE FACILITY AT F-20.5 SEWER DRAIN WAS BLOCKED TO PREVENT ANY LOSSES TO THE SYSTEM - HAZ-MAT ABSORBANTS WERE USED TO COLLECT THE MATERIAL		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9505669	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	JIM BARCZAK	Caller Agency:	ENVIRO ENGINEER
Caller Phone:	(716) 879-5060	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-5060
Spiller:	AMERICAN AXLE		
Address:	2390 KENMORE AVE TONAWANDA, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/06/1995	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/08/1995 09:35
Spill Date:	08/08/1995 08:20		
Cleanup Ceased:	09/26/1995		
Last Inspection:	08/08/1995		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/06/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/09/1995		
Remark:	YARD LOADER HIT DEBRIS RUPTURING HYDRAULIC FUEL LINE		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9514634	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	KAH	Spill Type:	Facility
Caller Name:	JIM BARCZAK	Caller Agency:	AMERICAN AXLE & MANUFACT
Caller Phone:	(716) 879-5060	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	JIM BARCZAK	Spiller Phone:	(716) 879-5060
Spiller:	AMERICAN AXLE & MANUFACT		
Address:	2390 KENMORE AVENUE TONAWANDA, NY 14150		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/20/1996		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	02/15/1996 09:00	Reported to Dept:	02/15/1996 09:30
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/22/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/15/1996		
Remark:	someone accidentally tipped over a transformer spilling approx 1 qt of transformer oil spillage cleaned up + oil was tested for pcb's results due mon 2/19 spill faxed from region 9 on 2/15/96		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

PBS UST:

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC.		

1840 HOLBROOK AVENUE
DETROIT, MI 48212
(313) 974-2044

Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
-------------	----------------------	-------------	--------------

Owner Subtype: Not reported
Mailing Address: AAM TONAWANDA FORGE
PO BOX 1210
2390 KENMORE AVENUE
NY 14240
(716) 879-5000
ATTN: ENVIRONMENTAL ENGINEER

Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	01/54
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	01/54
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044	Owner Mark:	Second Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUT :D		
Tank ID:	3	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

NRG019549

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	4	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	5	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	6	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	7	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	8	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	9	Install Date:	01/54
Product Stored:	NOS 5 OR 6 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	15	Install Date:	01/54
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	16	Install Date:	01/54
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	17	Install Date:	01/54
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

NRG019558

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	24722
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	18	Install Date:	01/54
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	STEEL/IRON
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	02/91	Test Method:	Not reported
Database Type:	Not reported		

NRG019559

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-5060	Location:	Not reported
Operator:	J T BARCZAK		
Contact:	Not reported		
Emergency Contact:	PLANT SECURITY, (716) 879-5151		
Facility Type:	MANUFACTURING		
Total Tanks:	14	Old PBS Num:	Not reported
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044	Owner Mark:	Second Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	AAM TONAWANDA FORGE PO BOX 1210 2390 KENMORE AVENUE NY 14240 (716) 879-5000 ATTN: ENVIRONMENTAL ENGINEER		
Facility Status:	Active	Total Capacity:	2000
Certification:	04/12/1995	Expiration:	03/30/1999
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	19	Install Date:	06/71
Product Stored:	UNLEADED GASOLINE	Tank Type:	Fiberglass coated steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Above/Underground Combination	Pipe Type:	STEEL/IRON
Tank External:	FIBERGLASS		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	07/94	Next Test Date:	Not reported
Date Closed:	01/95	Test Method:	PETRO-TITE
Database Type:	Not reported		

NRG019560

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

PBS AST:

Facility ID:	9-386219	Telephone:	(716) 879-5060
Facility Status:	Active	Total Ast's:	3
Owner:	AMERICAN AXLE & MANUFACTURING, INC.		

1840 HOLBROOK AVENUE
DETROIT, MI 48212
(313) 974-2044

Tank ID:	20	Capacity (Gal):	7000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND	Tank Type:	Fiberglass reinforced plastic [FRP]
Product Stored:	LUBE OIL	Tank Internal:	Not reported
Install Date:	08/83		
Tank External:	Not reported		
Tank Containment:	NONE/CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Leak Detection:	Not reported		
Overfill Prot:	Not reported	Dispenser:	Gravity
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-386219	Telephone:	(716) 879-5060
Facility Status:	Active	Total Ast's:	3
Owner:	AMERICAN AXLE & MANUFACTURING, INC.		

1840 HOLBROOK AVENUE
DETROIT, MI 48212
(313) 974-2044

Tank ID:	21	Capacity (Gal):	1000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND	Tank Type:	Equivalent technology
Product Stored:	UNLEADED GASOLINE	Tank Internal:	OTHER
Install Date:	12/94		
Tank External:	OTHER/NONE		
Tank Containment:	VAULT/SYNTHETIC LINER		
Pipe Location:	Aboveground	Pipe Type:	GALVANIZED STEEL
Pipe Internal:	OTHER		
Pipe External:	NONE/NONE		
Leak Detection:	IN-TANK SYSTEM		
Overfill Prot:	Automatic Shut-Off, Catch Basin	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019561

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE & MANUFACTURING INC.-TONAWANDA FORGE (Continued)

U003079584

Facility ID:	9-386219	Telephone:	(716) 879-5060
Facility Status:	Active	Total Ast's:	3
Owner:	AMERICAN AXLE & MANUFACTURING, INC. 1840 HOLBROOK AVENUE DETROIT, MI 48212 (313) 974-2044		
Tank ID:	22	Capacity (Gal):	290
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	DIESEL	Tank Type:	Equivalent technology
Install Date:	12/94	Tank Internal:	OTHER
Tank External:	OTHER/NONE		
Tank Containment:	SYNTHETIC LINER		
Pipe Location:	Aboveground	Pipe Type:	GALVANIZED STEEL
Pipe Internal:	OTHER		
Pipe External:	NONE/NONE		
Leak Detection:	IN-TANK SYSTEM		
Overfill Prot:	Automatic Shut-Off, Catch Basin	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

174
ENE
> 1
Higher

**KENTON CTR
151 TWO MILE RD
TONAWANDA, NY 14150**

**FINDS 1000416384
RCRIS-LQG NYD981876881
UST**

RCRIS:

Owner: ERIE | BOCES
(212) 555-1212

Contact: HAROLD KNAUER
(716) 632-6680

Record Date: 02/13/87

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

NRG019562

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

KENTON CTR (Continued)

1000416384

PBS UST:			
Facility ID:	9-504718	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 877-7777	Location:	Not reported
Operator:	ERIE 1 BOCES		
Contact:	Not reported		
Emergency Contact:	HAROLD D KNAUER, (716) 662-1233		
Facility Type:	SCHOOL		
Total Tanks:	1	Old PBS Num:	Not reported
Owner:	ERIE 1 BOCES 2 PLEASANT AVE WEST LANCASTER, NY 14086 (716) 686-2000	Owner Mark:	First Owner
Owner Type:	Not reported		
Owner Subtype:	Not reported		
Mailing Address:	ERIE 1 BOCES 2 PLEASANT AVE WEST NY 14086 (716) 686-2000 Not Reported		
Facility Status:	Inactive	Total Capacity:	10000
Certification:	08/20/1990	Expiration:	08/07/1995
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	01/78
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Fiberglass reinforced plastic [FRP]
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	06/90	Next Test Date:	Not reported
Date Closed:	08/94	Test Method:	TANK AUDITOR
Database Type:	Not reported		

Y175
NE
> 1
Higher

PST VANS INC.
350 GRAND ISLAND BLVD
TONAWANDA, NY

NY Spills

S102177862
N/A

NRG019563

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

PST VANS INC. (Continued)

S102177862

SPILLS:

Facility ID:	9302465	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	UST
Caller Name:	LT. CARUANA	Caller Agency:	TONAWANDA PD
Caller Phone:	(716) 695-5040	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(800) 535-0544
Spiller:	PST VANS, INC.		
Address:	1891 WEST 2100 SOUTH SALT LAKE CITY, UTAH		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/21/1993	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	-
Spill Notifier:	Other	Reported to Dept:	05/22/1993 20:03
Spill Date:	05/22/1993 18:14		
Cleanup Ceased:	10/07/1993		
Last Inspection:	06/08/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/01/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/24/1993		
Remark:	TRACTOR TRAILOR FUEL LEAK		

176
East
> 1
Higher

**AMERICAN AXLE
2370 KENMORE AVE
TONAWANDA, NY**

NY Spills

**S102561465
N/A**

NRG019564

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AMERICAN AXLE (Continued)

S102561465

SPILLS:

Facility ID:	9700820	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	Not reported	Spill Type:	UST
Caller Name:	JIM BARCZAK	Caller Agency:	AMERICAN AXLE
Caller Phone:	(000) 447-5060	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	JIM BARCZACK	Spiller Phone:	() 447-5065
Spiller:	AMERICAN AXLE		
Address:	2390 KENMORE AV TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported		
Spill Cause:	Housekeeping	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	03/19/1997 10:30	Reported to Dept:	03/19/1997 11:30
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/21/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/18/1997		
Remark:	SAMPLE RESULTS FOR SLLDGE SAMPLES COLLECTED FROM ABANDONED SUBTERRAIN AIR SHAFTS-SHOWED LEVELS OF PCB GRATER THAN 50 PRM CLEanup work will begin in june of 97 during plant shutdown		

AA177
NNW
> 1
Higher

TONAWANDA, PLOT 34 P1-30
4111 RIVER RD
TONAWANDA, NY 14150

SWF/LF

S101650759
N/A

NRG019565

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA, PLOT 34 P1-30 (Continued)

S101650759

LF:

Facility ID:	15S33	Telephone:	Not reported
DEC Region:	9	Permit #:	Not reported
Permit issue date:	Not reported	Permit Expires:	Not reported
Authrzd/Operate Dt:	Not reported	Constrct Perm #:	Not reported
Auth. to Construct:	Not reported	Const Permit Exp:	Not reported
Regulatory Status:	None	Receiving Waste:	False
Started Rec Waste:	Not reported	Stop Rec Waste:	Not reported
Aquifer:	none		
Date Ordered On Consent Signed:		Not reported	
Accomplish Date Of Order:		Not reported	
Inactive HWS:	False	Inactive HWS Num:	
Inactive HWS Class:	Not reported		
Waste type:	Not reported		
Owner Name:	INS EQUIPMENT CO, INC	Owner Type:	Private
Mail Address:	4111 RIVER RD TONAWANDA, NY 14150		
Owner Phone Num:	Not reported	Operator Name:	INS EQUIPMENT CO, INC
Ny Transverse Mercator Coordinates East:			181100
Ny Transverse Mercator Coordinates North:			4768700
Annual Report Submitted to ALB:			
1989:	False	1990:	False
1991:	False	1992:	False
1993:	False	1994:	False
1995:	False		
1996:	False		
Primary Liner:	Not reported	Secondary Liner:	Not reported
Annual Rprt Waived:	Not reported	Tiping Fee Rprt:	Not reported

**AA178
NNW
> 1
Higher**

**INS EQUIPMENT
RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000112821
CERC-NFRAP NYD071470033**

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS-NFRAP Assessment History:

Assessment:	PRELIMINARY ASSESSMENT	Completed:	09/01/84
Assessment:	SCREENING SITE INSPECTION	Completed:	05/31/85
Assessment:	DISCOVERY	Completed:	09/01/84

CERCLIS-NFRAP Alias Name(s):

RIVER ROAD SITE

**AA179
NNW
> 1
Higher**

**INS SCRAP
4111 RIVER RD
TONAWANDA, NY**

**NY Spills S102179169
N/A**

NRG019566

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

INS SCRAP (Continued)

S102179169

SPILLS:

Facility ID:	8504923	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	I. N. S.		
Address	4111 RIVER ROAD TONAWANDA, N. Y. 14150		
Spill Class:	Not reported		
Spill Closed Dt:	08/12/1986		
Spill Cause:	Housekeeping	Resource Affected:	Surface Water
Water Affected:	DITCH	Spill Source:	Other Commercial/Industrial
Spill Notifier:	DEC	PBS Number:	Not reported
Spill Date:	03/28/1986 15:00	Reported to Dept:	03/28/1986 15:00
Cleanup Ceased:	08/12/1986		
Last Inspection:	08/12/1986		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/08/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/27/1986		
Remark:	DITCH BETWEEN INS AND TONAWANDA COKE		

AB180
NE
> 1
Higher

LYONS TRAN LINES INC
410 GRAND ISLAND BLVD
BUFFALO, NY 14150

RCRIS-SQG 1000833515
FINDS NYD987026390

RCRIS:

Owner: LYONS TRANS LINES INC
(814) 456-8551

Contact: THOMAS STOUT
(814) 456-8551

Record Date: 01/21/93

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

AB181
NE
> 1
Higher

GRIFFITH OIL
410 GRAND ISLAND BLVD
TONAWANDA, NY

NY Spills S102177990
N/A

NRG019567

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GRIFFITH OIL (Continued)

S102177990

SPILLS:

Facility ID:	9304906	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ROB COEN	Caller Agency:	GRIFFITH OIL
Caller Phone:	(716) 372-2171	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	GRIFFITH OIL		
Address:	Not reported ROCHESTER, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/23/1993		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Tank Truck
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/20/1993 08:15	Reported to Dept:	07/20/1993 08:27
Cleanup Ceased:	07/23/1993		
Last Inspection:	07/20/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/09/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/20/1993		
Remark:	TANK OVERFILL; OIL SPILLED ONTO BLACKTOP.		

182
ENE
> 1
Higher

**ROLLINS LEASING CORP.
155 WOODWARD AVENUE WEST
TONAWANDA, NY 14150**

**RCRIS-SQG 1000286012
FINDS NYD055064216**

RCRIS:

Owner: ROLLINS LEASING
(212) 555-1212

Contact: KEE CASOER
(716) 876-9567

Record Date: 10/09/86

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

183
ENE
> 1
Higher

**ED'S AUTO
136 GRAND ISLAND BLVD
TONAWANDA, NY**

**NY Spills S102174026
N/A**

NRG019568

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ED'S AUTO (Continued)

S102174026

SPILLS:

Facility ID:	9102853	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	OFFICER REED	Caller Agency:	TONAWANDA PD
Caller Phone:	(716) 879-6613	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ED'S AUTO		
Address:	136 GRAND ISLAND BLVD. GRAND ISLAND, NY		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	06/13/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Deliberate	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	06/11/1991 19:46
Spill Notifier:	Police Department		
Spill Date:	06/11/1991 18:23		
Cleanup Ceased:	06/11/1991		
Last Inspection:	06/11/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/13/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/12/1991		
Remark:	ED'S AUTO DUMPED ANTI-FREEZE AND RADIATOR TRACER INTO DRAIN		

NRG019569



City	EDR ID	Site Name	Site Address	Zip	Database(s)	Facility ID
BUFFALO	1000912710	NYSTA C O OAKGROVE CONSTRUCTION	I-190 NIAGARA THRUWAY	14207	FINDS, RCRIS-LQG	
TONAWANDA	S100669523	DUPONT BOAT CLUB	AQUA DRIVE AT RIVER ROAD		LUST	9009390
TONAWANDA	1000274235	NATL FUEL GAS CO REG STA TN RM 508	CHEVROLET GMC RIVER RD	14150	RCRIS-SQG, FINDS	
TONAWANDA	1000413631	STATION 133	EI DUPONT RIVER RD	14150	FINDS, RCRIS-LQG	
TONAWANDA	1000555396	NYSDOT BIN 1044960	RTE I-290 OVER RTE I-190	14150	FINDS, RCRIS-LQG	
TONAWANDA	1000221579	JAMES ST SVC CTR	JAMES ST	14150	FINDS, RCRIS-LQG	
TONAWANDA	S100667149	SAGINAW DIVISION - GM	KENMORE AVENUE	14150	LUST, NY Spills	9104438
TONAWANDA	U003079973	TONAWANDA SECTION MAINTENANCE	NEW YORK STATE THRUWAY		UST, AST	9-141607
TONAWANDA	U00668590	OCTO MANUFACTURING CO.	EAST NIAGARA STREET		LUST	8704748
TONAWANDA	1000160430	TONAWANDA TOWN OF WATER TREATMENT	FT OF SHERIDAN DR & RIVER RD	14150	RCRIS-SQG, FINDS	
TONAWANDA	1000432571	SERVICE STATION	S PARK AVE	14150	FINDS, RCRIS-LQG	
TONAWANDA	1001029633	NYSDOT BIN 1044980 D256665	E PARK DR BRG OVER RTE I-290	14150	FINDS, RCRIS-LQG	
TONAWANDA	S102174086	NIAGARA MOHAWK - HUNTLEY	RIVER ROAD	14150	RCRIS-LQG	
TONAWANDA	S102176852	HUNTLEY COAL PLANT	RIVER ROAD		NY Spills	
TONAWANDA	1000299737	TERMINAL STATION C	RIVER RD	14150	NY Spills	
TONAWANDA	1000554172	NYS THRUWAY AUTH	RIVER RD ENT OVER THRUWAY	14150	FINDS, RCRIS-LQG	
TONAWANDA	1001124925	US TRANSCO	4400 RIVER RD SUITE A	14150	FINDS, RCRIS-LQG	
TONAWANDA	A100085922	DUPONT-YERKES	RIVER & SHERIDAN RDS	14150	AST	
TONAWANDA	S101174768	SUN TERMINAL(ATLANTIC)	RIVER ROAD		LUST	9408626
TONAWANDA	S101341713	TONAWANDA ENGINE PLANT	RIVER ROAD		LUST	9413928
TONAWANDA	S102519190	NIAGARA MOHAWK	RIVER ROAD		LUST	8805221
TONAWANDA	S100493900	NOCO ENERGY TANK 122	RIVER RD		LUST, NY Spills	9516835
TONAWANDA	S100494392	AGWAY	RIVER ROAD		LUST	9205796
TONAWANDA	S100494400	DUPONT YURKEES SITE	RIVER / SHERIDAN ROADS		LUST	9209880
TONAWANDA	S100493208	VAN DE WATER WATER PLANT	RIVER ROAD		LUST	9209841
TONAWANDA	S100495114	NOCO ENERGY	RIVER ROAD		LUST	9111755
TONAWANDA	S101103100	UNITED REFINING	RIVER ROAD		LUST, NY Spills	9301371
TONAWANDA	S100666802	CPC GROUP	RIVER ROAD		LUST, NY Spills	9401932
TONAWANDA	S100669140	CPC TONAWANDA	RIVER ROAD		LUST	8706462
TONAWANDA	S100669080	CHARLIE FASO BACKYARD	EAST RIVER ROAD		LUST	8807786
TONAWANDA	S100669524	CHEVROLET ENGINE PLANT	RIVER ROAD		LUST	8905477
TONAWANDA	S100154706	ROBO STATION	RIVER ROAD		LUST	9009486
TONAWANDA	1001028640	NYSDOT BIN 4043850 D256665	ROBO SERVICE STATION		LUST	8602450
TONAWANDA	S102235967	GOETZ - FMC	NY RTE 265 BRG OVER ERIE CANAL	14150	RCRIS-LQG	
TONAWANDA	S102174820	NIAGARA MOHAWK - HUNTLEY	SAWYER AVENUE		LUST, NY Spills	9514925
TONAWANDA	A100085942	SHERIDAN PARKSIDE WADING POOL	SHERIDAN DRIVE	14150	NY Spills	
TONAWANDA	S100154649	DUNLOP TIRE	SHERIDAN PARKSIDE DRIVE		AST	8600997
TONAWANDA	1000693882	NYS THRUWAY AUTH	SHERIDAN DRIVE	14150	LUST, NY Spills	
TONAWANDA	1000893884	NYS THRUWAY AUTH	THRUWAY OVER SHERIDAN DR	14150	FINDS, RCRIS-LQG	
TONAWANDA	S100669484	M.L YOUNG MOTOR EXPRESS	THRUWAY OVER SHERIDAN DR		FINDS, RCRIS-LQG	
TONAWANDA	S100669491	AMERICAN ENVIROMENTAL	TWIN CITY MEMEROIL HWY		LUST	9004350
TONAWANDA	1000290533	DUNLOP SITE 2	YOUNGMAN HIGHWAY I290	14150	LUST	9005054
TONAWANDA			SHERIDAN D7		FINDS, CERC-NFRAP	

**GEOCHECK VERSION 2.1 ADDENDUM
STATE DATABASE WELL INFORMATION**

Water Well Information:

Well Within 1/4 - 1/2 Mile of Target Property (Southern Quadrant)

Public Water Supply #:	1400443	Source ID:	002
PW Supply Name:	ERIE COUNTY WATER AUTHORITY		
Source Name:	NIAGARA RIVER		
Source Description:	Surface		
Availability/Utilization:	Permanent Utilization	Source Type:	Source Record
Latitude:	425753	Longitude:	-785553
Source Prod Capacity:	50000000 Million Gals/Day	Fed ID of Seller:	Not Reported
Watershed Basin:	01	Watershed Sub-basin:	00
Treatment Plant ID:	P004	Date of rec Last Update:	19931228
Water Type:	Not Reported	Record Tag:	Not Reported

Well Within >2 Miles of Target Property (Western Quadrant)

Public Water Supply #:	1400451	Source ID:	001
PW Supply Name:	GRAND ISLAND TOWN WATER DEPT.		
Source Name:	NIAGARA RIVER		
Source Description:	Surface		
Availability/Utilization:	Permanent Utilization	Source Type:	Source Record
Latitude:	425755	Longitude:	-785820
Source Prod Capacity:	999999999 Million Gals/Day	Fed ID of Seller:	Not Reported
Watershed Basin:	01	Watershed Sub-basin:	00
Treatment Plant ID:	003	Date of rec Last Update:	Not Reported
Water Type:	Not Reported	Record Tag:	Not Reported

NRG019571

GEOCHECK VERSION 2.1
PUBLIC WATER SUPPLY SYSTEM INFORMATION

Searched by Nearest Well.

PWS SUMMARY:

PWS ID: NY0000443 PWS Status: Active Distance from TP: 1/4 - 1/2 Mile
Date Initiated: Not Reported Date Deactivated: Not Reported Dir relative to TP: South
PWS Name: ERIE COUNTY WATER AUTHORITY
ELLICOTT SQUARE BUILDING
BUFFALO, NY 14203

Addressee / Facility: System Owner/Responsible Party
MOGAVERO JOHN
ERIE COUNTY WATER AUTHORITY
ELLICOTT SQUARE BLDG
BUFFALO, NY 14203

Facility Latitude: 42 41 43 Facility Longitude: 079 03 18
Facility Latitude: 42 57 53 Facility Longitude: 078 55 53
City Served: EVANS (T) Population Served: Not Reported
Treatment Class: Not Reported

Well currently has or has had major violation(s): No

NRG019572

EPA Waste Codes Addendum

Code	Description
D001	IGNITABLE HAZARDOUS WASTES ARE THOSE WASTES WHICH HAVE A FLASHPOINT OF LESS THAN 140 DEGREES FAHRENHEIT AS DETERMINED BY A PENSKEY-MARTENS CLOSED CUP FLASH POINT TESTER. ANOTHER METHOD OF DETERMINING THE FLASH POINT OF A WASTE IS TO REVIEW THE MATERIAL SAFETY DATA SHEET, WHICH CAN BE OBTAINED FROM THE MANUFACTURER OR DISTRIBUTOR OF THE MATERIAL. LACQUER THINNER IS AN EXAMPLE OF A COMMONLY USED SOLVENT WHICH WOULD BE CONSIDERED AS IGNITABLE HAZARDOUS WASTE.
D002	A WASTE WHICH HAS A PH OF LESS THAN 2 OR GREATER THAN 12.5 IS CONSIDERED TO BE A CORROSIVE HAZARDOUS WASTE. SODIUM HYDROXIDE, A CAUSTIC SOLUTION WITH A HIGH PH, IS OFTEN USED BY INDUSTRIES TO CLEAN OR DEGREASE PARTS. HYDROCHLORIC ACID, A SOLUTION WITH A LOW PH, IS USED BY MANY INDUSTRIES TO CLEAN METAL PARTS PRIOR TO PAINTING. WHEN THESE CAUSTIC OR ACID SOLUTIONS BECOME CONTAMINATED AND MUST BE DISPOSED, THE WASTE WOULD BE A CORROSIVE HAZARDOUS WASTE.
D003	A MATERIAL IS CONSIDERED TO BE A REACTIVE HAZARDOUS WASTE IF IT IS NORMALLY UNSTABLE, REACTS VIOLENTLY WITH WATER, GENERATES TOXIC GASES WHEN EXPOSED TO WATER OR CORROSIVE MATERIALS, OR IF IT IS CAPABLE OF DETONATION OR EXPLOSION WHEN EXPOSED TO HEAT OR A FLAME. ONE EXAMPLE OF SUCH WASTE WOULD BE WASTE GUNPOWDER.
D005	BARIUM
D006	CADMIUM
D007	CHROMIUM
D008	LEAD
D009	MERCURY
D010	SELENIUM
D018	BENZENE
D021	CHLOROBENZENE
D028	1,2-DICHLOROETHANE
D035	METHYL ETHYL KETONE
D039	TETRACHLOROETHYLENE
D040	TRICHLOROETHYLENE
F001	THE FOLLOWING SPENT HALOGENATED SOLVENTS USED IN DEGREASING: TETRACHLOROETHYLENE, TRICHLOROETHYLENE, METHYLENE CHLORIDE, 1,1,1-TRICHLOROETHANE, CARBON TETRACHLORIDE, AND CHLORINATED FLUOROCARBONS; ALL SPENT SOLVENT MIXTURES/BLENDS USED IN DEGREASING CONTAINING, BEFORE USE, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THE ABOVE HALOGENATED SOLVENTS OR THOSE SOLVENTS LISTED IN F002, F004, AND F005, AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT

NRG019573

EPA Waste Codes Addendum

Code	Description
	MIXTURES.
F002	THE FOLLOWING SPENT HALOGENATED SOLVENTS: TETRACHLOROETHYLENE, METHYLENE CHLORIDE, TRICHLOROETHYLENE, 1,1,1-TRICHLOROETHANE, CHLOROBENZENE, 1,1,2-TRICHLORO-1,2,2-TRIFLUOROETHANE, ORTHO-DICHLOROBENZENE, TRICHLOROFLUOROMETHANE, AND 1,1,2-TRICHLOROETHANE; ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THE ABOVE HALOGENATED SOLVENTS OR THOSE LISTED IN F001, F004, OR F005, AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
F003	THE FOLLOWING SPENT NON-HALOGENATED SOLVENTS: XYLENE, ACETONE, ETHYL ACETATE, ETHYL BENZENE, ETHYL ETHER, METHYL ISOBUTYL KETONE, N-BUTYL ALCOHOL, CYCLOHEXANONE, AND METHANOL; ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, ONLY THE ABOVE SPENT NON-HALOGENATED SOLVENTS; AND ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, ONE OR MORE OF THE ABOVE NON-HALOGENATED SOLVENTS, AND, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THOSE SOLVENTS LISTED IN F001, F002, F004, AND F005, AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
F005	THE FOLLOWING SPENT NON-HALOGENATED SOLVENTS: TOLUENE, METHYL ETHYL KETONE, CARBON DISULFIDE, ISOBUTANOL, PYRIDINE, BENZENE, 2-ETHOXYETHANOL, AND 2-NITROPROPANE; ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THE ABOVE NON-HALOGENATED SOLVENTS OR THOSE SOLVENTS LISTED IN F001, F002, OR F004; AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
P022	CARBON DISULFIDE
U154	METHANOL (I)
U154	METHYL ALCOHOL (I)

NRG019574

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

To maintain currency of the following federal and state databases, EDR contacts the appropriate governmental agency on a monthly or quarterly basis, as required.

Elapsed ASTM days: Provides confirmation that this EDR report meets or exceeds the 90-day updating requirement of the ASTM standard.

FEDERAL ASTM RECORDS:

CERCLIS: Comprehensive Environmental Response, Compensation, and Liability Information System

Source: EPA/NTIS

Telephone: 703-413-0223

CERCLIS: CERCLIS contains data on potentially hazardous waste sites that have been reported to the USEPA by states, municipalities, private companies and private persons, pursuant to Section 103 of the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA). CERCLIS contains sites which are either proposed to or on the National Priorities List (NPL) and sites which are in the screening and assessment phase for possible inclusion on the NPL.

Date of Government Version: 04/30/97

Date Made Active at EDR: 06/30/97

Database Release Frequency: Monthly

Date of Data Arrival at EDR: 05/19/97

Elapsed ASTM days: 42

Date of Last EDR Contact: 08/22/97

ERNS: Emergency Response Notification System

Source: EPA/NTIS

Telephone: 202-260-2342

ERNS: Emergency Response Notification System. ERNS records and stores information on reported releases of oil and hazardous substances.

Date of Government Version: 03/01/97

Date Made Active at EDR: 06/24/97

Database Release Frequency: Quarterly

Date of Data Arrival at EDR: 04/10/97

Elapsed ASTM days: 75

Date of Last EDR Contact: 08/26/97

NPL: National Priority List

Source: EPA

Telephone: 703-603-8852

NPL: National Priorities List (Superfund). The NPL is a subset of CERCLIS and identifies over 1,200 sites for priority cleanup under the Superfund Program. NPL sites may encompass relatively large areas. As such, EDR provides polygon coverage for over 1,000 NPL site boundaries produced by EPA's Environmental Photographic Interpretation Center (EPIC).

Date of Government Version: 04/01/97

Date Made Active at EDR: 05/29/97

Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 04/21/97

Elapsed ASTM days: 38

Date of Last EDR Contact: 07/01/97

RCRIS: Resource Conservation and Recovery Information System

Source: EPA/NTIS

Telephone: 800-424-9346

RCRIS: Resource Conservation and Recovery Information System. RCRIS includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA).

Date of Government Version: 04/01/97

Date Made Active at EDR: 06/30/97

Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 04/25/97

Elapsed ASTM days: 66

Date of Last EDR Contact: 08/04/97

CORRACTS: Corrective Action Report

Source: EPA

Telephone: 800-424-9346

CORRACTS: CORRACTS identifies hazardous waste handlers with RCRA corrective action activity.

Date of Government Version: 12/01/96

Date Made Active at EDR: 03/03/97

Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 12/30/96

Elapsed ASTM days: 63

Date of Last EDR Contact: 07/07/97

NRG019575

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

FEDERAL NON-ASTM RECORDS:

BRS: Biennial Reporting System

Source: EPA/NTIS

Telephone: 800-424-9346

BRS: The Biennial Reporting System is a national system administered by the EPA that collects data on the generation and management of hazardous waste. BRS captures detailed data from two groups: Large Quantity Generators (LQG) and Treatment, Storage, and Disposal Facilities.

Date of Government Version: 12/31/93
Database Release Frequency: Biennially

Date of Last EDR Contact: 08/04/97
Date of Next Scheduled EDR Contact: 09/22/97

CONSENT: Superfund (CERCLA) Consent Decrees

Source: EPA Regional Offices

Telephone: Varies

Major legal settlements that establish responsibility and standards for cleanup at NPL (Superfund) sites. Released periodically by United States District Courts after settlement by parties to litigation matters.

Date of Government Version: Varies
Database Release Frequency: Varies

Date of Last EDR Contact: Varies
Date of Next Scheduled EDR Contact: N/A

FINDS: Facility Index System

Source: EPA/NTIS

Telephone: 703-908-2493

FINDS: Facility Index System. FINDS contains both facility information and "pointers" to other sources that contain more detail. EDR includes the following FINDS databases in this report: PCS (Permit Compliance System), AIRS (Aerometric Information Retrieval System), DOCKET (Enforcement Docket used to manage and track information on civil judicial enforcement cases for all environmental statutes), FURS (Federal Underground Injection Control), C-DOCKET (Criminal Docket System used to track criminal enforcement actions for all environmental statutes), FFIS (Federal Facilities Information System), STATE (State Environmental Laws and Statutes), and PADS (PCB Activity Data System).

Date of Government Version: 09/30/95
Database Release Frequency: Quarterly

Date of Last EDR Contact: 08/22/97
Date of Next Scheduled EDR Contact: 11/04/97

HMIRS: Hazardous Materials Information Reporting System

Source: U.S. Department of Transportation

Telephone: 202-366-4526

HMIRS: Hazardous Materials Incident Report System. HMIRS contains hazardous material spill incidents reported to DOT.

Date of Government Version: 12/31/95
Database Release Frequency: Annually

Date of Last EDR Contact: 07/28/97
Date of Next Scheduled EDR Contact: 10/27/97

MLTS: Material Licensing Tracking System

Source: Nuclear Regulatory Commission

Telephone: 301-415-7169

MLTS is maintained by the Nuclear Regulatory Commission and contains a list of approximately 8,100 sites which possess or use radioactive materials and which are subject to NRC licensing requirements. To maintain currency, EDR contacts the Agency on a quarterly basis.

Date of Government Version: 01/15/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/14/97
Date of Next Scheduled EDR Contact: 10/13/97

NPL LIENS: Federal Superfund Liens

Source: EPA

Telephone: 205-564-4267

NPL LIENS: Federal Superfund Liens. Under the authority granted the USEPA by the Comprehensive Environmental Response, Compensation and Liability Act (CERCLA) of 1980, the USEPA has the authority to file liens against real property in order to recover remedial action expenditures or when the property owner receives notification of potential liability. USEPA compiles a listing of filed notices of Superfund Liens.

Date of Government Version: 10/15/91
Database Release Frequency: No Update Planned

Date of Last EDR Contact: 08/25/97
Date of Next Scheduled EDR Contact: 11/24/97

NRG019576

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

PADS: PCB Activity Database System

Source: EPA

Telephone: 202-260-3936

PADS: PCB Activity Database. PADS identifies generators, transporters, commercial storers and/or brokers and disposers of PCB's who are required to notify the EPA of such activities.

Date of Government Version: 01/27/97

Database Release Frequency: Semi-Annually

Date of Last EDR Contact: 08/19/97

Date of Next Scheduled EDR Contact: 11/17/97

RAATS: RCRA Administrative Action Tracking System

Source: EPA

Telephone: 202-564-4104

RAATS: RCRA Administration Action Tracking System. RAATS contains records based on enforcement actions issued under RCRA pertaining to major violators and includes administrative and civil actions brought by the EPA. For administration actions after September 30, 1995, data entry in the RAATS database was discontinued. EPA will retain a copy of the database for historical records. It was necessary to terminate RAATS because a decrease in agency resources made it impossible to continue to update the information contained in the database.

Date of Government Version: 04/17/95

Database Release Frequency: No Update Planned

Date of Last EDR Contact: 07/01/97

Date of Next Scheduled EDR Contact: 09/15/97

ROD: Records Of Decision

Source: NTIS

Telephone: 703-416-0223

Record of Decision. ROD documents mandate a permanent remedy at an NPL (Superfund) site containing technical and health information to aid in the cleanup.

Date of Government Version: 03/31/95

Database Release Frequency: Annually

Date of Last EDR Contact: 09/03/97

Date of Next Scheduled EDR Contact: 12/01/97

TRIS: Toxic Chemical Release Inventory System

Source: EPA/NTIS

Telephone: 202-260-1531

TRIS: Toxic Release Inventory System. TRIS identifies facilities which release toxic chemicals to the air, water and land in reportable quantities under SARA Title III Section 313.

Date of Government Version: 12/31/92

Database Release Frequency: Annually

Date of Last EDR Contact: 07/02/97

Date of Next Scheduled EDR Contact: 09/29/97

TSCA: Toxic Substances Control Act

Source: EPA/NTIS

Telephone: 202-260-1444

TSCA: Toxic Substances Control Act. TSCA identifies manufacturers and importers of chemical substances included on the TSCA Chemical Substance Inventory list. It includes data on the production volume of these substances by plant site. USEPA has no current plan to update and/or re-issue this database.

Date of Government Version: 01/31/95

Database Release Frequency: Annually

Date of Last EDR Contact: 06/16/97

Date of Next Scheduled EDR Contact: 09/15/97

NRG019577

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

STATE OF NEW YORK ASTM RECORDS:

LUST: Spills Information Database

Source: Department of Environmental Conservation
Telephone: 518-457-2462

LUST: Leaking Underground Storage Tank Incident Reports. LUST records contain an inventory of reported leaking underground storage tank incidents. Not all states maintain these records, and the information stored varies by state.

Date of Government Version: 12/31/96
Date Made Active at EDR: 04/21/97
Database Release Frequency: Quarterly

Date of Data Arrival at EDR: 02/12/97
Elapsed ASTM days: 68
Date of Last EDR Contact: 07/28/97

SHWS: Inactive Hazardous Waste Disposal Sites in New York State

Source: Department of Environmental Conservation
Telephone: 518-457-0747

SHWS: State Hazardous Waste Sites. State hazardous waste site records are the states' equivalent to CERCLIS. These sites may or may not already be listed on the federal CERCLIS list. Priority sites planned for cleanup using state funds (state equivalent of Superfund) are identified along with sites where cleanup will be paid for by potentially responsible parties. Available information varies by state.

Date of Government Version: 04/30/96
Date Made Active at EDR: 06/06/96
Database Release Frequency: Annually

Date of Data Arrival at EDR: 05/06/96
Elapsed ASTM days: 31
Date of Last EDR Contact: 08/11/97

SWF/LF: Facility Register

Source: Department of Environmental Conservation
Telephone: 518-457-2051

SWF/LF: Solid Waste Facilities/Landfill Sites. SWF/LF type records typically contain an inventory of solid waste disposal facilities or landfills in a particular state. Depending on the state, these may be active or inactive facilities or open dumps that failed to meet RCRA Subtitle D Section 4004 criteria for solid waste landfills or disposal sites.

Date of Government Version: 12/31/96
Date Made Active at EDR: 04/21/97
Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 02/20/97
Elapsed ASTM days: 60
Date of Last EDR Contact: 08/11/97

UST: Petroleum Bulk Storage (PBS, CBS, MOSF) Database (UST)

Source: Department of Environmental Conservation
Telephone: 518-457-4351

UST: Registered Underground Storage Tanks. UST's are regulated under Subtitle I of the Resource Conservation and Recovery Act (RCRA) and must be registered with the state department responsible for administering the UST program. Available information varies by state program.

Date of Government Version: 12/31/96
Date Made Active at EDR: 04/07/97
Database Release Frequency: Quarterly

Date of Data Arrival at EDR: 02/18/97
Elapsed ASTM days: 48
Date of Last EDR Contact: 08/04/97

STATE OF NEW YORK NON-ASTM RECORDS:

AST: Petroleum Bulk Storage (AST)

Source: Department of Environmental Conservation
Telephone: 518-457-4351

AST: Registered Aboveground Storage Tanks.

Date of Government Version: 09/30/96
Database Release Frequency: Quarterly

Date of Last EDR Contact: 08/04/97
Date of Next Scheduled EDR Contact: 11/03/97

SPILLS: Spills Information Database

Source: Department of Environmental Conservation
Telephone: 518-457-2462

SPILLS: Data collected on spills reported to NYSDEC as required by one or more of the following: Article 12 of the Navigation Law, 6 NYCRR Section 613.8 (from PBS regs), or 6 NYCRR Section 595.2 (from CBS regs). It includes spills active as of April 1, 1986, as well as spills occurring since this date.

Date of Government Version: 12/31/96
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/28/97
Date of Next Scheduled EDR Contact: 10/27/97

NRG019578

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

NEW YORK COUNTY RECORDS

CORTLAND COUNTY:

Cortland County UST Listing (AST)

Source: Cortland County Health Department
Telephone: 607-753-5035

Date of Government Version: 03/25/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

Cortland County UST Listing (UST)

Source: Cortland County Health Department
Telephone: 607-753-5035

Date of Government Version: 06/20/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

NASSAU COUNTY:

NCPHO Article XI Database (AST)

Source: Nassau County Health Department
Telephone: 516-571-3314

Date of Government Version: 12/01/96
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/08/97
Date of Next Scheduled EDR Contact: 10/06/97

NCPHO Article XI Database (UST)

Source: Nassau County Health Department
Telephone: 516-571-3314

Date of Government Version: 02/04/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/08/97
Date of Next Scheduled EDR Contact: 10/06/97

ROCKLAND COUNTY:

Petroleum Bulk Storage Database (AST)

Source: Rockland County Health Department
Telephone: 914-364-2605

Date of Government Version: 03/28/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

Petroleum Bulk Storage Database (UST)

Source: Rockland County Health Department
Telephone: 914-364-2605

Date of Government Version: 06/01/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

SUFFOLK COUNTY:

Underground Storage Tank Database (AST)

Source: Suffolk County Department of Health Services
Telephone: 516-854-2521

Date of Government Version: 03/01/96
Database Release Frequency: Annually

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

NRG019579

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

Underground Storage Tank Database (UST)

Source: Suffolk County Department of Health Services
Telephone: 516-854-2521

Date of Government Version: 02/21/97
Database Release Frequency: Annually

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

Historical and Other Database(s)

Depending on the geographic area covered by this report, the data provided in these specialty databases may or may not be complete. For example, the existence of wetlands information data in a specific report does not mean that all wetlands in the area covered by the report are included. Moreover, the absence of any reported wetlands information does not necessarily mean that wetlands do not exist in the area covered by the report.

Former Manufactured Gas (Coal Gas) Sites: The existence and location of Coal Gas sites is provided exclusively to EDR by Real Property Scan, Inc. ©Copyright 1993 Real Property Scan, Inc. For a technical description of the types of hazards which may be found at such sites, contact your EDR customer service representative.

Disclaimer Provided by Real Property Scan, Inc.

The information contained in this report has predominantly been obtained from publicly available sources produced by entities other than Real Property Scan. While reasonable steps have been taken to insure the accuracy of this report, Real Property Scan does not guarantee the accuracy of this report. Any liability on the part of Real Property Scan is strictly limited to a refund of the amount paid. No claim is made for the actual existence of toxins at any site. This report does not constitute a legal opinion.

DELISTED NPL: Delisted NPL Sites

Source: EPA
Telephone: 703-603-8769

DELISTED NPL: The National Oil and Hazardous Substances Pollution Contingency Plan (NCP) establishes the criteria that the EPA uses to delete sites from the NPL. In accordance with 40 CFR 300.425.(e), sites may be deleted from the NPL where no further response is appropriate.

NFRAP: No Further Remedial Action Planned

Source: EPA/NTIS
Telephone: 703-413-0223

NFRAP: As of February 1995, CERCLIS sites designated "No Further Remedial Action Planned" (NFRAP) have been removed from CERCLIS. NFRAP sites may be sites where, following an initial investigation, no contamination was found, contamination was removed quickly without the need for the site to be placed on the NPL, or the contamination was not serious enough to require Federal Superfund action or NPL consideration. EPA has removed approximately 25,000 NFRAP sites to lift the unintended barriers to the redevelopment of these properties and has archived them as historical records so EPA does not needlessly repeat the investigations in the future. This policy change is part of the EPA's Brownfields Redevelopment Program to help cities, states, private investors and affected citizens to promote economic redevelopment of unproductive urban sites.

FRDS: Federal Reporting Data System

Source: EPA/Office of Drinking Water
Telephone: 202-260-2805

FRDS provides information regarding public water supplies and their compliance with monitoring requirements, maximum contaminant levels (MCL's), and other requirements of the Safe Drinking Water Act of 1986.

Area Radon Information: The National Radon Database has been developed by the U.S. Environmental Protection Agency (USEPA) and is a compilation of the EPA/State Residential Radon Survey and the National Residential Radon Survey. The study covers the years 1986 - 1992. Where necessary data has been supplemented by information collected at private sources such as universities and research institutions.

NRG019580

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

Oil/Gas Pipelines/Electrical Transmission Lines: This data was obtained by EDR from the USGS in 1994. It is referred to by USGS as GeoData Digital Line Graphs from 1:100,000-Scale Maps. It was extracted from the transportation category including some oil, but primarily gas pipelines and electrical transmission lines.

Sensitive Receptors: There are individuals deemed sensitive receptors due to their fragile immune systems and special sensitivity to environmental discharges. These sensitive receptors typically include the elderly, the sick, and children. While the location of all sensitive receptors cannot be determined, EDR indicates those buildings and facilities - schools, daycares, hospitals, medical centers, and nursing homes - where individuals who are sensitive receptors are likely to be located.

USGS Water Wells: In November 1971 the United States Geological Survey (USGS) implemented a national water resource information tracking system. This database contains descriptive information on sites where the USGS collects or has collected data on surface water and/or groundwater. The groundwater data includes information on more than 900,000 wells, springs, and other sources of groundwater.

Flood Zone Data: This data, available in select counties across the country, was obtained by EDR in 1994 from the Federal Emergency Management Agency (FEMA). Data depicts 100-year and 500-year flood zones as defined by FEMA.

Epicenters: World earthquake epicenters, Richter 5 or greater
Source: Department of Commerce, National Oceanic and Atmospheric Administration

Water Dams: National Inventory of Dams
Source: Federal Emergency Management Agency
Telephone: 202-646-2801
WATER DAMS: National computer database of more than 74,000 dams maintained by the Federal Emergency Management Agency.

New York Public Water Wells
Source: New York Department of Health
Telephone: 518-458-6731

NRG019582

APPENDIX A2
Environmental Data Resources Report
C. R. Huntley Fly Ash Landfill



**The EDR-Radius Map
with GeoCheck™**

**C.R. Huntley Fly Ash Landfill
River Rd
Tonawanda, NY 14150**

Inquiry Number: 1201713.15p

October 06, 1997

**The Source
For Environmental
Risk Management
Data**

3530 Post Road
Southport, Connecticut 06490

Nationwide Customer Service

Telephone: 1-800-352-0050
Fax: 1-800-231-6802
Internet: www.edrmet.com

NRG019584

TABLE OF CONTENTS

<u>SECTION</u>	<u>PAGE</u>
Executive Summary.....	ES1
Topographic Map.....	2
GeoCheck Summary.....	3
Overview Map.....	5
Detail Map.....	6
Map Summary - All Sites.....	7
Map Summary - Sites with higher or the same elevation as the Target Property.....	8
Map Findings.....	9
Orphan Summary.....	205
 <u>APPENDICES</u>	
GeoCheck Version 2.1.....	A1
EPA Waste Codes.....	A5
Government Records Searched / Data Currency Tracking Addendum.....	A7

Thank you for your business.
Please contact EDR at 1-800-352-0050
with any questions or comments.

Disclaimer

This Report contains information obtained from a variety of public sources and EDR makes no representation or warranty regarding the accuracy, reliability, quality, or completeness of said information or the information contained in this report. The customer shall assume full responsibility for the use of this report. No warranty of merchantability or of fitness for a particular purpose, expressed or implied, shall apply and EDR specifically disclaims the making of such warranties. In no event shall EDR be liable to anyone for special, incidental, consequential or exemplary damages. Copyright (c) 1997 by EDR. All rights reserved.

NRG019585

EXECUTIVE SUMMARY

A search of available environmental records was conducted by Environmental Data Resources, Inc. (EDR). The report meets the government records search requirements of ASTM Standard Practice for Environmental Site Assessments, E 1527-97. Search distances are per ASTM standard or custom distances requested by the user.

The address of the subject property for which the search was intended is:

RIVER RD
TONAWANDA, NY 14150

No mapped sites were found in EDR's search of available ("reasonably ascertainable ") government records either on the subject property or within the ASTM E 1527-97 search radius around the subject property for the following Databases:

NPL:..... National Priority List
Delisted NPL:..... NPL Deletions
RCRIS-TSD:..... Resource Conservation and Recovery Information System
CERC-NFRAP:..... Comprehensive Environmental Response, Compensation, and Liability Information System
HMIRS:..... Hazardous Materials Information Reporting System
PADS:..... PCB Activity Database System
TRIS:..... Toxic Chemical Release Inventory System
NPL Lien:..... Federal Superfund Liens
TSCA:..... Toxic Substances Control Act
MLTS:..... Material Licensing Tracking System
ROD:..... Records Of Decision
CONSENT:..... Superfund (CERCLA) Consent Decrees
Coal Gas:..... Former Manufactured gas (Coal Gas) Sites.

Unmapped (orphan) sites are not considered in the foregoing analysis.

Search Results:

Search results for the subject property and the search radius, are listed below:

Subject Property:

The subject property was identified in the following government records. For more information on this property see page 9 of the attached EDR Radius Map report:

<u>Site</u>	<u>Database(s)</u>	<u>EPA ID</u>
CR HUNTLEY FLY ASH LDFL RIVER RD TONAWANDA, NY 14150	FINDS	NY0000557496

NRG019586

EXECUTIVE SUMMARY

Surrounding Properties:

Elevations have been determined from the USGS 1 degree Digital Elevation Model and should be evaluated on a relative (not an absolute) basis. Relative elevation information between sites of close proximity should be field verified. EDR's definition of a site with an elevation equal to the subject property includes a tolerance of -10 feet. Sites with an elevation equal to or higher than the subject property have been differentiated below from sites with an elevation lower than the subject property (by more than 10 feet). Page numbers and map identification numbers refer to the EDR Radius Map report where detailed data on individual sites can be reviewed.

Sites listed in *bold italics* are in multiple databases.

SHWS: The State Hazardous Waste Sites records are the states' equivalent to CERCLIS. These sites may or may not already be listed on the federal CERCLIS list. Priority sites planned for cleanup using state funds (state equivalent of Superfund) are identified along with sites where cleanup will be paid for by potentially responsible parties. The data comes from the Department of Environmental Conservation's Inactive Hazardous waste Disposal Sites in New York State.

A review of the SHWS list, as provided by EDR, and dated 04/30/1996 has revealed that there are 7 SHWS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
NIAGARA MOHAWK - CHERRY FARM	RIVER ROAD (NEAR 4000 R	1/8 - 1/4SSE	B7	12
RIVER ROAD SITE	4000 RIVER RD	1/8 - 1/4SSE	B10	24
<i>ROBLIN STEEL</i>	<i>4000 RIVER RD</i>	<i>1/8 - 1/4SSE</i>	<i>B12</i>	<i>26</i>
<i>TONAWANDA COKE INC</i>	<i>3875 RIVER RD</i>	<i>1/4 - 1/2SSE</i>	<i>C26</i>	<i>39</i>
ASHLAND TANK 75	4625 RIVER ROAD	1/2 - 1 NNE	J71	104
<i>FMC CORP</i>	<i>34 SAWYER AVE.</i>	<i>1 - 2 SSE</i>	<i>O93</i>	<i>138</i>
O-CEL-O SPONGE PLANT	305 SAWYER AVE	1 - 2 SE	W121	176

CERCLIS: The Comprehensive Environmental Response, Compensation and Liability Information System contains data on potentially hazardous waste sites that have been reported to the USEPA by states, municipalities, private companies and private persons, pursuant to Section 103 of the Comprehensive Environmental Response, Compensation and Liability Act (CERCLA).

CERCLIS contains sites which are either proposed to or on the National Priorities List (NPL) and sites which are in the screening and assessment phase for possible inclusion on the NPL.

A review of the CERCLIS list, as provided by EDR, and dated 04/30/1997 has revealed that there are 4 CERCLIS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
<i>ENVIROTEK</i>	<i>4000 RIVER RD</i>	<i>1/8 - 1/4SSE</i>	<i>B13</i>	<i>28</i>
<i>ASHLAND OIL</i>	<i>4545 RIVER ROAD</i>	<i>1/2 - 1 NNE</i>	<i>I58</i>	<i>69</i>
<i>ASHLAND CHEMICAL CO</i>	<i>3701 RIVER RD</i>	<i>1/2 - 1 SSE</i>	<i>64</i>	<i>77</i>
<i>SEAWAY IND WASTE DSPL</i>	<i>4825 RIVER RD</i>	<i>1 - 2 NNE</i>	<i>N87</i>	<i>124</i>

CORRACTS: CORRACTS is a list of handlers with RCRA Corrective Action Activity. This report shows which nationally-defined corrective action core events have occurred for every handler that has had corrective action activity.

A review of the CORRACTS list, as provided by EDR, and dated 12/01/1996 has revealed that there are 3 CORRACTS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
<i>ENVIROTEK</i>	<i>4000 RIVER RD</i>	<i>1/8 - 1/4SSE</i>	<i>B13</i>	<i>28</i>

NRG019587

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
ALLIED CORPORATION	3821 RIVER RD	1/4 - 1/2 SSE	D28	43
FMC CORP	34 SAWYER AVE.	1 - 2 SSE	O93	138

SWF/LF: The Solid Waste Facilities/Landfill Sites records typically contain an inventory of solid waste disposal facilities or landfills in a particular state. The data comes from the list.

A review of the SWF/LF list, as provided by EDR, and dated 12/31/1996 has revealed that there are 3 SWF/LF sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
TONAWANDA, PLOT 34 P1-30	4111 RIVER RD	0 - 1/8 ESE	A4	10
TONAWANDA COKE INC	3875 RIVER RD	1/4 - 1/2 SSE	C26	39
ASHLAND PETRO LF	4545 RIVER RD	1/2 - 1 NNE	I56	65

LUST: The Leaking Underground Storage Tank Incident Reports contain an inventory of reported leaking underground storage tank incidents. The data comes from the Department of Environmental Conservation's Spills Information Database.

A review of the LUST list, as provided by EDR, and dated 12/31/1996 has revealed that there are 12 LUST sites within approximately 0.75 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
SIVACO NY COMPANY	3937 RIVER RD	1/4 - 1/2 SSE	C21	33
NEW YORK WIRE MILLS CORP	3937 RIVER RD	1/4 - 1/2 SSE	C22	34
SIVACO	3937 RIVER RD	1/4 - 1/2 SSE	C24	37
SUN OIL	3755 RIVER RD	1/2 - 1 SSE	D34	47
SUN OIL REFINERY	3733 RIVER RD	1/2 - 1 SSE	F39	50
ATLANTIC REFINING	3732 RIVER RD	1/2 - 1 SSE	F40	50
PILOT MOTOR FREIGHT	4400 RIVER RD	1/2 - 1 NNE	G43	53
ABF / ESTES FREIGHT	4425 RIVER RD	1/2 - 1 NNE	G45	54
CAROLINA FREIGHT CARRIERS CORP	4425 RIVER RD	1/2 - 1 NNE	G46	55
T & T FREIGHTWAYS CORP	4500 RIVER RD	1/2 - 1 NNE	I52	62
UNITED REFINING	4545 RIVER RD	1/2 - 1 NNE	I54	63
BROKEN TANKS	1249 STONY POINT RD	1/2 - 1 NNW	61	75

UST: The Underground Storage Tank database contains registered USTs. USTs are regulated under Subtitle I of the Resource Conservation and Recovery Act (RCRA). The data comes from the Department of Environmental Conservation's Petroleum Bulk Storage (PBS, CBS, MOSF) Database.

A review of the UST list, as provided by EDR, and dated 12/31/1996 has revealed that there is 1 UST site within approximately 0.5 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
PINE HILL MATERIALS CORP	4100 RIVER ROAD	0 - 1/8 SE	A5	10

NRG019588

EXECUTIVE SUMMARY

AST: The Aboveground Storage Tank database contains registered ASTs. The data comes from the Department of Environmental Conservation's Petroleum Bulk Storage (PBS, CBS, MOSF) Database.

A review of the AST list, as provided by EDR, and dated 09/30/1996 has revealed that there are 3 AST sites within approximately 0.5 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
MARATHON OIL COMPANY	4000 RIVER RD	1/8 - 1/4 SSE	B8	13
SIVACO NEW YORK	3937 RIVER RD.	1/4 - 1/2 SSE	C23	35
TONAWANDA COKE CORPORATION	3875 RIVER RD	1/4 - 1/2 SSE	C25	38

RAATS: The RCRA Administration Action Tracking System contains records based on enforcement actions issued under RCRA and pertaining to major violators. It includes administrative and civil actions brought by the United States Environmental Protection Agency. The source of this database is the U.S. EPA.

A review of the RAATS list, as provided by EDR, and dated 04/17/1995 has revealed that there is 1 RAATS site within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
ENVIROTEK	4000 RIVER RD	1/8 - 1/4 SSE	B13	28

RCRIS: The Resource Conservation and Recovery Act database includes selected information on sites that generate, store, treat, or dispose of hazardous waste as defined by the Act. The source of this database is the U.S. EPA.

A review of the RCRIS-SQG list, as provided by EDR, and dated 04/01/1997 has revealed that there are 15 RCRIS-SQG sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
NIAGARA RIVER WORLD	4000 RIVER RD	1/8 - 1/4 SSE	B11	25
ENVIROTEK	4000 RIVER RD	1/8 - 1/4 SSE	B13	28
ASCENSION CHEMICAL OF AMERICA	4000 RIVER ROAD	1/8 - 1/4 SSE	B18	31
TNT PILOT FREIGHT INC.	4400 RIVER ROAD	1/2 - 1 NNE	G44	54
CAROLINA FREIGHT CARRIERS CORP	4425 RIVER RD	1/2 - 1 NNE	G47	57
MOBIL OIL GASOLINE ADDITIVE TK	4545 RIVER RD	1/2 - 1 NNE	I55	65
NOCO ENERGY CORP	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K68	85
CARMEN M PARISO INC	3649 RIVER RD	1/2 - 1 SSE	L78	119
TEXACO USA /A DIV OF TEXACO IN	RIVER RD & JAMES ST	1/2 - 1 SSE	L79	119
LAKEHEAD PIPE LINE CO INC	4700 RIVER RD	1 - 2 NNE	N84	123
GOETZ ENERGY CORP	87 SAWYER AVE	1 - 2 SSE	P96	142
KURK FUEL OIL CO	130 SAWYER AVE	1 - 2 SE	Q100	144
R W WEAVER CORP DBA ANCHOR MAR	1501 FERRY RD	1 - 2 SSW	U110	151
LYONS TRAN LINES INC	410 GRAND ISLAND BLVD	1 - 2 E	V114	154
A B F FREIGHT SYSTEMS INC	50 FLYDER AVE	1 - 2 ESE	116	155

RCRIS: The Resource Conservation and Recovery Act database includes selected information on sites that generate, store, treat, or dispose of hazardous waste as defined by the Act. The source of this database is the U.S. EPA.

A review of the RCRIS-LQG list, as provided by EDR, and dated 04/01/1997 has revealed that there are 21 RCRIS-LQG sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
CLARENCE MATERIALS CORP	4010 RIVER RD	1/8 - 1/4 SSE	B6	11

NRG019589

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
LAKE ERIE ROLLING MILL INC	4000 RIVER RD	1/8 - 1/4 SSE	B14	29
TONAWANDA NEW YORK TERMINAL	4000 RIVER RD	1/8 - 1/4 SSE	B15	29
ENVIROTEK II PRP GROUP	4000 RIVER RD	1/8 - 1/4 SSE	B16	30
NEW YORK WIRE MILLS CORP	3937 RIVER RD	1/4 - 1/2 SSE	C22	34
TONAWANDA COKE CORP	3875 RIVER RD	1/4 - 1/2 SSE	C27	42
ALLIED CORPORATION	3821 RIVER RD	1/4 - 1/2 SSE	D28	43
SUNMARK PETROLEUM MARKETING TE	3755 RIVER RD	1/2 - 1 SSE	D35	48
VAN DE WATER TREATMENT PLT	3750 RIVER RD	1/2 - 1 SSE	F37	49
A R & M CORP TONAWANDA TERM	3733 RIVER RD	1/2 - 1 SSE	F38	49
CHEMCENTRAL/BUFFALO	3709 RIVER RD	1/2 - 1 SSE	H51	61
OVERLAND EXPRESS INTL	4500 RIVER RD	1/2 - 1 NNE	I53	62
ASHLAND OIL	4545 RIVER ROAD	1/2 - 1 NNE	I58	69
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 SSE	64	77
OCCIDENTAL CHEMICAL CORP	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K66	84
AGWAY PETROLEM CORP	4635 RIVER RD	1/2 - 1 NNE	J75	116
FMC CORP	34 SAWYER AVE.	1 - 2 SSE	O93	138
BUFFALO INDUSTRIAL PARK	1800 BROADWAY	1 - 2 WNW	R103	146
CONRAIL FRONTIER CAR SHOP	1800 BROADWAY	1 - 2 WNW	R104	146
WESTERN NEW YORK BARREL & DRUM	225 SAWYER AVE	1 - 2 SE	T109	151
GENERAL MILLS INC	305 SAWYER AVE	1 - 2 SE	W129	184

ERNS: The Emergency Response Notification System records and stores information on reported releases of oil and hazardous substances. The source of this database is the U.S. EPA.

A review of the ERNS list, as provided by EDR, and dated 03/01/1997 has revealed that there are 2 ERNS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
4363 RIVER RD	4363 RIVER RD	1/4 - 1/2 NNE	E30	45
700 GRAND ISLAND BLVD.	700 GRAND ISLAND BLVD.	1/2 - 1 ENE	K67	85

FINDS: The Facility Index System contains both facility information and "pointers" to other sources of information that contain more detail. These include: RCRIS; Permit Compliance System (PCS); Aerometric Information Retrieval System (AIRS); FATES (FIFRA [Federal Insecticide Fungicide Rodenticide Act] and TSCA Enforcement System, FTTS [FIFRA/TSCA Tracking System]; CERCLIS; DOCKET (Enforcement Docket used to manage and track information on civil judicial enforcement cases for all environmental statutes); Federal Underground Injection Control (FURS); Federal Reporting Data System (FRDS); Surface Impoundments (SIA); TSCA Chemicals in Commerce Information System (CICS); PADS; RCRA-J (medical waste transporters/disposers); TRIS; and TSCA. The source of this database is the U.S. EPA/NTIS.

A review of the FINDS list, as provided by EDR, and dated 09/30/1995 has revealed that there are 44 FINDS sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
INS EQUIPMENT	RIVER RD	0 - 1/8 ESE	A3	9
CLARENCE MATERIALS CORP	4010 RIVER RD	1/8 - 1/4 SSE	B6	11
NIAGARA RIVER WORLD	4000 RIVER RD	1/8 - 1/4 SSE	B11	25
ROBLIN STEEL	4000 RIVER RD	1/8 - 1/4 SSE	B12	26
ENVIROTEK	4000 RIVER RD	1/8 - 1/4 SSE	B13	28
LAKE ERIE ROLLING MILL INC	4000 RIVER RD	1/8 - 1/4 SSE	B14	29
TONAWANDA NEW YORK TERMINAL	4000 RIVER RD	1/8 - 1/4 SSE	B15	29

NRG019590

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
ENVIROTEK II PRP GROUP	4000 RIVER RD	1/8 - 1/4 SSE	B16	30
ASCENSION CHEMICAL OF AMERICA	4000 RIVER ROAD	1/8 - 1/4 SSE	B18	31
NEW YORK WIRE MILLS CORP	3937 RIVER RD	1/4 - 1/2 SSE	C22	34
TONAWANDA COKE INC	3875 RIVER RD	1/4 - 1/2 SSE	C26	39
ALLIED CORPORATION	3821 RIVER RD	1/4 - 1/2 SSE	D28	43
ARCO	3773 RIVER ROAD	1/4 - 1/2 SSE	D32	46
SUNMARK PETROLEUM MARKETING TE	3755 RIVER RD	1/2 - 1 SSE	D35	48
VAN DE WATER TREATMENT PLT	3750 RIVER RD	1/2 - 1 SSE	F37	49
A R & M CORP TONAWANDA TERM	3733 RIVER RD	1/2 - 1 SSE	F38	49
TNT PILOT FREIGHT INC.	4400 RIVER ROAD	1/2 - 1 NNE	G44	54
CAROLINA FREIGHT CARRIERS CORP	4425 RIVER RD	1/2 - 1 NNE	G46	55
CHEMCENTRAL/BUFFALO	3709 RIVER RD	1/2 - 1 SSE	H51	61
OVERLAND EXPRESS INTL	4500 RIVER RD	1/2 - 1 NNE	I53	62
MOBIL OIL GASOLINE ADDITIVE TK	4545 RIVER RD	1/2 - 1 NNE	I55	65
ASHLAND OIL	4545 RIVER ROAD	1/2 - 1 NNE	I58	69
ASHLAND PETROLEUM-CANLAKE TRUC	740 GRAND ISLAND BLVD	1/2 - 1 ENE	62	76
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 SSE	64	77
OCCIDENTAL CHEMICAL CORP	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K66	84
NOCO ENERGY CORP	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K68	85
ASHLAND PETROLEUM CO	4625 RIVER RD	1/2 - 1 NNE	J72	105
AGWAY PETROLEM CORP	4635 RIVER RD	1/2 - 1 NNE	J75	116
CARMEN M PARISO INC	3649 RIVER RD	1/2 - 1 SSE	L78	119
TEXACO USA /A DIV OF TEXACO IN	RIVER RD & JAMES ST	1/2 - 1 SSE	L79	119
CROMWELL METALS INC	1740 BROADWAY	1 - 2 WNW	82	122
LAKEHEAD PIPE LINE CO INC	4700 RIVER RD	1 - 2 NNE	N84	123
NIAGARA LANDFILL	4825 RIVER ROAD	1 - 2 NNE	N86	124
SEAWAY IND WASTE DSPL	4825 RIVER RD	1 - 2 NNE	N87	124
FMC CORP	34 SAWYER AVE.	1 - 2 SSE	O93	138
GOETZ ENERGY CORP	87 SAWYER AVE	1 - 2 SSE	P97	143
CENTRAL FOUNDRY	91 SAWYER AVE	1 - 2 SSE	P99	144
KURK FUEL OIL CO	130 SAWYER AVE	1 - 2 SE	Q100	144
CONRAIL FRONTIER CAR SHOP	1800 BROADWAY	1 - 2 WNW	R104	146
WESTERN NEW YORK BARREL & DRUM	225 SAWYER AVE	1 - 2 SE	T109	151
R W WEAVER CORP DBA ANCHOR MAR	1501 FERRY RD	1 - 2 SSW	U110	151
LYONS TRAN LINES INC	410 GRAND ISLAND BLVD	1 - 2 E	V114	154
A B F FREIGHT SYSTEMS INC	50 FLYDER AVE	1 - 2 ESE	I16	155
GENERAL MILLS INC	305 SAWYER AVE	1 - 2 SE	W129	184

SPILLS: The Spills Information Database from The Department of Environmental Conservation.

A review of the NY Spills list, as provided by EDR, and dated 12/31/1996 has revealed that there are 76 NY Spills sites within approximately 1.25 Miles of the subject property.

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
INS SCRAP	4111 RIVER RD	0 - 1/8 ESE	A2	9
MARATHON PETROLEUM	4000 RIVER RD	1/8 - 1/4 SSE	B9	23
ROBLIN STEEL	4000 RIVER RD	1/8 - 1/4 SSE	B12	26
WICK WIRE FACTORY	4000 RIVER RD	1/8 - 1/4 SSE	B17	30
SIVACO NEW YORK INC	3937 RIVER RD	1/4 - 1/2 SSE	C19	31
SIVACO 3937 RIVER ROAD	3937 RIVER RD	1/4 - 1/2 SSE	C20	32
SIVACO NY COMPANY	3937 RIVER RD	1/4 - 1/2 SSE	C21	33
TONAWANDA COKE INC	3875 RIVER RD	1/4 - 1/2 SSE	C26	39
NOCO ENERGY	4363 RIVER RD	1/4 - 1/2 NNE	E29	44
NOCO ENERGY	4365 RIVER RD	1/4 - 1/2 NNE	E31	45

NRG019591

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
SUN REFINING	3755 RIVER RD	1/2 - 1 SSE	D33	46
GOETZ OIL	3755 RIVER RD	1/2 - 1 SSE	D36	48
ISLAND MARINA	1093 EAST RIVER ROAD	1/2 - 1 WNW	41	51
CHEMICAL WASTE MGMT	4400 RIVER RD	1/2 - 1 NNE	G42	52
ABF / ESTES FREIGHT	4425 RIVER RD	1/2 - 1 NNE	G45	54
CAPTAINS COVE	4444 RIVER RD	1/2 - 1 NNE	48	58
SHEEN IN RIVER	787 NORTH COLONY	1/2 - 1 WSW	49	58
CHEMCENTRAL/BUFFALO	3709 RIVER RD	1/2 - 1 SSE	H50	59
UNITED REFINING	4545 RIVER RD	1/2 - 1 NNE	I54	63
UNITED REFINING TERMINAL	4545 RIVER RD	1/2 - 1 NNE	I57	66
SHEEN IN NIAGARA RIVER	4545 RIVER RD	1/2 - 1 NNE	I59	70
ASHLAND OIL	4545 RIVER RD	1/2 - 1 NNE	I60	71
LAKEHEAD PIPE LINE CO.	4570 RIVER RD	1/2 - 1 NNE	J63	76
ASHLAND CHEMICAL CO	3701 RIVER RD	1/2 - 1 SSE	64	77
NOCO MOTOR FUELS INC	661 MAIN ST	1/2 - 1 ENE	K65	80
NOCO ENERGY CORP	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K68	85
NOCO - 700 RIVER ROAD	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K69	102
NOCO ENERGY - TERMINAL	700 GRAND ISLAND BLVD	1/2 - 1 ENE	K70	103
ASHLAND PETROLEUM CO	4625 RIVER RD	1/2 - 1 NNE	J72	105
LEAKING DRUMS AT NOCO	4635 RIVER RD	1/2 - 1 NNE	J73	106
NOCO ENERGY CORP S-T	4635 RIVER RD	1/2 - 1 NNE	J74	107
AGWAY PETROLEM CORP	4635 RIVER RD	1/2 - 1 NNE	J75	116
PAINTING DOCK IN RIVER	48 MELROSE	1/2 - 1 SW	76	117
RIVER ROAD DITCH	3688 RIVER RD	1/2 - 1 SSE	L77	118
OIL FROM DISCARDED TANK	71 CAROL LANE	1/2 - 1 W	80	120
NOCO ENERGY PRODUCTS III	100 JAMES AVE	1 - 2 SSE	M81	121
PETROLEUM IN DITCH	4700 RIVER RD	1 - 2 NNE	N83	122
LAKHEAD RIVER ROAD	4700 RIVER RD	1 - 2 NNE	N85	123
CHEMICAL/OIL ODOR	83 KAUFMAN AVE	1 - 2 SSE	M88	125
FMC CORPORATION	35 SAWYER AVE	1 - 2 SSE	O89	125
FMC CORPORATION	39 SAWYER AVE	1 - 2 SSE	O90	129
FMC CORP-BUFFALO PLANT	37 SAWYER AVE	1 - 2 SSE	O91	130
FMC CORPORATION	37 SAWYER AVE	1 - 2 SSE	O92	137
GOETZ ENERGY	85 SAWYER AVE	1 - 2 SSE	P94	140
NIAGARA MOHAWK	87 SAWYER AVE	1 - 2 SSE	P95	141
BROSKIN ENTERPRISES, INC.	87 SAWYER AVE	1 - 2 SSE	P98	143
Not reported	130 SAWYER AVE	1 - 2 SE	Q101	145
LAUGHLIN	130 SAWYER AVE	1 - 2 SE	Q102	145
ACID ON DRIVEWAY	10 WEST PARK COURT	1 - 2 NW	105	147
BESTWAY TRUCKING	500 GRAND ISLAND BLVD	1 - 2 E	S106	148
LOGISTIC PARTNERS	500 GRAND ISLAND BLVD	1 - 2 E	S107	149
WESTERN NY DRUM CO.	225 SAWYER AVE	1 - 2 SE	T108	150
ANCHOR MARINE	1501 FERRY ROAD	1 - 2 SSW	U111	152
VILLAGE INN	1510 FERRY STREET	1 - 2 SSW	U112	152
ANCHOR MARINE	1509 FERRY STREET	1 - 2 SSW	U113	153
GRIFFITH OIL	410 GRAND ISLAND BLVD	1 - 2 E	V115	154
MESMER DAIRY	1815 LOVE ROAD	1 - 2 WNW	117	155
3M COMPANY	305 SAWYER AVE	1 - 2 SE	W118	157
3M TONAWANDA	305 SAWYER AVENUE	1 - 2 SE	W119	158
OCELLO	305 SAWYER AVE	1 - 2 SE	W120	175
3M O-CELLO	305 SAWYER AVE	1 - 2 SE	W122	177
TRAFFIC ACCIDENT	305 SAWYER AVE	1 - 2 SE	W123	178
3M O-CEL-O	305 SAWYER AVE	1 - 2 SE	W124	179
O-CEL-O 3M	305 SAWYER AVE	1 - 2 SE	W125	180
3M O-CELL-O	305 SAWYER AVE	1 - 2 SE	W126	181
3-M	305 SAWYER AVE	1 - 2 SE	W127	182

NRG019592

EXECUTIVE SUMMARY

<u>Equal/Higher Elevation</u>	<u>Address</u>	<u>Dist / Dir</u>	<u>Map ID</u>	<u>Page</u>
3M O'CELLO	305 SAWYER AVE	1 - 2 SE	W128	183
GENERAL MILLS INC	305 SAWYER AVE	1 - 2 SE	W129	184
3-M COMPANY	305 SAWYER AVE	1 - 2 SE	W130	186
3M CORPORATION	305 SAWYER AVE	1 - 2 SE	W131	187
O-CELL-O	305 SAWYER AVE	1 - 2 SE	W132	196
3M OCELLO	305 SAWYER AVE	1 - 2 SE	W133	197
O'CELLO DIVISION	305 SAWYER AVE	1 - 2 SE	W134	199
3M O-CEL-O	305 SAWYER AVE	1 - 2 SE	W135	200
O-CEL-O	305 SAWYER AVE	1 - 2 SE	W136	201
3-M O'CELLO PLANT	305 SAWYER AVE	1 - 2 SE	W137	203

NRG019593

EXECUTIVE SUMMARY

Due to poor or inadequate address information, the following sites were not mapped:

<u>Site Name</u>	<u>Database(s)</u>
SEAWAY/NIAGARA LANDFILL, INC.	SHWS, LUST, NY Spills
MOBIL	LUST
DUPONT BOAT CLUB	LUST
NOCO - SUN PIPELINE	LUST
APA TRANSPORT	LUST
OIL SHEEN IN RIVER	LUST
SUN TERMINAL(ATLANTIC)	LUST
TONAWANDA ENGINE PLANT	LUST
NIAGARA MOHAWK	LUST, NY Spills
NOCO ENERGY TANK 122	LUST
AGWAY	LUST
VAN DE WATER WATER PLANT	LUST
NOCO OIL	LUST
NOCO ENERGY	LUST, NY Spills
UNITED REFINING	LUST, NY Spills
CPC GROUP	LUST
CPC TONAWANDA	LUST
CHARLIE FASO BACKYARD	LUST
CHEVROLET ENGINE PLANT	LUST
GOETZ - FMC	LUST, NY Spills
M.L YOUNG MOTOR EXPRESS	LUST
NYS THRUWAY AUTH	RCRIS-SQG, FINDS
NATL FUEL GAS CO REG STA TN RM 508	RCRIS-SQG, FINDS
US TRANSCO	RCRIS-SQG
NYS THRUWAY AUTH	FINDS, RCRIS-LQG
STATION 133	FINDS, RCRIS-LQG
SVC STA	FINDS, RCRIS-LQG
NYSDOT BIN 1044960	FINDS, RCRIS-LQG
TERMINAL STATION C	FINDS, RCRIS-LQG
NYS THRUWAY AUTH	FINDS, RCRIS-LQG
E.R. WILLIAMS INC.	NY Spills
STORM SEWER TO ELLICOTT C	NY Spills
NIAGARA MOHAWK - HUNTLEY	NY Spills
HUNTLEY COAL PLANT	NY Spills
C.P.C. GROUP	NY Spills

NRG019594

TOPOGRAPHIC MAP - 1201713.15p - Fluor Daniel GTI



- ↘ Major Roads
- ⌒ Contour Lines
- ⌒ Waterways
- ★ Earthquake epicenter, Richter 5 or greater
- Ⓜ Closest Federal Well in quadrant
- Ⓢ Closest State Well in quadrant
- Ⓜ Closest Public Water Supply Well

(HD) Closest Hydrogeological Data



TARGET PROPERTY: ADDRESS: CITY/STATE/ZIP:	C.R. Huntley Fly Ash Landfill River Rd Tonawanda, NY 14150	CUSTOMER: CONTACT: INQUIRY #:	Fluor Daniel GTI Rich Hixon 4041713.15p
--	--	--	---

NRG019595

GEOCHECK VERSION 2.1 SUMMARY

TARGET PROPERTY COORDINATES

Latitude (North): 42.987499 - 42° 59' 15.0"
 Longitude (West): 78.937500 - 78° 56' 15.0"
 Universal Transverse Mercator: Zone 17
 UTM X (Meters): 668152.4
 UTM Y (Meters): 4761276.0

GEOLOGIC AGE IDENTIFICATION†

Geologic Code: S3
 Era: Paleozoic
 System: Silurian
 Series: Upper Silurian (Cayugan)

ROCK STRATIGRAPHIC UNIT†

Category: Stratified Sequence

GROUNDWATER FLOW INFORMATION

Groundwater flow direction for a particular site is best determined by a qualified environmental professional using site-specific well data. If such data is not reasonably ascertainable, it may be necessary to rely on other sources of information, including well data collected on nearby properties, regional groundwater flow information (from deep aquifers), or surface topography.‡

General Topographic Gradient: General West
 General Hydrogeologic Gradient: No hydrogeologic data available.
 Site-Specific Hydrogeological Data*:
 Search Radius: 2.0 miles
 Status: Not found

USGS TOPOGRAPHIC MAP ASSOCIATED WITH THIS SITE

Target Property: 2442078-H8 BUFFALO NW, NY CA10

FEDERAL DATABASE WELL INFORMATION

WELL QUADRANT	DISTANCE FROM TP	LITHOLOGY	DEPTH TO WATER TABLE
Northern	>2 Miles	Shale	Not Reported
Western	>2 Miles	Shale	18 ft.

STATE DATABASE WELL INFORMATION

WELL QUADRANT	DISTANCE FROM TP
Northern	>2 Miles
Southern	1 - 2 Miles
Western	>2 Miles

PUBLIC WATER SUPPLY SYSTEM INFORMATION (EPA-FRDS)

Searched by Nearest Well.

NOTE: PWS System location is not always the same as well location.

PWS Name: ERIE COUNTY WATER AUTHORITY
 ELLICOTT SQUARE BUILDING
 BUFFALO, NY 14203

Location Relative to TP: 1 - 2 Miles South

Well currently has or has had major violation(s): No

NRG019596

† Source: P.G. Schruben, R.E. Arndt and W.J. Bewick, Geology of the Conterminous U.S. at 1:2,500,000 Scale - A digital representation of the 1974 P.B. King and H.M. Bellman Map, USGS Digital Data Series DDS - 11 (1994).
 ‡ U.S. EPA Ground Water Handbook, Vol I: Ground Water and Contamination, Office of Research and development EPA/625/6-90/016a, Chapter 4, page 78, September 1990.

**GEOCHECK VERSION 2.1
SUMMARY**

AREA RADON INFORMATION

EPA Radon Zone for ERIE County: 1 .

Note: Zone 1 indoor average level > 4pCi/L
: Zone 2 indoor average level >= 2pCi/L
: Zone 3 indoor average level < 2pCi/L


ERIE COUNTY, NY

Number of sites tested: 622

<u>Area</u>	<u>Average Activity</u>	<u>% <4 pCi/L</u>	<u>% 4-20 pCi/L</u>	<u>% >20 pCi/L</u>
Living Area	1.000 pCi/L	89%	11%	0%
Basement	1.150 pCi/L	87%	11%	2%


NRG019597

OVERVIEW MAP - 1201713.15p - Fluor Daniel GTI

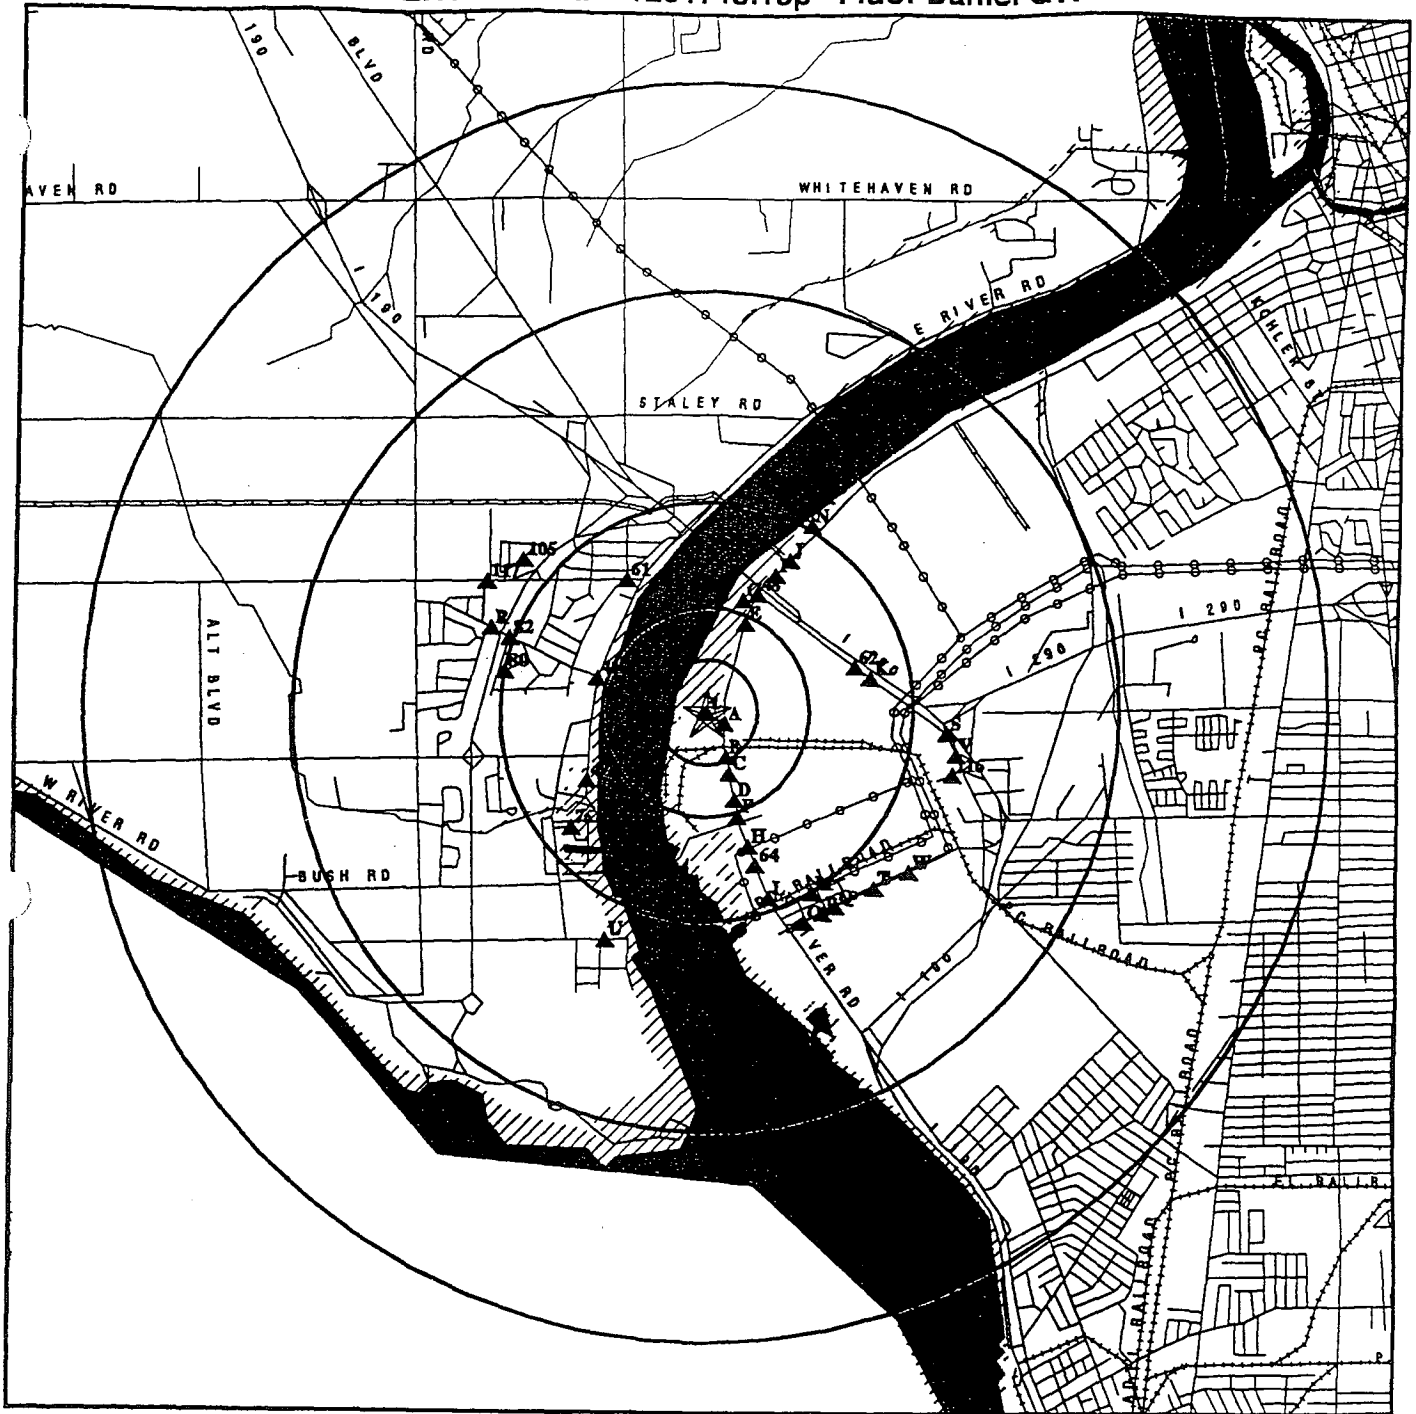


- ★ Target Property
- ▲ Sites at elevations higher than or equal to the target property
- ◆ Sites at elevations lower than the target property
- ▲ Coal Gasification Sites (if requested)
- ▨ National Priority List Sites
- ▩ Landfill Sites

- Power transmission lines
- Oil & Gas pipelines
- ▨ 100-year flood zone
- ▩ 500-year flood zone



TARGET PROPERTY:	C.R. Huntley Fly Ash Landfill	CUSTOMER:	Fluor Daniel GTI
ADDRESS:	River Rd	CONTACT:	Rich Hixon
CITY/STATE/ZIP:	Tonawanda NY 14150	INQUIRY #:	1201713.15p
			NRG019598

DETAIL MAP - 1201713.15p - Fluor Daniel GTI

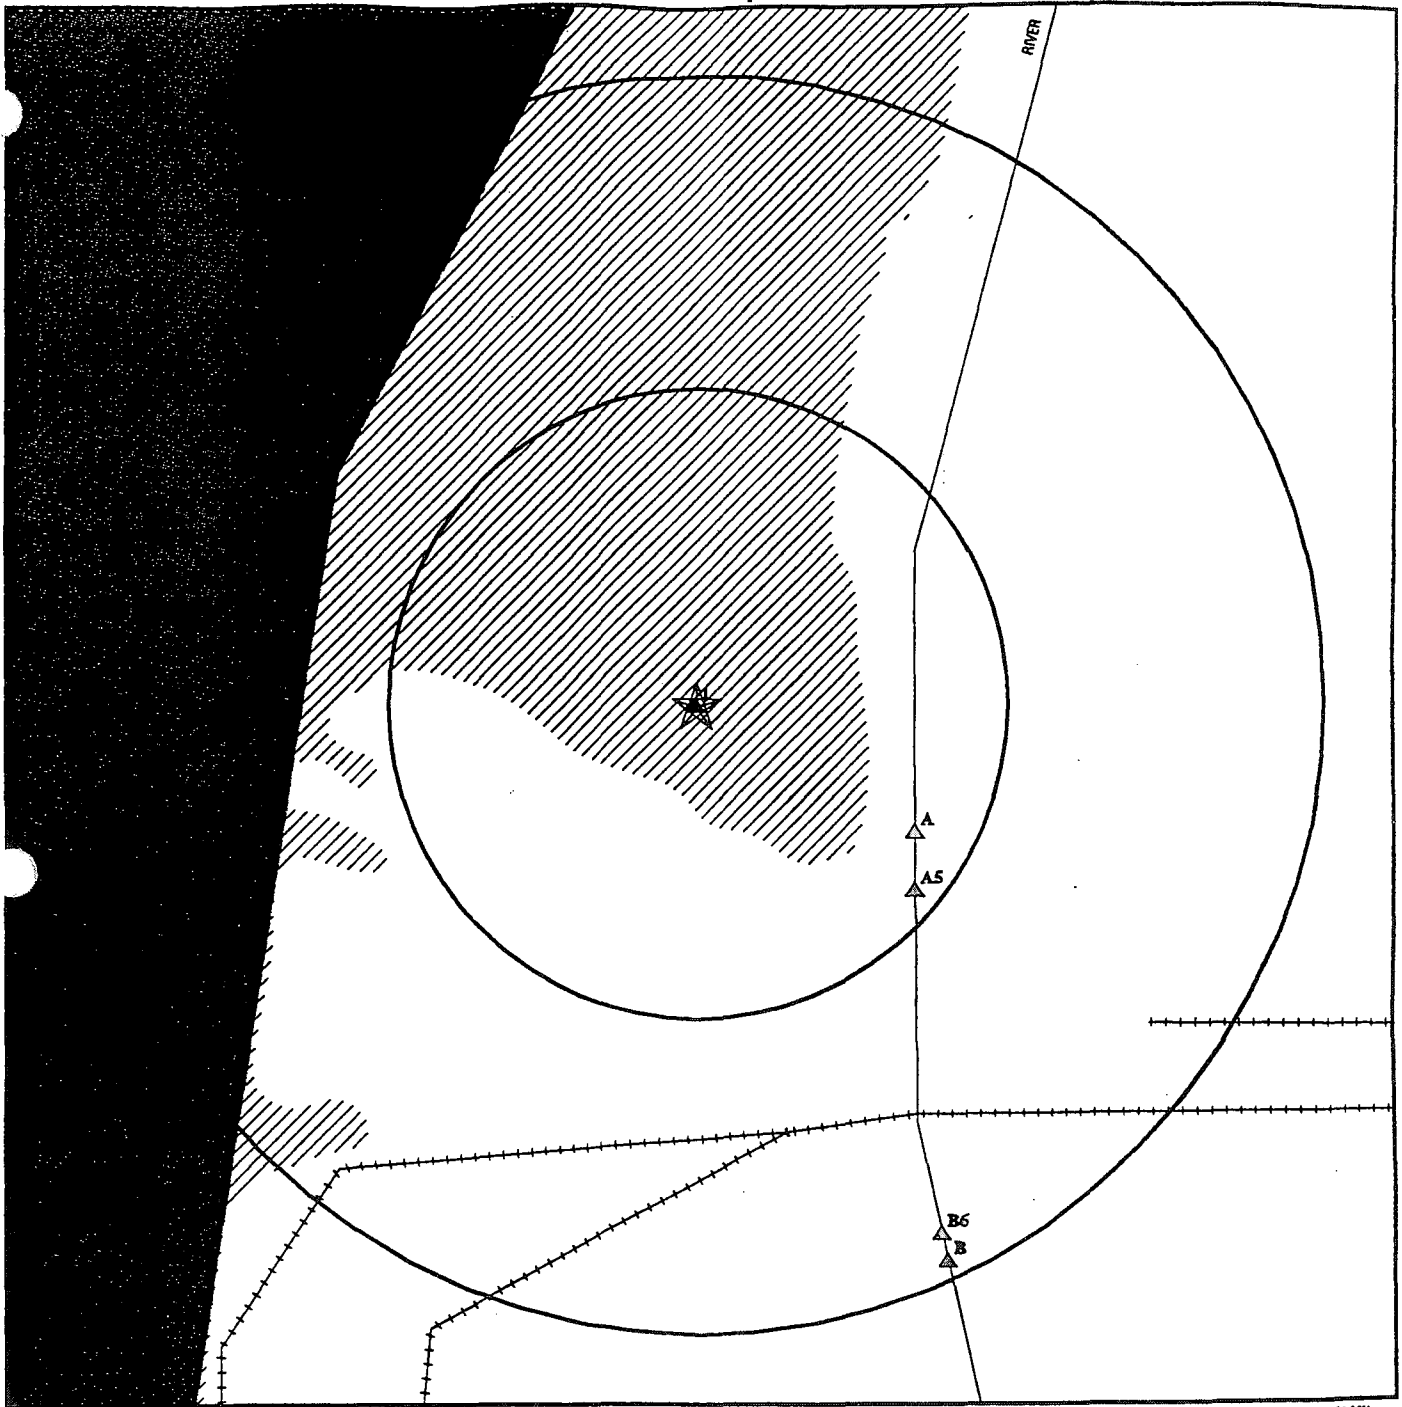

- ★ Target Property
- ▲ Sites at elevations higher than or equal to the target property
- ◊ Sites at elevations lower than the target property
- ▲ Coal Gasification Sites (if requested)
- ⊕ Sensitive Receptors
- ⊕ National Priority List Sites
- ⊕ Landfill Sites

- N Power transmission lines
- N Oil & Gas pipelines
- ▨ 100-year flood zone
- ▨ 500-year flood zone



TARGET PROPERTY: ADDRESS:	C.R. Huntley Fly Ash Landfill River Rd	CUSTOMER: CONTACT:	Fluor Daniel GTI Rich Hixon	NRG019599
------------------------------	---	-----------------------	--------------------------------	-----------

**MAP FINDINGS SUMMARY SHOWING
ALL SITES**

Database	Target Property	Search Distance (Miles)	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
NPL		1.250	0	0	0	0	0	0
Delisted NPL	TP		NR	NR	NR	NR	NR	0
RCRIS-TSD		1.250	0	0	0	0	0	0
State Haz. Waste		1.250	0	3	1	1	2	7
CERCLIS		1.250	0	1	0	2	1	4
CERC-NFRAP	TP		NR	NR	NR	NR	NR	0
CORRACTS		1.250	0	1	1	0	1	3
State Landfill		1.250	1	0	1	1	0	3
LUST		0.750	0	0	3	11	NR	14
UST		0.500	1	0	0	NR	NR	1
AST		0.500	0	1	2	NR	NR	3
RAATS		1.250	0	1	0	0	0	1
RCRIS Sm. Quan. Gen.		1.250	0	3	0	6	6	15
RCRIS Lg. Quan. Gen.		1.250	0	4	3	9	5	21
HMIRS	TP		NR	NR	NR	NR	NR	0
PADS	TP		NR	NR	NR	NR	NR	0
ERNS		1.250	0	0	1	1	0	2
FINDS	X	1.250	1	8	4	17	14	44
TRIS	TP		NR	NR	NR	NR	NR	0
NPL Liens	TP		NR	NR	NR	NR	NR	0
TSCA	TP		NR	NR	NR	NR	NR	0
MLTS		1.250	0	0	0	0	0	0
NY Spills		1.250	1	3	6	25	41	76
ROD		1.250	0	0	0	0	0	0
CONSENT		1.250	0	0	0	0	0	0
Coal Gas		1.000	0	0	0	0	NR	0

TP = Target Property

NR = Not Requested at this Search Distance

* Sites may be listed in more than one database

NRG019600

**MAP FINDINGS SUMMARY SHOWING
ONLY SITES HIGHER THAN OR THE SAME ELEVATION AS TP**

Database	Target Property	Search Distance (Miles)	< 1/8	1/8 - 1/4	1/4 - 1/2	1/2 - 1	> 1	Total Plotted
NPL		1.250	0	0	0	0	0	0
Delisted NPL	TP		NR	NR	NR	NR	NR	0
RCRIS-TSD		1.250	0	0	0	0	0	0
State Haz. Waste		1.250	0	3	1	1	2	7
CERCLIS		1.250	0	1	0	2	1	4
CERC-NFRAP	TP		NR	NR	NR	NR	NR	0
CORRACTS		1.250	0	1	1	0	1	3
State Landfill		1.250	1	0	1	1	0	3
LUST		0.750	0	0	3	11	NR	14
UST		0.500	1	0	0	NR	NR	1
AST		0.500	0	1	2	NR	NR	3
RAATS		1.250	0	1	0	0	0	1
RCRIS Sm. Quan. Gen.		1.250	0	3	0	6	6	15
RCRIS Lg. Quan. Gen.		1.250	0	4	3	9	5	21
HMIRS	TP		NR	NR	NR	NR	NR	0
PADS	TP		NR	NR	NR	NR	NR	0
ERNS		1.250	0	0	1	1	0	2
FINDS	X	1.250	1	8	4	17	14	44
TRIS	TP		NR	NR	NR	NR	NR	0
NPL Liens	TP		NR	NR	NR	NR	NR	0
TSCA	TP		NR	NR	NR	NR	NR	0
MLTS		1.250	0	0	0	0	0	0
NY Spills		1.250	1	3	6	25	41	76
ROD		1.250	0	0	0	0	0	0
CONSENT		1.250	0	0	0	0	0	0
Coal Gas		1.000	0	0	0	0	NR	0

TP = Target Property

NR = Not Requested at this Search Distance

* Sites may be listed in more than one database

NRG019601

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

Coal Gas Site Search: No site was found in a search of Real Property Scan's ENVIROHAZ database.

1	CR HUNTLEY FLY ASH LDFL	FINDS	1000961528
Target	RIVER RD		NY0000557496
Property	TONAWANDA, NY 14150		

FINDS:
Other Pertinent Environmental Activity Identified at Site:
- Facility has an active water discharge permit (under PCS)

A2	INS SCRAP	NY Spills	S102179169
ESE	4111 RIVER RD		N/A
< 1/8	TONAWANDA, NY		
Higher			

SPILLS:

<p>Facility ID: 8504923 Facility Contact: Not reported Investigator: LQR Caller Name: Not reported Caller Phone: Not reported Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: I. N. S. Address: 4111 RIVER ROAD TONAWANDA, N. Y. 14150</p>	<p>Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: Not reported Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: Not reported</p>
<p>Spill Class: Not reported Spill Closed Dt: 08/12/1986 Spill Cause: Housekeeping Water Affected: DITCH Spill Notifier: DEC Spill Date: 03/28/1986 15:00 Cleanup Ceased: 08/12/1986 Last Inspection: 08/12/1986 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 11/08/1994 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 06/27/1986 Remark: DITCH BETWEEN INS AND TONAWANDA COKE</p>	<p>Resource Affected: Surface Water Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 03/28/1986 15:00</p>

A3	INS EQUIPMENT	FINDS	1000112821
ESE	RIVER RD		CERC-NFRAP NYD071470033
< 1/8	TONAWANDA, NY 14150		
Higher			

CERCLIS-NFRAP Classification Data:

<p>Site Incident Category: Not reported Ownership Status: OTHER EPA Notes: Not reported</p>	<p>Federal Facility: NO NPL Status: NOT ON NPL</p>
CERCLIS-NFRAP Assessment History:	
Assessment: PRELIMINARY ASSESSMENT	Completed: 09/01/84

NRG019602

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

INS EQUIPMENT (Continued)

1000112821

Assessment:	SCREENING SITE INSPECTION	Completed:	05/31/85
Assessment:	DISCOVERY	Completed:	09/01/84
CERCLIS-NFRAP Alias Name(s):			
RIVER ROAD SITE			

**A4
ESE
< 1/8
Higher**

**TONAWANDA, PLOT 34 P1-30
4111 RIVER RD
TONAWANDA, NY 14150**

SWF/LF

S101650759
N/A

LF:

Facility ID: 15S33	Telephone: Not reported
DEC Region: 9	Permit #: Not reported
Permit issue date: Not reported	Permit Expires: Not reported
Authrzd/Operate Dt: Not reported	Constrct Perm #: Not reported
Auth. to Construct: Not reported	Const Permit Exp: Not reported
Regulatory Status: None	Receiving Waste: False
Started Rec Waste: Not reported	Stop Rec Waste: Not reported
Aquifer: none	
Date Ordered On Consent Signed: Not reported	
Accomplish Date Of Order: Not reported	
Inactive HWS: False	inactive HWS Num: 0
Inactive HWS Class: Not reported	
Waste type: Not reported	
Owner Name: INS EQUIPMENT CO, INC	Owner Type: Private
Mail Address: 4111 RIVER RD TONAWANDA, NY 14150	
Owner Phone Num: Not reported	Operator Name: INS EQUIPMENT CO, INC
Ny Transverse Mercator Coordinates East: 181100	
Ny Transverse Mercator Coordinates North: 4768700	
Annual Report Submitted to ALB:	
1989: False	1990: False
1991: False	1992: False
1993: False	1994: False
1995: False	
1996: False	
Primary Liner: Not reported	Secondary Liner: Not reported
Annual Rprt Waived: Not reported	Tiping Fee Rprtd: Not reported

**A5
SE
< 1/8
Higher**

**PINE HILL MATERIALS CORP
4100 RIVER ROAD
TONAWANDA, NY 14150**

UST

U003153369
N/A

NRG019603

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

PINE HILL MATERIALS CORP (Continued)

U003153369

PBS UST:

Facility ID:	9-600290	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-8788	Location:	Not reported
Operator:	JAMES LEISING		
Contact:	Not reported		
Emergency Contact:	JAMES LEISING, (716) 876-8788		
Facility Type:	DF		
Total Tanks:	1	Old PBS Num:	Not reported
Owner:	PINE HILL MATERIALS CORP 2255 BAILEY AVENUE BUFFALO, NY 14211 (716) 894-2255		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	PINE HILL MATERIALS CORP 2255 BAILEY AVE NY 14211 (716) 894-2255 ATTN: MR. LEN STUDLEY		
Facility Status:	Active	Total Capacity:	8000
Certification:	04/24/1997	Expiration:	12/06/1901
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	04/88
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Above/Underground Combination	Pipe Type:	FIBERGLASS [FRP]
Tank External:	NONE/SACRIFICIAL ANODE		
Pipe External:	NONE/FIBERGLASS		
Second Containment:	NONE/DOUBLED-WALLED TANK		
Leak Detection:	NONE/INTERSTITIAL MONITORING		
Overfill Prot:	Float Vent Valve	Dispenser:	Submersible
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Database Type:	Not reported		

**B6
SSE
1/8-1/4
Higher**

**CLARENCE MATERIALS CORP
4010 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000554143
RCRIS-LQG NYD986966000**

RCRIS:

Owner: CLARENCE MATERIALS CORP
(212) 555-1212

Contact: JAMES PFALZER
(716) 632-2000

Record Date: 06/20/91

Classification: Large Quantity Generator

NRG019604

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

CLARENCE MATERIALS CORP (Continued)		1000554143
Used Oil Recyc: No		
Violation Status: No violations found		

**B7
SSE
1/8-1/4
Higher**

NIAGARA MOHAWK - CHERRY FARM RIVER ROAD (NEAR 4000 RIVER ROAD) TONAWANDA, NY 14150	SHWS	S101008675 N/A
---	-------------	---------------------------

SHWS:

Facility ID:	915063	EPA ID:	NYD003909694
Owner:	Niagara Mohawk attn: J. Toennies 300 Erie Blvd West Syracuse, NY 13202		
Owner Telephone:	Not reported		
Operator:	Not reported Not reported Not reported		
Contact:	Not reported	Telephone:	Not reported
Site Classification:	Significant threat to the public health or environment - action required.		
Region:	9		
Site Type:	Dump		
Acres:	50	User:	C.F.&I. Steel, Pueblo, CO.
HW Started:	1950's	HW Ended:	1970's
HW Disposed:	PCB waste		
Units:	unknown		
Air Data:	Unavailable		
Gmd. Water Data:	Available	Surf. Water Data:	Available
Sediment Data:	Available	Soil Data:	Available
Ground Water Standards Contravention:	Yes		
Drinking Water Standards Contravention:	No		
Surface Water Standards Contravention:	Yes		
Air Standards Contravention:	No		
Enforcement Status:	Order Has Been Signed	Legal Action:	No
State Action:	Yes	Fed Action:	No
Remedial Action:	In Progress		
Remed action type:	RD-RA, Waste containment, GW collection-treatment		
Soil Type:	Fill material followed by fine sand		
Gmd Water Depth:	Approx. 20 ft.		

NRG019605

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NIAGARA MOHAWK - CHERRY FARM (Continued)

S101008675

Assessment of Environmental Problems:

Soil data indicates concentrations in excess of background levels for some of the heavy metals. Surface water analysis indicated presence of chlorinated organics and heavy metals in the samples. PCB's were detected in subsurface soils, sediments, and groundwater.

Assessment of Health Problems:

The most likely route of exposure is direct contact with contaminated soil and surface water. Although a fence has been installed around the site, the integrity has been compromised in some locations. Groundwater from this site contributes to the contamination of the Niagara River in two possible ways: (1) groundwater flows directly into the River and (2) leachate from the site flows directly into the River. The area is provided with public water, while there are many private industrial wells in the area. The site is to be covered and the side wall grades modified. Groundwater extraction wells are to be installed along the river's edge with the groundwater treated prior to discharge to the wastewater treatment plant.

**B8
SSE
1/8-1/4
Higher**

**MARATHON OIL COMPANY
4000 RIVER RD
TONAWANDA, NY 14150**

AST

**A100086324
N/A**

NRG019606

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

MOSF AST:

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121		
Owner Type:	Corporate/Commercial	CASNO:	Not reported
Tank Status:	Closed-Removed	Tank ID:	6-4
Total Tanks:	10	Daily Throughput	64000 Gal(s)
Tank Location:	ABOVEGROUND	Capacity (Gal):	249774
Install Date:	10/68		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	ASPHALT	Dispenser:	Suction
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Test Date:	Not reported	Date Closed:	03/95
Dispensing Mthd:	Suction	Facility Town:	TONAWANDA
SWIS Code:	14		
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019607

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121		
Owner Type:	Corporate/Commercial	CASNO:	Not reported
Tank Status:	Temporarily Out Of Service	Tank ID:	T-5
Total Tanks:	10	Daily Throughput:	64000 Gal(s)
Tank Location:	ABOVEGROUND	Capacity (Gal):	10000
Install Date:	09/68		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	EMPTY	Dispenser:	Suction
Pipe Location:	Above/Underground Combination		
Pipe Internal:	NONE		
Pipe External:	IMPRESSED CURRENT		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	None		
Test Date:	Not reported	Date Closed:	Not reported
Dispensing Mthd:	Suction		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019608

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121		
Owner Type:	Corporate/Commercial	CASNO:	Not reported
Tank Status:	Temporarily Out Of Service	Tank ID:	T-7
Total Tanks:	10	Daily Throughput:	64000 Gal(s)
Tank Location:	ABOVEGROUND	Capacity (Gal):	10000
Install Date:	09/68		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	EMPTY	Dispenser:	Gravity
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	None		
Test Date:	Not reported	Date Closed:	Not reported
Dispensing Mthd:	Gravity		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019609

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121	CASNO:	Not reported
Owner Type:	Corporate/Commercial	Tank ID:	24-6
Tank Status:	Closed-Removed	Daily Throughput:	64000 Gal(s)
Total Tanks:	10	Capacity (Gal):	996408
Tank Location:	ABOVEGROUND		
Install Date:	09/68		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	ASPHALT	Dispenser:	Suction
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Test Date:	Not reported	Date Closed:	03/95
Dispensing Mthd:	Suction		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019610

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121	CASNO:	Not reported
Owner Type:	Corporate/Commercial	Tank ID:	35-2
Tank Status:	Closed-Removed	Daily Throughput	64000 Gal(s)
Total Tanks:	10	Capacity (Gal):	1492932
Tank Location:	ABOVEGROUND		
Install Date:	11/74		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	ASPHALT	Dispenser:	Suction
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Test Date:	Not reported	Date Closed:	06/92
Dispensing Mthd:	Suction		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019611

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840 (419) 422-2121		
Owner Tel:	(419) 422-2121	CASNO:	Not reported
Owner Type:	Corporate/Commercial	Tank ID:	42-3
Tank Status:	Closed-Removed	Daily Throughput:	64000 Gal(s)
Total Tanks:	10	Capacity (Gal):	1768242
Tank Location:	ABOVEGROUND		
Install Date:	09/68		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	ASPHALT	Dispenser:	Suction
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Test Date:	Not reported	Date Closed:	05/93
Dispensing Mthd:	Suction		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019612

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121	CASNO:	Not reported
Owner Type:	Corporate/Commercial	Tank ID:	55-1
Tank Status:	Closed-Removed	Daily Throughput:	64000 Gal(s)
Total Tanks:	10	Capacity (Gal):	2323944
Tank Location:	ABOVEGROUND		
Install Date:	11/74		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	ASPHALT	Dispenser:	Suction
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE		
Second Contain:	EARTHEN DIKE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Test Date:	Not reported	Date Closed:	03/95
Dispensing Mthd:	Suction	Facility Town:	TONAWANDA
SWIS Code:	14		
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck		
	Vessel/Barge (Including off-shore platform)		

NRG019613

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121	CASNO:	Not reported
Owner Type:	Corporate/Commercial	Tank ID:	35-1
Tank Status:	In Service	Daily Throughput:	64000 Gal(s)
Total Tanks:	10	Capacity (Gal):	1470000
Tank Location:	ABOVEGROUND		
Install Date:	09/92		
Tank Type:	Steel/carbon steel	Tank Internal:	NONE
Tank External:	IMPRESSED CURRENT	Pipe Type:	STEEL/IRON
Product:	ASPHALT	Dispenser:	Suction
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	OTHER		
Second Contain:	EARTHEN DIKE		
Leak Detection:	INTERSTITIAL MONITORING		
Overfill Protection:	Catch Basin, Product Level Gauge		
Test Date:	Not reported	Date Closed:	Not reported
Dispensing Mthd:	Suction		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019614

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121		
Owner Type:	Corporate/Commercial	CASNO:	Not reported
Tank Status:	In Service	Tank ID:	55-2
Total Tanks:	10	Daily Throughput	64000 Gal(s)
Tank Location:	ABOVEGROUND		
Install Date:	10/93	Capacity (Gal):	2282500
Tank Type:	Steel/carbon steel		
Tank External:	IMPRESSED CURRENT		
Product:	ASPHALT	Tank Internal:	NONE
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE	Dispenser:	Suction
Pipe External:	OTHER		
Second Contain:	EARTHEN DIKE/IMPERVIOUS UNDERLAYMENT		
Leak Detection:	INTERSTITIAL MONITORING		
Overfill Protection:	Catch Basin, Product Level Gauge		
Test Date:	Not reported	Date Closed:	Not reported
Dispensing Mthd:	Suction		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

NRG019615

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON OIL COMPANY (Continued)

A100086324

Facility ID:	9-1400	Telephone:	(716) 877-2100
Facility Type:	Storage Terminal	Facility Contact:	ELDON L. SKELLY
Facility Status:	ACTIVE FACILITY		
Owner:	MARATHON OIL COMPANY 539 S. MAIN STREET FINDLAY, OH 45840		
Owner Tel:	(419) 422-2121		
Owner Type:	Corporate/Commercial	CASNO:	Not reported
Tank Status:	In Service	Tank ID:	25-3
Total Tanks:	10	Daily Throughput	64000 Gal(s)
Tank Location:	ABOVEGROUND	Capacity (Gal):	1069500
Install Date:	09/94		
Tank Type:	Steel/carbon steel		
Tank External:	IMPRESSED CURRENT/JACKETED		
Product:	ASPHALT	Tank Internal:	NONE
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE	Dispenser:	Not reported
Pipe External:	JACKETED		
Second Contain:	EARTHEN DIKE/IMPERVIOUS UNDERLAYMENT		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge, Other		
Test Date:	04/95	Date Closed:	Not reported
Dispensing Mthd:	Not reported		
SWIS Code:	14	Facility Town:	TONAWANDA
Mailing Name:	MARATHON OIL COMPANY 539 S. MAIN STREET ROOM 4111 OH 45840		
Mailing Contact:	D.E. SIEBOLD		
Mailing Phone:	(419) 421-2629		
Legal Agent:	C.T. CORPORATION SYSTEM 1633 BROADWAY NEW YORK, NY 10019		
Date Legal Agent Filed with Secretary of State:	01/54		
Name of Emergency Contact:	ELDON L. SKELLY		
Emergency Contact Telephone:	(716) 877-2100		
Chemical Bulk Storage Number:	Not reported		
Pollution Discharge Elimination System Num:	0-204927		
License Status:	License Issued		
Date License Application Received:	02/22/1994		
Date License Issued:	04/01/1994		
Date License Expires or Expired:	03/31/1999		
Product Transfer Operation:	Tank Truck Vessel/Barge (Including off-shore platform)		

B9
SSE
1/8-1/4
Higher

MARATHON PETROLEUM
4000 RIVER RD
TONAWANDA, NY

NY Spills

S102176334
N/A

NRG019616

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MARATHON PETROLEUM (Continued)

S102176334

SPILLS:

Facility ID:	8804429	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	BOB HARINGTON	Caller Agency:	MARATHON PETROLEUM
Caller Phone:	(419) 422-2121	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-2100
Spiller:	MARATHON PETROLEUM		
Address:	4000 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	12/20/1988	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/19/1988 14:02
Spill Date:	08/18/1988 21:00		
Cleanup Ceased:	12/20/1988		
Last Inspection:	12/16/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/27/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/20/1988		
Remark:	HEAT TRANSFER FLUID SPILLED FROM RUPTURED PRESSURE GAUGE		

**B10
SSE
1/8-1/4
Higher**

**RIVER ROAD SITE
4000 RIVER RD
TONAWANDA, NY 14150**

SHWS

**S101008742
N/A**

NRG019617

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RIVER ROAD SITE (Continued)

S101008742

SHWS:

Facility ID:	915031	EPA ID:	NYD071470033
Owner:	Matthew Duggan, Jr. 85 Crosby Blvd. Amherst, NY 14226		
Owner Telephone:	Not reported		
Operator:	INS Equipment River Road Tonawanda, NY 14150		
Contact:	Not reported	Telephone	Not reported
Site Classification:	Significant threat to the public health or environment - action required.		
Region:	9		
Site Type:	Dump		
Acres:	55	User:	Colorado Fuel and Iron
HW Started:	1960s	HW Ended:	1978
HW Disposed:	Pit sludge, Cutting oils, Grinding waste, PCBs		
Units:	unknown, unknown, unknown, unknown		
Air Data:	Unavailable	Surf. Water Data:	Unavailable
Gmd. Water Data:	Available	Soil Data:	Available
Sediment Data:	Available		
Ground Water Standards Contravention:	Yes		
Drinking Water Standards Contravention:	No		
Surface Water Standards Contravention:	No		
Air Standards Contravention:	No		
Enforcement Status:	Order Has Been Signed	Legal Action:	No
State Action:	Yes	Fed Action:	No
Remedial Action:	Under Design		
Remed action type:	RD-RA		
Soil Type:	Urban soil; non-homogeneous		
Gmd Water Depth:	15-20 feet below surface		

Assessment of Environmental Problems:

Concentrations of heavy metals were found in excess of background levels. Soil samples indicated the presence of organics in the soil. Liquid containing PCBs has been found in the western portion of the site. Groundwater is contaminated with PCBs, PAHs, metals and cyanide.

Assessment of Health Problems:

The Remedial Investigation documented the presence of heavy metals and organic chemicals including benzene, toluene, xylene in on-site soils. The most likely route of exposure is direct contact with contaminated soil. The site is unfenced but access is limited since the site is located along the Niagara River in an industrial part of the Town of Tonawanda. Although groundwater contamination has been reported the area is served by a public water supply system. Since the Niagara River is used for drinking water supplies, recreation and also supports a variety of aquatic wildlife a concern exists over the potential migration of these contaminants into the adjacent Niagara River. The proposed remedial action plan which includes LNAPL removal, groundwater extraction and treatment and a placement of a protective cap over the entire site should eliminate all routes of exposure. Deed restrictions to prevent activities that would intrude into the protective cap and waste would be put in place.

**B11
SSE
1/8-1/4
Higher**

**NIAGARA RIVER WORLD
4000 RIVER RD
TONAWANDA, NY 14150**

**RCRIS-SQG 1000232936
FINDS NYD986900074**

NRG019618

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site		Database(s)	EDR ID Number EPA ID Number
------	--	-------------	--------------------------------

NIAGARA RIVER WORLD (Continued)

1000232936

RCRIS:
 Owner: NIAGARA RIVER WORLD
 (212) 555-1212
 Contact: PETER GFROERER
 (716) 874-6670
 Record Date: 05/09/90
 Classification: Small Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

**B12
SSE
1/8-1/4
Higher**

**ROBLIN STEEL
4000 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000285107
CERC-NFRAP NYD000346858
SHWS
NY Spills**

CERCLIS-NFRAP Classification Data:

Site Incident Category: Not reported
 Ownership Status: OTHER
 EPA Notes: Not reported

Federal Facility: NO
 NPL Status: NOT ON NPL

CERCLIS-NFRAP Assessment History:

Assessment:	HAZARD RANKING DETERMINED	Completed:	05/01/83
Assessment:	SCREENING SITE INSPECTION	Completed:	05/01/83
Assessment:	PRELIMINARY ASSESSMENT	Completed:	09/01/84
Assessment:	DISCOVERY	Completed:	04/15/80
Assessment:	SCREENING SITE INSPECTION	Completed:	02/13/91
Assessment:	REMOVAL INVESTIGATION	Completed:	Not reported

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROBLIN STEEL (Continued)

1000285107

SHWS:

Facility ID: 915056 EPA ID: NYD000346858

Owner: Niagara River World
4000 River Road
Tonawanda, NY 14150

Owner Telephone: Not reported

Operator: Roblin Steel
4000 River Road
Tonawanda, NY 14150

Contact: Not reported Telephone: Not reported

Site Classification: Significant threat to the public health or environment - action required.

Region: 9

Site Type: Dump

Acres: Not reported User: Roblin Steel

HW Started: 1967 HW Ended: 1989

HW Disposed: Spent pickle liquor,, halogenated and non-halogenated solvents., F002, F003, F004 Wastes.

Units: 1-2 million gallons, > 68,000 gallons

Air Data: Unavailable Surf. Water Data: Unavailable

Gmd. Water Data: Available Soil Data: Available

Sediment Data: Available

Ground Water Standards Contravention: Yes

Drinking Water Standards Contravention: No

Surface Water Standards Contravention: No

Air Standards Contravention: No

Enforcement Status: Negotiation In Progress Legal Action: No

State Action: Yes Fed Action: No

Remedial Action: In Progress

Remed action type: Removal, pump and treat, soil vapor extraction

Soil Type: River deposits of sand and gravel

Gmd Water Depth: 5 feet

Assessment of Environmental Problems:

Gross contamination of the shallow groundwater with chlorinated solvents has been documented in the Envirotek leased area of the site. Significant groundwater contamination in other areas of the site is documented as well.

Assessment of Health Problems:

Not reported

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ROBLIN STEEL (Continued)

1000285107

SPILLS:

Facility ID:	8601156	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 696-6653
Spiller:	ROBLIN INDUSTRIAL PK.		
Address:	4000 RIVER ROAD TONAWANDA, N. Y.		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/17/1986	Spill Source:	Other Commercial/Industrial
Spill Cause:	Housekeeping	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	05/19/1986 08:30
Spill Notifier:	Responsible Party		
Spill Date:	05/19/1986 08:30		
Cleanup Ceased:	12/17/1986		
Last Inspection:	10/08/1986		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/31/1986		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/02/1986		
Remark:	ABOVE GROUND TANK		

**B13
SSE
1/8-1/4
Higher**

**ENVIROTEK
4000 RIVER RD
TONAWANDA, NY 14150**

**CERCLIS 1000261739
RCRIS-SQG NYD038641601
FINDS
RAATS
CORRACTS**

CERCLIS Classification Data:

Site Incident Category:	ABANDONED	Federal Facility:	NO
Ownership Status:	UNKNOWN	NPL Status:	NOT ON NPL
EPA Notes:	AN ABANDONED TSDf WITH APPROXIMATELY 300 DRUMS OF MATERIAL AND 4 WASTE PITS ON SITE.		

CERCLIS Assessment History:

Assessment:	REMOVAL ACTION	Completed:	05/28/93
-------------	----------------	------------	----------

CERCLIS Site Status:

This site is currently under investigation by the government to assess the extent of further action

CERCLIS Alias Name(s):

ENVIROTECK 2

CORRACTS Data:

Prioritization:	High
Status:	RCRA Facility Assessment Completed, Referred to a Non-RCRA Authority

NRG019621

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ENVIROTEK (Continued)

1000261739

RCRIS:

Owner: KROLAB PRODUCTS CORP
(716) 885-0300

Contact: RICHARD I JOHNSON SR
(716) 885-0300

Record Date: 07/16/81

Classification: Hazardous Waste Transporter

Used Oil Recyc: No

Violation Status: Violations exist

There are 8 compliance/violation record(s) reported at this site:

<u>Evaluation</u>	<u>Area of Violation</u>	<u>Date of Compliance</u>
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	10/04/89
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	10/04/89
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	10/04/89
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	11/10/88
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	10/04/89
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	10/04/89
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	11/10/88
Compliance Evaluation Inspection (CEI)	Generator-All Requirements	10/04/89

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Civil judicial and administrative enforcement case against facility (under DOCKET)

**B14
SSE
1/8-1/4
Higher**

**LAKE ERIE ROLLING MILL INC
4000 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000196602
RCRIS-LQG NYD981873375**

RCRIS:

Owner: ROBLIN INDUSTRIES INC
(212) 555-1212

Contact: SIMMONS C WESLEY
(716) 696-6600

Record Date: 12/23/86

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**B15
SSE
1/8-1/4
Higher**

**TONAWANDA NEW YORK TERMINAL
4000 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000160431
RCRIS-LQG NYD980664445**

NRG019622

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

TONAWANDA NEW YORK TERMINAL (Continued)

1000160431

RCRIS:
 Owner: MARATHON PETROLEUM
 (212) 555-1212

 Contact: F STANCZAK
 (419) 422-2121

 Record Date: 02/15/83
 Classification: Large Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

**B16
 SSE
 1/8-1/4
 Higher**

**ENVIROTEK II PRP GROUP
 4000 RIVER RD
 TONAWANDA, NY 14150**

**FINDS 1000447058
 RCRIS-LQG NYD986907723**

RCRIS:
 Owner: SEE ATTACHED LETTER
 (212) 555-1212

 Contact: WILLIAM B POPHAM
 (716) 223-4490

 Record Date: 07/27/90
 Classification: Large Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

FINDS:
 Other Pertinent Environmental Activity Identified at Site:
 - Civil judicial and administrative enforcement case against facility (under DOCKET)

**B17
 SSE
 1/8-1/4
 Higher**

**WICK WIRE FACTORY
 4000 RIVER RD
 TONAWANDA, NY**

**NY Spills S102174249
 N/A**

NRG019623

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

WICK WIRE FACTORY (Continued)

S102174249

SPILLS:

Facility ID:	9107739	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DAVE JONES	Caller Agency:	CITIZEN
Caller Phone:	(716) 773-9059	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	10/21/1991	Resource Affected:	Surface Water
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	10/20/1991 19:18
Spill Date:	10/18/1991 12:00		
Cleanup Ceased:	10/21/1991		
Last Inspection:	10/21/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/15/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/25/1991		
Remark:	OIL SEEP FROM GROUND AT OLD FACTORY		

B18
SSE
1/8-1/4
Higher

ASCENSION CHEMICAL OF AMERICA
4000 RIVER ROAD
TONAWANDA, NY 14150

RCRIS-SQG 1000208497
FINDS NYD067528927
TSCA

RCRIS:

Owner: JESSE JACKSON
(212) 555-1212

Contact: JESSE JACKSON
(716) 875-2446

Record Date: 08/01/80

Classification: Hazardous Waste Transporter

Used Oil Recyc: No

Violation Status: No violations found

C19
SSE
1/4-1/2
Higher

SIVACO NEW YORK INC
3937 RIVER RD
TONAWANDA, NY

NY Spills S102178074
N/A

NRG019624

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO NEW YORK INC (Continued)

S102178074

SPILLS:

Facility ID:	9306513	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO
Caller Phone:	(716) 874-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	SIVACO		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/17/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/27/1993 12:31
Spill Date:	08/27/1993 11:30		
Cleanup Ceased:	09/17/1993		
Last Inspection:	08/27/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/27/1993		
Remark:	SULFURIC ACID PIPE BROKE. CONTAINED ON PAVEMENT		

**C20
SSE
1/4-1/2
Higher**

**SIVACO 3937 RIVER ROAD
3937 RIVER RD
TONAWANDA, NY**

NY Spills

**S102178764
N/A**

NRG019625

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO 3937 RIVER ROAD (Continued)

S102178764

SPILLS:

Facility ID:	9406083	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO
Caller Phone:	(716) 894-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 894-5681
Spiller:	SIVACO NATIONAL WIRE		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release that creates potential for fire or hazard. (Highly Improbable)		
Spill Closed Dt:	08/05/1994	Resource Affected:	Surface Water
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	SNAKE CREEK	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/04/1994 09:01
Spill Date:	08/03/1994 05:00		
Cleanup Ceased:	08/05/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/12/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/05/1994		
Remark:	RUPTURED LINE DURING DEMOLITION		

**C21
SSE
1/4-1/2
Higher**

**SIVACO NY COMPANY
3937 RIVER RD
TONAWANDA, NY**

**LUST
NY Spills**

**S100781650
N/A**

LUST:

Facility ID:	9008357	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO NY
Caller Phone:	(716) 874-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-5681
Spiller:	SIVACO NY COMPANY		
Address:	3937 RIVER ROAD TONAWANDA, NY 14151		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	10/31/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	10/31/1990 08:37
Spill Notifier:	Responsible Party		
Spill Date:	10/31/1990 05:20		
Cleanup Ceased:	10/31/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		

NRG019626

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO NY COMPANY (Continued)

S100781650

Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 11/03/1990
Corrective Action Plan Submitted: Not reported
Date Spill Entered In Computer Data File: 10/31/1990

Remark: STORAGE TANK SPLIT, WATER/ACID WENT INTO DIKED AREA. SYSTEM SHUT DOWN.
PRODUCT WILL BE PUMPED INTO ANOTHER TANK. DIKE AREA TO BE CLEANED.

SPILLS:

Facility ID: 9012166
Facility Contact: Not reported
Investigator: MEL
Caller Name: RON BUCHNER
Caller Phone: (716) 874-5681
Notifier Name: Not reported
Notifier Phone: Not reported
Spiller Contact: Not reported
Spiller: SIVACO NEW YORK
Address: 3937 RIVER ROAD
TONAWANDA, NY 14151

Region of Spill: 9
Facility Tele: Not reported
Spill Type: Facility
Caller Agency: SIVACO NY
Caller Extension: Not reported
Notifier Agency: Not reported
Notifier Extension: Not reported
Spiller Phone: (716) 874-5681

Spill Class: Not reported
Spill Closed Dt: 04/12/1991
Spill Cause: Equipment Failure
Water Affected: Not reported
Spill Notifier: Responsible Party
Spill Date: 02/22/1991 10:00
Cleanup Ceased: 03/20/1991
Last Inspection: 02/25/1991

Resource Affected: On Land
Spill Source: Other Commercial/Industrial
PBS Number: Not reported
Reported to Dept: 02/22/1991 10:41

Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 04/12/1991
Corrective Action Plan Submitted: Not reported
Date Spill Entered In Computer Data File: 03/01/1991
Remark: HOSE FITTING BROKE ON EQUIPMENT

C22
SSE
1/4-1/2
Higher

NEW YORK WIRE MILLS CORP
3937 RIVER RD
TONAWANDA, NY 14150

FINDS 1000136922
RCRIS-LQG NYD071478044
TRIS
LUST

NRG019627

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NEW YORK WIRE MILLS CORP (Continued)

1000136922

RCRIS:

Owner: Not reported
 Contact: ALBERT LYTLE
 (716) 874-5681
 Record Date: 03/22/82
 Classification: Large Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility has an active water discharge permit (under PCS)
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

LUST:

Facility ID:	8900993	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	BOB STUFF	Caller Agency:	CITIZEN
Caller Phone:	(716) 692-2015	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NEW YORK WIRE MILL		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	05/05/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	05/01/1989 12:45
Spill Notifier:	Citizen		
Spill Date:	05/01/1989 11:00		
Cleanup Ceased:	05/05/1989		
Last Inspection:	05/02/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/11/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/02/1989		
Remark:	INADEQUADE FACILITY FOR RIDDING FERRIC HYDROXIDE AFTER MANUFACTURING PROCESS.NON COMPLIANCE WITH SPDES REGULATION.		

C23
SSE
1/4-1/2
Higher

SIVACO NEW YORK
3937 RIVER RD.
TONAWANDA, NY 14151

AST

A100085965
N/A

NRG019628

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO NEW YORK (Continued)

A100085965

CBS AST:		
Facility ID:	9-000075	Telephone: (716) 874-5681
Owner:	SIVACO NEW YORK 3937 RIVER RD. TONAWANDA, NY 14151 (716) 874-5681	
Facility Status:	Active	
Tank ID:	T2	Total AST's: 2
Tank Status:	Not reported	
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE	
Install Date:	11/88	Capacity (Gal): 6592
Tank Type:	Steel/carbon steel	Product Stored: LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING	
Intrnl Protection:	NONE	
Tank Containment:	VAULT	
Pipe Type:	STEEL/IRON	Pipe Location: Aboveground
Pipe Internal:	NONE	
Pipe External:	PAINTED/ASPHALT COATING	
Pipe Containment:	NONE	
Leak Detection:	NONE	
Overfill Protection:	Product Level Gauge	
Chemical:	Not reported	
Tank Closed:	Not reported	
Region:	STATE	
Case Number:	7664939	PBS Number: Not reported
MOSF Number:	Not reported	SWIS Code: 1464
SPDES Number:	0-083623	ICS Number: 9-167092
Operator:	D. MCCANNA	Facility Town: TONAWANDA
Emrgncy Contact:	D. MCCANNA	Emrgncy Phone: (716) 874-5681
Certified Date:	03/05/97	Expiration Date: 05/19/99
Owner type:	Corporate/Commercial	Facility Type: Manufacturing
Owner Sub Type:	Not reported	
Mail Name:	SIVACO NEW YORK	
Mail Contact:	D. MCCANNA 3937 RIVER RD. TONAWANDA, NY 14151	
Mail Phone:	(716) 874-5681	

NRG019629

MAP FINDINGS

Map ID
Direction
Distance
Elevation

EDR ID Number
EPA ID Number

SIVACO NEW YORK (Continued)

A100085965

Facility ID:	9-000075	Telephone:	(716) 874-5681
Owner:	SIVACO NEW YORK 3937 RIVER RD. TONAWANDA, NY 14151 (716) 874-5681		
Facility Status:	Active	Total AST's:	2
Tank ID:	C14		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	05/89	Capacity (Gal):	3805
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	JACKETED		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	WRAPPED [PIPING]		
Pipe Containment:	NONE		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	Not reported
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	0-083623	ICS Number:	9-167092
Operator:	D. MCCANNA	Facility Town:	TONAWANDA
Emergncy Contact:	D. MCCANNA	Emergncy Phone:	(716) 874-5681
Certified Date:	03/05/97	Expiration Date:	05/19/99
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	SIVACO NEW YORK		
Mail Contact:	D. MCCANNA 3937 RIVER RD. TONAWANDA, NY 14151		
Mail Phone:	(716) 874-5681		

**C24
SSE
1/4-1/2
Higher**

**SIVACO
3937 RIVER RD
TONAWANDA, NY**

LUST

**S100781639
N/A**

LUST:

Facility ID:	9105569	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DENNIS MCCANNA	Caller Agency:	SIVACO
Caller Phone:	(716) 874-5681	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	SIVACO		
Address:	3937 RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/15/1993		
Spill Cause:	Tank Failure	Resource Affected:	On Land

NRG019630

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SIVACO (Continued)

S100781639

Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	08/22/1991 15:30	Reported to Dept:	08/22/1991 16:04
Cleanup Ceased:	09/15/1993		
Last Inspection:	08/23/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	08/26/1991		
Remark:	TANK RUSTED THROUGH SPILLING WASTE OIL		

**C25
SSE
1/4-1/2
Higher**

**TONAWANDA COKE CORPORATION
3875 RIVER RD
TONAWANDA, NY 14150**

AST

**A100084073
N/A**

PBS AST:

Facility ID:	9-030058	Telephone:	(716) 876-6222
Facility Status:	Active	Total Ast's:	2
Owner:	J D CRANE 3875 RIVER ROAD TONAWANDA, NY 14150 (716) 876-6222		
Tank ID:	E01	Capacity (Gal):	16500
Tank Status:	In Service		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	NONE/EARTHEN DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/OTHER		
Overfill Prot:	Product Level Gauge	Dispenser:	Gravity
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019631

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE CORPORATION (Continued)

A100084073

Facility ID:	9-030058	Telephone:	(716) 876-6222
Facility Status:	Active	Total Ast's:	2
Owner:	J D CRANE 3875 RIVER ROAD TONAWANDA, NY 14150 (716) 876-6222		
Tank ID:	B10	Capacity (Gal):	900
Tank Status:	In Service		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Product Stored:	LEADED GASOLINE	Tank Type:	Steel/carbon steel
Install Date:	Not reported	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	NONE/CONCRETE DIKE		
Pipe Location:	Aboveground	Pipe Type:	STEEL/IRON
Pipe Internal:	NONE		
Pipe External:	NONE/PAINTED/ASPHALT COATING		
Leak Detection:	NONE/OTHER		
Overfill Prot:	Product Level Gauge	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

**C26
SSE
1/4-1/2
Higher**

**TONAWANDA COKE INC
3875 RIVER RD
TONAWANDA, NY 14150**

**FINDS
TRIS
SHWS
SWFLF
NY Spills**

**1000160426
NYD088413877**

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)
- Civil judicial and administrative enforcement case against facility (under DOCKET)

NRG019632

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE INC (Continued)

1000160426

SHWS:
 Facility ID: 915055 EPA ID: NYD088413877
 Owner: Tonawanda Coke Corporation
 3875 River Road
 Tonawanda, NY 14150
 Owner Telephone: Not reported
 Operator: Allied Chemical-Semet Solvay Div.
 Not reported
 Solvay, NY
 Contact: Not reported Telephone: Not reported
 Site Classification: Significant threat to the public health or environment - action
 required.
 Region: 9
 Site Type: Dump, Landfill
 Acres: 160 User: Allied Chemical Corporation
 HW Started: 1930 HW Ended: 1979
 HW Disposed: Coal tar wastes including PAHs, Organic solvents, Cyanide, Heavy Metals,
 Phenols, Benzene
 Units: unknown, unknown, unknown, unknown, unknown, unknown
 Air Data: Unavailable Surf. Water Data: Unavailable
 Grnd. Water Data: Available Soil Data: Available
 Sediment Data: Available
 Ground Water Standards Contravention: Yes
 Drinking Water Standards Contravention: No
 Surface Water Standards Contravention: No
 Air Standards Contravention: No
 Enforcement Status: Negotiation In Progress Legal Action: No
 State Action: Yes Fed Action: No
 Remedial Action: None
 Remed action type: none
 Soil Type: Fill overlying dense silty clay, reddish
 Grnd Water Depth: 3 feet
 Assessment of Environmental Problems:
 Contamination of soils, sediment, surface water and groundwater have been
 documented at this site. This contamination may be affecting the adjacent
 Niagara River. Investigation into the extent of contamination across this
 entire site is needed.
 Assessment of Health Problems:
 Not reported

NRG019633

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE INC (Continued)

1000160426

LF:

Facility ID:	15S26	Telephone:	Not reported
DEC Region:	9	Permit #:	Not reported
Permit issue date:	Not reported	Permit Expires:	Not reported
Authrzd/Operate Dt:	Not reported	Constrct Perm #:	Not reported
Auth. to Construct:	Not reported	Const Permit Exp:	Not reported
Regulatory Status:	None	Receiving Waste:	False
Started Rec Waste:	Not reported	Stop Rec Waste:	Not reported
Aquifer:	none		
Date Ordered On Consent Signed:		Not reported	
Accomplish Date Of Order:		Not reported	
Inactive HWS:	True	Inactive HWS Num	915055
Inactive HWS Class:	Significant threat to the public health or environment - action required.		
Waste type:	Not reported		
Owner Name:	Not reported	Owner Type:	Municipal
Mail Address:	Not reported		
Owner Phone Num:	Not reported	Operator Name:	Not reported
Ny Transverse Mercator Coordinates East:		179666	
Ny Transverse Mercator Coordinates North:		4765700	
Annual Report Submitted to ALB:			
1989:	False	1990:	False
1991:	False	1992:	False
1993:	False	1994:	False
1995:	False		
1996:	False		
Primary Liner:	Not reported	Secondary Liner:	Not reported
Annual Rprt Waived:	Not reported	Tiping Fee Rprtd:	Not reported

NRG019634

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE INC (Continued)

1000160426

SPILLS:

Facility ID:	9306743	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DICK COWAN	Caller Agency:	NYSDEC
Caller Phone:	(518) 457-7363	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-6222

Spiller: TONAWANDA COKE CORP.
Address: 3875 RIVER ROAD
TONAWANDA, NY 14051

Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 09/20/1993

Spill Cause: Unknown

Water Affected: Not reported

Spill Notifier: DEC

Spill Date: 08/10/1993 12:00

Cleanup Ceased: 09/20/1993

Last Inspection: 09/20/1993

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 05/26/1995

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 09/02/1993

Remark: DURING PBS INSPECTION, MR. COWAN DISCOVERED 20' X 15' AREA NEAR DIESEL
TANK LOADING AREA THAT APPEARS TO BE CONTAMINATED.

Resource Affected: On Land

Spill Source: Other Commercial/Industrial

PBS Number: Not reported

Reported to Dept: 09/01/1993 11:00

C27
SSE
1/4-1/2
Higher

TONAWANDA COKE CORP
3875 RIVER RD
TONAWANDA, NY 14151

RCRIS-LQG 1000160428
CERC-NFRAP NYD088413877

CERCLIS-NFRAP Classification Data:

Site Incident Category: Not reported

Ownership Status: OTHER

EPA Notes: Not reported

Federal Facility: NO

NPL Status: NOT ON NPL

CERCLIS-NFRAP Assessment History:

Assessment: DISCOVERY

Assessment: PRELIMINARY ASSESSMENT

Completed: 04/01/80

Completed: 06/01/83

CERCLIS-NFRAP Alias Name(s):

TONAWANDA COKE SITE 2

TONAWANDA COKE SITE 3

ALLIED CORP BUFFALO COKE PLT

NRG019635

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TONAWANDA COKE CORP (Continued)

1000160428

RCRIS:

Owner: TONAWANDA COKE CORPORATION
(212) 555-1212

Contact: MARK KAMHOLZ
(716) 876-6222

Record Date: 02/19/86

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

**D28
SSE
1/4-1/2
Higher**

**ALLIED CORPORATION
3821 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000248673
RCRIS-LQG NYD051816262
TSCA
CORRACTS
CERC-NFRAP**

CERCLIS-NFRAP Classification Data:

Site Incident Category: Not reported

Ownership Status: OTHER

EPA Notes: Not reported

Federal Facility: NO

NPL Status: NOT ON NPL

CERCLIS-NFRAP Assessment History:

Assessment: DISCOVERY

Assessment: PRELIMINARY ASSESSMENT

Assessment: SCREENING SITE INSPECTION

Completed: 04/01/80

Completed: 10/01/84

Completed: 05/31/85

CERCLIS-NFRAP Alias Name(s):

ALLIED CORP TONAWANDA A C POLYETHYLENE

ALLIED CHEM SITE 2

ALLIED CHEMICAL SPECIALTY CHEM DIV

ALLIED CHEM SITE 3

CORRACTS Data:

Prioritization: Low

Status: RCRA Facility Assessment Completed

RCRIS:

Owner: ALLIED CHEMICAL CORPORATION
(716) 877-6300

Contact: JACK HONEY
(716) 877-6300

Record Date: 08/18/80

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

NRG019636

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

E29
NNE
1/4-1/2
Higher

NOCO ENERGY
4363 RIVER RD
TONAWANDA, NY

NY Spills **S102176608**
N/A

SPILLS:

Facility ID: 8900014
Facility Contact: Not reported
Investigator: MJH
Caller Name: GARY ROESCH
Caller Phone: (716) 874-6200
Notifier Name: Not reported
Notifier Phone: Not reported
Spiller Contact: Not reported
Spiller: NOCO ENERGY CORP
Address: 700 GRAND ISLAND BLVD
TONAWANDA, NY 14150

Region of Spill: 9
Facility Tele: Not reported
Spill Type: Facility
Caller Agency: NOCO ENERGY
Caller Extension: Not reported
Notifier Agency: Not reported
Notifier Extension: Not reported
Spiller Phone: (716) 874-6200

Spill Class: Not reported
Spill Closed Dt: 02/01/1990
Spill Cause: Equipment Failure
Water Affected: Not reported
Spill Notifier: Responsible Party
Spill Date: 04/02/1989 08:00
Cleanup Ceased: 02/01/1990
Last Inspection: 01/11/1990
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 02/06/1990

Resource Affected: On Land
Spill Source: Major Facility 400,000 gallons
PBS Number: Not reported
Reported to Dept: 04/02/1989 12:01

Corrective Action Plan Submitted: Not reported
Date Spill Entered In Computer Data File: 04/04/1989

Remark: RUPTURED NIPPLE ON PRESSURE GAGE ALLOWED PRODUCT TO SPRAY OUT

NRG019637

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY (Continued)

S102176608

Facility ID:	8904059	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	DISPATCHER SCHROEDER	Caller Agency:	TONAWANDA FD
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	08/18/1989		
Spill Cause:	Traffic Accident	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Commercial Vehicle
Spill Notifier:	Fire Department	PBS Number:	Not reported
Spill Date:	07/24/1989 17:00	Reported to Dept:	07/24/1989 17:30
Cleanup Ceased:	08/18/1989		
Last Inspection:	07/24/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/06/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/31/1989		
Remark:	FUEL TANK RUPTURED ON TRUCK		

E30
NNE
1/4-1/2
Higher

4363 RIVER RD
4363 RIVER RD
ERIE (County), NY

ERNS

8901467
N/A

E31
NNE
1/4-1/2
Higher

NOCO ENERGY
4365 RIVER RD
TONAWANDA, NY

NY Spills

S102174259
N/A

NRG019638

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY (Continued)

S102174259

SPILLS:

Facility ID:	9107986	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	GARY ROESCH	Caller Agency:	NOCO ENERGY
Caller Phone:	(716) 874-6200	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-6200
Spiller:	NOCO ENERGY		
Address:	700 GRAND ISLAND BLVD TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	11/22/1991	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/26/1991 02:01
Spill Date:	10/26/1991 00:01		
Cleanup Ceased:	11/22/1991		
Last Inspection:	10/29/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/22/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/28/1991		
Remark:	VALVE WAS LEFT OPEN CAUSING SPILL TO GROUND		

D32
SSE
1/4-1/2
Higher

ARCO
3773 RIVER ROAD
TONAWANDA, NY 14150

FINDS

1000549989
NYD986868354

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

D33
SSE
1/2-1
Higher

SUN REFINING
3755 RIVER RD
TONAWANDA, NY

NY Spills

S102175363
N/A

NRG019639

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SUN REFINING (Continued)

S102175363

SPILLS:

Facility ID:	8604694	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-7846
Spiller:	SUN REFINING		
Address:	3755 RIVER ROAD TONAWANDA, N. Y. 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	07/20/1987	Spill Source:	Major Facility 400,000 gallons
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	10/22/1986 09:40
Spill Notifier:	Responsible Party		
Spill Date:	10/22/1986 09:00		
Cleanup Ceased:	07/20/1987		
Last Inspection:	06/15/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/20/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/22/1986		
Remark:	MAJOR FACILITY LICENSE 09-1360		

D34
SSE
1/2-1
Higher

SUN OIL
3755 RIVER RD
TONAWANDA, NY

LUST

S100154865
N/A

LUST:

Facility ID:	8607229	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	SUN OIL		
Address:	3755 RIVER ROAD TONAWANDA, N. Y.		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	03/09/1987	Spill Source:	Tank Truck
Spill Cause:	Tank Overfill	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	02/26/1987 19:45
Spill Notifier:	Police Department		
Spill Date:	02/26/1987 19:38		
Cleanup Ceased:	03/09/1987		
Last Inspection:	02/27/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		

NRG019640

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SUN OIL (Continued)

S100154865

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 03/10/1987
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 02/27/1987
 Remark: Not reported

**D35
SSE
1/2-1
Higher**

**SUNMARK PETROLEUM MARKETING TERMINAL
3755 RIVER RD
TONAWANDA, NY 14150**

**FINDS 1000296072
RCRIS-LQG NYD980646665**

RCRIS:

Owner: Not reported
 Contact: CHARLES BURNETT
 (716) 877-2285
 Record Date: 08/18/80
 Classification: Large Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

**D36
SSE
1/2-1
Higher**

**GOETZ OIL
3755 RIVER RD
TONAWANDA, NY**

**NY Spills S102175149
N/A**

NRG019641

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ OIL (Continued)

S102175149

SPILLS:

Facility ID:	8600903	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	GOETZ OIL		
Address:	3755 RIVER RD TONAWANDA		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	05/19/1986	Spill Source:	Major Facility 400,000 gallons
Spill Cause:	Housekeeping	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	05/01/1986 10:00
Spill Notifier:	DEC		
Spill Date:	05/01/1986 10:00		
Cleanup Ceased:	05/19/1986		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/10/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/29/1986		
Remark:	FACILITY CLEANING UP. DEC MAY REFER TO LEGAL.		

F37
SSE
1/2-1
Higher

VAN DE WATER TREATMENT PLT
3750 RIVER RD
TONAWANDA, NY 14150

FINDS 1000457314
RCRIS-LQG NYD980529358

RCRIS:

Owner: ERIE COUNTY WATER AUTH
(716) 684-1510

Contact: JAY MEYERS
(716) 684-1510

Record Date: 02/28/91

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

F38
SSE
1/2-1
Higher

A R & M CORP TONAWANDA TERM
3733 RIVER RD
TONAWANDA, NY 14150

FINDS 1000137252
RCRIS-LQG NYD059957324

NRG019642

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

A R & M CORP TONAWANDA TERM (Continued)

1000137252

RCRIS:
 Owner: ATLANTIC REFINING & MARKETING
 (212) 555-1212
 Contact: JAMES PITTS
 (215) 339-2120
 Record Date: 08/18/80
 Classification: Large Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

F39
SSE
1/2-1
Higher

**SUN OIL REFINERY
3733 RIVER RD
TONAWANDA, NY**

LUST

S100667744
N/A

LUST:

Facility ID:	9202406	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	CHUCK BURNETT	Caller Agency:	SUN OIL
Caller Phone:	(716) 874-6025	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.		
Spill Closed Dt:	05/29/1992		
Spill Cause:	Other	Resource Affected:	Surface Water
Water Affected:	DRAINAGE DITCH	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Affected Persons	PBS Number:	Not reported
Spill Date:	05/01/1992 12:00	Reported to Dept:	05/28/1992 14:45
Cleanup Ceased:	05/29/1992		
Last Inspection:	05/28/1992		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/16/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/29/1992		
Remark:	ERIE COUNTY WATER AUTHORITY HAD A RUPTURED VALVE SINCE LAST FALL. WATER THAT WAS DISCHARGED HAD A DUST FILM ON IT WHICH APPEARED TO BE COKE DUST.		

F40
SSE
1/2-1
Higher

**ATLANTIC REFINING
3732 RIVER RD
TONAWANDA, NY**

LUST

S100669143
N/A
NRG019643

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ATLANTIC REFINING (Continued)

S100669143

LUST:

Facility ID:	8808535	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	SAM KEPPLER	Caller Agency:	ATLANTIC REFINING
Caller Phone:	(716) 874-6025	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-6025
Spiller:	ATLANTIC REFINING		
Address:	3732 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	02/01/1989	Spill Source:	Major Facility 400,000 gallons
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	01/27/1989 14:11
Spill Notifier:	Responsible Party		
Spill Date:	01/27/1989 12:00		
Cleanup Ceased:	02/01/1989		
Last Inspection:	01/27/1989		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/03/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/01/1989		
Remark:	OVER FILL OF TANK TRUCK AT LOADING RACK		

41
WNW
1/2-1
Higher

ISLAND MARINA
1093 EAST RIVER ROAD
GRAND ISLAND, NY

NY Spills

S102132446
N/A

NRG019644

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ISLAND MARINA (Continued)

S102132446

SPILLS:

Facility ID:	9202451	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	MRS RATHMONC	Caller Agency:	RESIDENT
Caller Phone:	(716) 773-4152	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	06/08/1992		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Unknown
Spill Notifier:	Affected Persons	PBS Number:	Not reported
Spill Date:	05/30/1992 14:00	Reported to Dept:	05/30/1992 15:45
Cleanup Ceased:	06/08/1992		
Last Inspection:	06/01/1992		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/22/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/23/1992		
Remark:	WHITE FOAM ON NIAGARA RIVER AT ISLAND MARINE		

**G42
NNE
1/2-1
Higher**

**CHEMICAL WASTE MGMT
4400 RIVER RD
TONAWANDA, NY**

NY Spills

**S102179715
N/A**

NRG019645

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CHEMICAL WASTE MGMT (Continued)

S102179715

SPILLS:

Facility ID:	9508524	Region of Spill:	9
Facility Contact:	SAME	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	TOM BAKER	Caller Agency:	CHEMICAL WASTE MGMT
Caller Phone:	(201) 691-7330	Caller Extension:	Not reported
Notifier Name:	SAME	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	SAME	Spiller Phone:	Not reported
Spiller:	CHEMICAL WASTE MGMT		

Address 4400 RIVER RD
TONAWANDA, NY 14150

Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	11/10/1995	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/12/1995 10:18
Spill Date:	10/12/1995 09:30		

Cleanup Ceased: 11/10/1995
Last Inspection: Not reported
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 11/10/1995
Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 10/12/1995
Remark: PUNCTURED SINGLE CONTAINER ALL CLEANED UP AND OVER PACKED CALLER WOULD
LIKE A CALL BACK - NEEDS TO KNOW IF HE HAS TO FILE A FOLLOW UP REPORT

**G43
NNE
1/2-1
Higher**

**PILOT MOTOR FREIGHT
4400 RIVER RD
TONAWANDA, NY**

LUST

**S100118365
N/A**

LUST:

Facility ID:	8600069	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	PILOT MOTOR FREIGHT		

Address 4400 RIVER ROAD
TONAWANDA, N. Y. 14150

Spill Class:	Not reported	Resource Affected:	Groundwater
Spill Closed Dt:	08/04/1986	Spill Source:	Other Commercial/Industrial
Spill Cause:	Tank Test Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/03/1986 11:00
Spill Notifier:	Citizen		
Spill Date:	04/03/1986 11:00		
Cleanup Ceased:	08/04/1986		
Last Inspection:	08/04/1986		

NRG019646

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

PILOT MOTOR FREIGHT (Continued)

S100118365

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: True
 Spill Record Last Update: 01/02/1987
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 04/17/1986
 Remark: TANKS LEAKING AND EMPTIED NOVEMBER 1985

G44
NNE
1/2-1
Higher

TNT PILOT FREIGHT INC.
4400 RIVER ROAD
TONAWANDA, NY 14150

RCRIS-SQG 1000127735
 FINDS NYD152517462

RCRIS:

Owner: OVERLAND EXPRESS INTERNATIONAL
 (708) 696-1529
 Contact: HOLLY DURGIN
 (716) 879-0600
 Record Date: 08/15/94
 Classification: Conditionally Exempt Small Quantity Generator
 Used Oil Recyc: No
 Violation Status: No violations found

G45
NNE
1/2-1
Higher

ABF / ESTES FREIGHT
4425 RIVER RD
TONAWANDA, NY

LUST S102178376
 NY Spills N/A

LUST:

Facility ID:	9610459	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	DAVE ELLSWORTH	Caller Agency:	EPS
Caller Phone:	(716) 447-4700	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	MIKE ROGERS	Spiller Phone:	Not reported
Spiller:	ABF FREIGHT SYSTEMS INC		
Address:	3801 OLD GREENWOOD ROAD FORT SMITH, AR 72903		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.		
Spill Closed Dt:	11/21/1996		
Spill Cause:	Other	Resource Affected:	Groundwater
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Other	PBS Number:	Not reported
Spill Date:	05/01/1996 12:00	Reported to Dept:	11/20/1996 16:00
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		

NRG019647

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ABF / ESTES FREIGHT (Continued)

S102178376

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 11/22/1996
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/20/1996
 Remark: SOIL BORINGS INDICATE LOW-LEVEL CONTAMINATION.

SPILLS:

Facility ID:	9313542	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	STANK BIELAWA	Caller Agency:	SEMO
Caller Phone:	(518) 457-2200	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-3441
Spiller:	CAROLINA FREIGHT		
Address:	4425 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	06/08/1994	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Commercial Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Other	Reported to Dept:	02/17/1994 19:48
Spill Date:	02/17/1994 19:30		
Cleanup Ceased:	06/03/1994		
Last Inspection:	02/22/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/16/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/22/1994		
Remark:	EMPLOYEE KNOCKED JAR OFF SHELF.		

**G46
NNE
1/2-1
Higher**

**CAROLINA FREIGHT CARRIERS CORP
4425 RIVER RD
TONAWANDA, NY 14150**

**FINDS
UST
LUST
1000845604
NYD987040045**

LUST:

Facility ID:	9210179	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	CURTIS CARR	Caller Agency:	CAROLINA FREIGHT CARRIERS
Caller Phone:	(704) 435-6811	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(704) 435-6811
Spiller:	CAROLINA FREIGHT CARRIERS		
Address:	PO BOX 697 CHERRYVILLE, NC 28021		

NRG019648

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

CAROLINA FREIGHT CARRIERS CORP (Continued)

1000845604

Facility ID:	9-009172	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-3441	Location:	Not reported
Operator:	HANK VOGEL		
Contact:	Not reported		
Emergency Contact:	CURTIS CARR, (704) 435-6811		
Facility Type:	TRUCKING/TRANSPORTATION		
Total Tanks:	2	Old PBS Num:	Not reported
Owner:	CAROLINA FREIGHT CARRIERS CORP HIGHWAY 150 EAST CHERRYVILLE, NC 28021 (704) 435-6811		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	CAROLINA FREIGHT CARRIERS CORP HIGHWAY 150 EAST NC 28021 (704) 435-6811 ATTN: CURTIS CARR		
Facility Status:	Inactive	Total Capacity:	4000
Certification:	12/10/1992	Expiration:	09/02/1996
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	2	Install Date:	06/75
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	EPOXY LINER
Pipe Location:	Aboveground	Pipe Type:	GALVANIZED STEEL
Tank External:	NONE/NONE		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	09/89	Next Test Date:	Not reported
Date Closed:	08/93	Test Method:	TANK AUDITOR
Database Type:	Not reported		

**G47
NNE
1/2-1
Higher**

**CAROLINA FREIGHT CARRIERS CORP
4425 RIVER RD
TONAWANDA, NY 14150**

**RCRIS-SQG 1000872786
NYD987040045**

RCRIS:

Owner:	CAROLINA FREIGHT CARRIERS CORP (704) 435-6811
Contact:	CURTIS CARR (704) 435-6811
Record Date:	08/30/93
Classification:	Small Quantity Generator

NRG019650

MAP FINDINGS

Map ID	Direction	Distance	Elevation	Site	Database(s)	EDR ID Number	EPA ID Number
--------	-----------	----------	-----------	------	-------------	---------------	---------------

CAROLINA FREIGHT CARRIERS CORP (Continued)

1000872786

Used Oil Recyc: No
 Violation Status: No violations found

48
 NNE
 1/2-1
 Higher

CAPTAINS COVE
 4444 RIVER RD
 TONAWANDA, NY

NY Spills S102175781
 N/A

SPILLS:

Facility ID: 8703975	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: JDC	Spill Type: Facility
Caller Name: Not reported	Caller Agency: Not reported
Caller Phone: Not reported	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: Not reported
Spiller: UNKNOWN BOAT	
Address: Not reported	
Spill Class: Not reported	Resource Affected: Surface Water
Spill Closed Dt: 08/14/1987	Spill Source: Vessel
Spill Cause: Equipment Failure	PBS Number: Not reported
Water Affected: NIAGARA RIVER	Reported to Dept: 08/13/1987 11:05
Spill Notifier: Citizen	
Spill Date: 08/11/1987 12:00	
Cleanup Ceased: 08/14/1987	
Last Inspection: Not reported	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 08/25/1987	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 08/14/1987	
Remark: CABIN CRUISER SANK IN SLIP 'C' AT CAPTAINS COVE PETROLEUM FLOATING TO SURFACE	

49
 WSW
 1/2-1
 Higher

SHEEN IN RIVER
 787 NORTH COLONY
 GRAND ISLAND, NY

NY Spills S102134269
 N/A

NRG019651

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SHEEN IN RIVER (Continued)

S102134269

SPILLS:

Facility ID:	9307013	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	JIM ROGERS	Caller Agency:	NYSDEC
Caller Phone:	(716) 851-7000	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	09/20/1993		
Spill Cause:	Unknown	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Unknown
Spill Notifier:	DEC	PBS Number:	Not reported
Spill Date:	09/02/1993 19:30	Reported to Dept:	09/03/1993 15:15
Cleanup Ceased:	09/20/1993		
Last Inspection:	09/07/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/09/1993		
Remark:	NOTIFIER'S SON NOTICED SHEEN ALONG SHORELINE OF NIAGARA RIVER WHILE SWIMMING.		

H50
SSE
1/2-1
Higher

CHEMCENTRAL/BUFFALO
3709 RIVER RD
TONAWANDA, NY

NY Spills S102175460
N/A

NRG019652

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

CHEMCENTRAL/BUFFALO (Continued)

S102175460

SPILLS:

Facility ID:	8606758	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-1600
Spiller:	CHEMCENTRAL/BUFFALO		
Address:	3709 RIVER RD. TONAWANDA		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	02/04/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	DITCH	Reported to Dept:	02/04/1987 10:05
Spill Notifier:	Responsible Party		
Spill Date:	02/04/1987 10:00		
Cleanup Ceased:	02/04/1987		
Last Inspection:	02/04/1987		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/09/1987		
Remark:	PROPYLENE GLYCOL METHYL ETHER ACETATE 1-METHOXY-2-PROPANOL,ACETATE.		

NRG019653

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CHEMCENTRAL/BUFFALO (Continued)

S102175460

Facility ID:	9507864	Region of Spill:	9
Facility Contact:	JOSEPH CUTRIE JR.	Facility Tele:	(716) 874-1600
Investigator:	MNP	Spill Type:	Facility
Caller Name:	ANONYMOUS	Caller Agency:	CITIZEN
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	ANONYMOUS	Notifier Agency:	CITIZEN
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	DAVID W. BAUMGART	Spiller Phone:	(716) 874-1600
Spiller:	CHEMCENTRAL		
Address:	PO BOX 90 BUFFALO, NY 14207		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/10/1995	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Tank Truck
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	09/27/1995 10:31
Spill Date:	09/26/1995 16:00		
Cleanup Ceased:	11/10/1995		
Last Inspection:	10/19/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/14/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	09/28/1995		
Remark:	CHEMCENTRAL TANK TRUCK SPILLED XYLENE FROM OPEN DOMES ON TOP OF TANK.		

H51
SSE
1/2-1
Higher

CHEMCENTRAL/BUFFALO
3709 RIVER RD
TOWN OF TONAWANDA, NY 14150

FINDS 1000296931
RCRIS-LQG NYD000691154

RCRIS:
Owner: CHEMCENTRAL CORPORATION
(212) 555-1212
Contact: WILLIAM MULLIKEN
(312) 594-7000
Record Date: 08/18/80
Classification: Large Quantity Generator, Hazardous Waste Transporter

BIENNIAL REPORTS:
Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
F001	1644.00	F002	1214.00
F003	6222.00	F005	1460.00

NRG019654

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

CHEMCENTRAL/BUFFALO (Continued) Used Oil Recyc: No Violation Status: No violations found	1000296931
---	------------

152 NNE 1/2-1 Higher	T & T FREIGHTWAYS CORP 4500 RIVER RD TONAWANDA, NY	LUST	S100493284 N/A
---	---	-------------	---------------------------

LUST:

Facility ID: 9112991 Facility Contact: Not reported Investigator: MJS Caller Name: JIM BUCKI Caller Phone: (716) 824-5089 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: WILLIAM BACHELOR Address: 9700 HIGGINS RD SUITE 570 ROSEMOUNT, ILLINOIS	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: INTERNATIONAL WASTE REMOV Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (919) 661-1900
---	---

Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: Not reported Spill Cause: Tank Failure Water Affected: Not reported Spill Notifier: Other Spill Date: 03/19/1992 10:30 Cleanup Ceased: Not reported Last Inspection: 04/10/1992 Cleanup Meets Standard: False Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: True Spill Record Last Update: 06/10/1993 Corrective Action Plan Submitted: Not reported Date Spill Entered in Computer Data File: 03/27/1992	Resource Affected: Groundwater Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 03/19/1992 10:50
---	---

Remark: WASTE OIL TANK WAS REMOVED. TANK LOOKS TO BE IN GOOD CONDITION BUT GASOLINE IS COMING INTO EXCAVATION.

153 NNE 1/2-1 Higher	OVERLAND EXPRESS INTL 4500 RIVER RD TONAWANDA, NY 14151	FINDS	1000693638 RCRIS-LQG NYD986997039
---	--	--------------	--

NRG019655

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

OVERLAND EXPRESS INTL (Continued)

1000693638

RCRIS:

Owner: OVERLAND EXPRESS INTERNATIONAL
(708) 696-0200

Contact: MAC BATCHELOR
(919) 661-1900

Record Date: 04/07/92

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

154
NNE
1/2-1
Higher

UNITED REFINING
4545 RIVER RD
TONAWANDA, NY

LUST
NY Spills

S101341683
N/A

LUST:

Facility ID:	9409532	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	TIMOTHY RUTH	Caller Agency:	UNITED REFINING
Caller Phone:	(814) 723-1500	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	TIMOTHY RUTH	Spiller Phone:	(814) 723-1500
Spiller:	UNITED REFINING		
Address:	BOX 599 WARREN, PA 16365		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	04/01/1996	Resource Affected:	On Land
Spill Cause:	Tank Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	09/26/1994 12:00
Spill Date:	09/01/1994 12:00		
Cleanup Ceased:	Not reported		
Last Inspection:	04/01/1996		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	04/09/1996		

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 10/18/1994

Remark: BIOREMEDIATION AT UNITED REFINING TERMINAL.

Facility ID:	9411354	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	GEORGE WHITE	Caller Agency:	UNITED REFINING
Caller Phone:	(716) 874-6650	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported

NRG019656

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

UNITED REFINING (Continued)

S101341683

Spiller: UNITED REFINING
Address: PO BOX 599
WARREN, PA 16365
Spill Class: Known release that creates potential for fire or hazard. DEC Response.
Willing Responsible Party. Corrective action taken.
Spill Closed Dt: Not reported
Spill Cause: Other
Resource Affected: On Land
Water Affected: Not reported
Spill Source: Other Commercial/Industrial
Spill Notifier: Responsible Party
PBS Number: Not reported
Spill Date: 11/17/1994 10:00
Reported to Dept: 11/17/1994 12:00
Cleanup Ceased: Not reported
Last Inspection: Not reported
Cleanup Meets Standard: False
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 03/07/1997
Corrective Action Plan Submitted: Not reported
Date Spill Entered in Computer Data File: 11/28/1994
Remark: NFG ENCOUNTERED CONTAMINATED SOIL WHILE TRENCHING FOR NEW GAS LINE.

NRG019657

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

UNITED REFINING (Continued)		S101341683
-----------------------------	--	------------

SPILLS:

Facility ID: 9304713	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: SAC	Spill Type: UST
Caller Name: MARK STERNBERG	Caller Agency: UNITED REFINING
Caller Phone: (814) 723-1500	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: BERT RICHNAFSKY	Spiller Phone: (814) 723-1500
Spiller: UNITED REFINING	
Address: PO BOX 780 WARREN, PA 16365	
Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.	
Spill Closed Dt: Not reported	Resource Affected: On Land
Spill Cause: Equipment Failure	Spill Source: Major Facility 400,000 gallons
Water Affected: Not reported	PBS Number: Not reported
Spill Notifier: Responsible Party	Reported to Dept: 07/14/1993 17:12
Spill Date: 07/14/1993 16:45	
Cleanup Ceased: Not reported	
Last Inspection: 11/13/1995	
Cleanup Meets Standard: False	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 10/02/1996	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered in Computer Data File: 07/20/1993	
Remark: NOTICED PRODUCT ON GROUND OUTSIDE OF TANK.	

I55 NNE 1/2-1 Higher	MOBIL OIL GASOLINE ADDITIVE TK 4545 RIVER RD TONAWANDA, NY 14150	RCRIS-SQG FINDS	1000253449 NYD981487036
-------------------------------	--	--------------------	----------------------------

RCRIS:

Owner: ASHLAND PETROLEUM CO
(212) 555-1212

Contact: S JENKINS
(215) 293-4103

Record Date: 05/19/86

Classification: Not reported

Used Oil Recyc: No

Violation Status: No violations found

I56 NNE 1/2-1 Higher	ASHLAND PETRO LF 4545 RIVER RD TONAWANDA, NY 14150	SWF/LF	S101650762 N/A
-------------------------------	--	--------	-------------------

NRG019658

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND PETRO LF (Continued)

S101650762

LF:

Facility ID:	15S52	Telephone:	Not reported
DEC Region:	9	Permit #:	2070
Permit issue date:	Not reported	Permit Expires:	07/30/1982
Authrzd/Operate Dt:	07/30/1979	Construct Perm #:	Not reported
Auth. to Construct:	Not reported	Const Permit Exp:	Not reported
Regulatory Status:	None	Receiving Waste:	False
Started Rec Waste:	Not reported	Stop Rec Waste:	Not reported
Aquifer:	none		
Date Ordered On Consent Signed:			Not reported
Accomplish Date Of Order:			Not reported
Inactive HWS:	True	Inactive HWS Num:	15061
Inactive HWS Class:	Temporary classification assigned to sites that have inadequate and/or insufficient data or inclusion in any of the other classifications.		
Waste type:	Not reported		
Owner Name:	ASHLAND OIL INC	Owner Type:	Private
Mail Address:	P.O. BOX 391		
	ASHLAND, KY 41107		
Owner Phone Num:	Not reported	Operator Name:	ASHLAND PETROLEUM CO
Ny Transverse Mercator Coordinates East:			180288
Ny Transverse Mercator Coordinates North:			4763756
Annual Report Submitted to ALB:			
1989:	False	1990:	False
1991:	False	1992:	False
1993:	False	1994:	False
1995:	False		
1996:	False		
Primary Liner:	Not reported	Secondary Liner:	Not reported
Annual Rprt Waived:	Not reported	Tipping Fee Rprtd:	Not reported

I57
NNE
1/2-1
Higher

**UNITED REFINING TERMINAL
4545 RIVER RD
TONAWANDA, NY**

NY Spills

**S102177991
N/A**

NRG019659

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

UNITED REFINING TERMINAL (Continued)

S102177991

SPILLS:

Facility ID:	9304912	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	UST
Caller Name:	GEORGE WHITE	Caller Agency:	UNITED REFINING
Caller Phone:	(716) 874-6650	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GEORGE E. WHITE	Spiller Phone:	(814) 723-1500
Spiller:	UNITED REFINING		
Address:	BOX 780 WARREN, PA 16365		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/15/1996		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/01/1993 12:00	Reported to Dept:	07/15/1993 08:00
Cleanup Ceased:	Not reported		
Last Inspection:	05/15/1996		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/20/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/20/1993		
Remark:	#2 FUEL OIL FOUND DURING EPA INSPECTION.		

NRG019660

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

UNITED REFINING TERMINAL (Continued)

S102177991

Facility ID:	9607742	Region of Spill:	9
Facility Contact:	DISP CONFER	Facility Tele:	(716) 876-1212
Investigator:	MJS	Spill Type:	UST
Caller Name:	DISPATCHER CONFER	Caller Agency:	TOWN OF TONAWANDA
Caller Phone:	(716) 876-1212	Caller Extension:	Not reported
Notifier Name:	UNITED REFINING	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNITED REFINING		
Address:	11 BRADLEY STREET WARREN, PA 16365		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Notifier:	Fire Department	PBS Number:	Not reported
Spill Date:	09/19/1996 16:55	Reported to Dept:	09/19/1996 19:33
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/07/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/19/1996		
Remark:	LEAK IS AT ASHIN OIL COMPANY IN THE TOWN OF TONAWANDA FIRE DEPT IS ON SCENE AT THIS TIME - UNK HOW THE SPILL OCCURED - FIRE DEPT STATES IT IS OVER 100 GAL - REQ CALL FROM DEC REP		

NRG019661

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

UNITED REFINING TERMINAL (Continued)

S102177991

Facility ID:	9700810	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	Not reported	Spill Type:	UST
Caller Name:	GEORGE WHITE	Caller Agency:	UNITED REFINING
Caller Phone:	(000) 874-6650	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNITED REFINING COMPANY		
Address:	P.O. BOX 780 WARREN, PA 16365		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/14/1997 12:00
Spill Notifier:	Responsible Party		
Spill Date:	04/01/1997 12:00		
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/18/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/18/1997		
Remark:	OUT OF SERVICE ABOVE GROUND PIPE FOUND LEAKING AT THE FLANGE NEAR TANKS 886 887 888		

I58
NNE
1/2-1
Higher

ASHLAND OIL
4545 RIVER ROAD
TONAWANDA, NY 14150

CERCLIS 1000276724
FINDS NYD063653133
RCRIS-LQG

CERCLIS Classification Data:

Site Incident Category:	R	Federal Facility:	NO
Ownership Status:	PRIVATE	NPL Status:	NOT ON NPL
EPA Notes:			

CERCLIS Assessment History:

Assessment:	DISCOVERY	Completed:	12/01/80
Assessment:	PRELIMINARY ASSESSMENT	Completed:	12/01/80
Assessment:	PRELIMINARY ASSESSMENT	Completed:	03/17/86
Assessment:	HAZARD RANKING DETERMINED	Completed:	01/15/88
Assessment:	SCREENING SITE INSPECTION	Completed:	12/31/91
Assessment:	TECHNICAL ASSISTANCE	Completed:	Not reported

CERCLIS Site Status:

This site is currently under investigation by the government to assess the extent of further action

CERCLIS Alias Name(s):

ASHLAND PETROLEUM, INC.
ASHLAND PETROLEUM CO /BUFFALO REFINERY
ASHLAND PETROLEUM CORP
ASHLAND I

NRG019662

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND OIL (Continued)

1000276724

RCRIS:

Owner: ASHLAND OIL INC
(606) 739-4166

Contact: JAMES J PRICHARD
(606) 739-4166

Record Date: 08/18/80

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	85873.80

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Civil judicial and administrative enforcement case against facility (under DOCKET)

I59
NNE
1/2-1
Higher

**SHEEN IN NIAGARA RIVER
4545 RIVER RD
TONAWANDA, NY**

NY Spills

S102178461
N/A

NRG019663

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SHEEN IN NIAGARA RIVER (Continued)

S102178461

SPILLS:

Facility ID:	9315448	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	GEORGE WHITE	Caller Agency:	UNITED REFINING
Caller Phone:	(716) 874-6650	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/11/1994		
Spill Cause:	Unknown	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Unknown
Spill Notifier:	Affected Persons	PBS Number:	Not reported
Spill Date:	03/29/1994 16:00	Reported to Dept:	03/29/1994 16:40
Cleanup Ceased:	04/11/1994		
Last Inspection:	04/11/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/21/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/01/1994		
Remark:	SHEEN BY THE DOCKS BEHIND UNITED REFINING.		

160
NNE
1/2-1
Higher

ASHLAND OIL
4545 RIVER RD
TONAWANDA, NY 14150

UST
NY Spills

U001852459
N/A

NRG019664

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND OIL (Continued)

U001852459

SPILLS:

Facility ID:	8807554	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	TERRY NICHOLS	Caller Agency:	ASHLAND OIL
Caller Phone:	(606) 329-4010	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-8600
Spiller:	ASHLAND OIL		
Address:	4545 RIVER RD TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	02/06/1989		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	12/13/1988 09:00	Reported to Dept:	12/14/1988 16:50
Cleanup Ceased:	02/06/1989		
Last Inspection:	12/20/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	02/13/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/15/1988		
Remark:	ABANDONED TANKS BEING REMOVED, SLIGHT AMOUNT OF WATER W/ OIL SHEEN SPILLED FROM TANK WHEN HIT BY BACKHOE		

NRG019665

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND OIL (Continued)

U001852459

PBS UST:

Facility ID:	9-459607	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-8610	Location:	Not reported
Operator:	ASHLAND OIL INC		
Contact:	Not reported		
Emergency Contact:	JACK PATTON, (716) 879-8610		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	ASHLAND OIL INC		

PO BOX 391
ASHLAND, KY 41114
(606) 329-3333

Owner Type: Corporate/Commercial
Owner Subtype: Not reported
Mailing Address: ASHLAND OIL INC
PO BOX 391
KY 41114
(606) 329-3333

Owner Mark: First Owner

Not Reported
Facility Status: Inactive
Certification: 08/23/1988
Tank Status: Closed Before April 1, 1991
Tank Location: UNDERGROUND

Total Capacity: 550
Expiration: 08/23/1993

Tank ID: 002
Product Stored: OTHER
Tank Internal: Not reported
Pipe Location: Not reported
Tank External: Not reported
Pipe External: Not reported
Second Containment: NONE
Leak Detection: NONE
Overfill Prot: Not reported
Date Tested: Not reported
Date Closed: 00/00
Database Type: Not reported

Install Date: 01/53
Tank Type: Steel/carbon steel
Pipe Internal: Not reported
Pipe Type: GALVANIZED STEEL

Dispenser: Suction
Next Test Date: Not reported
Test Method: Not reported

NRG019666

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND OIL (Continued)

U001852459

Facility ID:	9-459607	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-8610	Location:	Not reported
Operator:	ASHLAND OIL INC		
Contact:	Not reported		
Emergency Contact:	JACK PATTON, (716) 879-8610		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	ASHLAND OIL INC PO BOX 391 ASHLAND, KY 41114 (606) 329-3333	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	ASHLAND OIL INC PO BOX 391 KY 41114 (606) 329-3333 Not Reported		
Facility Status:	Inactive	Total Capacity:	8000
Certification:	08/23/1988	Expiration:	08/23/1993
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	003	Install Date:	00/00
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019667

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND OIL (Continued)

U001852459

Facility ID:	9-459607	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 879-8610	Location:	Not reported
Operator:	ASHLAND OIL INC		
Contact:	Not reported		
Emergency Contact:	JACK PATTON, (716) 879-8610		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	ASHLAND OIL INC PO BOX 391 ASHLAND, KY 41114 (606) 329-3333		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	ASHLAND OIL INC PO BOX 391 KY 41114 (606) 329-3333 Not Reported		
Facility Status:	Inactive	Total Capacity:	8000
Certification:	08/23/1988	Expiration:	08/23/1993
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	004	Install Date:	00/00
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

61
NNW
1/2-1
Higher

BROKEN TANKS
1249 STONY POINT RD
GRAND ISLAND, NY

LUST

S100118356
N/A

LUST:

Facility ID:	8912314	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	ANONYMOUS	Caller Agency:	CITIZEN
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	RESIDENT		
Address:	1249 STONY POINT GRAND ISLAND, NY 14072		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	05/09/1990	Spill Source:	Private Dwe
Spill Cause:	Tank Overfill	PBS Number:	Not reporter
Water Affected:	Not reported		
Spill Notifier:	Citizen		

NRG019668

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

BROKEN TANKS (Continued)

S100118356

Spill Date: 03/27/1990 12:00 Reported to Dept: 03/27/1990 12:30
 Cleanup Ceased: 03/28/1990
 Last Inspection: 03/28/1990
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 06/01/1990
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 03/28/1990
 Remark: BROKEN TANKS ON SITE

62
ENE
1/2-1
Higher

ASHLAND PETROLEUM-CANLAKE TRUC
740 GRAND ISLAND BLVD
TONAWANDA, NY 14150

FINDS

1000544763
NYD000325977

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility has an active water discharge permit (under PCS)

J63
NNE
1/2-1
Higher

LAKEHEAD PIPE LINE CO.
4570 RIVER RD
TONAWANDA, NY

NY Spills

S102178465
N/A

NRG019669

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

LAKEHEAD PIPE LINE CO. (Continued)

S102178465

SPILLS:

Facility ID:	9400011	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	JACK BOGNAR	Caller Agency:	BOGNAR BROS.
Caller Phone:	(716) 877-2115	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-3888
Spiller:	LAKEHEAD PIPE LINE CO.		
Address:	4700 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/23/1994		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Other	PBS Number:	Not reported
Spill Date:	03/28/1994 13:00	Reported to Dept:	03/28/1994 15:10
Cleanup Ceased:	12/23/1994		
Last Inspection:	10/15/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/06/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	04/05/1994		
Remark:	LEAK IN UNDERGROUND CRUDE OIL PIPELINE		

64
SSE
1/2-1
Higher

ASHLAND CHEMICAL CO
3701 RIVER RD
TONAWANDA, NY 14150

CERCLIS 1000276708
FINDS NYD000688630
RCRIS-LQG
LUST
NY Spills

CERCLIS Classification Data:

Site Incident Category:	R	Federal Facility:	NO
Ownership Status:	PRIVATE	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS Assessment History:

Assessment:	DISCOVERY	Completed:	12/15/80
Assessment:	HAZARD RANKING DETERMINED	Completed:	01/15/88
Assessment:	PRELIMINARY ASSESSMENT	Completed:	10/30/88
Assessment:	SCREENING SITE INSPECTION	Completed:	05/31/90

CERCLIS Site Status:

This site is currently under investigation by the government to assess the extent of further action

CERCLIS Alias Name(s):

ASHLAND II

NRG019670

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND CHEMICAL CO (Continued)

1000276708

RCRIS:

Owner: ASHLAND CHEMICAL CO
(614) 889-3333

Contact: ARLENE A HENDRICKSON
(614) 889-3695

Record Date: 11/14/94

Classification: Large Quantity Generator, Hazardous Waste Transporter

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	7400.00	D035	9000.00
F002	9000.00	F003	12000.00
F005	9000.00		

Used Oil Recyc: No

Violation Status: No violations found

LUST:

Facility ID: 8706601
Facility Contact: Not reported
Investigator: MF
Caller Name: Not reported
Caller Phone: Not reported
Notifier Name: Not reported
Notifier Phone: Not reported
Spiller Contact: Not reported
Spiller: ASHLAND CHEMICAL COMPANY
Address: 5200 BLAZER PARKWAY
DUBLIN, OHIO 43017

Region of Spill: 9
Facility Tele: Not reported
Spill Type: Facility
Caller Agency: Not reported
Caller Extension: Not reported
Notifier Agency: Not reported
Notifier Extension: Not reported
Spiller Phone: (716) 873-2446

Spill Class: Not reported
Spill Closed Dt: 01/07/1988
Spill Cause: Tank Test Failure
Water Affected: Not reported
Spill Notifier: Tank Tester
Spill Date: 11/04/1987 11:15
Cleanup Ceased: 01/07/1988
Last Inspection: 11/23/1987
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: True

Resource Affected: Groundwater
Spill Source: Other Commercial/Industrial
PBS Number: Not reported
Reported to Dept: 11/04/1987 11:15

Spill Record Last Update: 01/13/1988
Corrective Action Plan Submitted: Not reported
Date Spill Entered In Computer Data File: 11/05/1987

Remark: TANK TEST COULD NOT BE PERFORMED ON 10K UST, LEAK RATE TOO HIGH.

NRG019671

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND CHEMICAL CO (Continued)

1000276708

SPILLS:

Facility ID:	9409029	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	JACK SPICUZZA	Caller Agency:	ASHLAND CHEMICAL
Caller Phone:	(614) 889-3633	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(614) 790-3333
Spiller:	ASHLAND CHEMICAL		
Address:	PO BOX 2219 COLUMBUS, OHIO 43216		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/05/1994 13:00	Reported to Dept:	10/06/1994 10:00
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/26/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/17/1994		
Remark:	CONTAMINATED SOIL FOUND UNDER CONCRETE PAD IN OLD DIKE AREA		

NRG019672

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND CHEMICAL CO (Continued)

1000276708

Facility ID:	9615049	Region of Spill:	9
Facility Contact:	JACK SPICUZZA	Facility Tele:	(614) 790-3633
Investigator:	SAC	Spill Type:	UST
Caller Name:	JACK SPICUZZA	Caller Agency:	ASHLAND CHEMICAL CO
Caller Phone:	(614) 790-3633	Caller Extension:	Not reported
Notifier Name:	DEAN FERRELL	Notifier Agency:	ASHLAND CHEMICAL CO
Notifier Phone:	(716) 873-8294	Notifier Extension:	Not reported
Spiller Contact:	JACK SPICUZZA	Spiller Phone:	(614) 790-3633
Spiller:	ASHLAND CHEMICAL		
Address:	3701 RIVER RD TONAWANDA, NY		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	03/31/1997 08:30	Reported to Dept:	03/31/1997 10:35
Cleanup Ceased:	Not reported		
Last Inspection:	04/02/1997		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/02/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/31/1997		
Remark:	POSSIBLY 10-20 GALLONS MADE IT INTO A DITCH - ALL THE REST WAS CAPTURED IN A CONCRETE TANK FARM AREA - IT IS BELIEVED THAT SOME ONE MAY HAVE VANDALIZED A VALVE CAUSING SPILL		

K65
ENE
1/2-1
Higher

NOCO MOTOR FUELS INC
661 MAIN ST
TONAWANDA, NY 14150

UST
NY Spills

U001327026
N/A

NRG019673

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO MOTOR FUELS INC (Continued)

U001327026

SPILLS:

Facility ID:	8604973	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NOCO		
Address	661 MAIN STREET TONAWANDA, N. Y.		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	11/05/1986	Spill Source:	Gas Station
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/05/1986 11:15
Spill Notifier:	Fire Department		
Spill Date:	11/05/1986 10:57		
Cleanup Ceased:	11/05/1986		
Last Inspection:	11/05/1986		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/10/1986		
Remark:	Not reported		

NRG019674

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO MOTOR FUELS INC (Continued)

U001327026

PBS UST:

Facility ID:	9-042471	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 692-2257	Location:	Not reported
Operator:	NOCO MOTOR FUELS INC		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	RETAIL GASOLINE SALES		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		

Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		

Facility Status:	Active	Total Capacity:	4000
Certification:	01/15/1997	Expiration:	11/14/1901
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	1	Install Date:	12/73
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	SACRIFICIAL ANODE		
Pipe External:	NONE		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	04/93	Next Test Date:	04/98
Date Closed:	Not reported	Test Method:	AINLAY
Database Type:	Not reported		

NRG019675

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO MOTOR FUELS INC (Continued)

U001327026

<p>Facility ID: 9-042471 Town: Not reported Telephone: (716) 692-2257 Operator: NOCO MOTOR FUELS INC Contact: Not reported Emergency Contact: GARY ROESCH, (716) 874-6200 Facility Type: RETAIL GASOLINE SALES Total Tanks: 3 Owner: NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200 Owner Type: Corporate/Commercial Owner Subtype: Not reported Mailing Address: NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH Facility Status: Active Certification: 01/15/1997 Tank Status: In Service Tank Location: UNDERGROUND Tank ID: 2 Product Stored: UNLEADED GASOLINE Tank Internal: NONE Pipe Location: Underground Tank External: FIBERGLASS Pipe External: NONE Second Containment: NONE Leak Detection: NONE Overfill Prot: None Date Tested: 12/91 Date Closed: Not reported Database Type: Not reported</p>	<p>CBS Number: Not reported SWIS ID: 1464 Location: Not reported Old PBS Num: Not reported Owner Mark: First Owner Total Capacity: 10000 Expiration: 11/14/1901 Install Date: 12/77 Tank Type: Fiberglass reinforced plastic (FRP) Pipe Internal: NONE Pipe Type: GALVANIZED STEEL Dispenser: Suction Next Test Date: 12/96 Test Method: TANK AUDITOR</p>
---	--

NRG019676

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO MOTOR FUELS INC (Continued)

U001327026

Facility ID:	9-042471	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 692-2257	Location:	Not reported
Operator:	NOCO MOTOR FUELS INC		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	RETAIL GASOLINE SALES		
Total Tanks:	3	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Active	Total Capacity:	10000
Certification:	01/15/1997	Expiration:	11/14/1901
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	3	Install Date:	09/80
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	SACRIFICIAL ANODE		
Pipe External:	NONE		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	12/91	Next Test Date:	12/96
Date Closed:	Not reported	Test Method:	TANK AUDITOR
Database Type:	Not reported		

**K66
ENE
1/2-1
Higher**

**OCCIDENTAL CHEMICAL CORP
700 GRAND ISLAND BLVD
TONAWANDA, NY 14150**

**FINDS 1000247998
RCRIS-LQG NYD980774665**

RCRIS:

Owner: Not reported
Contact: GARY ROESCH
(716) 278-7545
Record Date: 07/18/84
Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	5100.00

NRG019677

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

OCCIDENTAL CHEMICAL CORP (Continued)

1000247998

Used Oil Recyc: No
Violation Status: No violations found

**K67
ENE
1/2-1
Higher**

**700 GRAND ISLAND BLVD.
700 GRAND ISLAND BLVD.
TONAWANDA, NY 14150**

ERNS

93002003
N/A

**K68
ENE
1/2-1
Higher**

**NOCO ENERGY CORP
700 GRAND ISLAND BLVD
TONAWANDA, NY 14150**

RCRIS-SQG
FINDS
UST
LUST
NY Spills
AST

1000325240
NYD013293519

RCRIS:

Owner: NOCO ENERGY CORP
(716) 874-6200

Contact: GARY ROESCH
(716) 874-7250

Record Date: 03/11/94

Classification: Conditionally Exempt Small Quantity Generator, Hazardous Waste Transporter

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

Waste	Quantity (Lbs)	Waste	Quantity (Lbs)
D008	106000.00	F001	106000.00
F002	106000.00		

Used Oil Recyc: No
Violation Status: No violations found

FINDS:

- Other Pertinent Environmental Activity Identified at Site:
- Facility has an active water discharge permit (under PCS)
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

LUST:

Facility ID:	9208806	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	JOHN OTTO	Caller Agency:	DEC
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-6200
Spiller:	NOCO ENERGY		
Address:	700 GRAND ISLAND BLVD. TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/14/1994		
Spill Cause:	Tank Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Gas Station
Spill Notifier:	DEC	PBS Number:	9-224405

NRG019678

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 10/20/1995

Spill Cause: Tank Overfill

Water Affected: Not reported

Spill Notifier: Responsible Party

Spill Date: 09/11/1995 14:30

Cleanup Ceased: 10/20/1995

Last Inspection: 09/11/1995

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 11/01/1995

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 09/13/1995

Remark: OVERFILL OF 20000 GAL BULK WASTE OIL TANK. SPILL IS CONTAINED IN DIKE. VAC TRUCK PUMPING OUT DIKE.

Facility ID: 9413668

Facility Contact: Not reported

Investigator: SAC

Caller Name: GARY ROESCH

Caller Phone: (716) 874-6200

Notifier Name: Not reported

Notifier Phone: Not reported

Spiller Contact: GARY ROESCH

Spiller: NOCO ENERGY

Address: 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150

Region of Spill: 9

Facility Tele: Not reported

Spill Type: Facility

Caller Agency: NOCO ENERGY

Caller Extension: Not reported

Notifier Agency: Not reported

Notifier Extension: Not reported

Spiller Phone: (761) 874-6200

Spill Class: Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 01/23/1996

Spill Cause: Other

Water Affected: Not reported

Spill Notifier: Responsible Party

Spill Date: 01/01/1995 12:00

Cleanup Ceased: Not reported

Last Inspection: Not reported

Cleanup Meets Standard: False

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 02/06/1996

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 01/17/1995

Remark: ANNUAL WELL SAMPLING FOR MOSF LICENSE INDICATED EXCEEDANCES IN SOME WELLS.

NRG019680

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

SPILLS:

Facility ID:	8604425	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	UST
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-6200
Spiller:	NOCO ENERGY		
Address:	700 GRAND ISLAND BLVD. TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported		
Spill Cause:	Equipment Failure	Resource Affected:	Groundwater
Water Affected:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/08/1986 16:00	Reported to Dept:	10/08/1986 16:00
Cleanup Ceased:	Not reported		
Last Inspection:	06/16/1991		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/29/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	10/21/1986		
Remark:	GROUNDWATER MONITORING WELLS HAD ODORS		

NRG019681

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9011062	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	PAUL LEWCHNER	Caller Agency:	ARMY CORPS OF ENGINEERS
Caller Phone:	(716) 879-4313	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-6200
Spiller:	NOCO ENERGY		
Address:	700 GRAND ISLAND BLVD TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/14/1994	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Major Facility 400,000 gallons
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Federal Government	Reported to Dept:	01/17/1991 13:05
Spill Date:	01/17/1991 12:50		
Cleanup Ceased:	10/14/1994		
Last Inspection:	09/30/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/17/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	01/18/1991		
Remark:	TANK #110 OVERFILLED DURING PRODUCT RECEIPT FROM TANK TRUCKS		

NRG019682

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9510648	Region of Spill:	9
Facility Contact:	GARY ROESCH	Facility Tele:	(716) 874-7250
Investigator:	MJS	Spill Type:	Facility
Caller Name:	GARY ROESCH	Caller Agency:	NOCO
Caller Phone:	(716) 874-7250	Caller Extension:	0
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GARY ROESCH	Spiller Phone:	(716) 874-7250
Spiller:	NOCO ENERGY CORP		
Address:	700 GRAND ISLAND BLVD TONAWANDA, NY 14151		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	01/11/1996	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Major Facility 400,000 gallons
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	11/24/1995 14:14
Spill Date:	11/22/1995 08:00		
Cleanup Ceased:	Not reported		
Last Inspection:	11/24/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/18/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/24/1995		
Remark:	GAS LEAK FROM PIPELINE TO SUPPLY TERMINAL - LINE WONT HOLD PRESSURE		

NRG019683

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

PBS UST:

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	8000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	101	Install Date:	01/83
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019684

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	8000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	102	Install Date:	01/83
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	00/00	Test Method:	Not reported
Database Type:	Not reported		

NRG019685

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	8000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed Before April 1, 1991		
Tank Location:	UNDERGROUND		
Tank ID:	103	Install Date:	01/83
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Suction
Overfill Prot:	Not reported	Next Test Date:	Not reported
Date Tested:	Not reported	Test Method:	Not reported
Date Closed:	00/00		
Database Type:	Not reported		

NRG019686

MAP FINDINGS

Map ID
Direction
Distance
Elevation

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	6000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	104	Install Date:	01/68
Product Stored:	LEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE	Dispenser:	Suction
Overfill Prot:	Not reported	Next Test Date:	Not reported
Date Tested:	09/87	Test Method:	PETRO-TITE
Date Closed:	10/92		
Database Type:	Not reported		

NRG019687

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	10000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	105	Install Date:	01/68
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	09/87	Next Test Date:	Not reported
Date Closed:	10/92	Test Method:	PETRO-TITE
Database Type:	Not reported		

NRG019688

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	First Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	6000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	106	Install Date:	01/68
Product Stored:	UNLEADED GASOLINE	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	09/87	Next Test Date:	Not reported
Date Closed:	10/92	Test Method:	PETRO-TITE
Database Type:	Not reported		

NRG019689

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-224405	CBS Number:	9-000101
Town:	Not reported	SWIS ID:	1416
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	GARY ROESCH		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR		
Total Tanks:	7	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD TONAWANDA, NY 14150 (716) 874-6200	Owner Mark:	First Owner
Owner Type:	Corporate/Commercial		
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Inactive	Total Capacity:	10000
Certification:	07/14/1992	Expiration:	08/17/1997
Tank Status:	Closed-Removed		
Tank Location:	UNDERGROUND		
Tank ID:	107	Install Date:	01/68
Product Stored:	DIESEL	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	GALVANIZED STEEL
Tank External:	Not reported		
Pipe External:	Not reported		
Second Containment:	NONE		
Leak Detection:	NONE		
Overfill Prot:	Not reported	Dispenser:	Suction
Date Tested:	09/87	Next Test Date:	Not reported
Date Closed:	10/92	Test Method:	PETRO-TITE
Database Type:	Not reported		

NRG019690

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

CBS AST:			
Facility ID:	9-000101	Telephone:	(716) 874-6200
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Facility Status:	Inactive	Total AST's:	5
Tank ID:	115	Capacity (Gal):	30000
Tank Status:	Not reported	Product Stored:	Not reported
Tank Location:	ABOVEGROUND		
Install Date:	07/81	Pipe Location:	Not reported
Tank Type:	Steel/carbon steel	Haz Percent:	0
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON		
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported		
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE	PBS Number:	9-091240
Case Number:	108883	SWIS Code:	1464
MOSF Number:	9-1240	ICS Number:	9-177892
SPDES Number:	0-105678	Facility Town:	TONAWANDA
Operator:	GARY G. ROESCH	Emrgncy Phone:	(716) 773-3967
Emrgncy Contact:	GARY G. ROESCH	Expiration Date:	02/09/94
Certified Date:	01/22/92	Facility Type:	Storage Terminal
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	NOCO ENERGY CORP		
Mail Contact:	GARY G. ROESCH 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150		
Mail Phone:	(716) 874-6200		

NRG019691

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-000101	Telephone:	(716) 874-6200
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Facility Status:	Inactive	Total AST's:	5
Tank ID:	121		
Tank Status:	Not reported	Capacity (Gal):	995239
Tank Location:	ABOVEGROUND	Product Stored:	LEADED GASOLINE
Install Date:	12/52		
Tank Type:	Steel/carbon steel	Pipe Location:	Aboveground
Extrnl Protection:	NONE		
Intrnl Protection:	NONE	Haz Percent:	100
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON		
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	VAULT		
Leak Detection:	NONE		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported	PBS Number:	9-091240
Tank Closed:	00/00	SWIS Code:	1464
Region:	STATE	ICS Number:	9-177892
Case Number:	1330207	Facility Town:	TONAWANDA
MOSF Number:	9-1240	Emrgncy Phone:	(716) 773-3967
SPDES Number:	0-105678	Expiration Date:	02/09/94
Operator:	GARY G. ROESCH	Facility Type:	Storage Terminal
Emrgncy Contact:	GARY G. ROESCH		
Certified Date:	01/22/92		
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	NOCO ENERGY CORP		
Mail Contact:	GARY G. ROESCH 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Mail Phone:			

NRG019692

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-000101	Telephone:	(716) 874-6200
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Facility Status:	Inactive	Total AST's:	5
Tank ID:	111		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	983000
Install Date:	12/46	Product Stored:	LEADED GASOLINE
Tank Type:	Steel/carbon steel		
Extrnl Protection:	SACRIFICIAL ANODE	Pipe Location:	Aboveground
Intrnl Protection:	EPOXY LINER		
Tank Containment:	CUT-OFF WALLS	Haz Percent:	100
Pipe Type:	STEEL/IRON		
Pipe Internal:	NONE		
Pipe External:	NONE		
Pipe Containment:	VAULT		
Leak Detection:	VAPOR WELL		
Overfill Protection:	Product Level Gauge		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE	PBS Number:	9-091240
Case Number:	108883	SWIS Code:	1464
MOSF Number:	9-1240	ICS Number:	9-177892
SPDES Number:	0-105678	Facility Town:	TONAWANDA
Operator:	GARY G. ROESCH	Emrgncy Phone:	(716) 773-3967
Emrgncy Contact:	GARY G. ROESCH	Expiration Date:	02/09/94
Certified Date:	01/22/92	Facility Type:	Storage Terminal
Owner type:	Corporate/Commercial		
Owner Sub Type:	Not reported		
Mail Name:	NOCO ENERGY CORP		
Mail Contact:	GARY G. ROESCH 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Mail Phone:	(716) 874-6200		

NRG019693

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-000101	Telephone:	(716) 874-6200
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Facility Status:	Inactive	Total AST's:	5
Tank ID:	116		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	01/87	Capacity (Gal):	30000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE		
Case Number:	75070	PBS Number:	9-091240
MOSF Number:	9-1240	SWIS Code:	1464
SPDES Number:	0-105678	ICS Number:	9-177892
Operator:	GARY G. ROESCH	Facility Town:	TONAWANDA
Emrgncy Contact:	GARY G. ROESCH	Emrgncy Phone:	(716) 773-3967
Certified Date:	01/22/92	Expiration Date:	02/09/94
Owner type:	Corporate/Commercial	Facility Type:	Storage Terminal
Owner Sub Type:	Not reported		
Mail Name:	NOCO ENERGY CORP		
Mail Contact:	GARY G. ROESCH 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150		
Mail Phone:	(716) 874-6200		

NRG019694

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

NOCO ENERGY CORP (Continued)

1000325240

Facility ID:	9-000101	Telephone:	(716) 874-6200
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150 (716) 874-6200		
Facility Status:	Inactive	Total AST's:	5
Tank ID:	117		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	01/87	Capacity (Gal):	30000
Tank Type:	Steel/carbon steel	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overfill Protection:	Not reported		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE		
Case Number:	75070	PBS Number:	9-091240
MOSF Number:	9-1240	SWIS Code:	1464
SPDES Number:	0-105678	ICS Number:	9-177892
Operator:	GARY G. ROESCH	Facility Town:	TONAWANDA
Emrgncy Contact:	GARY G. ROESCH	Emrgncy Phone:	(716) 773-3967
Certified Date:	01/22/92	Expiration Date:	02/09/94
Owner type:	Corporate/Commercial	Facility Type:	Storage Terminal
Owner Sub Type:	Not reported		
Mail Name:	NOCO ENERGY CORP		
Mail Contact:	GARY G. ROESCH 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150		
Mail Phone:	(716) 874-6200		

**K69
ENE
1/2-1
Higher**

**NOCO - 700 RIVER ROAD
700 GRAND ISLAND BLVD
TONAWANDA, NY**

**NY Spills S102177901
N/A**

NRG019695

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO - 700 RIVER ROAD (Continued)

S102177901

SPILLS:

Facility ID:	9303377	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	KRISTINE SMITH	Caller Agency:	NOCO ENERGY
Caller Phone:	(716) 874-6200	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NOCO ENERGY		
Address:	700 GRAND ISLAND BLVD TOANWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	08/06/1993	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Major Facility 400,000 gallons
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	06/15/1993 10:43
Spill Date:	06/15/1993 10:40		
Cleanup Ceased:	08/06/1993		
Last Inspection:	08/06/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/31/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/17/1993		
Remark:	DEFECTIVE FLANGE ON #6 FUEL OIL STORAGE TANK.		

K70
ENE
1/2-1
Higher

**NOCO ENERGY - TERMINAL
700 GRAND ISLAND BLVD
TONAWANDA, NY**

NY Spills

**S102179132
N/A**

NRG019696

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

NOCO ENERGY - TERMINAL (Continued)

S102179132

SPILLS:

Facility ID: 9410370 Facility Contact: Not reported Investigator: SAC Caller Name: GARY ROESCH Caller Phone: (716) 874-6200 Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: NOCO ENERGY Address: 700 GRAND ISLAND BLVD. TONAWANDA, NY 14150	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: NOCO ENERGY Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 874-6200
---	---

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 01/31/1995 Spill Cause: Equipment Failure Water Affected: Not reported Spill Notifier: Responsible Party Spill Date: 10/01/1994 12:00 Cleanup Ceased: 01/31/1995 Last Inspection: 11/29/1994 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 02/06/1995 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 11/03/1994	Resource Affected: On Land Spill Source: Major Facility 400,000 gallons PBS Number: Not reported Reported to Dept: 10/27/1994 11:30
--	--

Remark: SEAL ON PUMP LEAKED SPILLING OIL INTO THE DIKE FOR TANK #122.

J71
 NNE
 1/2-1
 Higher

ASHLAND TANK 75
 4625 RIVER ROAD
 TONAWANDA (T), NY 14150

SHWS

S102001036
 N/A

NRG019697

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ASHLAND PETROLEUM CO (Continued)

1000845571

SPILLS:

Facility ID:	9507120	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	UST
Caller Name:	PAT MCCAFFREY	Caller Agency:	ASHLAND
Caller Phone:	(606) 921-3943	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ASHLAND OIL		
Address:	4625 RIVER ROAD TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	Not reported	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	09/11/1995 17:50
Spill Date:	09/11/1995 16:30		
Cleanup Ceased:	Not reported		
Last Inspection:	09/12/1995		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/19/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/11/1995		
Remark:	HOLDING TANK FAILURE, CLEANUP UNDER WAY		

J73
NNE
1/2-1
Higher

LEAKING DRUMS AT NOCO
4635 RIVER RD
TONAWANDA, NY

NY Spills

S102561411
N/A

NRG019699

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

LEAKING DRUMS AT NOCO (Continued)

S102561411

SPILLS:

Facility ID:	9614139	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	ANNONYMOUS	Caller Agency:	CITIZEN
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GARY ROESCH	Spiller Phone:	(716) 874-6200
Spiller:	NOCO		
Address	700 GRAND ISLAND TONAWANDA, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	03/06/1997	Resource Affected:	On Land
Spill Cause:	Housekeeping	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	03/05/1997 12:45
Spill Date:	03/01/1997 12:00		
Cleanup Ceased:	03/06/1997		
Last Inspection:	03/06/1997		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/07/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/05/1997		
Remark:	25-40 55gal drums on premises containing waste fuel & oil. drums are in poor condition and are leaking to ground. FAXED FROM REGION		

J74
NNE
1/2-1
Higher

NOCO ENERGY CORP S-T
4635 RIVER RD
TONAWANDA, NY 14150

UST
NY Spills
AST

U003079780
N/A

NRG019700

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

SPILLS:

Facility ID:	9502719	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	TED	Spill Type:	Facility
Caller Name:	MICHAEL GUGGEMOS	Caller Agency:	TONAWANDA FD
Caller Phone:	(716) 876-1212	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN MOTORIST		
Address:	Not reported		
	Not reported		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	06/06/1995		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Gas Station
Spill Notifier:	Fire Department	PBS Number:	Not reported
Spill Date:	06/02/1995 19:58	Reported to Dept:	06/02/1995 20:32
Cleanup Ceased:	06/06/1995		
Last Inspection:	06/05/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/06/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/06/1995		
Remark:	DRIVER DROVE AWAY WITH NOZZLE IN TANK		

NRG019701

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

PBS UST:

Facility ID:	9-463280	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	NOCO MOTOR FUELS		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR, RETAIL GASOLINE SALES		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP		

700 GRAND ISLAND BOULEVARD
TONAWANDA, NY 14150
(716) 874-6200

Owner Type: Corporate/Commercial Owner Mark: Second Owner

Owner Subtype: Not reported
Mailing Address: NOCO ENERGY CORP
700 GRAND ISLAND BOULEVARD
P.O. BOX 86
NY 14150
(716) 874-6200
ATTN: GARY ROESCH

Facility Status:	Active	Total Capacity:	10000
Certification:	09/06/1995	Expiration:	11/03/1997

Tank Status: In Service
Tank Location: UNDERGROUND
Tank ID: U1

Install Date:	10/78
Tank Type:	Fiberglass reinforced plastic [FRP]
Pipe Internal:	NONE
Pipe Type:	GALVANIZED STEEL

Product Stored: UNLEADED GASOLINE
Tank Internal: NONE
Pipe Location: Underground
Tank External: NONE/NONE
Pipe External: NONE/NONE
Second Containment: NONE/NONE
Leak Detection: NONE/NONE
Overfill Prot: None
Date Tested: 08/92
Date Closed: Not reported
Database Type: Not reported

Dispenser:	Submersible
Next Test Date:	08/97
Test Method:	HORNER

NRG019702

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

Facility ID:	9-463280	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	NOCO MOTOR FUELS		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR, RETAIL GASOLINE SALES		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD P.O. BOX 86 NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Active	Total Capacity:	10000
Certification:	09/06/1995	Expiration:	11/03/1997
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	U2	Install Date:	10/78
Product Stored:	UNLEADED GASOLINE	Tank Type:	Fiberglass reinforced plastic [FRP]
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	NONE/NONE		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Submersible
Date Tested:	08/92	Next Test Date:	08/97
Date Closed:	Not reported	Test Method:	HORNER
Database Type:	Not reported		

NRG019703

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

Facility ID:	9-463280	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	NOCO MOTOR FUELS		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR, RETAIL GASOLINE SALES		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD P.O. BOX 86 NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Active	Total Capacity:	10000
Certification:	09/06/1995	Expiration:	11/03/1997
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	U3	Install Date:	10/78
Product Stored:	UNLEADED GASOLINE	Tank Type:	Fiberglass reinforced plastic [FRP]
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	NONE/NONE		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Submersible
Date Tested:	08/92	Next Test Date:	08/97
Date Closed:	Not reported	Test Method:	HORNER
Database Type:	Not reported		

NRG019704

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

Facility ID:	9-463280	CBS Number:	Not reported
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 874-6200	Location:	Not reported
Operator:	NOCO MOTOR FUELS		
Contact:	Not reported		
Emergency Contact:	GARY ROESCH, (716) 874-6200		
Facility Type:	STORAGE TERMINAL/PETROLEUM DISTRIBUTOR, RETAIL GASOLINE SALES		
Total Tanks:	4	Old PBS Num:	Not reported
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
Owner Subtype:	Not reported		
Mailing Address:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD P.O. BOX 86 NY 14150 (716) 874-6200 ATTN: GARY ROESCH		
Facility Status:	Active	Total Capacity:	10000
Certification:	09/06/1995	Expiration:	11/03/1997
Tank Status:	In Service		
Tank Location:	UNDERGROUND		
Tank ID:	U4	Install Date:	10/78
Product Stored:	DIESEL	Tank Type:	Fiberglass reinforced plastic [FRP]
Tank Internal:	NONE	Pipe Internal:	NONE
Pipe Location:	Underground	Pipe Type:	GALVANIZED STEEL
Tank External:	NONE/NONE		
Pipe External:	NONE/NONE		
Second Containment:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Submersible
Date Tested:	08/92	Next Test Date:	08/97
Date Closed:	Not reported	Test Method:	HORNER
Database Type:	Not reported		

NRG019705

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

PBS AST:

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		

Tank ID:	A1	Capacity (Gal):	1000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	KEROSENE	Tank Type:	Steel/carbon steel
Install Date:	01/80	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	NONE/NONE		
Pipe Location:	Aboveground	Pipe Type:	GALVANIZED STEEL
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		

Tank ID:	A02	Capacity (Gal):	2000
Tank Status:	In Service		
Tank Location:	ABOVEGROUND		
Product Stored:	OTHER	Tank Type:	Steel/carbon steel
Install Date:	01/75	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	NONE/NONE		
Pipe Location:	Aboveground	Pipe Type:	GALVANIZED STEEL
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019706

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		

Tank ID:	A03	Capacity (Gal):	2000
Tank Status:	In Service	Tank Type:	Steel/carbon steel
Tank Location:	ABOVEGROUND	Tank Internal:	NONE
Product Stored:	OTHER	Pipe Location:	Underground
Install Date:	01/75	Pipe Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING	Pipe External:	NONE/NONE
Tank Containment:	NONE/NONE	Leak Detection:	NONE/NONE
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		

Tank ID:	A05	Capacity (Gal):	275
Tank Status:	In Service	Tank Type:	Steel/carbon steel
Tank Location:	ABOVEGROUND	Tank Internal:	NONE
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Pipe Location:	Aboveground
Install Date:	06/91	Pipe Internal:	NONE
Tank External:	NONE/NONE	Pipe External:	NONE/NONE
Tank Containment:	NONE/NONE	Leak Detection:	NONE/NONE
Overfill Prot:	Vent Whistle	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019707

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	A06	Capacity (Gal):	275
Tank Status:	In Service		
Tank Location:	ABOVEGROUND	Tank Type:	Steel/carbon steel
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Internal:	NONE
Install Date:	01/75		
Tank External:	NONE/NONE		
Tank Containment:	NONE/NONE	Pipe Type:	GALVANIZED STEEL
Pipe Location:	Aboveground		
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	Vent Whistle	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	N.T.R
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		
Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	A07	Capacity (Gal):	300
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND	Tank Type:	Steel/carbon steel
Product Stored:	NOS 1,2, OR 4 FUEL OIL	Tank Internal:	NONE
Install Date:	06/89		
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	NONE/NONE	Pipe Type:	NONE
Pipe Location:	None		
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Submersible
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

NRG019708

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY CORP S-T (Continued)

U003079780

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	A08	Capacity (Gal):	300
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND		
Product Stored:	LUBE OIL	Tank Type:	Steel/carbon steel
Install Date:	01/92	Tank Internal:	NONE
Tank External:	NONE/PAINTED/ASPHALT COATING		
Tank Containment:	NONE/NONE		
Pipe Location:	None	Pipe Type:	NONE
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Submersible
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

Facility ID:	9-463280	Telephone:	(716) 874-6200
Facility Status:	Active	Total Ast's:	8
Owner:	NOCO ENERGY CORP 700 GRAND ISLAND BOULEVARD TONAWANDA, NY 14150 (716) 874-6200		
Tank ID:	A04	Capacity (Gal):	1000
Tank Status:	Closed-Removed		
Tank Location:	ABOVEGROUND		
Product Stored:	EMPTY	Tank Type:	Steel/carbon steel
Install Date:	10/90	Tank Internal:	NONE
Tank External:	NONE/NONE		
Tank Containment:	NONE/NONE		
Pipe Location:	Aboveground	Pipe Type:	GALVANIZED STEEL
Pipe Internal:	NONE		
Pipe External:	NONE/NONE		
Leak Detection:	NONE/NONE		
Overfill Prot:	None	Dispenser:	Suction
Date Tested:	Not reported	Next Test Date:	Not reported
Date Closed:	Not reported	Test Method:	Not reported
Region:	ST		

J75
NNE
1/2-1
Higher

AGWAY PETROLEM CORP
4635 RIVER RD
TONAWANDA, NY 14150

FINDS 1000160983
RCRIS-LQG NYD002127090
NY Spills

NRG019709

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

AGWAY PETROLEM CORP (Continued)

1000160983

RCRIS:

Owner: AGWAY PETROLEUM CORPORATION
(212) 555-1212

Contact: RICHARD D WILLIAM
(315) 477-6032

Record Date: 06/04/82

Classification: Large Quantity Generator, Conditionally Exempt Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

SPILLS:

Facility ID:	9010215	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	RANDY BAKER	Caller Agency:	AGWAY - TONAWANDA
Caller Phone:	(716) 877-3143	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-3143
Spiller:	KAY TRUCKING (AGWAY)		
Address:	24 EAST CHARBURG DRIVE CHEEKTOWAGA, NY 14225		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/19/1991	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Non Major Facility > 1,100 gallons
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Affected Persons	Reported to Dept:	12/20/1990 10:26
Spill Date:	12/20/1990 10:00		
Cleanup Ceased:	12/19/1991		
Last Inspection:	09/17/1991		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	10/04/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/24/1990		
Remark:	NOZZLE CAME OUT OF TANK WHEN FILLING TANK FROM TRUCK		

76
SW
1/2-1
Higher

PAINTING DOCK IN RIVER
48 MELROSE
GRAND ISLAND, NY

NY Spills

S102447756
N/A

NRG019710

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

PAINTING DOCK IN RIVER (Continued)

S102447756

SPILLS:

Facility ID:	9609878	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	UST
Caller Name:	MARK KOWZANK	Caller Agency:	RESIDENT
Caller Phone:	(716) 773-7393	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	PEACOCK RESIDENT		
Address:	48 MELROSE STREET GRAND ISLAND, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	11/12/1996	Resource Affected:	Surface Water
Spill Cause:	Housekeeping	Spill Source:	Vessel
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	11/07/1996 12:15
Spill Date:	11/06/1996 08:00		
Cleanup Ceased:	11/07/1996		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/22/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/07/1996		
Remark:	paint fell in river from dock while painting		

L77
SSE
1/2-1
Higher

RIVER ROAD DITCH
3688 RIVER RD
TONAWANDA, NY

NY Spills

S102175139
N/A

NRG019711

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

RIVER ROAD DITCH (Continued)

S102175139

SPILLS:

Facility ID:	8600786	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	05/02/1986	Resource Affected:	Surface Water
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	05/01/1986 09:15
Spill Date:	04/30/1986 12:00		
Cleanup Ceased:	05/02/1986		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/02/1987		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/29/1986		
Remark:	OTHER SPILL LOCATION-@REFINERY AREA		

**L78
SSE
1/2-1
Higher**

**CARMEN M PARISO INC
3649 RIVER RD
TONAWANDA, NY 14150**

**RCRIS-SQG 1000297443
FINDS NYD057671729**

RCRIS:

Owner: Not reported
Contact: TONY PARISO
(716) 875-6168
Record Date: 05/21/85
Classification: Hazardous Waste Transporter
Used Oil Recyc: No
Violation Status: No violations found

**L79
SSE
1/2-1
Higher**

**TEXACO USA /A DIV OF TEXACO INC
RIVER RD & JAMES ST
TONAWANDA, NY 14150**

**RCRIS-SQG 1000144980
FINDS NYD085684264
CERC-NFRAP**

NRG019712

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

TEXACO USA /A DIV OF TEXACO INC (Continued)

1000144980

CERCLIS-NFRAP Classification Data:

Site Incident Category: Not reported	Federal Facility: NO
Ownership Status: OTHER	NPL Status: NOT ON NPL
EPA Notes: 30 ACRES USED FOR GASOLINE, JET FUEL, & FUEL OIL STORAGE IN ABOVE GRND TNKS. TWO LARGE TNKS, 3 MILLNS GALL EACH, STILL ONSITE AS ARE SMLLR 20,000 TNKS. OIL/WATER SEPARATOR, BUILT FOR DRAINAGE OF LOADNG PLTFORM, STILL EXIST ONSITE & CONTNS OIL	

CERCLIS-NFRAP Assessment History:

Assessment: DISCOVERY	Completed: 06/01/81
Assessment: PRELIMINARY ASSESSMENT	Completed: 04/25/86
Assessment: SCREENING SITE INSPECTION	Completed: 09/18/86

CERCLIS-NFRAP Alias Name(s):

TEXACO INC TONAWANDA TERMINAL

RCRIS:

Owner: TEXACO-U.S.A.
(609) 667-3800

Contact: H E PHILLIPS
(609) 667-3800

Record Date: 08/18/80

Classification: Not reported

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility has an active water discharge permit (under PCS)

80
West
1/2-1
Higher

OIL FROM DISCARDED TANK
71 CAROL LANE
GRAND ISLAND, NY

NY Spills S102133386
N/A

NRG019713

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

OIL FROM DISCARDED TANK (Continued)

S102133386

SPILLS:

Facility ID:	8805999	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	DONNA JELLISON	Caller Agency:	GRAND ISLAND FD
Caller Phone:	(716) 773-4337	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 773-7365
Spiller:	JOHN CAMERON		
Address:	71 CAROL LANE GRAND ISLAND, NY		
Spill Class:	Not reported		
Spill Closed Dt:	10/20/1988	Resource Affected:	In Sewer
Spill Cause:	Human Error	Spill Source:	Private Dwelling
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	10/16/1988 16:05
Spill Date:	10/16/1988 15:20		
Cleanup Ceased:	10/20/1988		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/25/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/17/1988		
Remark:	OIL SPILLED FROM BOTTOM OF DISCARDED 250 GAL.TANK AT CURB.WASHED DOWN WITH WATER AND COVERED WITH SPEEDY DRY.		

M81
SSE
> 1
Higher

NOCO ENERGY PRODUCTS III
100 JAMES AVE
TONAWANDA, NY

NY Spills

S102178088
N/A

NRG019714

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NOCO ENERGY PRODUCTS III (Continued)

S102178088

SPILLS:

Facility ID:	9306748	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	RICHARD COWAN	Caller Agency:	NYSDEC
Caller Phone:	(518) 457-7363	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NOCO ENERGY		
Address:	100 JAMES AVENUE TONAWANDA, NY 14051		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/06/1995	Resource Affected:	On Land
Spill Cause:	Housekeeping	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	DEC	Reported to Dept:	09/01/1993 11:00
Spill Date:	08/10/1993 12:00		
Cleanup Ceased:	02/06/1995		
Last Inspection:	09/08/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/20/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/02/1993		
Remark:	25' X 10' AREA AT LOADING RACK APPEARS CONTAMINATED.		

82
WNW
> 1
Higher

CROMWELL METALS INC
1740 BROADWAY
BUFFALO, NY 14227

FINDS

1000549971
NYD986868099

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

N83
NNE
> 1
Higher

PETROLEUM IN DITCH
4700 RIVER RD
TONAWANDA, NY

NY Spills

S102177871
N/A

NRG019715

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

PETROLEUM IN DITCH (Continued)

S102177871

SPILLS:

Facility ID:	9302729	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	OFFICER KELMAN	Caller Agency:	TONAWANDA P.D.
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.		
Spill Closed Dt:	06/01/1993		
Spill Cause:	Unknown	Resource Affected:	Surface Water
Water Affected:	Not reported	Spill Source:	Major Facility 400,000 gallons
Spill Notifier:	Affected Persons	PBS Number:	Not reported
Spill Date:	05/28/1993 21:00	Reported to Dept:	05/29/1993 18:24
Cleanup Ceased:	06/01/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/11/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/09/1993		
Remark:	DOG COVERED WITH PETROLEUM AFTER GOING INTO AGWAY DITCH		

**N84
NNE
> 1
Higher**

**LAKEHEAD PIPE LINE CO INC
4700 RIVER RD
TONAWANDA, NY 14150**

**RCRIS-SQG 1000202811
FINDS NYD980773618**

RCRIS:

Owner: Not reported
Contact: G J BARTH
(716) 877-3888
Record Date: 06/15/84
Classification: Small Quantity Generator
Used Oil Recyc: No
Violation Status: No violations found

**N85
NNE
> 1
Higher**

**LAKHEAD RIVER ROAD
4700 RIVER RD
TONAWANDA, NY**

**NY Spills S102179349
N/A**

NRG019716

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

LAKHEAD RIVER ROAD (Continued)

S102179349

SPILLS:

Facility ID:	9416921	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	JACK BOGNAR	Caller Agency:	BOGNAR BROTHERS
Caller Phone:	(716) 877-2215	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 877-3888
Spiller:	LAKEHEAD PIPELINE CO		
Address:	4700 RIVER ROAD TONAWANDA, NY 14150		
Spill Class:	Known release that creates potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	08/07/1995	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Other	Reported to Dept:	03/30/1995 11:00
Spill Date:	03/29/1995 10:00		
Cleanup Ceased:	08/07/1995		
Last Inspection:	03/30/1995		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/18/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/03/1995		
Remark:	FOUND PIPELINE CONTAMINATION WHILE DOING CHECK OF SYSTEM		

**N86
NNE
> 1
Higher**

**NIAGARA LANDFILL
4825 RIVER ROAD
TONAWANDA, NY 14120**

FINDS

**1000551142
NYD986921203**

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

**N87
NNE
> 1
Higher**

**SEAWAY IND WASTE DSPL
4825 RIVER RD
TONAWANDA, NY 14150**

**CERCLIS
FINDS**

**1000435652
NYD094177292**

CERCLIS Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS Assessment History:

Assessment:	DISCOVERY	Completed:	03/01/79
Assessment:	PRELIMINARY ASSESSMENT	Completed:	12/01/80
Assessment:	SCREENING SITE INSPECTION	Completed:	12/31/91

CERCLIS Site Status:

This site is currently under investigation by the government to assess the extent of further acti-

CERCLIS Alias Name(s):
NIAGARA LANDFILL INC

NRG019717

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

SEAWAY IND WASTE DSPL (Continued)

1000435652

SEAWAY INDUSTRIAL PARK DEVELOPMENT CO

M88
SSE
> 1
Higher

CHEMICAL/OIL ODOR
83 KAUFMAN AVE
TONAWANDA, NY

NY Spills

S102561469
N/A

SPILLS:

Facility ID:	9700993	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	KATHY HARRIS	Caller Agency:	CITIZEN
Caller Phone:	(716) 877-5618	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.

Spill Closed Dt:	04/24/1997	Resource Affected:	Air
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	04/23/1997 07:14
Spill Date:	04/23/1997 07:00		
Cleanup Ceased:	Not reported		
Last Inspection:	04/23/1997		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/24/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/23/1997		

Remark: CALLER REPORTS A STRONG PETRO ODOR IN AREA - VERY OVERPOWERING REQ SOMEONE TO CHECK AREA

O89
SSE
> 1
Higher

FMC CORPORATION
35 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S101341681
N/A

LUST:

Facility ID:	9411242	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	RICH WISE	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE		
	TONAWANDA, NY		

Spill Class: No spill occurred. No DEC Response. No corrective action required.

NRG019718

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

FMC CORPORATION (Continued)

S101341681

Spill Closed Dt: 11/22/1994
 Spill Cause: Other
 Water Affected: Not reported
 Spill Notifier: Responsible Party
 Spill Date: 11/22/1994 14:18
 Cleanup Ceased: 11/22/1994
 Last Inspection: Not reported
 Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 12/23/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 11/23/1994
 Remark: RECEIVED RESULTS FROM EVALUATION OF OLD WASTE SITE. PCB'S FOUND

Resource Affected: On Land
 Spill Source: Other Commercial/Industrial
 PBS Number: Not reported
 Reported to Dept: 11/22/1994 14:18

NRG019719

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S101341681

SPILLS:

Facility ID:	9604034	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	UST
Caller Name:	RICH WISE	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/15/1996		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	06/24/1996 16:00	Reported to Dept:	06/24/1996 16:15
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/17/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	06/24/1996		
Remark:	IN ORDER TO DO MAINTENANCE ON A TANK, 20 GALLONS OF HYDROGEN PEROXIDE WILL BE DILUTED AND DRUMMED TO THE TANK DIKE.		

NRG019720

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S101341681

Facility ID:	9611053	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	RICHARD WISE	Caller Agency:	FMC CORP
Caller Phone:	(716) 879-0427	Caller Extension:	240
Notifier Name:	GERRY WEISS	Notifier Agency:	ENVIORNMENTAL TECH
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	RICHARD WISE	Spiller Phone:	(716) 879-0427
Spiller:	FMC CORP		
Address:	35 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/10/1996		
Spill Cause:	Equipment Failure	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	12/07/1996 10:00	Reported to Dept:	12/07/1996 10:25
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/16/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	12/07/1996		
Remark:	caller was advised that the company went 24 lbs over the limit spdes permit - still investigating - problem has stopped they dont know what caused it		

NRG019721

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S101341681

Facility ID:	9514956	Region of Spill:	9
Facility Contact:	PAT KELLEY	Facility Tele:	(716) 879-0400 Ext. 240
Investigator:	RMC	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC CORP.
Caller Phone:	(716) 879-0400	Caller Extension:	Not reported
Notifier Name:	PAT KELLEY	Notifier Agency:	ENVIRONMENTAL STEWART
Notifier Phone:	(716) 879-0400	Notifier Extension:	240
Spiller Contact:	PAT KELLEY	Spiller Phone:	(716) 879-0400 Ext. 240
Spiller:	FMC CORPORATION		
Address:	35 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	02/26/1996		
Spill Cause:	Human Error	Resource Affected:	In Sewer
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	02/21/1996 18:00	Reported to Dept:	02/21/1996 20:48
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/28/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	02/21/1996		
Remark:	PRODUCT WAS BEING UNLOADED INTO A STORAGE TANK. SOMEONE APPEARS LEFT OPEN A VALVE. SOME OF THE PRODUCT WAS SPILLED IN THE NIAGRA RIVER. SPEEDY DRY USED TO CLEAN UP SAME. PAT KELLY CAN BE CALLED UNTIL 6AM. MR WEIS CAN BE CALLED IN AM IF NEEDED 716-879-0405.		

O90
SSE
> 1
Higher

**FMC CORPORATION
39 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102177810
N/A**

NRG019722

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S102177810

SPILLS:

Facility ID:	9301378	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	BRUCE WARNER	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC CORPORATION		
Address:	39 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/29/1993	Resource Affected:	In Sewer
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/29/1993 10:05
Spill Date:	04/29/1993 08:15		
Cleanup Ceased:	04/29/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/19/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/04/1993		
Remark:	VALVE LEFT OPEN; WAS DISCOVERED AND CLOSED.		

O91
SSE
> 1
Higher

FMC CORP-BUFFALO PLANT
37 SAWYER AVE
TONAWANDA, NY 14150

TSCA
LUST
NY Spills

1000995530
N/A

LUST:

Facility ID:	9506125	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	UST
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 878-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	RICHARD WISE	Spiller Phone:	(716) 878-8300
Spiller:	FMC		
Address:	37 SAWYER AVENUE TONAWANDA		
Spill Class:	Known release that creates a file or hazard. DEC Response. Unknown Responsible Party. Corrective action taken. (ISR)		
Spill Closed Dt:	02/21/1996	Resource Affected:	On Land
Spill Cause:	Other	Spill Source:	Other Commercial/Industrial
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	08/18/1995 03:40
Spill Date:	08/18/1995 03:00		
Cleanup Ceased:	02/21/1996		
Last Inspection:	09/25/1995		

NRG019723

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Cleanup Meets Standard: True
 Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 06/21/1996
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 08/20/1995
 Remark: CHEMICAL WAREHOUSE HAD AN EXPLOSION WITH FIRE

Facility ID:	9013072	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC		
Address:	37 SAWYER ROAD TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	03/25/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Other	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	03/23/1991 03:34
Spill Notifier:	Responsible Party		
Spill Date:	03/22/1991 23:00		
Cleanup Ceased:	03/25/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/16/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/26/1991		
Remark:	DRUMS FILLED WITH AMMONIA SULFATE DECOMPOSED AND LEAKED - STARTED FIRE. WATER ON THE FIRE CREATED SULFURIC ACID. RAN TO SPDES OUTFALL.		

NRG019724

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

SPILLS:

Facility ID:	9608272	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	BRUCE WARNER	Caller Agency:	FMC
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	BRUCE WARNER	Spiller Phone:	(716) 876-8300
Spiller:	FMC		
Address:	37 SAWYER AVENUE TOAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/04/1996		
Spill Cause:	Equipment Failure	Resource Affected:	In Sewer
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/03/1996 02:50	Reported to Dept:	10/03/1996 04:56
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/09/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/03/1996		
Remark:	ph electrodes in sewer system indicated an elevated ph investigation is underway		

NRG019725

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9004065	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC		
Address	37 SAWYER AVENUE TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	07/12/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	07/12/1990 12:43
Spill Notifier:	Responsible Party		
Spill Date:	07/12/1990 10:15		
Cleanup Ceased:	07/12/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/04/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	07/13/1990		
Remark:	PUNCTURED DRUMED FLUSHED TO SEWERS TO OUTFALL		

NRG019726

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9113036	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	FMC		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported		
Spill Closed Dt:	03/27/1992	Resource Affected:	Surface Water
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	03/25/1992 11:35
Spill Date:	03/25/1992 10:00		
Cleanup Ceased:	03/27/1992		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/31/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/27/1992		
Remark:	SPDES OUTFALL 001, TANK OVERFILLED, RECOVERY NOT POSSIBLE, REFERRED TO SPDES DOW 3/25/92.		

NRG019727

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9304315	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	MARIA HANBY	Caller Agency:	NYSDEC
Caller Phone:	(518) 279-3753	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC CORPORATION		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/08/1993	Resource Affected:	Surface Water
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	NIAGARA RIVER	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	07/06/1993 21:47
Spill Date:	07/06/1993 17:30		
Cleanup Ceased:	07/08/1993		
Last Inspection:	07/07/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/16/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/12/1993		
Remark:	A LEAKING VALVE CAUSED THE SPILL		

NRG019728

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9402345	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC		
Address	PO BOX 845 BUFFALO, NY 14240		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/17/1994		
Spill Cause:	Human Error	Resource Affected:	In Sewer
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	05/17/1994 12:15	Reported to Dept:	05/17/1994 13:39
Cleanup Ceased:	05/17/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/27/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/18/1994		
Remark:	VALVE LEFT OPEN ON SYSTEM MATERIAL DRAINED TO FLOOR DRAIN		

NRG019729

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP-BUFFALO PLANT (Continued)

1000995530

Facility ID:	9504238	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	BRUCE WARNER	Caller Agency:	FMC
Caller Phone:	(716) 876-8300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-8300
Spiller:	FMC CORPORATION		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/10/1995		
Spill Cause:	Unknown	Resource Affected:	Surface Water
Water Affected:	NIAGARA RIVER	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/08/1995 11:00	Reported to Dept:	07/08/1995 22:23
Cleanup Ceased:	07/10/1995		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/25/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/10/1995		
Remark:	AMMONIA LEAK FROM FMC, CAUSE UNKNOWN		

092
SSE
> 1
Higher

**FMC CORPORATION
37 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102176626
N/A**

NRG019730

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORPORATION (Continued)

S102176626

SPILLS:

Facility ID:	8900301	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	LQR	Spill Type:	Facility
Caller Name:	RICHARD WISE	Caller Agency:	FMC CORPORATION
Caller Phone:	(716) 879-0405	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 879-0405
Spiller:	FMC CORPORATION		
Address:	37 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Surface Water
Spill Closed Dt:	04/11/1989	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	NIAGARA RIVER	Reported to Dept:	04/11/1989 09:50
Spill Notifier:	Responsible Party		
Spill Date:	04/11/1989 07:45		
Cleanup Ceased:	04/11/1989		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/11/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/11/1989		
Remark:	OUTFALL 001 DISCHARGE		

O93
SSE
> 1
Higher

FMC CORP
34 SAWYER AVE.
TONAWANDA, NY 14150

FINDS 1000108779
RCRIS-LQG NYD074033101
TRIS
CORRACTS
CERC-NFRAP
SHWS

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	Not reported		

CERCLIS-NFRAP Assessment History:

Assessment:	DISCOVERY	Completed:	06/01/81
Assessment:	PRELIMINARY ASSESSMENT	Completed:	09/22/87

CORRACTS Data:

Prioritization: Low
Status: RCRA Facility Assessment Completed, Determination of Need for a RCRA Facility Investigation, Referred to a Non-RCRA Authority

NRG019731

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP (Continued)

1000108779

RCRIS:

Owner: FMC CORPORATION
(312) 861-6000

Contact: RICHARD R WISE
(716) 876-8300

Record Date: 03/29/84

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	24369.00	D002	3227210.00
D007	45913.00	D008	9157.00
D009	45453.00	D010	45453.00
D018	1922.00	D039	1922.00
LABP	2880.00		

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility has an active water discharge permit (under PCS)
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

NRG019732

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

FMC CORP (Continued)

1000108779

SHWS:

Facility ID: 915025 EPA ID: NYD074033101
Owner: FMC Corp.-Peroxygen Chemicals Div.
34 Sawyer Ave.
Tonawanda, NY 14150

Owner Telephone: Not reported
Operator: FMC Corporation
34 Sawyer Avenue
Tonawanda, NY 14150

Contact: Not reported Telephone: Not reported
Site Classification: Temporary classification assigned to sites that have inadequate and/or
insufficient data for inclusion in any of the other classifications.

Region: 9
Site Type: Dump

Acres: 1 User: FMC Corporation
HW Started: 1964 HW Ended: 1976
HW Disposed: Persulfates, perborates, sodium carbonate, ammonia compounds, hydrogen
peroxide,, calcium peroxide, magnesium urea,, pyrophosphate

Units: 100 tons total

Air Data: Unavailable Surf. Water Data: Unavailable
Gmd. Water Data: Unavailable Soil Data: Available
Sediment Data: Unavailable

Ground Water Standards Contravention: No
Drinking Water Standards Contravention: No
Surface Water Standards Contravention: No
Air Standards Contravention: No
Enforcement Status: Order Has Been Signed Legal Action: No
State Action: No Fed Action: No

Remedial Action: None

Remed action type: none

Soil Type: Silty clay

Gmd Water Depth: unknown

Assessment of Environmental Problems:

Waste disposal pits have been properly closed. There is potential for
contaminant migration from the site.

Assessment of Health Problems:

The site is located in a commercial/industrial/residential area
of Tonawanda. A housing development borders the facility on the north. The
disposal area is completely surrounded by a fence and access to the site
is controlled at all times. Analytical data generated during
the Preliminary Site Assessment did not detect the presence of any of
the wastes that were known to be disposed on-site. However, PCBs up
to 16,000 ppm were found in on-site soils. The site is covered and
graded and indistinguishable from the surrounding terrain. Exposure
from direct contact or airborne particulates is highly unlikely.
Groundwater is not used for drinking water in the vicinity of the site.
The Niagara River is located 400 meters to the west and is a major source
of drinking water in the area. Additional investigation is needed
to determine the extent of contamination.

P94
SSE
> 1
Higher

GOETZ ENERGY
85 SAWYER AVE
TONAWANDA, NY

NY Spills

S102174353
N/A

NRG019733

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY (Continued)

S102174353

SPILLS:

Facility ID:	9110841	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	LEE MCELHINNEY	Caller Agency:	TONAWANDA DISPATCH
Caller Phone:	(716) 876-1212	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-4324
Spiller:	GOETZ ENERGY		
Address:	PO BOX A BUFFALO, NY 14217		
Spill Class:	Known release that creates a file or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/02/1993		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Tank Truck
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	01/18/1992 01:10	Reported to Dept:	01/18/1992 03:50
Cleanup Ceased:	09/02/1993		
Last Inspection:	08/18/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/16/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/12/1992		
Remark:	TANKER TRUCK USED FOR STORAGE TIPPED OVER		

P95
SSE
> 1
Higher

NIAGARA MOHAWK
87 SAWYER AVE
TONAWANDA, NY

NY Spills

S102173992
N/A

NRG019734

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

NIAGARA MOHAWK (Continued)

S102173992

SPILLS:

Facility ID:	9101906	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	JIM DONNAGAN	Caller Agency:	NIAGARA MOHAWK
Caller Phone:	(315) 428-3172	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(315) 428-3172
Spiller:	NIAGARA MOHAWK		
Address:	300 ERIE BOULEVARD WEST SYRACUSE, NY 13202		
Spill Class:	Not reported		
Spill Closed Dt:	06/04/1991	Resource Affected:	On Land
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	05/16/1991 23:03
Spill Date:	05/16/1991 15:40		
Cleanup Ceased:	06/04/1991		
Last Inspection:	05/17/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/04/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	05/17/1991		
Remark:	TRUCK BACKED OVER CABLE CAUSING POLE AND TRANSFORMER TO FALL		

P96
SSE
> 1
Higher

**GOETZ ENERGY CORP
87 SAWYER AVE
TONAWANDA, NY 14050**

RCRIS-SQG 1000872511
NYD987037256

RCRIS:

Owner: GOETZ ENERGY CORP
(716) 876-4324

Contact: ROGER SCHINTZIUS
(716) 876-4324

Record Date: 07/06/93

Classification: Small Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	50234.36	D008	50234.36
F002	50234.36		

NRG019735

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GOETZ ENERGY CORP (Continued)

1000872511

Used Oil Recyc: No

Violation Status: No violations found

**P97
SSE
> 1
Higher**

**GOETZ ENERGY CORP
87 SAWYER AVE
TONAWANDA, NY 14050**

**FINDS
LUST**

**1000845347
NYD987037256**

LUST:

Facility ID:	9103953	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	JOHN KUDLA	Caller Agency:	ELMWOOD TANK & PIPING
Caller Phone:	(716) 694-0106	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-4324
Spiller:	GOETZ ENERGY		
Address:	PO BOX A 87 SAWYER AVENUE BUFFALO, NY 14217		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/07/1993	Resource Affected:	Groundwater
Spill Cause:	Tank Test Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Tank Tester	Reported to Dept:	07/12/1991 15:20
Spill Date:	07/16/1991 12:30		
Cleanup Ceased:	09/07/1993		
Last Inspection:	07/18/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	True		
Spill Record Last Update:	09/16/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/16/1991		
Remark:	FAILED TANK AT GOETZ ENERGY		

**P98
SSE
> 1
Higher**

**BROSKIN ENTERPRISES, INC.
87 SAWYER AVE
TONAWANDA, NY**

NY Spills

**S102175701
N/A**

NRG019736

MAP FINDINGS

Map ID Direction Distance Elevation	Site	Database(s)	EDR ID Number EPA ID Number
--	------	-------------	--------------------------------

BROSKIN ENTERPRISES, INC. (Continued)

S102175701

SPILLS:

Facility ID: 8702321 Facility Contact: Not reported Investigator: JDC Caller Name: Not reported Caller Phone: Not reported Notifier Name: Not reported Notifier Phone: Not reported Spiller Contact: Not reported Spiller: BROSKIN ENTERPRISES, INC. Address: 5335 RIVER ROAD TONAWANDA, NY 14150 Spill Class: Not reported Spill Closed Dt: 08/05/1987 Spill Cause: Housekeeping Water Affected: NIAGARA RIVER Spill Notifier: Affected Persons Spill Date: 06/22/1987 10:30 Cleanup Ceased: 08/05/1987 Last Inspection: 06/22/1987 Cleanup Meets Standard: True Recommended Penalty: No Penalty Spiller Cleanup Date: Not reported Enforcement Date: Not reported Investigation Complete: Not reported UST Involvement: False Spill Record Last Update: 08/07/1987 Corrective Action Plan Submitted: Not reported Date Spill Entered In Computer Data File: 06/22/1987 Remark: BLACK OIL SPILLING TO NIAGARA RIVER FROM SEEP IN EMBANKMENT	Region of Spill: 9 Facility Tele: Not reported Spill Type: Facility Caller Agency: Not reported Caller Extension: Not reported Notifier Agency: Not reported Notifier Extension: Not reported Spiller Phone: (716) 879-0405 Resource Affected: Surface Water Spill Source: Other Commercial/Industrial PBS Number: Not reported Reported to Dept: 06/22/1987 12:05
--	---

P99
SSE
> 1
Higher

CENTRAL FOUNDRY
91 SAWYER AVE
TONAWANDA, NY 14150

FINDS

1000551623
NYD986939734

FINDS:

Other Pertinent Environmental Activity Identified at Site:
 - Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

Q100
SE
> 1
Higher

KURK FUEL OIL CO
130 SAWYER AVE
TONAWANDA, NY 14150

RCRIS-SQG
FINDS

1000266482
NYD980755193

NRG019737

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

KURK FUEL OIL CO (Continued)

1000266482

RCRIS:

Owner: KURK FUEL OIL COMPANY
(212) 555-1212

Contact: GREG KURK
(716) 892-0359

Record Date: 04/19/83

Classification: Not reported

Used Oil Recyc: No

Violation Status: No violations found

Q101
SE
> 1
Higher

130 SAWYER AVE
TONAWANDA, NY

NY Spills

S102178909
N/A

SPILLS:

Facility ID: 8501822

Facility Contact: Not reported

Investigator: BRT

Caller Name: Not reported

Caller Phone: Not reported

Notifier Name: Not reported

Notifier Phone: Not reported

Spiller Contact: Not reported

Spiller: KNOWN, SEE FILE

Address: Not reported

Spill Class: Not reported

Spill Closed Dt: 10/30/1985

Spill Cause: Unknown

Water Affected: Not reported

Spill Notifier: Other

Spill Date: 08/28/1985

Cleanup Ceased: 10/30/1985

Last Inspection: Not reported

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 05/09/1996

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: Not reported

Remark: Not reported

Region of Spill: 9

Facility Tele: Not reported

Spill Type: UST

Caller Agency: Not reported

Caller Extension: Not reported

Notifier Agency: Not reported

Notifier Extension: Not reported

Spiller Phone: Not reported

Resource Affected: Surface Water

Spill Source: Unknown

PBS Number: Not reported

Reported to Dept: Not reported

Q102
SE
> 1
Higher

LAUGHLIN
130 SAWYER AVE
TONAWANDA, NY

NY Spills

S102177076
N/A

NRG019738

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

LAUGHLIN (Continued)

S102177076

SPILLS:

Facility ID:	8910457	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	PAUL CASTRICONE	Caller Agency:	ANONYMOUS
Caller Phone:	(716) 894-5787	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 874-0214
Spiller:	DENNIS LAUGHLIN		
Address:	130 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	04/16/1990	Resource Affected:	In Sewer
Spill Cause:	Deliberate	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	02/01/1990 14:25
Spill Date:	01/01/1990 12:00		
Cleanup Ceased:	04/16/1990		
Last Inspection:	03/07/1990		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/08/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/02/1990		
Remark:	SLOPPY HOUSEKEEP ALLOWING OIL TO SPILL TO GROUND AND CONTAMINATE SEWER(STORM)		

R103
WNW
> 1
Higher

**BUFFALO INDUSTRIAL PARK
1800 BROADWAY
BUFFALO, NY 14240**

RCRIS-LQG 1000227742
NYD080321854

RCRIS:

Owner: BOSBERG
(212) 555-1212

Contact: DAVID DILL
(716) 884-7000

Record Date: 08/30/89

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

R104
WNW
> 1
Higher

**CONRAIL FRONTIER CAR SHOP
1800 BROADWAY
BUFFALO, NY 14214**

FINDS 1000353065
RCRIS-LQG NYD000810952

NRG019739

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

CONRAIL FRONTIER CAR SHOP (Continued)

1000353065

RCRIS:

Owner: CONSOLIDATED RAIL CORP
(212) 555-1212

Contact: J D
(716) 892-0281

Record Date: 08/18/80

Classification: Large Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

105
NW
> 1
Higher

ACID ON DRIVEWAY
10 WEST PARK COURT
GRAND ISLAND, NY

NY Spills

S102135120
N/A

NRG019740

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ACID ON DRIVEWAY (Continued)

S102135120

SPILLS:

Facility ID:	9507214	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MNP	Spill Type:	Facility
Caller Name:	JOHN WIERTEL	Caller Agency:	KAEGEBEIN SCHOOL
Caller Phone:	(716) 773-8840	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN STUDENTS		
Address:	Not reported		
	Not reported		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/14/1995		
Spill Cause:	Deliberate	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Private Dwelling
Spill Notifier:	Citizen	PBS Number:	Not reported
Spill Date:	09/13/1995 08:00	Reported to Dept:	09/13/1995 10:45
Cleanup Ceased:	09/14/1995		
Last Inspection:	09/13/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/21/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/13/1995		
Remark:	CALLER STATES STUDENTS SPILLED THE HCL ACID & ALGECIDE ON DRIVEWAY OF PRIVATE RESIDENCE		

S106
East
> 1
Higher

**BESTWAY TRUCKING
500 GRAND ISLAND BLVD
TONAWANDA, NY**

NY Spills

**S102179450
N/A**

NRG019741

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

BESTWAY TRUCKING (Continued)

S102179450

SPILLS:

Facility ID:	9502113	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	RAY JONAC	Caller Agency:	DOT
Caller Phone:	(716) 683-5264	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	11/01/1995	Resource Affected:	In Sewer
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Local Agency	Reported to Dept:	05/19/1995 09:00
Spill Date:	05/01/1995 12:00		
Cleanup Ceased:	11/01/1995		
Last Inspection:	05/23/1995		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/12/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/19/1995		
Remark:	DOT WAS EXCAVATING TO REPLACE CULVERS AND FOUND DIESEL FUEL IN STORM DITCH AT BESTWAY TRANSPORT.		

S107
East
> 1
Higher

LOGISTIC PARTNERS
500 GRAND ISLAND BLVD
TONAWANDA, NY

NY Spills S102178429
N/A

NRG019742

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

LOGISTIC PARTNERS (Continued)

S102178429

SPILLS:

Facility ID:	9314899	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	SANDY JOHNSON	Caller Agency:	KELLEHER ENVIRONMENTAL
Caller Phone:	(800) 553-2648	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	LOGISTIC PARTNERS		
Address:	500 GRAND ISLAND BLVD. TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	05/02/1994		
Spill Cause:	Equipment Failure	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Other	PBS Number:	Not reported
Spill Date:	03/16/1994 10:20	Reported to Dept:	03/16/1994 12:01
Cleanup Ceased:	05/02/1994		
Last Inspection:	03/22/1994		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/19/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/22/1994		
Remark:	CROSSOVER LINE LEAKING IN PARKING LOT.		

T108
SE
> 1
Higher

WESTERN NY DRUM CO.
225 SAWYER AVE
TONAWANDA, NY

NY Spills

S102175251
N/A

NRG019743

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

WESTERN NY DRUM CO. (Continued)

S102175251

SPILLS:

Facility ID:	8602683	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	WESTERN NY DRUM CO.		
Address:	225 SAWYER AVE. TOANAWANDA		
Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	07/22/1986	Spill Source:	Other Commercial/Industrial
Spill Cause:	Deliberate	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	07/22/1986 12:00
Spill Notifier:	Citizen		
Spill Date:	07/07/1986 12:00		
Cleanup Ceased:	07/22/1986		
Last Inspection:	07/22/1986		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	02/15/1995		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/25/1986		
Remark:	ALLEGED DUMPING OF DRUMS		

**T109
SE
> 1
Higher**

**WESTERN NEW YORK BARREL & DRUM
225 SAWYER AVE
TONAWANDA, NY 14150**

**FINDS 1000402181
RCRIS-LQG NYD013294947**

RCRIS:

Owner: CORPORATION
(212) 555-1212

Contact: JOHN P HENDERSON
(716) 873-4440

Record Date: 08/18/80

Classification: Large Quantity Generator, Hazardous Waste Transporter

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:
- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)

**U110
SSW
> 1
Higher**

**R W WEAVER CORP DBA ANCHOR MARINE
1501 FERRY RD
GRAND ISLAND, NY 14072**

**RCRIS-SQG 1000693604
FINDS NYD986996650**

NRG019744

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

R W WEAVER CORP DBA ANCHOR MARINE (Continued)

1000693604

RCRIS:

Owner: ROBERT W WEAVER
(212) 555-1212

Contact: ROBERT WEAVER
(716) 773-7063

Record Date: 03/26/92

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

U111
SSW
> 1
Higher

ANCHOR MARINE
1501 FERRY ROAD
GRAND ISLAND, NY

NY Spills

S100666740
N/A

SPILLS:

Facility ID:	9104017	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	LT. JAMES CUMMING	Caller Agency:	USCG-MSO
Caller Phone:	(716) 846-4168	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	07/15/1991	Resource Affected:	Surface Water
Spill Cause:	Unknown	Spill Source:	Unknown
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Federal Government	Reported to Dept:	07/15/1991 08:20
Spill Date:	07/12/1991 18:00		
Cleanup Ceased:	07/15/1991		
Last Inspection:	07/13/1991		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/23/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/15/1991		
Remark:	SHEEN REPORTED IN NIAGARA RIVER AT ANCHOR MARINE		

U112
SSW
> 1
Higher

VILLAGE INN
1510 FERRY STREET
GRAND ISLAND, NY

NY Spills

S102132121
N/A

NRG019745

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

VILLAGE INN (Continued)

S102132121

SPILLS:

Facility ID:	9101133	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	BERNIE PINKANS	Caller Agency:	DEC-A DUTY OFFICER
Caller Phone:	(800) 457-7362	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	Not reported		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	04/30/1991	Resource Affected:	Air
Spill Cause:	Deliberate	Spill Source:	Vessel
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Citizen	Reported to Dept:	04/27/1991 17:55
Spill Date:	04/27/1991 17:50		
Cleanup Ceased:	04/30/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/01/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	05/01/1991		
Remark:	CALLER ADVISED THAT THE BAS WAS BURNING A BOAT AS PART OF A PARTY AT THE INN - THOUGHT IT SHOULD BE STOPPED.		

U113
SSW
> 1
Higher

ANCHOR MARINE
1509 FERRY STREET
GRAND ISLAND, NY

NY Spills

S102132324
N/A

NRG019746

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

ANCHOR MARINE (Continued)

S102132324

SPILLS:

Facility ID:	91 10734	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	TANYA ALEXANDER	Caller Agency:	NFG
Caller Phone:	(716) 857-7410	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	ANCHOR MARINE		
Address:	Not reported		
	GRAND ISLAND, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/16/1993		
Spill Cause:	Unknown	Resource Affected:	Groundwater
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Other	PBS Number:	Not reported
Spill Date:	01/15/1992 08:30	Reported to Dept:	01/15/1992 08:47
Cleanup Ceased:	12/16/1993		
Last Inspection:	01/15/1992		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/21/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	01/31/1992		
Remark:	NFG CREW FOUND STRONG PETROLEUM ODOR AND OIL PRODUCT IN EXCAVATION WHILE REPAIRING GAS LINE. SOIL TO BE STOCKPILED.		

V114
East
> 1
Higher

LYONS TRAN LINES INC
410 GRAND ISLAND BLVD
BUFFALO, NY 14150

RCRIS-SQG 1000833515
FINDS NYD987026390

RCRIS:

Owner: LYONS TRANS LINES INC
(814) 456-8551

Contact: THOMAS STOUT
(814) 456-8551

Record Date: 01/21/93

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

V115
East
> 1
Higher

GRIFFITH OIL
410 GRAND ISLAND BLVD
TONAWANDA, NY

NY Spills S102177990
N/A

NRG019747

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GRIFFITH OIL (Continued)

S102177990

SPILLS:

Facility ID:	9304906	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	ROB COEN	Caller Agency:	GRIFFITH OIL
Caller Phone:	(716) 372-2171	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	GRIFFITH OIL		
Address:	Not reported		
	ROCHESTER, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	07/23/1993		
Spill Cause:	Human Error	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Tank Truck
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	07/20/1993 08:15	Reported to Dept:	07/20/1993 08:27
Cleanup Ceased:	07/23/1993		
Last Inspection:	07/20/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/09/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/20/1993		
Remark:	TANK OVERFILL; OIL SPILLED ONTO BLACKTOP.		

116
ESE
>1
Higher

A B F FREIGHT SYSTEMS INC
50 FLYDER AVE
TONAWANDA, NY 14150

RCRIS-SQG 1000114538
FINDS NYD030203343

RCRIS:

Owner: A B F FREIGHT SYSTEM INC
(501) 785-6221

Contact: MIKE NEAL
(501) 785-6221

Record Date: 05/08/87

Classification: Small Quantity Generator

Used Oil Recyc: No

Violation Status: No violations found

117
WNW
>1
Higher

MESMER DAIRY
1815 LOVE ROAD
GRAND ISLAND, NY

NY Spills S102134120
N/A

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MESMER DAIRY (Continued)

S102134120

SPILLS:

Facility ID:	9301308	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DOUG LEHMAN	Caller Agency:	TOWN OF GRAND ISLAND
Caller Phone:	(716) 773-9646	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	MESMER DAIRY		
Address	1815 LOVE ROAD GRAND ISLAND, NY		
Spill Class:	Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/30/1993	Resource Affected:	On Land
Spill Cause:	Abandoned Drums	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Local Agency	Reported to Dept:	04/26/1993 15:05
Spill Date:	04/01/1993 12:00		
Cleanup Ceased:	04/30/1993		
Last Inspection:	04/30/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/14/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/28/1993		
Remark:	ABANDONED DRUMS ON-SITE. DAIRY IS ABANDONED.		

NRG019749

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

Underground Storage Tank Database (UST)

Source: Suffolk County Department of Health Services
Telephone: 516-854-2521

Date of Government Version: 02/21/97
Database Release Frequency: Annually

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

Historical and Other Database(s)

Depending on the geographic area covered by this report, the data provided in these specialty databases may or may not be complete. For example, the existence of wetlands information data in a specific report does not mean that all wetlands in the area covered by the report are included. Moreover, the absence of any reported wetlands information does not necessarily mean that wetlands do not exist in the area covered by the report.

Former Manufactured Gas (Coal Gas) Sites: The existence and location of Coal Gas sites is provided exclusively to EDR by Real Property Scan, Inc. ©Copyright 1993 Real Property Scan, Inc. For a technical description of the types of hazards which may be found at such sites, contact your EDR customer service representative.

Disclaimer Provided by Real Property Scan, Inc.

The information contained in this report has predominantly been obtained from publicly available sources produced by entities other than Real Property Scan. While reasonable steps have been taken to insure the accuracy of this report, Real Property Scan does not guarantee the accuracy of this report. Any liability on the part of Real Property Scan is strictly limited to a refund of the amount paid. No claim is made for the actual existence of toxins at any site. This report does not constitute a legal opinion.

DELISTED NPL: Delisted NPL Sites

Source: EPA
Telephone: 703-603-8769

DELISTED NPL: The National Oil and Hazardous Substances Pollution Contingency Plan (NCP) establishes the criteria that the EPA uses to delete sites from the NPL. In accordance with 40 CFR 300.425.(e), sites may be deleted from the NPL where no further response is appropriate.

NFRAP: No Further Remedial Action Planned

Source: EPA/NTIS
Telephone: 703-413-0223

NFRAP: As of February 1995, CERCLIS sites designated "No Further Remedial Action Planned" (NFRAP) have been removed from CERCLIS. NFRAP sites may be sites where, following an initial investigation, no contamination was found, contamination was removed quickly without the need for the site to be placed on the NPL, or the contamination was not serious enough to require Federal Superfund action or NPL consideration. EPA has removed approximately 25,000 NFRAP sites to lift the unintended barriers to the redevelopment of these properties and has archived them as historical records so EPA does not needlessly repeat the investigations in the future. This policy change is part of the EPA's Brownfields Redevelopment Program to help cities, states, private investors and affected citizens to promote economic redevelopment of unproductive urban sites.

FRDS: Federal Reporting Data System

Source: EPA/Office of Drinking Water
Telephone: 202-260-2805

FRDS provides information regarding public water supplies and their compliance with monitoring requirements, maximum contaminant levels (MCL's), and other requirements of the Safe Drinking Water Act of 1986.

Area Radon Information: The National Radon Database has been developed by the U.S. Environmental Protection Agency (USEPA) and is a compilation of the EPA/State Residential Radon Survey and the National Residential Radon Survey. The study covers the years 1986 - 1992. Where necessary data has been supplemented by information collected at private sources such as universities and research institutions.

NRG019750

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

Oil/Gas Pipelines/Electrical Transmission Lines: This data was obtained by EDR from the USGS in 1994. It is referred to by USGS as GeoData Digital Line Graphs from 1:100,000-Scale Maps. It was extracted from the transportation category including some oil, but primarily gas pipelines and electrical transmission lines.

Sensitive Receptors: There are individuals deemed sensitive receptors due to their fragile immune systems and special sensitivity to environmental discharges. These sensitive receptors typically include the elderly, the sick, and children. While the location of all sensitive receptors cannot be determined, EDR indicates those buildings and facilities - schools, daycares, hospitals, medical centers, and nursing homes - where individuals who are sensitive receptors are likely to be located.

USGS Water Wells: In November 1971 the United States Geological Survey (USGS) implemented a national water resource information tracking system. This database contains descriptive information on sites where the USGS collects or has collected data on surface water and/or groundwater. The groundwater data includes information on more than 900,000 wells, springs, and other sources of groundwater.

Flood Zone Data: This data, available in select counties across the country, was obtained by EDR in 1994 from the Federal Emergency Management Agency (FEMA). Data depicts 100-year and 500-year flood zones as defined by FEMA.

Epicenters: World earthquake epicenters, Richter 5 or greater

Source: Department of Commerce, National Oceanic and Atmospheric Administration

Water Dams: National Inventory of Dams

Source: Federal Emergency Management Agency

Telephone: 202-646-2801

WATER DAMS: National computer database of more than 74,000 dams maintained by the Federal Emergency Management Agency.

New York Public Water Wells

Source: New York Department of Health

Telephone: 518-458-6731

NRG019751

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

MESMER DAIRY (Continued)

S102134120

Facility ID:	9306633	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	KEVIN GLASER	Caller Agency:	NYSDEC
Caller Phone:	(716) 851-7220	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	MESMER DAIRY		
Address:	1815 LOVE ROAD GRAND ISLAND, NY 14072		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	08/15/1994		
Spill Cause:	Housekeeping	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Local Agency	PBS Number:	Not reported
Spill Date:	08/01/1993 12:00	Reported to Dept:	08/30/1993 12:00
Cleanup Ceased:	08/15/1994		
Last Inspection:	12/17/1993		
Cleanup Meets Standard:	True		
Recommended Penalty:	Recommended Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	09/27/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	08/31/1993		
Remark:	ABANDONED DRUMS ON-SITE, FACILITY IS ABANDONED, COMPANY IS BANKRUPT		

W118
SE
> 1
Higher

3M COMPANY
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S101175086
N/A

LUST:

Facility ID:	9407824	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	BOB SIGEL	Caller Agency:	3M COMPANY
Caller Phone:	(612) 778-6130	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 871-6281
Spiller:	3M COMPANY		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	09/12/1994		
Spill Cause:	Other	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	09/12/1994 15:30	Reported to Dept:	09/12/1994 16:52
Cleanup Ceased:	09/12/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		

NRG019752

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M COMPANY (Continued)

S101175086

Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 09/15/1994
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 09/13/1994
 Remark: FIRE IN CARBON BED RELEASED FUMES TO AIR

SPILLS:

Facility ID:	9310137	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	JDC	Spill Type:	Facility
Caller Name:	DAVID SCHUTT	Caller Agency:	3M COMPANY
Caller Phone:	(612) 778-5563	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M COMPANY		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	06/10/1994	Resource Affected:	On Land
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	11/19/1993 16:09
Spill Date:	11/19/1993 14:00		
Cleanup Ceased:	11/19/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	08/08/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/23/1993		
Remark:	LINE HOSE FAILED. SPILL ON CONCRETE PAD.		

W119
SE
> 1
Higher

3M TONAWANDA
305 SAWYER AVENUE
TONAWANDA, NY 14150

UST
LUST
NY Spills
AST

U003080603
N/A

LUST:

Facility ID:	9507270	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	KAH	Spill Type:	Facility
Caller Name:	GREG STUBBS	Caller Agency:	3M
Caller Phone:	(716) 876-1597	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1597

NRG019753

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

3M TONAWANDA (Continued)

U003080603

Spiller: 3M
 Address: 305 SAWYER AVENUE
 TONAWANDA, NY

Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
 Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 09/14/1995

Spill Cause: Other

Water Affected: Not reported

Spill Notifier: Responsible Party

Spill Date: 09/13/1995 12:00

Cleanup Ceased: 09/14/1995

Last Inspection: Not reported

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 09/21/1995

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 09/14/1995

Remark: PRODUCT IN NEW TANK THAT WAS BEING INSTALLED STARTED ON FIRE CAUSING AN
 AIR RELEASE OF BETWEEN 1/2 AND 14 LBS. OF SULFUR DIOXIDE.

Resource Affected: Air
 Spill Source: Major Facility 400,000 gallons
 PBS Number: Not reported
 Reported to Dept: 09/13/1995 17:15

NRG019754

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

SPILLS:

Facility ID:	9701177	Region of Spill:	9
Facility Contact:	GREGG STUBBS	Facility Tele:	(716) 871-6281
Investigator:	MJS	Spill Type:	UST
Caller Name:	GREG STUBBS	Caller Agency:	3M
Caller Phone:	(716) 871-6281	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREGG STUDDS	Spiller Phone:	(716) 871-6281
Spiller:	3M COMPANY		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/28/1997		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/26/1997 09:30	Reported to Dept:	04/26/1997 11:23
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/29/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	04/26/1997		
Remark:	RELEASE INTO AIR - OCCURED OVER A 24 HR PERIOD - STARTING AT 0900 4/25/97 ENDING THIS DATE - UNK WHAT CAUSED THE RELEASE - STILL CHECKING INTO IT - COULD BE JUST AN INSTRUMENT ERROR		

NRG019755

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9701182	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	MJS	Spill Type:	UST
Caller Name:	MARGRET CHONG	Caller Agency:	EPA
Caller Phone:	(908) 548-8730	Caller Extension:	Not reported
Notifier Name:	GREG STUBBS	Notifier Agency:	3M
Notifier Phone:	(716) 871-6281	Notifier Extension:	Not reported
Spiller Contact:	GREG STUBBS	Spiller Phone:	(716) 871-6281
Spiller:	3M		
Address	305 SAWYER AVENUE TONAWANDA, NY 14105		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/28/1997		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Federal Government	PBS Number:	Not reported
Spill Date:	04/26/1997 06:30	Reported to Dept:	04/26/1997 12:48
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/29/1997		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/26/1997		
Remark:	UNK CAUSE OF RELEASE - OPERATIONS BACK TO NORMAL NOW THEY WILL INVESTIGATE ON MONDAY		

NRG019756

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

PBS UST:

Facility ID:	9-508519	CBS Number:	9-000079
Town:	Not reported	SWIS ID:	1464
Telephone:	(716) 876-1596	Location:	Not reported
Operator:	HERBERT FEDER		
Contact:	Not reported		
Emergency Contact:	GREGORY A STUBBS, (716) 876-1596		

Facility Type:	MANUFACTURING		
Total Tanks:	1	Old PBS Num:	001392

Owner:
3M COMPANY
BUILDING 41-01-05 BOX 33331
ST PAUL, MN 55133
(612) 778-5563

Owner Type:	Corporate/Commercial	Owner Mark:	Second Owner
-------------	----------------------	-------------	--------------

Owner Subtype: Not reported
Mailing Address:
3M COMPANY
305 SAWYER AVE
NY 14150
(716) 876-1596
ATTN: GREGORY A. STUBBS

Facility Status:	Active	Total Capacity:	30000
Certification:	02/14/1996	Expiration:	12/14/1900

Tank Status: Tank Converted To Non-Regulated Use

Tank Location: UNDERGROUND

Tank ID:	2	Install Date:	12/95
Product Stored:	EMPTY	Tank Type:	Steel/carbon steel
Tank Internal:	Not reported	Pipe Internal:	Not reported
Pipe Location:	Not reported	Pipe Type:	NONE

Tank External: Not reported
Pipe External: NONE/NONE

Second Containment: NONE/NONE

Leak Detection: NONE/NONE

Overfill Prot:	None	Dispenser:	None
----------------	------	------------	------

Date Tested:	Not reported	Next Test Date:	N.T.R
--------------	--------------	-----------------	-------

Date Closed:	12/95	Test Method:	Not reported
--------------	-------	--------------	--------------

Database Type: Not reported

NRG019757

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

CBS AST:			
Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY		
	PO BOX 33331 BLDG. 21-2W-05		
	ST. PAUL, MN 55133		
	(612) 778-5380		
Facility Status:	Active		
Tank ID:	BL002	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/75	Capacity (Gal):	3400
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	14
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS		
	305 SAWYER AVENUE		
	TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019758

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	ACID1		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/72	Capacity (Gal):	5800
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	78
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019759

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	ACID2		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/76	Capacity (Gal):	5800
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	78
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7664939	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019760

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active		
Tank ID:	NA0H1	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND		
Install Date:	07/54	Capacity (Gal):	20000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	JACKETED		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	JACKETED		
Pipe Containment:	NONE	Haz Percent:	50
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019761

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active		
Tank ID:	CS201	Total AST's:	13
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE:		
Install Date:	02/52	Capacity (Gal):	19000
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	100
Leak Detection:	OTHER		
Overfill Protection:	Product Level Gauge/Catch Basin		
Chemical:	Not reported		
Tank Closed:	11/96		
Region:	STATE		
Case Number:	75150	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019762

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	BL001		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	09/89	Capacity (Gal):	3400
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	14
Leak Detection:	OTHER		
Overfill Protection:	High Level Alarm/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019763

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	BL003		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	10/85	Capacity (Gal):	384
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	LEADED GASOLINE
Extrnl Protection:	NONE		
Intrnl Protection:	NONE		
Tank Containment:	NONE		
Pipe Type:	OTHER	Pipe Location:	Aboveground
Pipe Internal:	OTHER		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE	Haz Percent:	14
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/High Level Alarm		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019764

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	CS202		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	08/77	Capacity (Gal):	300
Tank Type:	Fiberglass coated steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	FIBERGLASS		
Intrnl Protection:	NONE		
Tank Containment:	OTHER/EARTHEN DIKE		
Pipe Type:	FIBERGLASS [FRP]	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	EARTHEN DIKE	Haz Percent:	100
Leak Detection:	INTERSTITIAL MONITORING		
Overfill Protection:	Catch Basin		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE		
Case Number:	75150	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019765

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NAOH2		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND	Capacity (Gal):	750
Install Date:	08/90	Product Stored:	LEADED GASOLINE
Tank Type:	Steel/carbon steel		
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT	Pipe Location:	Aboveground
Pipe Type:	STEEL/IRON		
Pipe Internal:	NONE	Haz Percent:	50
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE		
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emergency Contact:	GREGORY A STUBBS	Emergency Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019766

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number EPA ID Number
------	-------------	--------------------------------

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NA0H5		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	05/67	Capacity (Gal):	387
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE		
Leak Detection:	OTHER		
Overfill Protection:	Automatic Shut-Off/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019767

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	NA0H6		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	06/85	Capacity (Gal):	244
Tank Type:	Steel/carbon steel	Product Stored:	LEADED GASOLINE
Extrnl Protection:	PAINTED/ASPHALT COATING		
Intrnl Protection:	NONE		
Tank Containment:	VAULT		
Pipe Type:	STEEL/IRON	Pipe Location:	Aboveground
Pipe Internal:	NONE		
Pipe External:	PAINTED/ASPHALT COATING		
Pipe Containment:	NONE		
Leak Detection:	OTHER	Haz Percent:	19
Overfill Protection:	Automatic Shut-Off/Catch Basin		
Chemical:	Not reported		
Tank Closed:	Not reported		
Region:	STATE		
Case Number:	1310732	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019768

MAP FINDINGS

Map ID
 Direction
 Distance
 Elevation

Site

Database(s)

EDR ID Number
 EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID:	9-000079	Telephone:	(716) 876-1596
Owner:	3M COMPANY PO BOX 33331 BLDG. 21-2W-05 ST. PAUL, MN 55133 (612) 778-5380		
Facility Status:	Active	Total AST's:	13
Tank ID:	BL001		
Tank Status:	Not reported		
Tank Location:	ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE		
Install Date:	11/81	Capacity (Gal):	3400
Tank Type:	Fiberglass reinforced plastic [FRP]	Product Stored:	Not reported
Extrnl Protection:	Not reported		
Intrnl Protection:	Not reported		
Tank Containment:	VAULT		
Pipe Type:	NOT DEFINED	Pipe Location:	Not reported
Pipe Internal:	Not reported		
Pipe External:	Not reported		
Pipe Containment:	Not reported	Haz Percent:	0
Leak Detection:	Not reported		
Overflow Protection:	Catch Basin		
Chemical:	Not reported		
Tank Closed:	00/00		
Region:	STATE		
Case Number:	7681529	PBS Number:	9-001392
MOSF Number:	Not reported	SWIS Code:	1464
SPDES Number:	Not reported	ICS Number:	9-167068
Operator:	HERBERT FEDER	Facility Town:	TONAWANDA
Emrgncy Contact:	GREGORY A STUBBS	Emrgncy Phone:	(716) 876-1596
Certified Date:	12/10/96	Expiration Date:	12/07/98
Owner type:	Corporate/Commercial	Facility Type:	Manufacturing
Owner Sub Type:	Not reported		
Mail Name:	3M TONAWANDA		
Mail Contact:	GREGORY A. STUBBS 305 SAWYER AVENUE TONAWANDA, NY 14150		
Mail Phone:	(716) 871-6281		

NRG019769

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M TONAWANDA (Continued)

U003080603

Facility ID: 9-000079 Telephone: (716) 876-1596
 Owner: 3M COMPANY
 PO BOX 33331 BLDG. 21-2W-05
 ST. PAUL, MN 55133
 (612) 778-5380

Facility Status: Active
 Tank ID: CS203 Total AST's: 13
 Tank Status: Not reported
 Tank Location: ABOVEGROUND ON SADDLES LEGS, STILTS, RACK, OR CRADLE
 Install Date: 06/94 Capacity (Gal): 30000
 Tank Type: Steel/carbon steel Product Stored: LEADED GASOLINE
 Extrl Protection: PAINTED/ASPHALT COATING
 Intrnl Protection: OTHER
 Tank Containment: VAULT
 Pipe Type: FIBERGLASS [FRP] Pipe Location: Aboveground
 Pipe Internal: NONE
 Pipe External: NONE
 Pipe Containment: NONE Haz Percent: 100
 Leak Detection: INTERSTITIAL MONITORING
 Overfill Protection: High Level Alarm/Automatic Shut-Off
 Chemical: Not reported
 Tank Closed: Not reported
 Region: STATE
 Case Number: 75150 PBS Number: 9-001392
 MOSF Number: Not reported SWIS Code: 1464
 SPDES Number: Not reported ICS Number: 9-167068
 Operator: HERBERT FEDER Facility Town: TONAWANDA
 Emrgncy Contact: GREGORY A STUBBS Emrgncy Phone: (716) 876-1596
 Certified Date: 12/10/96 Expiration Date: 12/07/98
 Owner type: Corporate/Commercial Facility Type: Manufacturing
 Owner Sub Type: Not reported
 Mail Name: 3M TONAWANDA
 Mail Contact: GREGORY A. STUBBS
 305 SAWYER AVENUE
 TONAWANDA, NY 14150
 Mail Phone: (716) 871-6281

W120
SE
> 1
Higher

OCELLO
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S102174432
N/A

LUST:

Facility ID: 9008529 Region of Spill: 9
 Facility Contact: Not reported Facility Tele: Not reported
 Investigator: MF Spill Type: Facility
 Caller Name: HERBERT FEDER Caller Agency: OCELLO
 Caller Phone: (716) 876-1596 Caller Extension: Not reported
 Notifier Name: Not reported Notifier Agency: Not reported
 Notifier Phone: Not reported Notifier Extension: Not reported
 Spiller Contact: Not reported Spiller Phone: (716) 876-1596
 Spiller: OCELLO
 Address: 305 SAWYER ROAD
 TONAWANDA, NY 14150

Spill Class: Not reported
 Spill Closed Dt: 11/05/1990
 Spill Cause: Other
 Water Affected: Not reported

Resource Affected: Air
 Spill Source: Other Commercial/Industrial

NRG019770

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site	Database(s)	EDR ID Number	EPA ID Number
------	-------------	---------------	---------------

OCELLO (Continued)

S102174432

Spill Notifier: Responsible Party	PBS Number: Not reported
Spill Date: 11/05/1990 08:42	Reported to Dept: 11/05/1990 09:10
Cleanup Ceased: 11/05/1990	
Last Inspection: Not reported	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 11/21/1990	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 11/03/1990	
Remark: UNKNOWN SOURCE CAUSED FIRE. DUCT CARRING GAS BURNT THRU CAUSING RELEASE. HYDROGEN SULFIDE & CARBON DISULFIDE COMBINED CAUSING RELEASE OF SO2.	

SPILLS:

Facility ID: 9112462	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: MJH	Spill Type: Facility
Caller Name: MARLENE KONEICZNY	Caller Agency: 3M OCELLO
Caller Phone: (716) 876-1596	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: Not reported
Spiller: 3M OCELLO	
Address: 305 SAWYER AVENUE TONAWANDA, NY	
Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.	
Spill Closed Dt: 04/10/1992	
Spill Cause: Equipment Failure	Resource Affected: On Land
Water Affected: Not reported	Spill Source: Other Commercial/Industrial
Spill Notifier: Responsible Party	PBS Number: Not reported
Spill Date: 02/17/1992 09:00	Reported to Dept: 03/06/1992 15:03
Cleanup Ceased: 04/10/1992	
Last Inspection: Not reported	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 11/13/1992	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 03/12/1992	
Remark: PUMP SEAL FAILED LEAKED ETHYLENE GLYCOL TO PAVEMENT	

W121
SE
> 1
Higher

O-CEL-O SPONGE PLANT
305 SAWYER AVE
TONAWANDA, NY 14150

SHWS

S101008691
N/A

NRG019771

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O SPONGE PLANT (Continued)

S101008691

SHWS:

Facility ID: 915148 EPA ID: Not reported
Owner: 3M, O-Cel-O Sponge Co.
305 Sawyer Ave
Tonawanda, NY 14150 - 5102

Owner Telephone: Not reported
Operator: O-Cel-O Sponge Co., Div. of Gen. Mills
305 Sawyer Ave.
Tonawanda, NY

Contact: Not reported Telephone: Not reported
Site Classification: Does not present a significant threat to the public health or the environment - action may be deferred.

Region: 9

Site Type: Dump

Acres: Not reported User: O-Cel-O Sponge Co., Div. of Gen. Mills
HW Started: 1950's HW Ended: Present

HW Disposed: Carbon Disulfide (F005)

Units: Unknown

Air Data: Unavailable Surf. Water Data: Unavailable

Gmd. Water Data: Available Soil Data: Available

Sediment Data: Unavailable

Ground Water Standards Contravention: Yes

Drinking Water Standards Contravention: No

Surface Water Standards Contravention: No

Air Standards Contravention: No

Enforcement Status: Order Has Been Signed Legal Action: No

State Action: Yes Fed Action: No

Remedial Action: Under Design

Remed action type: IRM Soil Removal

Soil Type: Not reported

Gmd Water Depth: Not reported

Assessment of Environmental Problems:

Potential contamination of groundwater from leaching of carbon disulfide impregnated soils and potential for wetland contamination.

Assessment of Health Problems:

Previous remedial activities in 1991 and 1992 have removed some carbon disulfide contaminated soils to a depth of 1 to 1.5 meters. This action has removed the potential for exposure by direct contact and inhalation. The installation of additional monitoring wells in a downgradient position will be necessary to determine the impact to groundwater and to ensure that contaminated groundwater does not migrate off-site. The area is served by public water.

W122
SE
> 1
Higher

3M O-CELLO
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102173972
N/A

NRG019772

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CELLO (Continued)

S102173972

SPILLS:

Facility ID:	9101352	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	MARLENE KONIECZNY	Caller Agency:	3M O-CELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M O-CELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported		
Spill Closed Dt:	05/10/1991		
Spill Cause:	Unknown	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	05/02/1991 15:25	Reported to Dept:	05/02/1991 16:28
Cleanup Ceased:	05/02/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	05/20/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	05/10/1991		
Remark:	WELDING CAUSED FLASH FIRE, CAUSING A PRESSURE RELEASE FROM PURGING VESSEL.		

W123
SE
> 1
Higher

TRAFFIC ACCIDENT
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102176421
N/A

NRG019773

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

TRAFFIC ACCIDENT (Continued)

S102176421

SPILLS:

Facility ID:	8806112	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	DISPATCH LINDSTROM	Caller Agency:	TONAWANDA PD
Caller Phone:	(716) 876-5300	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	UNKNOWN		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	10/24/1988	Resource Affected:	On Land
Spill Cause:	Traffic Accident	Spill Source:	Passenger Vehicle
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Police Department	Reported to Dept:	10/20/1988 01:05
Spill Date:	10/20/1988 00:36		
Cleanup Ceased:	10/24/1988		
Last Inspection:	10/24/1988		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/25/1988		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/24/1988		
Remark:	TRAFFIC ACCIDENT, MINOR SPILL		

W124
SE
> 1
Higher

3M 0-CEL-0
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102179174
N/A

NRG019774

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CEL-0 (Continued)

S102179174

SPILLS:

Facility ID:	9411795	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	UST
Caller Name:	GREG STUBBS	Caller Agency:	3M O-CEL-0
Caller Phone:	(716) 871-6281	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREG STUBBS	Spiller Phone:	(716) 876-1596

Spiller: 3M O-CEL-0
Address: 305 SAWYER AVENUE
TONAWANDA, NY 14150

Spill Class: Known release with minimal potential for fire or hazard. DEC Response.
Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 01/28/1997

Spill Cause: Human Error

Water Affected: Not reported

Spill Notifier: Responsible Party

Spill Date: 12/02/1994 14:30

Cleanup Ceased: Not reported

Last Inspection: 12/07/1994

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 02/10/1997

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 12/05/1994

Remark: HIT FUEL LINE WHILE EXCAVATING. INTENT TO REPLACE TANK AND LINES IN NEXT FEW MONTHS.

W125
SE
> 1
Higher

O-CEL-O 3M
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102173910
N/A

NRG019775

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O 3M (Continued)

S102173910

SPILLS:

Facility ID:	9103324	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	JOHN HUNTER	Caller Agency:	3M
Caller Phone:	(612) 778-5251	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	O'CELLO 3-M		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		

Spill Class: Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	05/22/1992	Resource Affected:	On Land
Spill Cause:	Housekeeping	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	06/21/1991 10:30
Spill Date:	06/01/1991 12:00		
Cleanup Ceased:	05/22/1992		
Last Inspection:	12/05/1991		
Cleanup Meets Standard:	False		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/13/1992		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	06/25/1991		
Remark:	SITE ASSESMENT FOUND OIL CONTAMINATION IN FORMER DRUM STORAGE AREA HAZARDOUS WASTE REMEDIATION IS ALSO INVOLVED WITH THIS SITE		

W126
SE
> 1
Higher

3M O-CELL-O
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102175037
N/A

NRG019776

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CELL-O (Continued)

S102175037

SPILLS:

Facility ID:	9212281	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	GREG STUBBS	Caller Agency:	3M O-CELL-O
Caller Phone:	(716) 871-6281	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	NONE		
Address:	Not reported		
	Not reported		
Spill Class:	No spill occurred. No DEC Response. No corrective action required.		
Spill Closed Dt:	02/03/1993		
Spill Cause:	Unknown	Resource Affected:	On Land
Water Affected:	Not reported	Spill Source:	Unknown
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	01/01/1993 12:00	Reported to Dept:	01/26/1993 12:00
Cleanup Ceased:	02/03/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	01/20/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	01/29/1993		
Remark:	WHILE DIGGING UP CONCRETE FOOTERS, BLACKENED SOIL WAS NOTED		

W127
SE
> 1
Higher

3-M
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102174498
N/A

NRG019777

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3-M (Continued)

S102174498

SPILLS:

Facility ID:	9200491	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	DAVID SCHUTT	Caller Agency:	3-M ST PAUL
Caller Phone:	(612) 778-5563	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3-M		
Address	305 SAWYER AVENUE TONAWANDA, NY		

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. No DEC Response. No corrective action required.

Spill Closed Dt: 04/13/1992

Spill Cause: Equipment Failure

Resource Affected: Air

Water Affected: Not reported

Spill Source: Other Commercial/Industrial

Spill Notifier: Responsible Party

PBS Number: Not reported

Spill Date: 04/13/1992 14:15

Reported to Dept: 04/13/1992 15:07

Cleanup Ceased: 04/13/1992

Last Inspection: Not reported

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 11/10/1992

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 04/13/1992

Remark: DURING WASRE GAS PROCESSING ELECTRIC POWER IN PLANT FAILED FOR THREE MINUTES. LOST WATER FLOW TO STACK EMISSIONS SCRUBBER. GAS DISSIPATED. NRC CASE #114095. ERIE CO EMERG MANAGEMENT ALSO NOTIFIED.

W128
SE
>1
Higher

3M O'CELLO
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102174323
N/A

NRG019778

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O'CELLO (Continued)

S102174323

SPILLS:

Facility ID:	9109866	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	HERBERT FEDER	Caller Agency:	3M O'CELLO
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M O'CELLO		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported		
Spill Closed Dt:	12/17/1991		
Spill Cause:	Unknown	Resource Affected:	Groundwater
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	12/03/1991 12:00	Reported to Dept:	12/16/1991 12:30
Cleanup Ceased:	12/17/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	12/17/1991		
Remark:	GROUNDWATER FROM TANK PIT TEST RESULT FOUND HIGH LEVEL OF CARBON DISULFIDE		

W129
SE
> 1
Higher

GENERAL MILLS INC
305 SAWYER AVE
TONAWANDA, NY 14150

FINDS 1000212496
RCRIS-LQG NYD002127124
TRIS
TSCA
CERC-NFRAP
NY Spills

CERCLIS-NFRAP Classification Data:

Site Incident Category:	Not reported	Federal Facility:	NO
Ownership Status:	OTHER	NPL Status:	NOT ON NPL
EPA Notes:	THE SLUDGE LAGOON IS ALLEGED TO CONTAIN A SULFUR SLUDGE AND SODIUM SULFATE. POSSIBILITY OF OTHER CHEMICALS USED ON SITE SUCH AS HYDRAZINE, SODIUM HYDROXIDE, SULFURIC ACID AND CARBON DISULFIDE PRESENT IN THE LAGOON. CHROMIUM MAY BE PRESENT		

CERCLIS-NFRAP Assessment History:

Assessment:	PRELIMINARY ASSESSMENT	Completed:	03/24/86
Assessment:	SCREENING SITE INSPECTION	Completed:	05/30/86
Assessment:	DISCOVERY	Completed:	02/17/86

CERCLIS-NFRAP Alias Name(s):
O-CEL-O PRODUCTS

NRG019779

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GENERAL MILLS INC (Continued)

1000212496

RCRIS:

Owner: 3M
(612) 778-5380

Contact: HERBERT FEDER
(716) 876-1596

Record Date: 06/21/94

Classification: Large Quantity Generator

BIENNIAL REPORTS:

Last Biennial Reporting Year: 1993

<u>Waste</u>	<u>Quantity (Lbs)</u>	<u>Waste</u>	<u>Quantity (Lbs)</u>
D001	5146.20	D008	260.00
D009	260.00	D028	400.00
D039	2836.20	F005	400.00
P022	1032935.78		

Used Oil Recyc: No

Violation Status: No violations found

FINDS:

Other Pertinent Environmental Activity Identified at Site:

- Facility is monitored or permitted for air emissions under the Clean Air Act (under AFS/AIRS)
- Civil judicial and administrative enforcement case against facility (under DOCKET)

NRG019780

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

GENERAL MILLS INC (Continued)

1000212496

SPILLS:

Facility ID:	8706914	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	Not reported	Caller Agency:	Not reported
Caller Phone:	Not reported	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	GENERAL MILLS		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	In Sewer
Spill Closed Dt:	11/16/1987	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/05/1987 15:40
Spill Notifier:	Responsible Party		
Spill Date:	11/13/1987 08:15		
Cleanup Ceased:	11/16/1987		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/16/1987		
Remark:	Not reported		

W130
SE
> 1
Higher

3-M COMPANY
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102178143
N/A

NRG019781

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3-M COMPANY (Continued)

S102178143

SPILLS:

Facility ID:	9308044	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	BOB SIEGEL	Caller Agency:	3-M COMPANY
Caller Phone:	(612) 778-6130	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported

Spiller: 3-M COMPANY
Address: 305 SAWYER AVENUE
TONAWANDA, NY 14150

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt:	10/07/1993	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/01/1993 16:28
Spill Date:	10/01/1993 00:59		
Cleanup Ceased:	10/07/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/18/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/04/1993		
Remark:	DAMPER MALFUNCTION.		

W131
SE
> 1
Higher

3M CORPORATION
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102177965
N/A

NRG019782

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

SPILLS:

Facility ID:	9609379	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	HERBERT FEDER	Caller Agency:	3M CORPORATION
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREG STUBBS	Spiller Phone:	(716) 871-6281
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/29/1996	Resource Affected:	Air
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	10/26/1996 23:24
Spill Date:	10/26/1996 22:35		
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/30/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	10/26/1996		
Remark:	tank being flushed prior to diaposal material carbon disulfide entered atmosphere		

NRG019783

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9609391	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	() -
Investigator:	RMC	Spill Type:	UST
Caller Name:	HERBERT FEDER	Caller Agency:	3M CORPORATION
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	GREGG STUBBS	Spiller Phone:	(716) 871-6281
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	10/29/1996		
Spill Cause:	Housekeeping	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	10/27/1996 22:00	Reported to Dept:	10/27/1996 23:03
Cleanup Ceased:	Not reported		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/30/1996		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	10/27/1996		
Remark:	carbon disulfide released into atmosphere during steaming of tank prior to disposal		

NRG019784

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9304489	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	JIM GLASS	Caller Agency:	ERIE CO. EMERGENCY SVCS.
Caller Phone:	(716) 898-3696	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M CORPORATION		
Address:	305 SAYWER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. No DEC Response. No corrective action required.		
Spill Closed Dt:	07/12/1993	Resource Affected:	Air
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	07/09/1993 16:41
Spill Date:	07/09/1993 16:30		
Cleanup Ceased:	07/12/1993		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	07/22/1993		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	07/12/1993		
Remark:	EXCEEDED AIR PERMIT FOR SULFUR DIOXIDE.		

NRG019785

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9313853	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	KAH	Spill Type:	Facility
Caller Name:	BOB SIEGEL	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 778-6130	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. No DEC Response. No corrective action required.		
Spill Closed Dt:	02/24/1994	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	02/24/1994 11:29
Spill Date:	02/24/1994 09:50		
Cleanup Ceased:	02/24/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/03/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	02/24/1994		
Remark:	PIPE THEY WERE PUMPING THROUGH FAILED.		

NRG019786

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9315338	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MIKE FALCO	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 778-4403	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. No DEC Response. No corrective action required.		
Spill Closed Dt:	03/29/1994	Resource Affected:	Air
Spill Cause:	Human Error	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	03/28/1994 17:53
Spill Date:	03/28/1994 16:30		
Cleanup Ceased:	03/29/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	03/31/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	03/29/1994		
Remark:	AIR RELEASE OF 2000 LBS. EACH OF CARBON DISULFIDE AND HYDROGEN DISULFIDE.		

NRG019787

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9315495	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	MIKE FALSO	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 738-1451	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/01/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	03/30/1994 12:00	Reported to Dept:	03/30/1994 19:59
Cleanup Ceased:	04/01/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	06/03/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered in Computer Data File:	04/05/1994		
Remark:	SOLVENT RECOVERY PROCESS KEEPS FAILING. RELEASE OF 900 LBS. EACH OF HYDROGEN SULFIDE AND CARBON DISULFIDE.		

NRG019788

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9400025	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	HAZEN EL-GAMAL	Caller Agency:	3M CORP.
Caller Phone:	(612) 778-7848	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 871-6281
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/04/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/01/1994 11:30	Reported to Dept:	04/01/1994 13:20
Cleanup Ceased:	04/04/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/11/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/05/1994		
Remark:	900 LBS. EACH OF CARBON DISULFIDE AND HYDROGEN SULFIDE RELEASED TO AIR.		

NRG019789

MAP FINDINGS:

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9400067	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	BOB FIEGEL	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 739-0011	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 648-2040
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/04/1994	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	04/02/1994 11:19
Spill Date:	04/01/1994 12:00		
Cleanup Ceased:	04/04/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/11/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/05/1994		
Remark:	RELEASE OF CARBON DISULFIDE 580 LBS. OVER PERMITTED LIMIT.		

NRG019790

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M CORPORATION (Continued)

S102177965

Facility ID:	9400080	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJS	Spill Type:	Facility
Caller Name:	TERRY HUHENSTEIN	Caller Agency:	3M CORPORATION
Caller Phone:	(612) 770-6334	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M CORPORATION		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	04/04/1994		
Spill Cause:	Equipment Failure	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	04/02/1994 12:00	Reported to Dept:	04/03/1994 11:51
Cleanup Ceased:	04/04/1994		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	04/11/1994		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/05/1994		
Remark:	AIR RELEASE OF CARBON DISULFIDE 1000 LBS. OVER PERMITTED LIMIT.		

W132
SE
> 1
Higher

O-CELL-O
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102177491
N/A

NRG019791

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CELL-O (Continued)

S102177491

SPILLS:

Facility ID:	9006754	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MF	Spill Type:	Facility
Caller Name:	MARLENE KONIECZNY	Caller Agency:	O-CELL-O
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	O-CELL-O		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	09/19/1990		
Spill Cause:	Human Error	Resource Affected:	Air
Water Affected:	Not reported	Spill Source:	Other Commercial/Industrial
Spill Notifier:	Responsible Party	PBS Number:	Not reported
Spill Date:	09/19/1990 13:00	Reported to Dept:	09/19/1990 13:48
Cleanup Ceased:	09/19/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/01/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/19/1990		
Remark:	UPSET DURING ACID BASE REACTION. PROBLEM CONTINUING.		

W133
SE
> 1
Higher

3M OCELLO
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S100667584
N/A

LUST:

Facility ID:	9110025	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RNL	Spill Type:	Facility
Caller Name:	MARLENE KONIECZNY	Caller Agency:	3M OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M OCELLO		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14150		
Spill Class:	Not reported		
Spill Closed Dt:	12/20/1991	Resource Affected:	Surface Water
Spill Cause:	Other	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	12/20/1991 12:10
Spill Date:	12/20/1991 10:00		
Cleanup Ceased:	12/20/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		

NRG019792

MAP FINDINGS

Map ID
Direction
Distance
Location

Site

Database(s)

EDR ID Number
EPA ID Number

3M OCELLO (Continued)

S100667584

Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: Not reported
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 12/20/1991
 Remark: SURFACE WATER ENTERED ONGOING CONTAMINATED SOIL REMEDIATION PROJECT

SPILLS:

Facility ID: 9010381	Region of Spill: 9
Facility Contact: Not reported	Facility Tele: Not reported
Investigator: MJH	Spill Type: Facility
Caller Name: HERB FEDER	Caller Agency: OCELLO
Caller Phone: (716) 876-1596	Caller Extension: Not reported
Notifier Name: Not reported	Notifier Agency: Not reported
Notifier Phone: Not reported	Notifier Extension: Not reported
Spiller Contact: Not reported	Spiller Phone: (716) 876-1596
Spiller: 3M OCELLO	
Address: 305 SAWYER AVENUE TONAWANDA, NY 14150	
Spill Class: Not reported	
Spill Closed Dt: 12/27/1990	
Spill Cause: Equipment Failure	Resource Affected: Air
Water Affected: Not reported	Spill Source: Other Commercial/Industrial
Spill Notifier: Responsible Party	PBS Number: Not reported
Spill Date: 12/26/1990 13:00	Reported to Dept: 12/26/1990 13:41
Cleanup Ceased: 12/27/1990	
Last Inspection: Not reported	
Cleanup Meets Standard: True	
Recommended Penalty: No Penalty	
Spiller Cleanup Date: Not reported	
Enforcement Date: Not reported	
Investigation Complete: Not reported	
UST Involvement: False	
Spill Record Last Update: 12/28/1990	
Corrective Action Plan Submitted: Not reported	
Date Spill Entered In Computer Data File: 12/27/1990	
Remark: EQUIPMENT FAILURE ON AIR POLLUTION CONTROL EQUIPMENT RELEASED SULPHUR DIOXIDE INTO THE AIR	

NRG019793

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M OCELLO (Continued)

S100667584

Facility ID:	9300606	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	RMC	Spill Type:	Facility
Caller Name:	HERBERT FEDER	Caller Agency:	3M OCELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported

Spiller: 3M OCELLO
Address: 305 SAWYER AVENUE
TONAWANDA, NY

Spill Class: Possible release with minimal potential for fire or hazard or Known release with no damage. DEC Response. Willing Responsible Party. Corrective action taken.

Spill Closed Dt: 04/13/1993

Spill Cause: Equipment Failure

Water Affected: Not reported

Spill Notifier: Responsible Party

Spill Date: 04/13/1993 02:45

Cleanup Ceased: 04/13/1993

Last Inspection: Not reported

Cleanup Meets Standard: True

Recommended Penalty: No Penalty

Spiller Cleanup Date: Not reported

Enforcement Date: Not reported

Investigation Complete: Not reported

UST Involvement: False

Spill Record Last Update: 04/28/1993

Corrective Action Plan Submitted: Not reported

Date Spill Entered In Computer Data File: 04/15/1993

Remark: MAIN SOURCE OF SULFUR DIOXIDE IS PROCESS DESIGN OF RECOVERY EQUIPMENT

W134
SE
> 1
Higher

O'CELLO DIVISION
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102176905
N/A

NRG019794

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O'CELLO DIVISION (Continued)

S102176905

SPILLS:

Facility ID:	8905389	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	HERBERT FEDDER	Caller Agency:	O'CELLO DIVISION
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	OCELLO DIVISION		
Address:	305 SAWYER AVENUE TONAWANDA, NY 14151		
Spill Class:	Not reported		
Spill Closed Dt:	08/31/1989	Resource Affected:	Air
Spill Cause:	Equipment Failure	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Federal Government	Reported to Dept:	08/31/1989 15:36
Spill Date:	08/29/1989 19:40		
Cleanup Ceased:	08/31/1989		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	10/02/1989		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	09/25/1989		
Remark:	FIRE IN POLLUTION CONTROL EQUIPMENT CAUSED RELEASE OF SEVERAL POLUTANTS		

**W135
SE
> 1
Higher**

**3M O-CEL-O
305 SAWYER AVE
TONAWANDA, NY**

**LUST
NY Spills**

**S100667754
N/A**

LUST:

Facility ID:	9202864	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	SAC	Spill Type:	Facility
Caller Name:	PAT PENDRAK	Caller Agency:	3M O-CEL-O
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596
Spiller:	3M O-CEL-O DIVISION		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Known release with minimal potential for fire or hazard. DEC Response. Willing Responsible Party. Corrective action taken.		
Spill Closed Dt:	12/09/1992	Resource Affected:	On Land
Spill Cause:	Other	Spill Source:	Other Commercial/Industrial
Water Affected:	Not reported	PBS Number:	Not reported
Spill Notifier:	Responsible Party	Reported to Dept:	06/08/1992 09:35
Spill Date:	06/06/1992 12:00		
Cleanup Ceased:	12/09/1992		
Last Inspection:	06/08/1992		
Cleanup Meets Standard:	False		

NRG019795

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3M O-CEL-O (Continued)

S100667754

Recommended Penalty: No Penalty
 Spiller Cleanup Date: Not reported
 Enforcement Date: Not reported
 Investigation Complete: Not reported
 UST Involvement: False
 Spill Record Last Update: 12/17/1992
 Corrective Action Plan Submitted: Not reported
 Date Spill Entered In Computer Data File: 06/10/1992
 Remark: WHILE DIGGING FOR FOOTER FOR EXTENSION OF THE BUILDING, HYDRAULIC OIL WAS FOUND.

SPILLS:

Facility ID:	9108405	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	HERBERT FADER	Caller Agency:	3M O-CEL-O
Caller Phone:	(716) 871-6213	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3M O-CEL-O		
Address:	305 SAWYER AVENUE TONAWANDA, NY		

Spill Class:	Not reported	Resource Affected:	On Land
Spill Closed Dt:	12/04/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Unknown	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/06/1991 15:55
Spill Notifier:	Responsible Party		
Spill Date:	11/06/1991 15:00		
Cleanup Ceased:	12/04/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	12/04/1991		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/07/1991		
Remark:	CONTAMINATED SOIL FOUND DURING SOIL EXCAVATION		

W136
SE
> 1
Higher

O-CEL-O
305 SAWYER AVE
TONAWANDA, NY

LUST
NY Spills

S101659612
N/A

LUST:

Facility ID:	8807687	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	CAF	Spill Type:	Facility
Caller Name:	TOM WANTUCK	Caller Agency:	NYS DEC
Caller Phone:	(716) 847-4590	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	(716) 876-1596

NRG019796

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O (Continued)

S101659612

Spiller: O-CEL-O
Address: 305 SAWYER AVENUE
TONAWANDA, NY 14150

Spill Class: Not reported
Spill Closed Dt: 01/11/1989
Spill Cause: Other
Water Affected: DITCH
Spill Notifier: DEC
Spill Date: 12/20/1988 12:00

Resource Affected: Surface Water
Spill Source: Other Commercial/Industrial
PBS Number: Not reported
Reported to Dept: 12/20/1988 14:00

Cleanup Ceased: 01/11/1989
Last Inspection: 01/11/1989
Cleanup Meets Standard: True
Recommended Penalty: No Penalty
Spiller Cleanup Date: Not reported
Enforcement Date: Not reported
Investigation Complete: Not reported
UST Involvement: False
Spill Record Last Update: 01/23/1989
Corrective Action Plan Submitted: Not reported
Date Spill Entered In Computer Data File: 12/21/1988
Remark: O-CEL-O FLUSHED OILY MATERIAL FROM STORM CULVERT TO DITCH

NRG019797

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

O-CEL-O (Continued)

S101659612

SPILLS:

Facility ID:	9008670	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MEL	Spill Type:	Facility
Caller Name:	MARLENE KONIECZ	Caller Agency:	O-CEL-O
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	O-CEL-O		
Address:	305 SAWYER AVENUE TONAWANDA, NY		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	11/13/1990	Spill Source:	Other Commercial/Industrial
Spill Cause:	Equipment Failure	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	11/07/1990 21:10
Spill Notifier:	Responsible Party		
Spill Date:	11/07/1990 12:00		
Cleanup Ceased:	11/07/1990		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	11/13/1990		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	11/09/1990		
Remark:	AIR RELEASE AT O-CEL-O PLANT		

W137
SE
> 1
Higher

3-M O'CELLO PLANT
305 SAWYER AVE
TONAWANDA, NY

NY Spills

S102173961
N/A

NRG019798

MAP FINDINGS

Map ID
Direction
Distance
Elevation

Site

Database(s)

EDR ID Number
EPA ID Number

3-M O'CELLO PLANT (Continued)

S102173961

SPILLS:

Facility ID:	9101014	Region of Spill:	9
Facility Contact:	Not reported	Facility Tele:	Not reported
Investigator:	MJH	Spill Type:	Facility
Caller Name:	MARLENE KONIECZSY	Caller Agency:	3-M O'CELLO
Caller Phone:	(716) 876-1596	Caller Extension:	Not reported
Notifier Name:	Not reported	Notifier Agency:	Not reported
Notifier Phone:	Not reported	Notifier Extension:	Not reported
Spiller Contact:	Not reported	Spiller Phone:	Not reported
Spiller:	3-M O'CELLO		
Address:	Not reported		
	Not reported		
Spill Class:	Not reported	Resource Affected:	Air
Spill Closed Dt:	04/29/1991	Spill Source:	Other Commercial/Industrial
Spill Cause:	Human Error	PBS Number:	Not reported
Water Affected:	Not reported	Reported to Dept:	04/25/1991 16:31
Spill Notifier:	Responsible Party		
Spill Date:	04/25/1991 16:00		
Cleanup Ceased:	04/29/1991		
Last Inspection:	Not reported		
Cleanup Meets Standard:	True		
Recommended Penalty:	No Penalty		
Spiller Cleanup Date:	Not reported		
Enforcement Date:	Not reported		
Investigation Complete:	Not reported		
UST Involvement:	False		
Spill Record Last Update:	Not reported		
Corrective Action Plan Submitted:	Not reported		
Date Spill Entered In Computer Data File:	04/29/1991		
Remark:	AIR RELEASE FOLLOWUP REFERRED TO DIV. AIR RESOURCES HENRY SANDANATO		

NRG019799



City	EDR ID	Site Name	Site Address	Zip	Database(s)	Facility ID
GRAND ISLAND	1000133784	NYS THRUWAY AUTH	S GRAND ISLAND BRIDGES	14072	RCRIS-SQG, FINDS	
GRAND ISLAND	1000551845	NYS THRUWAY AUTH	N GRAND ISLAND BRIDGES	14072	FINDS, RCRIS-LOG	
GRAND ISLAND	S100666314	MOBIL	GRAND ISLAND BOULEVARD	14072	LUST	8805489
TONAWANDA	S100669523	DUPONT BOAT CLUB	AQUA DRIVE AT RIVER ROAD		LUST	9009390
TONAWANDA	1000274235	NATL FUEL GAS CO REG STA TN RM 508	CHEVROLET GMC RIVER RD	14150	RCRIS-SQG, FINDS	
TONAWANDA	1000413631	STATION 133	EI DUPONT RIVER RD	14150	FINDS, RCRIS-LOG	
TONAWANDA	S102177509	E.R. WILLIAMS INC.	174 NORTH ELLICOTT CR. RD		NY Spills	
TONAWANDA	1000432565	SVC STA	GRAND ISLAND BLVD LOCATION	14150	FINDS, RCRIS-LOG	
TONAWANDA	S101659216	NOCO - SUN PIPELINE	GRAND ISLAND BLVD.		LUST	9501236
TONAWANDA	S100118934	APA TRANSPORT	GRAND ISLAND BLVD		LUST	8607846
TONAWANDA	1000555396	NYS DOT BIN 1044960	RTE I-290 OVER RTE 1-190	14150	FINDS, RCRIS-LOG	
TONAWANDA	S101507763	OIL SHEEN IN RIVER	NIAGARA RIVER AT HINDS		LUST	9501126
TONAWANDA	S102245027	STORM SEWER TO ELLICOTT C	REEK VICKER / WALES		NY Spills	
TONAWANDA	S102174086	NIAGARA MOHAWK - HUNTLEY	RIVER ROAD		NY Spills	
TONAWANDA	S102176852	HUNTLEY COAL PLANT	RIVER ROAD		NY Spills	
TONAWANDA	S102175159	C.P.C. GROUP	RIVER RD.		NY Spills	
TONAWANDA	S101008679	SEAWAY/NIAGARA LANDFILL, INC.	RIVER ROAD	14150	SHWS, LUST, NY Spills	9108133
TONAWANDA	1000299737	TERMINAL STATION C	RIVER RD	14150	FINDS, RCRIS-LOG	
TONAWANDA	1000554172	NYS THRUWAY AUTH	RIVER RD ENT OVER THRUWAY	14150	FINDS, RCRIS-LOG	
TONAWANDA	1001124925	US TRANSCO	4400 RIVER RD SUITE A	14150	RCRIS-SQG	
TONAWANDA	S101174768	SUN TERMINAL(ATLANTIC)	RIVER ROAD		LUST	9408626
TONAWANDA	S101341713	TONAWANDA ENGINE PLANT	RIVER ROAD		LUST	9413928
TONAWANDA	S102519190	NIAGARA MOHAWK	RIVER ROAD		LUST, NY Spills	8805221
TONAWANDA	S102234953	NOCO ENERGY TANK 122	RIVER RD		LUST	9516835
TONAWANDA	S100493900	AGWAY	RIVER ROAD		LUST	9205796
TONAWANDA	S100494400	VAN DE WATER WATER PLANT	RIVER ROAD		LUST	9209941
TONAWANDA	S100493208	NOCO OIL	RIVER ROAD		LUST	9111755
TONAWANDA	S100495114	NOCO ENERGY	RIVER ROAD		LUST, NY Spills	9301371
TONAWANDA	S101103100	UNITED REFINING	RIVER ROAD		LUST, NY Spills	9401932
TONAWANDA	S100668802	CPC GROUP	RIVER ROAD		LUST	8706462
TONAWANDA	S100669140	CPC TONAWANDA	RIVER ROAD		LUST	8807786
TONAWANDA	S100669090	CHARLIE FASO BACKYARD	EAST RIVER ROAD		LUST	8905477
TONAWANDA	S100669524	CHEVROLET ENGINE PLANT	RIVER ROAD		LUST	9009486
TONAWANDA	S1022335987	GOETZ - FMC	SAWYER AVENUE		LUST, NY Spills	9514925
TONAWANDA	S100669484	M.L. YOUNG MOTOR EXPRESS	TWIN CITY MEMOROL HWY		LUST	9004350

**GEOCHECK VERSION 2.1 ADDENDUM
FEDERAL DATABASE WELL INFORMATION**

Well Closest to Target Property (Northern Quadrant)

BASIC WELL DATA

Site ID:	430126078575101	Distance from TP:	>2 Miles
Site Type:	Single well, other than collector or Ranney type		
Year Constructed:	1954	County:	Erie
Altitude:	595.00 ft.	State:	New York
Well Depth:	60.00 ft.	Topographic Setting:	Not Reported
Depth to Water Table:	Not Reported	Prim. Use of Site:	Withdrawal of water
Date Measured:	Not Reported	Prim. Use of Water:	Industrial

LITHOLOGIC DATA

Geologic Age ID (Era/System/Series):	Silurian-Upper
Principal Lithology of Unit:	Shale
Further Description:	Not Reported

WATER LEVEL VARIABILITY

Not Reported

NRG019801

GEOCHECK VERSION 2.1
FEDERAL DATABASE WELL INFORMATION

Well Closest to Target Property (Western Quadrant)

BASIC WELL DATA

Site ID:	430022078591001	Distance from TP:	>2 Miles
Site Type:	Single well, other than collector or Ranney type	County:	Erie
Year Constructed:	1952	State:	New York
Altitude:	595.00 ft.	Topographic Setting:	Not Reported
Well Depth:	53.00 ft.	Prim. Use of Site:	Withdrawal of water
Depth to Water Table:	18.00 ft.	Prim. Use of Water:	Other
Date Measured:	07011964		

LITHOLOGIC DATA

Geologic Age ID (Era/System/Series):	Silurian-Upper
Principal Lithology of Unit:	Shale
Further Description:	Not Reported

WATER LEVEL VARIABILITY

Not Reported

GEOCHECK VERSION 2.1
STATE DATABASE WELL INFORMATION

Water Well Information:

Well Within >2 Miles of Target Property (Northern Quadrant)

Public Water Supply #:	1811858	Source ID:	001
PW Supply Name:	Not Reported		
Source Name:	DRILLED WELL #1		
Source Description:	Groundwater		
Availability/Utilization:	Permanent Utilization	Source Type:	Source Record
Latitude:	430130	Longitude:	-785530
Source Prod Capacity:	30000 Million Gals/Day	Fed ID of Seller:	Not Reported
Watershed Basin:	04	Watershed Sub-basin:	00
Treatment Plant ID:	003	Date of rec Last Update:	Not Reported
Water Type:	Not Reported	Record Tag:	Existing Record

Well Within 1 - 2 Miles of Target Property (Southern Quadrant)

Public Water Supply #:	1400443	Source ID:	002
PW Supply Name:	ERIE COUNTY WATER AUTHORITY		
Source Name:	NIAGARA RIVER		
Source Description:	Surface		
Availability/Utilization:	Permanent Utilization	Source Type:	Source Record
Latitude:	425753	Longitude:	-785553
Source Prod Capacity:	50000000 Million Gals/Day	Fed ID of Seller:	Not Reported
Watershed Basin:	01	Watershed Sub-basin:	00
Treatment Plant ID:	P004	Date of rec Last Update:	19931228
Water Type:	Not Reported	Record Tag:	Not Reported

Well Within >2 Miles of Target Property (Western Quadrant)

Public Water Supply #:	1400450	Source ID:	001
PW Supply Name:	GRAND ISLAND WD #1		
Source Name:	GRAND ISLAND WATER STOR-DISTR-DIST		
Source Description:	Surface, Purchased		
Availability/Utilization:	Permanent Utilization	Source Type:	Source Record
Latitude:	425755	Longitude:	-785820
Source Prod Capacity:	999999999 Million Gals/Day	Fed ID of Seller:	Not Reported
Watershed Basin:	01	Watershed Sub-basin:	00
Treatment Plant ID:	002	Date of rec Last Update:	Not Reported
Water Type:	Not Reported	Record Tag:	Not Reported

NRG019803

GEOCHECK VERSION 2.1
PUBLIC WATER SUPPLY SYSTEM INFORMATION

Searched by Nearest Well.

PWS SUMMARY:

PWS ID: NY0000443 PWS Status: Active Distance from TP: 1 - 2 Miles
Date Initiated: Not Reported Date Deactivated: Not Reported Dir relative to TP: South
PWS Name: ERIE COUNTY WATER AUTHORITY
ELLICOTT SQUARE BUILDING
BUFFALO, NY 14203

Addressee / Facility: System Owner/Responsible Party
MOGAVERO JOHN
ERIE COUNTY WATER AUTHORITY
ELLICOTT SQUARE BLDG
BUFFALO, NY 14203

Facility Latitude: 42 41 43 Facility Longitude: 079 03 18
Facility Latitude: 42 57 53 Facility Longitude: 078 55 53
City Served: EVANS (T) Population Served: Not Reported
Treatment Class Not Reported

Well currently has or has had major violation(s): No

NRG019804

EPA Waste Codes Addendum

Code	Description
D001	IGNITABLE HAZARDOUS WASTES ARE THOSE WASTES WHICH HAVE A FLASHPOINT OF LESS THAN 140 DEGREES FAHRENHEIT AS DETERMINED BY A PENSKEY-MARTENS CLOSED CUP FLASH POINT TESTER. ANOTHER METHOD OF DETERMINING THE FLASH POINT OF A WASTE IS TO REVIEW THE MATERIAL SAFETY DATA SHEET, WHICH CAN BE OBTAINED FROM THE MANUFACTURER OR DISTRIBUTOR OF THE MATERIAL. LACQUER THINNER IS AN EXAMPLE OF A COMMONLY USED SOLVENT WHICH WOULD BE CONSIDERED AS IGNITABLE HAZARDOUS WASTE.
D002	A WASTE WHICH HAS A PH OF LESS THAN 2 OR GREATER THAN 12.5 IS CONSIDERED TO BE A CORROSIVE HAZARDOUS WASTE. SODIUM HYDROXIDE, A CAUSTIC SOLUTION WITH A HIGH PH, IS OFTEN USED BY INDUSTRIES TO CLEAN OR DEGREASE PARTS. HYDROCHLORIC ACID, A SOLUTION WITH A LOW PH, IS USED BY MANY INDUSTRIES TO CLEAN METAL PARTS PRIOR TO PAINTING. WHEN THESE CAUSTIC OR ACID SOLUTIONS BECOME CONTAMINATED AND MUST BE DISPOSED, THE WASTE WOULD BE A CORROSIVE HAZARDOUS WASTE.
D007	CHROMIUM
D008	LEAD
D009	MERCURY
D010	SELENIUM
D018	BENZENE
D028	1,2-DICHLOROETHANE
D035	METHYL ETHYL KETONE
D039	TETRACHLOROETHYLENE
F001	THE FOLLOWING SPENT HALOGENATED SOLVENTS USED IN DEGREASING: TETRACHLOROETHYLENE, TRICHLOROETHYLENE, METHYLENE CHLORIDE, 1,1,1-TRICHLOROETHANE, CARBON TETRACHLORIDE, AND CHLORINATED FLUOROCARBONS; ALL SPENT SOLVENT MIXTURES/BLENDS USED IN DEGREASING CONTAINING, BEFORE USE, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THE ABOVE HALOGENATED SOLVENTS OR THOSE SOLVENTS LISTED IN F002, F004, AND F005, AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
F002	THE FOLLOWING SPENT HALOGENATED SOLVENTS: TETRACHLOROETHYLENE, METHYLENE CHLORIDE, TRICHLOROETHYLENE, 1,1,1-TRICHLOROETHANE, CHLOROBENZENE, 1,1,2-TRICHLORO-1,2,2-TRIFLUOROETHANE, ORTHO-DICHLOROBENZENE, TRICHLOROFLUOROMETHANE, AND 1,1,2-TRICHLOROETHANE; ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THE ABOVE HALOGENATED SOLVENTS OR THOSE LISTED IN F001, F004, OR F005, AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
F003	THE FOLLOWING SPENT NON-HALOGENATED SOLVENTS: XYLENE, ACETONE, ETHYL ACETATE, ETHYL BENZENE, ETHYL ETHER, METHYL ISOBUTYL KETONE, N-BUTYL ALCOHOL, CYCLOHEXANONE, AND METHANOL; ALL SPENT SOLVENT MIXTURES/BLENDS

NRG019805

EPA Waste Codes Addendum

Code	Description
	CONTAINING, BEFORE USE, ONLY THE ABOVE SPENT NON-HALOGENATED SOLVENTS; AND ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, ONE OR MORE OF THE ABOVE NON-HALOGENATED SOLVENTS, AND, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THOSE SOLVENTS LISTED IN F001, F002, F004, AND F005, AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
F005	THE FOLLOWING SPENT NON-HALOGENATED SOLVENTS: TOLUENE, METHYL ETHYL KETONE, CARBON DISULFIDE, ISOBUTANOL, PYRIDINE, BENZENE, 2-ETHOXYETHANOL, AND 2-NITROPROPANE; ALL SPENT SOLVENT MIXTURES/BLENDS CONTAINING, BEFORE USE, A TOTAL OF TEN PERCENT OR MORE (BY VOLUME) OF ONE OR MORE OF THE ABOVE NON-HALOGENATED SOLVENTS OR THOSE SOLVENTS LISTED IN F001, F002, OR F004; AND STILL BOTTOMS FROM THE RECOVERY OF THESE SPENT SOLVENTS AND SPENT SOLVENT MIXTURES.
P022	CARBON DISULFIDE

NRG019806

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

To maintain currency of the following federal and state databases, EDR contacts the appropriate governmental agency on a monthly or quarterly basis, as required.

Elapsed ASTM days: Provides confirmation that this EDR report meets or exceeds the 90-day updating requirement of the ASTM standard.

FEDERAL ASTM RECORDS:

CERCLIS: Comprehensive Environmental Response, Compensation, and Liability Information System

Source: EPA/NTIS

Telephone: 703-413-0223

CERCLIS: CERCLIS contains data on potentially hazardous waste sites that have been reported to the USEPA by states, municipalities, private companies and private persons, pursuant to Section 103 of the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA). CERCLIS contains sites which are either proposed to or on the National Priorities List (NPL) and sites which are in the screening and assessment phase for possible inclusion on the NPL.

Date of Government Version: 04/30/97

Date Made Active at EDR: 06/30/97

Database Release Frequency: Monthly

Date of Data Arrival at EDR: 05/19/97

Elapsed ASTM days: 42

Date of Last EDR Contact: 08/22/97

ERNS: Emergency Response Notification System

Source: EPA/NTIS

Telephone: 202-260-2342

ERNS: Emergency Response Notification System. ERNS records and stores information on reported releases of oil and hazardous substances.

Date of Government Version: 03/01/97

Date Made Active at EDR: 06/24/97

Database Release Frequency: Quarterly

Date of Data Arrival at EDR: 04/10/97

Elapsed ASTM days: 75

Date of Last EDR Contact: 08/26/97

NPL: National Priority List

Source: EPA

Telephone: 703-603-8852

NPL: National Priorities List (Superfund). The NPL is a subset of CERCLIS and identifies over 1,200 sites for priority cleanup under the Superfund Program. NPL sites may encompass relatively large areas. As such, EDR provides polygon coverage for over 1,000 NPL site boundaries produced by EPA's Environmental Photographic Interpretation Center (EPIC).

Date of Government Version: 04/01/97

Date Made Active at EDR: 05/29/97

Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 04/21/97

Elapsed ASTM days: 38

Date of Last EDR Contact: 07/01/97

RCRIS: Resource Conservation and Recovery Information System

Source: EPA/NTIS

Telephone: 800-424-9346

RCRIS: Resource Conservation and Recovery Information System. RCRIS includes selective information on sites which generate, transport, store, treat and/or dispose of hazardous waste as defined by the Resource Conservation and Recovery Act (RCRA).

Date of Government Version: 04/01/97

Date Made Active at EDR: 06/30/97

Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 04/25/97

Elapsed ASTM days: 66

Date of Last EDR Contact: 08/04/97

CORRACTS: Corrective Action Report

Source: EPA

Telephone: 800-424-9346

CORRACTS: CORRACTS identifies hazardous waste handlers with RCRA corrective action activity.

Date of Government Version: 12/01/96

Date Made Active at EDR: 03/03/97

Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 12/30/96

Elapsed ASTM days: 63

Date of Last EDR Contact: 07/07/97

NRG019807

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

FEDERAL NON-ASTM RECORDS:

BRS: Biennial Reporting System

Source: EPA/NTIS

Telephone: 800-424-9346

BRS: The Biennial Reporting System is a national system administered by the EPA that collects data on the generation and management of hazardous waste. BRS captures detailed data from two groups: Large Quantity Generators (LQG) and Treatment, Storage, and Disposal Facilities.

Date of Government Version: 12/31/93

Database Release Frequency: Biennially

Date of Last EDR Contact: 08/04/97

Date of Next Scheduled EDR Contact: 09/22/97

CONSENT: Superfund (CERCLA) Consent Decrees

Source: EPA Regional Offices

Telephone: Varies

Major legal settlements that establish responsibility and standards for cleanup at NPL (Superfund) sites. Released periodically by United States District Courts after settlement by parties to litigation matters.

Date of Government Version: Varies

Database Release Frequency: Varies

Date of Last EDR Contact: Varies

Date of Next Scheduled EDR Contact: N/A

FINDS: Facility Index System

Source: EPA/NTIS

Telephone: 703-908-2493

FINDS: Facility Index System. FINDS contains both facility information and "pointers" to other sources that contain more detail. EDR includes the following FINDS databases in this report: PCS (Permit Compliance System), AIRS (Aerometric Information Retrieval System), DOCKET (Enforcement Docket used to manage and track information on civil judicial enforcement cases for all environmental statutes), FURS (Federal Underground Injection Control), C-DOCKET (Criminal Docket System used to track criminal enforcement actions for all environmental statutes), FFIS (Federal Facilities Information System), STATE (State Environmental Laws and Statutes), and PADS (PCB Activity Data System).

Date of Government Version: 09/30/95

Database Release Frequency: Quarterly

Date of Last EDR Contact: 08/22/97

Date of Next Scheduled EDR Contact: 11/04/97

HMIRS: Hazardous Materials Information Reporting System

Source: U.S. Department of Transportation

Telephone: 202-366-4526

HMIRS: Hazardous Materials Incident Report System. HMIRS contains hazardous material spill incidents reported to DOT.

Date of Government Version: 12/31/95

Database Release Frequency: Annually

Date of Last EDR Contact: 07/28/97

Date of Next Scheduled EDR Contact: 10/27/97

MLTS: Material Licensing Tracking System

Source: Nuclear Regulatory Commission

Telephone: 301-415-7169

MLTS is maintained by the Nuclear Regulatory Commission and contains a list of approximately 8,100 sites which possess or use radioactive materials and which are subject to NRC licensing requirements. To maintain currency, EDR contacts the Agency on a quarterly basis.

Date of Government Version: 01/15/97

Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/14/97

Date of Next Scheduled EDR Contact: 10/13/97

NPL LIENS: Federal Superfund Liens

Source: EPA

Telephone: 205-564-4267

NPL LIENS: Federal Superfund Liens. Under the authority granted the USEPA by the Comprehensive Environmental Response, Compensation and Liability Act (CERCLA) of 1980, the USEPA has the authority to file liens against real property in order to recover remedial action expenditures or when the property owner receives notification of potential liability. USEPA compiles a listing of filed notices of Superfund Liens.

Date of Government Version: 10/15/91

Database Release Frequency: No Update Planned

Date of Last EDR Contact: 08/25/97

Date of Next Scheduled EDR Contact: 11/24/97

NRG019808

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

PADS: PCB Activity Database System

Source: EPA

Telephone: 202-260-3936

PADS: PCB Activity Database. PADS identifies generators, transporters, commercial storers and/or brokers and disposers of PCB's who are required to notify the EPA of such activities.

Date of Government Version: 01/27/97

Database Release Frequency: Semi-Annually

Date of Last EDR Contact: 08/19/97

Date of Next Scheduled EDR Contact: 11/17/97

RAATS: RCRA Administrative Action Tracking System

Source: EPA

Telephone: 202-564-4104

RAATS: RCRA Administration Action Tracking System. RAATS contains records based on enforcement actions issued under RCRA pertaining to major violators and includes administrative and civil actions brought by the EPA. For administration actions after September 30, 1995, data entry in the RAATS database was discontinued. EPA will retain a copy of the database for historical records. It was necessary to terminate RAATS because a decrease in agency resources made it impossible to continue to update the information contained in the database.

Date of Government Version: 04/17/95

Database Release Frequency: No Update Planned

Date of Last EDR Contact: 07/01/97

Date of Next Scheduled EDR Contact: 09/15/97

ROD: Records Of Decision

Source: NTIS

Telephone: 703-416-0223

Record of Decision. ROD documents mandate a permanent remedy at an NPL (Superfund) site containing technical and health information to aid in the cleanup.

Date of Government Version: 03/31/95

Database Release Frequency: Annually

Date of Last EDR Contact: 09/03/97

Date of Next Scheduled EDR Contact: 12/01/97

TRIS: Toxic Chemical Release Inventory System

Source: EPA/NTIS

Telephone: 202-260-1531

TRIS: Toxic Release Inventory System. TRIS identifies facilities which release toxic chemicals to the air, water and land in reportable quantities under SARA Title III Section 313.

Date of Government Version: 12/31/92

Database Release Frequency: Annually

Date of Last EDR Contact: 07/02/97

Date of Next Scheduled EDR Contact: 09/29/97

TSCA: Toxic Substances Control Act

Source: EPA/NTIS

Telephone: 202-260-1444

TSCA: Toxic Substances Control Act. TSCA identifies manufacturers and importers of chemical substances included on the TSCA Chemical Substance Inventory list. It includes data on the production volume of these substances by plant site. USEPA has no current plan to update and/or re-issue this database.

Date of Government Version: 01/31/95

Database Release Frequency: Annually

Date of Last EDR Contact: 06/16/97

Date of Next Scheduled EDR Contact: 09/15/97

NRG019809

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

STATE OF NEW YORK ASTM RECORDS:

LUST: Spills Information Database

Source: Department of Environmental Conservation
Telephone: 518-457-2462

LUST: Leaking Underground Storage Tank Incident Reports. LUST records contain an inventory of reported leaking underground storage tank incidents. Not all states maintain these records, and the information stored varies by state.

Date of Government Version: 12/31/96
Date Made Active at EDR: 04/21/97
Database Release Frequency: Quarterly

Date of Data Arrival at EDR: 02/12/97
Elapsed ASTM days: 68
Date of Last EDR Contact: 07/28/97

SHWS: Inactive Hazardous Waste Disposal Sites in New York State

Source: Department of Environmental Conservation
Telephone: 518-457-0747

SHWS: State Hazardous Waste Sites. State hazardous waste site records are the states' equivalent to CERCLIS. These sites may or may not already be listed on the federal CERCLIS list. Priority sites planned for cleanup using state funds (state equivalent of Superfund) are identified along with sites where cleanup will be paid for by potentially responsible parties. Available information varies by state.

Date of Government Version: 04/30/96
Date Made Active at EDR: 06/06/96
Database Release Frequency: Annually

Date of Data Arrival at EDR: 05/06/96
Elapsed ASTM days: 31
Date of Last EDR Contact: 08/11/97

SWF/LF: Facility Register

Source: Department of Environmental Conservation
Telephone: 518-457-2051

SWF/LF: Solid Waste Facilities/Landfill Sites. SWF/LF type records typically contain an inventory of solid waste disposal facilities or landfills in a particular state. Depending on the state, these may be active or inactive facilities or open dumps that failed to meet RCRA Subtitle D Section 4004 criteria for solid waste landfills or disposal sites.

Date of Government Version: 12/31/96
Date Made Active at EDR: 04/21/97
Database Release Frequency: Semi-Annually

Date of Data Arrival at EDR: 02/20/97
Elapsed ASTM days: 60
Date of Last EDR Contact: 08/11/97

UST: Petroleum Bulk Storage (PBS, CBS, MOSF) Database (UST)

Source: Department of Environmental Conservation
Telephone: 518-457-4351

UST: Registered Underground Storage Tanks. UST's are regulated under Subtitle I of the Resource Conservation and Recovery Act (RCRA) and must be registered with the state department responsible for administering the UST program. Available information varies by state program.

Date of Government Version: 12/31/96
Date Made Active at EDR: 04/07/97
Database Release Frequency: Quarterly

Date of Data Arrival at EDR: 02/18/97
Elapsed ASTM days: 48
Date of Last EDR Contact: 08/04/97

STATE OF NEW YORK NON-ASTM RECORDS:

AST: Petroleum Bulk Storage (AST)

Source: Department of Environmental Conservation
Telephone: 518-457-4351

AST: Registered Aboveground Storage Tanks.

Date of Government Version: 09/30/96
Database Release Frequency: Quarterly

Date of Last EDR Contact: 08/04/97
Date of Next Scheduled EDR Contact: 11/03/97

SPILLS: Spills Information Database

Source: Department of Environmental Conservation
Telephone: 518-457-2462

SPILLS: Data collected on spills reported to NYSDEC as required by one or more of the following: Article 12 of the Navigation Law, 6 NYCRR Section 613.8 (from PBS regs), or 6 NYCRR Section 595.2 (from CBS regs). It includes spills active as of April 1, 1986, as well as spills occurring since this date.

Date of Government Version: 12/31/96
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/28/97
Date of Next Scheduled EDR Contact: 10/27/97

NRG019810

GOVERNMENT RECORDS SEARCHED / DATA CURRENCY TRACKING

NEW YORK COUNTY RECORDS

CORTLAND COUNTY:

Cortland County UST Listing (AST)

Source: Cortland County Health Department
Telephone: 607-753-5035

Date of Government Version: 03/25/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

Cortland County UST Listing (UST)

Source: Cortland County Health Department
Telephone: 607-753-5035

Date of Government Version: 06/20/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

NASSAU COUNTY:

NCPHO Article XI Database (AST)

Source: Nassau County Health Department
Telephone: 516-571-3314

Date of Government Version: 12/01/96
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/03/97
Date of Next Scheduled EDR Contact: 10/06/97

NCPHO Article XI Database (UST)

Source: Nassau County Health Department
Telephone: 516-571-3314

Date of Government Version: 02/04/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 07/08/97
Date of Next Scheduled EDR Contact: 10/06/97

ROCKLAND COUNTY:

Petroleum Bulk Storage Database (AST)

Source: Rockland County Health Department
Telephone: 914-364-2605

Date of Government Version: 03/28/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

Petroleum Bulk Storage Database (UST)

Source: Rockland County Health Department
Telephone: 914-364-2605

Date of Government Version: 06/01/97
Database Release Frequency: Quarterly

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

SUFFOLK COUNTY:

Underground Storage Tank Database (AST)

Source: Suffolk County Department of Health Services
Telephone: 516-854-2521

Date of Government Version: 03/01/96
Database Release Frequency: Annually

Date of Last EDR Contact: 09/08/97
Date of Next Scheduled EDR Contact: 12/08/97

NRG019811